

STATE OF TEXAS  
DEPARTMENT OF TRANSPORTATION

PLANS OF PROPOSED  
STATE HIGHWAY IMPROVEMENT

PROJECT NO. BR 2022(281)

TRINITY ST AT TOWN BRANCH  
MADISON COUNTY

NET LENGTH OF PROJECT: 325.00 FT = 0.061 MI

FOR THE CONSTRUCTION OF BRIDGE REPLACEMENT.  
CONSISTING OF REPLACING BRIDGE AND APPROACHES & GRADING.

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	1

SEE SHEET 2  
PROJECT LOCATION MAP  
AND SHEET 3 FOR  
INDEX OF SHEETS

FINAL PLANS

CONTRACTOR:  
LETTING DATE:  
DATE CONTRACTOR BEGAN WORK:  
DATE WORK WAS COMPLETED:  
DATE WORK WAS ACCEPTED:  
FINAL CONTRACT COST: \$

LOCATION NO.	HIGHWAY	CSJ	LIMITS	ADT	DESIGN SPEED (MPH)	STATION		ROADWAY LENGTH (FT)	BRIDGE LENGTH (FT)	TOTAL LENGTH (FT)
						FROM	TO			
1	TRINITY ST	0917-31-031	TRINITY ST AT TOWN BRANCH STR: 17-154-0-B003-25-101	2021: 56 2041: 56	MEETS OR EXCEEDS EXISTING	103+00.00	106+25.00	276.86	48.14	325.00

THESE DOCUMENTS WERE PREPARED BY OR UNDER THE SUPERVISION OF:


J. M. F. 4/18/2023  
JAMIE M. FURNEY, P.E. DATE



JACOBS ENGINEERING GROUP INC. FIRM #2966  
2705 BEE CAVE ROAD, SUITE 300  
AUSTIN, TEXAS 78746  
(512) 314-3100 FAX (512) 314-3135

SPECIFICATIONS ADOPTED BY THE TEXAS DEPARTMENT OF TRANSPORTATION, NOVEMBER 1, 2014 AND SPECIFICATION ITEMS INCLUDED IN THE CONTRACT, SHALL GOVERN ON THIS PROJECT: REQUIRED CONTRACT PROVISIONS FOR ALL FEDERAL AID CONSTRUCTION CONTRACTS (FORM FHWA 1273, JUL 05, 2022)

NO EXCEPTIONS  
NO EQUATIONS  
NO RAILROAD CROSSINGS




TEXAS DEPARTMENT OF TRANSPORTATION®

SUBMITTED FOR LETTING: 5/1/2023  
Designed by: [Signature]  
01EBC5C05E934CE  
BRIDGE ENGINEER

RECOMMENDED FOR DESIGN: 5/1/2023  
Designed by: [Signature]  
DAA3B0624EE3419  
DIRECTOR OF TRANSPORTATION  
PLANNING AND DEVELOPMENT



APPROVED FOR DESIGN: 5/1/2023  
Designed by: [Signature]  
60E5537715D24EA  
DISTRICT ENGINEER

TRINITY ST AT TOWN BRANCH  
 CSJ: 0917-31-031  
 BEGIN PROJECT STA. 103+00.00  
 EXISTING STRUCTURE  
 NBI #: 17-154-0-B003-25-001  
 PROPOSED STRUCTURE  
 NBI#: 17-154-0-B003-25-101  
 END PROJECT STA. 106+25.00

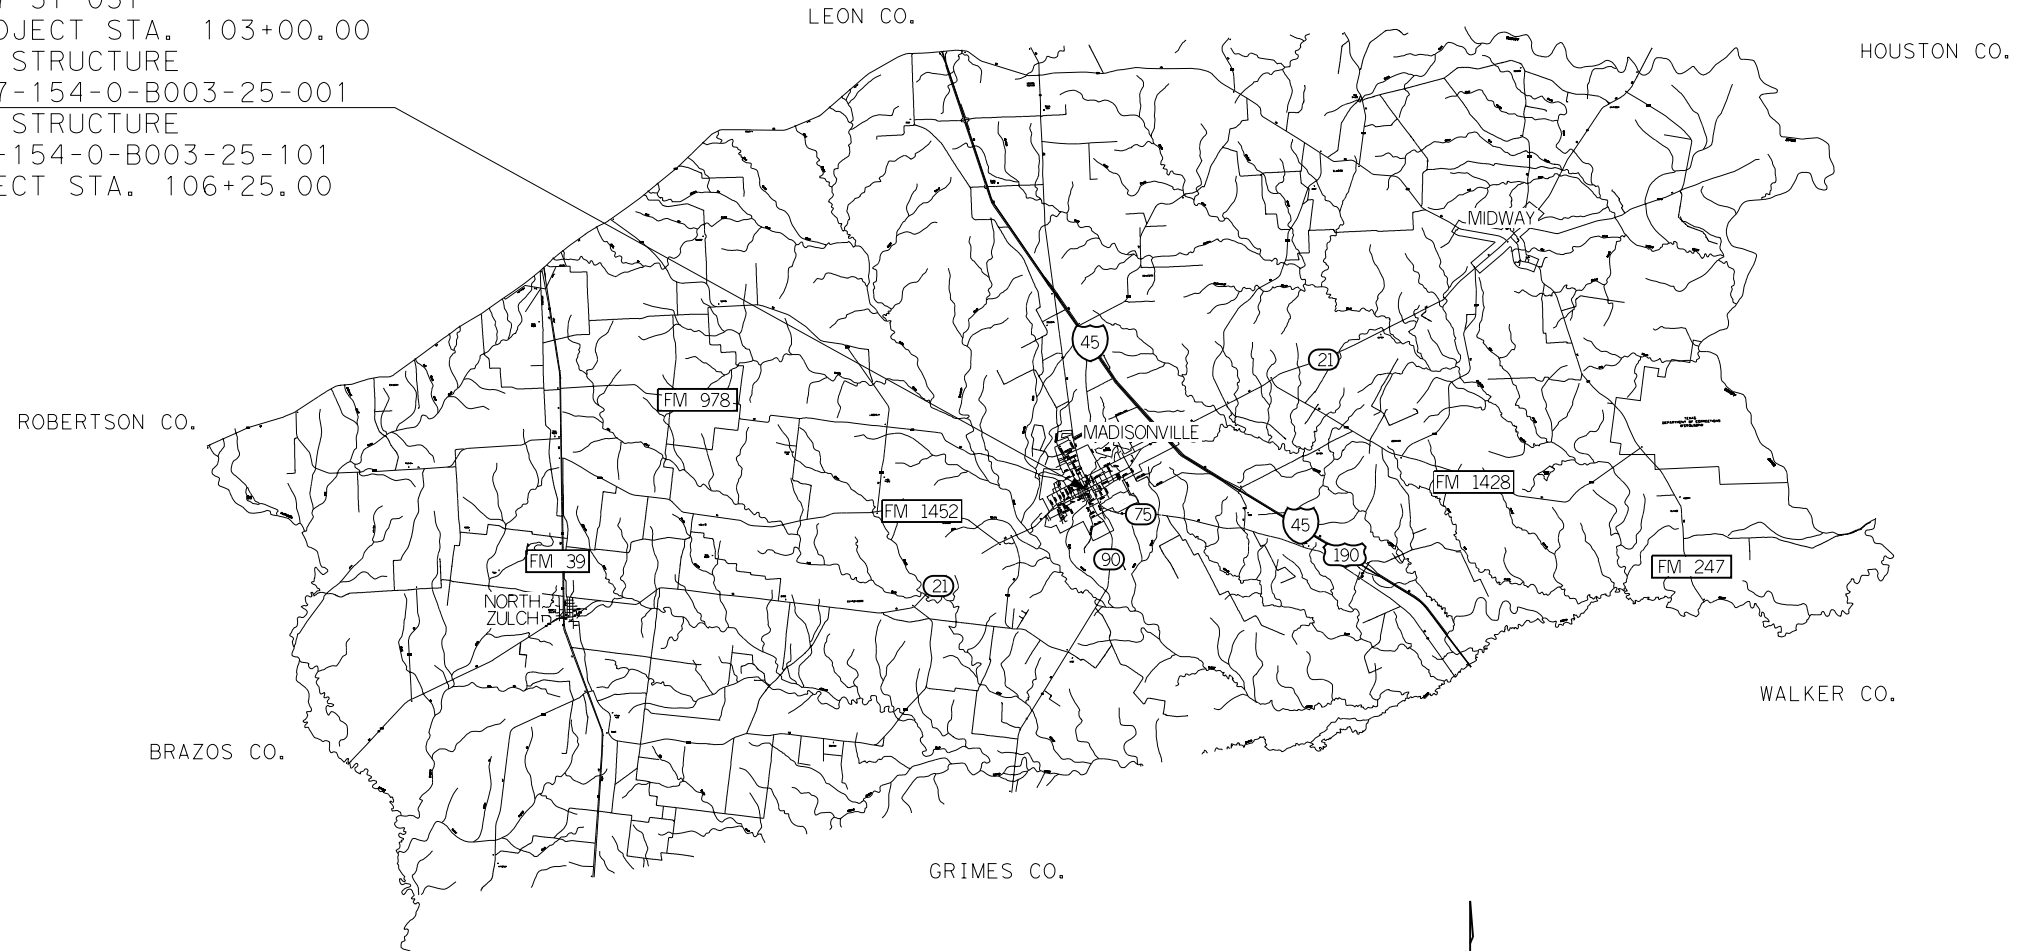


MADISON COUNTY  
 SCALE N. T. S.

PROJECT LAYOUT : NTS

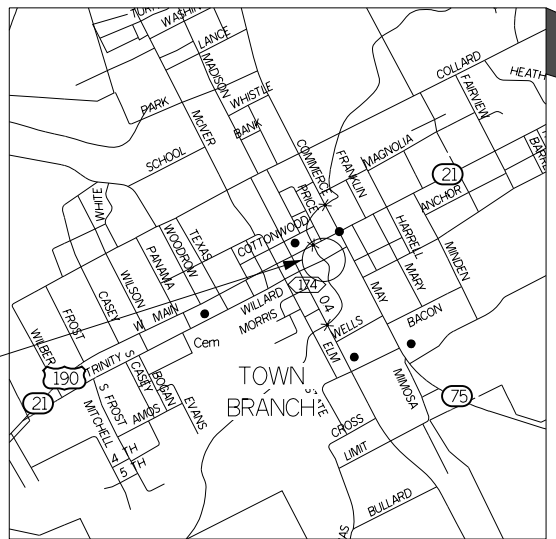

LOCATION OF  
 BRIDGE AT  
 TOWN BRANCH

TRINITY ST AT TOWN BRANCH  
 LOCATION DETAIL  
 SCALE N. T. S.

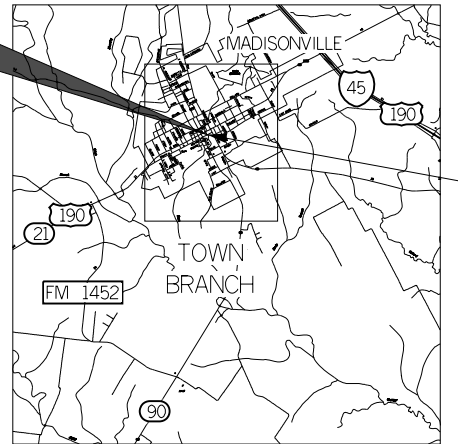

PROJECT LOCATION  
 TRINITY ST AT TOWN BRANCH

MADISON COUNTY PROJECT  
 TRINITY ST AT TOWN BRANCH LOCATION  
 SCALE N. T. S.

Drawings Not To Scale

PRINT DATE	REVISION DATE
3/30/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



PROJECT LOCATION MAP

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	2

REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: p:\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\91731031\_Trinity St\700 CADD\SHIT\GENRL\TRINITY ST\_PROJ\_LOC\_MAP\_01


REV DATE: 2-12-2015  
 CSJ: 0917-31-4031  
 FILENAME: .pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity St\700 CADD\SHIT\GENRL\TRINITY ST\_INDEX\_01.dgn

<u>SHEET</u>	<u>DESCRIPTION</u>
	<u>GENERAL</u>
1	TITLE SHEET
2	PROJECT LOCATION MAP
3	INDEX OF SHEETS
4	EXISTING TYPICAL SECTIONS
5	PROPOSED TYPICAL SECTIONS
6 - 6B	GENERAL NOTES
7	ESTIMATE AND QUANTITIES
	<u>QUANTITY SUMMARY SHEETS</u>
8	ROADWAY & TCP SUMMARY
9	DRAINAGE SUMMARY
10	SUMMARY OF SW3P QUANTITIES
	<u>TRAFFIC CONTROL PLAN</u>
11	TRAFFIC CONTROL PLAN & SEQUENCE OF CONSTRUCTION
	<u>TRAFFIC CONTROL PLAN STANDARDS</u>
11A - 11L	BC (1) - (12) - 21*
12	TREATMENT FOR VARIOUS EDGE CONDITIONS
	<u>ROADWAY</u>
13 - 14	SURVEY CONTROL
15	HORIZONTAL ALIGNMENT DATA
16	PLAN AND PROFILE
17	SIGNS AND OBJECT MARKERS
	<u>ROADWAY STANDARDS</u>
18	MBGF (SR) - 19*
19	RAIL - ADJ (A) - 19*
20	RAIL - ADJ (B) - 19*
21	MBGF - 19*
22	GF (31) - 19*
23	D&OM (1) - 20*
24	D&OM (2) - 20*
25	D&OM (3) - 20*
26	D&OM (5) - 20*
	<u>DRAINAGE</u>
27	DRAINAGE AREA MAP
28	HYDRAULIC DATA SHEET
29	BRIDGE CLASS CULVERT 01
	<u>DRAINAGE STANDARDS</u>
30	SCC - MD*
31 - 33	SCC - 10*
34	SCP - MD*
35	SCP - 10*
36	ECD*
37	BCS*
38	PW*
39	SETP - PD*
40 - 41	SRR*
42 - 43	T631*
	<u>SW3P</u>
44 - 45	STORM WATER POLLUTION PREVENTION PLAN (SW3P)
46	EPIC
47	SW3P LAYOUT
	<u>SW3P STANDARDS</u>
48	EC (1) - 16*
49	EC (2) - 16*

\* THE STANDARD SPECIFICALLY IDENTIFIED HAVE BEEN SELECTED BY ME OR UNDER MY RESPONSIBLE SUPERVISION AS BEING APPLICABLE TO THIS PROJECT.

JAMIE M. FURNEY, P. E.

4/28/2023



PRINT DATE	REVISION DATE
4/28/2023	


**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966




## INDEX OF SHEETS

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	3

REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: .pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\1731031\_Trinity St\700\_CADD\SHTRD\WJXN4000\TRINITY ST\_TYPSECT01

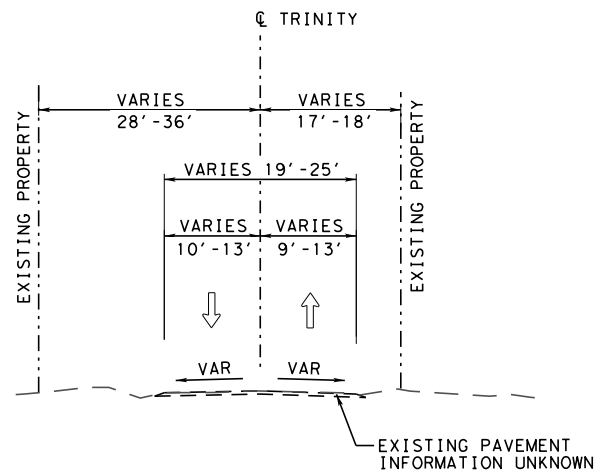

**EXISTING TRINITY ST TYPICAL**  
 N. T. S.

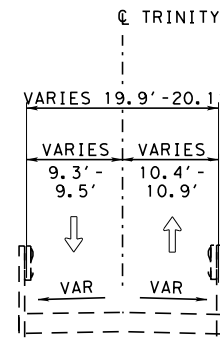

**EXISTING TRINITY ST (BRIDGE) TYPICAL**  
 STA 104+23.15 TO STA 104+62.35  
 N. T. S.



3/30/2023

*J. Alchevsky*

Drawings Not To Scale  
 PRINT DATE: 3/30/2023  
 REVISION DATE:


**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966




**EXISTING TYPICAL SECTIONS**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	4


REV DATE: 2-12-2015  
 CSJ: 0917-31-4031  
 FILENAME: \_pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\1731031\_Trinity St\_TYPSECT02.dgn

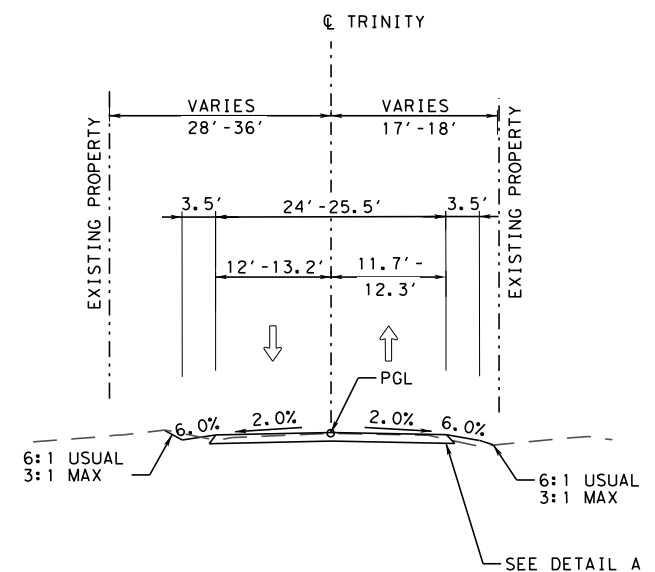


**PROPOSED TRINITY ST TYPICAL**  
 STA 103+00.00 TO STA 103+50.00  
 STA 105+75.00 TO STA 106+25.00  
 N. T. S.

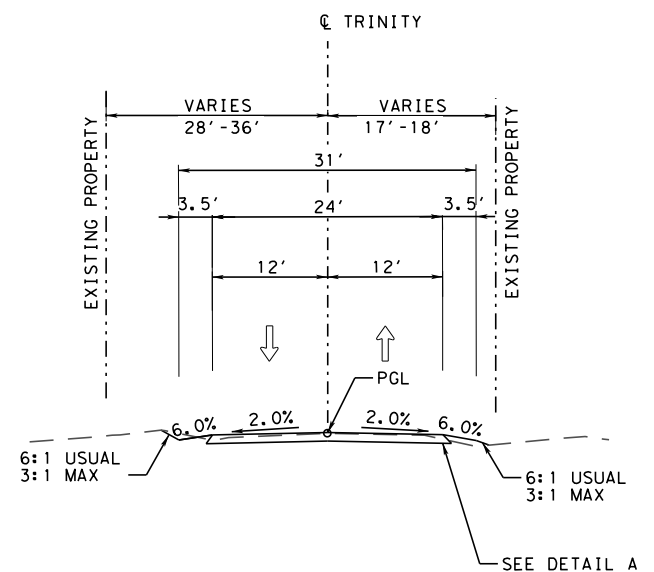

**PROPOSED TRINITY ST TYPICAL**  
 STA 103+50.00 TO STA 104+20.93  
 STA 104+69.07 TO STA 105+75.00  
 N. T. S.

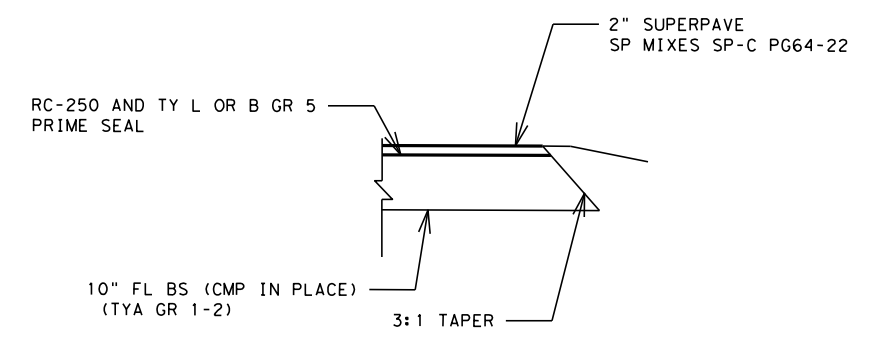

**DETAIL "A"**  
 N. T. S.

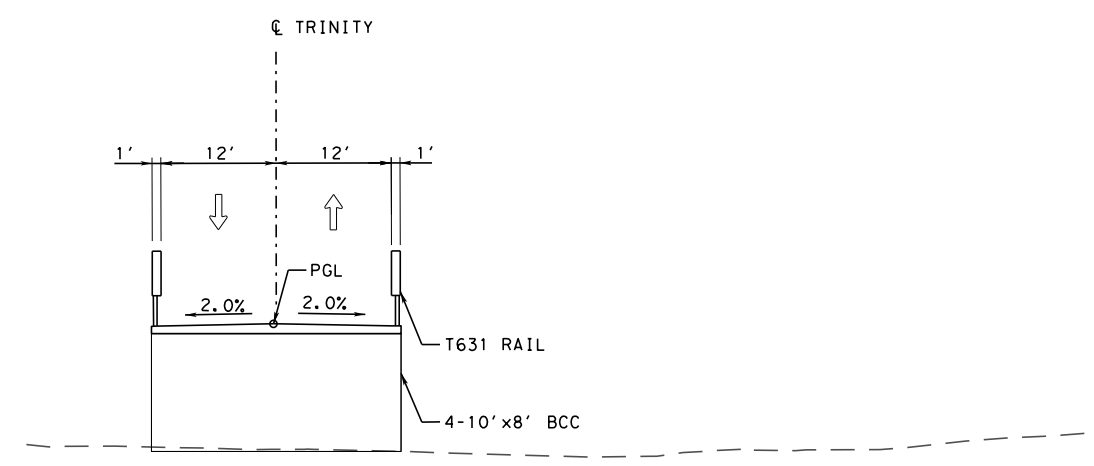

**PROPOSED TRINITY ST (BRIDGE CLASS CULVERT) TYPICAL**  
 STA 104+20.93 TO STA 104+69.07  
 N. T. S.



3/30/2023  
 Drawings Not to Scale

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



**PROPOSED TYPICAL SECTIONS**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	5

**Project Number:**  
**Highway:** Trinity St  
**County:** Madison

**Sheet:** 6  
**Control:** 0917-31-031

**Project Number:**  
**Highway:** Trinity St  
**County:** Madison

**Sheet:** 6  
**Control:** 0917-31-031

BASIS OF ESTIMATE					
ITEM	DESCRIPTION	COURSE	RATE	AMOUNT	QUANTITY
316	ASPH (RC-250)	PRIME SEAL	0.25 GAL/SY	780 SY	195 GAL
316	AGGR (TY-B GR-5 OR TY-L GR-5)	PRIME SEAL	1 CY/135SY	780 SY	6 CY
3077	SP MIXES SP-C PG64-22	HOT MIX	330 LB/SY	760 SY	125 TON

(1) PFC estimated at 93 LB/SY/IN, consisting of 6.3% asphalt and 93.7% aggregate by weight.  
Note: Rates are for estimating purposes only. Actual Rates will be determined in the field.

#### GENERAL:

Contractor questions on this project are to be addressed to the following individuals:  
Delmy Reyes, P.E., A.E., [Delmy.Reyes@txdot.gov](mailto:Delmy.Reyes@txdot.gov)  
Matt Hensarling, P.E., A.A.E., [Matt.Hensarling@txdot.gov](mailto:Matt.Hensarling@txdot.gov)

Questions may be submitted via the Letting Pre-Bid Q&A web page. This webpage can be accessed from the Notice to Contractors dashboard located at the following address:  
<https://tableau.txdot.gov/views/ProjectInformationDashboard/NoticetoContractors>

All contractor questions will be reviewed by the Engineer. All questions and any corresponding responses that are generated will be posted through the same Letting Pre-Bid Q&A web page.

The Letting Pre-Bid Q&A web page for each project can be accessed by using the dashboard to navigate to the project you are interested in by scrolling or filtering the dashboard using the controls on the left. Hover over the blue hyperlink for the project you want to view the Q&A for and click on the link in the window that pops up.

For non-bridge items, send eligible shop plan submittals with PDF attachments directly to the reviewing office. Submit bridge, retaining wall, and structural item shop drawings following the directions described at  
<http://www.txdot.gov/business/resources/specifications/shop-drawings.html>

#### ITEM 5 “CONTROL OF THE WORK”

Prior to letting, earthwork construction cross-section data is available at the Area Engineer’s office in **Huntsville** for inspection by prospective bidders. In addition, bidders may request electronic earthwork construction cross-section data by sending an email to:  
[Delmy.Reyes@txdot.gov](mailto:Delmy.Reyes@txdot.gov) or [Matt.Hensarling@txdot.gov](mailto:Matt.Hensarling@txdot.gov)

Earthwork files will be provided by email or by using TxDOT’s Dropbox FTP Service. These cross-sections are for non-construction purposes only, and it is the responsibility of the prospective bidder to validate the data for this project.

After letting, the Engineer will provide final earthwork construction cross-section data necessary for the contractor to establish and control the work.

When a precast or cast-in-place concrete element is included in the plans, a precast concrete alternate may be submitted in accordance with “Standard Operating Procedure for Alternate Precast Proposal Submission” found online at <https://www.txdot.gov/inside-txdot/forms-publications/consultants-contractors/publications/bridge.html#design>. Acceptance or denial of an alternate is at the sole discretion of the Engineer. Impacts to the project schedule and any additional costs resulting from the use of alternates are the sole responsibility of the Contractor.

#### ITEM 6 “BUY AMERICA”

To comply with the latest provisions of Build America, Buy America Act (BABA Act) of the Bipartisan Infrastructure Law, the contractor must submit a notarized original of the TxDOT Construction Material Buy America Certification Form for all items classified as construction materials. This form is not required for materials classified as a manufactured product.

Refer to the Buy America Material Classification Sheet for clarification on material categorization.

The Buy America Material Classification Sheet is located at the below link.

<https://www.txdot.gov/business/resources/materials/buy-america-material-classification-sheet.html> for clarification on material categorization.

#### ITEM 7 “LEGAL RELATIONS AND RESPONSIBILITIES”

In the event of the declaration of a hurricane watch, warning, other severe weather warning or national or state emergency that requires the roadways in the vicinity be used as evacuation routes, cease all work that requires the Contractor’s, sub-contractors’ or material suppliers’ vehicles to enter the stream of traffic on these primary or secondary evacuation routes. This work includes material hauling and delivery, and mobilization or demobilization of equipment.

The following roadways are recognized evacuation routes in the Bryan District:

Primary Evacuation Routes: IH 45, US 290, SH 6, SH 36.

Secondary Evacuation Routes: US 79, US 84, SH 7, SH 30, SH 21, SH 105.

**Project Number:**  
**Highway:** Trinity St  
**County:** Madison

**Sheet:** 6A  
**Control:** 0917-31-031

**Project Number:**  
**Highway:** Trinity St  
**County:** Madison

**Sheet:** 6A  
**Control:** 0917-31-031

Other routes may be designated.

- No significant traffic generator events identified.

#### **ITEM 8 “PROSECUTION AND PROGRESS”**

By noon of each Wednesday, provide the Engineer a written outline of the daily work schedule for the following week. Include in the outline the times and places for proposed traffic control changes, lane and shoulder closures, and moving operations or other operations that affect traffic on the roadway. Unless otherwise authorized by the Engineer, prosecute the work on this project in accordance with the following sequence of work:

- 1) Place advanced signing and barricades. Set up detour and place SW3P devices.
- 2) Close roadway then demolish existing bridge and remove stabilized base. Construct new culvert and full depth reconstruct proposed roadway. Return right of way to previous conditions.
- 3) Install attenuators, grade channel, and construct riprap. Place permanent signs, and object markers. Remove temporary SW3P devices and install permanent SW3P components. Stabilize disturbed soil (permanent).
- 4) Final cleanup.

A minimum clear distance of 10ft must be maintained from overhead utility lines when they are energized.

Some of these operations may be performed simultaneously.

Prepare Progress Schedule Bar Chart.

Equipment and material may be pre-staged at approved locations.

The 90-day delayed start allowed after authorization under SP008-003 is for Contractor time for material acquisition.

#### **ITEM 100 “PREPARING RIGHT OF WAY”**

During burn bans obtain written approval from the Commissioners Court prior to burning brush.

Prevent ashes from burned vegetation to be transported into any stream.

If burning is not allowed, all trees and brush will be disposed of by shredding, logging or other methods approved by the Engineer. Create a windrow, stockpile, or topdress biomass on disturbed areas along the project at locations approved by necessary permits and the Engineer.

#### **ITEM 132 “EMBANKMENT”**

Provide Embankment material for areas within the limits of the Pavement Structure that meet one of the following requirements:

- Sources outside the ROW provide material with a plasticity index between 10 and 25 and with less than 25% silt.
- Sources within the ROW provide material with a plasticity index between 10 and 25 and with less than 25% silt.

Provide Embankment material for areas outside the limits of the Pavement Structure with a plasticity index between 10 and 35.

#### **ITEM 247 “FLEXIBLE BASE”**

Place flexible base in equal lifts of 4 to 8 in. in depth unless otherwise approved by the Engineer. Use ordinary compaction.

#### **ITEM 316 “SEAL COAT”**

When placing surface treatment on base material, prepare surface by sweeping or other approved methods. Before applying bituminous material, lightly sprinkle the surface with water. When directed, sweep the surface after sprinkling with water. Do not apply bituminous material when water is puddling on the surface.

Sweep excess aggregate no sooner than 2 hours after rolling or as directed.

Vehicles used to haul aggregate from the stockpile to the chip spreader will not be overloaded. Any damage to the roadway caused by the vehicles will be repaired by the Contractor at his expense and subsequent loads will be reduced so as not to cause further damage.

Transverse variance rates shall be used as directed. The nozzles outside the wheel paths will output up to 20% more asphalt by volume than the nozzles over the wheel paths.

The Contractor may be required to furnish and set string line to insure straight and uniform alignment as directed by the Engineer. The Contractor may use other methods subject to approval of the Engineer.

**Project Number:**  
**Highway:** Trinity St  
**County:** Madison

**Sheet:** 6B  
**Control:** 0917-31-031

Air and surface temperature for asphalt material application will be in accordance with the specification and the manufacturer's recommendation. However, the engineer may limit the use of an asphalt material due to the time of year.

#### **ITEM 462 "CONCRETE BOX CULVERTS AND DRAINS"**

Do not use cast-in-place box culverts.

#### **ITEM 496 "REMOVING STRUCTURES"**

Notify the Engineer of the exact date of bridge removal at least twenty (20) working days prior to the removal of the existing structure to allow for compliance with the Texas Department of State Health Services requirements for structural demolition. Bridge removal will not be allowed to take place until this notice is given.

The structure(s) to be removed have surface coatings which may contain hazardous materials. Provide for the safety and health of employees and abide by all OSHA Standards and Regulations.

Paint chips from the existing bridge were analyzed and found to exhibit a low to moderate probability of containing lead. Tests suggest that waste generated by the complete removal of this paint system will be classified as hazardous. The Department will provide for a separate contractor to remove paint prior to dismantling of the steel. The Contractor will coordinate with the Department the timing of the structure removal in order to allow the Department sufficient time to schedule work with the separate contractor. The Contractor will clearly indicate the locations on site that will require paint removal in accordance with Item 6.

Store the following items to be salvaged at a location designated by the Engineer: All steel material including railing, deck and flatcar.

#### **ITEM 502 "BARRICADES, SIGNS AND TRAFFIC HANDLING"**

Barricades and detour signs are provided by the City of Madisonville.

The Contractor Force Account "Safety Contingency" that has been established for this project is intended to be utilized for work zone enhancements, to improve the effectiveness of the Traffic Control Plan, that could not be foreseen in the project planning and design stage. These enhancements will be mutually agreed upon by the Engineer and the Contractor's Responsible Person based on weekly or more frequent traffic management reviews on the project. The

**Project Number:**  
**Highway:** Trinity St  
**County:** Madison

**Sheet:** 6B  
**Control:** 0917-31-031

Engineer may choose to use existing bid items if it does not slow the implementation of enhancement.

#### **ITEM 644 "SMALL ROADSIDE SIGN ASSEMBLIES"**

Salvage and deliver all aluminum sign faces to Madison County.

#### **ITEM 3077 "SUPERPAVE MIXTURES"**

<b>Hamburg Wheel Test Requirements</b>			
<b>High-Temperature Binder Grade</b>	<b>Test Method</b>	<b>Laboratory Mixture Design or Trial Batch</b>	<b>Production and Placement Test<sup>1</sup></b>
		<b>Minimum # of Passes @ 0.5" Rut Depth, Tested @122°F</b>	<b>Minimum # of Passes @ 0.5" Rut Depth, Tested @122°F</b>
PG 64 or lower	Tex-242-F	7,000	7,000

<sup>1</sup> The Engineer may accept if no more than 1 of the 5 most recent Hamburg Wheel tests is below the specified number of passes and the failing test is no more than 2,000 passes below the specified number of passes.

Add one (1.0) percent hydrated lime, commercial lime slurry, or an equivalent anti-stripping agent, based on the total aggregate weight, as mix enhancer for all mixture types unless otherwise approved by the Engineer. Provide hydrated lime or commercial lime slurry in accordance with DMS-6350, "Lime and Lime Slurry". Add hydrated lime, commercial lime slurry, or an equivalent anti-stripping agent in accordance with Section 301.4.2.

Apply tack coat through a distributor spray bar in accordance with Section 316.3.1. Distributor. If residual from emulsion tack is not tacky, then the Engineer can require the use of PG binder.

RAS is not permitted n thin level-up courses.





CONTROLLING PROJECT ID 0917-31-031

DISTRICT Bryan  
HIGHWAY TRINITY

COUNTY Madison

# Estimate & Quantity Sheet

CONTROL SECTION JOB				0917-31-031		TOTAL EST.	TOTAL FINAL
PROJECT ID				A00124244			
COUNTY				Madison			
HIGHWAY				TRINITY			
ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL		
	100-6002	PREPARING ROW	STA	3.300		3.300	
	110-6001	EXCAVATION (ROADWAY)	CY	307.000		307.000	
	110-6002	EXCAVATION (CHANNEL)	CY	1,050.000		1,050.000	
	132-6006	EMBANKMENT (FINAL)(DENS CONT)(TY C)	CY	7.000		7.000	
	247-6231	FL BS (CMP IN PLACE)(TY A GR 1-2)(10")	SY	870.000		870.000	
	316-6029	ASPH (RC-250)	GAL	195.000		195.000	
	316-6403	AGGR (TY-B GR-5 OR TY-L GR-5)	CY	6.000		6.000	
	402-6001	TRENCH EXCAVATION PROTECTION	LF	26.000		26.000	
	403-6001	TEMPORARY SPL SHORING	SF	755.000		755.000	
	432-6033	RIPRAP (STONE PROTECTION)(18 IN)	CY	413.000		413.000	
	450-6018	RAIL (TY T631)	LF	186.000		186.000	
	462-6032	CONC BOX CULV (10 FT X 8 FT)	LF	108.000		108.000	
	466-6172	WINGWALL (PW - 1) (HW=11 FT)	EA	2.000		2.000	
	467-6375	SET (TY II) (24 IN) (CMP) (3: 1) (C)	EA	1.000		1.000	
	467-6456	SET (TY II) (42 IN) (CMP) (3: 1) (C)	EA	1.000		1.000	
	496-6009	REMOV STR (BRIDGE 0 - 99 FT LENGTH)	EA	1.000		1.000	
	500-6001	MOBILIZATION	LS	1.000		1.000	
	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	MO	3.000		3.000	
	506-6003	ROCK FILTER DAMS (INSTALL) (TY 3)	LF	71.000		71.000	
	506-6011	ROCK FILTER DAMS (REMOVE)	LF	71.000		71.000	
	506-6038	TEMP SEDMT CONT FENCE (INSTALL)	LF	543.000		543.000	
	506-6039	TEMP SEDMT CONT FENCE (REMOVE)	LF	543.000		543.000	
	530-6005	DRIVEWAYS (ACP)	SY	77.000		77.000	
	540-6001	MTL W-BEAM GD FEN (TIM POST)	LF	13.000		13.000	
	540-6014	SHORT RADIUS	LF	25.000		25.000	
	540-6015	DRIVEWAY TERMINAL ANCHOR SECTION	EA	1.000		1.000	
	644-6076	REMOVE SM RD SN SUP&AM	EA	2.000		2.000	
	658-6010	INSTL DEL ASSM (D-SW)SZ 2(WC)GND	EA	12.000		12.000	
	658-6014	INSTL DEL ASSM (D-SW)SZ (BRF)CTB (BI)	EA	3.000		3.000	
	658-6053	INSTL OM ASSM (OM-3L)(TWT)GND	EA	2.000		2.000	
	658-6057	INSTL OM ASSM (OM-3R)(TWT)GND	EA	2.000		2.000	
	658-6062	INSTL DEL ASSM (D-SW)SZ 1(BRF)GF2(BI)	EA	6.000		6.000	
	3077-6011	SP MIXESSP-CPG64-22	TON	125.000		125.000	
	4171-6001	INSTALL BRIDGE IDENTIFICATION NUMBERS	EA	2.000		2.000	
18		EROSION CONTROL MAINTENANCE	LS	1.000		1.000	
		SAFETY CONTINGENCY	LS	1.000		1.000	



Report Generated By: txdotconnect\_internal\_ext

Report Created On: May 4, 2023 9:21:41 AM

DISTRICT	COUNTY	CCSJ	SHEET
Bryan	Madison	0917-31-031	7

SUMMARY OF ROADWAY ITEMS											
LOCATION	100	110	110	132	247	PRIME SEAL		496	530	540	540
	6002	6001	6002	6006	6231	316	316	6009	6005	6001	6014
	6029*	6403*	EMBANKMENT (FINAL) (DENS CONT) (TY C)		FL BS (CMP IN PLACE) (TY A GR 1-2) (10")	ASPH (RC-250)	AGGR (TY-B GR-5 OR TY-L GR-5)	REMOV STR (BRIDGE 0 - 99 FT LENGTH)	DRIVEWAYS (ACP)	MTL W-BEAM GD FEN (TIM POST)	SHORT RADIUS
	STA	CY	CY	CY	SY	AREA (SY)	AREA (SY)	EA	SY	LF	LF
0917-31-031	3.3	307	1050	7	870	780	780	1	77	12.5	25
PROJECT TOTALS	3.3	307	1050	7	870	780	780	1	77	12.5	25

SUMMARY OF ROADWAY ITEMS								
LOCATION	540	644	658	658	658	658	658	3077
	6015	6076	6010	6014	6053	6057	6062	6011
	DRIVEWAY TERMINAL ANCHOR SECTION	REMOVE SM RD SN SUP&AM	IN STL DEL ASSM (D-SW) SZ 2 (WC) GND	IN STL DEL ASSM (D-SW) SZ (BRF) CTB (B1)	IN STL OM ASSM (OM-3L) (TWT) GND	IN STL OM ASSM (OM-3R) (TWT) GND	IN STL DEL ASSM (D-SW) SZ 1 (BRF) GF2 (B1)	SP MIXES SP-C PG64-22*
	EA	EA	EA	EA	EA	EA	EA	AREA (SY)
0917-31-031	1	2	12	3	2	2	6	760
PROJECT TOTALS	1	2	12	3	2	2	6	760

SUMMARY OF TRAFFIC CONTROL ITEMS	
LOCATION	403
	6001
	TEMPORARY SPL SHORING
	SF
0917-31-031	755
PROJECT TOTALS	755

PRINT DATE	REVISION DATE
3/31/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
AUSTIN TX 78746  
FIRM REGISTRATION F-2966



**ROADWAY & TCP SUMMARY**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	8

REV DATE: 2-12-2015  
CSJ: 0917-31-031  
FILENAME: pwc\Project\Wise\AMER\jacobs\US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\91731031\_Trinity\_SV700\_CADD\SHITS\SUMTRINITY\_QTY\_SUM01

REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: .pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity\_Si700\_CADD\SHTS\SUM\TRINITY\_QTY\_SUM\_DRN.dwg

SUMMARY OF DRAINAGE ITEMS								
LOCATION	402 6001	432 6033	450 6018	462 6032	466 6172	467 6375	467 6456	4171 6001
	TRENCH EXCAVATION PROTECTION	RIPRAP (STONE PROTECTION) (18 IN)	RAIL (TY T631)	CONC BOX CULV (10 FT X 8 FT)	WINGWALL (PW-1) (HW=11 FT)	SET (TY II) (24 IN) (CMP) (3: 1) (C)	SET (TY II) (42 IN) (CMP) (3: 1) (C)	BRIDGE IDENTIFICATION NUMBERS
	LF	CY	LF	LF	EA	EA	EA	EA
0917-31-031	26	413	186	108	2	1	1	2
PROJECT TOTALS	26	413	186	108	2	1	1	2



Drawings Not To Scale

PRINT DATE	REVISION DATE
3/30/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



**DRAINAGE SUMMARY**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	9

REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: .pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\1731031\_Trinity\_SV700\_CADD\SHTS\SUM\TRINITY\_QTY\_SW3P\_SUM.dgn

SUMMARY OF SW3P ITEMS				
	506 6003	506 6011	506 6038	506 6039
	ROCK FILTER DAMS (INSTALL) (TY 3)	ROCK FILTER DAMS (REMOVE)	TEMP SEDMT CONT FENCE (INSTALL)	TEMP SEDMT CONT FENCE (REMOVE)
LOCATION	LF	LF	LF	LF
0917-31-031	71	71	543	543
<b>PROJECT TOTALS</b>	<b>71</b>	<b>71</b>	<b>543</b>	<b>543</b>

\* FOR CONTRACTOR USE ONLY, SEE BASIS OF ESTIMATE FOR RATE

PRINT DATE	REVISION DATE
3/29/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



**SUMMARY OF SW3P  
 QUANTITIES**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	10

SEQUENCE OF CONSTRUCTION

ROADWAY AND BRIDGE HAVE BEEN CLOSED BY THE CITY OF MADISONVILLE AND A DETOUR ROUTE HAS BEEN PROVIDED AND SHALL BE MAINTAINED DURING CONSTRUCTION. CONTRACTOR SHALL COORDINATE WITH THE CITY OF MADISONVILLE ON THE USE OF BARRICADES AND SIGNS.


MAINTAIN TEMPORARY DRAINAGE AT ALL TIMES. TEMPORARY DRAINAGE SHALL BE CONSIDERED SUBSIDIARY TO OTHER BID ITEMS.

PHASE 1:  
INSTALL TEMPORARY SW3P DEVICES.




PHASE 2:  
DEMOLISH EXISTING BRIDGE, CONSTRUCT NEW ROADWAY, GRADING, AND BRIDGE CLASS CULVERT, TIE TO EXISTING PAVEMENT.

PHASE 4:  
INSTALL METAL BEAM GUARD FENCE, GUARDRAIL END TREATMENTS, AND DELINEATORS/OBJECT MARKERS.  
COMPLETE PERMANENT SEEDING AND PLACE SIGNING.

PHASE 5:  
RESTORE ROW BACK TO PRE-CONSTRUCTION CONDITIONS AND COMPLETE FINAL SITE CLEAN UP.  
REMOVE ADVANCED WARNING SIGNS AND BARRICADES AND OPEN ROADWAY.




LEGEND

-  TRAFFIC SIGN
-  TY II OR TY III BARRICADE
-  DIRECTION OF CREEK FLOW

NOTES:

1. LOCAL ACCESS SHALL BE MAINTAINED FOR THE EXISTING COUNTY ROADS, CROSS STREETS, AND DRIVEWAYS.
2. CONTRACTOR SHALL BE RESPONSIBLE FOR TEMPORARY DRAINAGE AT ALL TIMES, TO BE SUBSIDIARY TO OTHER BID ITEMS.
3. UTILIZE CHANNELING DEVICES TO CLOSE DRIVEWAYS UNDER CONSTRUCTION, ONCE AN ALTERNATE ACCESS IS PROVIDED.
4. SPACE CHANNELIZING DEVICES IN ACCORDANCE WITH TXDOT STANDARD BC(9)-21.

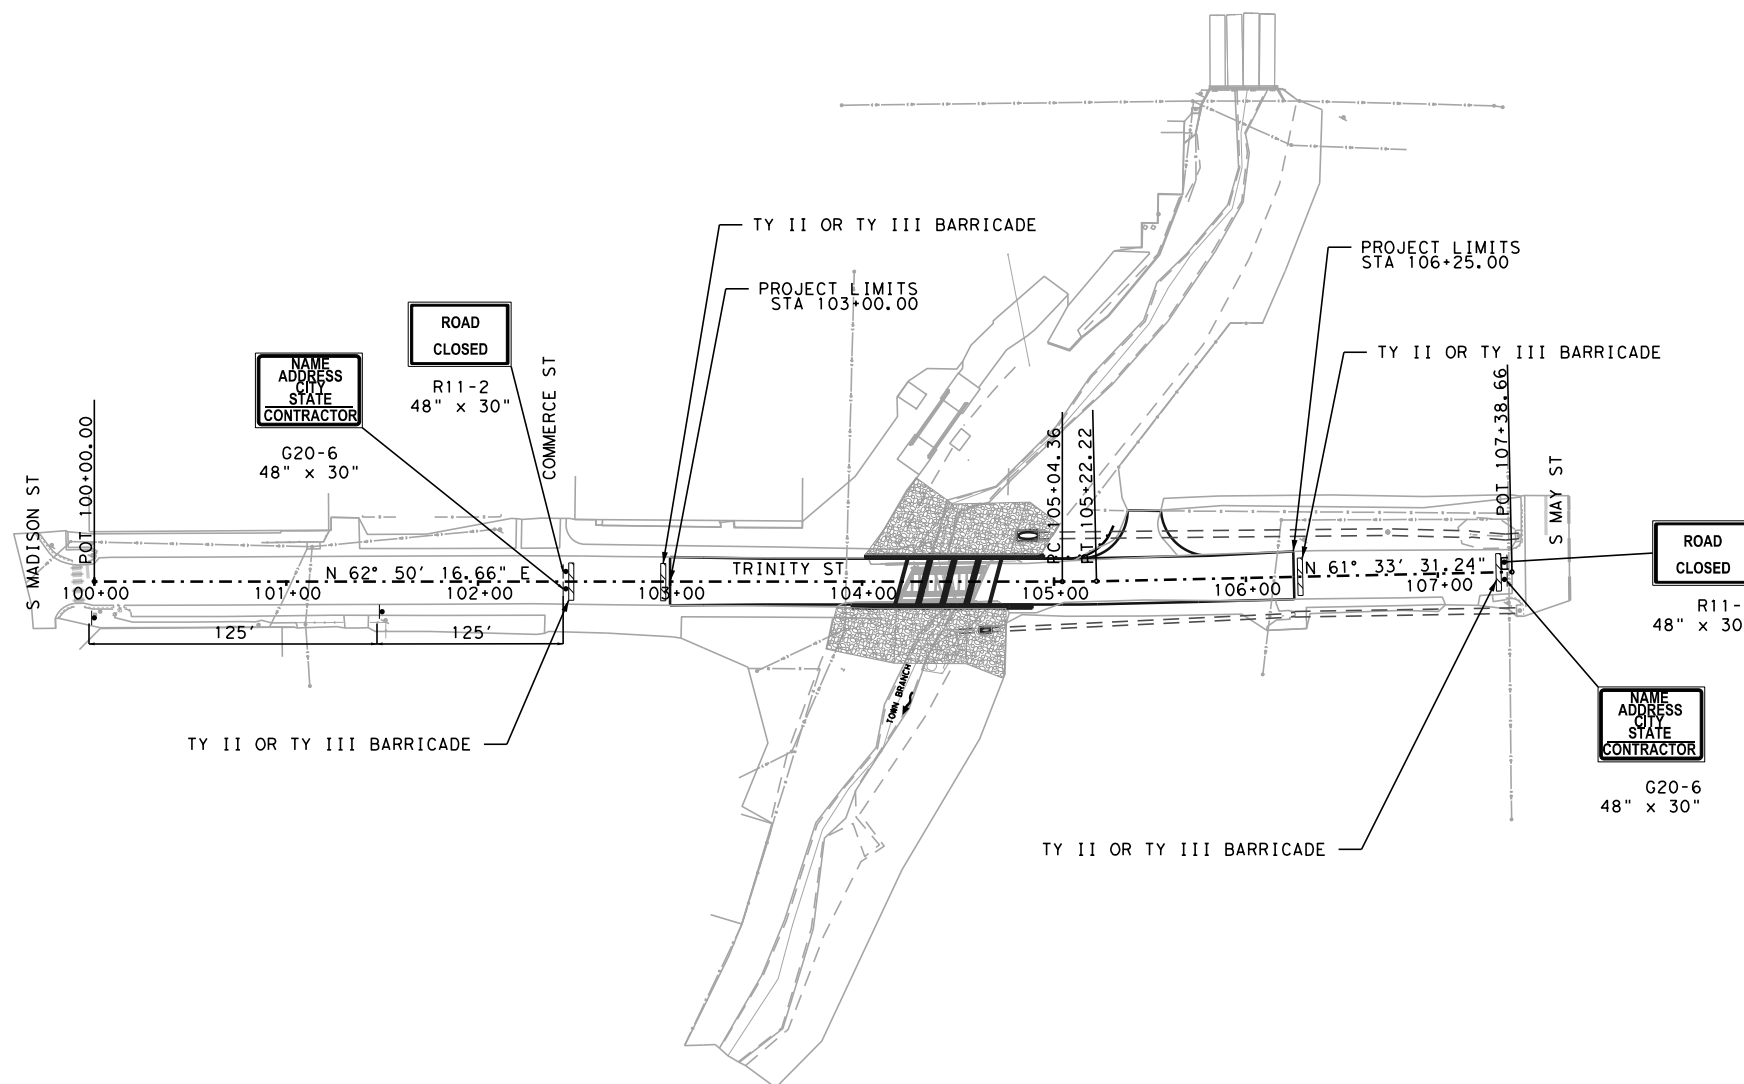

*J. Alchevsky*

PRINT DATE	REVISION DATE
4/28/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
AUSTIN TX 78746  
FIRM REGISTRATION F-2966



TRAFFIC CONTROL PLAN & SEQUENCE OF CONSTRUCTION

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	11

REV DATE: 2-12-2015  
CSJ: 0917-31-4031  
FILENAME: pw\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_L\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity St\700 CADD\SH\TTC\TRINITY\_TCP

DATE: 4/28/2023 10:15:47 AM  
 FILE: \\Project\wise\AMEER\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\91251031\_Traffic\_Engineering\_Practice\_Act.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to any other format.

**BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:**

- The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- The development and design of the Traffic Control Plan (TCP) is the responsibility of the Engineer.
- The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
- The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
- Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.
- When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
- The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
- All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
- The temporary traffic control devices shown in the illustrations of the BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.
- Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
- Traffic control devices should be in place only while work is actually in progress or a definite need exists.
- The Engineer has the final decision on the location of all traffic control devices.
- Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

**WORKER SAFETY NOTES:**



- Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
- Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.

**COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES**

- Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources.
- Work zone traffic control devices shall be compliant with the Manual for Assessing safety Hardware (MASH).


<b>THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT</b> <a href="http://www.txdot.gov">http://www.txdot.gov</a>
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS

SHEET 1 OF 12

			
<b>BARRICADE AND CONSTRUCTION GENERAL NOTES AND REQUIREMENTS</b>			
<b>BC (1) - 21</b>			
FILE:	bc-21.dgn	DN:	TxDOT
© TxDOT	November 2002	CK:	TxDOT
		DW:	TxDOT
		CK:	TxDOT
CONT	SECT	JOB	HIGHWAY
0917	31	031	CR
REVISIONS		DIST	COUNTY
4-03	7-13	BRY	MADISON
9-07	8-14		
5-10	5-21		
		SHEET NO.	11A


DATE: 4/28/2023 10:15:47 AM  
 FILE: \\Project\wise\amer\_jacobs\_us\_b\_i\_ss4\Documents\WJXN4000\_BRY\_BI.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of any information from its use.

**TYPICAL LOCATION OF CROSSROAD SIGNS**

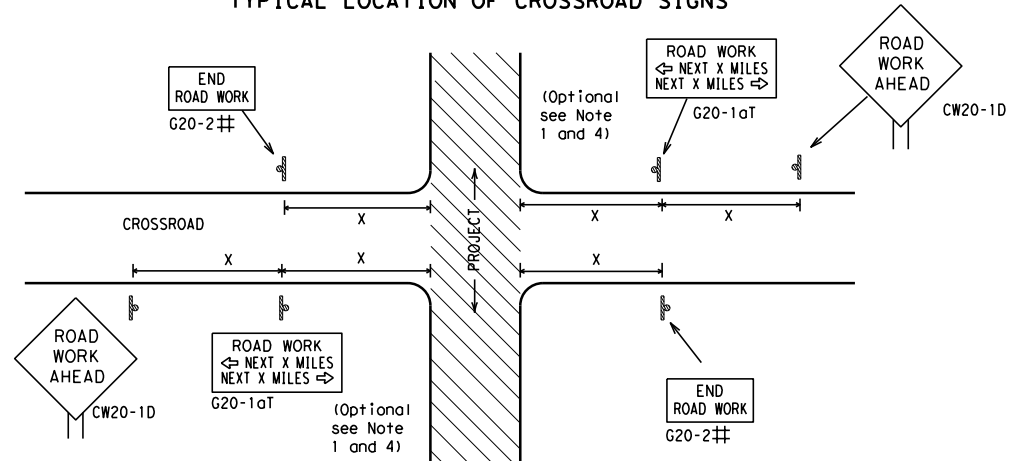

- ## May be mounted on back of "ROAD WORK AHEAD" (CW20-1D) sign with approval of Engineer. (See note 2 below)
- The typical minimum signing on a crossroad approach should be a "ROAD WORK AHEAD" (CW20-1D) sign and a (G20-2) "END ROAD WORK" sign, unless noted otherwise in plans.
  - The Engineer may use the reduced size 36" x 36" ROAD WORK AHEAD (CW20-1D) sign mounted back to back with the reduced size 36" x 18" "END ROAD WORK" (G20-2) sign on low volume crossroads (see Note 4 under "Typical Construction Warning Sign Size and Spacing"). See the "Standard Highway Sign Designs for Texas" manual for sign details. The Engineer may omit the advance warning signs on low volume crossroads. The Engineer will determine whether a road is low volume as per TMUTCD Part 5. This information shall be shown in the plans.
  - Based on existing field conditions, the Engineer/Inspector may require additional signs such as FLAGGER AHEAD, LOOSE GRAVEL, or other appropriate signs. When additional signs are required, these signs will be considered part of the minimum requirements. The Engineer/Inspector will determine the proper location and spacing of any sign not shown on the BC sheets, Traffic Control Plan sheets or the Work Zone Standard Sheets.
  - The "ROAD WORK NEXT X MILES" (G20-1aT) sign shall be required at high volume crossroads to advise motorists of the length of construction in either direction from the intersection. The Engineer will determine whether a roadway is considered high volume.
  - Additional traffic control devices may be shown elsewhere in the plans for higher volume crossroads.
  - When work occurs in the intersection area, appropriate traffic control devices, as shown elsewhere in the plans or as determined by the Engineer/Inspector, shall be in place.

**T-INTERSECTION**

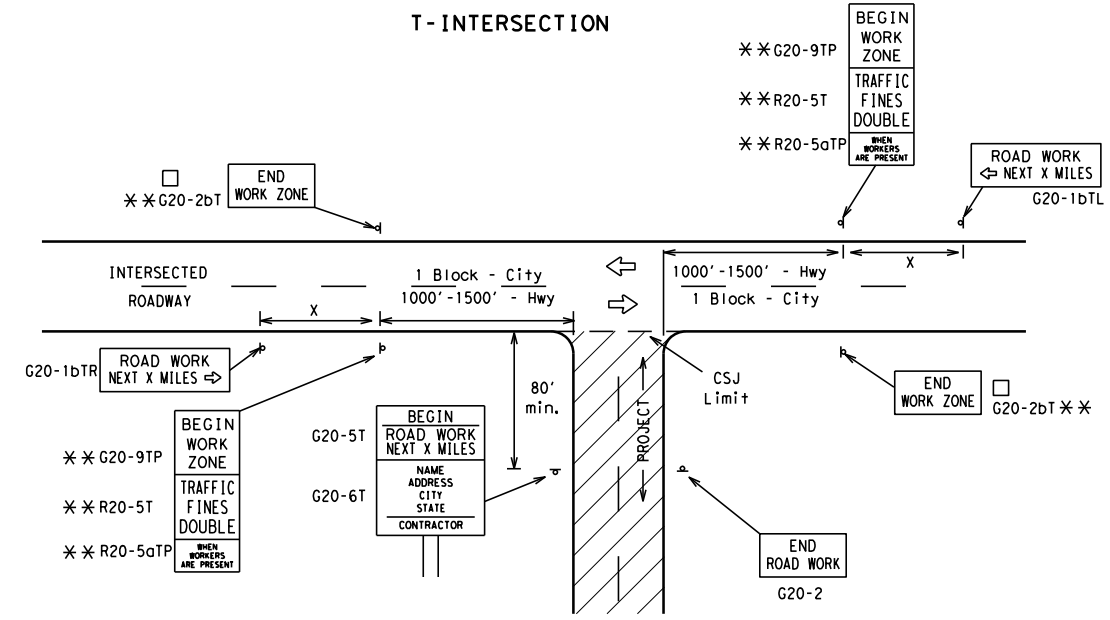

**CSJ LIMITS AT T-INTERSECTION**

- The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
- If construction closes the road at a T-intersection, the Contractor shall place the "CONTRACTOR NAME" (G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(10) also). The "ROAD WORK NEXT X MILES" left arrow (G20-1bTL) and "ROAD WORK NEXT X MILES" right arrow (G20-1bTR) signs shall be replaced by the detour signing called for in the plans.

**TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING<sup>1,5,6</sup>**

Sign Number or Series	SIZE		SPACING	
	Conventional Road	Expressway/Freeway	Posted Speed MPH	Sign Δ Spacing "x" Feet (Apprx.)
CW20 <sup>4</sup>	48" x 48"	48" x 48"	30	120
CW21			35	160
CW22			40	240
CW23			45	320
CW1, CW2, CW7, CW8, CW9, CW11, CW14	36" x 36"	48" x 48"	50	400
CW3, CW4, CW5, CW6, CW8-3, CW10, CW12	48" x 48"	48" x 48"	60	600 <sup>2</sup>
			65	700 <sup>2</sup>
			70	800 <sup>2</sup>
			80	1000 <sup>2</sup>
*			*	* <sup>3</sup>


\* For typical sign spacings on divided highways, expressways and freeways, see Part 6 of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) typical application diagrams or TCP Standard Sheets.

Δ Minimum distance from work area to first Advance Warning sign nearest the work area and/or distance between each additional sign.

**GENERAL NOTES**


- Special or larger size signs may be used as necessary.
- Distance between signs should be increased as required to have 1500 feet advance warning.
- Distance between signs should be increased as required to have 1/2 mile or more advance warning.
- 36" x 36" "ROAD WORK AHEAD" (CW20-1D) signs may be used on low volume crossroads at the discretion of the Engineer as per TMUTCD Part 5. See Note 2 under "Typical Location of Crossroad Signs".
- Only diamond shaped warning sign sizes are indicated.
- See sign size listing in "TMUTCD", Sign Appendix or the "Standard Highway Sign Designs for Texas" manual for complete list of available sign design sizes.

**WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS**

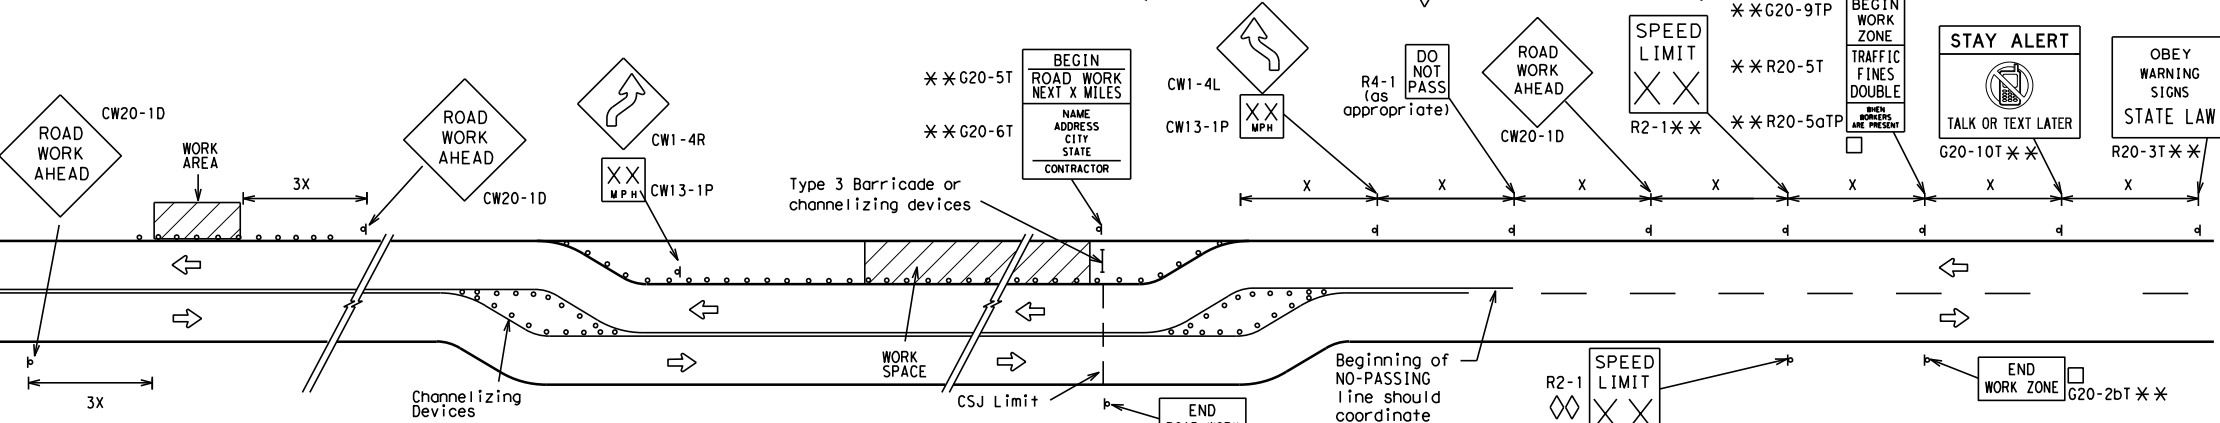


When extended distances occur between minimal work spaces, the Engineer/Inspector should ensure additional "ROAD WORK AHEAD" (CW20-1D) signs are placed in advance of these work areas to remind drivers they are still within the project limits. See the applicable TCP sheets for exact location and spacing of signs and channelizing devices.

**SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS**

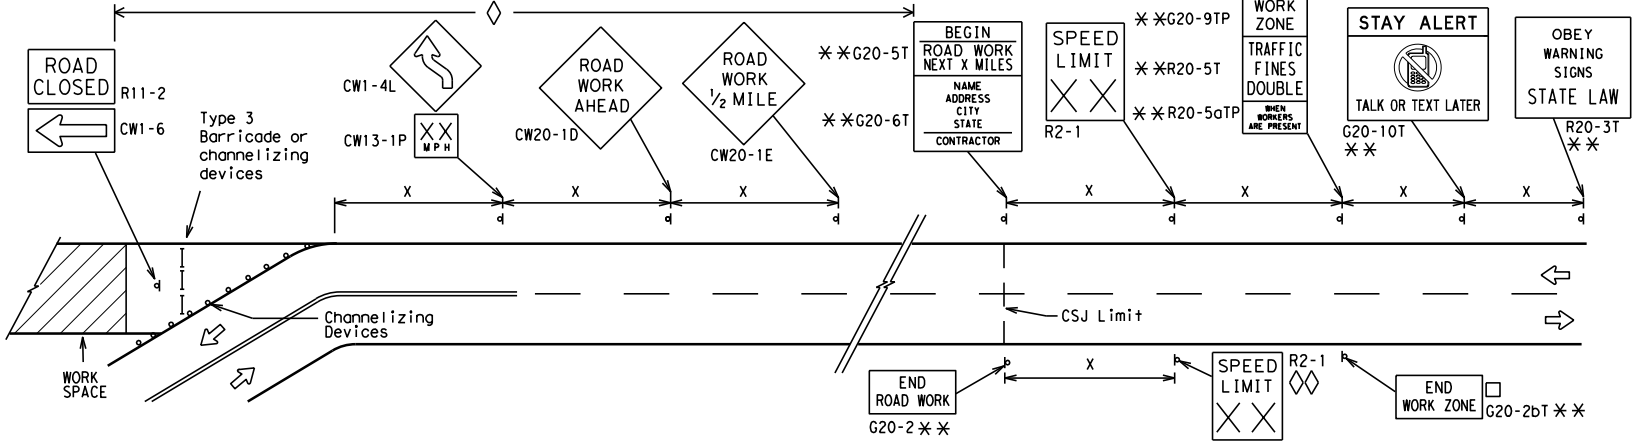

**SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING AT THE CSJ LIMITS**

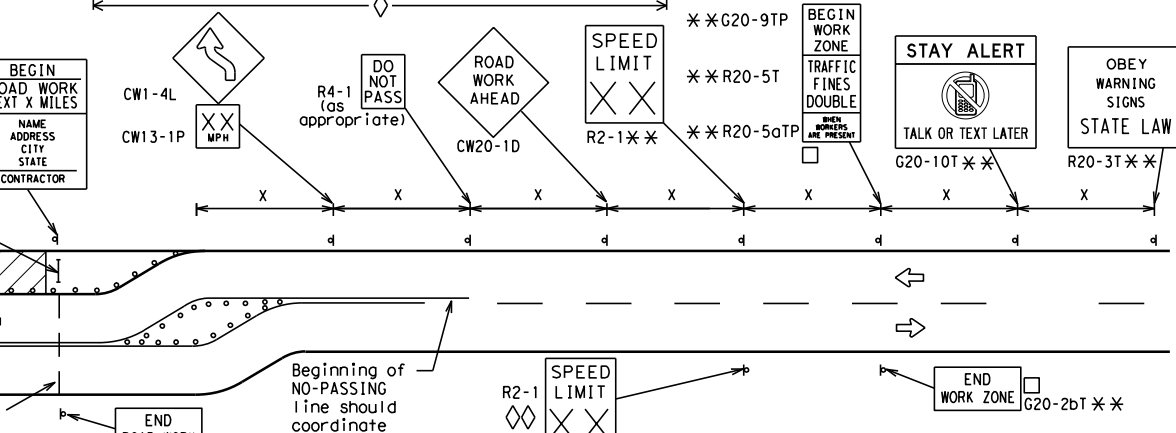

**NOTES**

- The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and "BEGIN ROAD WORK NEXT X MILES" (G20-5T) sign for each specific project. This distance shall replace the "x" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- The "BEGIN WORK ZONE" (G20-9TP) and "END WORK ZONE" (G20-2bT) shall be used as shown on the sample layout when advance signs are required outside the CSJ Limits. They inform the motorist of entering or leaving a part of the work zone lying outside the CSJ Limits where traffic fines may double if workers are present.
  - CSJ limit signing is required for highway construction and maintenance work, with the exception of mobile operations.
  - Area for placement of "ROAD WORK AHEAD" (CW20-1D) sign and other signs or devices as called for on the Traffic Control Plan.
  - Contractor will install a regulatory speed limit sign at the end of the work zone.

**LEGEND**

—	Type 3 Barricade
○ ○ ○	Channelizing Devices
■	Sign
X	See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.

SHEET 2 OF 12



**BARRICADE AND CONSTRUCTION PROJECT LIMIT**


**BC (2) - 21**

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	BRY	MADISON	11B	

# TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within Incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project. Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.

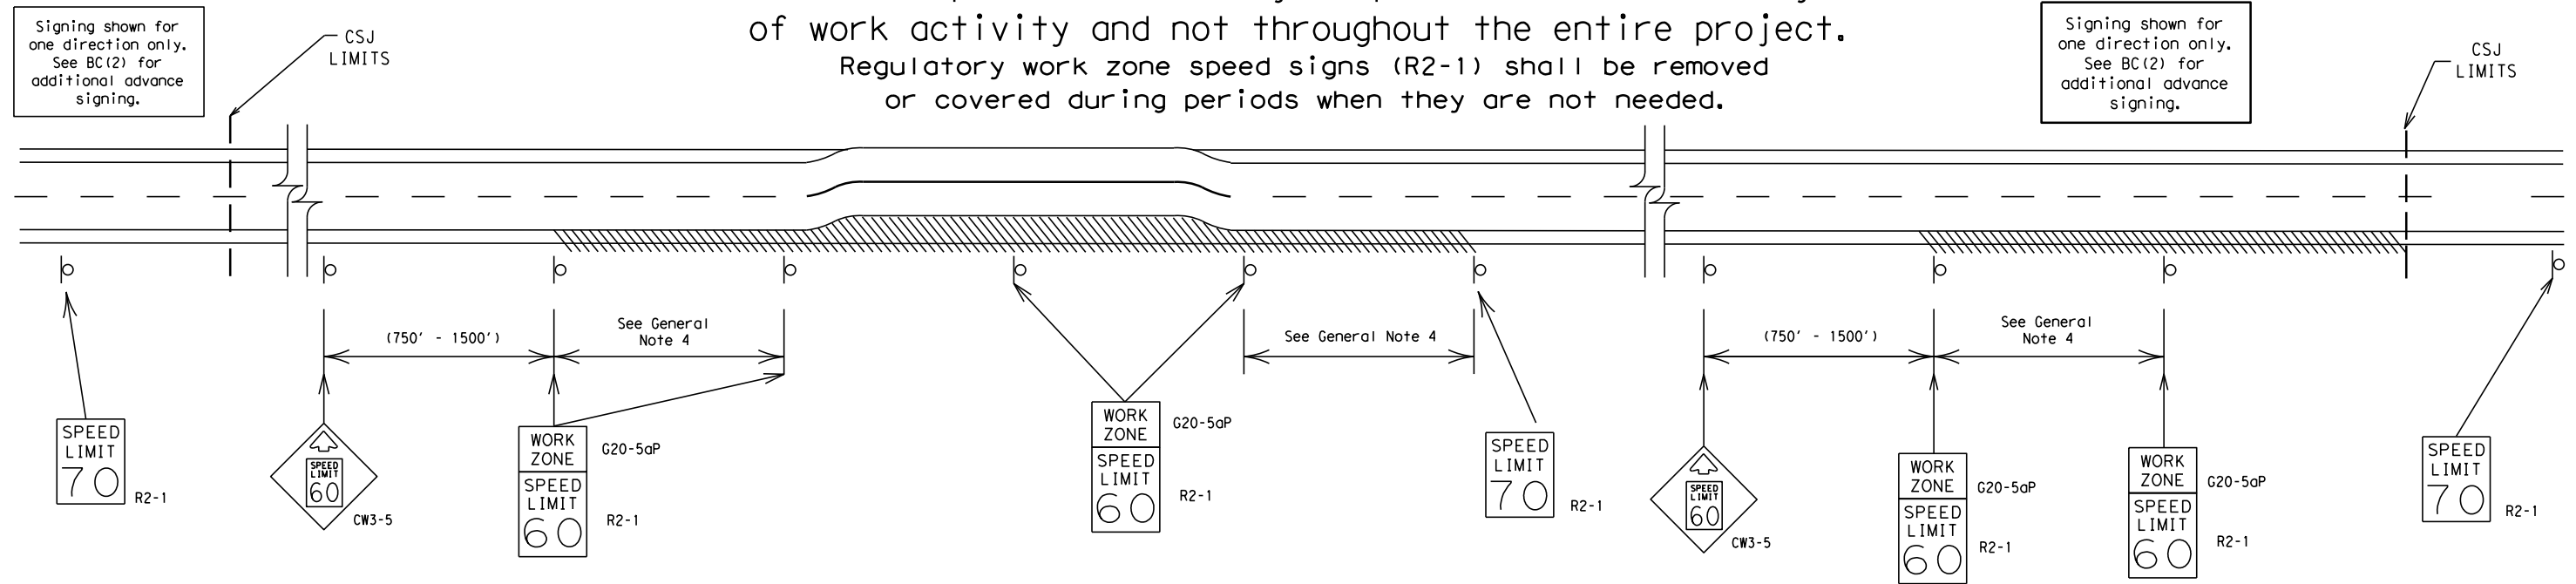

## GUIDANCE FOR USE:

### LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including:

- rough road or damaged pavement surface
- substantial alteration of roadway geometrics (diversions)
- construction detours
- grade
- width
- other conditions readily apparent to the driver

As long as any of these conditions exist, the work zone speed limit signs should remain in place.

### SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the traveled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered. (See Removing or Covering on BC(4)).

## GENERAL NOTES

- Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
- Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
- Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
- Frequency of work zone speed limit signs should be:
 

40 mph and greater	0.2 to 2 miles
35 mph and less	0.2 to 1 mile
- Regulatory speed limit signs shall have black legend and border on a white reflective background (See "Reflective Sheeting" on BC(4)).
- Fabrication, erection and maintenance of the "ADVANCE SPEED LIMIT" (CW3-5) sign, "WORK ZONE" (G20-5aP) plaque and the "SPEED LIMIT" (R2-1) signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
- Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
- Techniques that may help reduce traffic speeds include but are not limited to:
  - Law enforcement.
  - Flagger stationed next to sign.
  - Portable changeable message sign (PCMS).
  - Low-power (drone) radar transmitter.
  - Speed monitor trailers or signs.
- Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
- For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form #1204 in the TxDOT e-form system.

SHEET 3 OF 12



## BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT

BC (3) - 21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0917	31	031	CR				
9-07	8-14	DIST	COUNTY		SHEET NO.				
7-13	5-21	BRY	MADISON		11C				


DATE: 4/28/2023 10:15:47 AM  
 FILE: \\ProjectWise\seamer\jacobson\B.I.\_SS4\Documents\WJXN4000\_BRY\BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of any information from any source to any other source.



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/28/2023 10:15:47 AM  
 FILE: \\Project\wise\AME\jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\TCP\bc-21.dgn


**TYPICAL MINIMUM CLEARANCES FOR LONG TERM AND INTERMEDIATE TERM SIGNS**

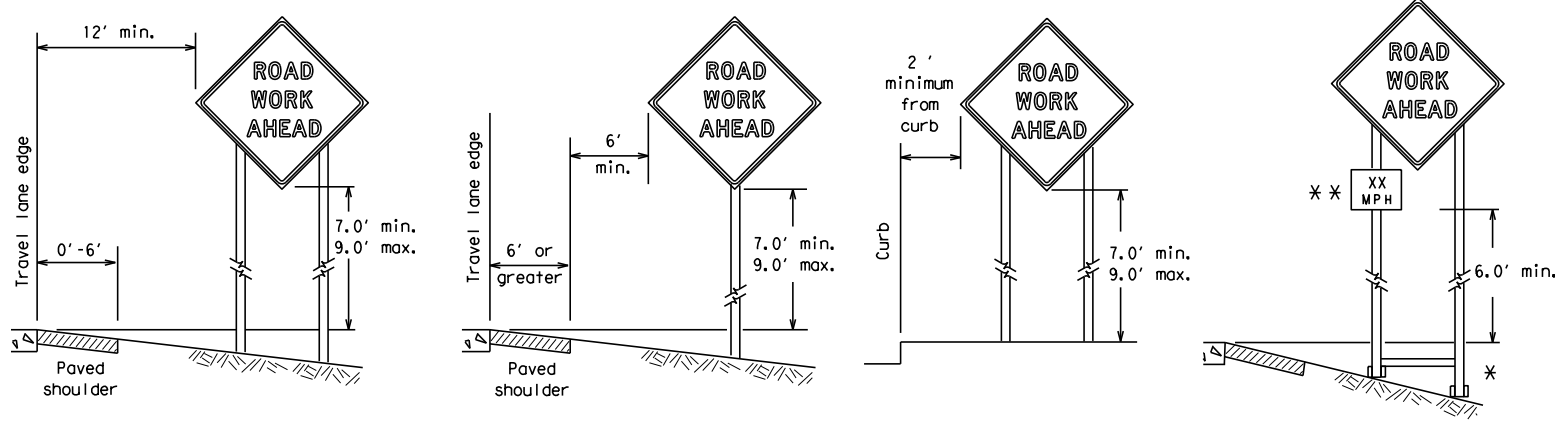

\* When placing skid supports on unlevel ground, the leg post lengths must be adjusted so the sign appears straight and plumb. Objects shall NOT be placed under skids as a means of leveling.

\*\* When plaques are placed on dual-leg supports, they should be attached to the upright nearest the travel lane. Supplemental plaques (advisory or distance) should not cover the surface of the parent sign.

**ATTACHMENT FOR SIGN SUPPORTS**

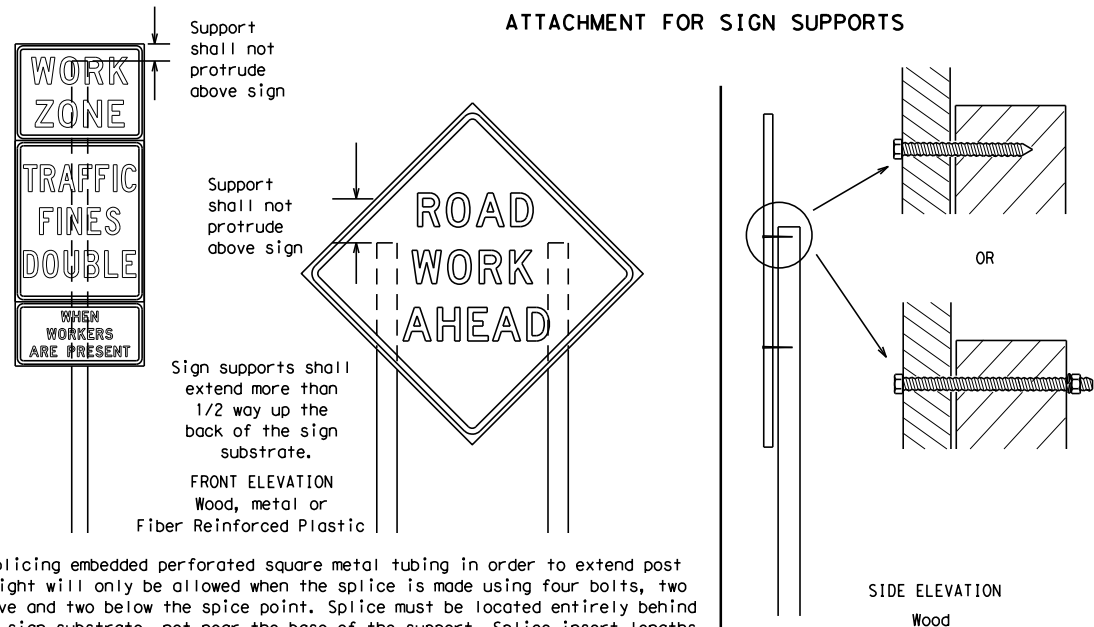


Nails shall NOT be allowed. Each sign shall be attached directly to the sign support. Multiple signs shall not be joined or spliced by any means. Wood supports shall not be extended or repaired by splicing or other means.

Splicing embedded perforated square metal tubing in order to extend post height will only be allowed when the splice is made using four bolts, two above and two below the splice point. Splice must be located entirely behind the sign substrate, not near the base of the support. Splice insert lengths should be at least 5 times nominal post size, centered on the splice and of at least the same gauge material.

**STOP/SLOW PADDLES**

1. STOP/SLOW paddles are the primary method to control traffic by flaggers. The STOP/SLOW paddle size should be 24" x 24".
2. STOP/SLOW paddles shall be retroreflectORIZED when used at night.
3. STOP/SLOW paddles may be attached to a staff with a minimum length of 6' to the bottom of the sign.
4. Any lights incorporated into the STOP or SLOW paddle faces shall only be as specifically described in Section 6E.03 Hand Signaling Devices in the TMUTCD.

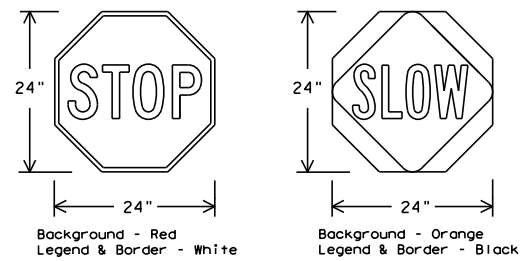

SHEETING REQUIREMENTS (WHEN USED AT NIGHT)		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	ORANGE	TYPE B <sub>FL</sub> OR C <sub>FL</sub> SHEETING
LEGEND & BORDER	WHITE	TYPE B OR C SHEETING
LEGEND & BORDER	BLACK	ACRYLIC NON-REFLECTIVE FILM

**CONTRACTOR REQUIREMENTS FOR MAINTAINING PERMANENT SIGNS WITHIN THE PROJECT LIMITS**

1. Permanent signs are used to give notice of traffic laws or regulations, call attention to conditions that are potentially hazardous to traffic operations, show route designations, destinations, directions, distances, services, points of interest, and other geographical, recreational, specific service (LOGO), or cultural information. Drivers proceeding through a work zone need the same, if not better route guidance as normally installed on a roadway without construction.
2. When permanent regulatory or warning signs conflict with work zone conditions, remove or cover the permanent signs until the permanent sign message matches the roadway condition. For details for covering large guide signs see the TS-CD standard.
3. When existing permanent signs are moved and relocated due to construction purposes, they shall be visible to motorists at all times.
4. If existing signs are to be relocated on their original supports, they shall be installed on crashworthy bases as shown on the SMD Standard sheets. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards. This work should be paid for under the appropriate pay item for relocating existing signs.
5. If permanent signs are to be removed and relocated using temporary supports, the Contractor shall use crashworthy supports as shown on the BC standard sheets, TLRs standard sheets or the CWZTCD list. The signs shall meet the required mounting heights shown on the BC, or the SMD standard sheets during construction. This work should be paid for under the appropriate pay item for relocating existing signs.
6. Any sign or traffic control device that is struck or damaged by the Contractor or his/her construction equipment shall be replaced as soon as possible by the Contractor to ensure proper guidance for the motorists. This will be subsidiary to Item 502.

**GENERAL NOTES FOR WORK ZONE SIGNS**

1. Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer.
2. Wooden sign posts shall be painted white.
3. Barricades shall NOT be used as sign supports.
4. All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and guide the traveling public safely through the work zone.
5. The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
6. The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD) for small roadside signs. Supports for temporary large roadside signs shall meet the requirements detailed on the Temporary Large Roadside Signs (TLRS) standard sheets. The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so the Engineer can verify the correct procedures are being followed.
7. The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or damaged or marred reflective sheeting as directed by the Engineer/Inspector.
8. Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1 inch.
9. The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

**DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)**

1. The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in regard to crashworthiness and duration of work requirements.
  - a. Long-term stationary - work that occupies a location more than 3 days.
  - b. Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting more than one hour.
  - c. Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period.
  - d. Short, duration - work that occupies a location up to 1 hour.
  - e. Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

**SIGN MOUNTING HEIGHT**

1. The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except as shown for supplemental plaques mounted below other signs.
2. The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above the ground.
3. Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
4. Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to appropriate Long-term/Intermediate sign height.
5. Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

**SIZE OF SIGNS**

1. The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

**SIGN SUBSTRATES**

1. The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports.
2. "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave.
3. All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6" centers. The Engineer may approve other methods of splicing the sign face.

**REFLECTIVE SHEETING**

1. All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1).
2. White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background.
3. Orange sheeting, meeting the requirements of DMS-8300 Type B<sub>FL</sub> or Type C<sub>FL</sub>, shall be used for rigid signs with orange backgrounds.

**SIGN LETTERS**

1. All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of first class workmanship in accordance with Department Standards and Specifications.

**REMOVING OR COVERING**

1. When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
2. Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any intersections where the sign may be seen from approaching traffic.
3. Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely covered when not required.
4. When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.
5. Burlap shall NOT be used to cover signs.
6. Duct tape or other adhesive material shall NOT be affixed to a sign face.
7. Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

**SIGN SUPPORT WEIGHTS**

1. Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used.
2. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
3. Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights.
4. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
5. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall NOT be used.
6. Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
7. Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
8. Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

**FLAGS ON SIGNS**

1. Flags may be used to draw attention to warning signs. When used, the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.




**BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES**

**BC (4) - 21**


FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0917	31	031	CR				
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	BRY	MADISON	11D					

DATE: 4/28/2023 10:15:48 AM  
 FILE: \\Project\wise\BRY\Bridg\_Program\WJXN4000\_01\31031\_Triplicity\_Sign\BC(5)-21.dgn  
 PROJECT: WISER  
 DRAWN BY: BRY  
 CHECKED BY: JACOBSON  
 DATE: 4/28/2023 10:15:48 AM  
 FILE: \\Project\wise\BRY\Bridg\_Program\WJXN4000\_01\31031\_Triplicity\_Sign\BC(5)-21.dgn  
 PROJECT: WISER  
 DRAWN BY: BRY  
 CHECKED BY: JACOBSON

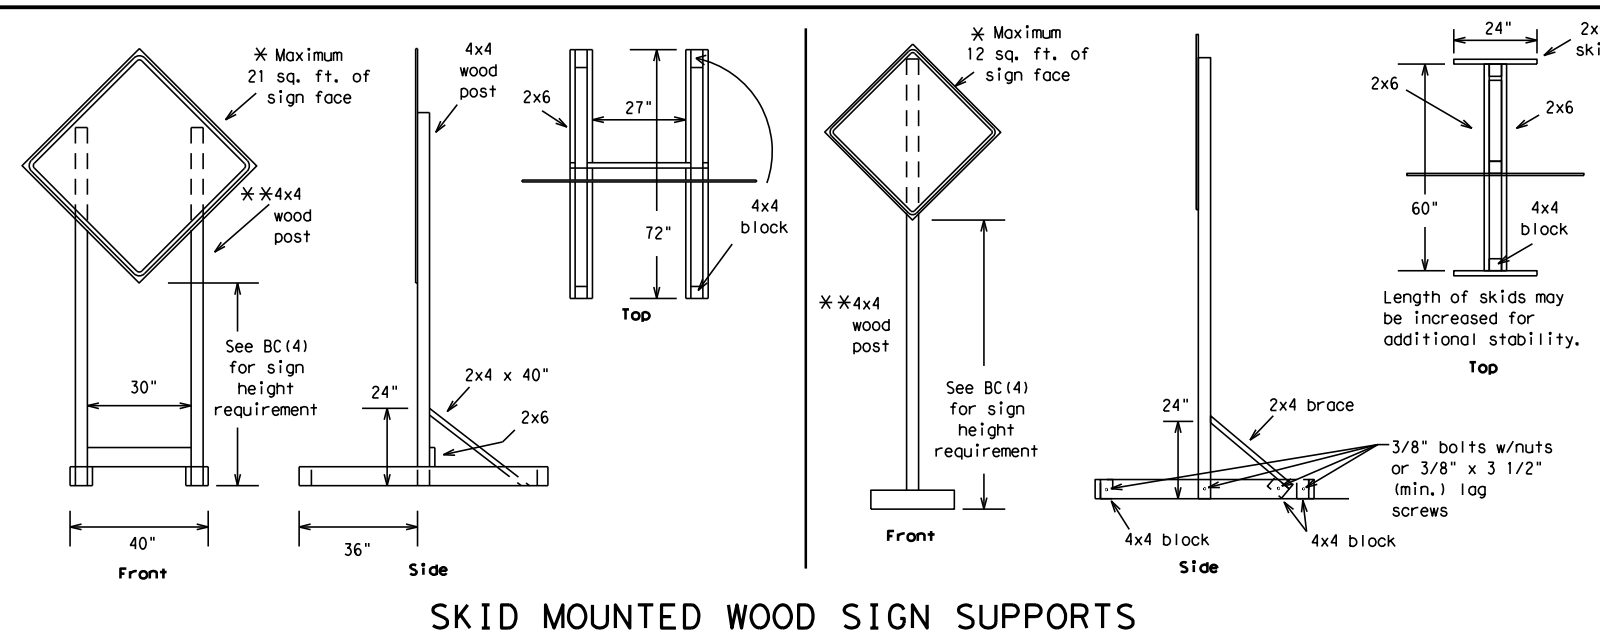


**SKID MOUNTED WOOD SIGN SUPPORTS**

\* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

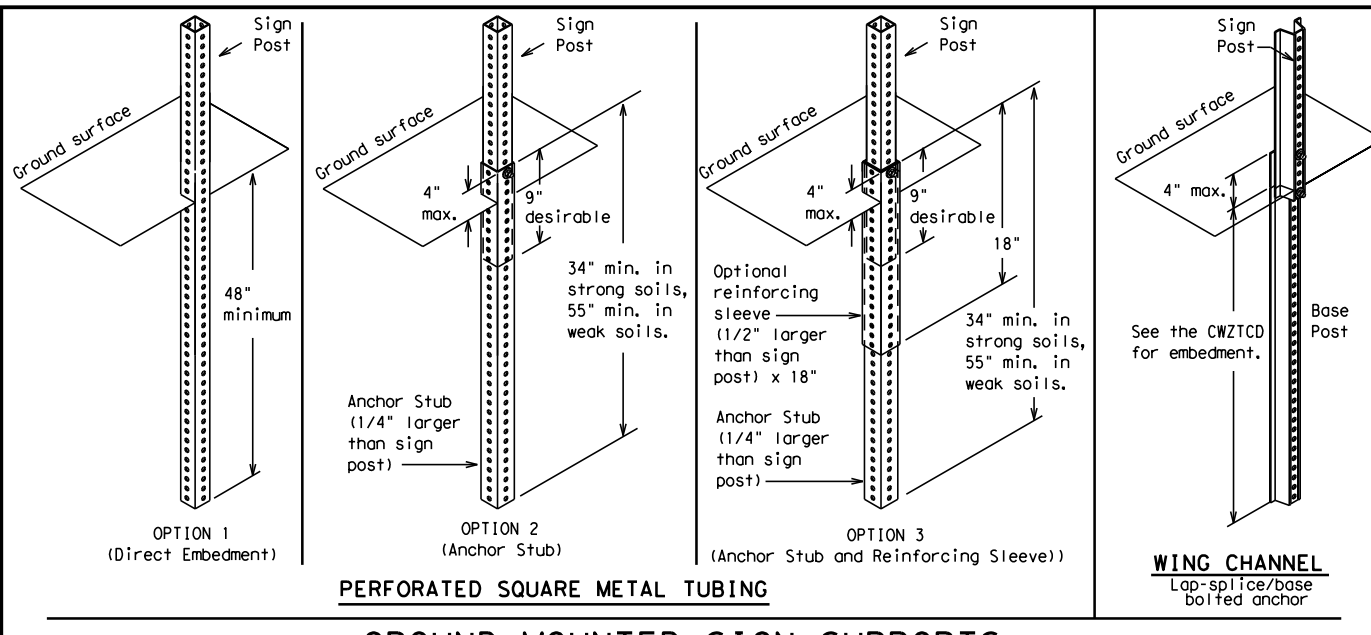

**GROUND MOUNTED SIGN SUPPORTS**

Refer to the CWZTCD and the manufacturer's installation procedure for each type sign support. The maximum sign square footage shall adhere to the manufacturer's recommendation. Two post installations can be used for larger signs.

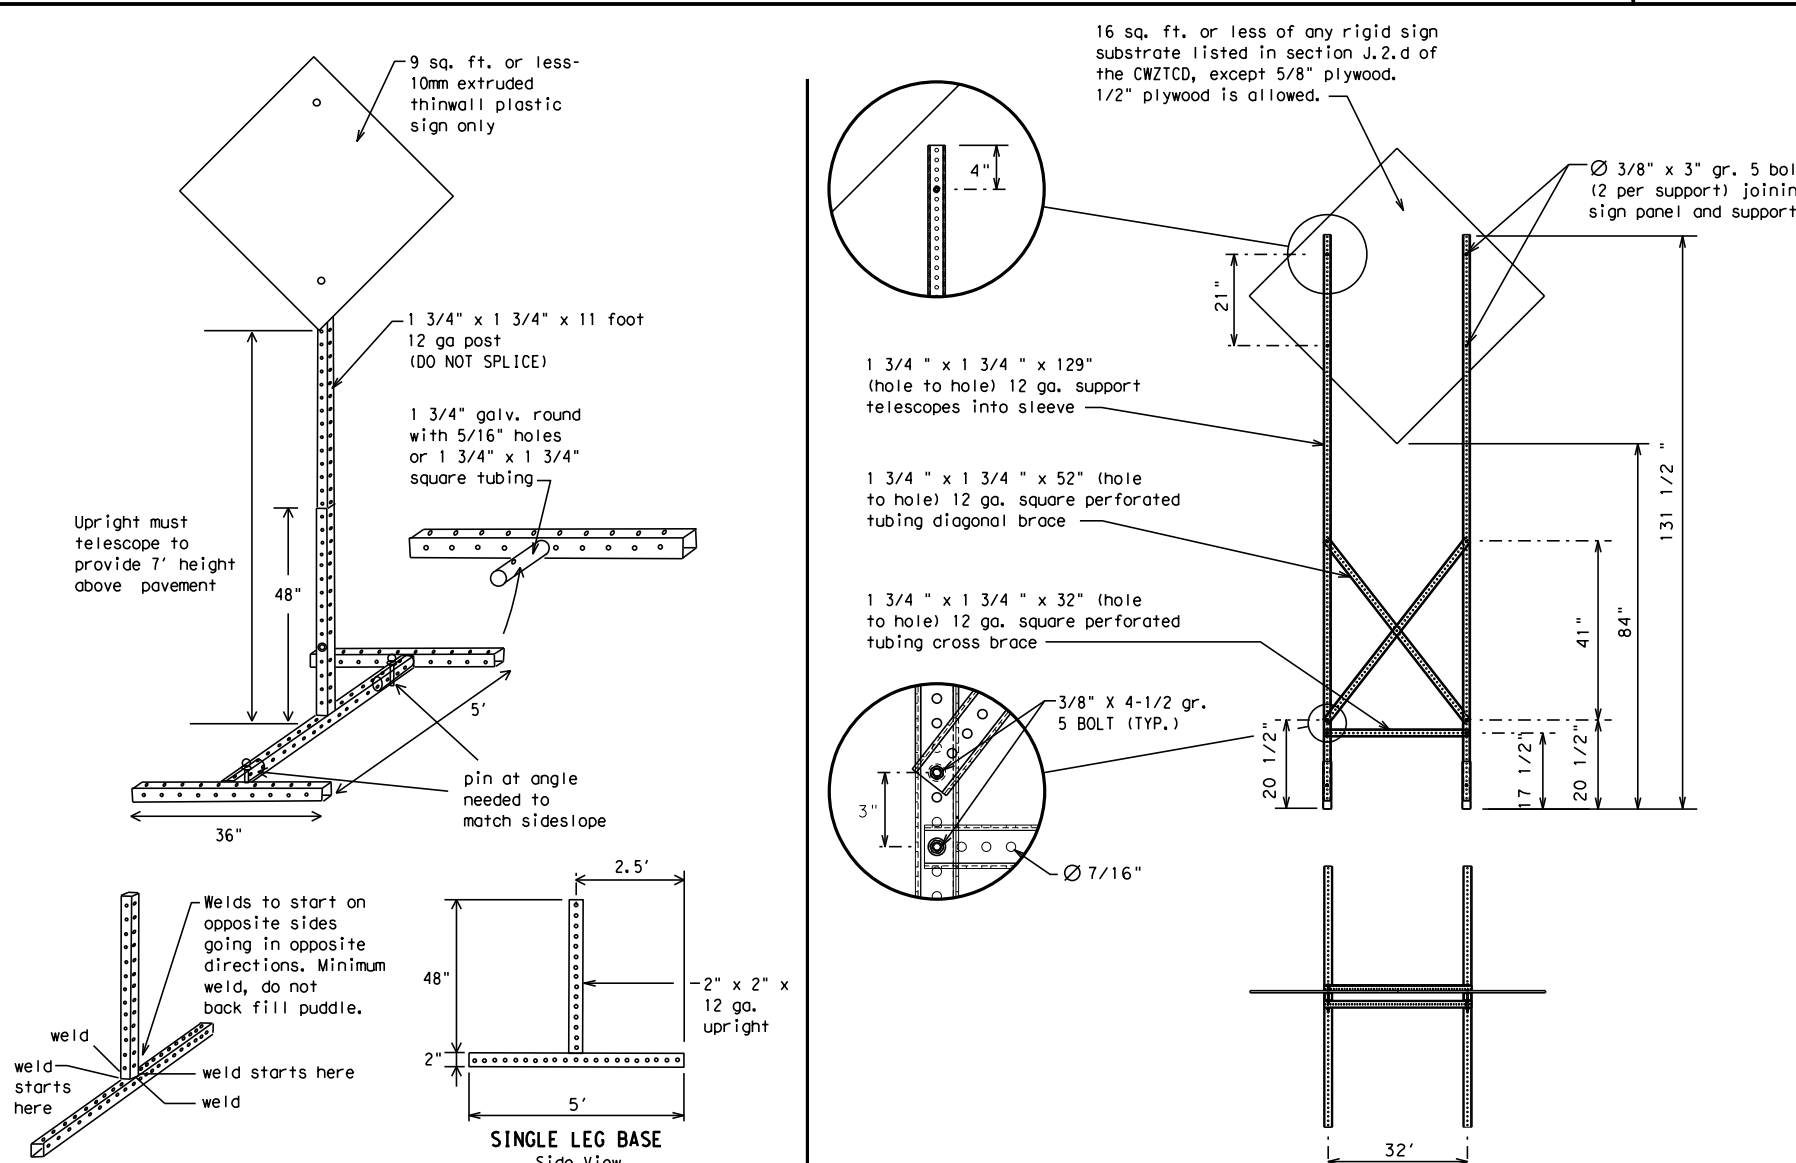

**SKID MOUNTED PERFORATED SQUARE STEEL TUBING SIGN SUPPORTS**

\* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

**WEDGE ANCHORS**  
 Both steel and plastic Wedge Anchor Systems as shown on the SMD Standard Sheets may be used as temporary sign supports for signs up to 10 square feet of sign face. They may be set in concrete or in sturdy soils if approved by the Engineer. (See web address for "Traffic Engineering Standard Sheets" on BC(1)).

**OTHER DESIGNS**  
 MORE DETAILS OF APPROVED LONG/INTERMEDIATE AND SHORT TERM SUPPORTS CAN BE FOUND ON THE CWZTCD LIST. SEE BC(1) FOR WEBSITE LOCATION.

- GENERAL NOTES**
- Nails may be used in the assembly of wooden sign supports, but 3/8" bolts with nuts or 3/8" x 3 1/2" lag screws must be used on every joint for final connection.
  - No more than 2 sign posts shall be placed within a 7 ft. circle, except for specific materials noted on the CWZTCD List.
  - When project is completed, all sign supports and foundations shall be removed from the project site. This will be considered subsidiary to Item 502.
- \* See BC(4) for definition of "Work Duration."  
 \*\* Wood sign posts MUST be one piece. Splicing will NOT be allowed. Posts shall be painted white.  
 See the CWZTCD for the type of sign substrate that can be used for each approved sign support.



**BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT**

**BC(5) - 21**

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	BRY	MADISON	11E	

WHEN NOT IN USE, REMOVE THE PCMS FROM THE RIGHT-OF-WAY OR PLACE THE PCMS BEHIND BARRIER OR GUARDRAIL WITH SIGN PANEL TURNED PARALLEL TO TRAFFIC

# RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES

(The Engineer may approve other messages not specifically covered here.)

## PORTABLE CHANGEABLE MESSAGE SIGNS

- The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
- Messages on PCMS should contain no more than 8 words (about four to eight characters per word), not including simple words such as "TO," "FOR," "AT," etc.
- Messages should consist of a single phase, or two phases that alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
- Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
- Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
- When in use, the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
- The message term "WEEKEND" should be used only if the work is to start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
- The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
- Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
- Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
- Do not use the word "Danger" in message.
- Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
- Do not display messages that scroll horizontally or vertically across the face of the sign.
- The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
- PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
- Each line of text should be centered on the message board rather than left or right justified.
- If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

## Phase 1: Condition Lists

### Road/Lane/Ramp Closure List

FREEWAY CLOSED X MILE	FRONTAGE ROAD CLOSED
ROAD CLOSED AT SH XXX	SHOULDER CLOSED XXX FT
ROAD CLSD AT FM XXXX	RIGHT LN CLOSED XXX FT
RIGHT X LANES CLOSED	RIGHT X LANES OPEN
CENTER LANE CLOSED	DAYTIME LANE CLOSURES
NIGHT LANE CLOSURES	I-XX SOUTH EXIT CLOSED
VARIOUS LANES CLOSED	EXIT XXX CLOSED X MILE
EXIT CLOSED	RIGHT LN TO BE CLOSED
MALL DRIVEWAY CLOSED	X LANES CLOSED TUE - FRI
XXXXXXXX BLVD CLOSED	

### Other Condition List

ROADWORK XXX FT	ROAD REPAIRS XXXX FT
FLAGGER XXXX FT	LANE NARROWS XXXX FT
RIGHT LN NARROWS XXXX FT	TWO-WAY TRAFFIC XX MILE
MERGING TRAFFIC XXXX FT	CONST TRAFFIC XXX FT
LOOSE GRAVEL XXXX FT	UNEVEN LANES XXXX FT
DETOUR X MILE	ROUGH ROAD XXXX FT
ROADWORK PAST SH XXXX	ROADWORK NEXT FRI-SUN
BUMP XXXX FT	US XXX EXIT X MILES
TRAFFIC SIGNAL XXXX FT	LANES SHIFT *

\* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

## Phase 2: Possible Component Lists

### Action to Take/Effect on Travel List

MERGE RIGHT	FORM X LINES RIGHT
DETOUR NEXT X EXITS	USE XXXXX RD EXIT
USE EXIT XXX	USE EXIT I-XX NORTH
STAY ON US XXX SOUTH	USE I-XX E TO I-XX N
TRUCKS USE US XXX N	WATCH FOR TRUCKS
WATCH FOR TRUCKS	EXPECT DELAYS
EXPECT DELAYS	PREPARE TO STOP
REDUCE SPEED XXX FT	END SHOULDER USE
USE OTHER ROUTES	WATCH FOR WORKERS
STAY IN LANE *	

### Location List

AT FM XXXX
BEFORE RAILROAD CROSSING
NEXT X MILES
PAST US XXX EXIT
XXXXXXXX TO XXXXXX
US XXX TO FM XXXX

### Warning List

SPEED LIMIT XX MPH
MAXIMUM SPEED XX MPH
MINIMUM SPEED XX MPH
ADVISORY SPEED XX MPH
RIGHT LANE EXIT
USE CAUTION
DRIVE SAFELY
DRIVE WITH CARE

### \*\* Advance Notice List

TUE-FRI XX AM-X PM
APR XX-XX X PM-X AM
BEGINS MONDAY
BEGINS MAY XX
MAY X-X XX PM - XX AM
NEXT FRI-SUN
XX AM TO XX PM
NEXT TUE AUG XX
TONIGHT XX PM-XX AM

\*\* See Application Guidelines Note 6.

## APPLICATION GUIDELINES

- Only 1 or 2 phases are to be used on a PCMS.
- The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
- A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
- A Location Phase is necessary only if a distance or location is not included in the first phase selected.
- If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS shall be limited to two phases, and should be understandable by themselves.
- For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

## WORDING ALTERNATIVES

- The words RIGHT, LEFT and ALL can be interchanged as appropriate.
- Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
- EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
- Highway names and numbers replaced as appropriate.
- ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
- AHEAD may be used instead of distances if necessary.
- FT and MI, MILE and MILES interchanged as appropriate.
- AT, BEFORE and PAST interchanged as needed.
- Distances or AHEAD can be eliminated from the message if a location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC, THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

## FULL MATRIX PCMS SIGNS

- When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
- When symbol signs, such as the "Flagger Symbol" (CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
- When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute for, or replace that sign.
- A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

WORD OR PHRASE	ABBREVIATION	WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD	Major	MAJ
Alternate	ALT	Miles	MI
Avenue	AVE	Miles Per Hour	MPH
Best Route	BEST RTE	Minor	MNR
Boulevard	BLVD	Monday	MON
Bridge	BRDG	Normal	NORM
Canot	CANT	North	N
Center	CTR	Northbound	(route) N
Construction Ahead	CONST AHD	Parking	PKING
CROSSING	XING	Road	RD
Detour Route	DETOUR RTE	Right Lane	RT LN
Do Not	DONT	Saturday	SAT
East	E	Service Road	SERV RD
Eastbound	(route) E	Shoulder	SHLDR
Emergency	EMER	Slippery	SLIP
Emergency Vehicle	EMER VEH	South	S
Entrance, Enter	ENT	Southbound	(route) S
Express Lane	EXP LN	Speed	SPD
Expressway	EXPWY	Street	ST
XXXX Feet	XXXX FT	Sunday	SUN
Fog Ahead	FOG AHD	Telephone	PHONE
Freeway	FRWY, FWY	Temporary	TEMP
Freeway Blocked	FWY BLKD	Thursday	THURS
Friday	FRI	To Downtown	TO DWNTN
Hazardous Driving	HAZ DRIVING	Traffic	TRAF
Hazardous Material	HAZMAT	Travelers	TRVLR
High-Occupancy Vehicle	HOV	Tuesday	TUES
Highway	HWY	Time Minutes	TIME MIN
Hour(s)	HR, HRS	Upper Level	UPR LEVEL
Information	INFO	Vehicles (s)	VEH, VEHS
It Is	ITS	Warning	WARN
Junction	JCT	Wednesday	WED
Left	LFT	Weight Limit	WT LIMIT
Left Lane	LFT LN	West	W
Lane Closed	LN CLOSED	Westbound	(route) W
Lower Level	LWR LEVEL	Wet Pavement	WET PVMT
Maintenance	MAINT	Will Not	WONT

Roadway designation # IH-number, US-number, SH-number, FM-number



## BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS)


BC (6) - 21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	BRY	MADISON	11F	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 4/28/2023 10:15:48 AM  
 FILE: \\Project\wise\amer\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\TCP\bc-21.dgn

- Barrier Reflectors shall be pre-qualified, and conform to the color and reflectivity requirements of DMS-8600. A list of prequalified Barrier Reflectors can be found at the Material Producer List web address shown on BC(1).
- Color of Barrier Reflectors shall be as specified in the TMUTCD. The cost of the reflectors shall be considered subsidiary to Item 512.

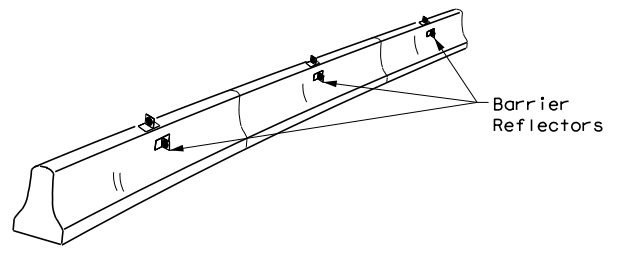


CONCRETE TRAFFIC BARRIER (CTB)

- Where traffic is on one side of the CTB, two (2) Barrier Reflectors shall be mounted in approximately the midsection of each section of CTB. An alternate mounting location is uniformly spaced at one end of each CTB. This will allow for attachment of a barrier grapple without damaging the reflector. The Barrier Reflector mounted on the side of the CTB shall be located directly below the reflector mounted on top of the barrier, as shown in the detail above.
- Where CTB separates two-way traffic, three barrier reflectors shall be mounted on each section of CTB. The reflector unit on top shall have two yellow reflective faces (Bi-Directional) while the reflectors on each side of the barrier shall have one yellow reflective face, as shown in the detail above.
- When CTB separates traffic traveling in the same direction, no barrier reflectors will be required on top of the CTB.
- Barrier Reflector units shall be yellow or white in color to match the edgeline being supplemented.
- Maximum spacing of Barrier Reflectors is forty (40) feet.
- Pavement markers or temporary flexible-reflective roadway marker tabs shall NOT be used as CTB delineation.
- Attachment of Barrier Reflectors to CTB shall be per manufacturer's recommendations.
- Missing or damaged Barrier Reflectors shall be replaced as directed by the Engineer.
- Single slope barriers shall be delineated as shown on the above detail.

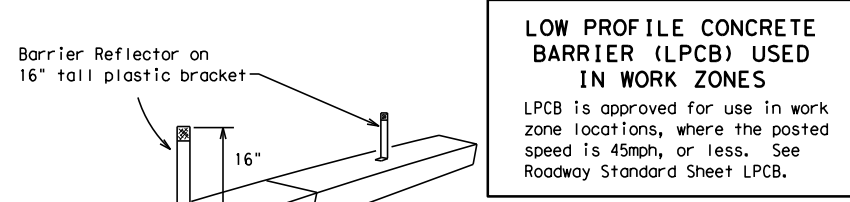

LOW PROFILE CONCRETE BARRIER (LPCB) USED IN WORK ZONES  
 LPCB is approved for use in work zone locations, where the posted speed is 45mph, or less. See Roadway Standard Sheet LPCB.

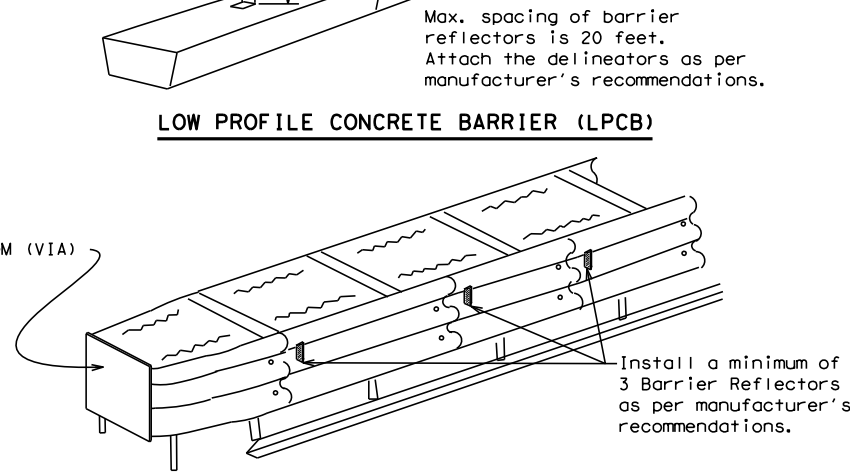

DELINEATION OF END TREATMENTS  
 END TREATMENTS FOR CTB'S USED IN WORK ZONES  
 End treatments used on CTB's in work zones shall meet the appropriate crashworthy standards as defined in the Manual for Assessing Safety Hardware (MASH). Refer to the CWZTCD List for approved end treatments and manufacturers.

BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS

WARNING LIGHTS


- Warning lights shall meet the requirements of the TMUTCD.
- Warning lights shall NOT be installed on barricades.
- Type A-Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall not be used with signs manufactured with Type B<sub>FL</sub> or C<sub>FL</sub> Sheeting meeting the requirements of Departmental Material Specification DMS-8300.
- Type-C and Type D 360 degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".
- The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.
- When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights.
- When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.
- The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

WARNING LIGHTS MOUNTED ON PLASTIC DRUMS


- Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.
- Type A random flashing warning lights are not intended for delineation and shall not be used in a series.
- A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used, the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.
- Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane changes, on lane closures, and on other similar conditions.
- Type A, Type C and Type D warning lights shall be installed at locations as detailed on other sheets in the plans.
- Warning lights shall not be installed on a drum that has a sign, chevron or vertical panel.
- The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS

- A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the discretion of the Contractor unless otherwise noted in the plans.
- The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed on the CWZTCD.
- The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches.
- Round reflectors shall be fully reflectorized, including the area where attached to the drum.
- Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it attaches to the drum.
- The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for DMS 8300-Type B or Type C.
- When used near two-way traffic, both sides of the warning reflector shall be reflectorized.
- The warning reflector should be mounted on the side of the handle nearest approaching traffic.
- The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

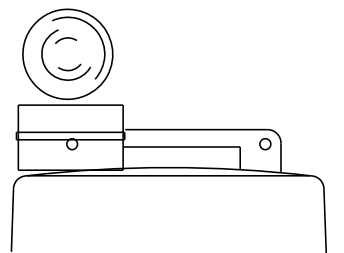


Type C Warning Light or approved substitute mounted on a drum adjacent to the travel way.

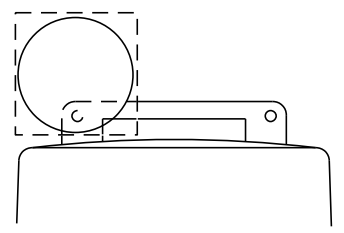

Warning reflector may be round or square. Must have a yellow reflective surface area of at least 30 square inches

Arrow Boards may be located behind channelizing devices in place for a shoulder taper or merging taper, otherwise they shall be delineated with four (4) channelizing devices placed perpendicular to traffic on the upstream side of traffic.

- The Flashing Arrow Board should be used for all lane closures on multi-lane roadways, or slow moving maintenance or construction activities on the travel lanes.
- Flashing Arrow Boards should not be used on two-lane, two-way roadways, detours, diversions or work on shoulders unless the "CAUTION" display (see detail below) is used.
- The Engineer/Inspector shall choose all appropriate signs, barricades and/or other traffic control devices that should be used in conjunction with the Flashing Arrow Board.
- The Flashing Arrow Board should be able to display the following symbols:

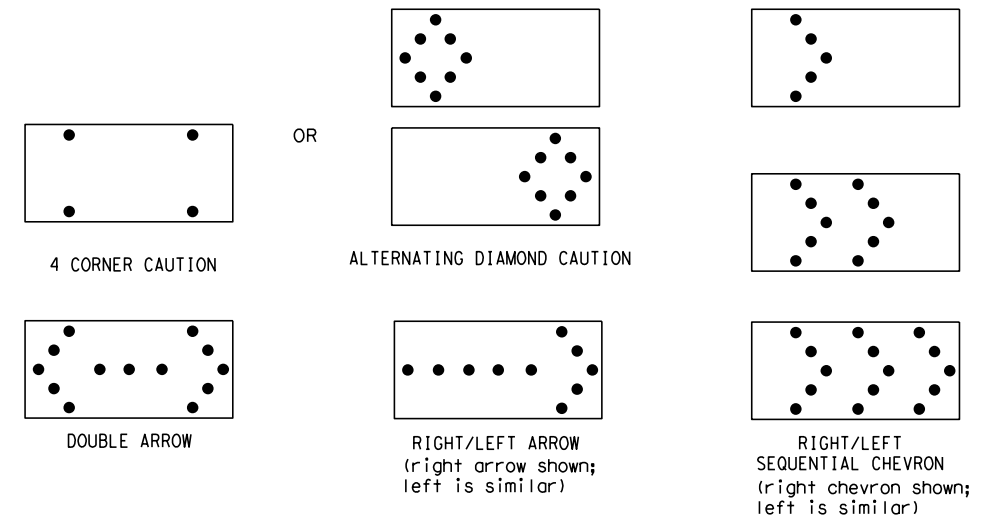

- The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
- The straight line caution display is NOT ALLOWED.
- The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.
- Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.
- The sequential arrow display is NOT ALLOWED.
- The flashing arrow display is the TxDOT standard; however, the sequential chevron display may be used during daylight operations.
- The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.
- A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.
- A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.
- Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway to bottom of panel.

REQUIREMENTS			
TYPE	MINIMUM SIZE	MINIMUM NUMBER OF PANEL LAMPS	MINIMUM VISIBILITY DISTANCE
B	30 x 60	13	3/4 mile
C	48 x 96	15	1 mile

**ATTENTION**  
 Flashing Arrow Boards shall be equipped with automatic dimming devices.

WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE ARROW BOARD BEHIND CONCRETE TRAFFIC BARRIER OR GUARDRAIL.

FLASHING ARROW BOARDS

SHEET 7 OF 12

TRUCK-MOUNTED ATTENUATORS

- Truck-mounted attenuators (TMA) used on TxDOT facilities must meet the requirements outlined in the Manual for Assessing Safety Hardware (MASH).
- Refer to the CWZTCD for the requirements of Level 2 or Level 3 TMAs.
- Refer to the CWZTCD for a list of approved TMAs.
- TMAs are required on freeways unless otherwise noted in the plans.
- A TMA should be used anytime that it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.
- The only reason a TMA should not be required is when a work area is spread down the roadway and the work crew is an extended distance from the TMA.



BARRICADE AND CONSTRUCTION ARROW PANEL, REFLECTORS, WARNING LIGHTS & ATTENUATOR

BC (7) - 21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0917	31	031	CR				
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	BRY	MADISON	11G					

DATE: 4/28/2023 10:15:49 AM  
 FILE: \\Project\wise\AMER\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\TCP\bc-21.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**GENERAL NOTES**

- For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
- For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections, one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
- For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
- Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
- The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

**GENERAL DESIGN REQUIREMENTS**




- Pre-qualified plastic drums shall meet the following requirements:
- Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
  - The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
  - Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
  - Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
  - The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
  - The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectorized space between any two adjacent stripes shall not exceed 2 inches in width.
  - Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
  - Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
  - Drum body shall have a maximum unballasted weight of 11 lbs.
  - Drum and base shall be marked with manufacturer's name and model number.

**RETROREFLECTIVE SHEETING**

- The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials." Type A or Type B reflective sheeting shall be supplied unless otherwise specified in the plans.
- The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.


**BALLAST**

- Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
- Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
- Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
- The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
- When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
- Ballast shall not be placed on top of drums.
- Adhesives may be used to secure base of drums to pavement.

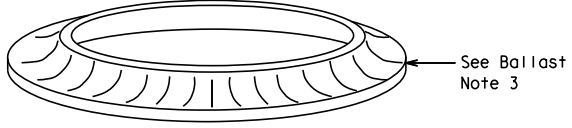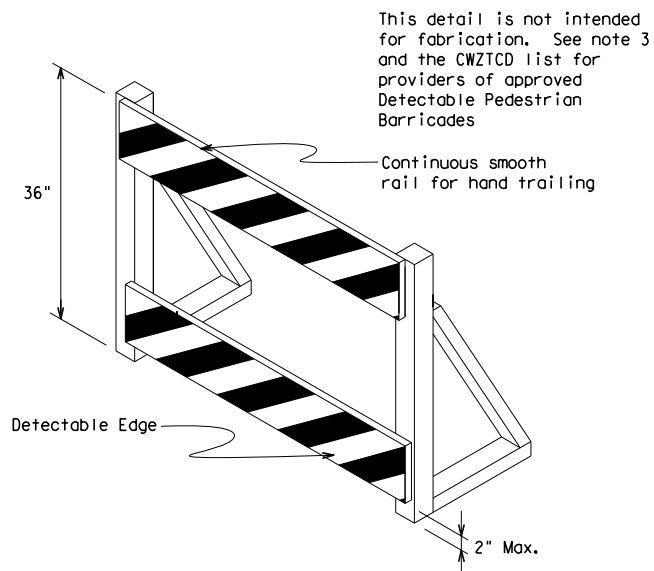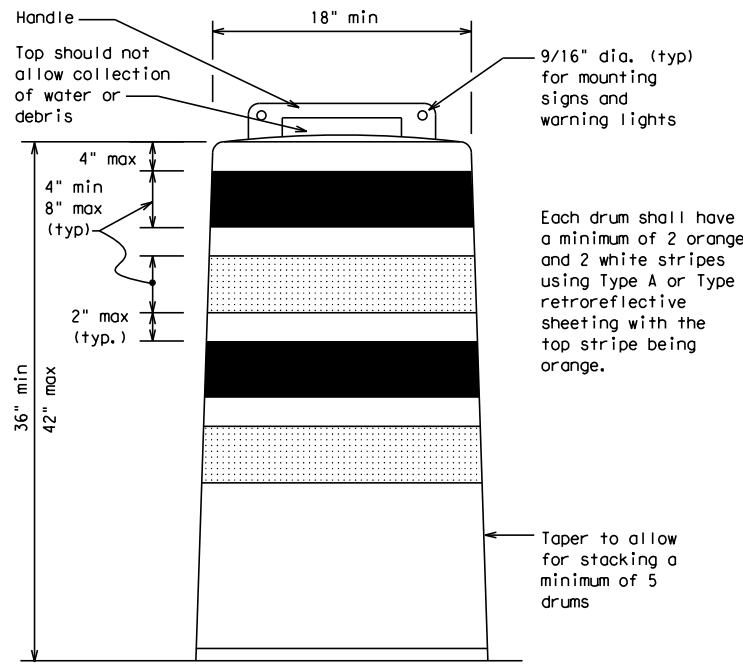

**DETECTABLE PEDESTRIAN BARRICADES**

- When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility. Refer to WZ(BTS-2) for Pedestrian Control requirements for Sidewalk Diversions, Sidewalk Detours and Crosswalk Closures.
- Where pedestrians with visual disabilities normally use the closed sidewalk, a Detectable Pedestrian Barricade shall be placed across the full width of the closed sidewalk instead of a Type 3 Barricade.
- Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
- Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines (ADAAG)" and should not be used as a control for pedestrian movements.
- Warning lights shall not be attached to detectable pedestrian barricades.
- Detectable pedestrian barricades should use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.

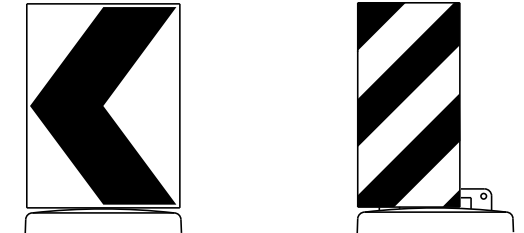

18" x 24" Sign (Maximum Sign Dimension)  
Chevron CW1-8, Opposing Traffic Lane Divider, Driveway sign D70a, Keep Right R4 series or other signs as approved by Engineer

12" x 24" Vertical Panel  
mount with diagonals sloping down towards travel way

Plywood, Aluminum or Metal sign substrates shall NOT be used on plastic drums

**SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS**

- Signs used on plastic drums shall be manufactured using substrates listed on the CWZTCD.
- Chevrons and other work zone signs with an orange background shall be manufactured with Type B<sub>FL</sub> or Type C<sub>FL</sub> Orange sheeting meeting the color and retroreflectivity requirements of DMS-8300, "Sign Face Material," unless otherwise specified in the plans.
- Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A or Type B. Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane.
- Other sign messages (text or symbolic) may be used as approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below.
- Signs shall be installed using a 1/2 inch bolt (nominal) and nut, two washers, and one locking washer for each connection.
- Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2 inch beyond nuts.
- Chevrons may be placed on drums on the outside of curves, on merging tapers or on shifting tapers. When used in these locations, they may be placed on every drum or spaced not more than on every third drum. A minimum of three (3) should be used at each location called for in the plans.
- R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.

SHEET 8 OF 12




**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (8) - 21**

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0917	31	031	CR				
4-03	8-14	DIST	COUNTY	SHEET NO.					
9-07	5-21	BRY	MADISON	11H					
7-13									


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/28/2023 10:15:49 AM  
 FILE: \\Project\wise\AME\jacobson\US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\TCP\bc-21.dgn

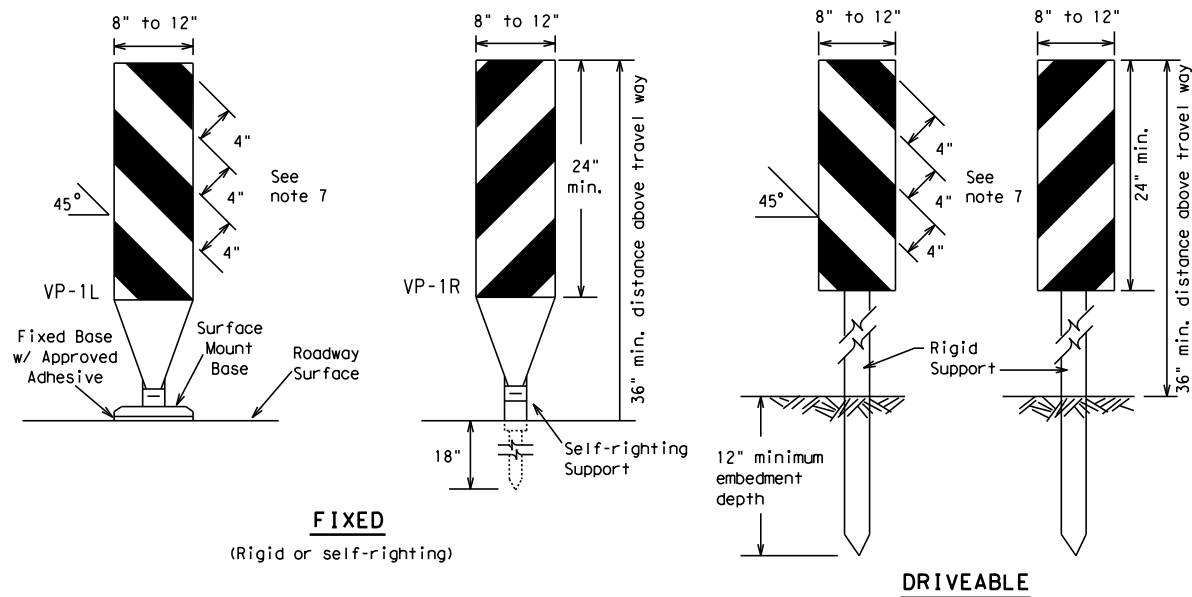

**FIXED**  
(Rigid or self-righting)


**DRIVEABLE**

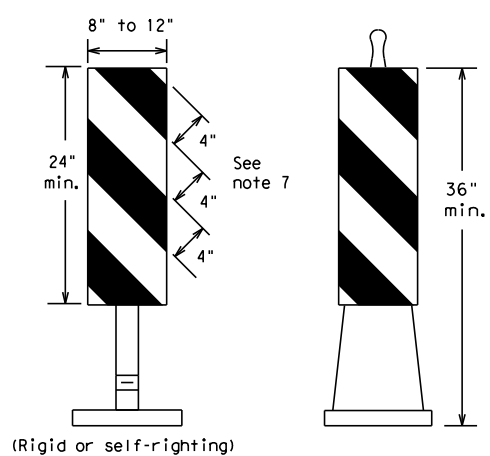

**PORTABLE**


**VERTICAL PANELS (VPs)**

- Vertical Panels (VP's) are normally used to channelize traffic or divide opposing lanes of traffic.
- VP's may be used in daytime or nighttime situations. They may be used at the edge of shoulder drop-offs and other areas such as lane transitions where positive daytime and nighttime delineation is required. The Engineer/Inspector shall refer to the Roadway Design Manual for additional requirements on the use VP's for drop-offs.
- VP's should be mounted back to back if used at the edge of cuts adjacent to two-way two lane roadways. Stripes are to be reflective orange and reflective white and should always slope downward toward the travel lane.
- VP's used on expressways and freeways or other high speed roadways, may have more than 270 square inches of retroreflective area facing traffic.
- Self-righting supports are available with portable base. See "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Sheeting for the VP's shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300, unless noted otherwise.
- Where the height of reflective material on the vertical panel is 36 inches or greater, a panel stripe of 6 inches shall be used.

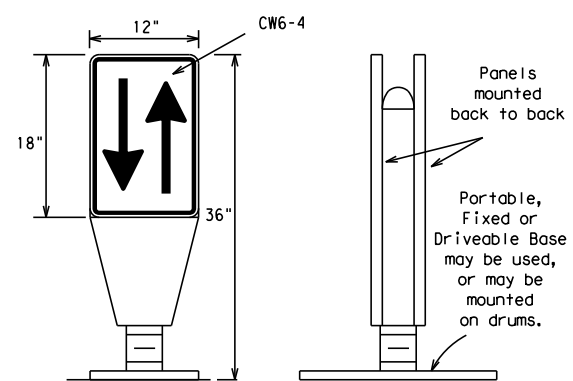


**OPPOSING TRAFFIC LANE DIVIDERS (OTLD)**

- Opposing Traffic Lane Dividers (OTLD) are delineation devices designed to convert a normal one-way roadway section to two-way operation. OTLD's are used on temporary centerlines. The upward and downward arrows on the sign's face indicate the direction of traffic on either side of the divider. The base is secured to the pavement with an adhesive or rubber weight to minimize movement caused by a vehicle impact or wind gust.
- The OTLD may be used in combination with 42" cones or VPs.
- Spacing between the OTLD shall not exceed 500 feet. 42" cones or VPs placed between the OTLD's should not exceed 100 foot spacing.
- The OTLD shall be orange with a black non-reflective legend. Sheeting for the OTLD shall be retroreflective Type B<sub>FL</sub> or Type C<sub>FL</sub> conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.

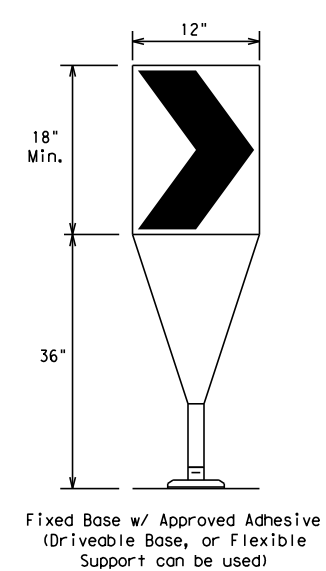

- The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
- Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
- Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
- To be effective, the chevron should be visible for at least 500 feet.
- Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type B<sub>FL</sub> or Type C<sub>FL</sub> conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
- For Long Term Stationary use on tapers or transitions on freeways and divided highways, self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

**CHEVRONS**

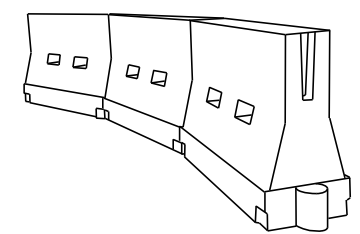

**LONGITUDINAL CHANNELIZING DEVICES (LCD)**

- LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
- LCDs may be used instead of a line of cones or drums.
- LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
- LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
- LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10). Place reflective sheeting near the top of the LCD along the full length of the device.

**WATER BALLASTED SYSTEMS USED AS BARRIERS**

- Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate Manual for Assessing Safety Hardware (MASH) crashworthiness requirements based on roadway speed and barrier application.
- Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
- Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
- When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long canes and the top of the unit shall not be less than 32 inches in height.

**HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS**

**GENERAL NOTES**

- Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
- Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
- Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
- Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
- The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.

Posted Speed	Formula	Minimum Desirable Taper Lengths * *			Suggested Maximum Spacing of Channelizing Devices	
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent
30	L = WS <sup>2</sup> / 60	150'	165'	180'	30'	60'
35		205'	225'	245'	35'	70'
40		265'	295'	320'	40'	80'
45	L = WS	450'	495'	540'	45'	90'
50		500'	550'	600'	50'	100'
55		550'	605'	660'	55'	110'
60		600'	660'	720'	60'	120'
65		650'	715'	780'	65'	130'
70		700'	770'	840'	70'	140'
75		750'	825'	900'	75'	150'
80		800'	880'	960'	80'	160'

\* \* \* Taper lengths have been rounded off.  
 L=Length of Taper (FT.) W=Width of Offset (FT.)  
 S=Posted Speed (MPH)

**SUGGESTED MAXIMUM SPACING OF CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS**

SHEET 9 OF 12



**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (9) - 21**


FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0917	31	031	CR				
9-07	8-14	DIST	COUNTY		SHEET NO.				
7-13	5-21	BRY	MADISON		111				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.  
 DATE: 4/28/2023 10:15:49 AM  
 FILE: pw:\Project\wise\AMER\_jacobs.com\Jacobs\_US\_B\_I\_S54\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\TCP\bc-21.dgn


**TYPE 3 BARRICADES**

1. Refer to the Compliant Work Zone Traffic Control Devices List (CWZTCD) for details of the Type 3 Barricades and a list of all materials used in the construction of Type 3 Barricades.
2. Type 3 Barricades shall be used at each end of construction projects closed to all traffic.
3. Barricades extending across a roadway should have stripes that slope downward in the direction toward which traffic must turn in detouring. When both right and left turns are provided, the chevron striping may slope downward in both directions from the center of the barricade. Where no turns are provided at a closed road, striping should slope downward in both directions toward the center of roadway.
4. Striping of rails, for the right side of the roadway, should slope downward to the left. For the left side of the roadway, striping should slope downward to the right.
5. Identification markings may be shown only on the back of the barricade rails. The maximum height of letters and/or company logos used for identification shall be 1".
6. Barricades shall not be placed parallel to traffic unless an adequate clear zone is provided.
7. Warning lights shall NOT be installed on barricades.
8. Where barricades require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand is recommended. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight. Sand bags shall not be stacked in a manner that covers any portion of a barricade rails reflective sheeting. Rock, concrete, iron, steel or other solid objects will NOT be permitted. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall not be used for sandbags. Sandbags shall only be placed along or upon the base supports of the device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners.
9. Sheeting for barricades shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300 unless otherwise noted.

Barricades shall NOT be used as a sign support.




**TYPICAL STRIPING DETAIL FOR BARRICADE RAIL**

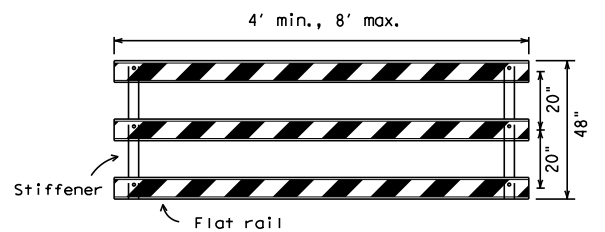


**TYPICAL PANEL DETAIL FOR SKID OR POST TYPE BARRICADES**

Each roadway of a divided highway shall be barricaded in the same manner.

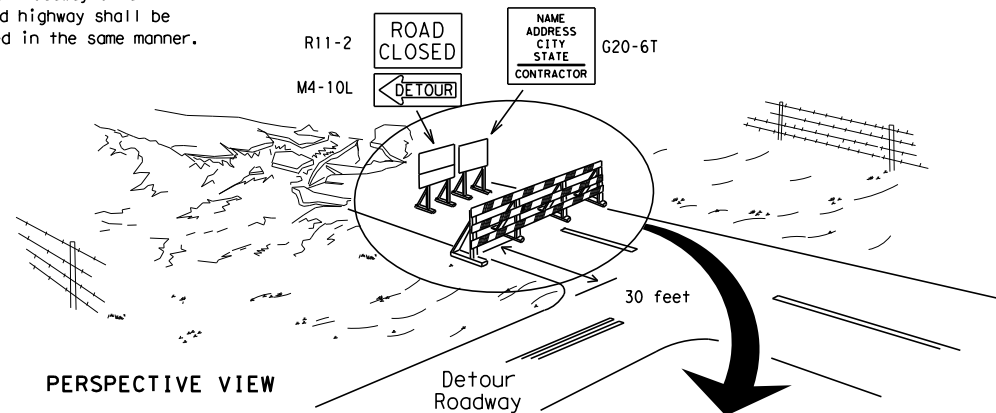

PERSPECTIVE VIEW


The three rails on Type 3 barricades shall be reflectorized orange and reflective white stripes on one side facing one-way traffic and both sides for two-way traffic. Barricade striping should slant downward in the direction of detour.

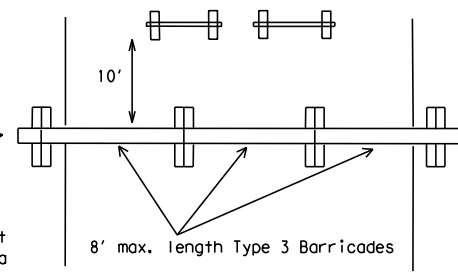


PLAN VIEW

1. Signs should be mounted on independent supports at a 7 foot mounting height in center of roadway. The signs should be a minimum of 10 feet behind Type 3 Barricades.
2. Advance signing shall be as specified elsewhere in the plans.

**TYPE 3 BARRICADE (POST AND SKID) TYPICAL APPLICATION**

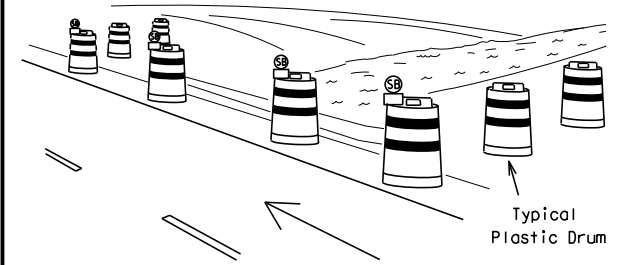

PERSPECTIVE VIEW

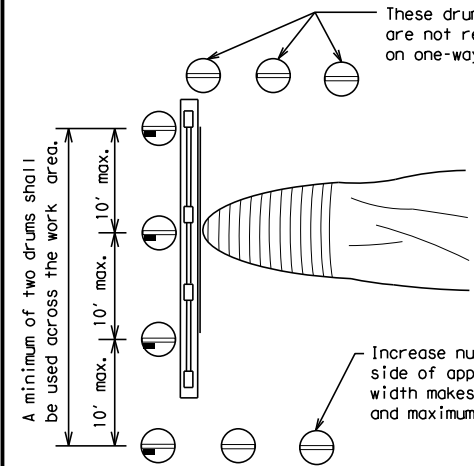


PLAN VIEW

**CULVERT WIDENING OR OTHER ISOLATED WORK WITHIN THE PROJECT LIMITS**

1. Where positive redirection capability is provided, drums may be omitted.
2. Plastic construction fencing may be used with drums for safety as required in the plans.
3. Vertical Panels on flexible support may be substituted for drums when the shoulder width is less than 4 feet.
4. When the shoulder width is greater than 12 feet, steady-burn lights may be omitted if drums are used.
5. Drums must extend the length of the culvert widening.

LEGEND	
	Plastic drum
	Plastic drum with steady burn light or yellow warning reflector
	Steady burn warning light or yellow warning reflector

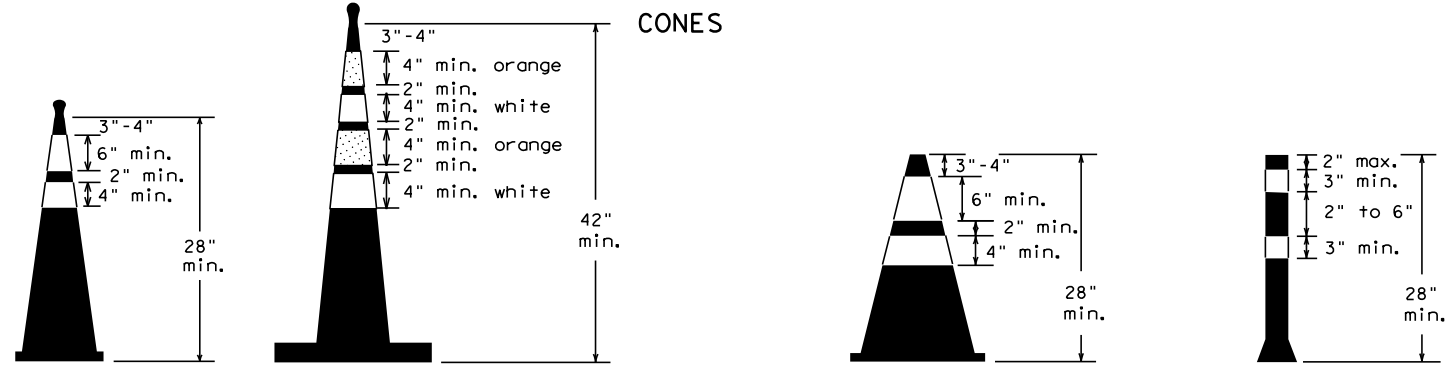


Two-Piece cones

One-Piece cones

Tubular Marker

28" Cones shall have a minimum weight of 9 1/2 lbs.  
 42" 2-piece cones shall have a minimum weight of 30 lbs. including base.

1. Traffic cones and tubular markers shall be predominantly orange, and meet the height and weight requirements shown above.
2. One-piece cones have the body and base of the cone molded in one consolidated unit. Two-piece cones have a cone shaped body and a separate rubber base, or ballast, that is added to keep the device upright and in place.
3. Two-piece cones may have a handle or loop extending up to 8" above the minimum height shown, in order to aid in retrieving the device.
4. Cones or tubular markers shall have white or white and orange reflective bands as shown above. The reflective bands shall have a smooth, sealed outer surface and meet the requirements of Departmental Material Specification DMS-8300 Type A or Type B.
5. 28" cones and tubular markers are generally suitable for short duration and short-term stationary work as defined on BC(4). These should not be used for intermediate-term or long-term stationary work unless personnel is on-site to maintain them in their proper upright position.
6. 42" two-piece cones, vertical panels or drums are suitable for all work zone durations.
7. Cones or tubular markers used on each project should be of the same size and shape.

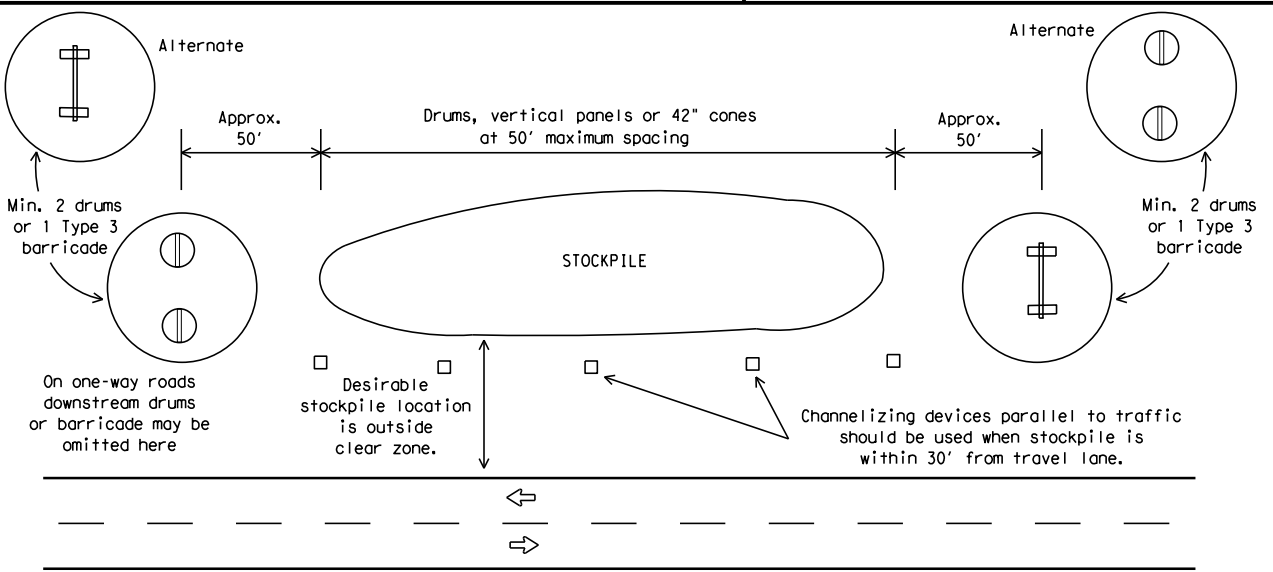

**TRAFFIC CONTROL FOR MATERIAL STOCKPILES**



**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (10) - 21**

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	BRY	MADISON	11J	

## WORK ZONE PAVEMENT MARKINGS

### GENERAL

- The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
- Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Additional supplemental pavement marking details may be found in the plans or specifications.
- Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
- When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
- When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
- All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

### RAISED PAVEMENT MARKERS

- Raised pavement markers are to be placed according to the patterns on BC(12).
- All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

### PREFABRICATED PAVEMENT MARKINGS

- Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
- Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


### MAINTAINING WORK ZONE PAVEMENT MARKINGS

- The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
- Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
- The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
- Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

### REMOVAL OF PAVEMENT MARKINGS

- Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
- The above shall not apply to detours in place for less than three days, where flaggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
- Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
- The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
- Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
- Blast cleaning may be used but will not be required unless specifically shown in the plans.
- Over-painting of the markings SHALL NOT BE permitted.
- Removal of raised pavement markers shall be as directed by the Engineer.
- Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
- Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

## Temporary Flexible-Reflective Roadway Marker Tabs

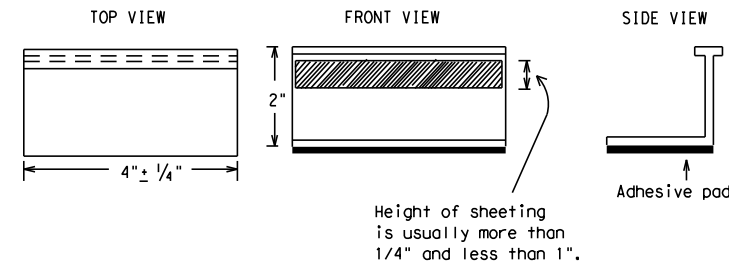

**STAPLES OR NAILS SHALL NOT BE USED TO SECURE  
TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARKER  
TABS TO THE PAVEMENT SURFACE**

- Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242.
- Tabs detailed on this sheet are to be inspected and accepted by the Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" or "B" below may be imposed to assure quality before placement on the roadway.
  - Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance.
  - Select five (5) tabs and perform the following test. Affix five (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed of 35 to 40 miles per hour, four (4) times in each direction. No more than one (1) out of the five (5) reflective surfaces shall be lost or displaced as a result of this test.
- Small design variances may be noted between tab manufacturers.
- See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work.

### RAISED PAVEMENT MARKERS USED AS GUIDEMARKS

- Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200.
- All temporary construction raised pavement markers provided on a project shall be of the same manufacturer.
- Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete surfaces.

Guidemarks shall be designated as:  
 YELLOW - (two amber reflective surfaces with yellow body).  
 WHITE - (one silver reflective surface with white body).

DEPARTMENTAL MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
TRAFFIC BUTTONS	DMS-4300
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8241
TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242

A list of prequalified reflective raised pavement markers, non-reflective traffic buttons, roadway marker tabs and other pavement markings can be found at the Material Producer List web address shown on BC(1).

SHEET 11 OF 12



## BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS

BC(11)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
2-98 9-07 5-21	DIST	COUNTY	SHEET NO.	
1-02 7-13	BRY	MADISON	11K	
11-02 8-14				


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act." No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/28/2023 10:15:50 AM


FILE: \\Project\wise\AMEER\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity STV700\_CADD\STND\TCP\bc-21.dgn



## PAVEMENT MARKING PATTERNS

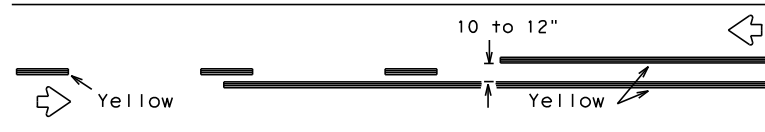


REFLECTORIZED PAVEMENT MARKINGS - PATTERN A

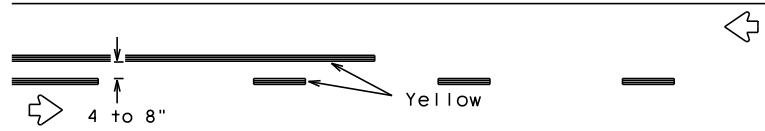


REFLECTORIZED PAVEMENT MARKINGS - PATTERN B

Pattern A is the TXDOT Standard, however Pattern B may be used if approved by the Engineer. Prefabricated markings may be substituted for reflectORIZED pavement markings.

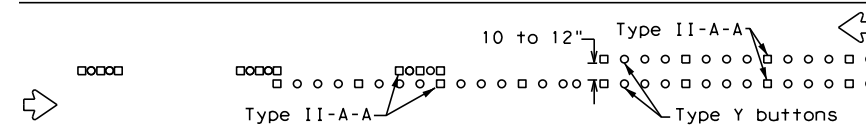


RAISED PAVEMENT MARKERS - PATTERN A

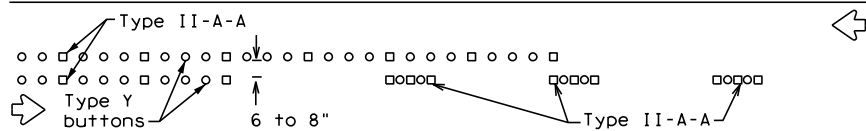


RAISED PAVEMENT MARKERS - PATTERN B

## CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO-LANE, TWO-WAY HIGHWAYS

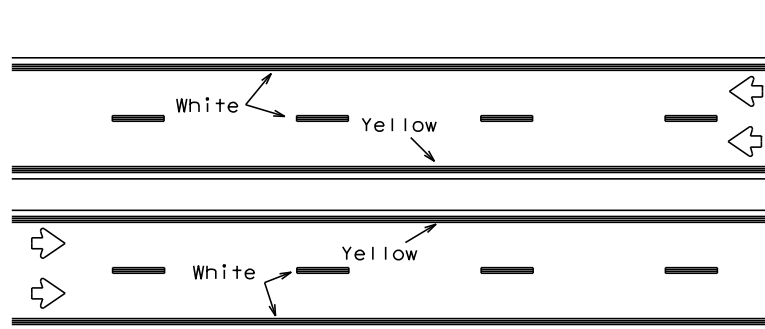


REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

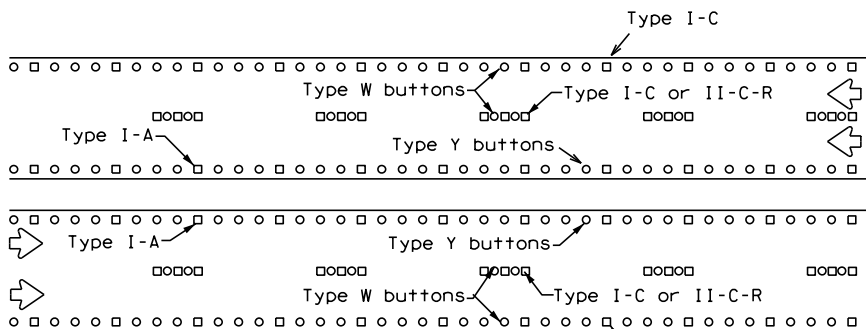


RAISED PAVEMENT MARKERS

## EDGE & LANE LINES FOR DIVIDED HIGHWAY

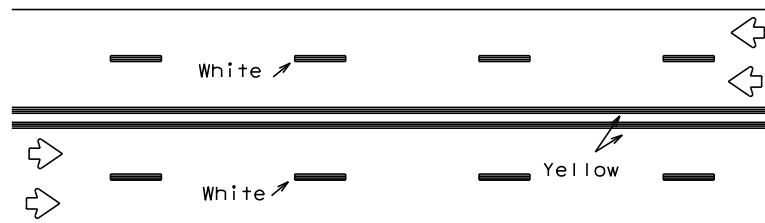


REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

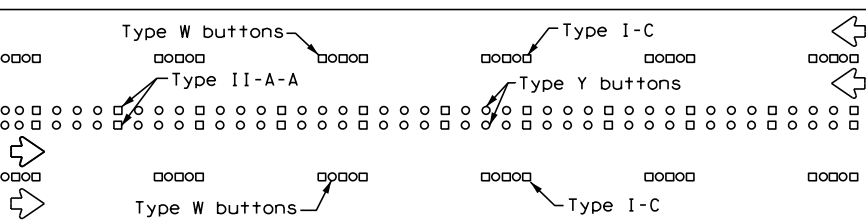


RAISED PAVEMENT MARKERS

## LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

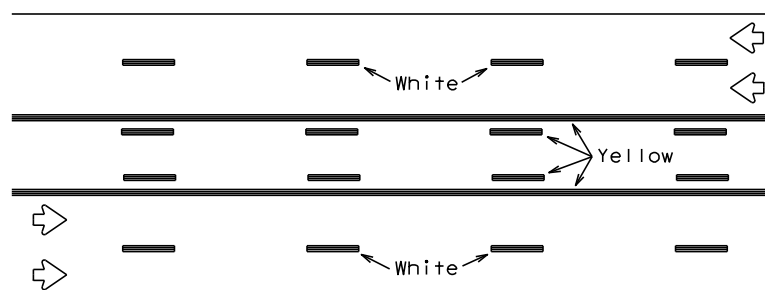

REFLECTORIZED PAVEMENT MARKINGS


Prefabricated markings may be substituted for reflectORIZED pavement markings.

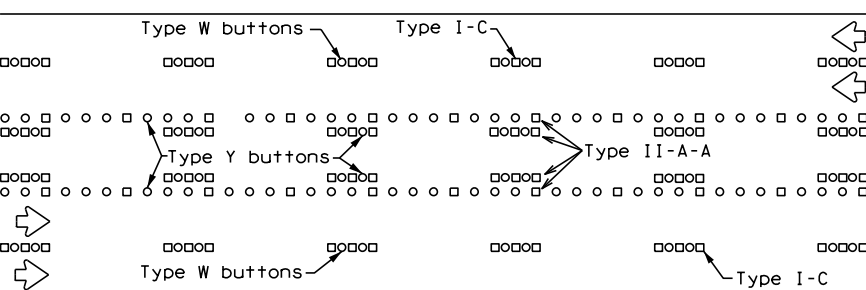



RAISED PAVEMENT MARKERS

## TWO-WAY LEFT TURN LANE


## STANDARD WORK ZONE PAVEMENT MARKINGS DETAILS

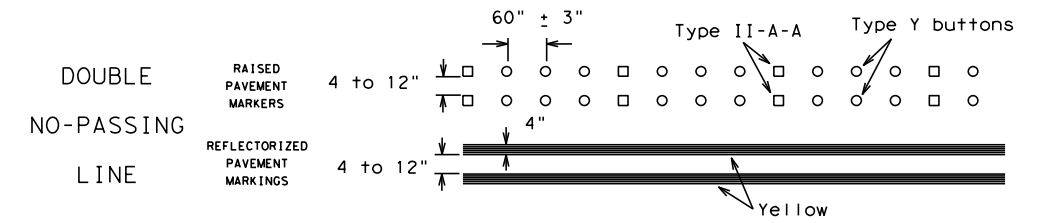


### SOLID LINES

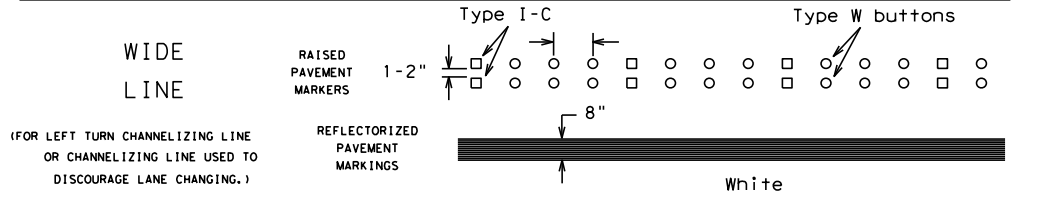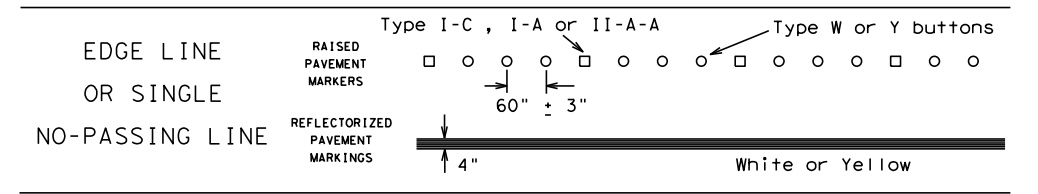

### BROKEN LINES

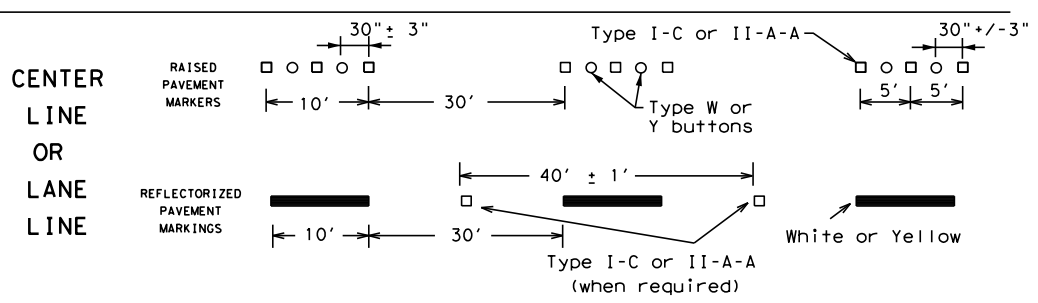


### AUXILIARY OR LANEDROP LINE

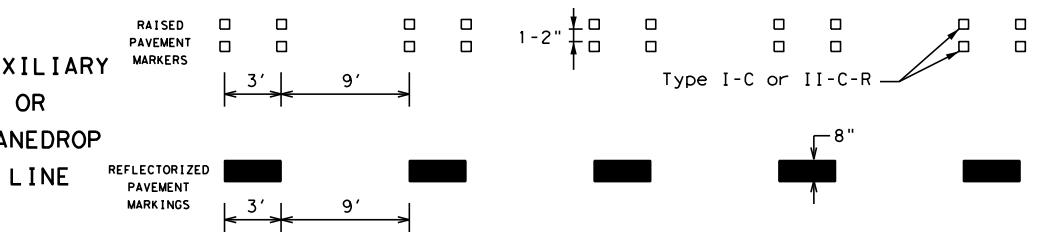

### REMOVABLE MARKINGS WITH RAISED PAVEMENT MARKERS

If raised pavement markers are used to supplement REMOVABLE markings, the markers shall be applied to the top of the tape at the approximate mid length of tape used for broken lines or at 20 foot spacing for solid lines. This allows an easier removal of raised pavement markers and tape.

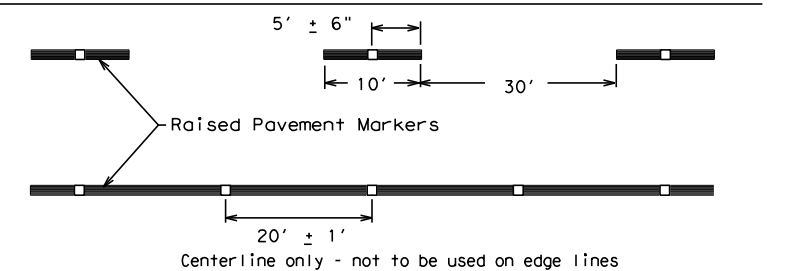

SHEET 12 OF 12



## BARRICADE AND CONSTRUCTION PAVEMENT MARKING PATTERNS

BC(12)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
1-97 9-07 5-21	DIST	COUNTY	SHEET NO.	
2-98 7-13	BRY	MADISON	11L	
11-02 8-14				


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TXDOT for any purpose whatsoever. TXDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/28/2023 10:15:50 AM  
FILE: \\Project\wise\BRY\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\700\_CADD\STND\TCP\bc-21.dgn


Raised pavement markers used as standard pavement markings shall be from the approved products list and meet the requirements of Item 672 "RAISED PAVEMENT MARKERS."

# DEFINITION OF TREATMENT ZONES FOR VARIOUS EDGE CONDITIONS


Edge Height (D) in Inches versus Lateral Clearance (Y) in Feet

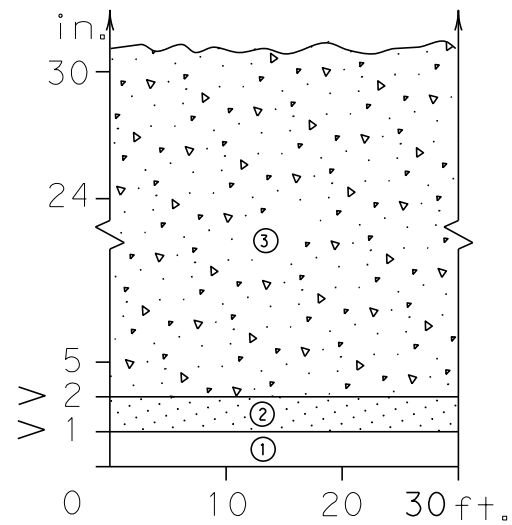




Edge Condition I  
S = (3:1) (or flatter)

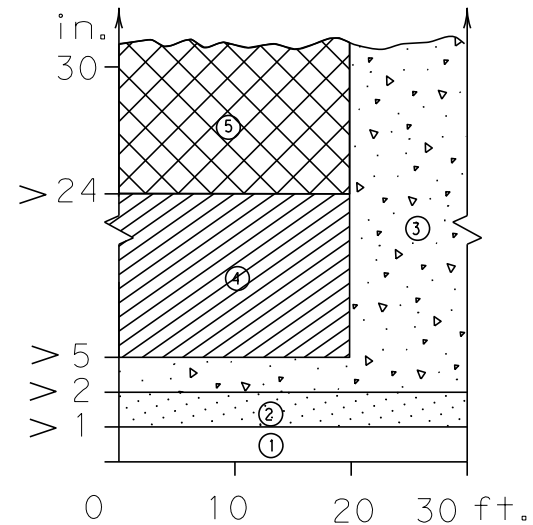

Edge Condition II  
S = ((2.99):1) to (1:1)

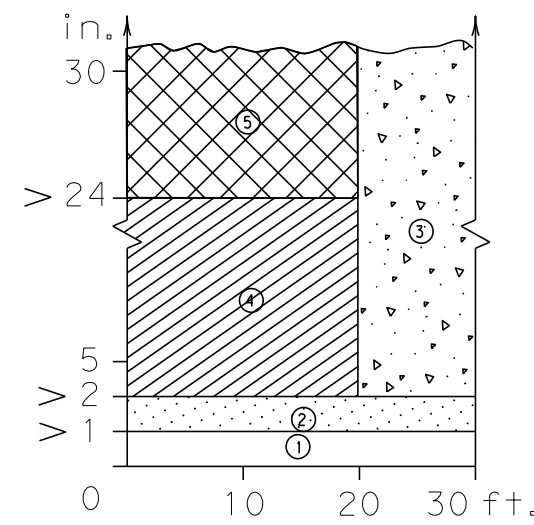

Edge Condition III  
S is steeper than (1:1)

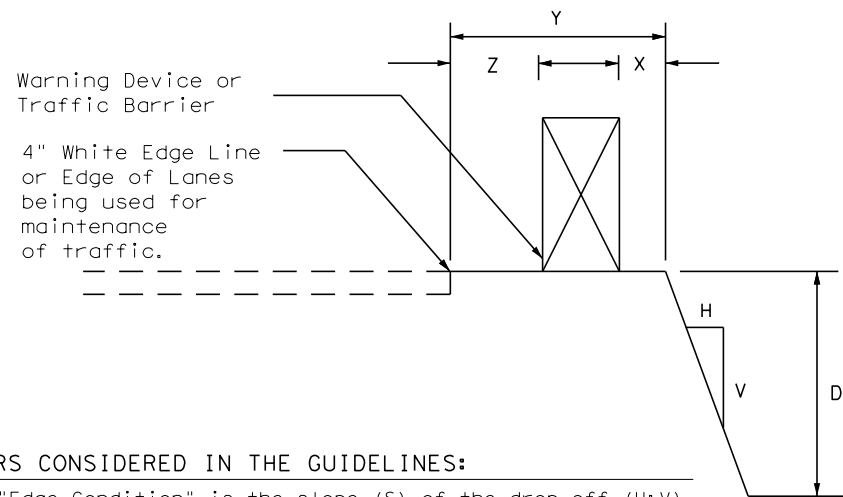

### FACTORS CONSIDERED IN THE GUIDELINES:


- The "Edge Condition" is the slope (S) of the drop-off (H:V). The "Edge Height" is the depth of the drop-off "D".
- Distance "X" is to be the maximum practical under job conditions. Two feet minimum for high speed conditions. Distance "Y" is the lateral clearance from edge of travel lane to edge of dropoff. Distance "Z" does not have a minimum.
- In addition to the factors considered in the guidelines, each construction zone drop-off situation should be analyzed individually, taking into account other variables, such as: traffic mix, posted speed in the construction zone, horizontal curvature, and the practicality of the treatment options.
- The conditions for indicating the use of positive or protective barriers are given by Zone-5 and Figure-1. Traffic barriers are primarily applicable for high speed conditions. Urban areas with speeds of 30 mph or less may have a lesser need for signing, delineation, and barriers. Right-angled edges, however, with "D" greater than 2 inches and located within a lateral offset of 6 feet, may indicate a higher level of treatment.
- If the distance "Y" must be less than 3 feet, the use of a positive barrier may not be feasible. In such a case, consider either: 1) narrowing the lanes to a desired 11 to 12 feet or 10 foot minimum (see CW20-8 sign), or 2) provide an edge slope such as Edge Condition I.

Zone	Treatment Types Guidelines:
①	No treatment
②	CW 8-11 "Uneven Lanes" signs.
③	CW 8-9a Shoulder Drop-Off" or CW 8-11 signs plus vertical panels.
④	CW8-9a or CW 8-11, signs plus drums. Where restricted space precludes the use of drums, use vertical panels. An edge slope to that of the proferred Edge Condition I.
⑤	Check indications (Figure-1) for positive barrier. Where positive barrier is not indicated, the treatment shown above for Zone-4 may be used after consideration of other applicable factors.

### Edge Condition Notes:

- Edge Condition I: Most vehicles are able to traverse an edge condition with a slope rate of (3 to 1) or flatter. The slope must be constructed with a compacted material capable of supporting vehicles.
- Edge Condition II: Most vehicles are able to traverse an edge condition with a slope between (2.99 to 1) and (1 to 1) so long as "D" does not exceed 5 inches. Under-carriage drag on most automobiles will occur when "D" exceeds 6 inches. As "D" exceeds 24 inches, the possibility for rollover is greater in most vehicles.
- Edge Condition III: When slopes are greater than (1 to 1) and where "D" is greater than 2 inches, a more difficult control factor may exist for some vehicles, if not properly treated. For example, where "D" is greater than 2 inches and up to 24 inches different types of vehicles may experience different steering control at different edge heights. Automobiles might experience more steering control differential when "D" is greater than 2 inches and up to 5 inches. Trucks, particularly those with high loads, have more steering control differential when "D" is greater than 5 inches and up to 24 inches. When "D" exceeds 24 inches, the possibility of rollover is greater for most vehicles.
- Milling or overlay operations that result in Edge Condition III should not be in place without appropriate warning treatments, and these conditions should not be left in place for extended periods of time.

## FIGURE-1: CONDITIONS INDICATING USE OF POSITIVE BARRIER FOR ZONE 5 ( [Cross-hatched] )

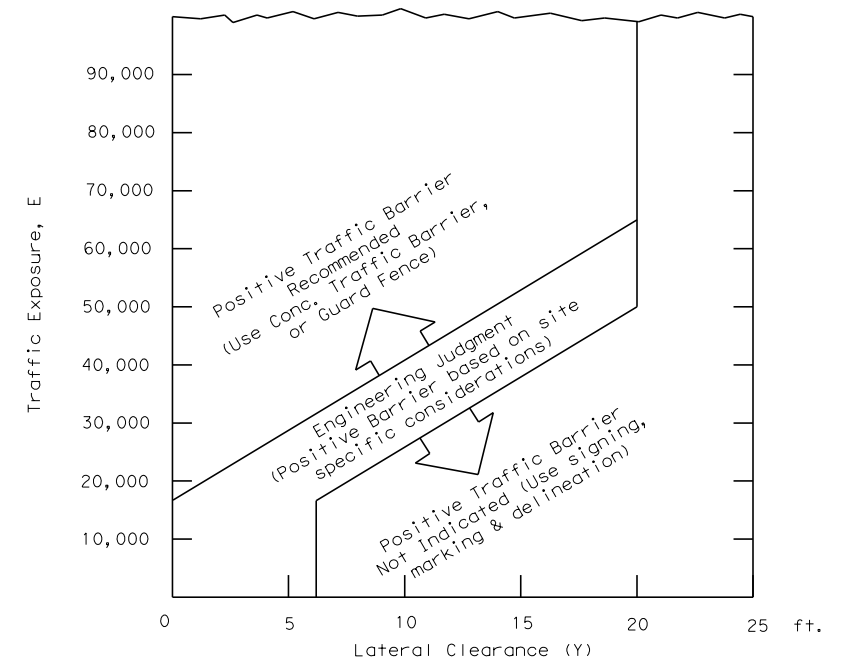

- $E = ADT \times T$   
Where ADT is that portion of the average daily traffic volume traveling within 20 feet (generally two adjacent lanes) of the edge dropoff condition; and, T is the duration time in years of the dropoff condition.
- Figure-1 provides a practical approach to the use of positive barriers for the protection of vehicles from pavement drop-offs. Other factors, such as the presence of heavy machinery, construction workers, or the mix and volume of traffic may make the use of positive barriers appropriate, even when the edge condition alone may not justify the use of a barrier.
- An approved end treatment should be provided for any positive barrier end located within the clear zone.



These guidelines apply to temporary traffic control areas or work zones where continuous pavement edges or drop-offs exists parallel and adjacent to a lane used by traffic. The edge conditions may be present between shoulders and travel lanes, between adjacent or opposing travel lanes, or at intermediate points across the width of the paved surface. Due to the variability in construction operations, tolerances in the variables may be allowed by the engineer. These guidelines do not apply to short term operations. These guidelines do not constitute a rigid standard or policy; rather, they are guidance to be used in conjunction with engineering judgement. These guidelines may be updated on the Design Division's on-line manuals.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or the use of the information herein for any purpose other than that for which it was prepared.

DATE: 3/30/2023 7:41:48 PM  
FILE: \\Project\wise\amer\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000.dgn

<h3>TREATMENT FOR VARIOUS EDGE CONDITIONS</h3>					
FILE:	edgecon.dgn	DN:	CK:	DW:	CK:
© TxDOT	August 2000	CONT	SECT	JOB	HIGHWAY
REVISIONS		0917	31	031	CR
03-01	08-01	DIST	COUNTY		SHEET NO.
9-21	BRY	MADISON		12	

11/28/2022 4:22:56 PM RETANAP J:\JOB\WF08701-36-01\DP5087 Map1 TxDOT FTW District Off System Bridges\700 CADD\713 Survey\713.4 Control Surveys\CONTROL WALNUT CREEK WF08701\WCCTRL.dgn

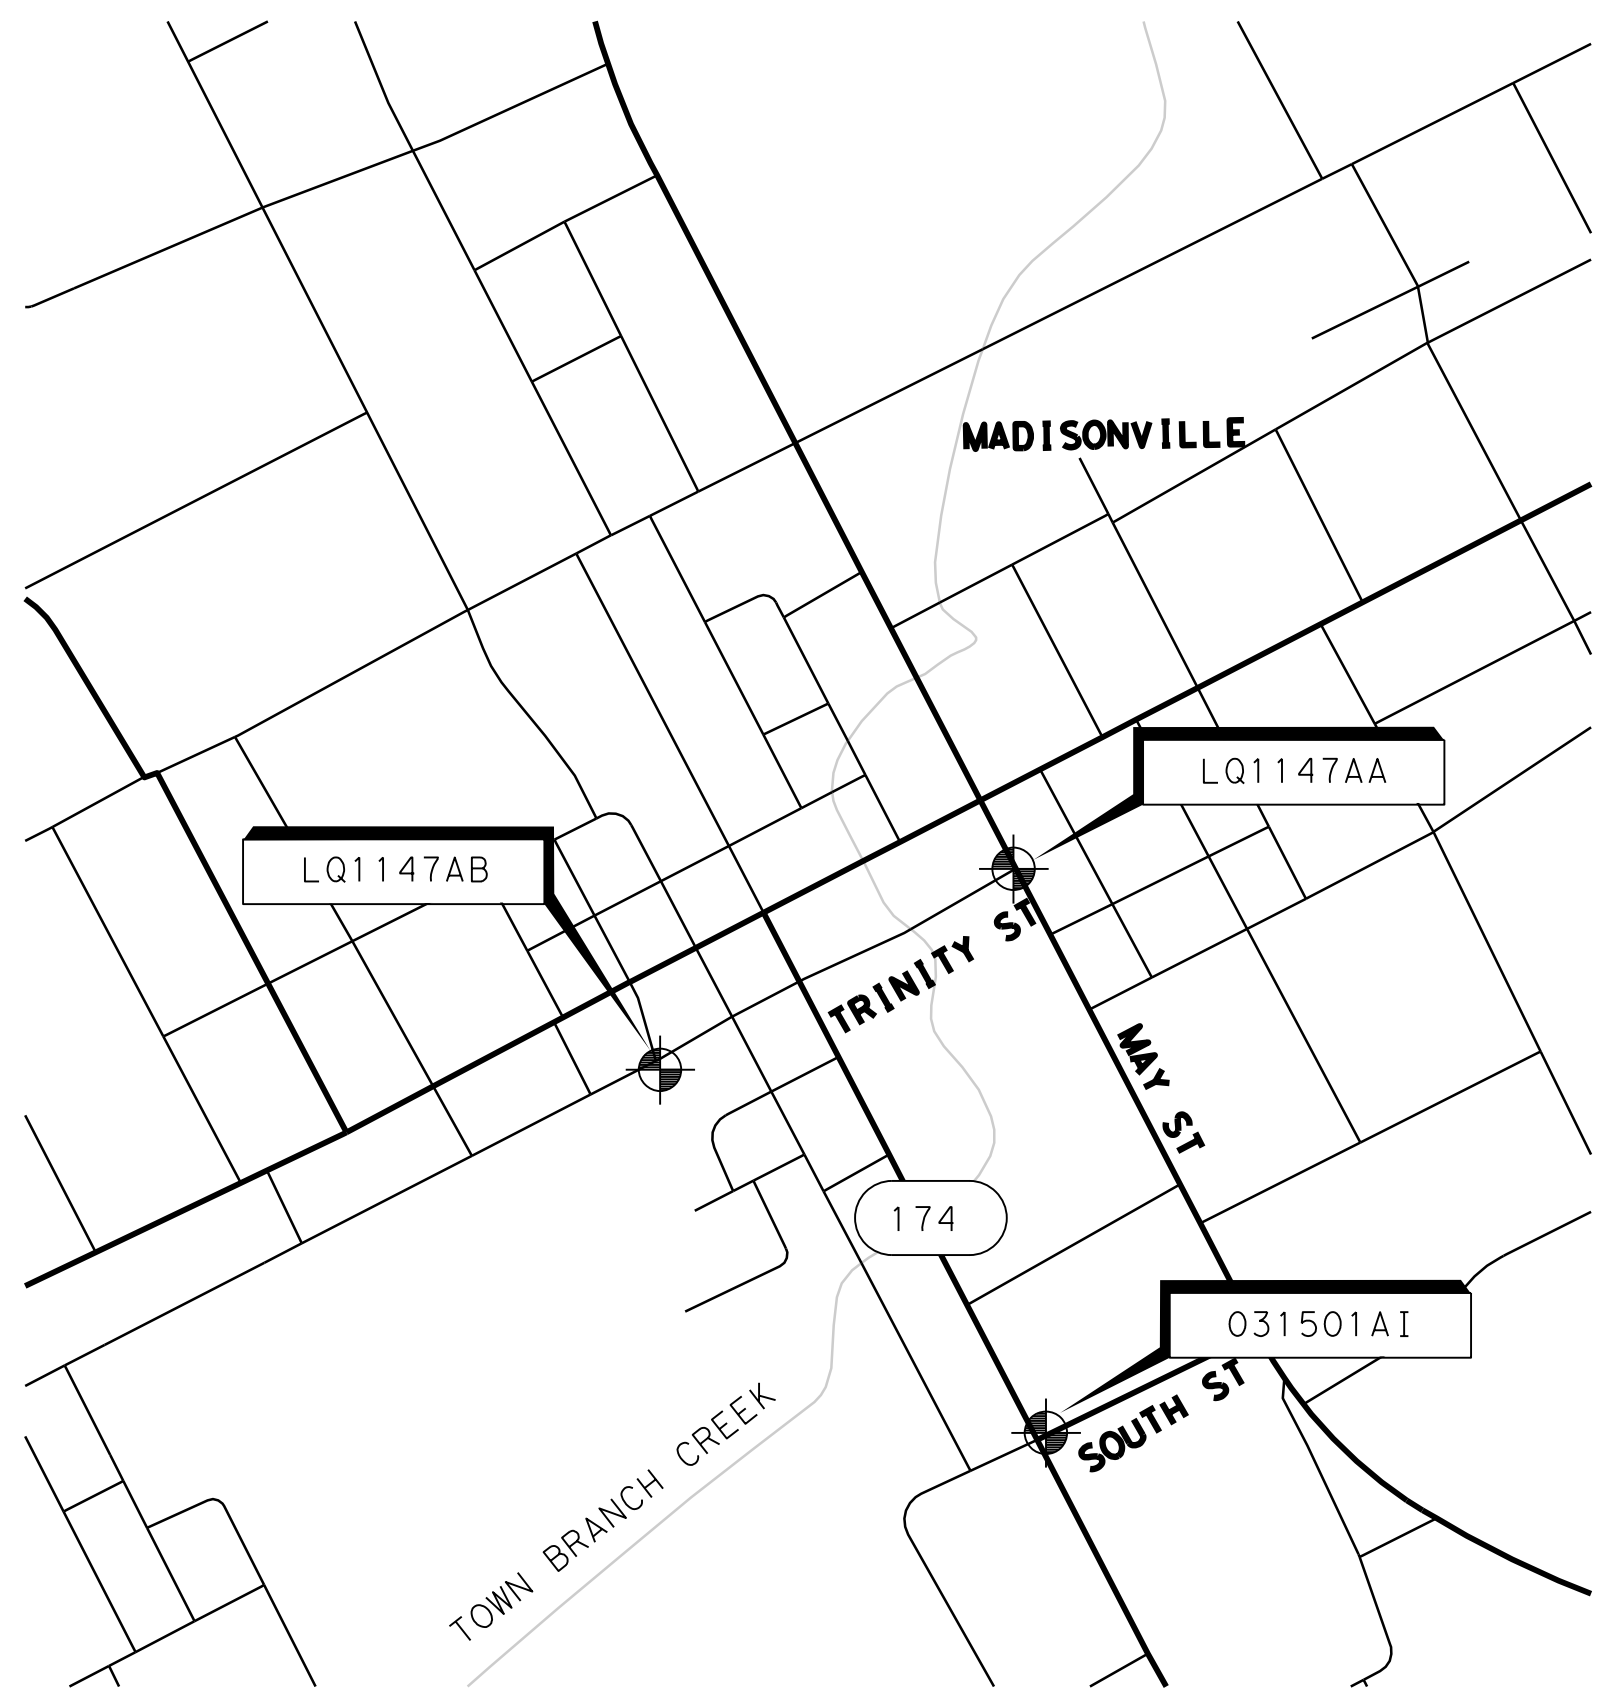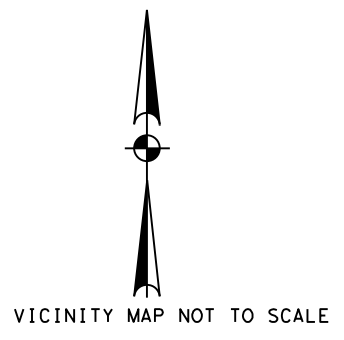

NOTES:  
 BEARING BASIS BEING GRID NORTH,  
 TEXAS COORDINATE SYSTEM, CENTRAL  
 ZONE (4203), NAD83 (NAD83 (2011  
 ADJUSTMENT) EPOCH 2010), DETERMINED  
 BY GPS OBSERVATIONS, CALCULATED FROM  
 THE TxDOT REAL TIME NETWORK (RTN)  
 STATION MADISONVILLE (TXMD RRP ARP  
 DR8272). ALL COORDINATES AND  
 DISTANCES SHOWN ARE US SURVEY FEET  
 DISPLAYED IN SURFACE VALUES AND MAY  
 BE CONVERTED TO GRID BY MULTIPLYING  
 BY THE TxDOT COUNTY WIDE SCALE  
 FACTOR OF 1.00012. ALL ELEVATIONS  
 SHOWN HEREIN ARE REFERENCED TO THE  
 NORTH AMERICAN VERTICAL DATUM OF  
 1988 (NAVD88) AS DETERMINED BY THE  
 TxDOT REAL TIME NETWORK (RTN) GEOID  
 09.

PROJECT BENCHMARK: 031501AI  
 EXISTING TxDOT PRIMARY CONTROL  
 BENCHMARK:  
 5/8 INCH IRON ROD WITH 3-1/4 INCH  
 ALUMINUM DISK STAMPED "031501AI"  
 LOCATED ALONG LOOP 174, APPROXIMATELY  
 165 FEET NORTH OF THE INTERSECTION OF  
 SH90 AND SOUTH LN, 7 FEET NORTHEAST  
 OF A NAIL WITH SHINER, APPROXIMATELY  
 43 FEET NORTHWEST OF A "NO TRUCKS"  
 SIGN, AND APPROXIMATELY 51 FEET SOUTH  
 OF "NORTH SPUR 174" SIGN.

SURFACE  
 NORTHING: 10,336,065.439 (MEASURED)  
 EASTING: 3,682,889.087 (MEASURED)  
 ELEV: 255.260' (PUBLISHED)  
 GRID  
 NORTHING: 10,334,825.17' (PUBLISHED)  
 EASTING: 3,682,447.17' (PUBLISHED)  
 ELEV: 255.260' (PUBLISHED)



*Mark E. Keeton* 11/28/2022  
 MARK E. KEETON DATE  
 RPLS NO. 6790

NO.	REVISIONS	BY	DATE



**SURVEY CONTROL**

Point ID	Latitude (Global)	Longitude (Global)	Northing (Grid)	Easting (Grid)	Northing (Surface)	Easting (Surface)	Elevation	Ellipsoid Height (Global)	Feature Code
LQ1147AA	30°56'57.99949"	-95°54'40.80390"	10,336,588.366	3,682,346.066	10,337,828.757	3,682,787.948	253.227'	165.257'	3 1/2-INCH ALUMINUM DISK TxDOT CONTROL MARK
LQ1147AB	30°56'52.22253"	-95°54'53.77297"	10,335,960.336	3,681,240.880	10,337,200.651	3,681,682.629	259.145'	171.182'	3 1/2-INCH ALUMINUM DISK TxDOT CONTROL MARK

SHEET 1 OF 2			
FED. RD. DIV. NO.	FEDERAL AID PROJECT NO.	SHEET NO.	
		13	
STATE	DISTRICT	COUNTY	
TEXAS	16	MADISON	
CONTROL	SECTION	JOB	HIGHWAY NO.
0917	31	031	TRINITY ST




CONTROL MONUMENT DESCRIPTION:

A 3-1/2" ALUMINUM DISK SET IN CONCRETE STAMPED "LQ1147AA".

SKETCH (NOT TO SCALE)

LQ1147AA  
SURFACE  
COORDINATES  
N=10,337,828.757  
E=3,682,787.948  
ELEV= 253.227'

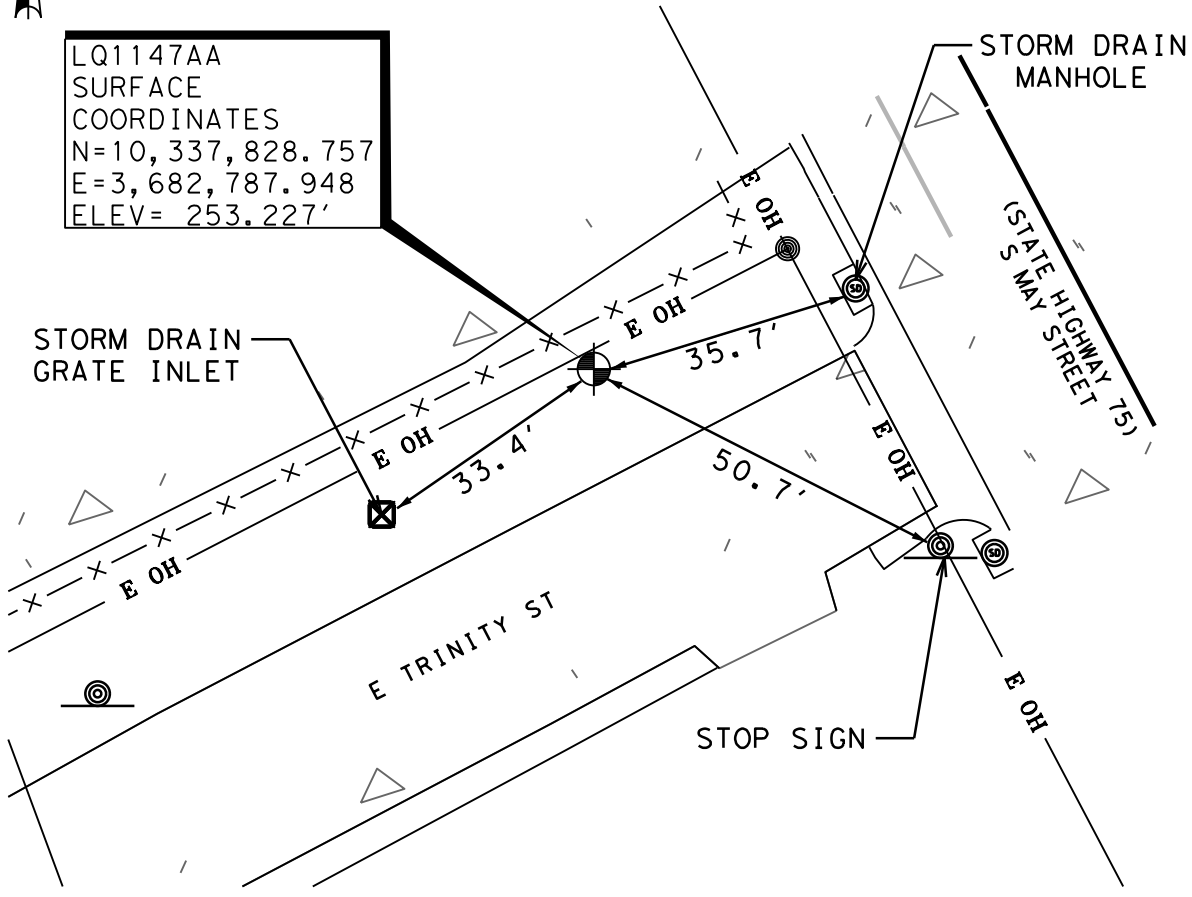


CONTROL MONUMENT DESCRIPTION:

A 3-1/2" ALUMINUM DISK SET IN CONCRETE STAMPED "LQ1147AB".

SKETCH (NOT TO SCALE)

LQ1147AB  
SURFACE  
COORDINATES  
N=10,337,200.651  
E=3,681,682.629  
ELEV= 259.145'

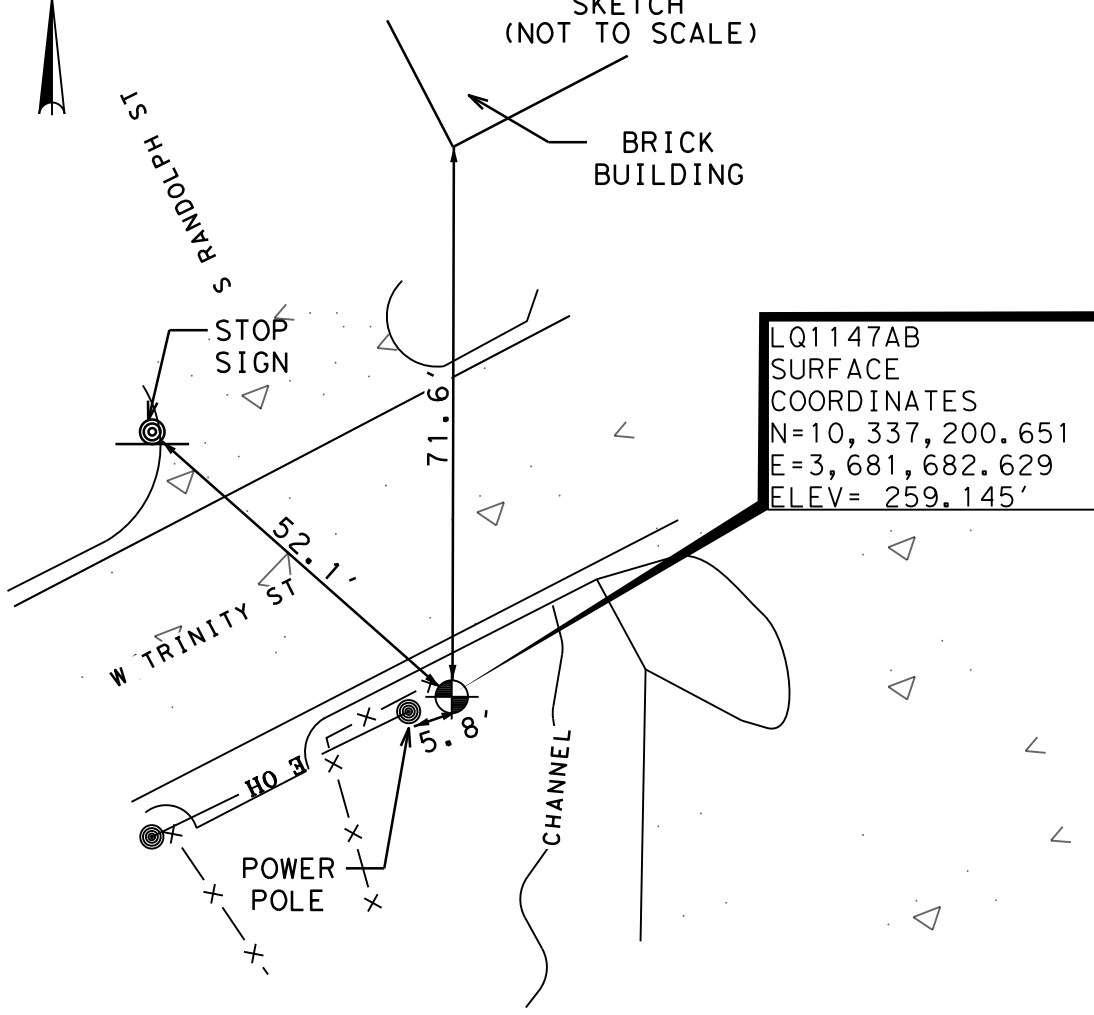

NOTES:  
BEARING BASIS BEING GRID NORTH, TEXAS COORDINATE SYSTEM, CENTRAL ZONE (4203), NAD83 (NAD83 (2011 ADJUSTMENT) EPOCH 2010), DETERMINED BY GPS OBSERVATIONS, CALCULATED FROM THE TXDOT REAL TIME NETWORK (RTN) STATION MADISONVILLE (TXMD RRP ARP DR8272). ALL COORDINATES AND DISTANCES SHOWN ARE US SURVEY FEET DISPLAYED IN SURFACE VALUES AND MAY BE CONVERTED TO GRID BY MULTIPLYING BY THE TXDOT COUNTY WIDE SCALE FACTOR OF 1.00012. ALL ELEVATIONS SHOWN HEREIN ARE REFERENCED TO THE NORTH AMERICAN VERTICAL DATUM OF 1988 (NAVD88) AS DETERMINED BY THE TXDOT REAL TIME NETWORK (RTN) GEOID 09.

PROJECT BENCHMARK: 031501AI  
EXISTING TXDOT PRIMARY CONTROL BENCHMARK:  
5/8 INCH IRON ROD WITH 3-1/4 INCH ALUMINUM DISK STAMPED "031501AI" LOCATED ALONG LOOP 174, APPROXIMATELY 165 FEET NORTH OF THE INTERSECTION OF SH90 AND SOUTH LN, 7 FEET NORTHEAST OF A NAIL WITH SHINER, APPROXIMATELY 43 FEET NORTHWEST OF A "NO TRUCKS" SIGN, AND APPROXIMATELY 51 FEET SOUTH OF "NORTH SPUR 174" SIGN.

SURFACE  
NORTHING: 10,336,065.439 (MEASURED)  
EASTING: 3,682,889.087 (MEASURED)  
ELEV: 255.260' (PUBLISHED)  
GRID  
NORTHING: 10,334,825.17' (PUBLISHED)  
EASTING: 3,682,447.17' (PUBLISHED)  
ELEV: 255.260' (PUBLISHED)



*Mark E. Keeton* 11/28/2022  
MARK E. KEETON DATE  
RPLS NO. 6790

REVISIONS	BY	DATE



**SURVEY CONTROL**

FED. RD. DIV. NO.	FEDERAL AID PROJECT NO.	SHEET NO.
STATE	DISTRICT	COUNTY
TEXAS	16	MADISON
CONTROL	SECTION	JOB
0917	31	031
HIGHWAY NO. TRINITY ST		

11/28/2022 4:23:26 PM RETANAP L:\SUR\MJKM001-Bryon Br\ldges P88E\700 CADD\713 Survey\713.4 Control Surveys\MJKM001 91731031 CONTROL.dgn

LQ1147AA

APPROXIMATE LOCATION:

A 3-1/2" ALUMINUM DISK SET IN CONCRETE STAMPED "LQ1147AA" LOCATED IN THE NORTH RIGHT-OF-WAY OF E TRINITY ST, APPROXIMATELY 65 FEET WEST OF THE CENTERLINE INTERSECTION OF S MAY ST AND E TRINITY ST, APPROXIMATELY 50.7 FEET NORTHWEST OF A STOP SIGN, APPROXIMATELY 35.7 FEET WEST OF A STORM DRAIN MANHOLE, AND APPROXIMATELY 33.4 FEET EAST OF A STORM DRAIN GRATE INLET.

US SURVEY FEET  
TEXAS CENTRAL ZONE 4203  
NORTH AMERICAN DATUM OF 1983 (NAD83)  
GEOID 09 MODEL  
DATE SET: NOVEMBER 15, 2022  
TXDOT SURFACE ADJUSTMENT FACTOR: 1.00012

GRID NORTHING: 10,336,588.366  
GRID EASTING: 3,682,346.066  
SURFACE NORTHING: 10,337,828.757  
SURFACE EASTING: 3,682,787.948  
NAVD88 ELEVATION: 253.227'

LQ1147AB

APPROXIMATE LOCATION:

A 3-1/2" ALUMINUM DISK SET IN CONCRETE STAMPED "LQ1147AB" LOCATED ON THE WEST BANK OF A CHANNEL IN THE SOUTH RIGHT-OF-WAY OF W TRINITY ST, APPROXIMATELY 30 FEET SOUTHEAST OF THE CENTERLINE INTERSECTION OF S RANDOLPH ST AND W TRINITY ST, APPROXIMATELY 52.1 FEET SOUTHEAST OF A STOP SIGN, APPROXIMATELY 5.8 FEET EAST OF A WOOD POWER POLE, AND APPROXIMATELY 71.6 FEET SOUTHWEST OF THE SOUTHWEST CORNER TO A BRICK BUILDING.

US SURVEY FEET  
TEXAS CENTRAL ZONE 4203  
NORTH AMERICAN DATUM OF 1983 (NAD83)  
GEOID 09 MODEL  
DATE SET: NOVEMBER 15, 2022  
TXDOT SURFACE ADJUSTMENT FACTOR: 1.00012

GRID NORTHING: 10,335,960.336  
GRID EASTING: 3,681,240.880  
SURFACE NORTHING: 10,337,200.651  
SURFACE EASTING: 3,681,682.629  
NAVD88 ELEVATION: 259.145'

Beginning chain TRINITY description  
 Feature: Geom\_Centerline

Point TRINITY1 N 10,337,479.1838 E 3,682,172.5097 Sta 100+00.00

Course from TRINITY1 to PC TRINITY\_3 N 62° 50' 16.66" E Dist 504.3586

Curve Data  
 \*-----\*

Curve TRINITY\_3

P.I. Station 105+13.29 N 10,337,713.5050 E 3,682,629.1935  
 Delta = 1° 16' 45.41" (LT)  
 Degree = 7° 09' 43.10"  
 Tangent = 8.9314  
 Length = 17.8621  
 Radius = 800.0000  
 External = 0.0499  
 Long Chord = 17.8618  
 Mid. Ord. = 0.0499  
 P.C. Station 105+04.36 N 10,337,709.4278 E 3,682,621.2471  
 P.T. Station 105+22.22 N 10,337,717.7587 E 3,682,637.0470  
 C.C. N 10,338,421.2030 E 3,682,256.0402  
 Back = N 62° 50' 16.66" E  
 Ahead = N 61° 33' 31.24" E  
 Chord Bear = N 62° 11' 53.95" E

Course from PT TRINITY\_3 to TRINITY5 N 61° 33' 31.24" E Dist 216.4420

Point TRINITY5 N 10,337,820.8410 E 3,682,827.3656 Sta 107+38.66

Ending chain TRINITY description


REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity\_S1700\_CADD\SHTRD\WY\TRINITY\_ST\_HALNDATA



*J. Alchevsky*  
 3/30/2023


PRINT DATE	REVISION DATE
3/30/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



**HORIZONTAL ALIGNMENT DATA**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	15

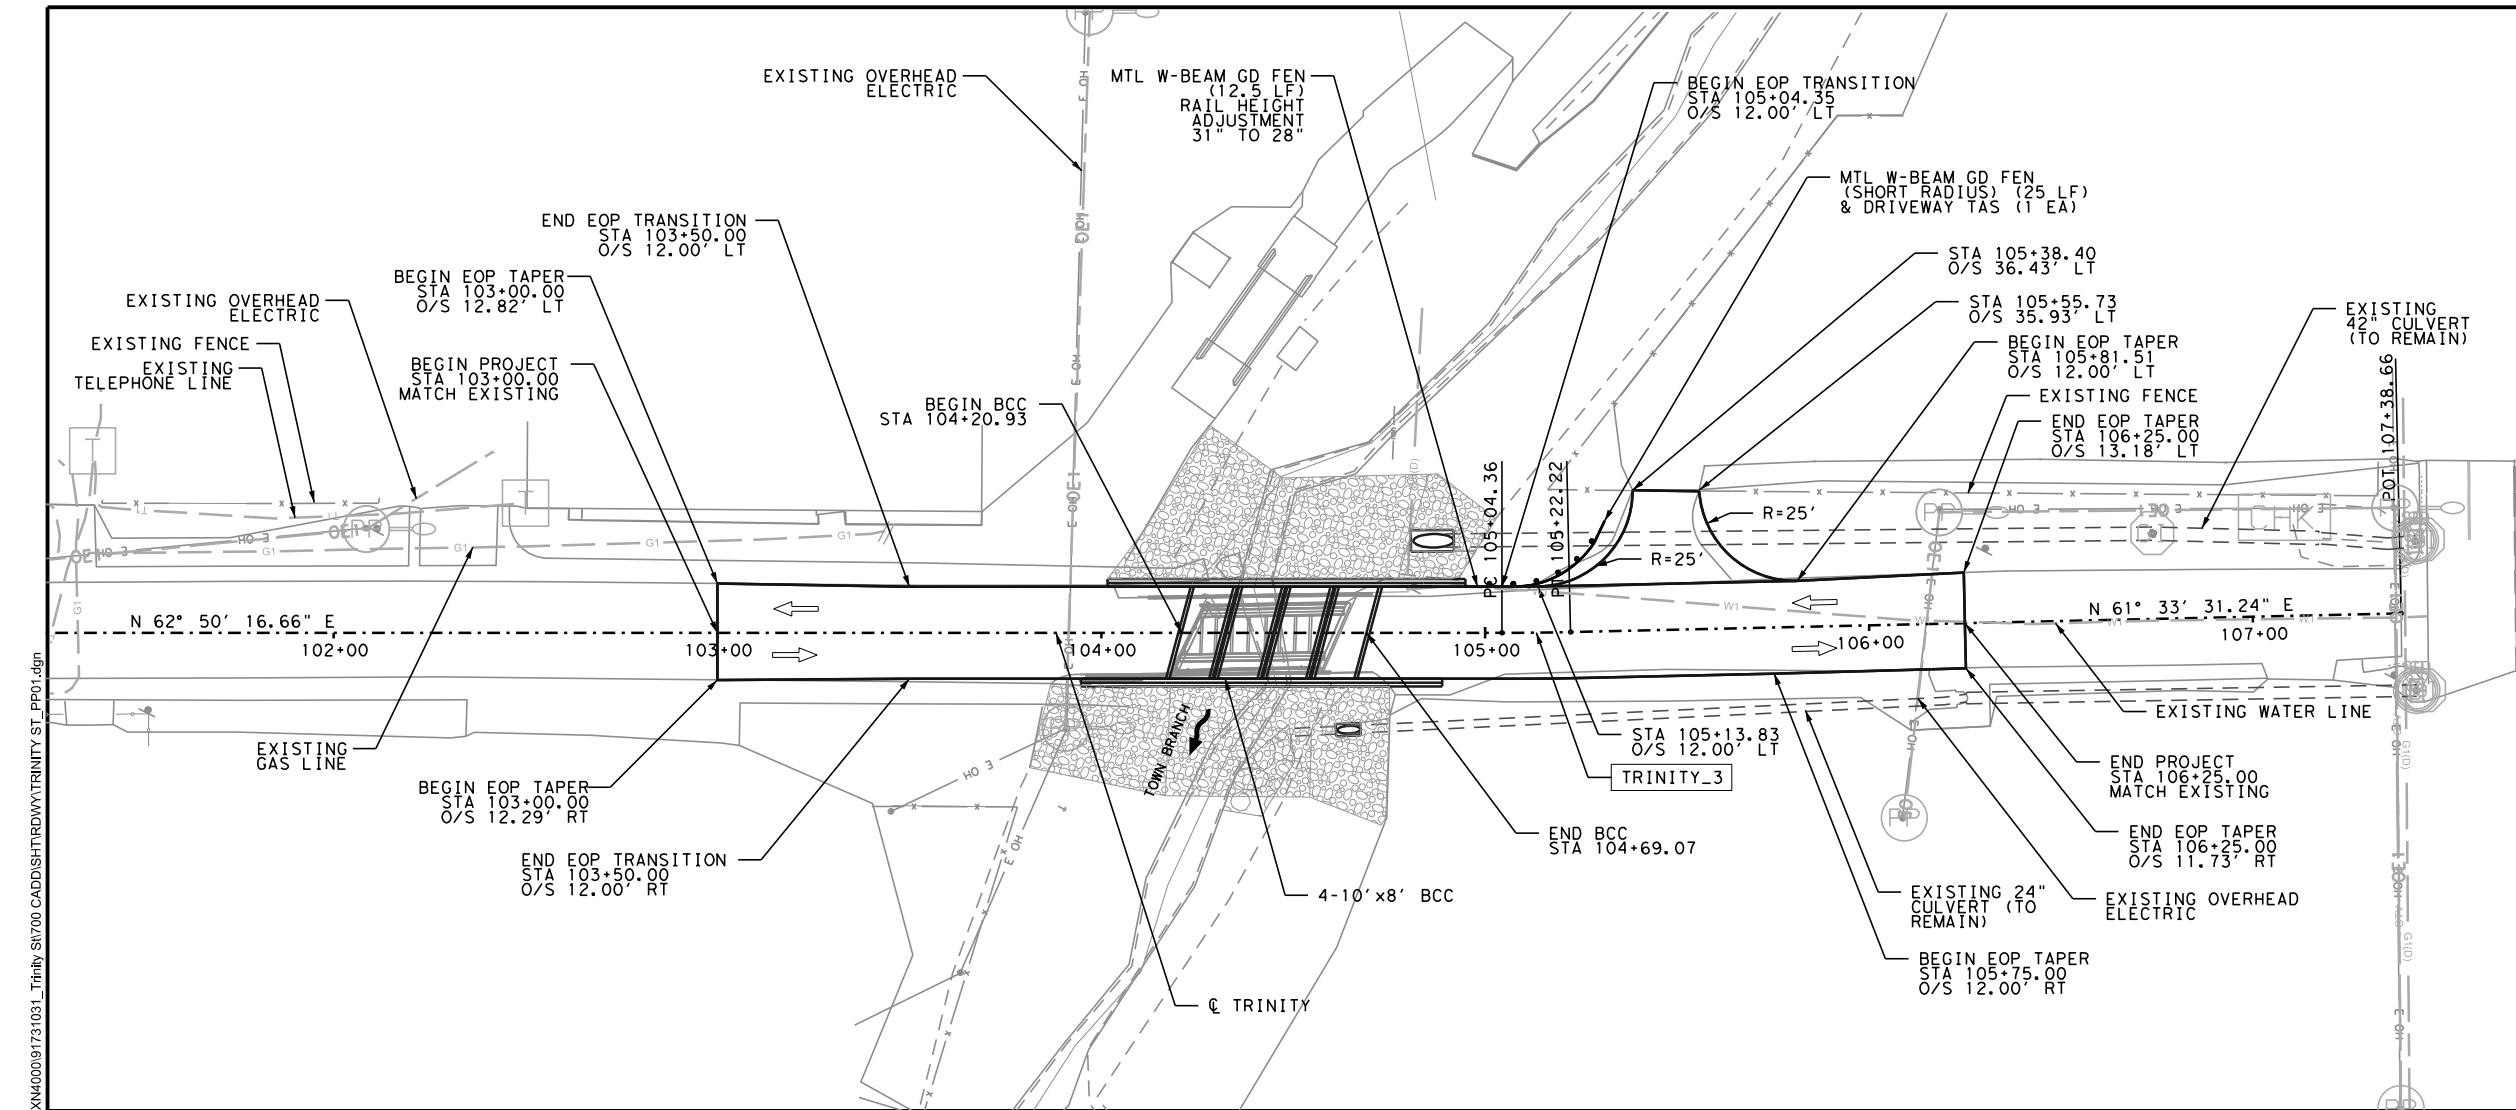

**HORIZONTAL**  
0 25 50  
**VERTICAL**  
0 5

**NOTES:**

- CONTRACTOR SHALL BE RESPONSIBLE FOR LOCATING ALL EXISTING UTILITIES IN THE FIELD PRIOR TO BEGINNING ANY TYPE OF WORK.
- EXISTING ROW IS ASSUMED BASED ON VISIBLE FEATURES SUCH AS FENCE LINES AND/OR MADISON COUNTY APPRAISAL DISTRICT MAPS.
- REMOVAL OF TREES LESS THAN 9" DIAMETER WILL BE SUBSIDIARY TO PREP ROW BID ITEM 0100-6002.


**LEGEND**

- DIRECTION OF TRAFFIC
- DIRECTION OF CREEK FLOW
- DITCH FLOW LINE
- CURVE ID

**PROFESSIONAL ENGINEER**  
STATE OF TEXAS  
JENNA I. ALCHEVSKY  
141671  
3/31/2023  
J. Alchevsky

**JACOBS** 2705 BEE CAVE RD, SUITE 300  
AUSTIN TX 78746  
FIRM REGISTRATION F-2966


**Texas Department of Transportation** ©2023  
Bryan District

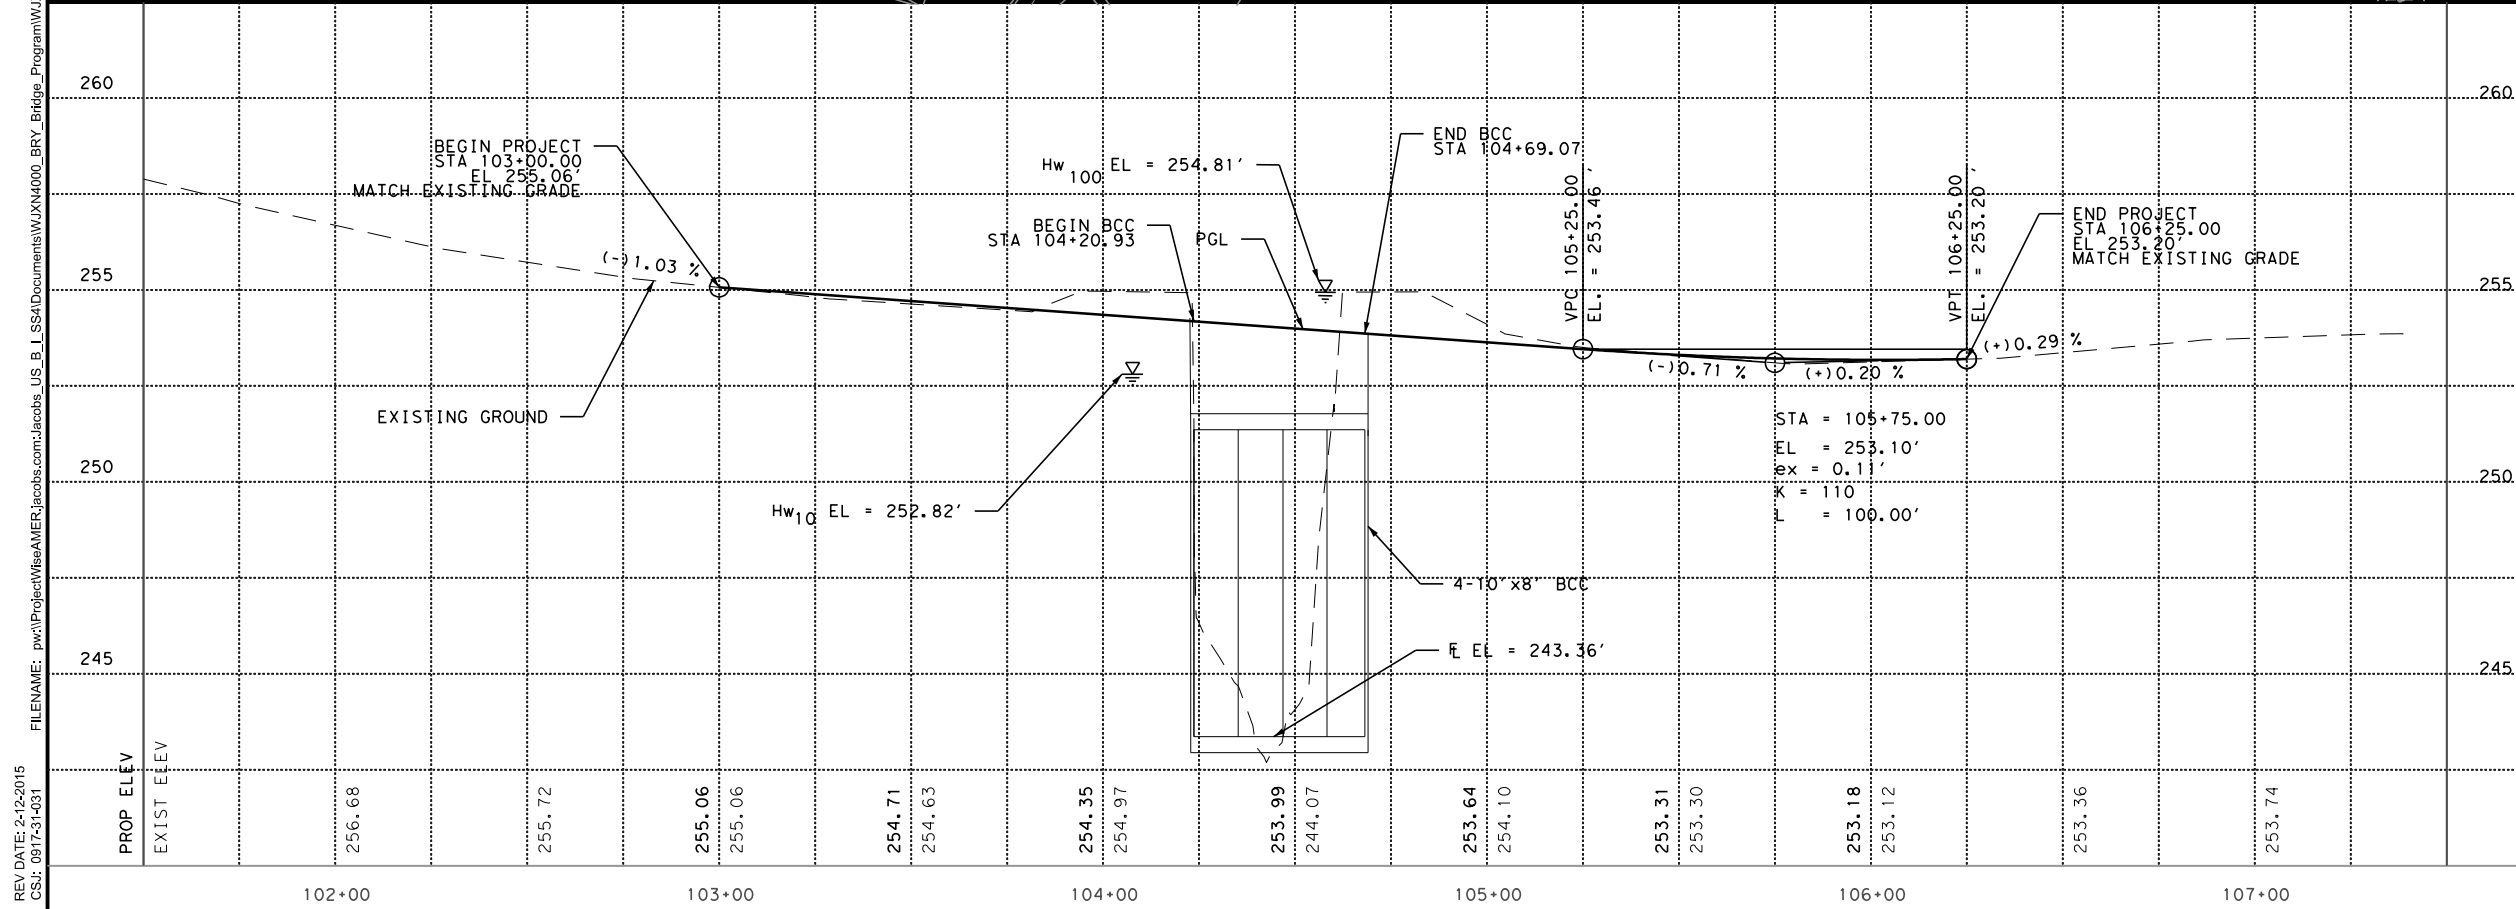

PROP ELEV	256.68	255.72	255.06	255.06	254.71	254.63	254.35	254.97	253.99	244.07	253.64	254.10	253.31	253.30	253.18	253.12	253.36	253.74
EXIST ELEV																		

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	16

REV DATE: 2-12-2015  
CSJ: 0917-31-031  
FILENAME: p:\Project\Bry\AMER\jacobs.com\jacobs\_US\_B\_L\_SSA\Documents\W\XN4000\_BRY\_Bridge\_Program\W\XN4000\1731031\_Trinity\_S\700\_CADD\SHTRD\WY\TRINITY\_ST\_PP01.dgn




NOTES:  
 1. CONTRACTOR TO REFER TO D&OM(5)-20 FOR OBJECT MARKER PLACEMENT AND SPACING.

LEGEND

- DIRECTION OF TRAFFIC
- DIRECTION OF CREEK FLOW
- TYPE CTB DELINEATOR
- TYPE GF2 DELINEATOR
- SINGLE DELINEATOR
- OBJECT MARKER TYPE 3 LEFT OR RIGHT

*Emily Weigand*



PRINT DATE	REVISION DATE
3/30/2023	


**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



SIGNS AND OBJECT MARKERS


FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	17

REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Tribby\_SIV700\_CADD\SHITRDWY\TRIN\_SOM1.dgn

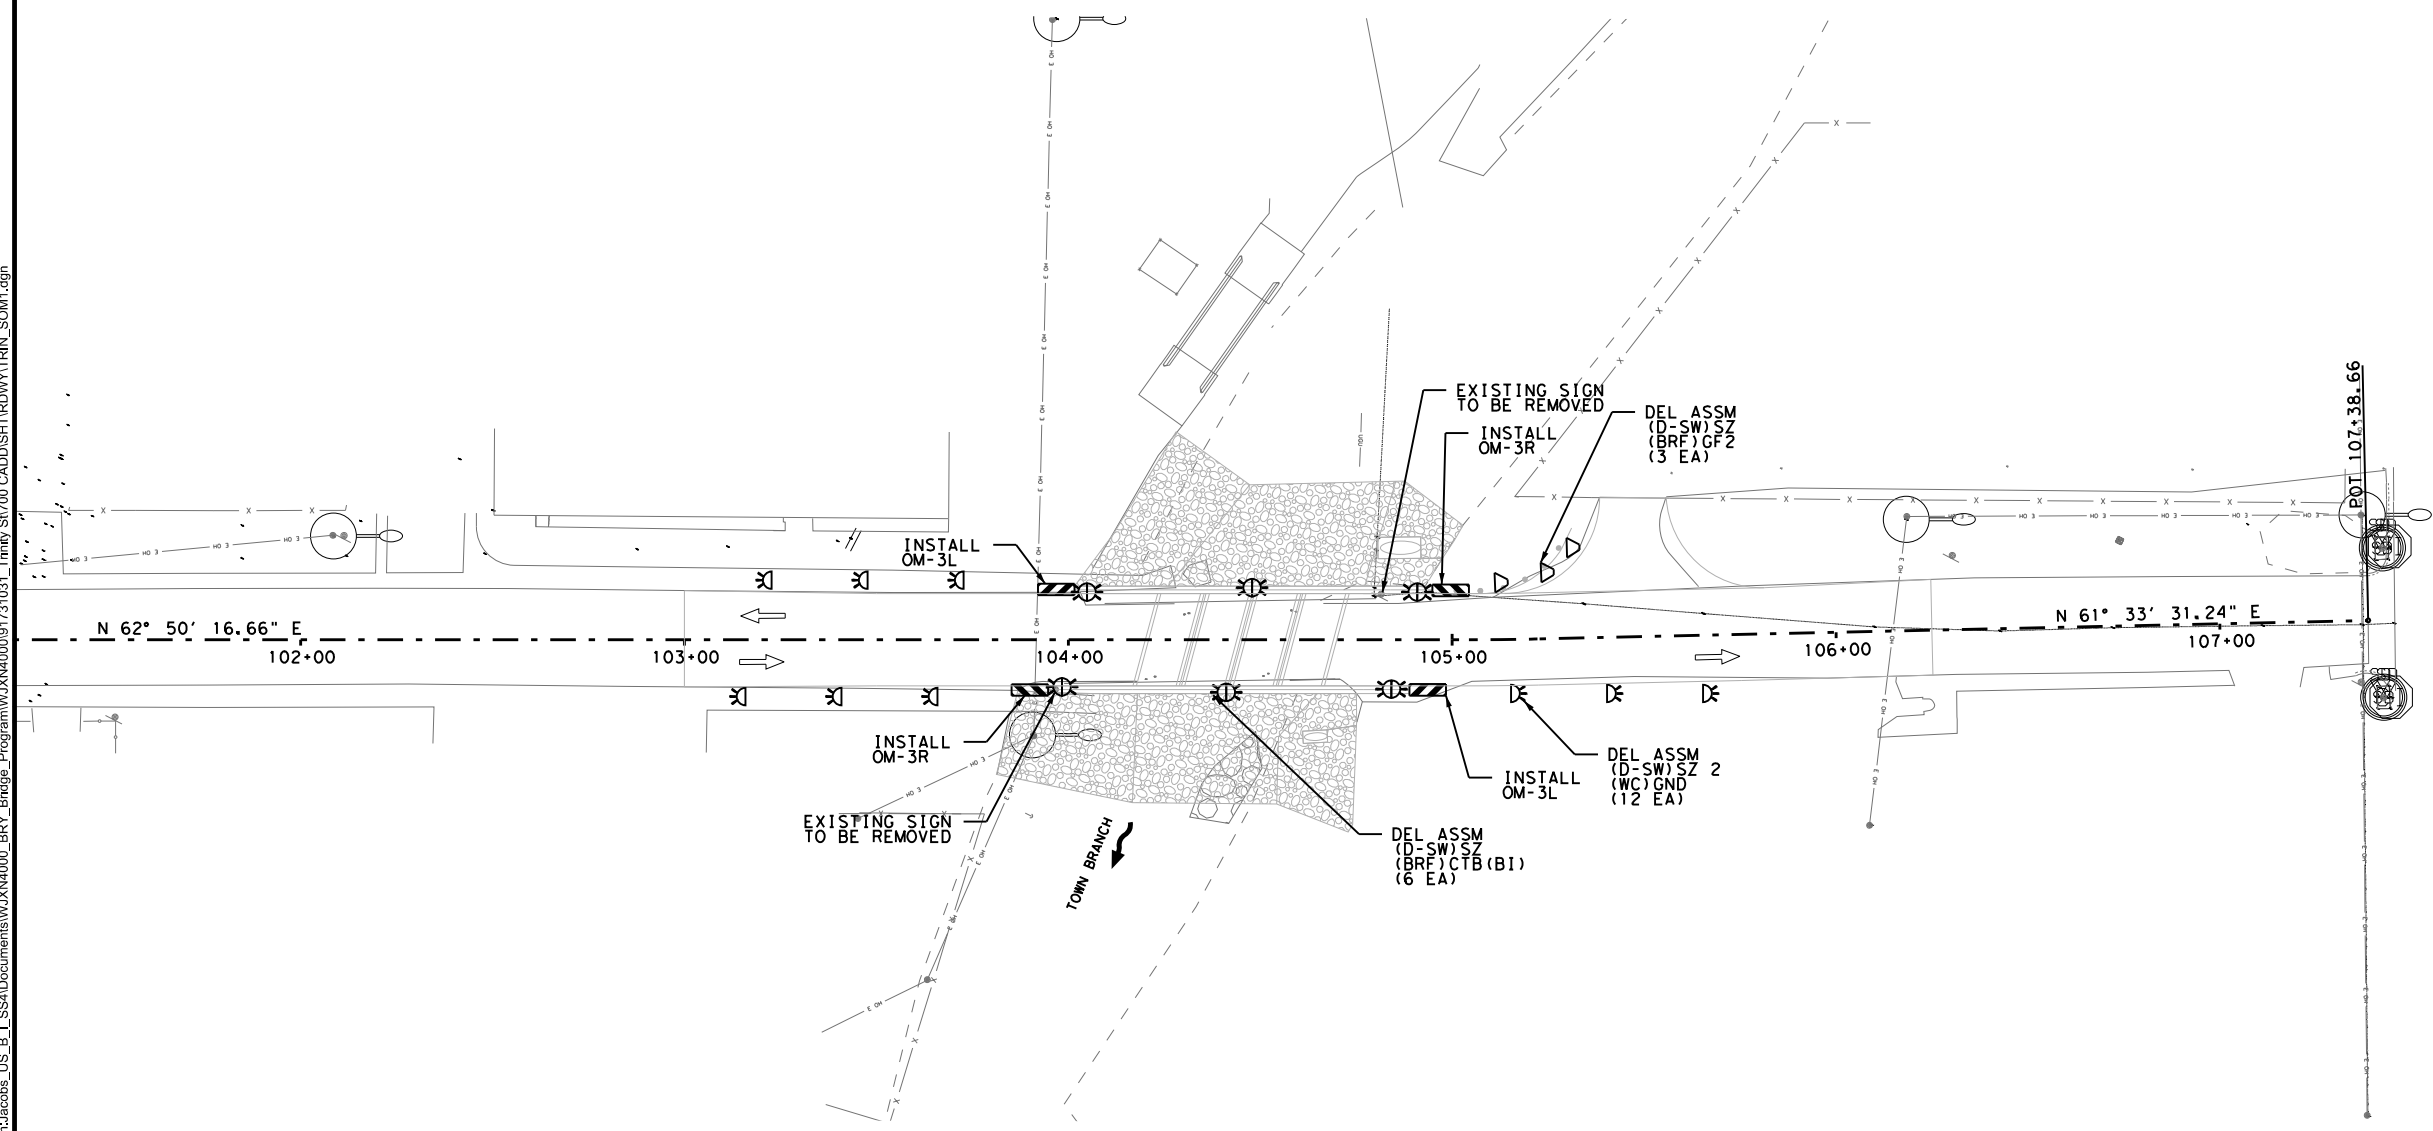


DISCLAIMER: THE USE OF THIS STANDARD IS COVERED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TxDOT FOR ANY PURPOSE WHATSOEVER. TxDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

DATE: 3/30/2023  
 FILE: \\Project\wise\amer\_jacobs.com\jacobs\_us\_b\_i\_ss4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\RDWY\mbgfsr19.dgn

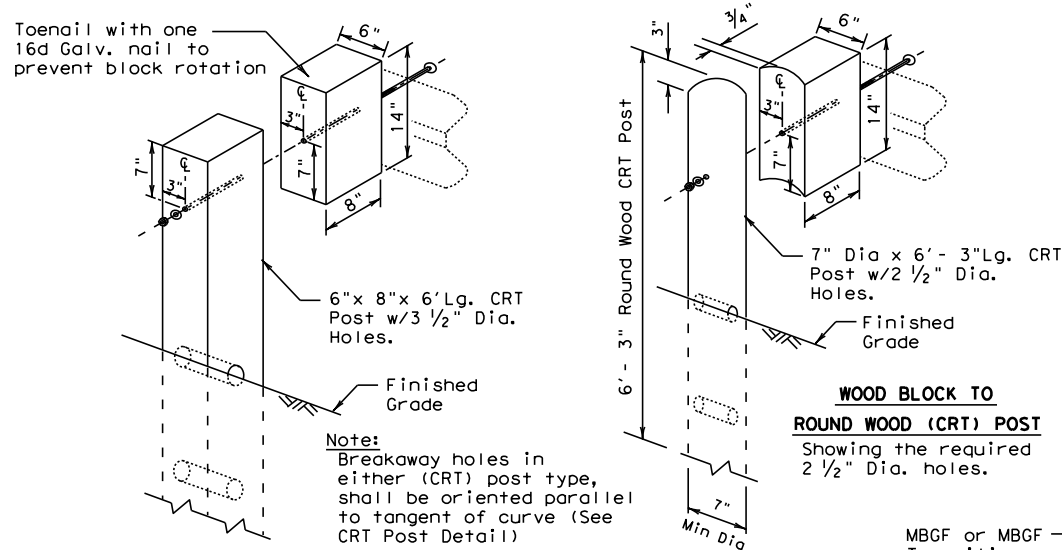


**WOOD BLOCK TO RECTANGULAR WOOD (CRT) POST**  
 Showing the required 3 1/2" Dia. holes.

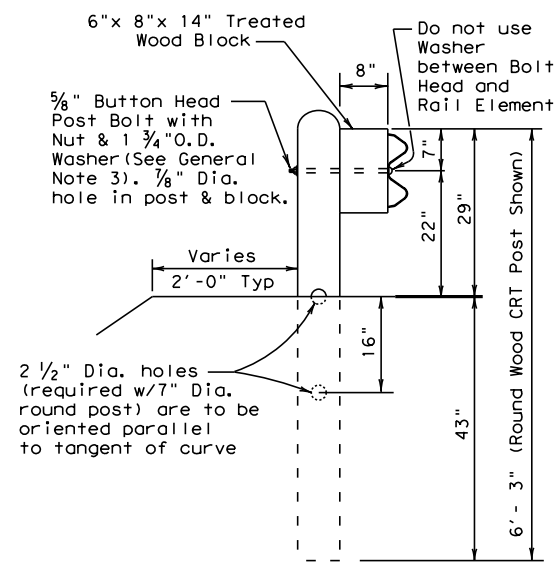


**(CRT) POST DETAIL CONTROLLED RELEASE TERMINAL POST**


Two or more wood CRT post(s) are required at any radius installation located at intersecting roadways or driveways.

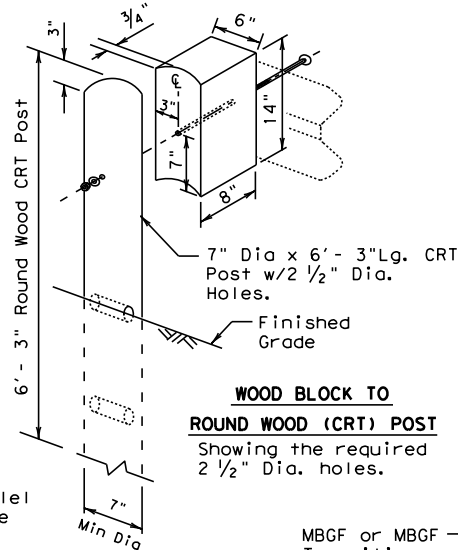

**WOOD BLOCK TO ROUND WOOD (CRT) POST**  
 Showing the required 2 1/2" Dia. holes.

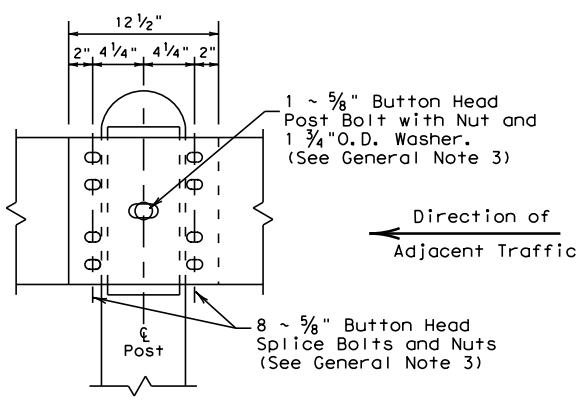


**RAIL SPLICE DETAIL**

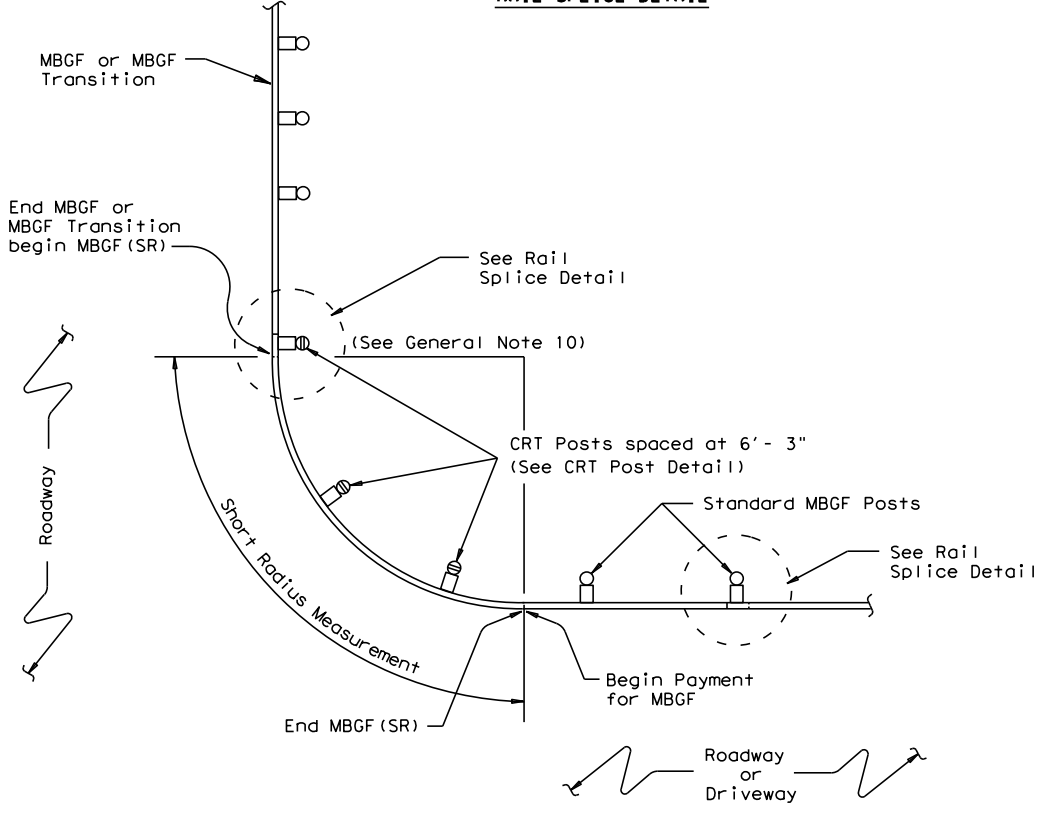

**PLAN VIEW SHOWING TYPICAL RADIUS**

The required radius is shown elsewhere on the plans.

- GENERAL NOTES**
- The type of (CRT) post (round wood post, or rectangular wood post) will be shown elsewhere in the plans. The exact position of MBGF shall be shown elsewhere in the plans or as directed by the Engineer.
  - Steel posts are not permitted at CRT post positions.
  - Rail element shall meet the requirements of Item 540, "Metal Beam Guard Fence" except as modified on the plans. The Contractor may furnish rail elements of 12 1/2 or 25 foot nominal lengths.
  - Button head "post" bolts (ASTM A307) shall be of sufficient length to extend through the full thickness of the nut (ASTM A563) and Type A (1 3/4" O.D.) washer and not more than 1" beyond it. Button head "splice" bolts (ASTM A307) are 5/8" x 1 1/4" (or 2" long at triple rail splices) with a 3/8" double recessed nut (ASTM A563).
  - Fittings (bolts, nuts, and washers) shall be galvanized in accordance with Item 445, "Galvanizing." Fittings shall be subsidiary to the bid item.
  - Crown shall be widened to accommodate the Metal Beam Guard Fence.
  - The lateral approach to the guard fence, shall have a slope rate of not more than 1V:10H.
  - Unless otherwise shown in the plans, guard fence placed in the vicinity of curbs shall be positioned so that the face of curb is located directly below or behind the face of the block. Rail placed over curbs shall be installed so that the post bolt is located approximately 21 inches above the gutter pan or roadway surface.
  - If solid rock is encountered within 0 to 18" of the finished grade, drill a 22" dia. hole, 24" into the rock, or drill two 12" dia. front to back overlapping holes, 24" into the rock. If solid rock is encountered below 18", drill a 12" dia. hole, 12" into the rock or to the standard embedment depth, whichever is less. Any excess post length, after meeting these depths, may be field cut to ensure proper guardrail mounting height. Backfill with a cohesionless material.
  - Guardrail posts shall not be set in concrete, of any depth.
  - Special rail fabrication will be required at installations having a curvature of less than 150 ft. radius. The required radius shall be shown on the plans.
  - The terminal anchor section (TAS) post shall be set in Class A concrete (unless otherwise shown in the plans) in accordance with Item 421, "Hydraulic Cement Concrete." Concrete shall be subsidiary to the bid item requiring construction of the terminal anchor section (TAS). Terminal anchor post to be galvanized in accordance with Item 445, "Galvanizing."
  - Unless otherwise shown in the plans, a composite material post and/or block that meets the requirements of DMS-7210, "Composite Material Posts and Blocks for Metal Beam Guard Fence" may be substituted for posts and/or blocks of similar dimensions. The Construction Division, TxDOT maintains a Material Producer List (MPL) for producers of materials conforming to DMS-7210. Only producers on the MPL can furnish composite material posts and/or blocks.

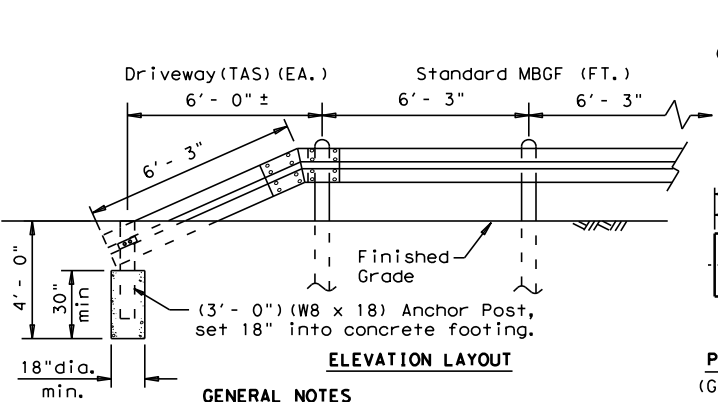


**ELEVATION LAYOUT**

**GENERAL NOTES**

- The "Driveway" Terminal Anchor Section is ONLY to be used within driveway locations, where the ROW is limited and a standard 25 ft. (TAS) Terminal Anchor Section, is too long.
- Terminal anchor post shall be set in Class A concrete.
- All steel shall be galvanized after fabrication in accordance with Item 445, "Galvanizing."


**"DRIVEWAY" TERMINAL ANCHOR SECTION**

Only for use within driveway locations, where a standard (TAS) Terminal Anchor Section can not be installed.

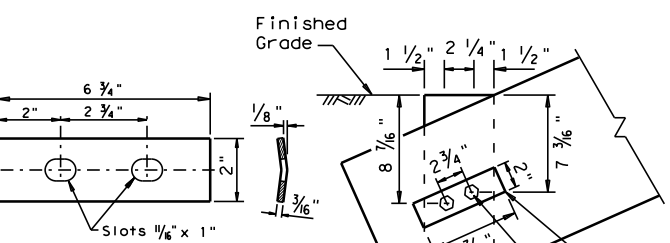

**PLATE WASHER FOR METAL BEAM**  
 (Galvanized after fabrication)

**ANCHOR POST**  
 W8 x 18 (3'-0")

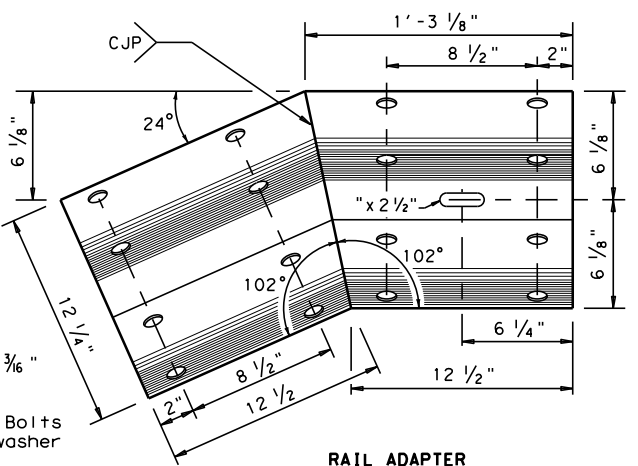

**RAIL ADAPTER**  
 Rail - 10 gauge  
 (Galvanized after fabrication)


**ONLY FOR USE IN MAINTENANCE REPAIRS OR HIGHLY CONSTRAINED SITE CONDITIONS.**

		<b>Design Division Standard</b>	
<b>METAL BEAM GUARD FENCE (SHORT RADIUS) MBGF (SR) - 19</b>			
FILE: mbgfsr19.dgn	DN: TxDOT	CK: KM	DW: BD
© TxDOT NOVEMBER 2019	CONT: 0917	SECT: 31	JOB: 031
REVISIONS	DIST: BRY	COUNTY: MADISON	SHEET NO. 18




**GENERAL NOTES**

1. THE TYPE OF POST (ROUND WOOD POST, RECTANGULAR WOOD POST, OR STEEL POST) WILL BE AS SHOWN IN THE PLANS. THE EXACT POSITION OF MBGF SHALL BE AS SHOWN IN THE PLANS OR AS DIRECTED BY THE ENGINEER. STEEL POSTS TO BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING."
2. RAIL ELEMENT SHALL MEET THE REQUIREMENTS OF ITEM 540, "METAL BEAM GUARD FENCE" EXCEPT AS MODIFIED IN THE PLANS. THE CONTRACTOR MAY FURNISH RAIL ELEMENTS OF 25'-0", OR 12'-6" (NOM.) LENGTHS. RAIL ELEMENTS MAY HAVE SLOTTED HOLES AT 3'-1 1/2" C-C OR 6'-3" C-C. A SPECIAL LENGTH OF RAIL MAY BE MANUFACTURED TO ACCOMMODATE THE TRANSITION SECTIONS OF GUARDRAIL.
3. BUTTON HEAD "POST" BOLTS (ASTM A307) SHALL BE OF SUFFICIENT LENGTH TO EXTEND THROUGH THE FULL THICKNESS OF THE NUT (ASTM A563) AND 3/8" ROUND WASHER (ASTM F436) AND NOT MORE THAN 1" BEYOND IT. BUTTON HEAD "SPLICE" BOLTS (ASTM A307) ARE 5/8" X 1-1/4" WITH 3/8" NUTS (ASTM A563).
4. FITTINGS (BOLTS, NUTS, AND WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING." FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM REQUIRING CONSTRUCTION OF THE TRANSITION.
5. CROWN SHALL BE WIDENED TO ACCOMMODATE THE METAL BEAM GUARD FENCE.
6. THE LATERAL APPROACH TO THE GUARD FENCE, SHALL HAVE A MAXIMUM SLOPE OF 1V:10H.
7. IF SHOWN ELSEWHERE IN THE PLANS OR AS DIRECTED BY THE ENGINEER, THE GUARD FENCE MAY BE FLARED AT A RATE OF 25:1 OR FLATTER.
8. APPLICATIONS IN SOLID ROCK ARE ONLY ALLOWED WITH STEEL POSTS. SEE GF(31) STANDARD FOR INSTALLATION GUIDANCE.
9. POSTS SHALL NOT BE SET IN CONCRETE.
10. UNLESS OTHERWISE SHOWN IN THE PLANS, A COMPOSITE MATERIAL BLOCK THAT MEETS THE REQUIREMENTS OF DMS-7210, "COMPOSITE MATERIAL POSTS AND BLOCKS FOR METAL BEAM GUARD FENCE" MAY BE SUBSTITUTED FOR BLOCKS OF SIMILAR DIMENSIONS. THE CONSTRUCTION DIVISION, TXDOT MAINTAINS A MATERIAL PRODUCER LIST (MPL) FOR PRODUCERS OF MATERIALS CONFORMING TO DMS-7210. ONLY PRODUCERS ON THE MPL MAY FURNISH COMPOSITE MATERIAL BLOCKS.
11. REFER TO STANDARD GF(31) FOR ADDITIONAL DETAILS.
12. RAIL HEIGHT ADJUSTMENT IS ASSESSED AT TL-3 MASH COMPLIANT FOR STEEL POST HEIGHT TRANSITION TO 28" STEEL POST GUARDRAIL.

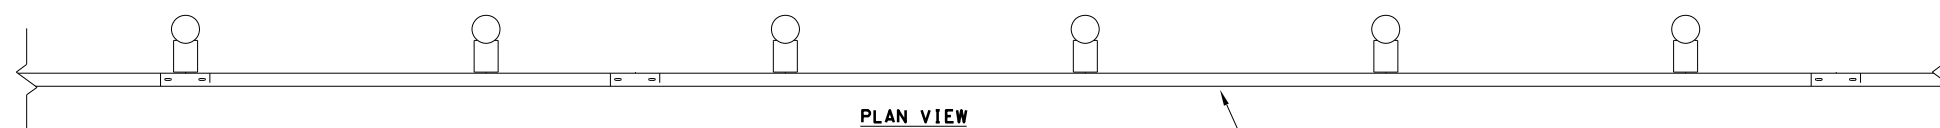



**PLAN VIEW**

(SINGLE) W-BEAM SHALL MATCH THE GAUGE OF THE ADJACENT RUN OF MBGF.

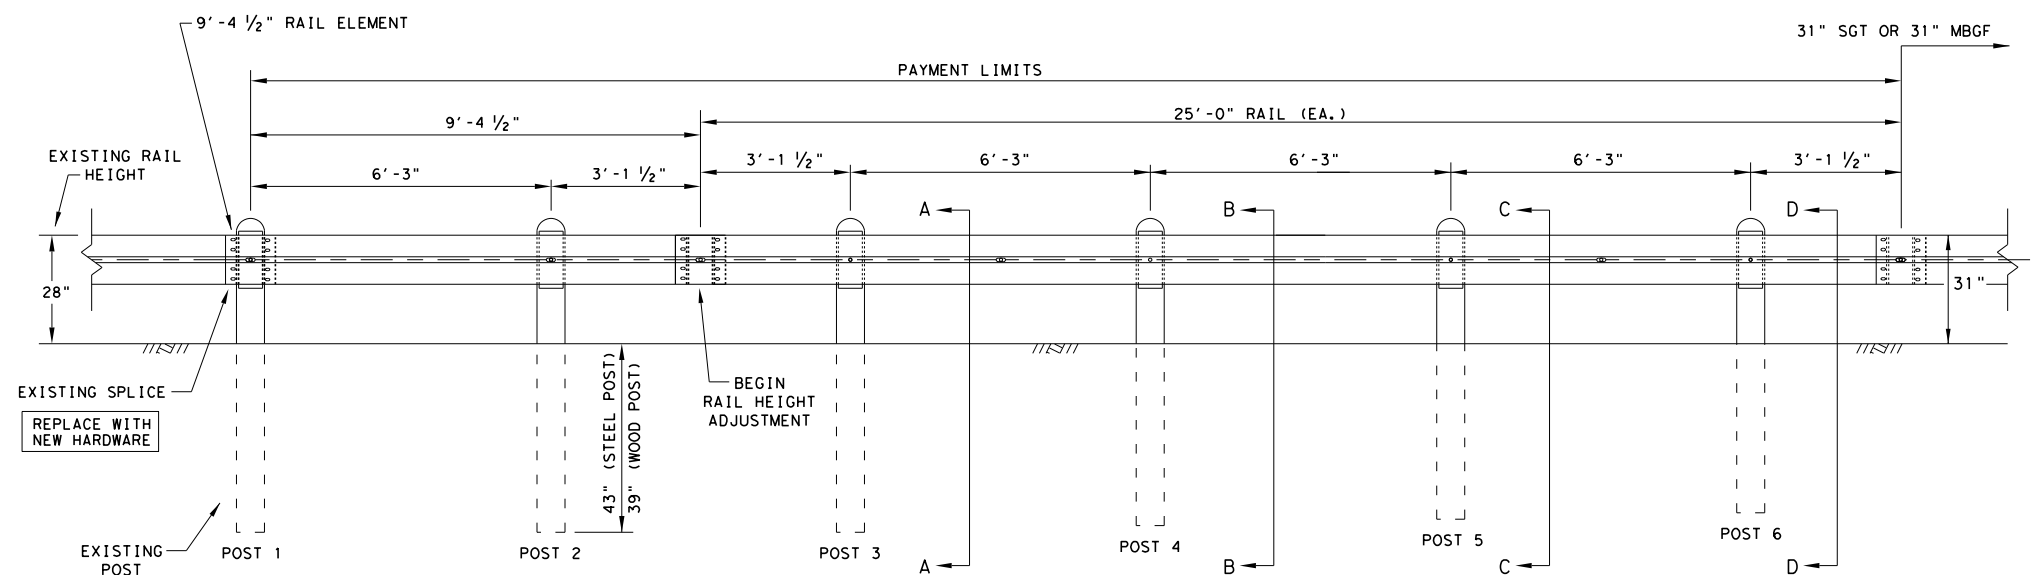


**ELEVATION VIEW**

\* "WOOD" INDICATES DIMENSIONS FOR BOTH ROUND AND RECTANGULAR WOOD POST SYSTEMS.

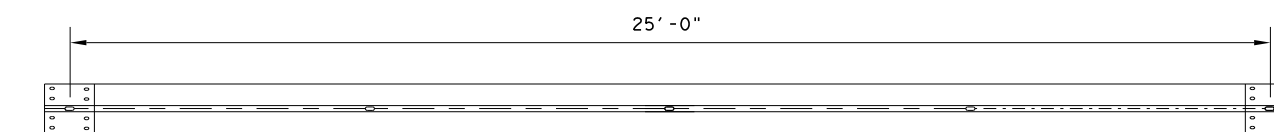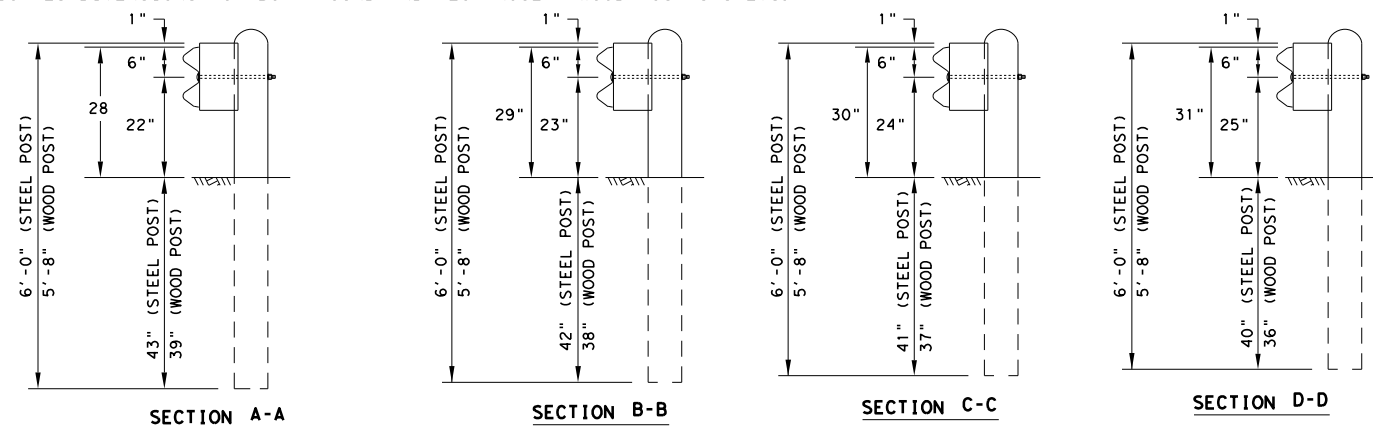

**25'-0" (NOM.) W-BEAM RAIL ELEMENT**




**9'-4 1/2" (NOM.) W-BEAM RAIL ELEMENT**

HARDWARE LIST	
QTY	DESCRIPTION
1	9'-4 1/2" W-BEAM RAIL ELEMENT 12GA.
1	25'-0" W-BEAM RAIL ELEMENT 12GA. (TYP)
6	7 1/2" DIA X 6'-0" DOMED ROUND WOOD POSTS (TYP)
6	6" X 8" X 68" RECTANGULAR WOOD POSTS (TYP)
6	W6 X 8.5 OR W6 X 9 X 72" STEEL POSTS (TYP)
6	6" X 8" X 14" WOOD BLOCKS OR COMPOSITE (TYP)
6	5/8" X 18" GUARDRAIL BOLTS WITH NUTS (FBB04)
6	5/8" ROUND WASHERS (ASTM F436) (FWC16a)
6	5/8" X 10" GUARDRAIL BOLTS WITH NUTS (FBB03)
24	5/8" X 1-1/4" GUARDRAIL SPLICE BOLTS WITH DOUBLE RECESSED NUTS (ASTM A563) (FBB01)

POST AND BLOCK-OUT TYPES AVAILABLE

FOR WOOD POST

FOR STEEL POST

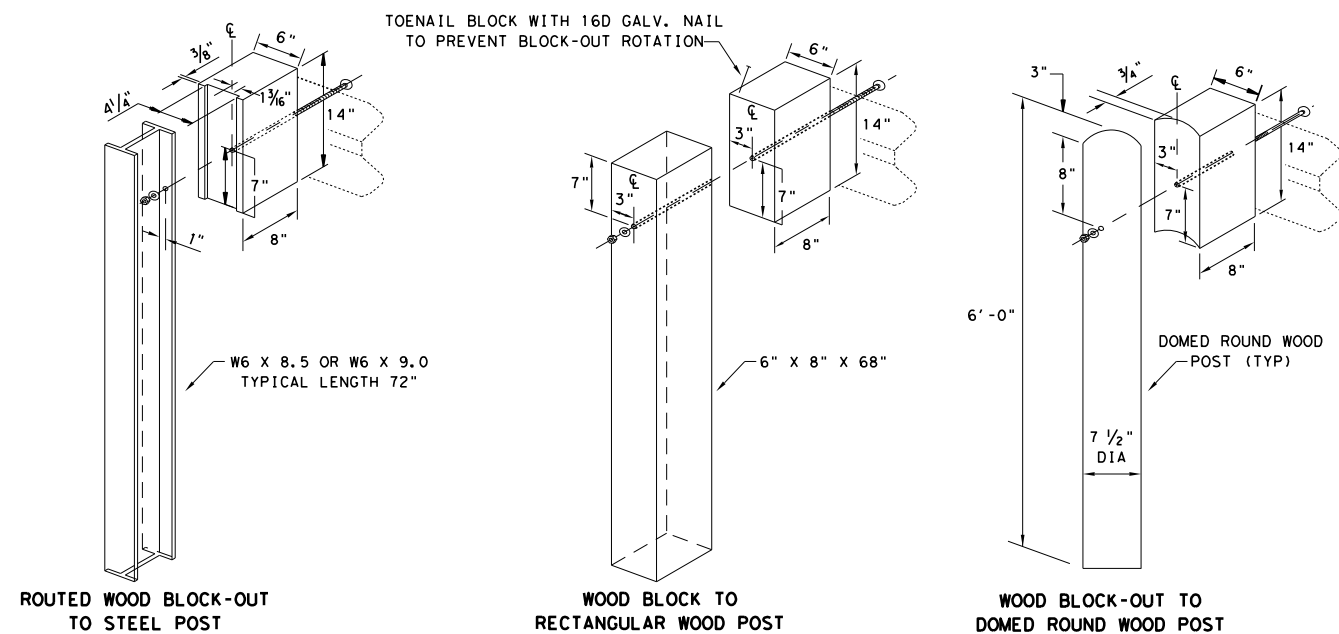

NOTE: HARDWARE SHALL MEET THE FOLLOWING REQUIREMENTS.  
 GUARDRAIL POST BOLTS (ASTM A307 GR. A)  
 GUARDRAIL ROUND WASHERS (ASTM F436)  
 GUARDRAIL DOUBLE RECESSED NUTS (ASTM A563)  
 GUARDRAIL SPLICE BOLTS (ASTM A307 GR. A)  
 GUARDRAIL SPLICE NUTS (ASTM A563)


**Texas Department of Transportation**  
 Design Division Standard

**METAL BEAM GUARD FENCE  
 RAIL HEIGHT ADJUSTMENT  
 (28" TO 31")  
 TL-3 MASH COMPLIANT  
 RAIL-ADJ(A)-19**

FILE: railadj19	DN: TXDOT	CK: KM	DW: VP	CK: CGL/AG
© TXDOT: NOVEMBER 2019	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
DIST	COUNTY		SHEET NO.	
BRY	MADISON		19	


DATE: 3/30/2023  
 FILE: \\Project\wise\AMER\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\RDW\rcal\ad\b19.dgn

DISCLAIMER: THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TXDOT FOR ANY PURPOSE WHATSOEVER. TXDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

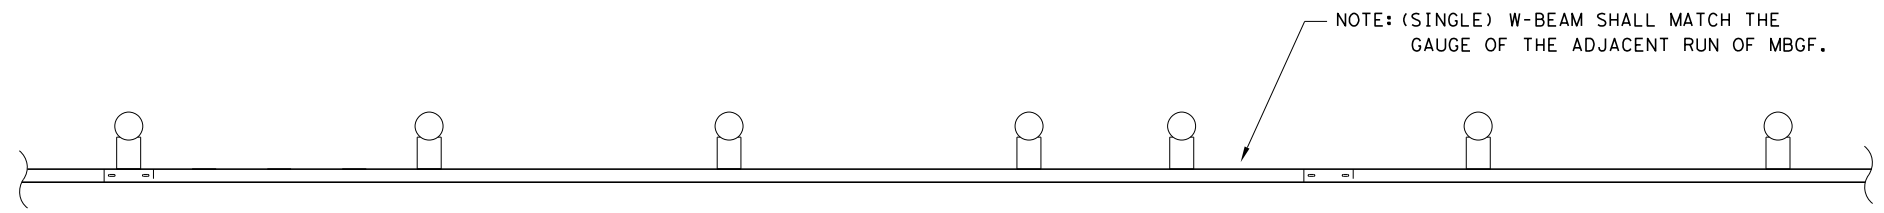

PLAN VIEW


NOTE: (SINGLE) W-BEAM SHALL MATCH THE GAUGE OF THE ADJACENT RUN OF MBGF.

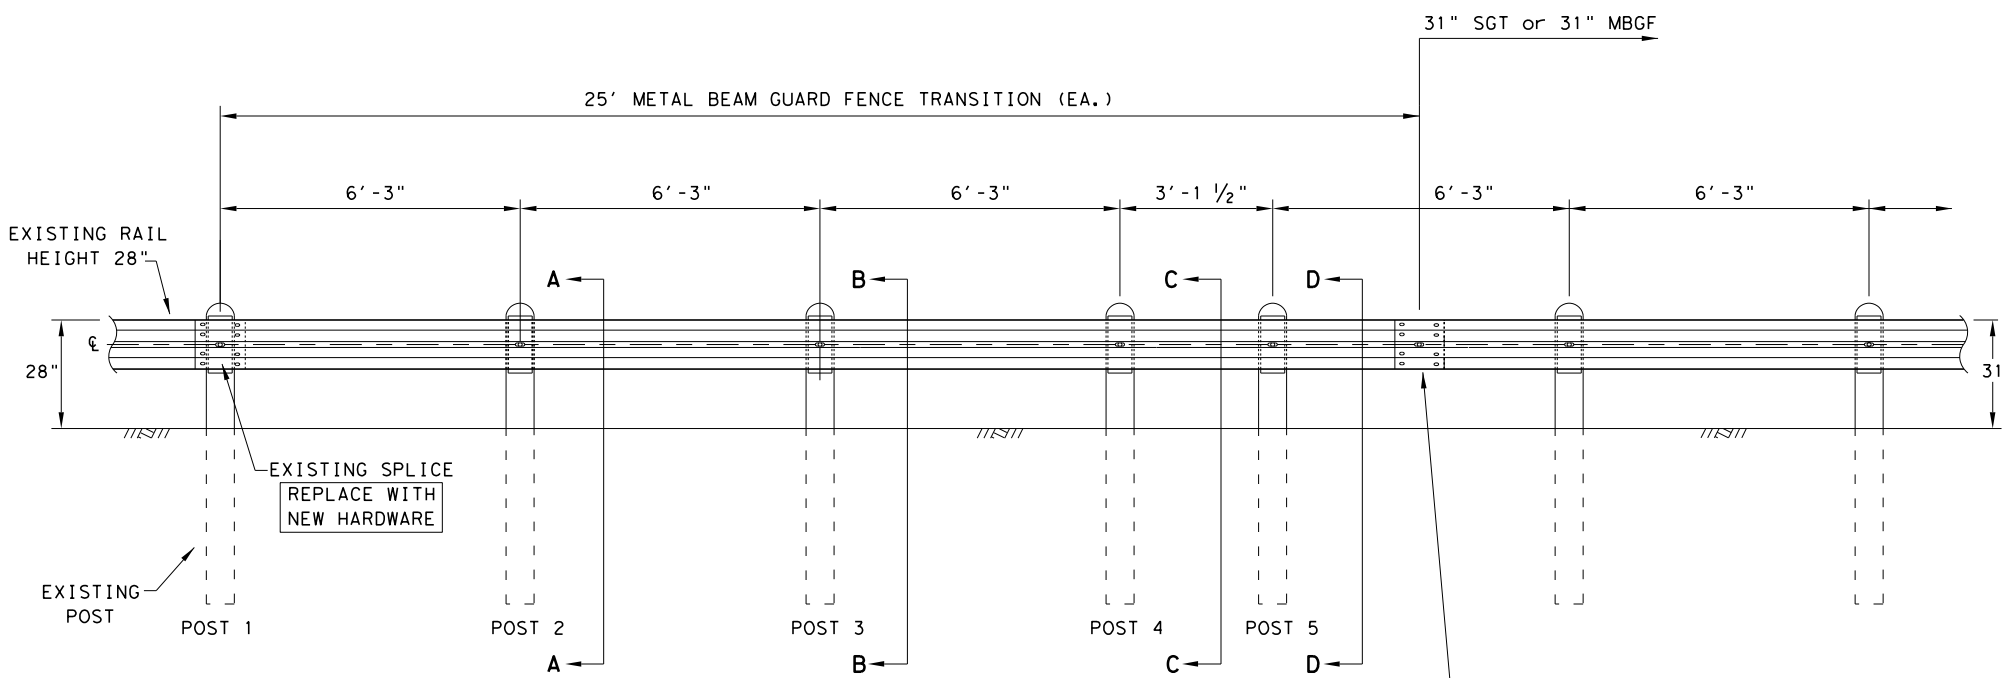

ELEVATION VIEW

\* "WOOD" INDICATES DIMENSIONS FOR BOTH ROUND AND RECTANGULAR WOOD POST SYSTEMS.

POST AND BLOCK-OUT TYPES AVAILABLE

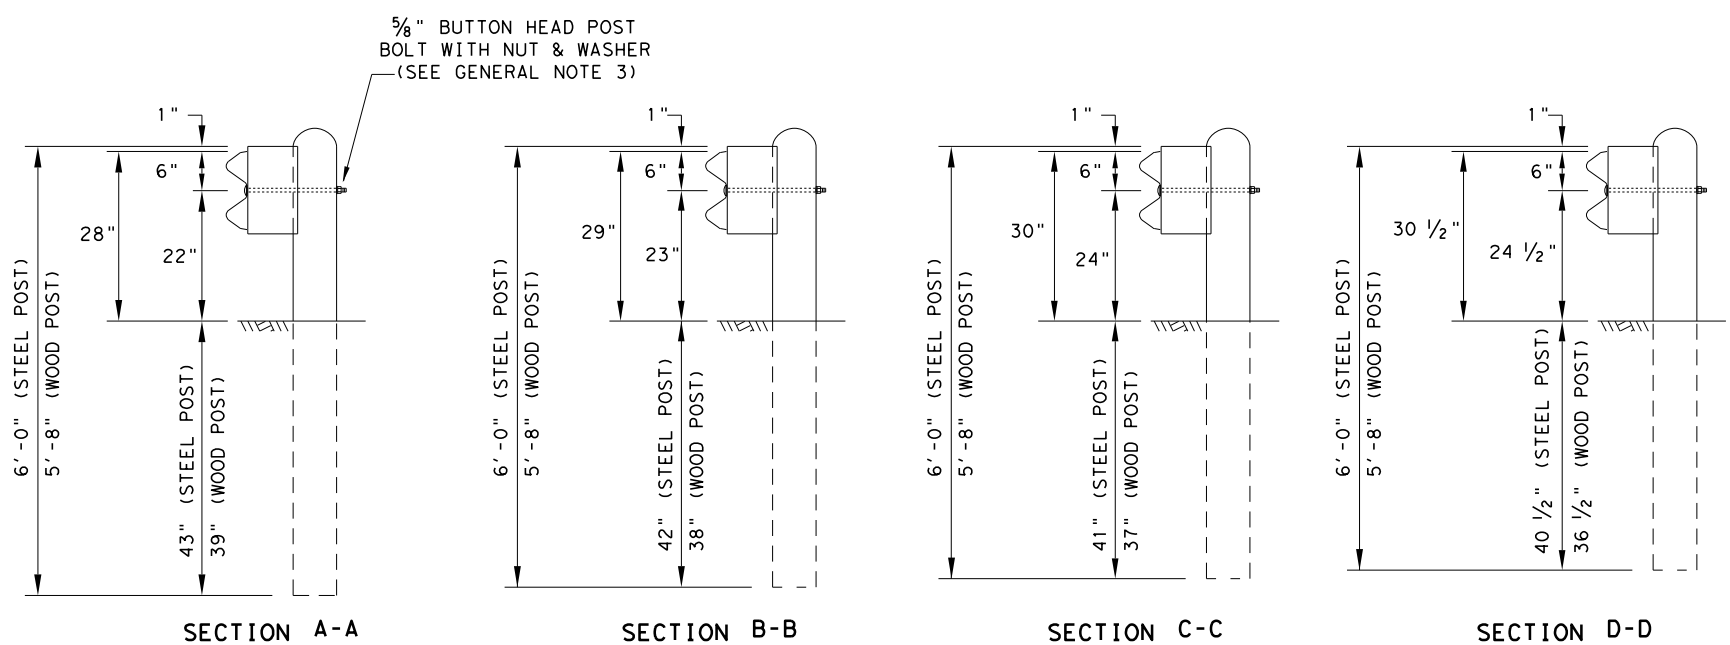

SECTION A-A

SECTION B-B

SECTION C-C

SECTION D-D

NOTE: HARDWARE SHALL MEET THE FOLLOWING REQUIREMENTS.  
 GUARDRAIL POST BOLTS (ASTM A307 GR.A)  
 GUARDRAIL ROUND WASHERS (ASTM F436)  
 GUARDRAIL DOUBLE RECESSED NUTS (ASTM A563)  
 GUARDRAIL SPLICE BOLTS (ASTM A307 GR.A)  
 GUARDRAIL SPLICE NUTS (ASTM A563)

GENERAL NOTES

1. THE TYPE OF POST (ROUND WOOD POST, RECTANGULAR WOOD POST, OR STEEL POST) WILL BE AS SHOWN IN THE PLANS. THE EXACT POSITION OF MBGF SHALL BE AS SHOWN IN THE PLANS OR AS DIRECTED BY THE ENGINEER. STEEL POSTS TO BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING."
2. RAIL ELEMENT SHALL MEET THE REQUIREMENTS OF ITEM 540, "METAL BEAM GUARD FENCE" EXCEPT AS MODIFIED IN THE PLANS. THE CONTRACTOR MAY FURNISH RAIL ELEMENTS OF 25'-0", OR 12'-6" (NOM.) LENGTHS. RAIL ELEMENTS MAY HAVE SLOTTED HOLES AT 3'-1 1/2" C-C OR 6'-3" C-C. A SPECIAL LENGTH OF RAIL MAY BE MANUFACTURED TO ACCOMMODATE THE TRANSITION SECTIONS OF GUARDRAIL.
3. BUTTON HEAD "POST" BOLTS (ASTM A307) SHALL BE OF SUFFICIENT LENGTH TO EXTEND THROUGH THE FULL THICKNESS OF THE NUT (ASTM A563) AND 5/8" ROUND WASHER (ASTM F436) AND NOT MORE THAN 1" BEYOND IT. BUTTON HEAD "SPLICE" BOLTS (ASTM A307) ARE 5/8" X 1-1/4" WITH 5/8" NUTS (ASTM A563).
4. FITTINGS (BOLTS, NUTS, AND WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING." FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM REQUIRING CONSTRUCTION OF THE TRANSITION.
5. CROWN SHALL BE WIDENED TO ACCOMMODATE THE METAL BEAM GUARD FENCE.
6. THE LATERAL APPROACH TO THE GUARD FENCE, SHALL HAVE A MAXIMUM SLOPE OF 1V:10H.
7. IF SHOWN ELSEWHERE IN THE PLANS OR AS DIRECTED BY THE ENGINEER, THE GUARD FENCE MAY BE FLARED AT A RATE OF 25:1 OR FLATTER.
8. APPLICATIONS IN SOLID ROCK ARE ONLY ALLOWED WITH STEEL POSTS. SEE GF(31) STANDARD FOR INSTALLATION GUIDANCE.
9. POSTS SHALL NOT BE SET IN CONCRETE.
10. UNLESS OTHERWISE SHOWN IN THE PLANS, A COMPOSITE MATERIAL BLOCK THAT MEETS THE REQUIREMENTS OF DMS-7210, "COMPOSITE MATERIAL POSTS AND BLOCKS FOR METAL BEAM GUARD FENCE" MAY BE SUBSTITUTED FOR BLOCKS OF SIMILAR DIMENSIONS. THE CONSTRUCTION DIVISION, TXDOT MAINTAINS A MATERIAL PRODUCER LIST (MPL) FOR PRODUCERS OF MATERIALS CONFORMING TO DMS-7210. ONLY PRODUCERS ON THE MPL MAY FURNISH COMPOSITE MATERIAL BLOCKS.
11. REFER TO STANDARD GF(31) FOR ADDITIONAL DETAILS.
12. RAIL HEIGHT ADJUSTMENT IS ASSESSED AT TL-3 MASH COMPLIANT FOR STEEL POST HEIGHT TRANSITION TO 28" STEEL POST GUARDRAIL.

HARDWARE LIST


QTY	DESCRIPTION
1	25'-0" W-BEAM RAIL ELEMENT 12GA. (TYP)
5	7 1/2" DIA X 6'-0" DOMED ROUND WOOD POSTS (TYP)
5	6" X 8" X 68" RECTANGULAR WOOD POSTS (TYP)
5	W6 X 8.5 OR W6 X 9 X 72" STEEL POSTS (TYP)
5	6" X 8" X 14" WOOD BLOCKS OR COMPOSITE (TYP)
5	5/8" X 18" GUARDRAIL BOLTS AND NUTS (FBB04)
5	5/8" ROUND WASHERS (ASTM F436) (FWC16a)
5	5/8" X 10" GUARDRAIL BOLTS AND NUTS (FBB03)
16	5/8" X 1-1/4" GUARDRAIL SPLICE BOLTS WITH DOUBLE RECESSED NUTS (ASTM A563) (FBB01)

Texas Department of Transportation  
 Design Division Standard


**METAL BEAM GUARD FENCE  
 RAIL HEIGHT ADJUSTMENT  
 (28" TO 31")  
 TL-3 MASH COMPLIANT  
 RAIL-ADJ(B)-19**

FILE: railadjb19	DN:TXDOT	CK:KM	DW:VP	CK:CGL/AG
©TXDOT: NOVEMBER 2019	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
	DIST	COUNTY	SHEET NO.	
	BRY	MADISON	20	


DATE: 3/30/2023  
 FILE: pw:\Project\wiseamer\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91731031\_Trinity St\_V700\_CADD\STND\RDWY\mbgf19.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

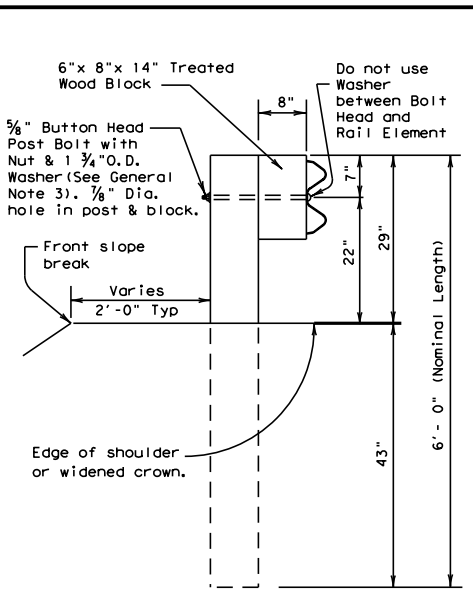


**TYPICAL POST**

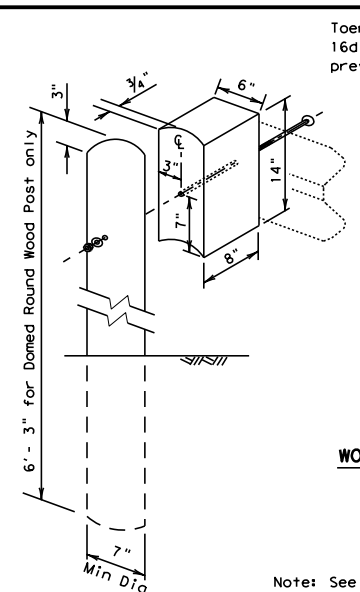


**WOOD BLOCK TO ROUND WOOD POST**

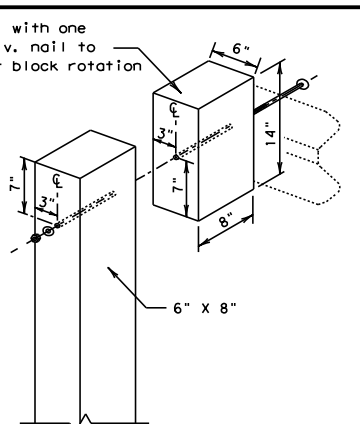


**WOOD BLOCK TO RECTANGULAR WOOD POST**

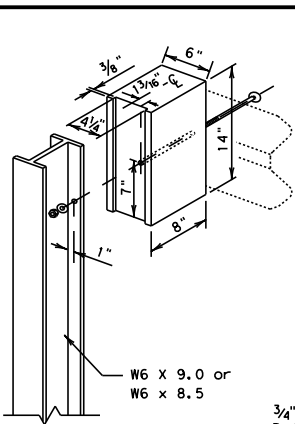


**WOOD BLOCK TO STEEL POST**

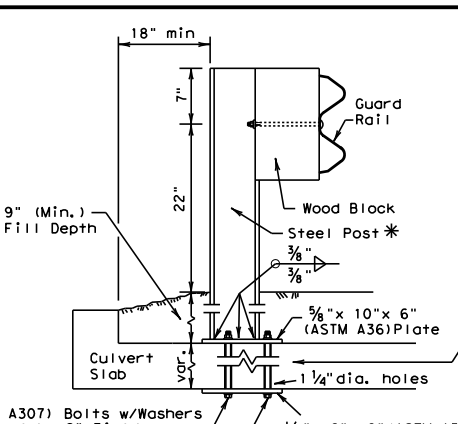

**\* LOW FILL CULVERT POST**  
FOR USE ON NON-BRIDGE CLASS CULVERTS ONLY

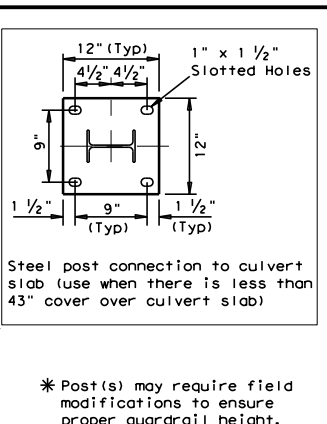


Steel post connection to culvert slab (use when there is less than 43" cover over culvert slab)

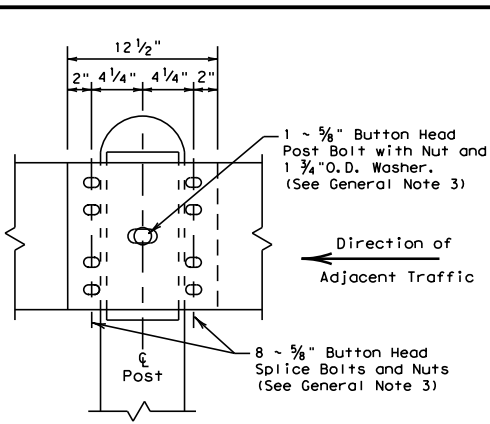


**RAIL SPLICE DETAIL**

**GENERAL NOTES**


- The type of post (round wood post, rectangular wood post, or steel post) will be shown elsewhere in the plans. The exact position of MBGF shall be shown elsewhere in the plans or as directed by the Engineer. Steel posts to be galvanized in accordance with Item 445, "Galvanizing."
- Rail element shall meet the requirements of Item 540, "Metal Beam Guard Fence" except as modified on the plans. The Contractor may furnish rail elements of 12 1/2 or 25 foot nominal lengths.
- Button head "post" bolts (ASTM A307) shall be of sufficient length to extend through the full thickness of the nut (ASTM A563) and Type A (1 3/4" O.D.) washer and not more than 1" beyond it. Button head "splice" bolts (ASTM A307) are 3/8" x 1 1/4" (or 2" long at triple rail splices) with a 3/8" double recessed nut (ASTM A563).
- Fittings (bolts, nuts, and washers) shall be galvanized in accordance with Item 445, "Galvanizing." Fittings shall be subsidiary to the bid item.
- Crown shall be widened to accommodate the Metal Beam Guard Fence.
- The lateral approach to the guard fence, shall have a slope rate of not more than 1V:10H.
- Unless otherwise shown in the plans, guard fence placed in the vicinity of curbs shall be positioned so that the face of curb is located directly below or behind the face of the block. Rail placed over curbs shall be installed so that the post bolt is located approximately 21 inches above the gutter pan or roadway surface.
- If solid rock is encountered within 0 to 18" of the finished grade, drill a 22" dia. hole, 24" into the rock, or drill two 12" dia. front to back overlapping holes, 24" into the rock. If solid rock is encountered below 18", drill a 12" dia. hole, 12" into the rock or to the standard embedment depth, whichever is less. Any excess post length, after meeting these depths, may be field cut to ensure proper guardrail mounting height. Backfill with a cohesionless material.
- Posts shall not be set in concrete, of any depth.
- Special fabrication will be required at installations having a curvature of less than 150 ft. radius.
- The terminal anchor section (TAS) post shall be set in Class A concrete (unless otherwise shown in the plans) in accordance with Item 421, "Hydraulic Cement Concrete." Concrete shall be subsidiary to the bid item requiring construction of the terminal anchor section (TAS). Terminal anchor post to be galvanized in accordance with Item 445, "Galvanizing."
- Unless otherwise shown in the plans, a composite material post and/or block that meets the requirements of DMS-7210, "Composite Material Posts and Blocks for Metal Beam Guard Fence" may be substituted for posts and/or blocks of similar dimensions. The Construction Division, TxDOT maintains a Material Producer List (MPL) for producers of materials conforming to DMS-7210. Only producers on the MPL can furnish composite material posts and/or blocks.

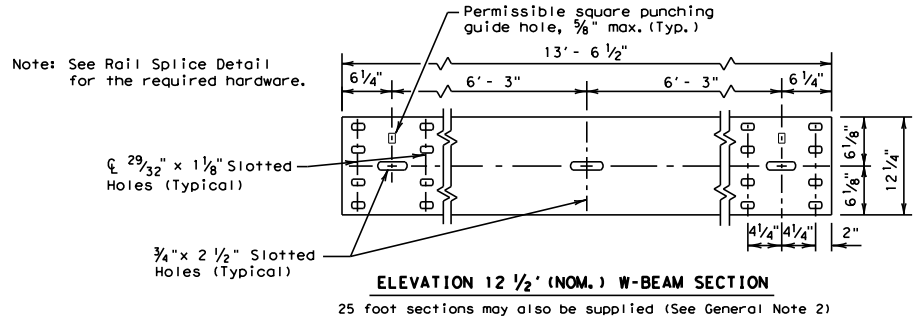

**ELEVATION 12 1/2' (NOM.) W-BEAM SECTION**  
25 foot sections may also be supplied (See General Note 2)

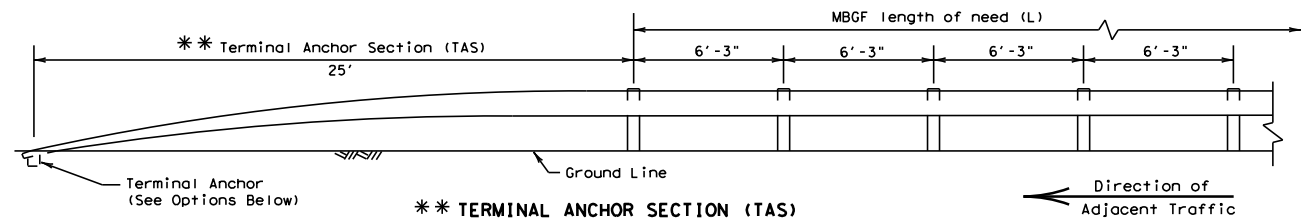


**\*\* TERMINAL ANCHOR SECTION (TAS)**  
Terminal anchor sections are only for downstream use, when located outside the horizontal clearance area of opposing traffic.

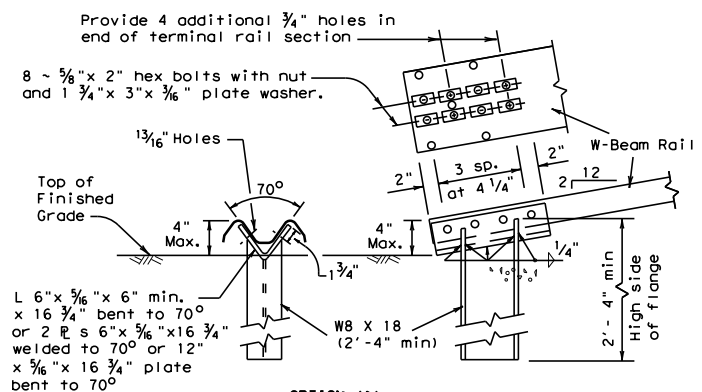

**OPTION (1)**

Note: This anchor post requires four additional 3/4" holes (shop or field) in the rail member with eight 3/8" hex bolts with nut and plate washer.

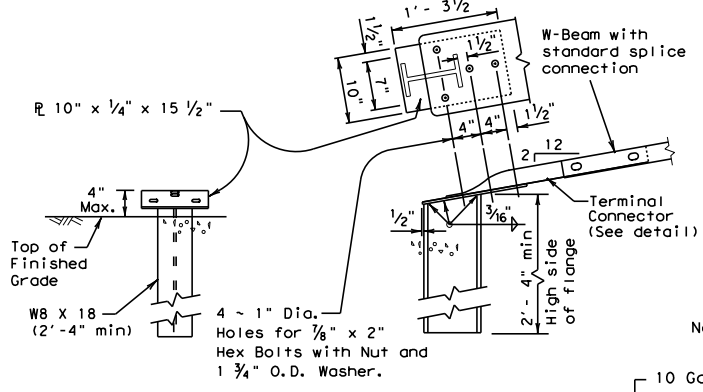


**OPTION (2)**


Note: This anchor post requires the use of the 10 ga. terminal connector with four 3/8" hex bolts with nut and washer.

**TERMINAL ANCHOR POST OPTIONS**  
(See General Note 11)


**Notes:**  
 Either concrete anchor may be used with either post option above.  
 No construction joint is allowed in the concrete anchor.  
 Terminal rail may be bolted to post and in twist position prior to placing concrete anchor.  
 If concrete anchor is precast, the area should be compacted as directed by the Engineer, when placed in the field.

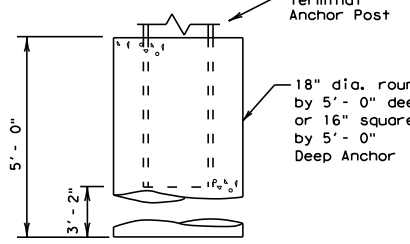


**TERMINAL CONCRETE ANCHOR OPTIONS**  
(See General Note 11)

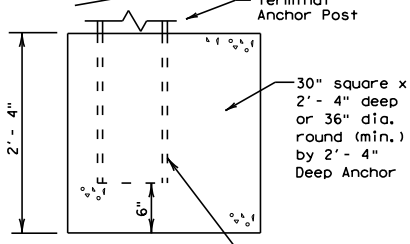

Place face of post approx. on center of anchor

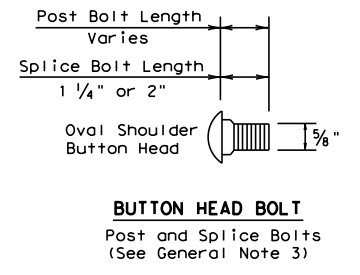

**BUTTON HEAD BOLT**  
Post and Splice Bolts  
(See General Note 3)

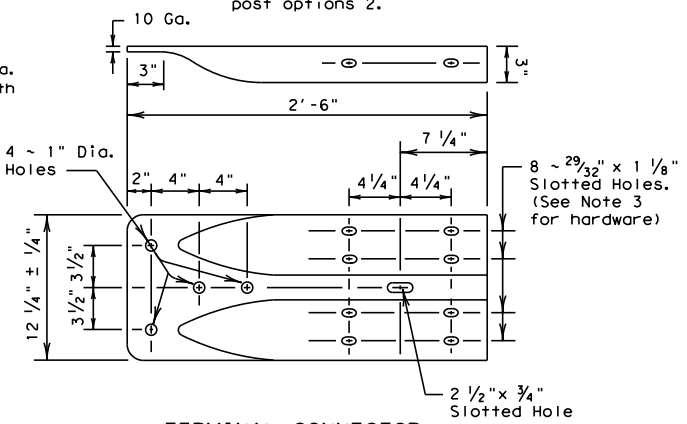


**TERMINAL CONNECTOR**

For connection hardware to concrete rails, see the MBGF transition standards.


**ONLY FOR USE IN MAINTENANCE REPAIRS OR HIGHLY CONSTRAINED SITE CONDITIONS.**

		<b>Design Division Standard</b>	
<h1>METAL BEAM GUARD FENCE</h1> <h2>MBGF - 19</h2>			
FILE: mbgf19.dgn	DN: TxDOT	CK: KM	DW: BD
© TxDOT NOVEMBER 2019	CONT: 0917	SECT: 31	JOB: 031
REVISIONS	DIST: BRY	COUNTY: MADISON	SHEET NO.: 21


DATE: 3/30/2023  
 FILE: \\Project\wisem\jacobson\US\_B\_I\_SS4\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\91731031\_Trinity St\700\_CADD\STND\RDWY\gf3119.dgn  
 DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TXDOT FOR ANY PURPOSE WHATSOEVER. TXDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

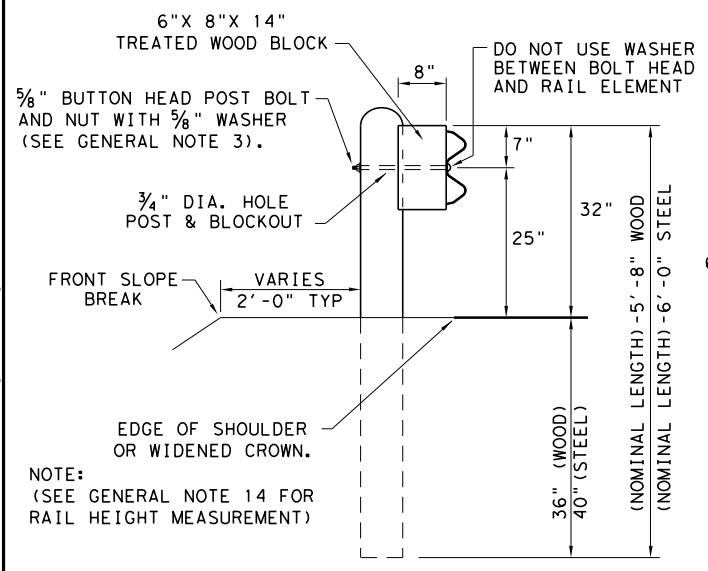

**TYPICAL POST PLACEMENT**

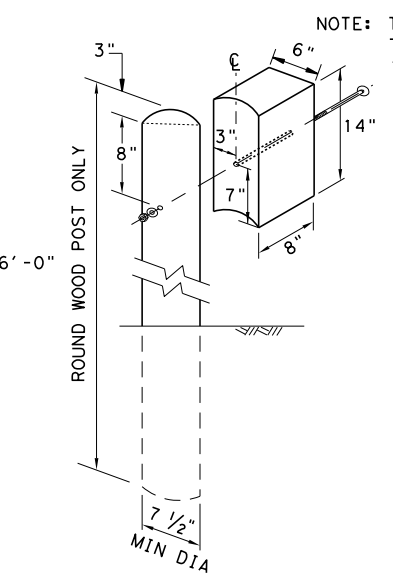


**WOOD BLOCK TO ROUND WOOD POST**

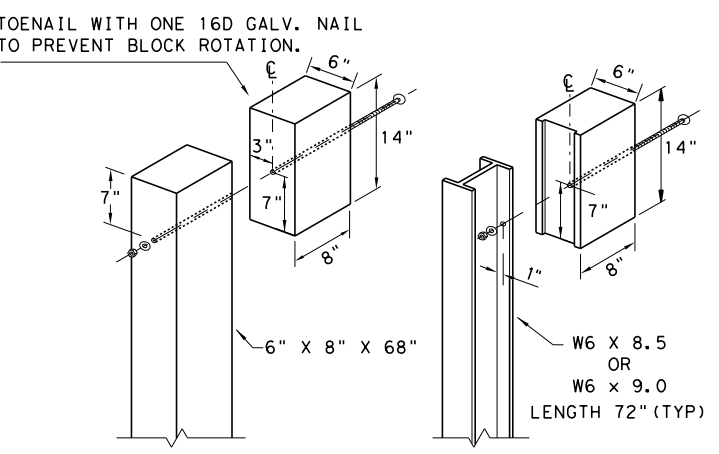

**WOOD BLOCK TO RECTANGULAR WOOD POST**


**ROUTED WOOD BLOCK TO I-BEAM STEEL POST**

- GENERAL NOTES**
1. THE TYPE OF POST (ROUND WOOD POST, RECTANGULAR WOOD POST, OR STEEL POST) WILL BE AS SHOWN IN THE PLANS. THE EXACT POSITION OF MBGF SHALL BE SHOWN IN THE PLANS OR AS DIRECTED BY THE ENGINEER. STEEL POSTS TO BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING."
  2. RAIL ELEMENTS SHALL MEET THE REQUIREMENTS OF ITEM 540, "METAL BEAM GUARD FENCE" EXCEPT AS MODIFIED IN THE PLANS. THE CONTRACTOR MAY FURNISH RAIL ELEMENTS OF 25'-0", OR 12'-6" (NOM.) LENGTHS. RAIL ELEMENTS MAY HAVE SLOTTED HOLES AT 3'-1 1/2" C-C OR 6'-3" C-C. A SPECIAL LENGTH OF RAIL MAY BE MANUFACTURED TO ACCOMMODATE THE DOWNSTREAM ANCHOR TERMINAL (DAT) AND THE TRANSITION SECTIONS OF GUARDRAIL.
  3. BUTTON HEAD "POST BOLTS & NUTS" SHALL MEET THE REQUIREMENTS OF (ASTM A307), AND SHALL BE OF SUFFICIENT LENGTH TO EXTEND THROUGH THE FULL THICKNESS OF THE NUT AND 5/8" WASHER (FWC160) AND NOT MORE THAN 1" BEYOND IT. TRIM REMAINING BOLT LENGTH TO MEET REQUIRED LENGTH.
  4. FITTINGS (BOLTS, NUTS, AND WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING." FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM.
  5. CROWN SHALL BE WIDENED TO ACCOMMODATE THE METAL BEAM GUARD FENCE.
  6. THE LATERAL APPROACH TO THE GUARD FENCE, SHALL HAVE A MAXIMUM SLOPE OF 1V:10H.
  7. IF SHOWN ELSEWHERE IN THE PLANS OR AS DIRECTED BY THE ENGINEER, THE GUARD FENCE MAY BE FLARED AT A RATE OF 25:1 OR FLATTER.
  8. UNLESS OTHERWISE SHOWN IN THE PLANS, GUARD FENCE PLACED IN THE VICINITY OF CURBS SHALL BE POSITIONED SO THAT THE FACE OF CURB IS LOCATED DIRECTLY BELOW OR BEHIND THE FACE OF THE RAIL. RAIL PLACED OVER CURBS SHALL BE INSTALLED SO THAT THE POST BOLT IS LOCATED APPROXIMATELY 25 INCHES ABOVE THE GUTTER PAN OR EDGE OF SHOULDER.
  9. APPLICATIONS IN SOLID ROCK ARE ONLY ALLOWED WITH STEEL POSTS. IF SOLID ROCK IS ENCOUNTERED WITHIN 0 TO 18" OF THE FINISHED GRADE, DRILL A 24" DIA. HOLE, 24" INTO THE ROCK. IF SOLID ROCK IS ENCOUNTERED BELOW 18", DRILL A 12" DIA. HOLE, 12" INTO THE ROCK OR TO THE STANDARD EMBEDMENT DEPTH, WHICHEVER MAYBE LESS. ANY EXCESS POST LENGTH, AFTER MEETING THESE DEPTHS, MAY BE FIELD CUT TO ENSURE PROPER GUARDRAIL MOUNTING HEIGHT. BACKFILL WITH COARSE AGGREGATE MATERIAL.
  10. POSTS SHALL NOT BE SET IN CONCRETE, OF ANY DEPTH.
  11. SPECIAL FABRICATION WILL BE REQUIRED AT INSTALLATION LOCATIONS HAVING A CURVATURE OF LESS THAN 150 FT. RADIUS.
  12. UNLESS OTHERWISE SHOWN IN THE PLANS, A COMPOSITE MATERIAL BLOCK THAT MEETS THE REQUIREMENTS OF DMS-7210, "COMPOSITE MATERIAL POSTS AND BLOCKS FOR METAL BEAM GUARD FENCE" MAY BE SUBSTITUTED FOR BLOCKS OF SIMILAR DIMENSIONS. THE CONSTRUCTION DIVISION, TXDOT MAINTAINS A MATERIAL PRODUCER LIST (MPL) FOR PRODUCERS OF MATERIALS CONFORMING TO DMS-7210 ONLY PRODUCERS ON THE MPL MAY FURNISH COMPOSITE MATERIAL BLOCKS.
  13. FOR THE LOW FILL CULVERT OPTION, POSTS LOCATED PARTIALLY OR WHOLLY BETWEEN PRECAST BOX CULVERT UNITS, THE USE OF A CAST-IN-PLACE CONCRETE CLOSURE BETWEEN BOXES IS REQUIRED. THE LENGTH OF THE CAST-IN-PLACE CONCRETE CLOSURE SHALL ACCOMMODATE THE PLACEMENT OF THE LOW FILL CULVERT OPTION. SEE CONCRETE CLOSURE DETAILS ON BRIDGE STANDARD SCP-MD.
  14. GUARDRAIL HEIGHT MEASUREMENT: WHEN THE GUARDRAIL IS LOCATED ABOVE PAVEMENT, MEASURE THE HEIGHT FROM THE PAVEMENT TO THE TOP OF THE W-BEAM RAIL. WHEN THE GUARDRAIL IS LOCATED UP TO 2 FT. OFF OF THE EDGE OF PAVEMENT OR FOR A PAVEMENT OVERLAY, USE A 10-FOOT STRAIGHTEDGE TO EXTEND THE PAVEMENT/SHOULDER SLOPE TO THE BACK OF RAIL, MEASURE FROM THE BOTTOM OF STRAIGHTEDGE TO THE TOP OF RAIL. FOR GUARDRAIL LOCATED DOWN A 10:1 SLOPE, MEASURE FROM THE NOMINAL TERRAIN.

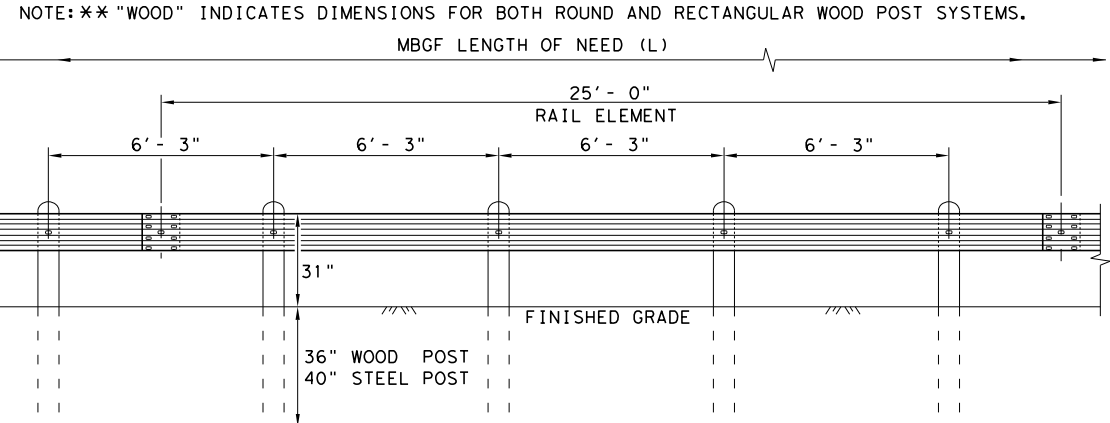


**ELEVATION MID-SPAN RAIL SPLICE**

NOTE: \*\* "WOOD" INDICATES DIMENSIONS FOR BOTH ROUND AND RECTANGULAR WOOD POST SYSTEMS.

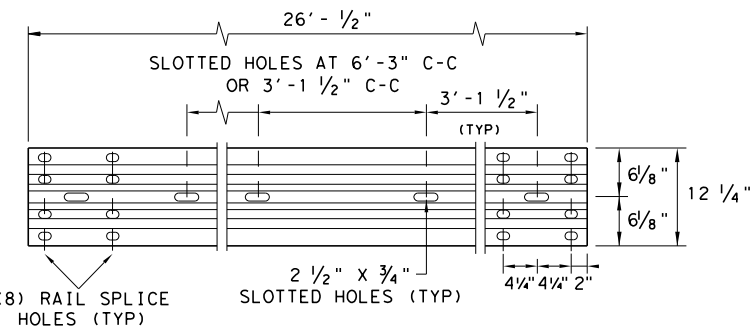


**ELEVATION 25'-0 (NOM.) W-BEAM SECTION**

NOTES: SEE GENERAL NOTE 2 FOR ALLOWABLE RAIL TYPES. SEE RAIL SPLICE DETAIL FOR REQUIRED HARDWARE.

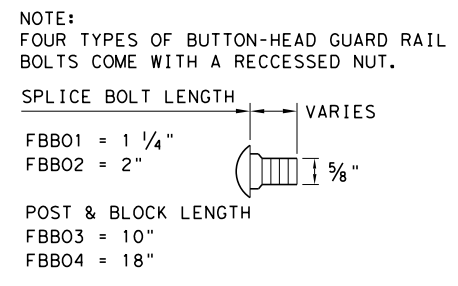

**BUTTON HEAD BOLT**


NOTE: SEE GENERAL NOTE 3 FOR SPLICE & POST BOLT DETAILS.

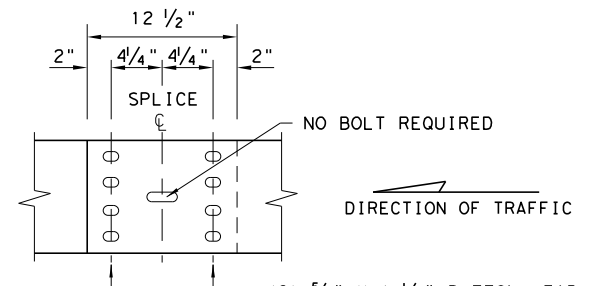

**MID-SPAN RAIL SPLICE DETAIL**

NOTE: GF(31), MID-SPAN RAIL SPLICES ARE REQUIRED WITH 6'-3" POST SPACINGS.

\* POST(S) MAY REQUIRE FIELD MODIFICATION TO ENSURE PROPER GUARDRAIL HEIGHT.

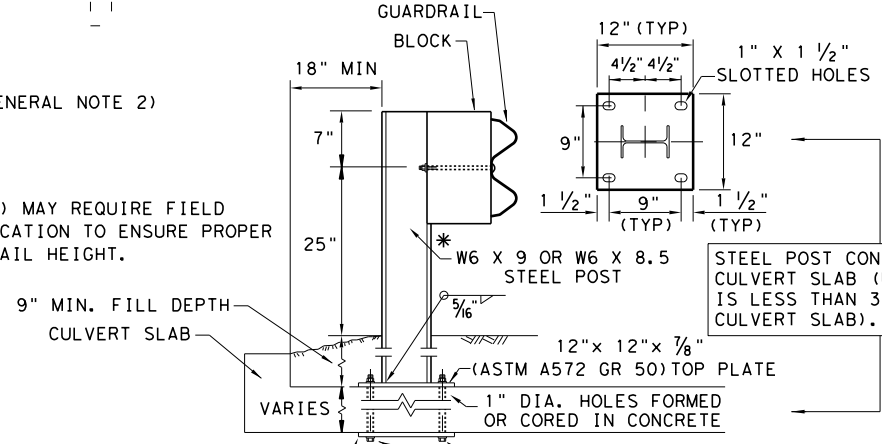

**LOW FILL CULVERT POST**

NOTE: TWO INSTALLATION OPTIONS.

1. **BOLT-THROUGH OPTION:** REQUIRES A 6" MIN. SLAB THICKNESS. 7/8" DIA (ASTM A449) HEAVY HEX BOLTS WITH TWO HARDENED WASHER EACH AND HEAVY HEX NUTS. NOTE: BOLT LENGTH = SLAB PLUS 2 1/4" MIN.
2. **EPOXY ANCHOR OPTION:** THIS OPTION MAY ONLY BE USED IF THE CULVERT SLAB IS 9" MIN. THICK. THREADED ANCHOR RODS MUST BE 7/8" DIA. ASTM A449 OR A193 GRADE B7 WITH HEAVY HEX NUT, AND ONE HARDENED WASHER EACH. EMBED ANCHOR RODS 6" WITH HILTI HIT RE 500 EPOXY ADHESIVE. OTHER TYPE III CLASS C EPOXY ADHESIVES MEETING THE REQUIREMENTS OF DMS-6100, "EPOXIES AND ADHESIVES", MAY BE USED IF IT CAN BE DEMONSTRATED THAT THEY MEET OR EXCEED THE STRENGTH OF HILTI HIT RE 500 WITH THE SAME EMBEDMENT DEPTH AND THREADED ROD DIA. FOLLOW THE MANUFACTURER'S REQUIREMENTS FOR INSTALLING EPOXIED THREADED RODS. EXTEND RODS 1/4" MIN. BEYOND NUT.

NOTE: CULVERTS OF 25 FT. OR LESS, SEE GF(31)LS STANDARD FOR "LONG SPAN" OPTION.

		<b>Design Division Standard</b>	
<b>METAL BEAM GUARD FENCE</b> <b>TL-3 MASH COMPLIANT</b> <b>GF(31)-19</b>			
FILE: gf3119.dgn	DN: TXDOT	CK: KM	DW: VP
© TXDOT: NOVEMBER 2019	CONT	SECT	JOB
REVISIONS	0917	31	031
	DIST	COUNTY	SHEET NO.
	BRY	MADISON	22



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for the use of this standard for any purpose other than that intended.

DATE: 3/30/2023 2:11:40 PM  
 FILE: \\Project\wise\amer\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Documents\WJXN4000.dgn

POST TYPE AND SUPPORT FOUNDATION DETAILS				TYPE OF BARRIER MOUNTS		
WING CHANNEL (WC)	FLEXIBLE POSTS (YFLX, WFLX)		WEDGE ANCHOR SYSTEMS		GUARD FENCE ATTACHMENT	
GND	GND	SRF	WAS	WAP	GF 1	GF 2
	EMBEDDED	SURFACE MOUNT	STEEL	PLASTIC	<b>CONCRETE TRAFFIC BARRIER (CTB)</b>	
<b>NOTES</b> 1. Embedded Wing Channel (WC) post option may be used for Type 2 Object Markers and Delineators only. 2. 1.12 lbs/ft steel per ASTM A 1011 SS Gr. 50, or ASTM A499.			<b>NOTE</b> 1. Install per manufacturer's recommendations.		<b>GENERAL NOTES</b> 1. Place delineators on a section of roadway at a consistent distance from the edge of pavement. 2. Where a restriction prevents consistent placement from the pavement edge, place the affected object markers in line with the innermost edge of the obstruction. 3. When Type 2 object markers and delineators are more than 8'-0" from the edge of the pavement, it may not be possible to maintain a height of approximately 4'-0". If this is the case, place the object marker or delineator as close to the desired height as possible. 4. Install all delineators, object markers and barrier reflectors in accordance with the manufacturer's recommendation. 5. Barrier reflectors should be installed a minimum of 18 inches above the edge of the pavement surface. 6. Diagonal stripes on Type 3 object markers shall slope down toward the intended travel lane.	
<b>NOTES</b> 1. See "Flexible Delineator and Object Marker Posts" Material Producer List for approved devices. 2. Install per manufacturer's recommendations. 3. Post length may vary to meet field conditions. 4. When using yellow delineators with flexible posts to separate opposing direction of travel, such as centerline or median use, the flexible posts shall be yellow.						
<b>TYPES 1, 3, AND 4 OBJECT MARKERS AND CHEVRONS</b>		<b>CHEVRONS AND ONE DIRECTION LARGE ARROW SIGN</b>		<b>DELINEATORS AND TYPE 2 OBJECT MARKERS</b>		
<b>NOTE</b> Mounting at 4 feet to the bottom of the chevron is permitted for chevrons that will not exceed a height of 6'-6" to the top of the chevron (sizes 24" x 30" and smaller)		<b>NOTE</b> Chevrons 30" x 36" and larger shall be mounted at a height of 7' to the bottom of the chevron. Chevron sign and ONE DIRECTION LARGE ARROW sign (W1-9T) shall be installed per SMD standard sheets and paid under item 644.		See general notes 1, 2 and 3.		

Texas Department of Transportation  
Traffic Safety Division Standard

## DELINEATOR & OBJECT MARKER INSTALLATION

### D & OM(2)-20



FILE: dom2-20.dgn	DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
© TXDOT August 2004	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
10-09 3-15	DIST	COUNTY	SHEET NO.	
4-10 7-20	BRY	MADISON	24	







REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: p:\Project\Wise\AMER\jacobs\US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity St\700 CADD\SHITDRNG\TrinitySL\_DA\_MAP.dgn

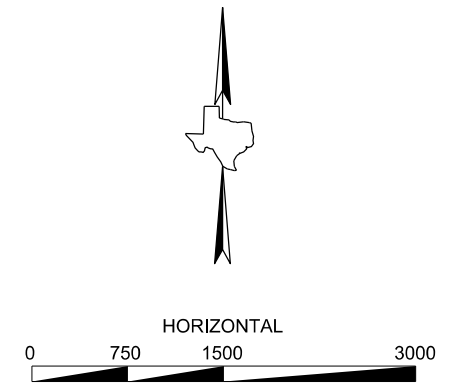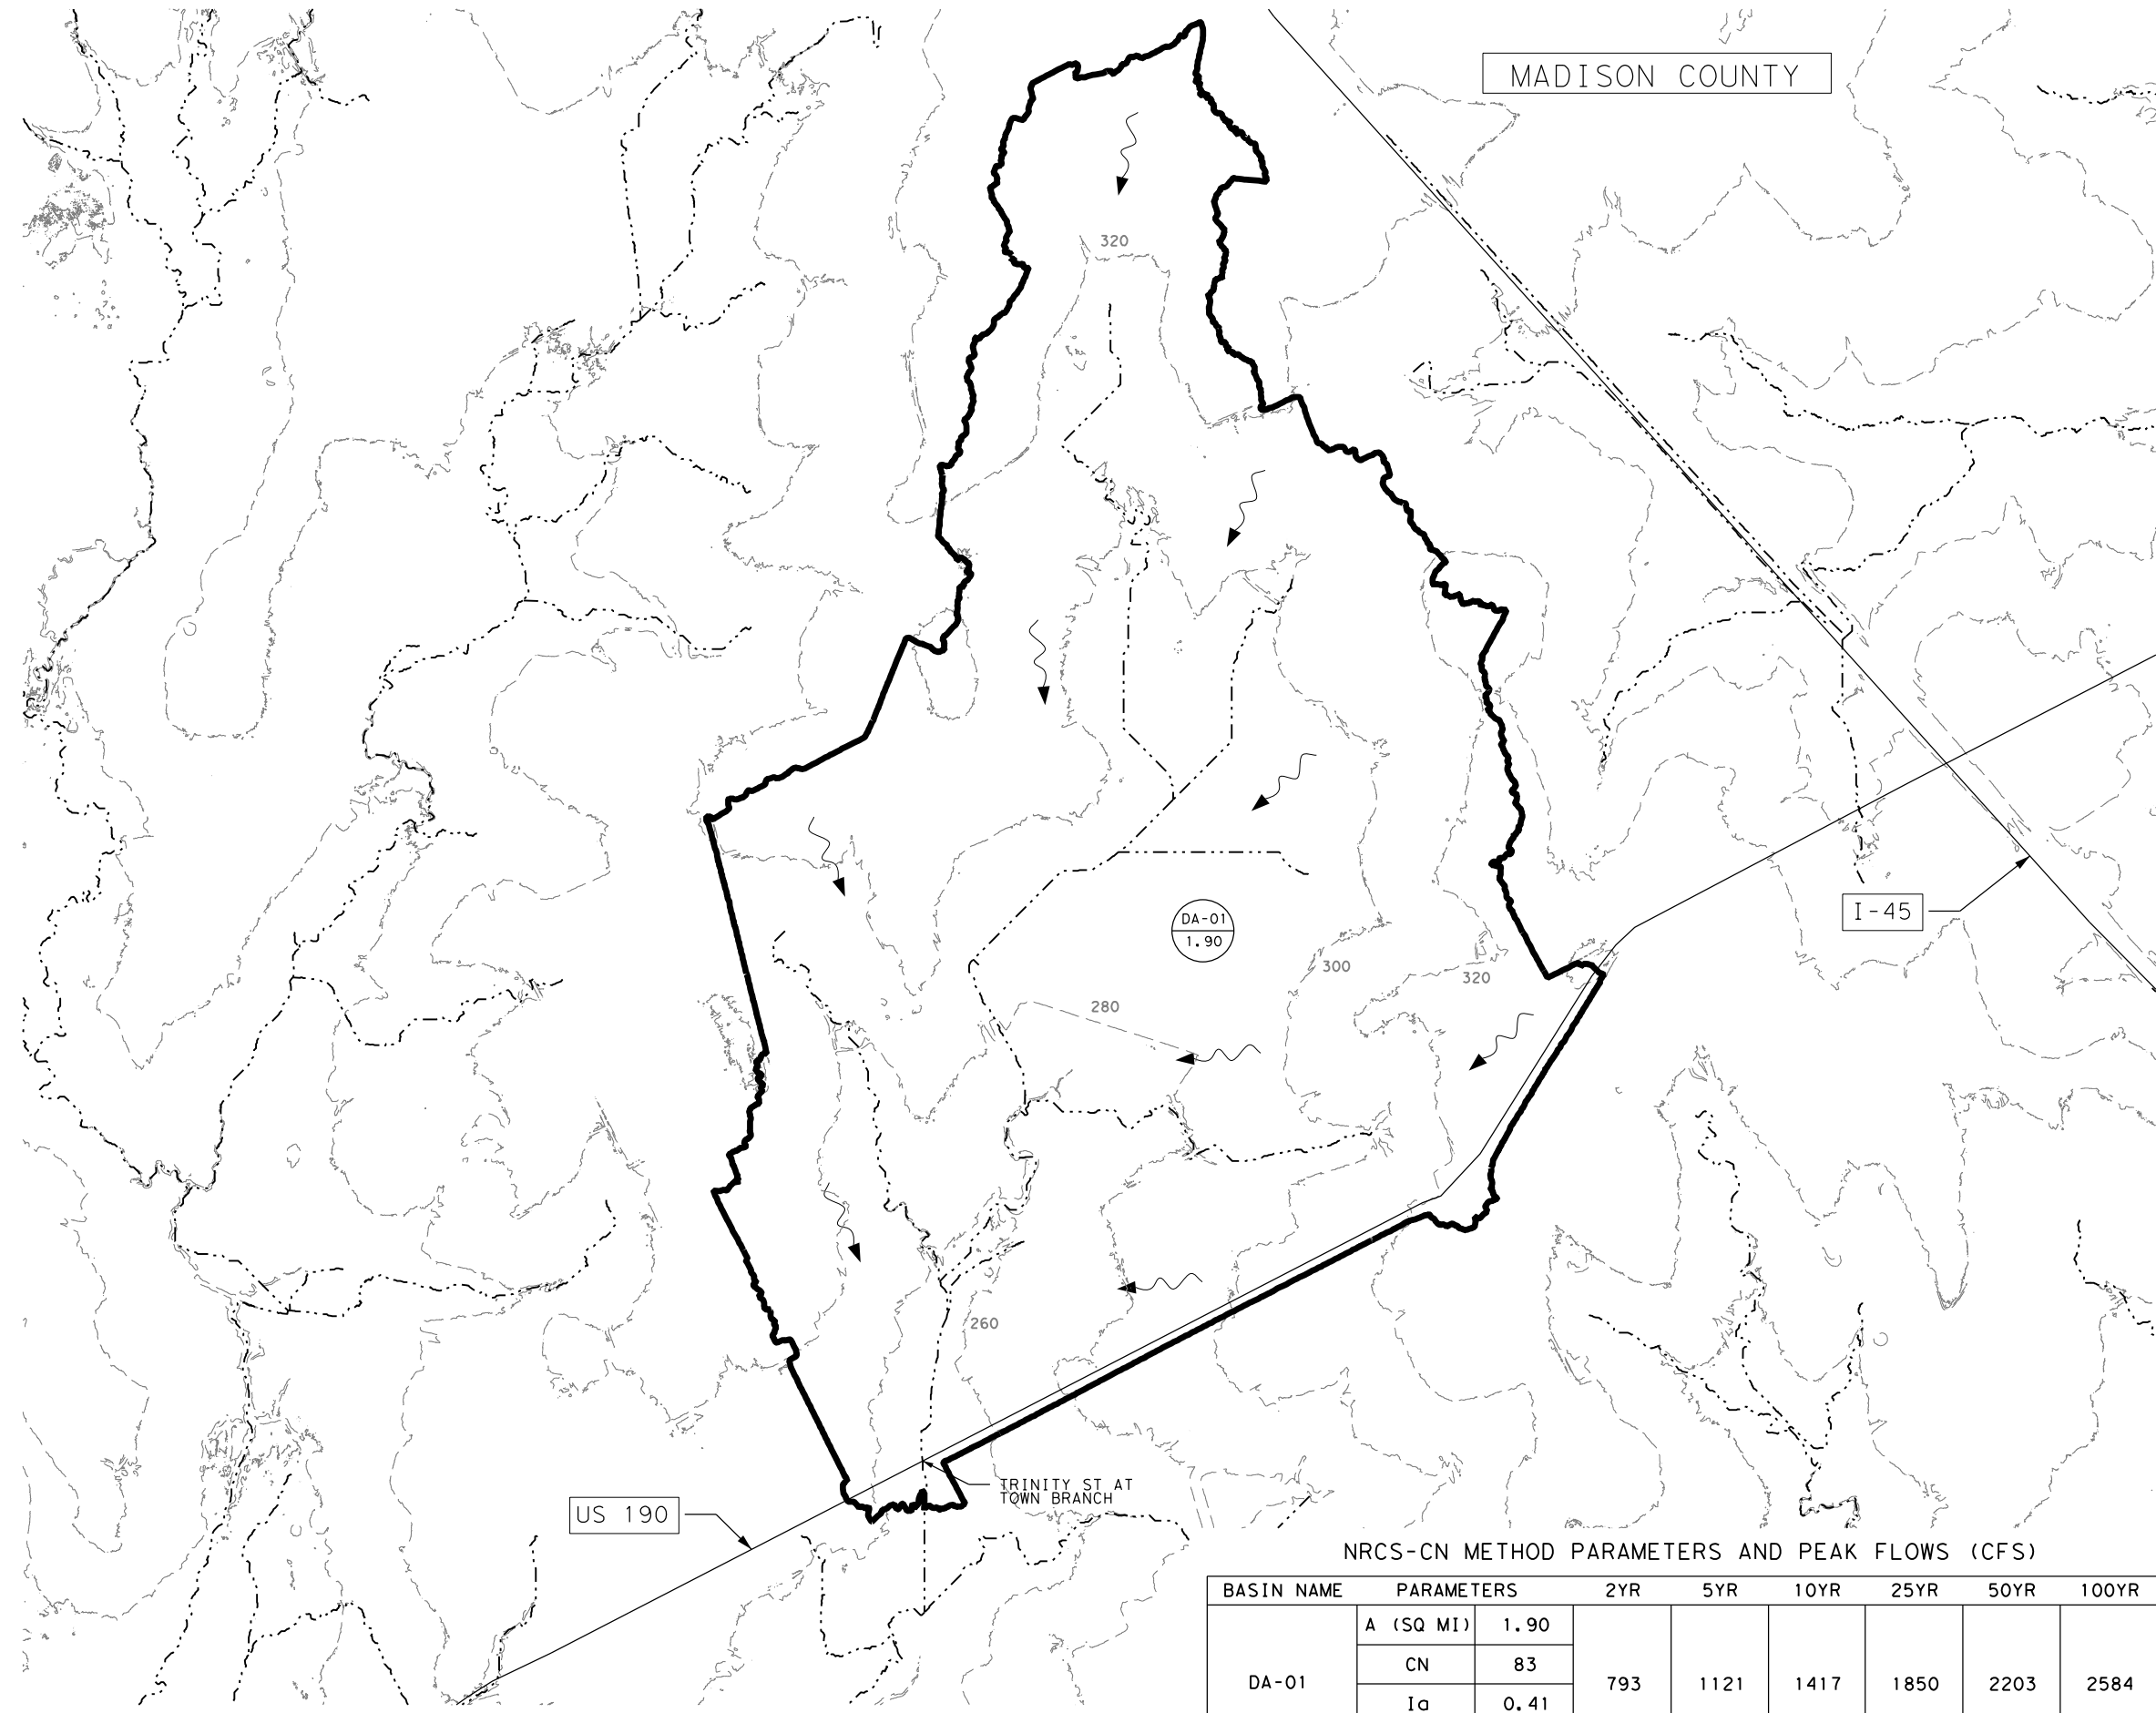

- LEGEND**
- NAME  
SQ. MI. DRAINAGE AREA I. D.
  - DRAINAGE AREA
  - CONTOUR
  - FLOW ARROW
  - STREAM

- NOTES:**
1. DRAINAGE AREA DELINEATED BASED ON USGS TOPOGRAPHIC DATA.
  2. NRCS-CN METHOD WAS USED TO CALCULATE PEAK FLOWS PER TXDOT HYDRAULIC DESIGN MANUAL (SEPT, 2019)
  3. FEMA ZONE AE, MAP NO 480464 0004B, EFFECTIVE MARCH 5, 1990



PRINT DATE	REVISION DATE
3/29/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



**DRAINAGE AREA MAP**

NRCS-CN METHOD PARAMETERS AND PEAK FLOWS (CFS)

BASIN NAME	PARAMETERS	2YR	5YR	10YR	25YR	50YR	100YR	
DA-01	A (SQ MI)	1.90	793	1121	1417	1850	2203	2584
	CN	83						
	I <sub>a</sub>	0.41						
	T <sub>lag</sub> (Min)	107.4						

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	27


HEC-RAS 10-YEAR COMPARISON

RIVER STATION (FT)	LOCATION	PROPOSED STRUCTURE			RIVER STATION (FT)	EXISTING STRUCTURE		
		10 YR				10 YR		
		Q	V (CHAN)	WSEL		Q	V (CHAN)	WSEL
CFS	FPS	FT	CFS	FPS	FT			
703		1417	6.55	253.17	703	1417	6.34	253.33
623		1417	6.57	252.82	623	1417	6.30	253.02
526		1417	4.51	252.81	526	1417	4.32	253.01
452	BR U/S XS	1417	3.07	252.82	452	1417	2.90	253.03
428	TOWN BR	Culvert			428	Bridge		
378	BR D/S XS	1417	4.80	252.45	378	1417	4.80	252.45
317		1417	4.46	252.37	317	1417	4.46	252.37
257		1417	4.16	252.32	257	1417	4.16	252.32
187		1417	3.58	252.31	187	1417	3.58	252.31


HEC-RAS 100-YEAR COMPARISON

RIVER STATION (FT)	LOCATION	PROPOSED STRUCTURE			RIVER STATION (FT)	EXISTING STRUCTURE		
		100 YR				100 YR		
		Q	V (CHAN)	WSEL		Q	V (CHAN)	WSEL
CFS	FPS	FT	CFS	FPS	FT			
703		2584	6.64	255.38	703	2584	5.78	255.72
623		2584	7.86	254.68	623	2584	5.88	255.48
526		2584	5.24	254.78	526	2584	4.29	255.48
452	BR U/S XS	2584	3.59	254.81	452	2584	3.09	255.49
428	TOWN BR	Culvert			428	Bridge		
378	BR D/S XS	2584	5.40	254.55	378	2584	5.41	254.55
317		2584	4.96	254.50	317	2584	4.96	254.50
257		2584	4.98	254.42	257	2584	4.98	254.42
187		2584	4.28	254.42	187	2584	4.28	254.42

CROSS SECTION LAYOUT MAP

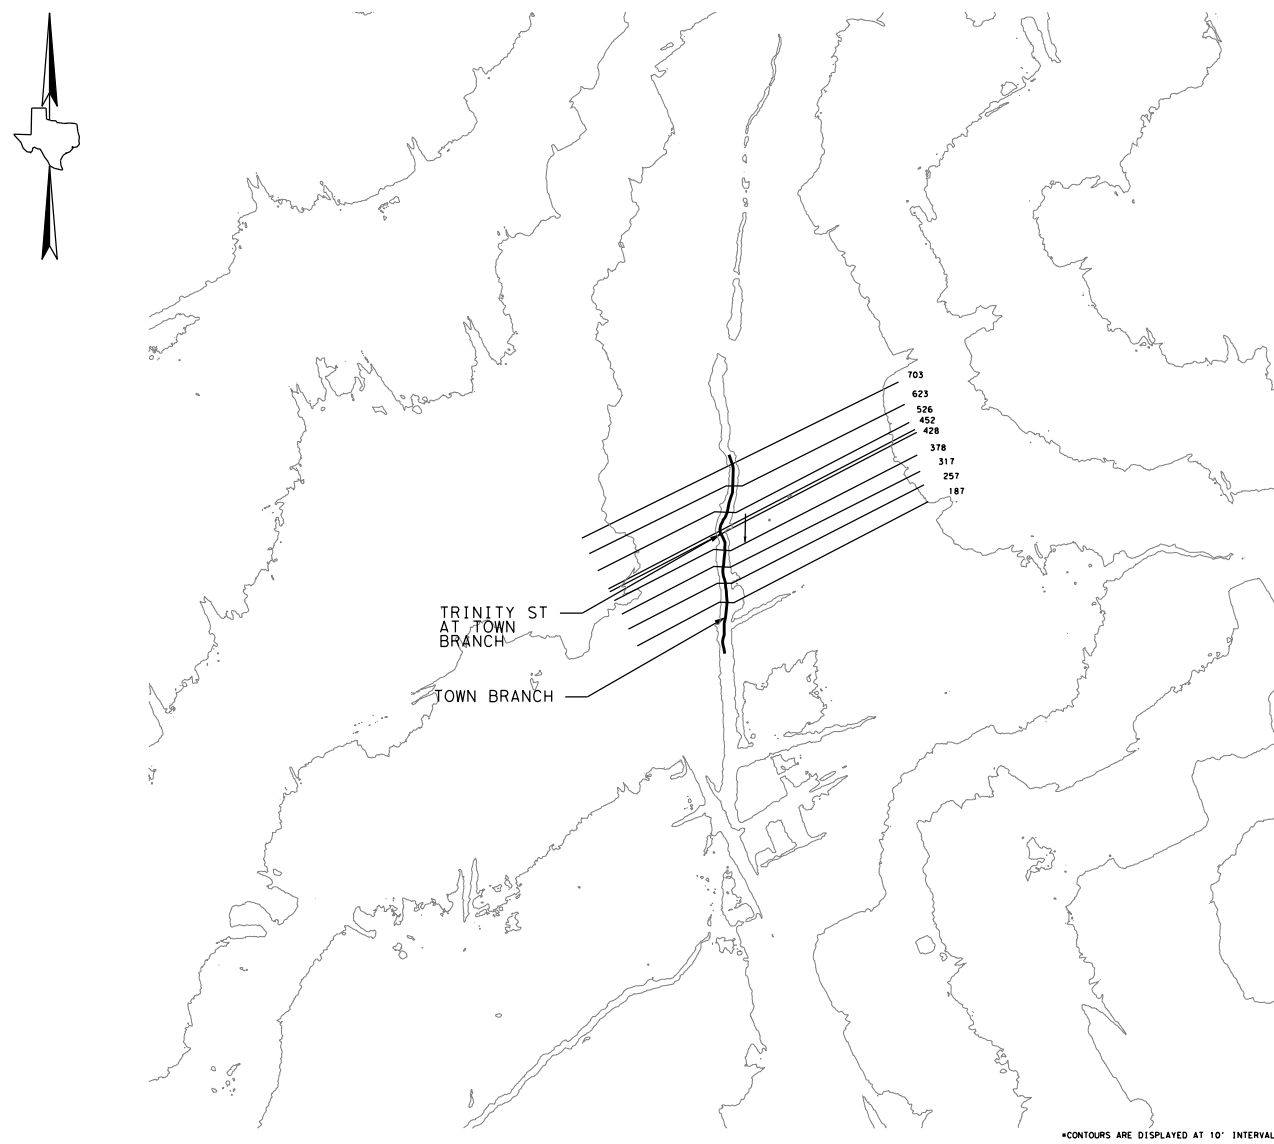


TRINITY ST AT TOWN BRANCH HEC-RAS CROSS SECTION COMPUTATION

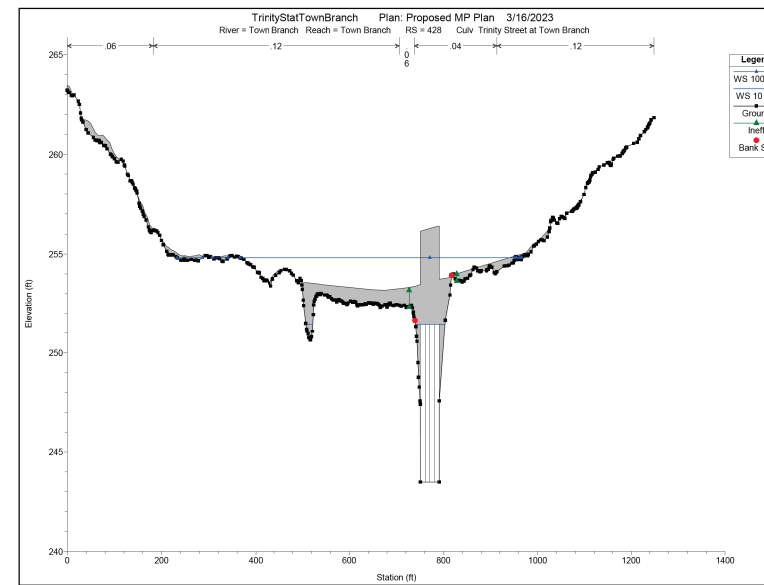

NOTES:

- HEC-RAS VER 5.0.7 WAS USED FOR THE HYDRAULIC ANALYSIS AND DESIGN OF THE BRIDGE. NORMAL DEPTH COMPUTATION USED FOR THE DOWNSTREAM BOUNDARY CONDITION SLOPE = 0.000781 FT/FT FOR EXISTING AND PROPOSED CONDITIONS.
- MADISON COUNTY FLOODPLAIN ADMINISTRATOR, SHELLY BUTTS, WAS INFORMED OF THE PROPOSED PROJECT AND PROVIDED WITH A SUMMARY OF HYDRAULIC IMPACTS ON XX-XX-XXXX.

TRINITY ST AT TOWN BRANCH HEC-RAS PROFILE COMPUTATION

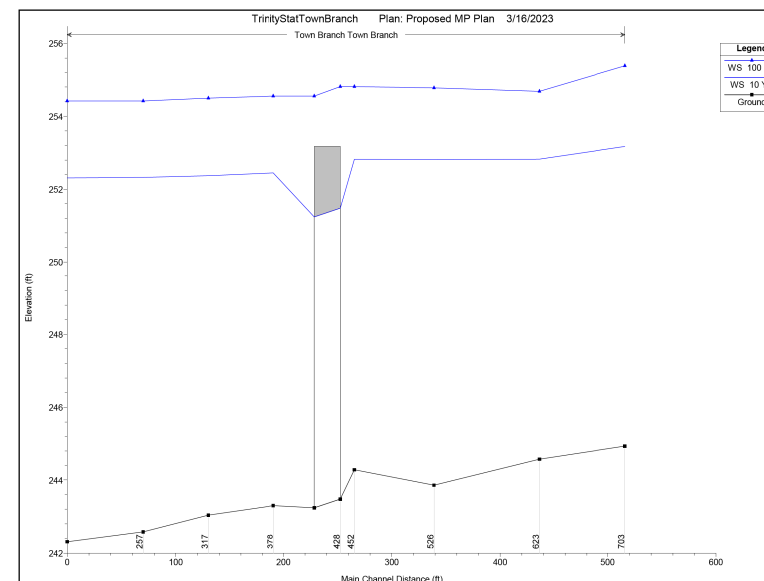

ADAM N. KORANSKY
   
 95988
   
 LICENSED PROFESSIONAL ENGINEER
   
 3/29/2023

PRINT DATE	REVISION DATE
3/30/2023	


**Jacobs**
  
 2705 BEE CAVE RD, SUITE 300
   
 AUSTIN TX 78746
   
 FIRM REGISTRATION F-2966

Texas Department of Transportation
   
 Bryan District

HYDRAULIC DATA SHEET

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	28

REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: \_pwc\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity St\Town Branch\Trinity St\Town Branch\Trinity Street\_HDS\_01.dgn



- NOTES:
1. CONTRACTOR SHALL VERIFY ALL EXISTING UTILITIES BEFORE BEGINNING ANY TYPE OF WORK.
  2. SEE HORIZONTAL ALIGNMENT DATA SHEET FOR ROADWAY GEOMETRIC DATA.
  3. SEE ROADWAY DETAILS SHEETS FOR CURB RADIUS AND ADDITIONAL INFORMATION.
  4. ALL PIPES ARE CLASS III, UNLESS OTHERWISE NOTED.

FUNCTIONAL CLASS : LOCAL  
 DESIGN SPEED: MOIEC  
 ADT: 56 (2021) 56 (2041)  
 EXISTING NBI NO: 17-154-0-B003-25-001  
 NBI NO: 17-154-0-B003-25-101





PRINT DATE	REVISION DATE
3/30/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966



**BRIDGE CLASS CULVERT 01  
 PLAN AND PROFILE  
 STA 104+45.00  
 SHEET 1 OF 1 SHEET**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	29

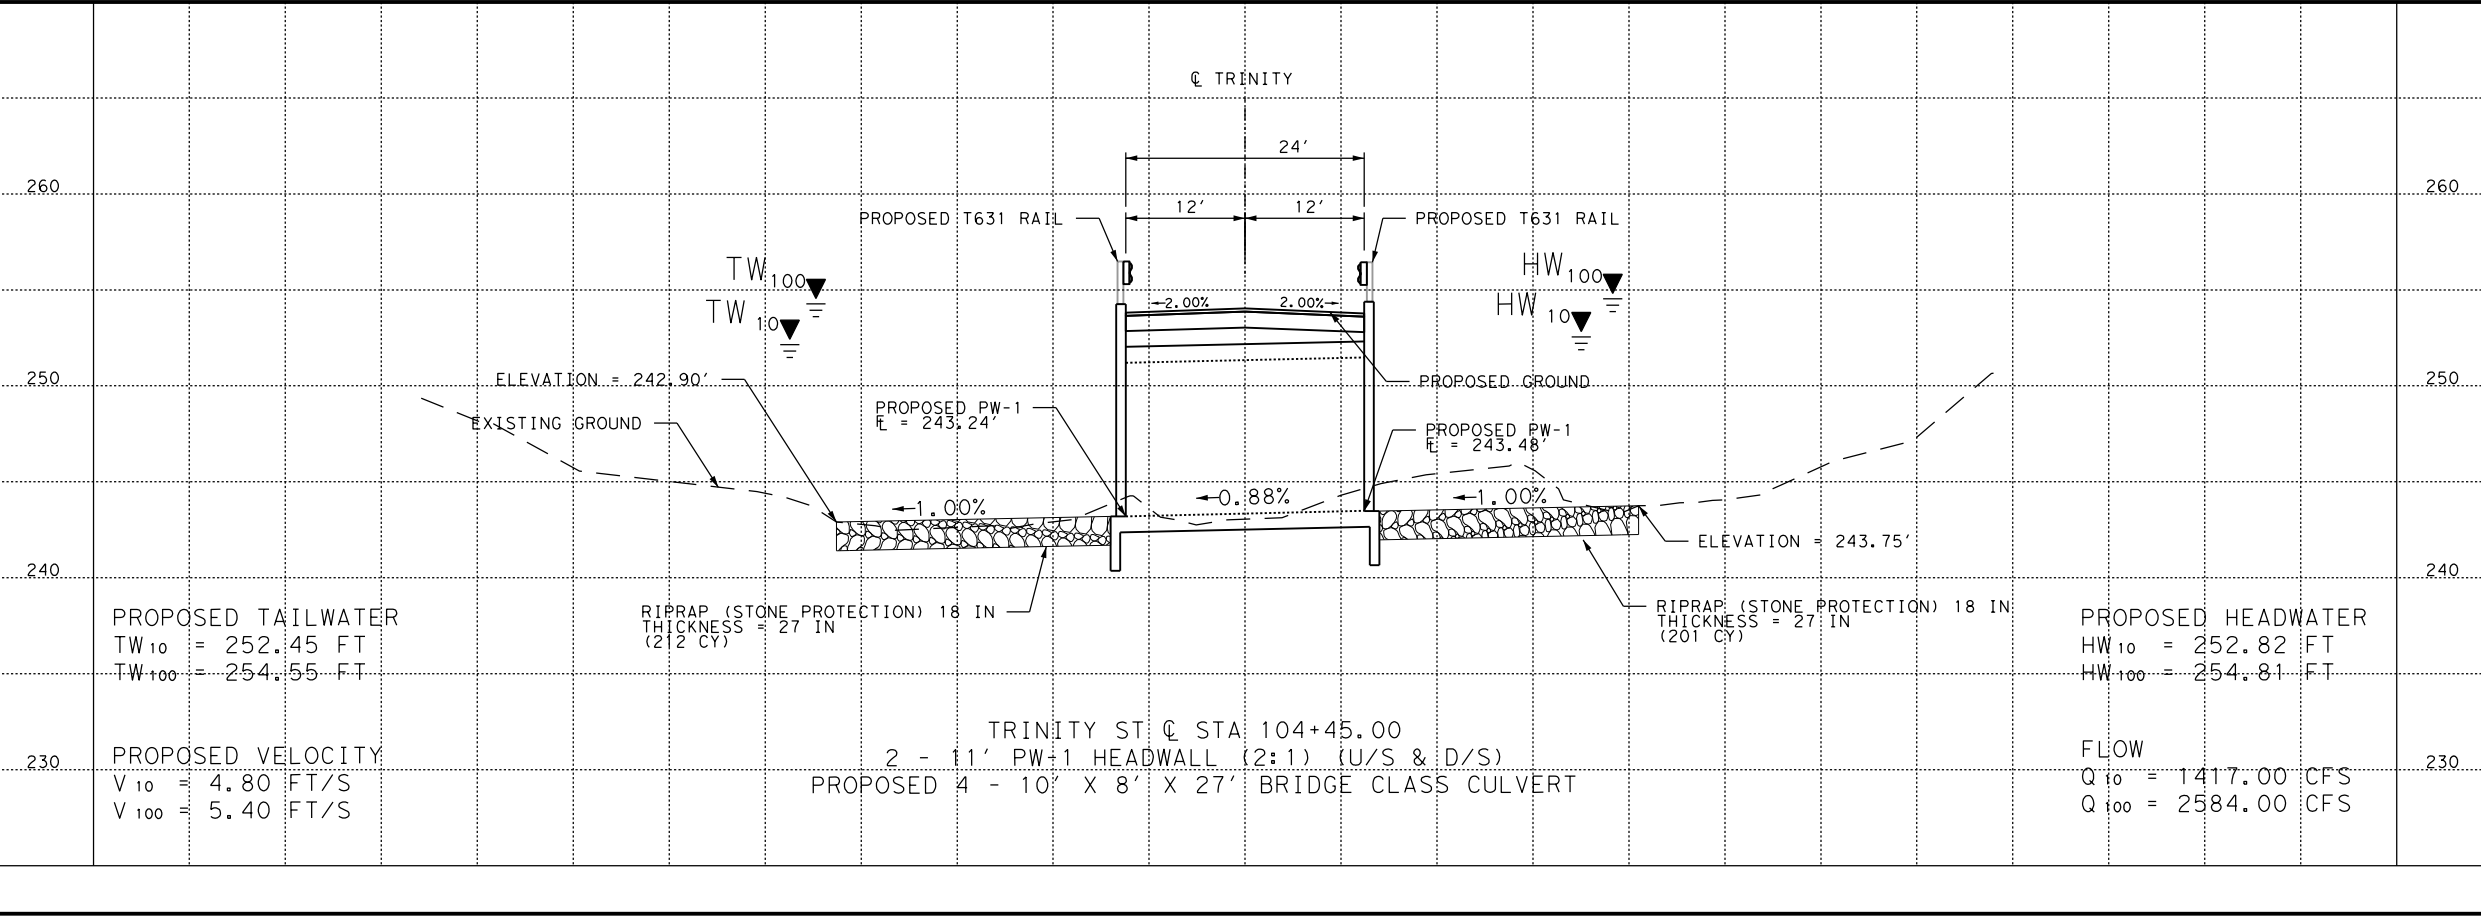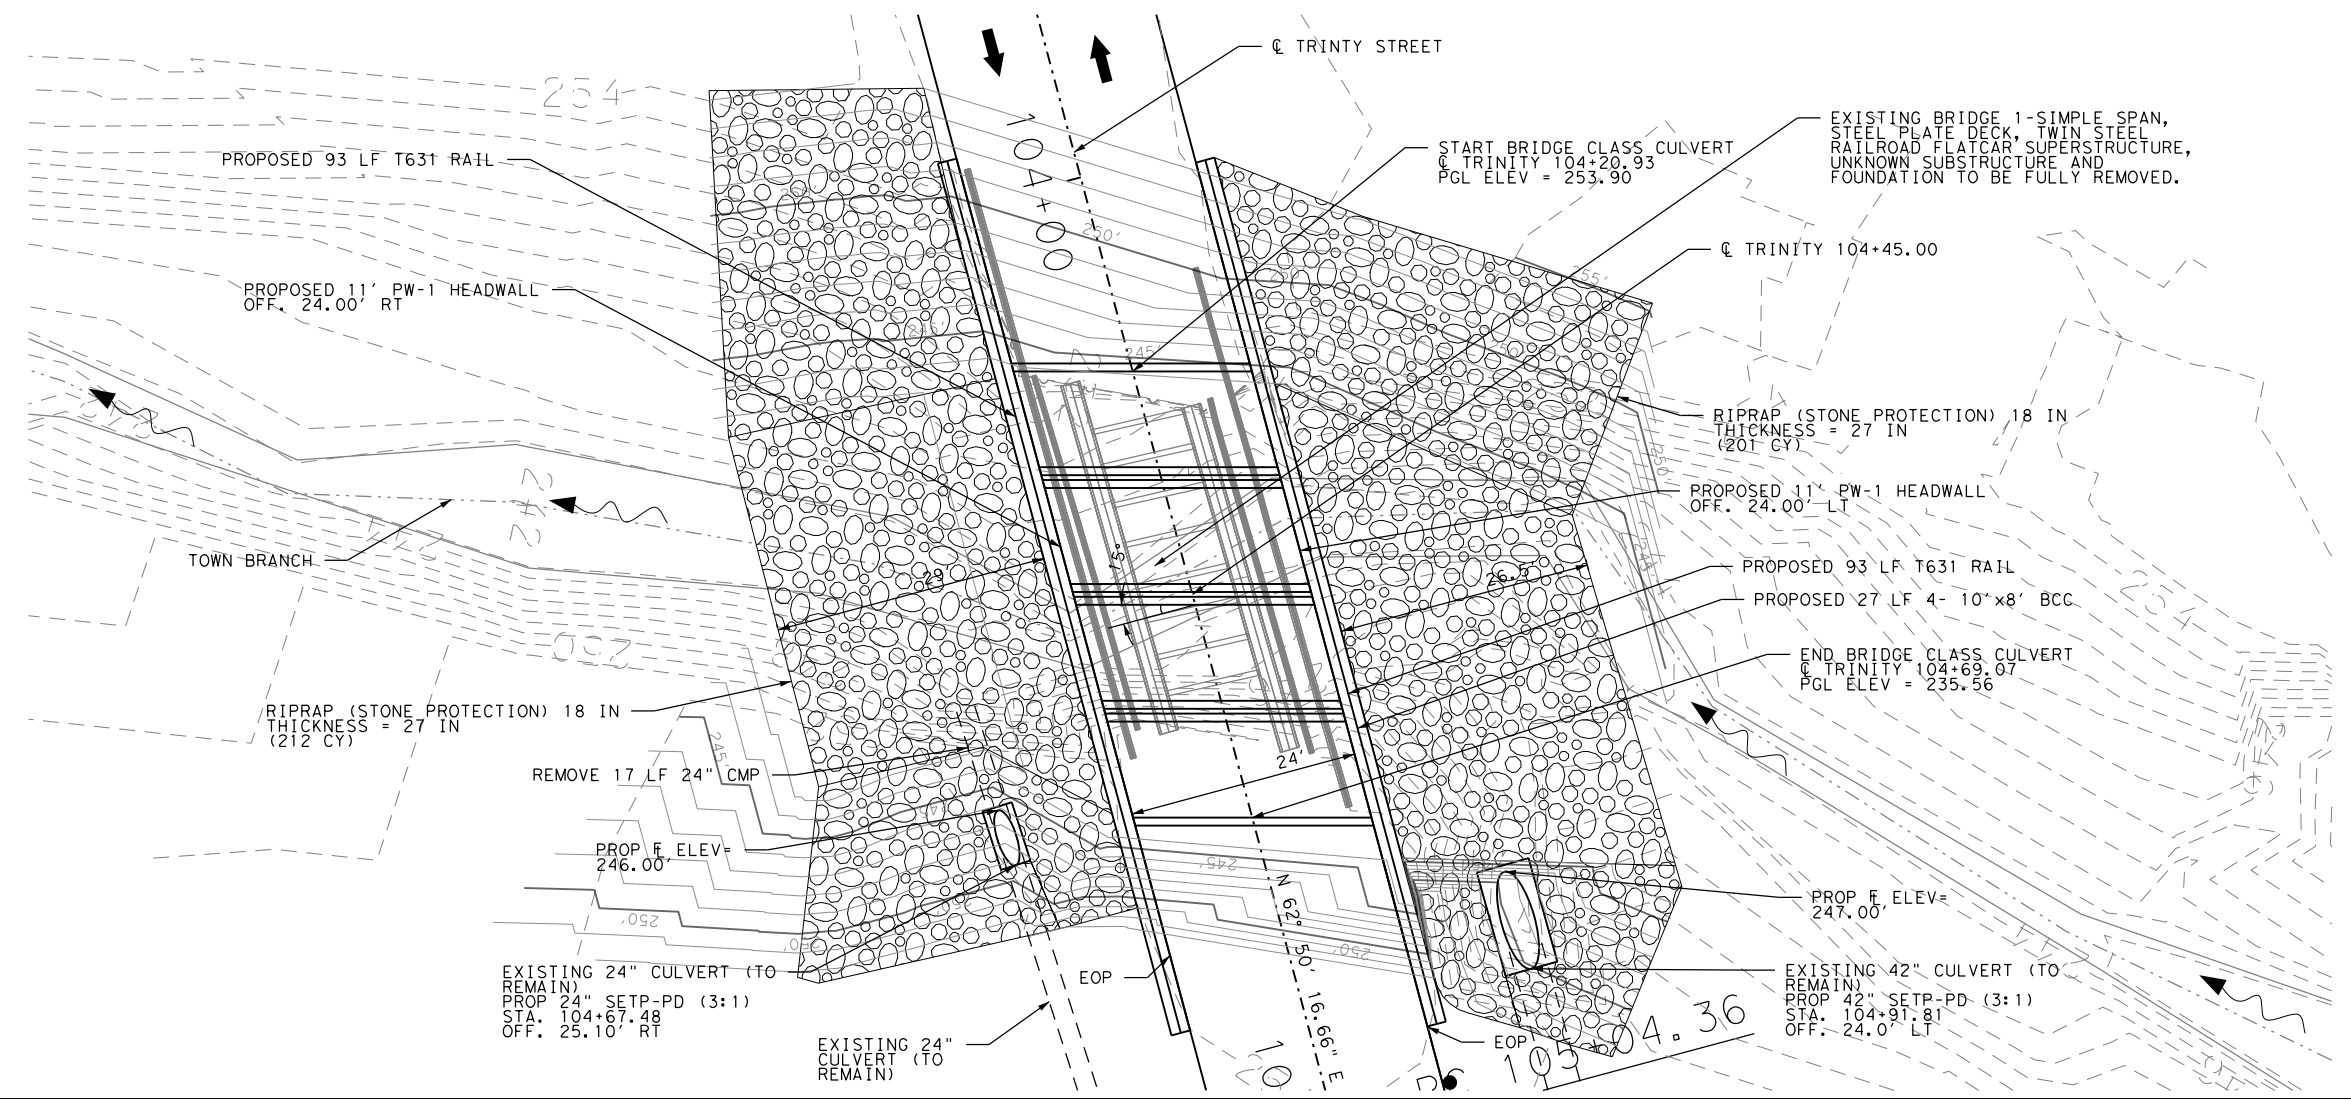

PROPOSED TAILWATER  
 TW<sub>10</sub> = 252.45 FT  
 TW<sub>100</sub> = 254.55 FT

PROPOSED VELOCITY  
 V<sub>10</sub> = 4.80 FT/S  
 V<sub>100</sub> = 5.40 FT/S

PROPOSED HEADWATER  
 HW<sub>10</sub> = 252.82 FT  
 HW<sub>100</sub> = 254.81 FT


FLOW  
 Q<sub>10</sub> = 1417.00 CFS  
 Q<sub>100</sub> = 2584.00 CFS

TRINITY ST @ STA 104+45.00  
 2 - 11' PW-1 HEADWALL (2:1) (U/S & D/S)  
 PROPOSED 4 - 10' X 8' X 27' BRIDGE CLASS CULVERT


REV DATE: 2-12-2015  
 CSJ: 0917-31-031  
 FILENAME: pw\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\W\XN4000\_BRY\_Bridge\_Program\W\XN4000\91731031\_Trinity St\700\_CADD\SHITDRNG\TRINITY\_CULV\_PP01.dgn

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

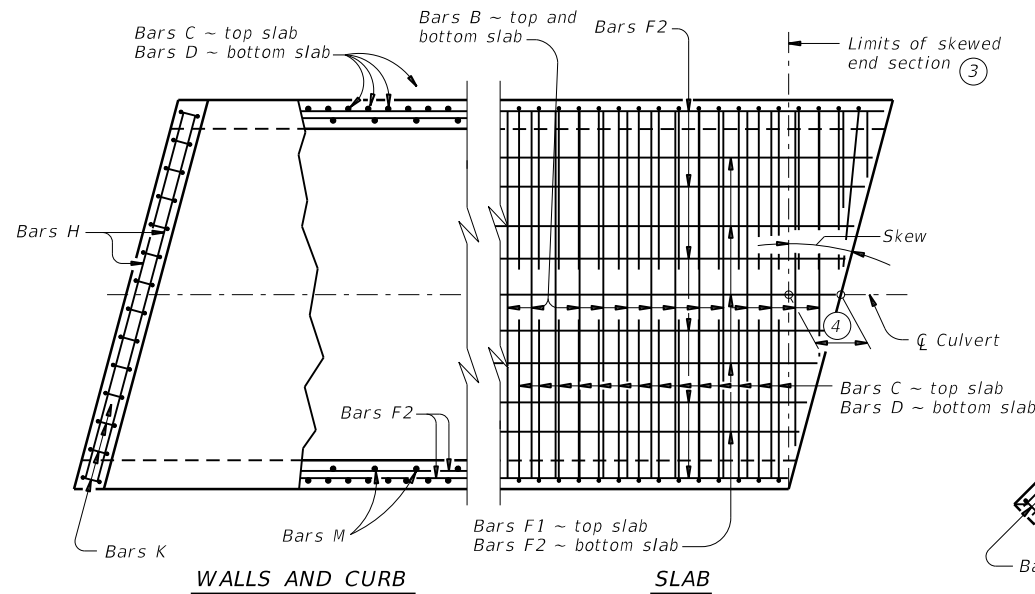


PLAN OF SKEWED ENDS ~ FROM 0° TO 15°

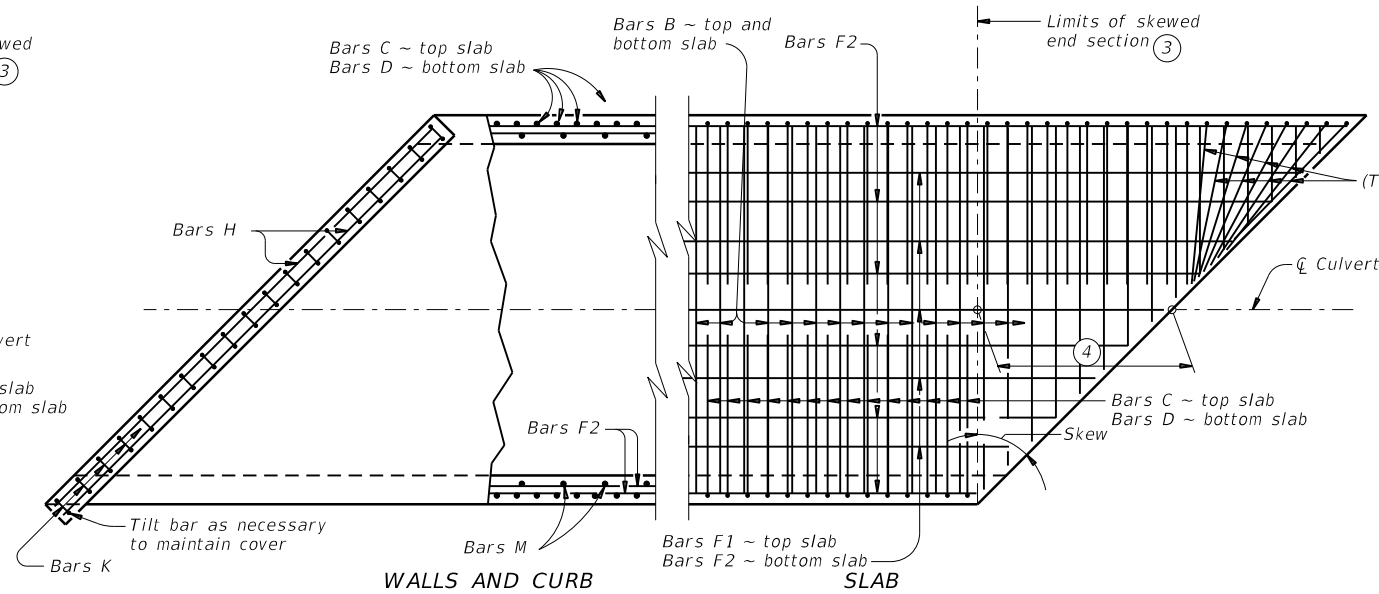


PLAN OF SKEWED ENDS ~ OVER 30° TO 45°

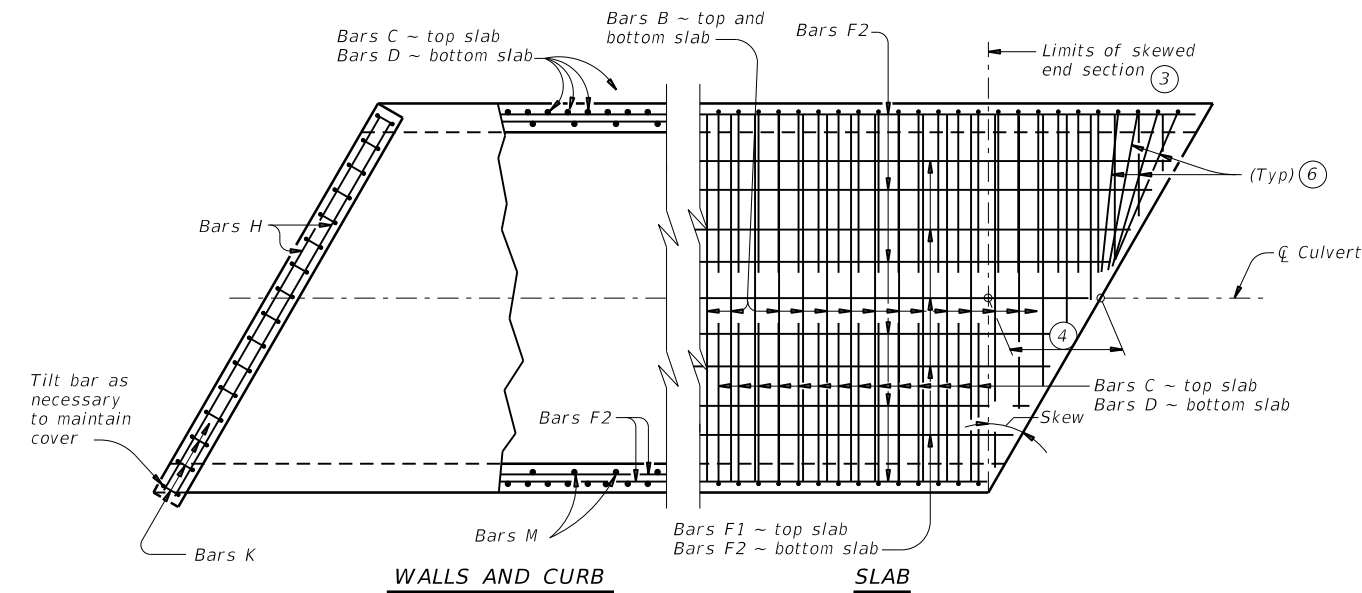


PLAN OF SKEWED ENDS ~ OVER 15° TO 30°

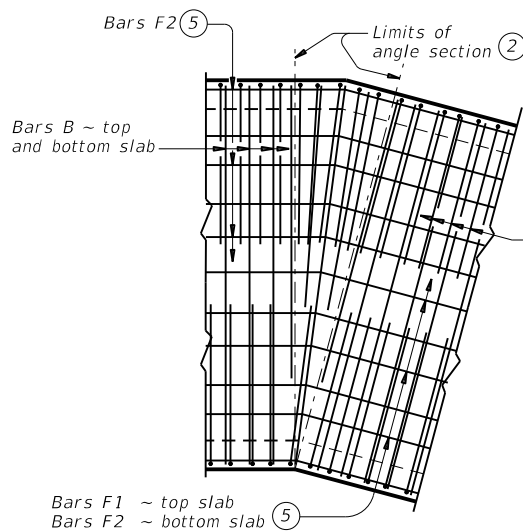


PLAN OF ANGLE SECTION ~ FROM 0° TO 15°

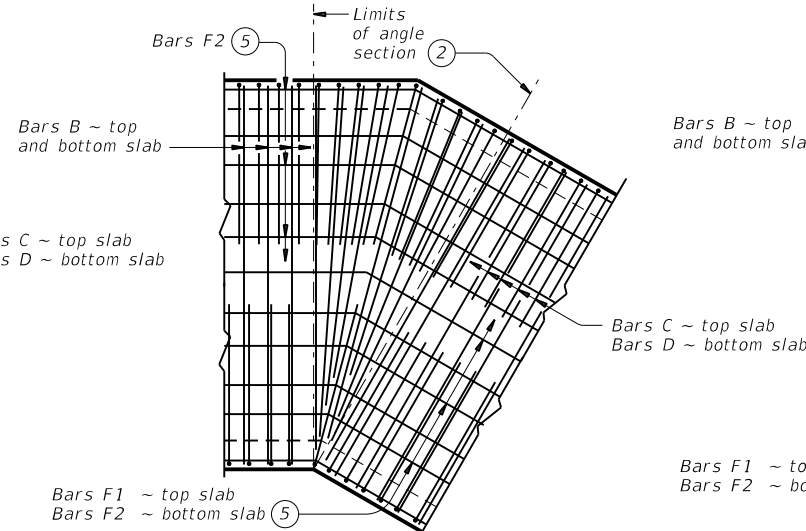

PLAN OF ANGLE SECTION ~ OVER 15° TO 30°

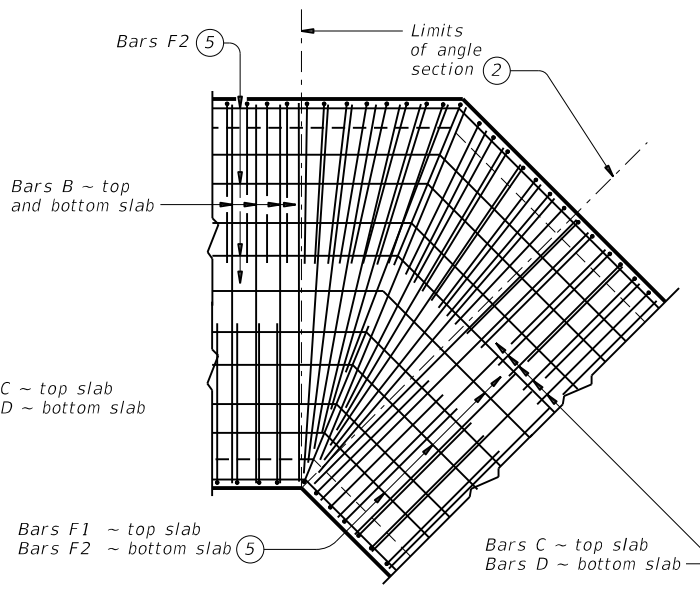

PLAN OF ANGLE SECTION ~ OVER 30° TO 45°

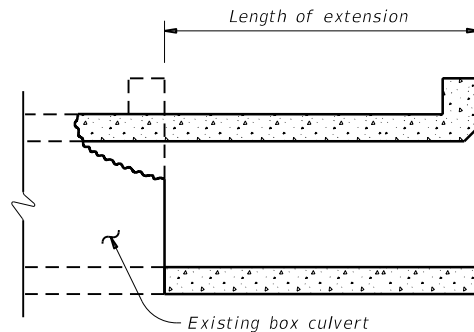

LENGTHENING DETAIL

- For skewed box culverts with less than 2'-0" of fill, break back the top slab to provide a 1'-10" minimum lap of the existing longitudinal bars with the longitudinal bars in the extension.  
For non-skewed box culverts with less than 2'-0" of fill and for skewed or non-skewed culverts with a fill depth of 2'-0" or greater, break back the top slab to provide a 1'-10" minimum lap of the existing longitudinal bars with the longitudinal bars in the extension. Alternatively, if the box is non-skewed, embed #6 anchor bars with a Type III, C, D, E, or F anchor adhesive into the existing walls, top and bottom slab at 1'-6" center-to-center spacing. Minimum embedment depth is 8". Anchor adhesive chosen must be able to achieve a basic bond strength in tension, Nba, of 26.4 kips. Submit signed and sealed calculations or the manufacturer's published literature showing the proposed anchor adhesive's ability to develop this load to the Engineer for approval prior to use. Anchor installation, including hole size, drilling, and clean out, must be in accordance with Item 450, "Railing." Test adhesive anchors in accordance with Item 450.3.3, "Tests." Test 3 anchors per 100 anchors installed.  
Break back wings and apron as necessary to install the extension. Clean and extend the exposed wingwall and apron reinforcing into the extension. When lengthening existing box culverts with dimensions different than current standard dimensions, form horizontal and vertical transitions as directed by the Engineer. Match bottom slabs to maintain an uninterrupted flow line. Field bend existing and new reinforcing into transitions and maintain specified cover requirements. For top slabs of culverts with overlay, with 1-to-2 course surface treatment, or with the top slab as the final riding surface, adjust the "H" dimension to provide a smooth riding surface.
- When the spacing between Bars B becomes less than half of the normal spacing, cut bars to avoid conflict.
- The length of Bars B vary in the skewed end sections.
- $[One\ half\ of\ overall\ width] \times [tangent\ of\ the\ skew\ angle]$
- Place Bars F1 and F2 continuously through the angle section. Bend Bars F1 and F2 to remain parallel to the walls of the box culvert.
- When necessary to avoid conflict in acute corners, shorten the slab extension leg of Bars C and Bars D to a minimum of 1'-6" for skews of 30° thru 45°.
- At the Contractor's option, for skews of 15° or less, place Bars B, C, and D parallel to the skewed end while maintaining spacing along centerline of box. Increase lengths of Bars B shown on the Single Box Culverts Cast-In-Place (SCC) standards sheets to accommodate the skew.


- CONSTRUCTION NOTES:**  
Do not use permanent forms.  
When required, lap Bars H 1'-8" for uncoated or galvanized bars.  
Provide a minimum of 1 1/2" clear cover.
- MATERIAL NOTES:**  
Provide Grade 60 reinforcing steel.  
Provide galvanized reinforcing steel, if required elsewhere in the plans.  
Provide Class C concrete (f'c = 3,600 psi) with these exceptions:  
provide Class S concrete (f'c = 4,000 psi) for top slabs of culverts with overlay, with 1-to-2 course surface treatment, or with the top slab as the final riding surface.
- GENERAL NOTES:**  
Designed according to AASHTO LRFD Bridge Design Specifications.  
Refer to Single Box Culverts Cast-in-Place (SCC) standard sheets for details of straight sections of culvert.  
For skewed sections and angle sections, refer to Single Box Culverts Cast-in-Place (SCC) standard sheets for slab and wall dimensions, bar sizes, maximum bar spacing, and any other details not shown.  
For skewed ends with curbs, adjust length of Bars H, number of Bars K, curb concrete volume, and reinforcing steel weight by dividing the values shown on the culvert Single Box Culverts Cast-In-Place (SCC) standard sheets by the cosine of the skew angle.
- Cover dimensions are clear dimensions, unless noted otherwise.

HL93 LOADING


		<b>Bridge Division Standard</b>	
<b>SINGLE BOX CULVERTS CAST-IN-PLACE MISCELLANEOUS DETAILS</b>			
<b>SCC-MD</b>			
FILE: sccmdste-20.dgn	DN: TxDOT	CK: TxDOT	OW: TxDOT
©TxDOT February 2020	CON: 0917	SECT: 31	JOB: 031
REVISIONS			HIGHWAY: CR
	DIST: BRY	COUNTY: MADISON	SHEET NO: 30

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

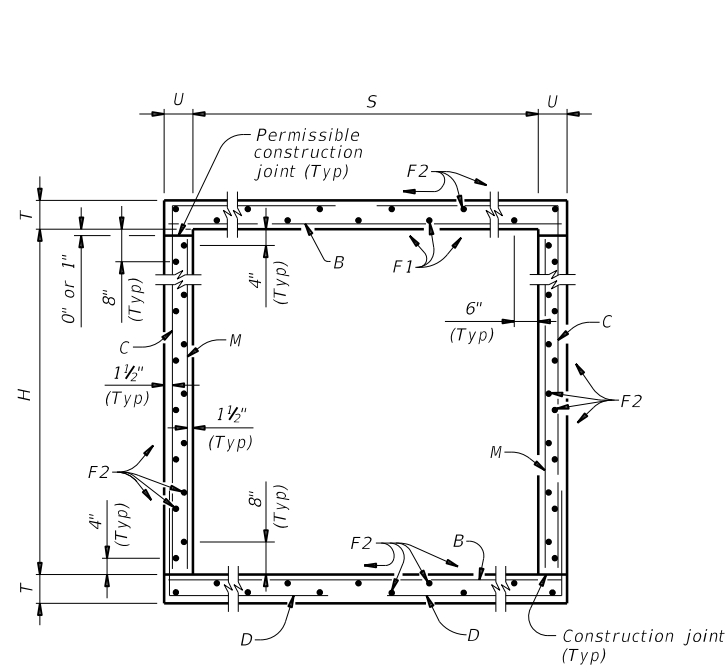


**TYPICAL SECTION**

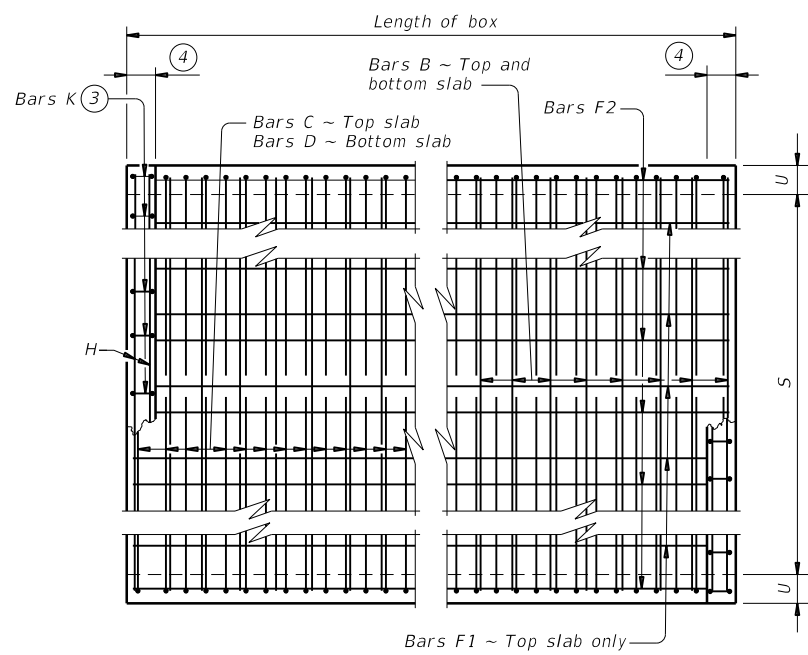

**PLAN OF REINF STEEL**

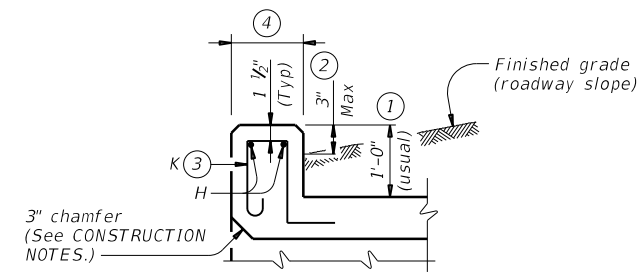

**SECTION THRU CURB**

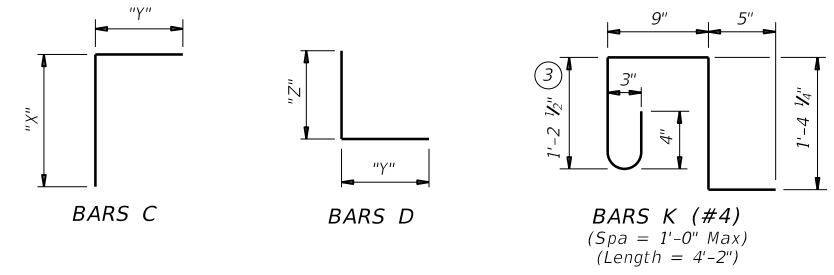

- ① 0" Min to 5'-0" Max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail or curbs taller than 1'-0", refer to the Extended Curb Details (ECD) standard sheet. For structures with T631 or T631LS bridge rail, refer to the Mounting Details for T631 & T631LS Rails (T631-CM) standard sheet. Refer to the Rail Anchorage Curb (RAC) standard sheet for structures with bridge rail other than T631 or T631LS.
- ② For vehicle safety, the following requirements must be met:
  - For structures without bridge rail, construct curbs no more than 3" above finished grade.
  - For structures with bridge rail, construct curbs flush with finished grade. Reduce curb heights, if necessary, to meet the above requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- ③ For curbs less than 1'-0" high, tilt Bars K or reduce bar height as necessary to maintain cover. For curbs less than 3" high, Bars K may be omitted.
- ④ 1'-0" typical. 2'-3" when the Rail Anchorage Curb (RAC) standard sheet is referred to elsewhere in the plans.

The Contractor may replace Bars B, C, D, E, F1, F2, M, Y, and/or Z with deformed welded wire reinforcement (WWR) meeting the requirements of ASTM A1064. The area of required reinforcement may be reduced by the ratio of 60 ksi / 70 ksi. Spacing of WWR is limited to 4" Min and 18" Max. When required, provide lap splices in the WWR of the same length required for the equivalent bar size, rounded up for wire sizes between conventional bar sizes. The lap length required for WWR is never less than the lap length required for uncoated #4 bars.

Example conversion: Replacing No. 6 Gr 60 at 6" Spacing with WWR.  
 Required WWR = (0.44 sq. in. per 0.5 ft.) x (60 ksi / 70 ksi) = 0.755 sq. in. per ft.  
 If D30.6 wire is used to meet the 0.755 sq. in. per ft. requirement in this example, the required spacing = (0.306 sq. in.) / (0.755 sq. in. per ft.) x (12 in. per ft.) = 4.86" Max spacing. Required lap length for the provided D30.6 wire is 2'-1" (the same minimum lap length required for uncoated #5 bars, as listed under MATERIAL NOTES).

**CONSTRUCTION NOTES:**

Do not use permanent forms.  
 Chamfer the bottom edge of the top slab 3" at the entrance.  
 Optionally, raise construction joints shown at the flow line by a maximum of 6". If this option is taken, Bars M may be cut off or raised, Bars C and D may be reversed.

**MATERIAL NOTES:**

- Provide Grade 60 reinforcing steel.
- Provide galvanized reinforcing steel if required elsewhere in the plans.
- Provide Class C concrete (f'c = 3,600 psi) for culvert barrel and curb, with the following exceptions: provide Class S concrete (f'c = 4,000 psi) for top slabs of:
  - culverts with overlay,
  - culverts with 1-to-2 course surface treatment, or
  - culverts with the top slab as the final riding surface.
- Provide bar laps, where required, as follows:
  - Uncoated or galvanized ~ #4 = 1'-8" Min
  - Uncoated or galvanized ~ #5 = 2'-1" Min
  - Uncoated or galvanized ~ #6 = 2'-6" Min
  - Uncoated or galvanized ~ #7 = 3'-3" Min

**GENERAL NOTES:**

Designed according to AASHTO LRFD Bridge Design Specifications for the range of fill heights shown.  
 See the Single Box Culverts Cast-In-Place Miscellaneous Detail (SCC-MD) standard sheet for details pertaining to skewed ends, angle sections, and lengthening.

Cover dimensions are clear dimensions, unless noted otherwise.  
 Reinforcing bar dimensions shown are out-to-out of bar.



**SINGLE BOX CULVERTS  
 CAST-IN-PLACE  
 0' TO 30' FILL**

**SCC-10**

FILE: scc10ste-21.dgn	DN: TBE	CK: BMP	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
04/2021 Updated X values.	DIST	COUNTY	SHEET NO.	
	BRY	MADISON	31	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

SECTION DIMENSIONS				FILL HEIGHT <sup>5</sup>	BILLS OF REINFORCING STEEL (For Box Length = 40 feet)																										QUANTITIES												
					Bars B					Bars C					Bars D					Bars M ~ #4				Bars F1 ~ #4 at 18" Spa			Bars F2 ~ #4 at 18" Spa			Bars H 4 ~ #4		Bars K		Per Foot of Barrel		Curb		Total					
S	H	T	U		No.	Size	Spa	Length	Weight	No.	Size	Spa	Length	Weight	" X "	" Y "	No.	Size	Spa	Length	Weight	" Y "	" Z "	No.	Spa	Length	Wt	No.	Length	Wt	No.	Length	Weight	Length	Wt	No.	Wt	Conc (CY)	Reinf (Lb)	Conc (CY)	Reinf (Lb)	Conc (CY)	Reinf (Lb)
10'-0"	4'-0"	8"	7"	7'	162	#6	6"	10'-11"	2,656	162	#6	6"	10'-4"	2,514	4'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"	4'-0"	289	7	39'-9"	186	37	39'-9"	982	10'-11"	29	24	67	0.724	219.9	0.8	96	29.8	8,893
10'-0"	4'-0"	9"	7"	10'	162	#6	6"	10'-11"	2,656	162	#6	6"	10'-5"	2,535	4'-7"	5'-10"	162	#6	6"	9'-0"	2,190	5'-10"	3'-2"	108	9"	4'-0"	289	7	39'-9"	186	37	39'-9"	982	10'-11"	29	24	67	0.793	221.0	0.8	96	32.5	8,934
10'-0"	4'-0"	10"	8"	13'	162	#6	6"	11'-1"	2,697	162	#6	6"	10'-7"	2,575	4'-8"	5'-11"	162	#6	6"	9'-2"	2,230	5'-11"	3'-3"	82	12"	4'-0"	219	7	39'-9"	186	37	39'-9"	982	11'-1"	30	26	72	0.897	222.2	0.8	102	36.7	8,991
10'-0"	4'-0"	11"	8"	16'	162	#6	6"	11'-1"	2,697	162	#6	6"	10'-8"	2,595	4'-9"	5'-11"	162	#6	6"	9'-3"	2,251	5'-11"	3'-4"	82	12"	4'-0"	219	7	39'-9"	186	37	39'-9"	982	11'-1"	30	26	72	0.967	223.3	0.8	102	39.5	9,032
10'-0"	4'-0"	12"	9"	20'	162	#6	6"	11'-3"	2,737	162	#6	6"	10'-10"	2,636	4'-10"	6'-0"	162	#6	6"	9'-5"	2,291	6'-0"	3'-5"	108	9"	4'-0"	289	7	39'-9"	186	37	39'-9"	982	11'-3"	30	26	72	1.074	228.0	0.8	102	43.8	9,223
10'-0"	4'-0"	13"	10"	23'	162	#6	6"	11'-5"	2,778	162	#6	6"	10'-11"	2,656	4'-11"	6'-0"	162	#6	6"	9'-6"	2,312	6'-0"	3'-6"	108	9"	4'-0"	289	7	39'-9"	186	37	39'-9"	982	11'-5"	31	26	72	1.183	230.1	0.9	103	48.2	9,306
10'-0"	4'-0"	14"	11"	26'	162	#6	6"	11'-7"	2,819	162	#6	6"	11'-1"	2,697	5'-0"	6'-1"	162	#6	6"	9'-8"	2,352	6'-1"	3'-7"	108	9"	4'-0"	289	7	39'-9"	186	37	39'-9"	982	11'-7"	31	26	72	1.294	233.1	0.9	103	52.6	9,428
10'-0"	4'-0"	15"	12"	30'	162	#6	6"	11'-9"	2,859	162	#6	6"	11'-3"	2,737	5'-1"	6'-2"	162	#6	6"	9'-10"	2,393	6'-2"	3'-8"	108	9"	4'-0"	289	7	39'-9"	186	37	39'-9"	982	11'-9"	31	26	72	1.407	236.2	0.9	103	57.2	9,549
10'-0"	5'-0"	8"	7"	7'	162	#6	6"	10'-11"	2,656	162	#6	6"	11'-4"	2,758	5'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"	5'-0"	361	7	39'-9"	186	41	39'-9"	1,089	10'-11"	29	24	67	0.767	230.5	0.8	96	31.5	9,316
10'-0"	5'-0"	9"	7"	10'	162	#6	6"	10'-11"	2,656	162	#6	6"	11'-5"	2,778	5'-7"	5'-10"	162	#6	6"	9'-0"	2,190	5'-10"	3'-2"	108	9"	5'-0"	361	7	39'-9"	186	41	39'-9"	1,089	10'-11"	29	24	67	0.836	231.5	0.8	96	34.3	9,356
10'-0"	5'-0"	10"	8"	13'	162	#6	6"	11'-1"	2,697	162	#6	6"	11'-7"	2,819	5'-8"	5'-11"	162	#6	6"	9'-2"	2,230	5'-11"	3'-3"	82	12"	5'-0"	274	7	39'-9"	186	41	39'-9"	1,089	11'-1"	30	26	72	0.947	232.4	0.8	102	38.7	9,397
10'-0"	5'-0"	11"	8"	16'	162	#6	6"	11'-1"	2,697	162	#6	6"	11'-8"	2,839	5'-9"	5'-11"	162	#6	6"	9'-3"	2,251	5'-11"	3'-4"	82	12"	5'-0"	274	7	39'-9"	186	41	39'-9"	1,089	11'-1"	30	26	72	1.016	233.4	0.8	102	41.5	9,438
10'-0"	5'-0"	12"	9"	20'	162	#6	6"	11'-3"	2,737	162	#6	6"	11'-10"	2,879	5'-10"	6'-0"	162	#6	6"	9'-5"	2,291	6'-0"	3'-5"	108	9"	5'-0"	361	7	39'-9"	186	41	39'-9"	1,089	11'-3"	30	26	72	1.130	238.6	0.8	102	46.0	9,645
10'-0"	5'-0"	13"	10"	23'	162	#6	6"	11'-5"	2,778	162	#6	6"	11'-11"	2,900	5'-11"	6'-0"	162	#6	6"	9'-6"	2,312	6'-0"	3'-6"	108	9"	5'-0"	361	7	39'-9"	186	41	39'-9"	1,089	11'-5"	31	26	72	1.245	240.7	0.9	103	50.7	9,729
10'-0"	5'-0"	14"	11"	26'	162	#6	6"	11'-7"	2,819	162	#6	6"	12'-1"	2,940	6'-0"	6'-1"	162	#6	6"	9'-8"	2,352	6'-1"	3'-7"	108	9"	5'-0"	361	7	39'-9"	186	41	39'-9"	1,089	11'-7"	31	26	72	1.362	243.7	0.9	103	55.4	9,850
10'-0"	5'-0"	15"	12"	30'	162	#7	6"	11'-9"	3,891	162	#6	6"	12'-3"	2,981	6'-1"	6'-2"	162	#6	6"	9'-10"	2,393	6'-2"	3'-8"	108	9"	5'-0"	361	7	39'-9"	186	41	39'-9"	1,089	11'-9"	31	26	72	1.481	272.5	0.9	103	60.1	11,004
10'-0"	6'-0"	8"	7"	7'	162	#6	6"	10'-11"	2,656	162	#6	6"	12'-4"	3,001	6'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"	6'-0"	433	7	39'-9"	186	45	39'-9"	1,195	10'-11"	29	24	67	0.811	241.0	0.8	96	33.3	9,737
10'-0"	6'-0"	8"	7"	10'	162	#6	6"	10'-11"	2,656	162	#6	6"	12'-4"	3,001	6'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"	6'-0"	433	7	39'-9"	186	45	39'-9"	1,195	10'-11"	29	24	67	0.811	241.0	0.8	96	33.3	9,737
10'-0"	6'-0"	9"	8"	13'	162	#6	6"	11'-1"	2,697	162	#6	6"	12'-6"	3,042	6'-7"	5'-11"	162	#6	6"	9'-1"	2,210	5'-11"	3'-2"	82	12"	6'-0"	329	7	39'-9"	186	45	39'-9"	1,195	11'-1"	30	26	72	0.926	241.5	0.8	102	37.9	9,761
10'-0"	6'-0"	10"	8"	16'	162	#6	6"	11'-1"	2,697	162	#6	6"	12'-7"	3,062	6'-8"	5'-11"	162	#6	6"	9'-2"	2,230	5'-11"	3'-3"	82	12"	6'-0"	329	7	39'-9"	186	45	39'-9"	1,195	11'-1"	30	26	72	0.996	242.5	0.8	102	40.7	9,801
10'-0"	6'-0"	12"	9"	20'	162	#6	6"	11'-3"	2,737	162	#6	6"	12'-10"	3,123	6'-10"	6'-10"	162	#6	6"	9'-5"	2,291	6'-0"	3'-5"	108	9"	6'-0"	433	7	39'-9"	186	45	39'-9"	1,195	11'-3"	30	26	72	1.185	249.1	0.8	102	48.2	10,067
10'-0"	6'-0"	13"	10"	23'	162	#6	6"	11'-5"	2,778	162	#6	6"	12'-11"	3,143	6'-11"	6'-0"	162	#6	6"	9'-6"	2,312	6'-0"	3'-6"	108	9"	6'-0"	433	7	39'-9"	186	45	39'-9"	1,195	11'-5"	31	26	72	1.307	251.2	0.9	103	53.1	10,150
10'-0"	6'-0"	14"	11"	26'	162	#6	6"	11'-7"	2,819	162	#6	6"	13'-1"	3,183	7'-0"	6'-1"	162	#6	6"	9'-8"	2,352	6'-1"	3'-7"	108	9"	6'-0"	433	7	39'-9"	186	45	39'-9"	1,195	11'-7"	31	26	72	1.430	254.2	0.9	103	58.1	10,271
10'-0"	6'-0"	15"	12"	30'	162	#7	6"	11'-9"	3,891	162	#6	6"	13'-3"	3,224	7'-1"	6'-2"	162	#6	6"	9'-10"	2,393	6'-2"	3'-8"	108	9"	6'-0"	433	7	39'-9"	186	45	39'-9"	1,195	11'-9"	31	26	72	1.556	283.1	0.9	103	63.1	11,425
10'-0"	7'-0"	8"	7"	7'	162	#6	6"	10'-11"	2,656	162	#6	6"	13'-4"	3,244	7'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"	7'-0"	505	7	39'-9"	186	45	39'-9"	1,195	10'-11"	29	24	67	0.854	248.9	0.8	96	35.0	10,052
10'-0"	7'-0"	8"	7"	10'	162	#6	6"	10'-11"	2,656	162	#6	6"	13'-4"	3,244	7'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"	7'-0"	505	7	39'-9"	186	45	39'-9"	1,195	10'-11"	29	24	67	0.854	248.9	0.8	96	35.0	10,052
10'-0"	7'-0"	9"	8"	13'	162	#6	6"	11'-1"	2,697	162	#6	6"	13'-6"	3,285	7'-7"	5'-11"	162	#6	6"	9'-1"	2,210	5'-11"	3'-2"	82	12"	7'-0"	383	7	39'-9"	186	45	39'-9"	1,195	11'-1"	30	26	72	0.975	248.9	0.8	102	39.8	10,058
10'-0"	7'-0"	10"	8"	16'	162	#6	6"	11'-1"	2,697	162	#6	6"	13'-7"	3,305	7'-8"	5'-11"	162	#6	6"	9'-2"	2,230	5'-11"	3'-3"	82	12"	7'-0"	383	7	39'-9"	186	45	39'-9"	1,195	11'-1"	30	26	72	1.045	249.9	0.8	102	42.6	10,098
10'-0"	7'-0"	12"	9"	20'	162	#6	6"	11'-3"	2,737	162	#6	6"	13'-10"	3,366	7'-10"	6'-0"	162	#6	6"	9'-5"	2,291	6'-0"	3'-5"	108	9"	7'-0"	505	7	39'-9"	186	45	39'-9"	1,195	11'-3"	30	26	72	1.241	257.0	0.8	102	50.5	10,382
10'-0"	7'-0"	13"	10"	23'	162	#6	6"	11'-5"	2,778	162	#6	6"	13'-11"	3,386	7'-11"	6'-0"	162	#6	6"	9'-6"	2,312	6'-0"	3'-6"	108	9"	7'-0"	505	7	39'-9"	186	45	39'-9"	1,195	11'-5"	31	26	72	1.368	259.1	0.9	103	55.6	10,465
10'-0"	7'-0"	14"	11"	26'	162	#6	6"	11'-7"	2,819	162	#6	6"	14'-1"	3,427	8'-0"	6'-1"	162	#6	6"	9'-8"	2,352	6'-1"	3'-7"	108	9"	7'-0"	505	7	39'-9"	186	45	39'-9"	1,195	11'-7"	31	26	72	1.498	262.1	0.9	103	60.8	10,587
10'-0"	7'-0"	15"	12"	30'	162	#7	6"	11'-9"	3,891	162	#6	6"	14'-3"	3,467	8'-1"	6'-2"	162	#6	6"	9'-10"	2,393	6'-2"	3'-8"	108	9"	7'-0"	505	7	39'-9"	186	45	39'-9"	1,195	11'-9"	31	26	72	1.630	290.9	0.9	103	66.1	11,740
10'-0"	8'-0"	8"	7"	7'	162	#6	6"	10'-11"	2,656	162	#6	6"	14'-4"	3,488	8'-6"	5'-10"	162	#6	6"	8'-11"	2,170	5'-10"	3'-1"	108	9"</																		

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results from its use.

DATE:  
 FILE:

SECTION DIMENSIONS				FILL HEIGHT ⑤	BILLS OF REINFORCING STEEL (For Box Length = 40 feet)																										QUANTITIES												
					Bars B					Bars C					Bars D					Bars M ~ #4				Bars F1 ~ #4 at 18" Spa			Bars F2 ~ #4 at 18" Spa			Bars H 4 ~ #4		Bars K		Per Foot of Barrel		Curb		Total					
S	H	T	U		No.	Size	Spa	Length	Wt	No.	Size	Spa	Length	Wt	" X "	" Y "	No.	Size	Spa	Length	Wt	" Y "	" Z "	No.	Spa	Length	Wt	No.	Length	Wt	No.	Length	Wt	Length	Wt	No.	Wt	Conc (CY)	Reinf (Lb)	Conc (CY)	Reinf (Lb)	Conc (CY)	Reinf (Lb)
10' - 0"	9' - 0"	8"	7"	7'	162	#6	6"	10' - 11"	2,656	162	#6	6"	15' - 4"	3,731	9' - 6"	5' - 10"	162	#6	6"	8' - 11"	2,170	5' - 10"	3' - 1"	108	9"	9' - 0"	649	7	39' - 9"	186	53	39' - 9"	1,407	10' - 11"	29	24	67	0.940	270.0	0.8	96	38.4	10,895
10' - 0"	9' - 0"	8"	7"	10'	162	#6	6"	10' - 11"	2,656	162	#6	6"	15' - 4"	3,731	9' - 6"	5' - 10"	162	#6	6"	8' - 11"	2,170	5' - 10"	3' - 1"	108	9"	9' - 0"	649	7	39' - 9"	186	53	39' - 9"	1,407	10' - 11"	29	24	67	0.940	270.0	0.8	96	38.4	10,895
10' - 0"	9' - 0"	9"	8"	13'	162	#6	6"	11' - 1"	2,697	162	#6	6"	15' - 6"	3,772	9' - 7"	5' - 11"	162	#6	6"	9' - 1"	2,210	5' - 11"	3' - 2"	108	9"	9' - 0"	649	7	39' - 9"	186	53	39' - 9"	1,407	11' - 1"	30	26	72	1.074	273.0	0.8	102	43.8	11,023
10' - 0"	9' - 0"	10"	8"	16'	162	#6	6"	11' - 1"	2,697	162	#6	6"	15' - 7"	3,792	9' - 8"	5' - 11"	162	#6	6"	9' - 2"	2,230	5' - 11"	3' - 3"	162	6"	9' - 0"	974	7	39' - 9"	186	53	39' - 9"	1,407	11' - 1"	30	26	72	1.144	282.2	0.8	102	46.6	11,388
10' - 0"	9' - 0"	12"	9"	20'	162	#6	6"	11' - 3"	2,737	162	#6	6"	15' - 10"	3,853	9' - 10"	6' - 0"	162	#6	6"	9' - 5"	2,291	6' - 0"	3' - 5"	162	6"	9' - 0"	974	7	39' - 9"	186	53	39' - 9"	1,407	11' - 3"	30	26	72	1.352	286.2	0.8	102	54.9	11,550
10' - 0"	9' - 0"	13"	10"	23'	162	#6	6"	11' - 5"	2,778	162	#6	6"	15' - 11"	3,873	9' - 11"	6' - 0"	162	#6	6"	9' - 6"	2,312	6' - 0"	3' - 6"	162	6"	9' - 0"	974	7	39' - 9"	186	53	39' - 9"	1,407	11' - 5"	31	26	72	1.492	288.3	0.9	103	60.5	11,633
10' - 0"	9' - 0"	14"	11"	26'	162	#6	6"	11' - 7"	2,819	162	#6	6"	16' - 1"	3,913	10' - 0"	6' - 1"	162	#6	6"	9' - 8"	2,352	6' - 1"	3' - 7"	162	6"	9' - 0"	974	7	39' - 9"	186	53	39' - 9"	1,407	11' - 7"	31	26	72	1.634	291.3	0.9	103	66.2	11,754
10' - 0"	9' - 0"	15"	12"	30'	162	#7	6"	11' - 9"	3,891	162	#6	6"	16' - 3"	3,954	10' - 1"	6' - 2"	162	#6	6"	9' - 10"	2,393	6' - 2"	3' - 8"	162	6"	9' - 0"	974	7	39' - 9"	186	53	39' - 9"	1,407	11' - 9"	31	26	72	1.778	320.1	0.9	103	72.0	12,908
10' - 0"	10' - 0"	8"	7"	7'	162	#6	6"	10' - 11"	2,656	162	#6	6"	16' - 4"	3,974	10' - 6"	5' - 10"	162	#6	6"	8' - 11"	2,170	5' - 10"	3' - 1"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	10' - 11"	29	24	67	0.984	286.9	0.8	96	40.2	11,571
10' - 0"	10' - 0"	8"	7"	10'	162	#6	6"	10' - 11"	2,656	162	#6	6"	16' - 4"	3,974	10' - 6"	5' - 10"	162	#6	6"	8' - 11"	2,170	5' - 10"	3' - 1"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	10' - 11"	29	24	67	0.984	286.9	0.8	96	40.2	11,571
10' - 0"	10' - 0"	9"	8"	13'	162	#6	6"	11' - 1"	2,697	162	#6	6"	16' - 6"	4,015	10' - 7"	5' - 11"	162	#6	6"	9' - 1"	2,210	5' - 11"	3' - 2"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	11' - 1"	30	26	72	1.123	289.9	0.8	102	45.8	11,699
10' - 0"	10' - 0"	10"	8"	16'	162	#6	6"	11' - 1"	2,697	162	#6	6"	16' - 7"	4,035	10' - 8"	5' - 11"	162	#6	6"	9' - 2"	2,230	5' - 11"	3' - 3"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	11' - 1"	30	26	72	1.193	290.9	0.8	102	48.6	11,739
10' - 0"	10' - 0"	12"	9"	20'	162	#6	6"	11' - 3"	2,737	162	#6	6"	16' - 10"	4,096	10' - 10"	6' - 0"	162	#6	6"	9' - 5"	2,291	6' - 0"	3' - 5"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	11' - 3"	30	26	72	1.407	295.0	0.8	102	57.1	11,901
10' - 0"	10' - 0"	13"	10"	23'	162	#6	6"	11' - 5"	2,778	162	#6	6"	16' - 11"	4,116	10' - 11"	6' - 0"	162	#6	6"	9' - 6"	2,312	6' - 0"	3' - 6"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	11' - 5"	31	26	72	1.553	297.0	0.9	103	63.0	11,984
10' - 0"	10' - 0"	14"	11"	26'	162	#6	6"	11' - 7"	2,819	162	#6	6"	17' - 1"	4,157	11' - 0"	6' - 1"	162	#6	6"	9' - 8"	2,352	6' - 1"	3' - 7"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	11' - 7"	31	26	72	1.702	300.1	0.9	103	69.0	12,106
10' - 0"	10' - 0"	15"	12"	30'	162	#7	6"	11' - 9"	3,891	162	#6	6"	17' - 3"	4,197	11' - 1"	6' - 2"	162	#6	6"	9' - 10"	2,393	6' - 2"	3' - 8"	162	6"	10' - 0"	1,082	7	39' - 9"	186	53	39' - 9"	1,407	11' - 9"	31	26	72	1.852	328.9	0.9	103	75.0	13,259

⑤ For direct traffic culverts (fill height ≤ 2 ft.), identify the required box size and select the option with the minimum fill height.




**SINGLE BOX CULVERTS  
CAST-IN-PLACE  
0' TO 30' FILL**

**SCC-10**


FILE: scc10ste-21.dgn	DN: TBE	CK: BMP	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
04/2021 Updated X values.	DIST	COUNTY	SHEET NO.	
	BRY	MADISON	33	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

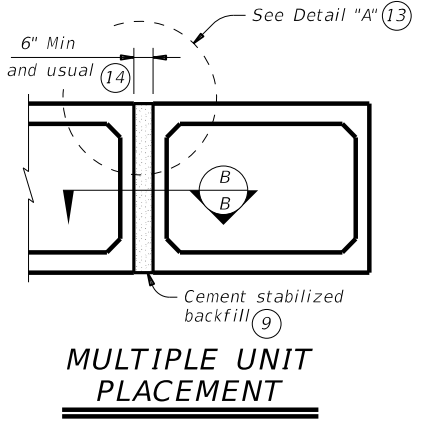


**MULTIPLE UNIT PLACEMENT**

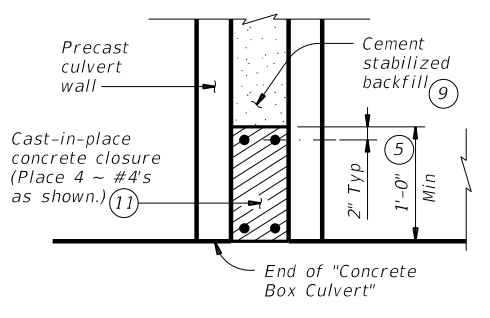

**SECTION B-B**

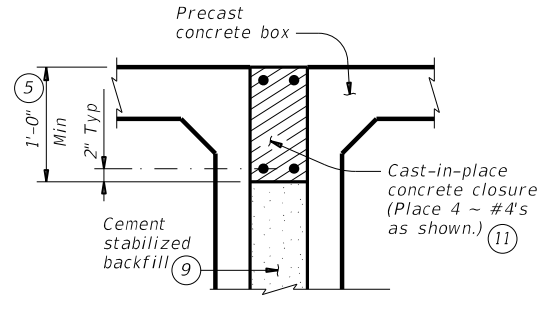


**DETAIL "A" (13)**

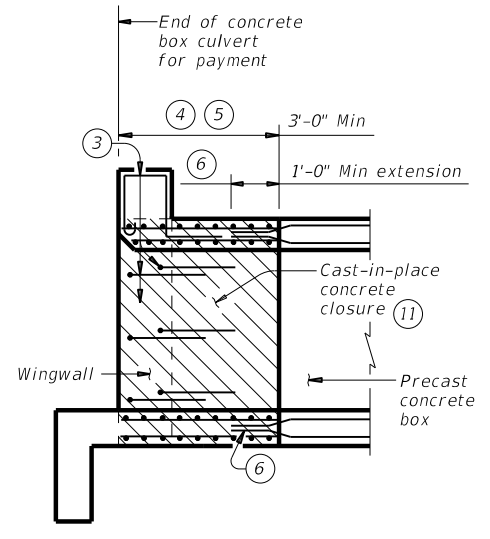


**WINGWALL CONNECTION**

(Also applies to safety end treatment.)

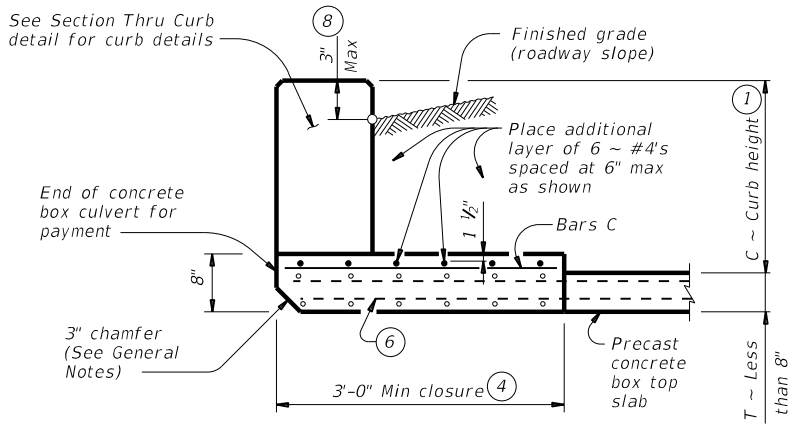


**SECTION THRU TOP SLABS LESS THAN 8"**

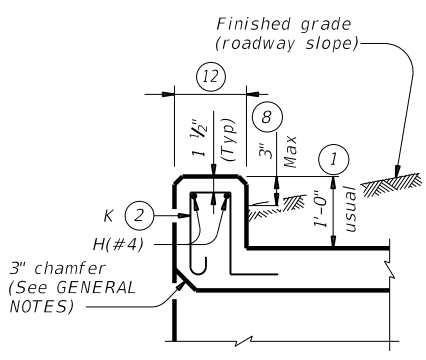


**SECTION THRU CURB**

QUANTITIES PER FOOT OF CURB (10)	
Reinforcing Steel	4.12 Lb
Concrete	0.037 CY



**BARS C (#4)**  
(Spa = 1'-0" Max)

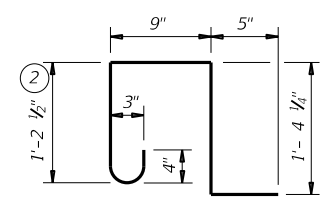

**BARS K (#4)**  
(Spa = 1'-0" Max)  
(Length = 4'-2")

- 0" Min to 5'-0" Max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail, bicycle rail, or curbs taller than 1'-0, refer to the Extended Curb Details (ECD) standard sheet. For structures with T631 or T631LS bridge rail, refer to the Mounting Details for T631 & T631LS Rails (T631-CM) standard sheet. Refer to the Box Culvert Rail Mounting Details (RAC) standard sheet for structures with bridge rail other than T631 or T631LS.
- For curbs less than 1'-0" high, tilt Bars K or reduce bar height as necessary to maintain cover. For curbs less than 3" high, Bars K may be omitted.
- Extend curb, wingwall, or safety end treatment reinforcing into concrete closure. Bend or trim, as necessary, any reinforcing that does not fit into closure area.
- Provide a 3'-0" Min cast-in-place concrete closure. Break back boxes in the field or cast boxes short. Provide bands of reinforcing in the closure that are the same size and spacing as in the precast box section. Provide #4 longitudinal reinforcement spaced at 12 inches Max within the closure. Except where shown otherwise, construct the cast-in-place closure flush with the inside and outside faces of the precast box section.
- For multiple unit placements, adjust the length of the closure for the interior walls as necessary. Provide a 3'-0" Min cast-in-place closure in the top slab, bottom slab, and exterior wall. See Section B-B detail when interior walls are cast full length.
- Extend precast box reinforcing a minimum of 1'-0" into concrete closure (Typ).
- Place bands of reinforcing matching the inside and outside face reinforcing in the gaps of the top and bottom slabs. Place a band matching the outside face reinforcing of the wall in the gaps of the walls (placed in the outside face only). Tack weld the bands to the exposed reinforcing at each point of contact.
- For vehicle safety, the following requirements must be met:
  - For structures without bridge rail, construct curbs no more than 3" above finished grade.
  - For structures with bridge rail, construct curbs flush with finished grade. Reduce curb heights, if necessary, to meet the above requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- Cement stabilized backfill between boxes is considered part of the box culvert for payment.
- All curb concrete and reinforcing is considered part of the box culvert for payment.
- Any additional concrete and reinforcing required for the closures will be considered subsidiary to the box culvert for payment.
- 1'-0" typical. 2'-3" when the Box Culvert Rail Mounting Details (RAC) standard sheet is referred to elsewhere in the plans.
- For multiple unit placement with overlay, with 1 to 2 course surface treatment, or with the top slab as the final riding surface, provide wall closure as shown in Detail "A".
- This dimension may be increased with approval of the Engineer to allow the precast boxes to be tunneled or jacked in accordance with Item 476, "Jacking, Boring, or Tunneling Pipe or Box". No payment will be made for any additional material in the gap between adjacent boxes.


**MATERIAL NOTES:**

- Provide Grade 60 reinforcing steel.
- Provide ASTM A1064 welded wire reinforcement.
- Provide Class C concrete (f'c = 3,600 psi) for the closures.
- Provide cement stabilized backfill meeting the requirements of Item 400, "Excavation and Backfill for Structures."
- Any additional concrete required for the closures will be considered subsidiary to the box culvert.


**GENERAL NOTES:**

- Designed according to AASHTO LRFD Bridge Design Specifications.
- Refer to the Single Box Culverts Precast (SCP) standard sheets for details and notes not shown.
- Chamfer the bottom edge of the top slab closure 3 inches at culvert closure ends.


Cover dimensions are clear dimensions, unless noted otherwise. Reinforcing bars dimensions are out-to-out of bars.

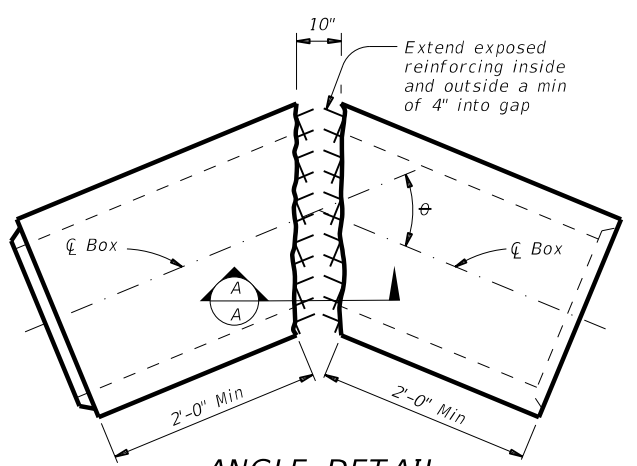

**ANGLE DETAIL**

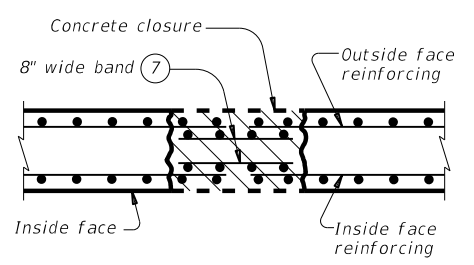

**SECTION A-A**

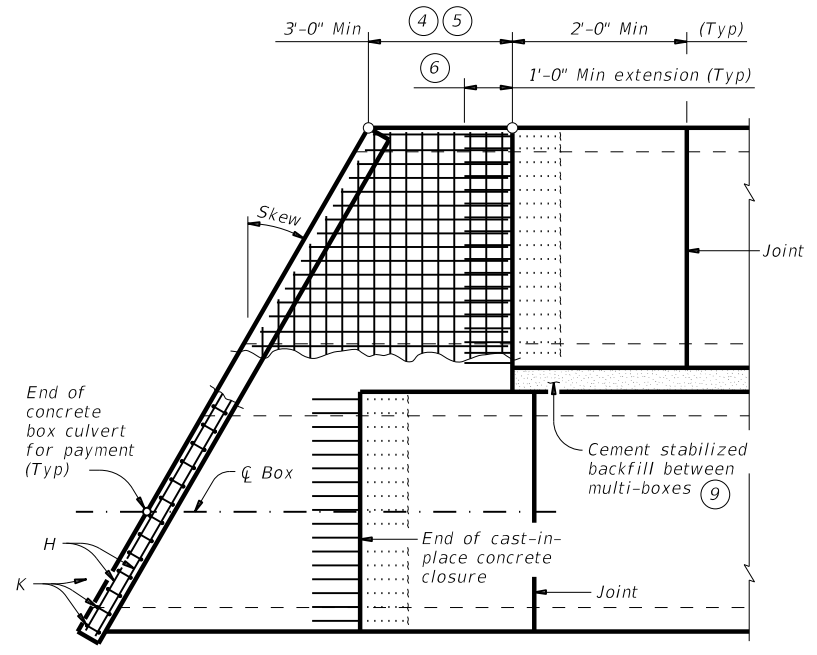

**PLAN OF SKEWED ENDS**

(Showing multi-box placement.)

HL93 LOADING

		<b>Bridge Division Standard</b>	
<b>BOX CULVERTS PRECAST MISCELLANEOUS DETAILS</b>			
<b>SCP-MD</b>			
FILE: scpmdsts-20.dgn	DN: GAF	CK: LMW	DW: BWH/TxDOT
©TxDOT February 2020	CONT: 0917	SECT: 31	JOB: 031
REVISIONS			HIGHWAY: CR
	DIST: BRY	COUNTY: MADISON	SHEET NO: 34



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

**BOX DATA**

SECTION DIMENSIONS					Fill Height (ft.)	M (Min) (in.)	REINFORCING (sq. in. / ft.) <sup>②</sup>						① Lift Weight (tons)
S (ft.)	H (ft.)	TT (in.)	TB (in.)	TS (in.)			AS1	AS2	AS3	AS4	AS5	AS7	
10	4	10	10	10	< 2	-	0.33	0.34	0.27	0.24	0.24	0.24	16.5
10	4	10	10	10	2 < 3	58	0.38	0.35	0.30	0.24	-	-	16.5
10	4	10	10	10	3 - 5	53	0.31	0.28	0.27	0.24	-	-	16.5
10	4	10	10	10	10	52	0.36	0.32	0.33	0.24	-	-	16.5
10	4	10	10	10	15	52	0.47	0.42	0.43	0.24	-	-	16.5
10	4	10	10	10	20	52	0.61	0.54	0.55	0.24	-	-	16.5
10	4	10	10	10	25	52	0.75	0.67	0.68	0.24	-	-	16.5
10	5	10	10	10	< 2	-	0.30	0.36	0.30	0.24	0.24	0.24	17.5
10	5	10	10	10	2 < 3	58	0.35	0.39	0.34	0.24	-	-	17.5
10	5	10	10	10	3 - 5	52	0.28	0.31	0.30	0.24	-	-	17.5
10	5	10	10	10	10	52	0.33	0.35	0.36	0.24	-	-	17.5
10	5	10	10	10	15	47	0.42	0.46	0.47	0.24	-	-	17.5
10	5	10	10	10	20	47	0.55	0.59	0.61	0.24	-	-	17.5
10	5	10	10	10	25	47	0.68	0.73	0.75	0.24	-	-	17.5
10	6	10	10	10	< 2	-	0.28	0.38	0.33	0.24	0.24	0.24	18.5
10	6	10	10	10	2 < 3	58	0.32	0.42	0.37	0.24	-	-	18.5
10	6	10	10	10	3 - 5	53	0.26	0.34	0.33	0.24	-	-	18.5
10	6	10	10	10	10	52	0.30	0.38	0.39	0.24	-	-	18.5
10	6	10	10	10	15	47	0.39	0.49	0.51	0.24	-	-	18.5
10	6	10	10	10	20	47	0.50	0.63	0.65	0.24	-	-	18.5
10	6	10	10	10	25	47	0.61	0.78	0.80	0.24	-	-	18.5
10	7	10	10	10	< 2	-	0.25	0.40	0.36	0.24	0.24	0.24	19.5
10	7	10	10	10	2 < 3	58	0.30	0.45	0.40	0.24	-	-	19.5
10	7	10	10	10	3 - 5	58	0.24	0.36	0.35	0.24	-	-	19.5
10	7	10	10	10	10	52	0.28	0.40	0.42	0.24	-	-	19.5
10	7	10	10	10	15	47	0.36	0.52	0.54	0.24	-	-	19.5
10	7	10	10	10	20	47	0.46	0.67	0.69	0.24	-	-	19.5
10	7	10	10	10	25	47	0.56	0.82	0.85	0.24	-	-	19.5
10	8	10	10	10	< 2	-	0.24	0.41	0.38	0.24	0.24	0.24	20.5
10	8	10	10	10	2 < 3	64	0.27	0.47	0.43	0.24	-	-	20.5
10	8	10	10	10	3 - 5	58	0.24	0.38	0.38	0.24	-	-	20.5
10	8	10	10	10	10	52	0.26	0.42	0.44	0.24	-	-	20.5
10	8	10	10	10	15	47	0.34	0.54	0.57	0.24	-	-	20.5
10	8	10	10	10	20	47	0.43	0.69	0.72	0.24	-	-	20.5
10	9	10	10	10	< 2	-	0.24	0.42	0.41	0.24	0.24	0.24	21.5
10	9	10	10	10	2 < 3	70	0.26	0.50	0.46	0.24	-	-	21.5
10	9	10	10	10	3 - 5	64	0.24	0.40	0.40	0.24	-	-	21.5
10	9	10	10	10	10	58	0.25	0.43	0.46	0.24	-	-	21.5
10	9	10	10	10	15	52	0.32	0.56	0.59	0.24	-	-	21.5
10	9	10	10	10	20	47	0.40	0.71	0.75	0.24	-	-	21.5
10	10	10	10	10	< 2	-	0.24	0.44	0.44	0.24	0.24	0.24	22.5
10	10	10	10	10	2 < 3	79	0.25	0.52	0.48	0.24	-	-	22.5
10	10	10	10	10	3 - 5	70	0.24	0.42	0.43	0.24	-	-	22.5
10	10	10	10	10	10	64	0.24	0.44	0.48	0.24	-	-	22.5
10	10	10	10	10	15	52	0.30	0.57	0.61	0.24	-	-	22.5
10	10	10	10	10	20	52	0.38	0.73	0.77	0.24	-	-	22.5


① For box length = 8'-0"

② AS1 thru AS4, AS7 and AS8 are minimum required areas of reinforcement per linear foot of box length. AS5 is minimum required area of reinforcement per linear foot of box width.

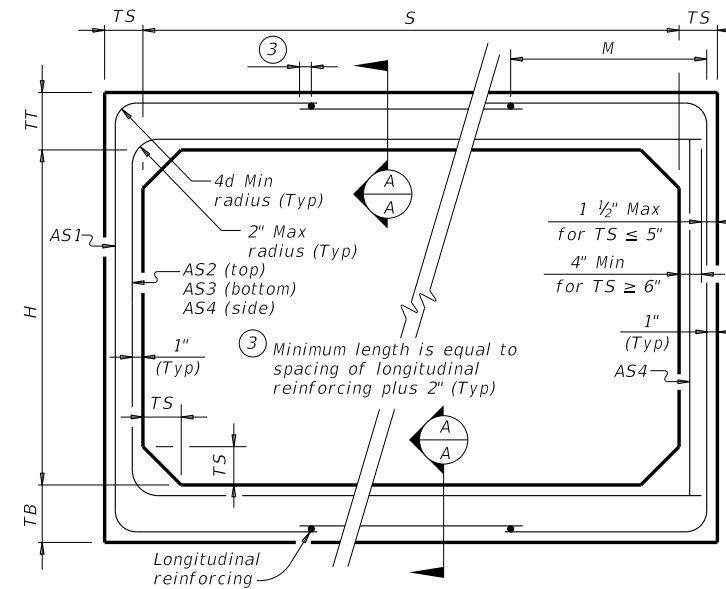

CORNER OPTION "A" CORNER OPTION "B"


**FILL HEIGHT 2 FT AND GREATER**

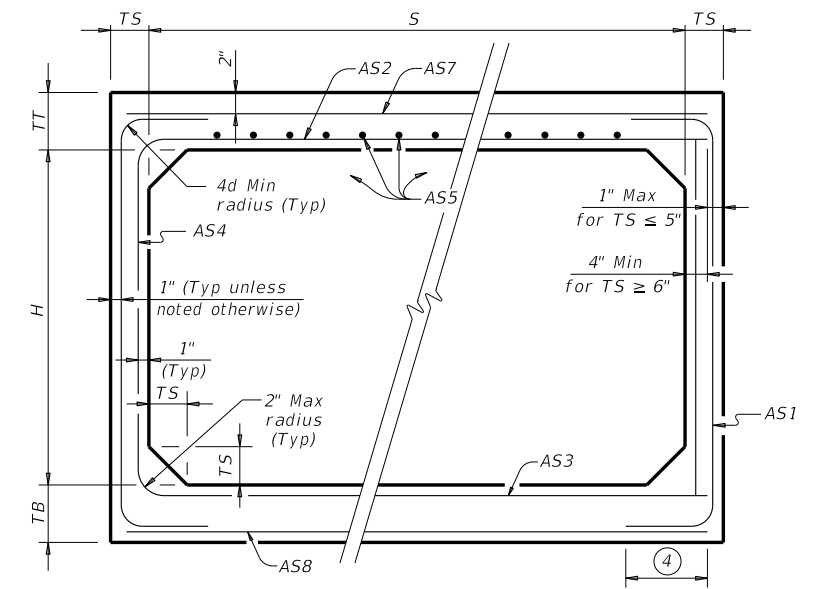

CORNER OPTION "A" CORNER OPTION "B"

**FILL HEIGHT LESS THAN 2 FT**

④ Length is equal to spacing of longitudinal reinforcing plus 2". (10" Min) (Typ)

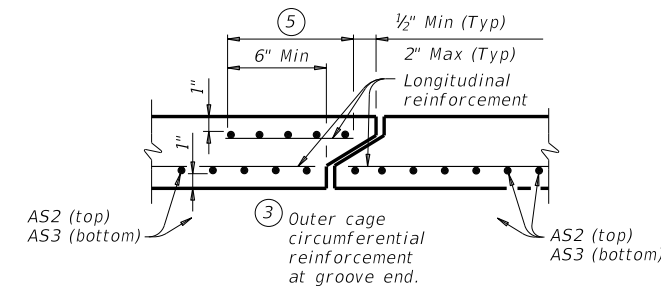

**SECTION A-A**

(Showing top and bottom slab joint reinforcement.)

**MATERIAL NOTES:**

Provide 0.03 sq. in./ft. minimum longitudinal reinforcing at each face in slabs and walls. This minimum requirement may be met by the transverse wires when wire mesh reinforcement is used.  
Provide Class H concrete ( $f'c = 5,000$  psi).

**GENERAL NOTES:**


Designs shown conform to ASTM C1577. Refer to ASTM C1577 for information or details not shown.  
See Box Culverts Precast Miscellaneous Details (SCP-MD) standard sheet for details and notes not shown.  
In lieu of furnishing the designs shown on this sheet, the contractor may furnish an alternate design that is equal to or exceeds the box design for the design fill height in the table. Submit shop plans for alternate designs in accordance with Item "Precast Concrete Structural Members (Fabrication)".

HL93 LOADING

				<b>Bridge Division Standard</b>	
<b>SINGLE BOX CULVERTS PRECAST 10'-0" SPAN</b>					
<b>SCP-10</b>					
FILE:	scp10sts-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
©TxDOT	February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS		0917	31	031	CR
DIST	COUNTY	SHEET NO.			
BRY	MADISON	35			





DISCLAIMER:  
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:  
FILE:

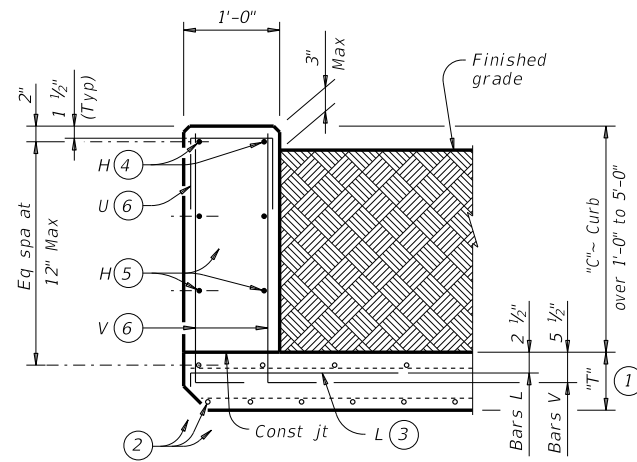

**TYPICAL SECTION**

Used for curbs over 1'-0" to 5'-0"

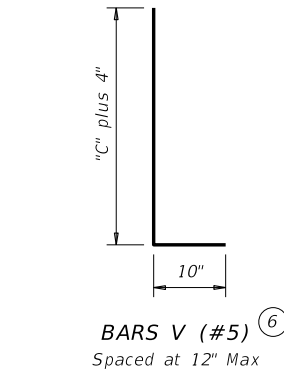

- ① "T" is equal to the culvert top slab thickness. For precast boxes with slabs less than 8" thick, see SCP-MD standard for additional details.
- ② Adjust normal culvert slab bars as necessary to clear obstructions.
- ③ Place bars L as shown. Tilt hook as necessary to maintain cover.
- ④ Place normal culvert curb bars H(#4) as shown. Adjust as necessary to clear obstructions.
- ⑤ Additional bars H(#4) as required to maintain 12" Max spacing.
- ⑥ Replace normal culvert curb bars K with one bar U and two bars V as shown spaced at 12" Max. Adjust length of bars V as necessary to maintain clear cover.
- ⑦ Optional bars L are to be used only for precast box culverts with 3'-0" closure pour.
- ⑧ Quantities shown are for Contractor's information only. Quantities are per linear foot of curb length. The value in table can be interpolated for intermediate values of curb height, "C". Quantity includes bars K (when applicable).

TABLE OF ESTIMATED CURB QUANTITIES ⑧		
Curb Height "C"	Conc (CY/LF)	Reinf Steel (Lb/LF)
1'-0"	0.037	10.4
1'-6"	0.056	14.5
2'-0"	0.074	15.6
2'-6"	0.093	18.0
3'-0"	0.111	19.0
3'-6"	0.130	21.3
4'-0"	0.148	22.4
4'-6"	0.167	24.8
5'-0"	0.185	25.9

**CONSTRUCTION NOTES:**  
Adjust reinforcing steel as necessary to provide 1 1/4" cover.  
For vehicle safety, top of the curb must not project more than 3" above the finished grade.

**MATERIAL NOTES:**  
Provide Grade 60 reinforcing steel.  
Provide galvanized reinforcing steel if required elsewhere in the plans.  
Provide Class "C" concrete (f'c = 3,600 psi) minimum for curbs.  
Provide bar laps, where required, as follows:  
• Uncoated or galvanized ~ #4 = 1'-8" Min

**GENERAL NOTES:**  
Designed according to AASHTO LRFD Bridge Design Specifications.  
These extended curb details have sufficient strength to allow for future retrofit of Type T631 or T631LS railing. These details are suitable for use with PR11, PR22 and PR3 type rails. These details are not suitable for the mounting of other rail types. For new construction using T631 or T631LS railing, use the T631-CM standard.  
This Curb is considered as part of the Box Culvert for payment.

Cover dimensions are clear dimensions, unless noted otherwise.  
Reinforcing bar dimensions shown are out-to-out of bar.



**EXTENDED CURB DETAILS**  
FOR BOX CULVERTS WITH CURBS OVER 1'-0" TO 5'-0" TALL

<b>ECD</b>				
FILE: ecdstde1-20.dgn	DN: GAF	CK: TxDOT	DW: TxDOT	CK: GAF
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917	31	031	CR
DIST	COUNTY		SHEET NO.	
BRY	MADISON		36	



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: FILE:

**TABLE OF DIMENSIONS AND REINFORCING STEEL**  
(Wings for one structure end)




Maximum Wingwall Height Hw	Dimensions				Variable Reinforcing				Estimated Quantities per ft of wing (2-wings) (4)		Estimated Quantities per ft of Toewall (1-toewall)	
	W	X	Y	Z	Bars J1		Bars J2		Reinf (Lb/Ft)	Conc (CY/Ft)	Reinf (Lb/Ft)	Conc (CY/Ft)
					Size	Spa	Size	Spa				
2'-6"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	48.64	0.406	6.85	0.071
2'-9"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	49.31	0.424	6.85	0.071
3'-0"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	49.98	0.444	6.85	0.071
3'-3"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	53.32	0.462	6.85	0.071
3'-6"	2'-10"	10"	1'-0"	7"	#4	1'-0"	#4	1'-0"	53.98	0.480	6.85	0.071
4'-0"	3'-2"	1'-2"	1'-0"	7"	#4	1'-0"	#4	1'-0"	55.77	0.532	6.85	0.071
4'-6"	3'-2"	1'-2"	1'-0"	7"	#4	1'-0"	#4	1'-0"	59.77	0.568	6.85	0.071
5'-0"	3'-9"	1'-7"	1'-2"	7"	#4	1'-0"	#4	1'-0"	63.45	0.632	6.96	0.075
5'-6"	3'-9"	1'-7"	1'-2"	7"	#4	1'-0"	#4	1'-0"	67.46	0.668	6.96	0.075
6'-0"	4'-4"	2'-0"	1'-4"	7"	#5	1'-0"	#5	1'-0"	80.67	0.730	7.07	0.078
6'-6"	4'-4"	2'-0"	1'-4"	7"	#5	1'-0"	#5	1'-0"	85.05	0.768	7.07	0.078
7'-0"	5'-0"	2'-3"	1'-9"	8"	#5	1'-0"	#5	1'-0"	92.15	0.864	8.07	0.093
7'-6"	5'-0"	2'-3"	1'-9"	8"	#5	1'-0"	#5	1'-0"	96.54	0.902	8.07	0.093
8'-0"	5'-6"	2'-8"	1'-10"	8"	#5	6"	#5	6"	139.04	0.962	8.13	0.095
8'-6"	5'-6"	2'-8"	1'-10"	8"	#5	6"	#5	6"	144.47	1.000	8.13	0.095
9'-6"	6'-0"	2'-10"	2'-2"	9"	#5	6"	#5	6"	156.93	1.136	8.41	0.110
10'-6"	6'-5"	3'-0"	2'-5"	9"	#6	6"	#5	6"	196.27	1.234	8.57	0.117
11'-6"	7'-2"	3'-6"	2'-8"	11"	#6	6"	#6	6"	230.13	1.438	9.52	0.140
12'-6"	7'-8"	3'-9"	2'-11"	1'-0"	#7	6"	#6	6"	283.41	1.592	9.74	0.157
13'-6"	8'-2"	4'-0"	3'-2"	1'-2"	#8	6"	#6	6"	348.72	1.804	10.02	0.186
14'-6"	8'-10"	4'-5"	3'-5"	1'-4"	#9	6"	#6	6"	432.94	2.046	10.30	0.218
15'-6"	9'-6"	4'-10"	3'-8"	1'-6"	#9	6"	#7	6"	489.52	2.302	11.24	0.253
16'-0"	9'-11"	5'-0"	3'-11"	1'-7"	#9	6"	#7	6"	505.72	2.448	11.47	0.279

**TABLE OF WINGWALL REINFORCING**  
(2-wings)

Bar	Size	No.	Spa
D1	#6	~	1'-0"
D2	#6	~	1'-0"
E1	#4	~	1'-0"
F	#4	~	1'-0"
G	#6	~	8"
M1	#4	4	~
P	#4	~	1'-0"
V	#4	~	1'-0"

**TABLE OF TOEWALL REINFORCING**

Bar	Size	No.	Spa
J3	#4	~	1'-0"
M2	#4	2	~
E2	#4	~	1'-0"

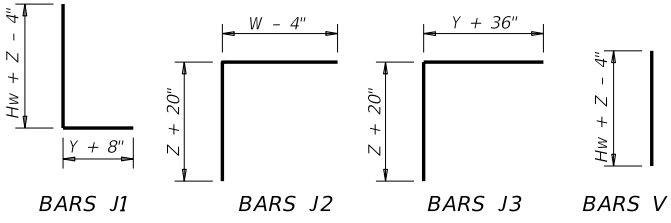

**WING DIMENSION FORMULAS:**  
(All values are in feet.)

$Hw = H + T + C$   
 $Lw = (Hw)(SL) \div \cosine(\theta)$  for Type PW-1  
 $= (Hw - 1')(SL) \div \cosine(\theta)$  for Type PW-2 and  $Hw \ge 4'$   
 $= (Hw - 0.5')(SL) \div \cosine(\theta)$  for Type PW-2 and  $Hw < 4'$








For cast-in-place culverts:  
 $Ltw = [(N)(S) + (N + 1)(U)] \div \cosine(\theta)$

For precast culverts:  
 $Ltw = [(N)(2U + S) + (N - 1)(0.5')] \div \cosine(\theta)$   
 Total Wingwall Area (two wings ~ SF)  
 $= (2)(Hw)(Lw)$  for Type PW-1  
 $= (2)(Hw)(Lw) - 6 SF$  for Type PW-2 and  $Hw \ge 4'$   
 $= (2)(Hw)(Lw) - 1.5 SF$  for Type PW-2 and  $Hw < 4'$

$Hw$  = Height of wingwall  
 $Lw$  = Length of wingwall  
 $Ltw$  = Culvert toewall length  
 $N$  = Number of culvert spans  
 $SL:1$  = Channel slope ratio, (horizontal: 1 vertical, usual value is 2:1)  
 $\theta$  = Culvert skew

See applicable box culvert standard sheet for S, H, T, and U values.

- Skew = 0°
- At discharge end, chamfer may be 3/4" minimum.
- For 15° skew ~ 1"  
For 30° skew ~ 2"  
For 45° skew ~ 3"
- Quantities shown are for two Type PW-1 wings. Adjust concrete volume for Type PW-2 wings. To determine estimated quantities for two wings, multiply the tabulated values by Lw. Quantities shown do not include weight of Bars D.
- Provide weepholes for Hw = 5'-0" and greater. Fill around weepholes with coarse gravel.
- Extend Bars E2 1'-6" minimum into the wingwall footing.
- Lap Bars M1 1'-6" minimum with Bars M2.
- Place Bars G as shown, equally spaced at 8" maximum. Provide at least two pairs of Bars G per wing.
- 0" Min to 5'-0" Max. Estimated curb heights are shown elsewhere in the plans. For structures with pedestrian rail or curbs taller than 1'-0, refer to the Extended Curb Details (ECD) standard sheet. For structures with T631 or T631LS bridge rail, refer to the Mounting Details for T631 & T631LS Rails (T631-CM) standard sheet. Refer to the Box Culvert Rail Mounting Details (RAC) standard sheet for structures with bridge rail other than T631 or T631LS.
- For vehicle safety, the following requirements must be met:
  - For structures without bridge rail, construct curbs no more than 3" above finished grade.
  - For structures with bridge rail, construct curbs flush with finished grade.
 Reduce curb heights, if necessary, to meet the above requirements. No changes will be made in quantities and no additional compensation will be allowed for this work.
- 1'-0" typical. 2'-3" when the Box Culvert Rail Mounting Details (RAC) standard sheet is referred to elsewhere in the plans.
- 3'-0" for Hw < 4'.
- 6" for Hw < 4'.

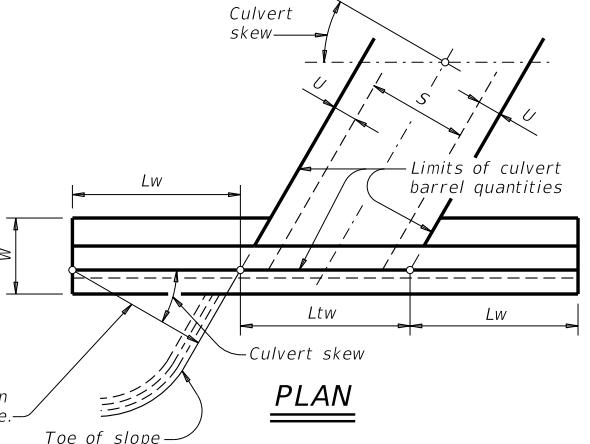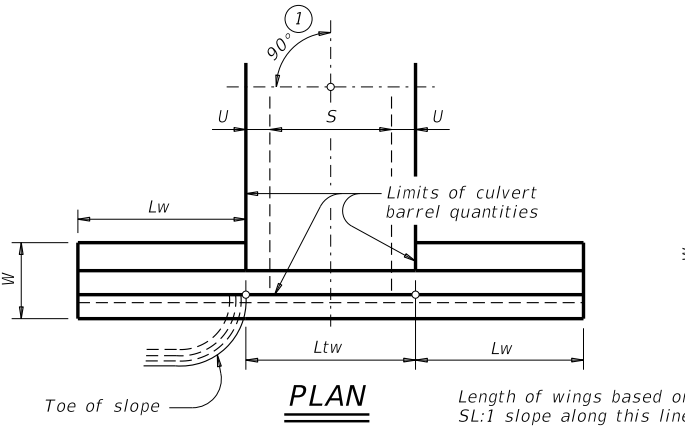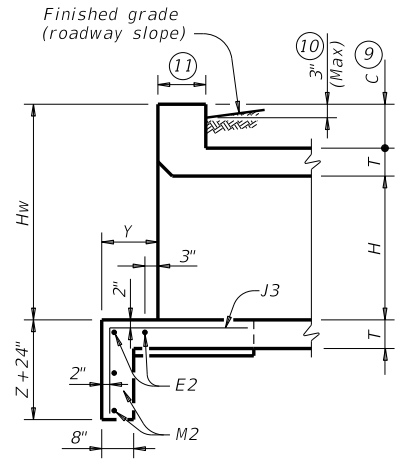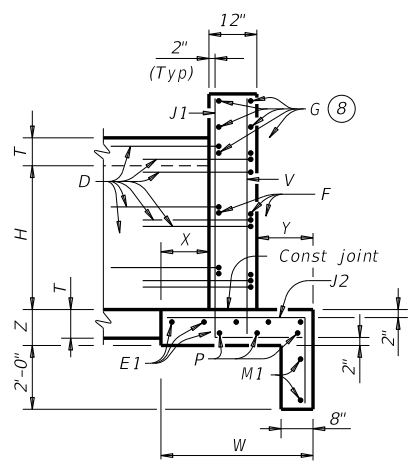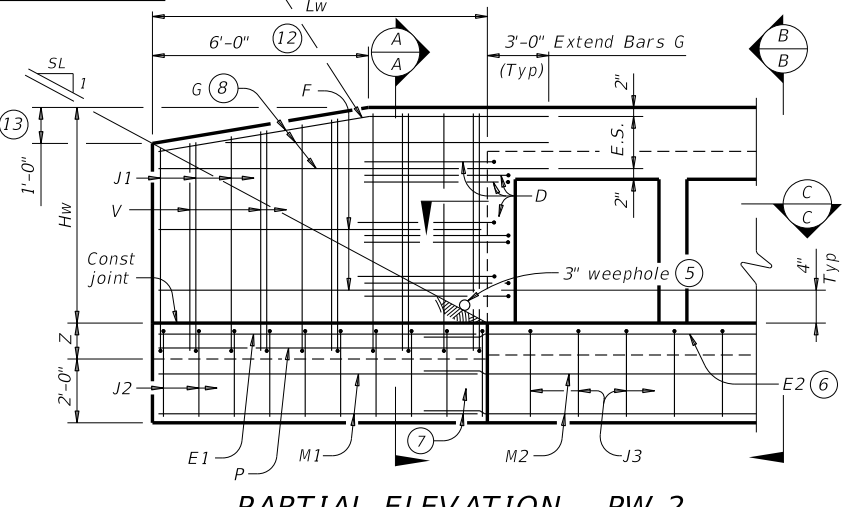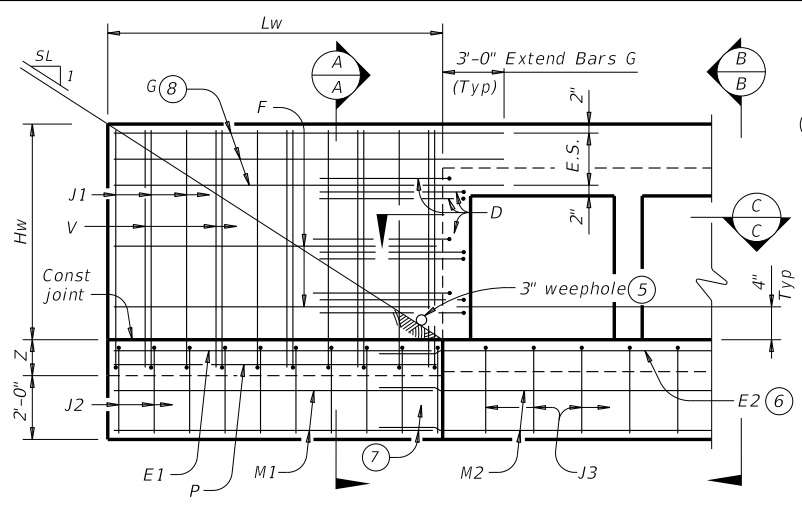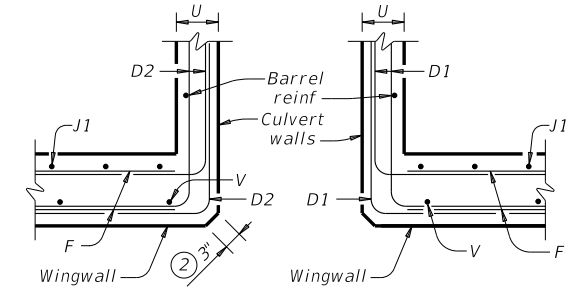

**DETAILS FOR NON-SKEWED BOX CULVERTS**

**DETAILS FOR SKEWED BOX CULVERTS**

**DESIGNER NOTES:**  
 Type PW-1 can be used for all applications and must be used if railing is to be mounted to the wingwall. Type PW-2 can only be used for applications without a railing mounted to the wingwall.

**MATERIAL NOTES:**  
 Provide Class C concrete (f'c=3,600 psi).  
 Provide Grade 60 reinforcing steel.  
 Provide galvanized reinforcing steel if required elsewhere in the plans.

**GENERAL NOTES:**  
 Designed in accordance with AASHTO LRFD Bridge Design Specifications.  
 Depth of toewalls for wingwalls and culverts may be reduced or eliminated when founded on solid rock, when directed by the Engineer.  
 See Box Culvert Supplement (BCS) standard sheet for wingwall type and additional dimensions and information.  
 Quantities for concrete and reinforcing steel resulting from the formulas given on this sheet are for the Contractor's information only.

Cover dimensions are clear dimensions, unless noted otherwise. Reinforcing dimensions are out-to-out of bars.


**Bridge Division Standard**

## CONCRETE WINGWALLS WITH PARALLEL WINGS FOR BOX CULVERTS TYPES PW-1 AND PW-2

**PW**

FILE: pwstde01-20.dgn	DN: GAF	CK: CAT	DW: TxDOT	CK: TxDOT
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917 31		031	CR
	DIST	COUNTY	SHEET NO.	
	BRY	MADISON	38	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

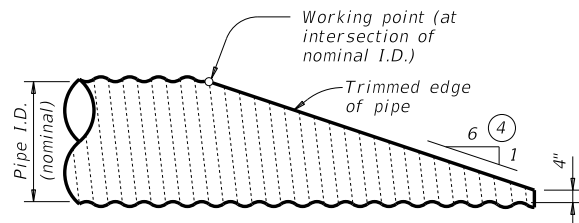


NOTE: All cross pipes, calculations, and dimensions are based on the pipe culverts mitered as shown in this detail. Alternate styles of mitered ends will require that appropriate adjustments be made to the values presented on this standard.

**SIDE ELEVATION OF TYPICAL PIPE CULVERT MITER**

(Showing corrugated metal pipe (CMP) culvert. Details at reinforced concrete pipe (RCP) culvert are similar.)

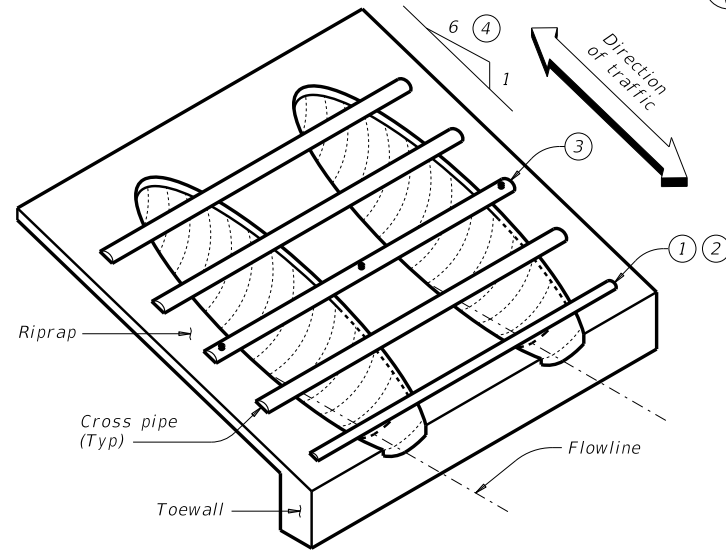


**ISOMETRIC VIEW OF TYPICAL INSTALLATION**

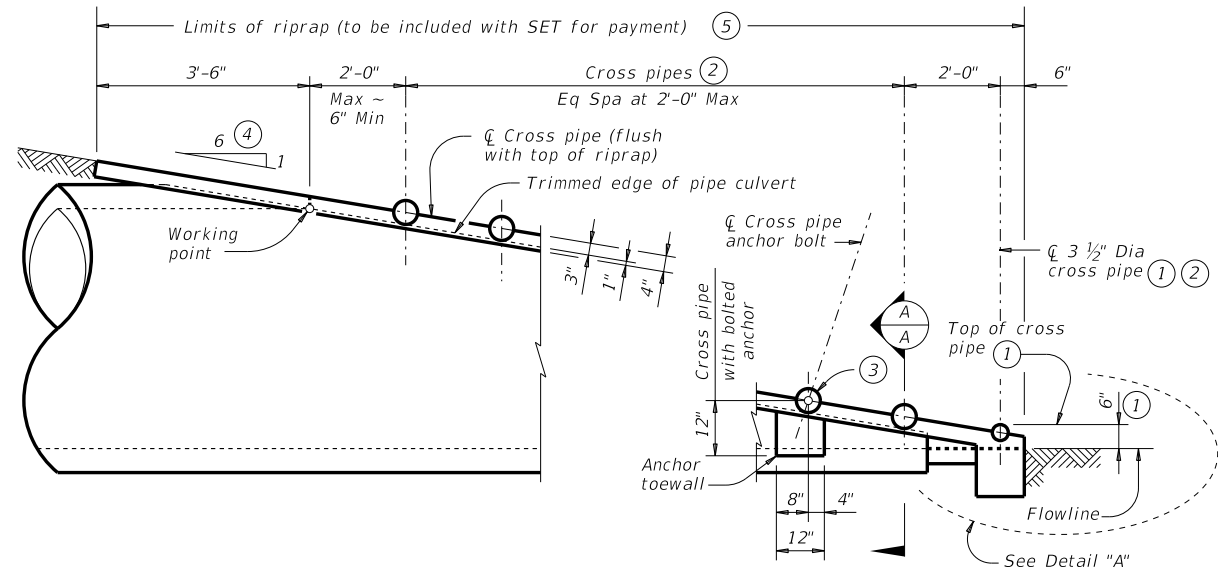


**SIDE ELEVATION OF CAST-IN-PLACE CONCRETE**


(Showing reinforced concrete pipe (RCP) culvert. Details at corrugated metal pipe (CMP) culvert are similar.)

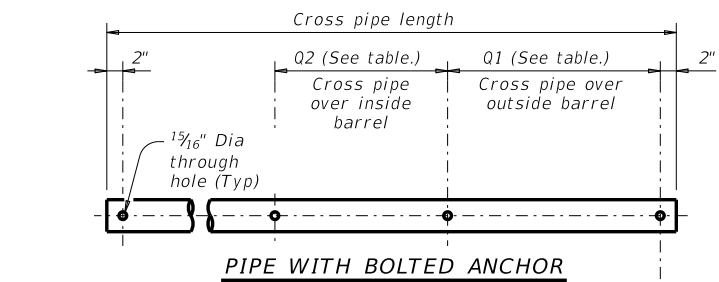

**PIPE WITH BOLTED ANCHOR**

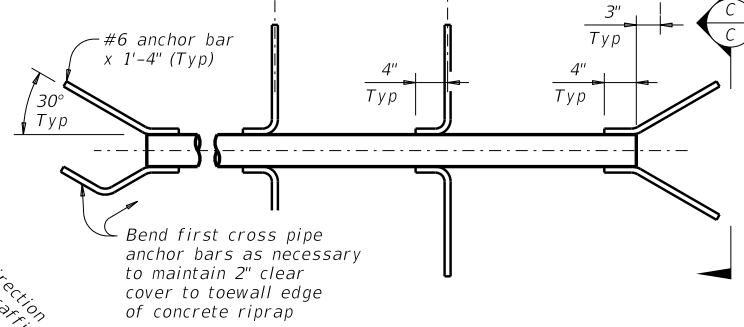


**PIPE WITH ANCHOR BARS**

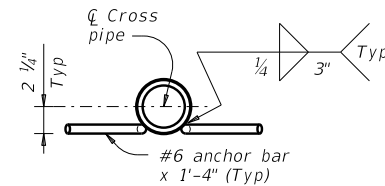


**SECTION C-C**

**CROSS PIPE DETAILS**

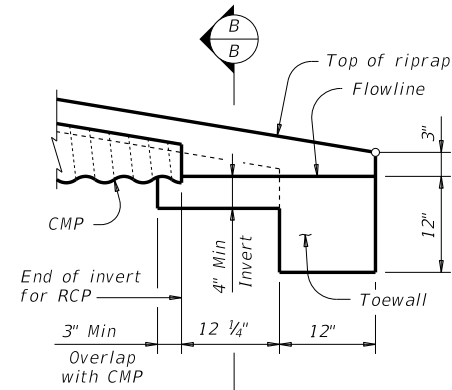


**DETAIL "A"**

(Showing invert with corrugated metal pipe (CMP) culvert. Reinforced concrete pipe (RCP) culvert details are similar. Cross pipes not shown for clarity.)

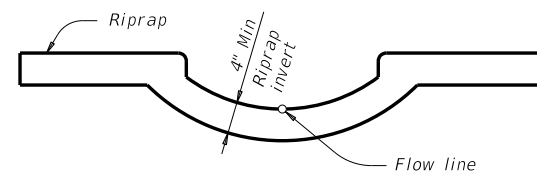


**SECTION B-B**


(Cross pipes not shown for clarity.)

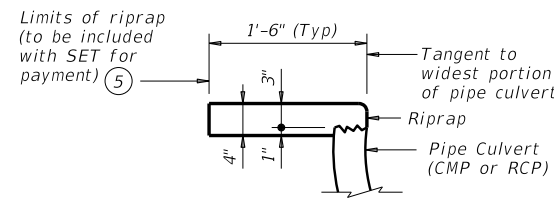

**SHOWING TYPICAL PIPE CULVERT AND RIPRAP**

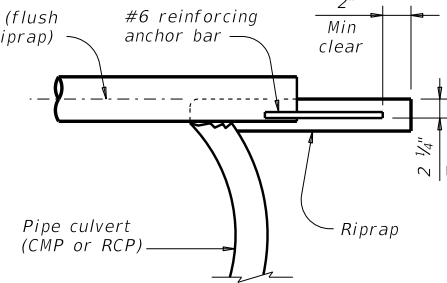

**SHOWING CROSS PIPE WITH ANCHOR BAR**

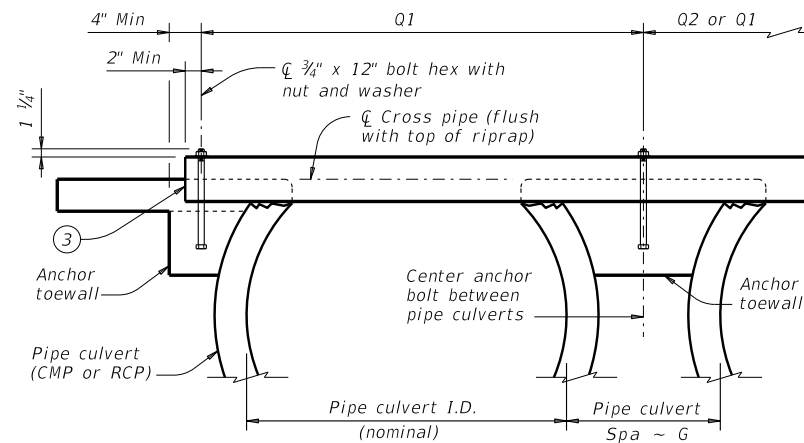

**SHOWING CROSS PIPE WITH BOLTED ANCHOR**

**SECTION A-A**

**CROSS PIPE LENGTHS, REQUIRED PIPE SIZES, AND RIPRAP QUANTITIES**

Nominal Culvert I.D.	Conc Riprap (CY) (6)	Pipe Culvert Spa ~ G	Single Barrel ~ Q1	Multi-Barrel ~ Q1	Q2	Conditions for Use of Cross Pipes	Cross Pipe Sizes
12"	0.6	0' - 9"	N/A	2' - 1"	1' - 9"	3 or more pipe culverts	3" Std (3.500" O.D.)
15"	0.7	0' - 11"	N/A	2' - 5"	2' - 2"		
18"	0.8	1' - 2"	N/A	2' - 10"	2' - 8"		
21"	0.9	1' - 4"	N/A	3' - 2"	3' - 1"		
24"	0.9	1' - 7"	N/A	3' - 6"	3' - 7"	3 or more pipe culverts	3 1/2" Std (4.000" O.D.)
27"	1.0	1' - 8"	N/A	3' - 10"	3' - 11"	2 or more pipe culverts	
30"	1.1	1' - 10"	N/A	4' - 2"	4' - 4"	All pipe culverts	
33"	1.2	1' - 11"	4' - 2"	4' - 5"	4' - 8"	All pipe culverts	4" Std (4.500" O.D.)
36"	1.3	2' - 1"	4' - 5"	4' - 9"	5' - 1"	All pipe culverts	
42"	1.5	2' - 4"	4' - 11"	5' - 5"	5' - 10"	All pipe culverts	5" Std (5.563" O.D.)
48"	1.7	2' - 7"	5' - 5"	6' - 0"	6' - 7"		
54"	2.0	3' - 0"	5' - 11"	6' - 9"	7' - 6"		
60"	2.2	3' - 3"	6' - 5"	7' - 4"	8' - 3"		
66"	2.4	3' - 3"	6' - 11"	7' - 10"	8' - 9"	All pipe culverts	5" Std (5.563" O.D.)
72"	2.7	3' - 4"	7' - 5"	8' - 5"	9' - 4"		

- The proper installation of the first cross pipe is critical for vehicle safety. Place the top of the first cross pipe no more than 6" above the flow line.
- Provide cross pipes, except the first bottom pipe, of the size shown in the table. Provide a 3 1/2" standard pipe (4" O.D.) for the first bottom pipe.
- Install the third cross pipe from the bottom of the culvert using a bolted connection. Ensure that riprap concrete does not flow into the cross pipe so as to permit disassembly of the bolted connection to allow cleanout access. At the Contractor's option, install all other cross pipes using the bolted connection details.
- Match cross slope as shown elsewhere in the plans. Cross slope of 6:1 or flatter is required for vehicle safety.
- Riprap placed beyond the limits shown will be paid for as concrete riprap in accordance with Item 432, "Riprap".
- Quantities shown are for one end of one reinforced concrete pipe (RCP) culvert. For multiple pipe culverts or for corrugated metal pipe (CMP) culverts, quantities will need to be adjusted. Riprap quantities are for contractor's information only.

**MATERIAL NOTES:**

Synthetic fibers listed on the "Fibers for Concrete" Material Producer List (MPL) may be used in lieu of steel reinforcing in riprap concrete unless noted otherwise. Provide cross pipes that meet the requirements of ASTM A53 (Type E or S, Gr B), ASTM A500 (Gr B), or API 5LX52. Provide ASTM A307 bolts and nuts. Galvanize all steel components, except concrete reinforcing, after fabrication. Repair galvanizing damaged during transport or construction in accordance with the specifications.

**GENERAL NOTES:**

Cross pipes are designed for a traversing load of 10,000 pounds at yield as recommended by Research Report 280-2F, "Safety Treatment of Roadside Parallel-Drainage Structures", Texas Transportation Institute, March 1981. Safety end treatments (SET) shown herein are intended for use in those installations where out of control vehicles are likely to traverse the openings approximately perpendicular to the cross pipes. Construct concrete riprap and all necessary inverts in accordance with the requirements of Item 432, "Riprap". Payment for riprap and toewall is included in the Price Bid for each Safety End Treatment.


Texas Department of Transportation  
**SAFETY END TREATMENT FOR 12" DIA TO 72" DIA PIPE CULVERTS TYPE II ~ PARALLEL DRAINAGE**  
 SETP-PD

FILE: setppdse-20.dgn	DN: GAF	CK: CAT	DW: JRP	CK: GAF
©TxDOT February 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	0917 31	031	CR	
DIST	COUNTY	SHEET NO.		
BRY	MADISON	39		


DATE: FILE:

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE:  
FILE:

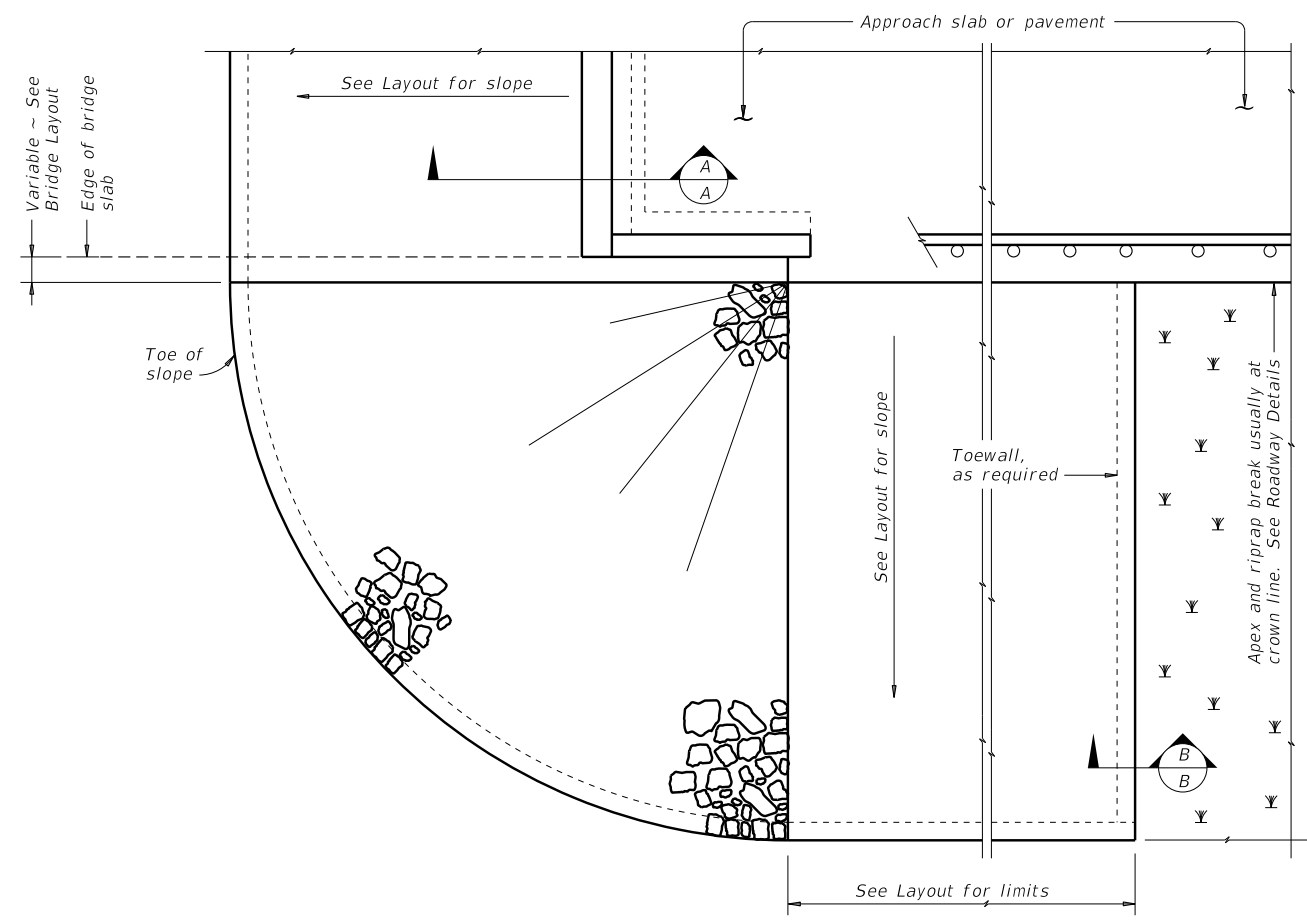


**PLAN**

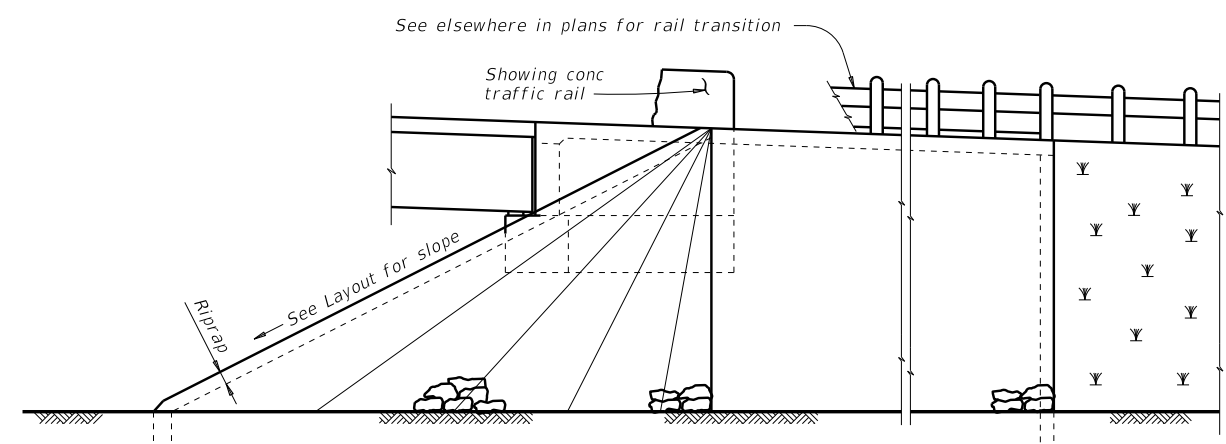

**ELEVATION**

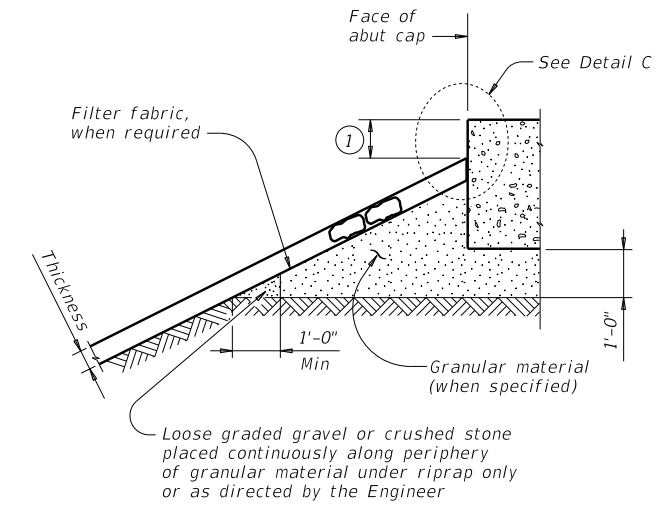


**SECTION A-A AT CAP**

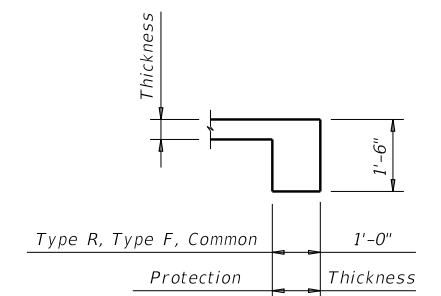


**SECTION B-B**

Provide toewall when shoulder drain is located adjacent to limits of stone riprap. Omit toewall when thickness of protection riprap is greater than 18".

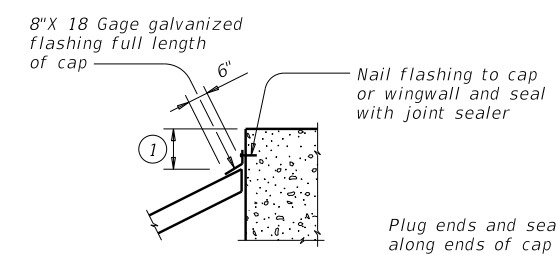

**CAP OPTION A**

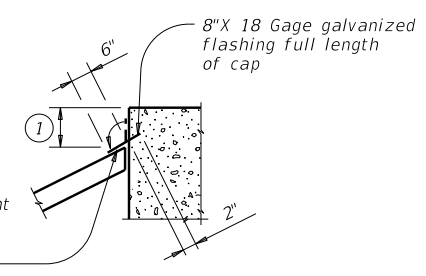

**CAP OPTION B**

**DETAIL C**

① Top of cap to top of riprap dimension varies as directed by the Engineer. Provide 9" Min for beam/slab type bridges and 1'-6" for slab span, box beam, or slab beam bridges.


**GENERAL NOTES:**  
Refer to Item 432, "Riprap" for stone size and gradation, and construction details. See Layout for limits and thickness of riprap specified.  
See elsewhere in plans for locations and details of shoulder drains.

SHEET 1 OF 2


		<b>Bridge Division Standard</b>	
<h2>STONE RIPRAP</h2>			
<h3>SRR</h3>			
FILE: srrstde1-19.dgn	DN: AES	CK: JGD	DW: BWH
©TxDOT April 2019	CONT SECT	JOB	HIGHWAY
REVISIONS	0917 31	031	CR
DIST	COUNTY	SHEET NO.	
BRY	MADISON	40	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

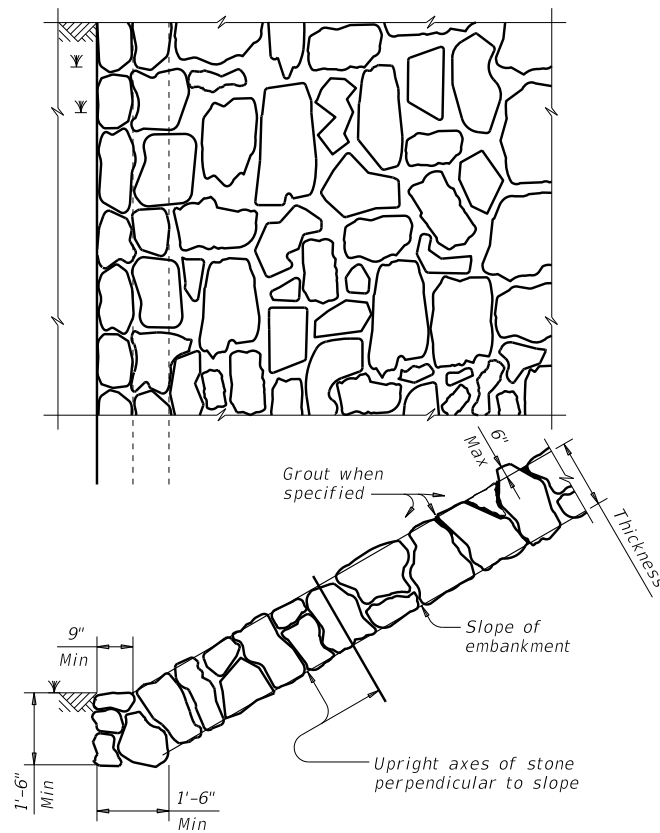

**FIGURE 1 ~ TYPE R STONE RIPRAP**  
dry or grouted

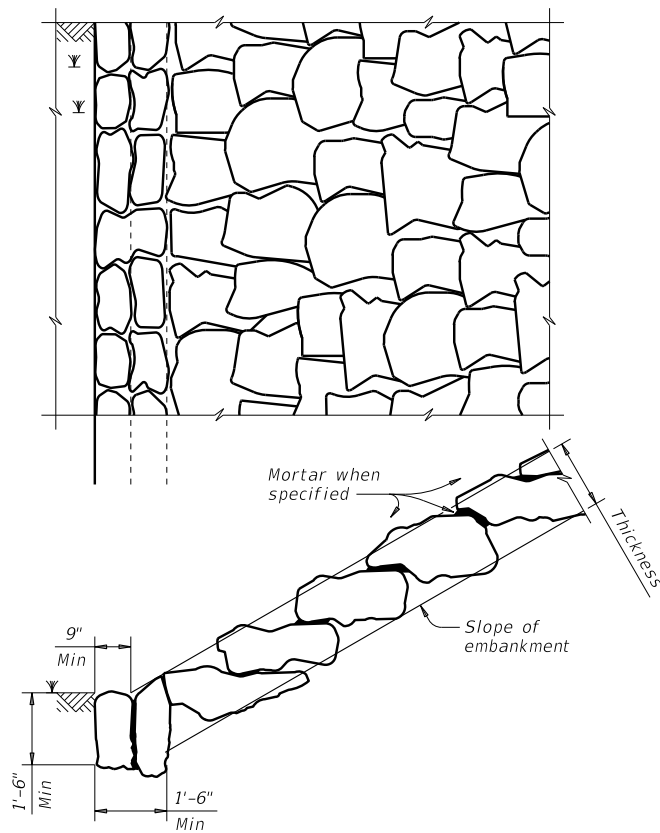


**FIGURE 2 ~ TYPE F STONE RIPRAP**  
dry or mortared

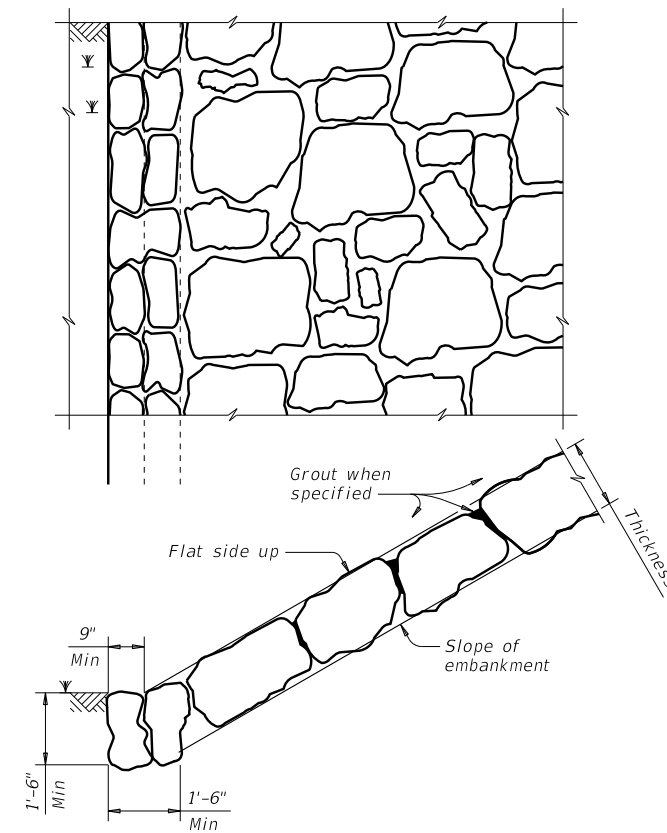


**FIGURE 3 ~ TYPE F STONE RIPRAP**  
grouted


- ② Provide bedding material instead of filter fabric if shown elsewhere in plans. See Layout for thickness of bedding material.
- ③ Minimum toe depth is the larger of the maximum scour depth or 2 times the riprap thickness.
- ④ "Y" and Height need to be defined. See layout or detail sheet for values if this option is used.
- ⑤ List Stone Protection as size (XX inch) and thickness (YY inch) on the layout.  
Example: Riprap (Stone Protection) XX inch, Thickness = YY inch.

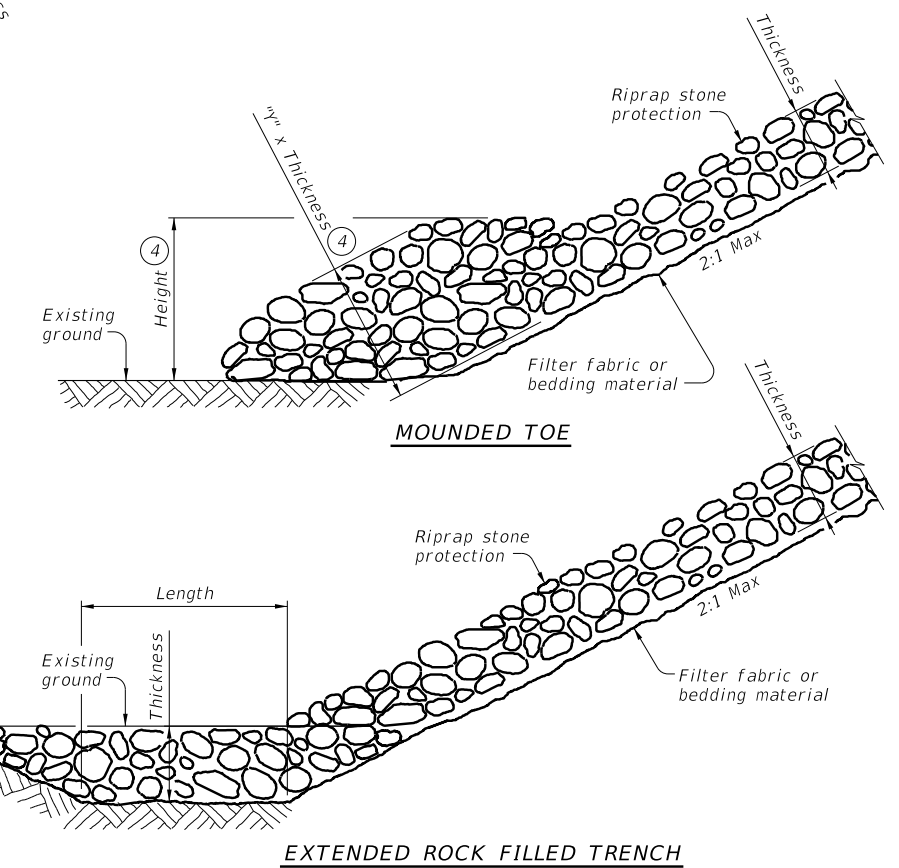

**PROTECTION STONE RIPRAP TOE OPTIONS ⑤**

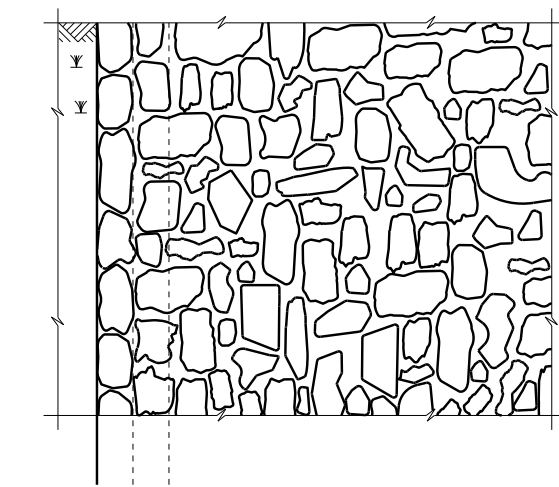

**FIGURE 4 ~ COMMON STONE RIPRAP**  
dry or grouted

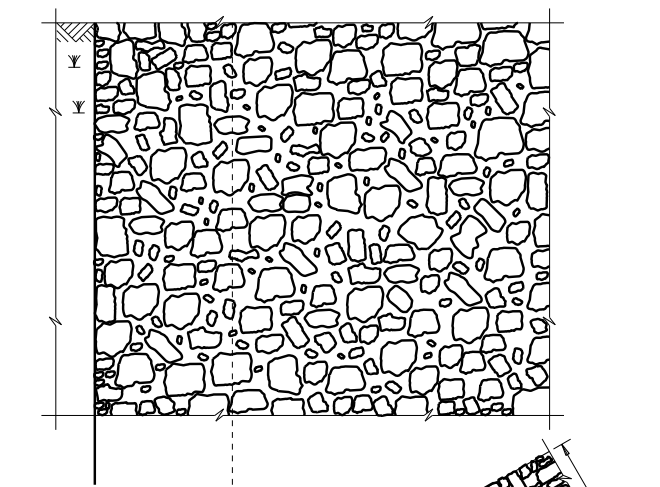


**FIGURE 5 ~ PROTECTION STONE RIPRAP ⑤**

**STONE RIPRAP**

**SRR**

FILE: srrstde1-19.dgn	DN: AES	CK: JGD	DW: BWH	CK: AES
©TxDOT April 2019 REVISIONS	CONT SECT	JOB	HIGHWAY	
	0917 31	031	CR	
	DIST	COUNTY	SHEET NO.	
	BRY	MADISON	41	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

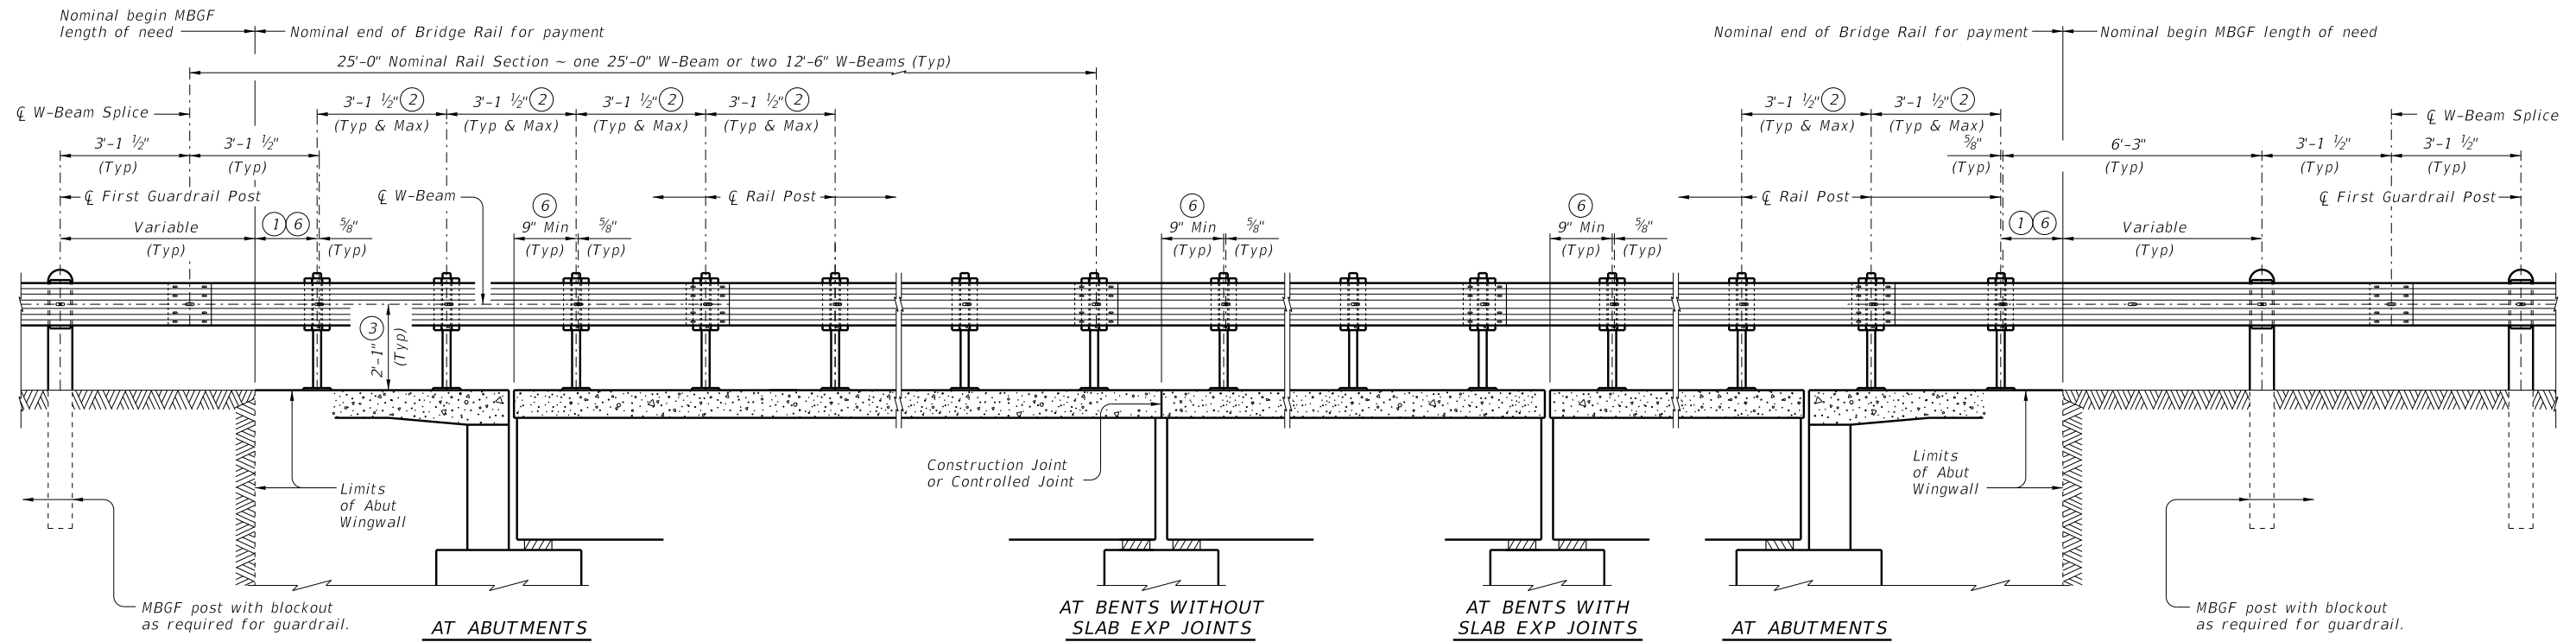

**ROADWAY ELEVATION OF RAIL**


Showing without overlay.

- ① 9" Min, 5'-9" Max
- ② Maintain 3'-1 1/2" Rail Post spacing wherever possible for use with nominal 25'-0" or 12'-6" W-Beam sections. Symmetry of post spacing on both sides and along the structure is not necessary.
- ③ Increase 2" for structures with overlay.
- ④ Tighten the first hex nut by hand until the top and bottom edges of the W-Beam engage the Backer Plate (Backer Plate should be snug against the post). Then tighten hex nut one revolution with wrench and secure with the second hex nut.
- ⑤ PL 1/8" x 1 3/4" x 1 3/4" with 3/8" Dia Hole centered in PL (ASTM A36). Square Guardrail Washer (FWR01).
- ⑥ The post nearest to a slab joint or end of structure may be shifted up to 9" in order to satisfy the minimum offset dimension. Drill a new 3/4" Dia hole in the centerline of W-beam for shifted post. Paint hole with two coats of zinc-rich paint conforming to the Item "Galvanizing". All other posts must remain on the typical spacing.
- ⑦ 3/8" Dia formed holes for 3/8" Dia heavy hex head anchor bolt (ASTM F3125 Gr A325 or A449) or threaded rod (ASTM A193 Gr B7 or F1554 Gr 105) with one hardened steel washer (ASTM F436) and one regular lock washer placed under heavy hex nut (ASTM A563). One additional heavy hex nut must be furnished and tack welded for each threaded rod. See "Cast-In-Place & Formed Hole Anchor Bolt Options".
- ⑧ 3/8" Dia heavy hex head anchor bolt (ASTM F3125 Gr A325 or A449) or threaded rod (ASTM A193 Gr B7 or F1554 Gr 105) with one hardened steel washer (ASTM F436) and one regular lock washer placed under heavy hex nut (ASTM A563). One additional heavy hex nut must be furnished and tack welded for each threaded rod. See "Cast-In-Place & Formed Hole Anchor Bolt Options".

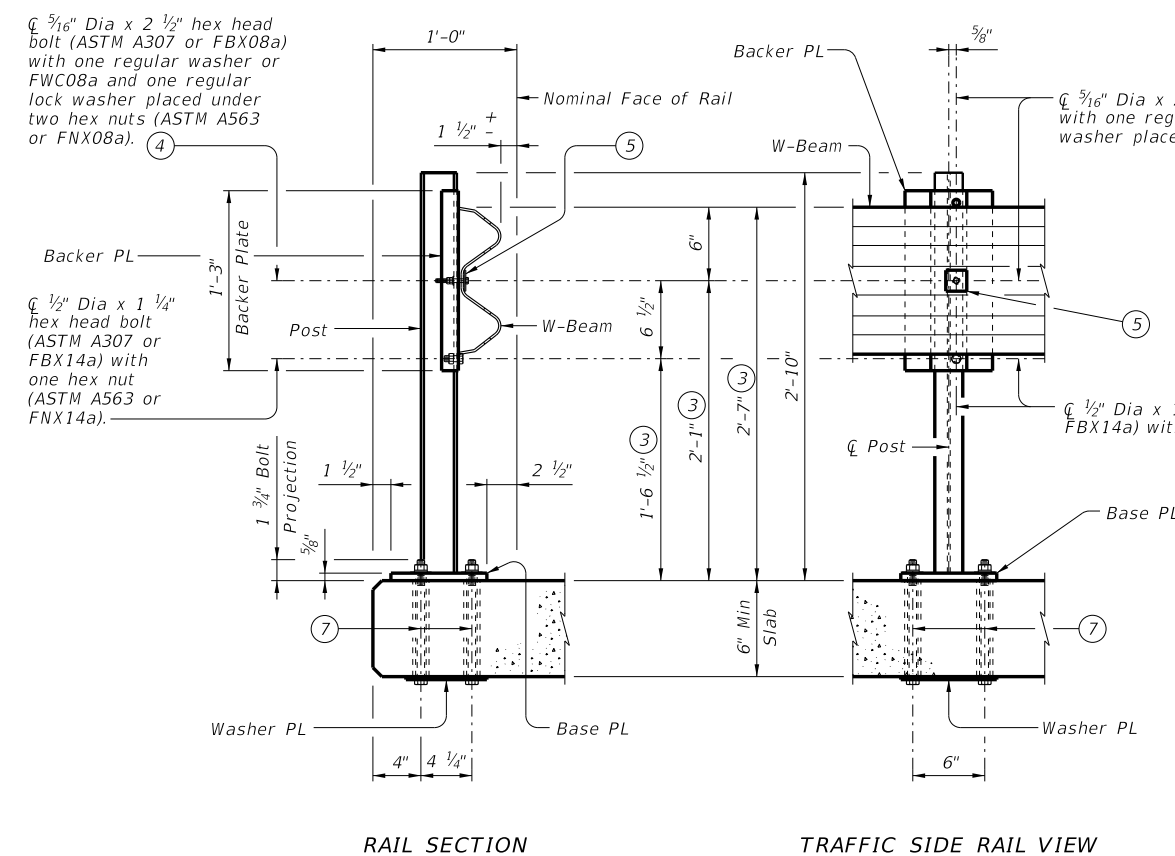

**RAIL DETAILS ON BRIDGE SLAB**

Showing without overlay.

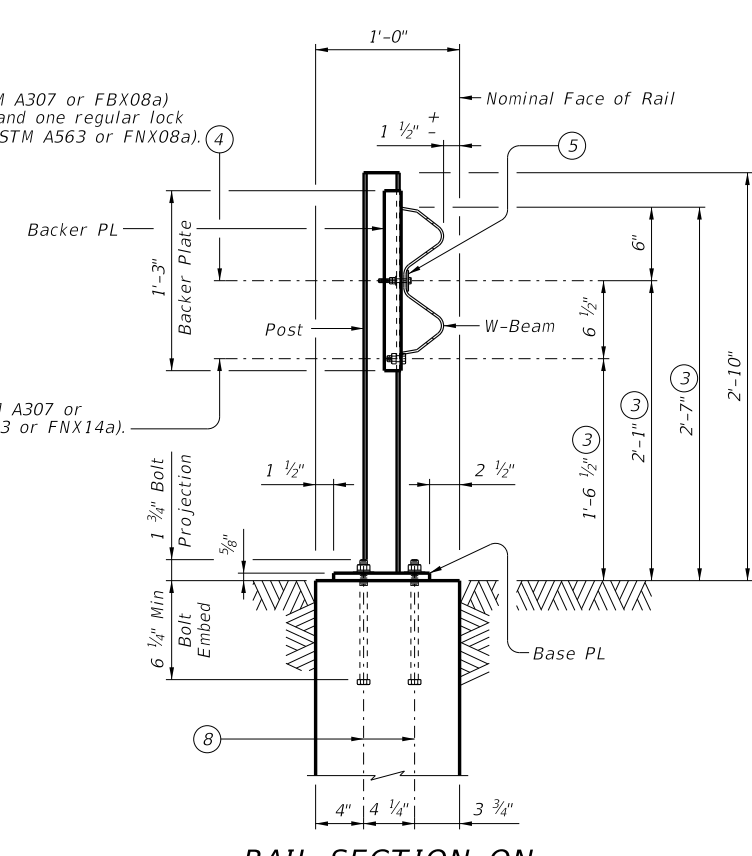

**RAIL SECTION ON ABUTMENT WINGWALL**

Showing without overlay.

SHEET 1 OF 2


		<b>Bridge Division Standard</b>	
<h2>TRAFFIC RAIL</h2>			
<h3>TYPE T631</h3>			
FILE: RL-T631-23.dgn	DN: TxDOT	CK: AES	DW: JTR
REVISED: September 2019	CONT: 0917	SECT: 31	JOB: 031
07/2020: Allowing 9'-4 1/2" or 6'-3" W-Beam sections	DIST: BRY	COUNTY: MADISON	SHEET NO: 42
03/2023: MBGF Notes.			

DATE: FILE:




DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: FILE:

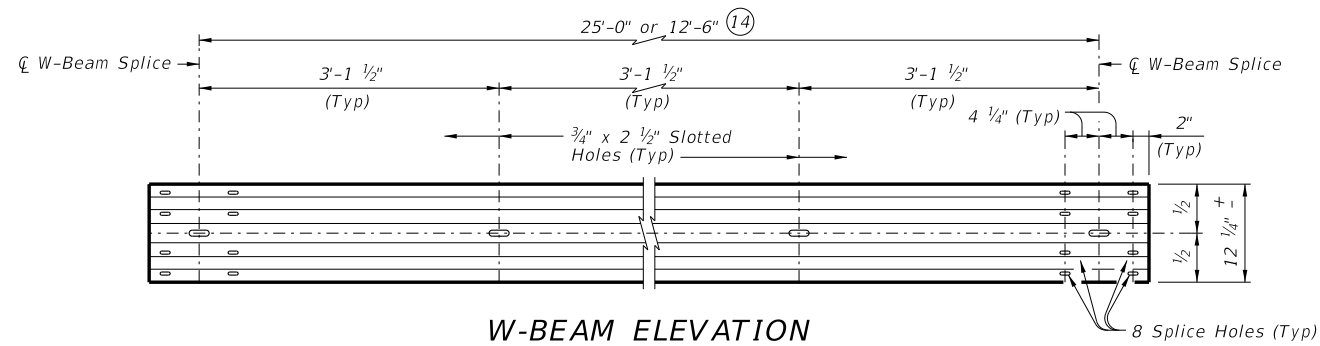


W-BEAM ELEVATION

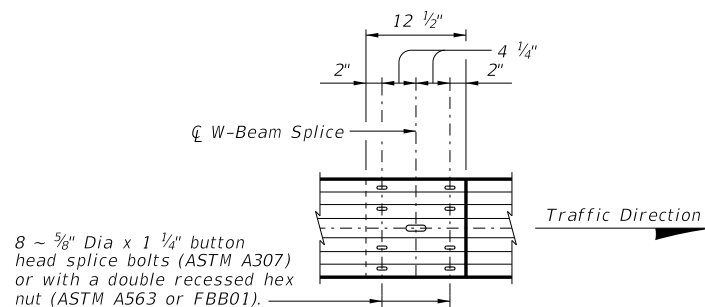


W-BEAM SPLICE ELEVATION

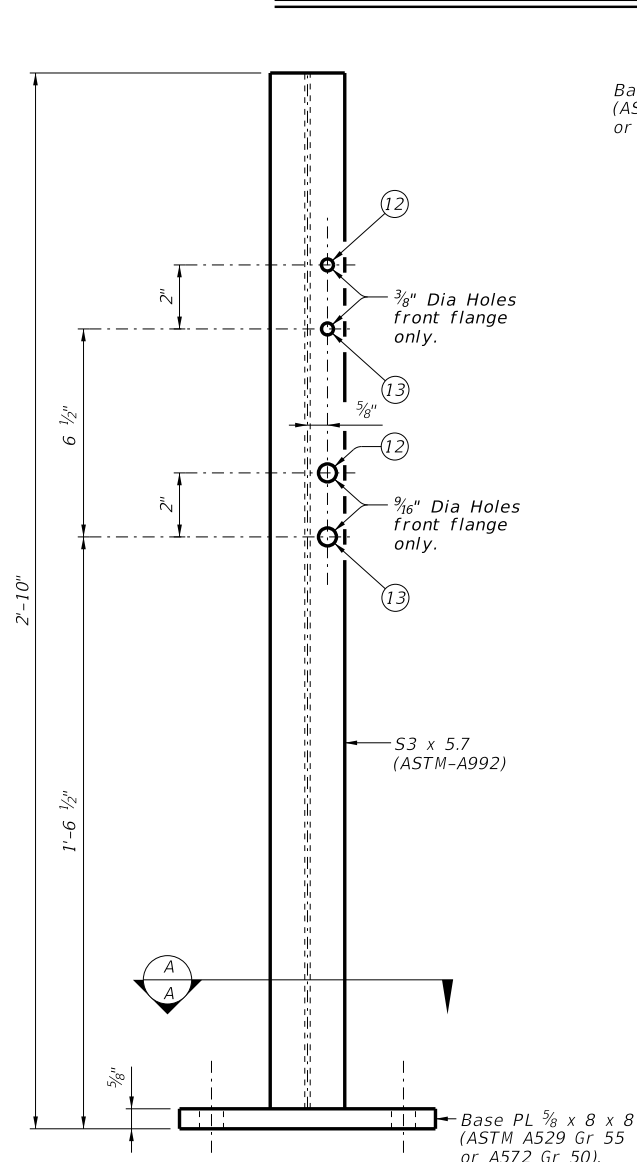

POST ELEVATION

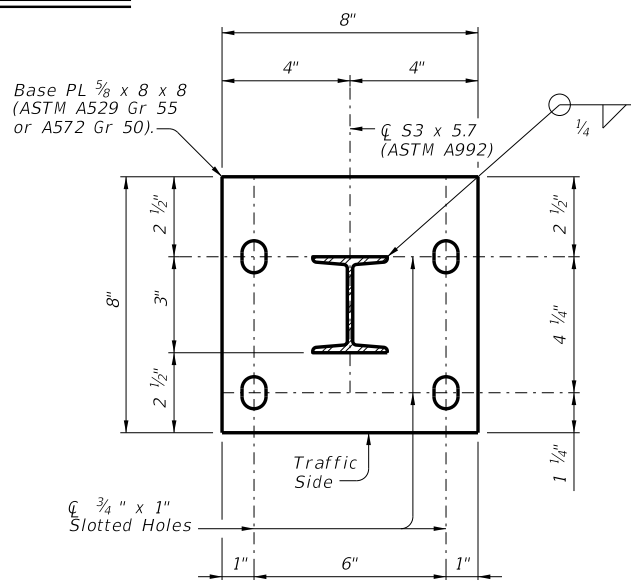


SECTION A-A

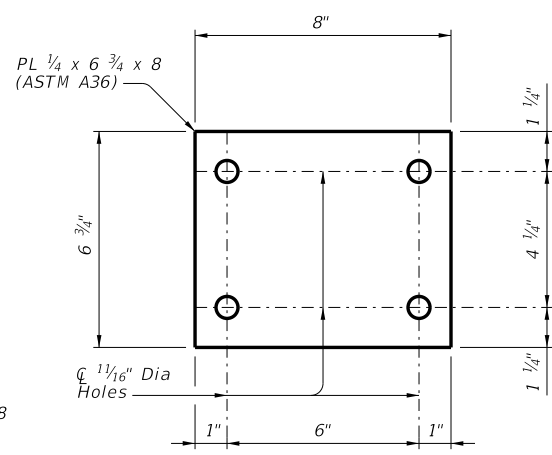


WASHER PLATE DETAIL

9/8" Dia heavy hex head anchor bolt (ASTM F3125 Gr A325 or A449) or threaded rod (ASTM A193 Gr B7 or F1554 Gr 105) with one hardened steel washer (ASTM F436) and one regular lock washer placed under heavy hex nut (ASTM A563). One additional heavy hex nut must be furnished and tack welded for each threaded rod.

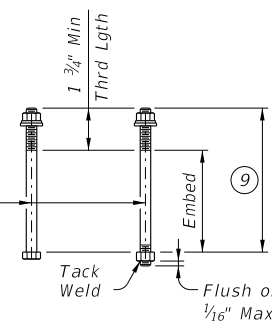

CAST-IN-PLACE & FORMED HOLE ANCHOR BOLT OPTIONS (10)

- (9) See "Rail Details On Bridge Slab" and/or "Rail Section On Abutment Wingwall".
- (10) See "Material Notes" for anchor bolt information.
- (11) Backer PL 1/4 x 8 x 1'-3" (ASTM A1011 CS or SS Gr 33, or A1008 CS or SS Gr 33 (11 Gage acceptable)).
- (12) Used for structures with overlay.
- (13) Used for structures without overlay.
- (14) At the nominal end of the bridge rail for payment, one 9'-4 1/2" or 6'-3" W-beam section is permitted in order to achieve the required W-Beam splice location on the MBGF.

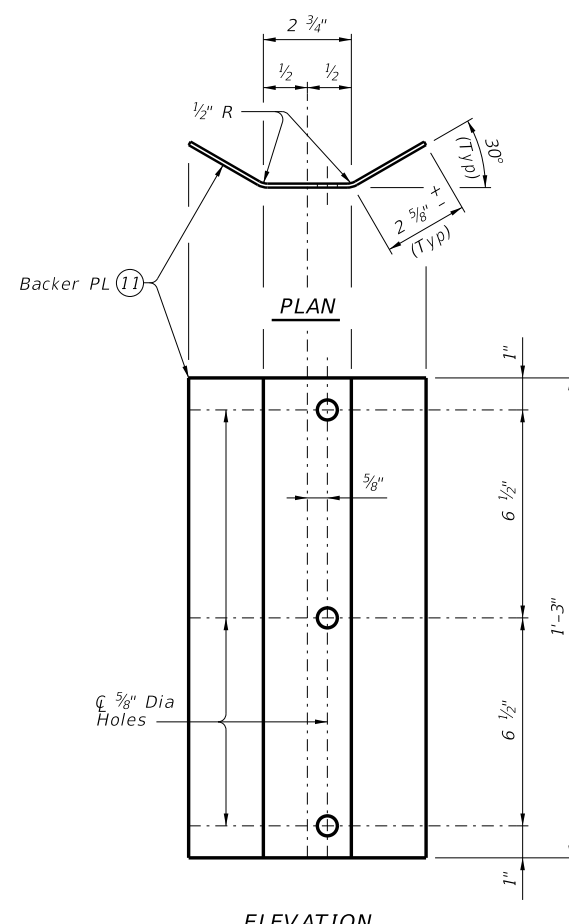

BACKER PLATE

**MBGF AND END TREATMENT NOTES:**

This traffic railing must be anchored by metal beam guard fence (MBGF) and guard fence end treatments. Determine MBGF length of need in accordance with the Roadway Design Manual, unless otherwise specified. The minimum MBGF length of need required for anchoring the railing is 25' of MBGF plus the appropriate end treatment installed tangent to the primary roadway.

**CONSTRUCTION NOTES:**

Face of rail post must be plumb unless otherwise approved by the Engineer. Post must be perpendicular to adjacent roadway grade. Use epoxy mortar under post base plates if gaps larger than 1/16" exist.

Fully anchored guardrail must be attached to each end of rail. A metal beam guard fence transition is not used with this rail.

At the Contractor's option anchor bolts may be an adhesive anchor system. See "Material Notes".

Test adhesive anchors in accordance with Item 450.3.3, "Tests". Test 3 anchors per 100 anchors installed. Perform corrective measures to provide adequate capacity if any of the tests do not meet the required test load. Repair damage from testing as directed.

It is recommended to show a Rail Layout with rail posts and W-beam splices. Fabricator must submit erection drawings to the Engineer for approval.

Round or chamfer exposed edges of rail post and backer plate to approximately 1/16" by grinding.

Shop drawings are not required for this rail.

**MATERIAL NOTES:**

Galvanize all steel components.

Anchor bolts for base plate must be 3/8" Dia ASTM F3125 Gr A325 or A449 bolts (or ASTM A193 Gr B7 or F1554 Gr 105 threaded rods with one tack welded heavy hex nut each) with one hardened steel washer (ASTM F436) and one regular lock washer placed under each heavy hex nut. Nuts must conform to ASTM A563 requirements.

Optional adhesive anchorage system must be 3/8" Dia ASTM A193 Gr B7 or F1554 Gr 105 fully threaded rods with one hardened steel washer (ASTM F436) and one regular lock washer placed under each heavy hex nut. Nuts must conform to ASTM A563 requirements. Embed fully threaded rod into slab and/or abutment wingwall using a Type III, Class C, D, E, or F anchor adhesive. Minimum adhesive anchor embedment depth is 4 3/4". Anchor adhesive chosen must be able to achieve a nominal bond strength in tension of a single anchor, Na, of 8 kips (edge distance must be accounted for). Submit signed and sealed calculations or the manufacturer's published literature showing the proposed anchor adhesive's ability to develop this load to the Engineer for approval prior to use. Anchor installation, including hole size, drilling, and clean out, must be in accordance with Item 450, "Railing."

W-beam must meet the requirements of Item 540, "Metal Beam Guard Fence" except as modified in the plans. The Contractor may furnish rail elements of 25'-0" or 12'-6" (Nominal) lengths and a single rail element of 9'-4 1/2" or 6'-3" (Nominal) length. W-Beam must have slotted holes at 3'-1 1/2".

Some part numbers from the "Task Force 13" Guide to Standardized Highway Barrier Hardware have been furnished for quick reference.

**GENERAL NOTES:**

This railing has been successfully evaluated by full-scale crash test to meet MASH TL-3 criteria. This railing can be used for speeds of 50 mph and greater.

This rail is designed to deflect approximately 4' to 4'-6" as it contains and redirects the errant vehicle. This rail may not be installed on top of or behind curbs that project above finished grade, on bridges with expansion joints providing more than 5" movement, on retaining walls, or on grade separations and interchanges.

Repairs to impact-damaged post and base plate unit are not permitted. Replace all impact-damaged posts with a new post and base plate unit.

Average weight of railing with no overlay: 20 plf total.

SHEET 2 OF 2

		<b>Bridge Division Standard</b>	
<h1>TRAFFIC RAIL</h1>			
<h2>TYPE T631</h2>			
FILE: RL-T631-23.dgn	DN: TxDOT	CK: AES	DW: JTR
REVISIONS	CONTRACT	SECTION	JOB
0917 31	031		CR
07/2020: Allowing 9'-4 1/2" or 6'-3" W-Beam sections	DIST	COUNTY	SHEET NO.
03/2023: MBGF Notes	BRY	MADISON	43

**STORMWATER POLLUTION PREVENTION PLAN (SWP3):**

This SWP3 has been developed in accordance with the TPDES Construction General Permit TXR150000 (CGP). The Texas Department of Transportation (TxDOT) ensures that project specifications include adequate best management practices (BMPs) for this project.

For all projects with any soil disturbing activities, TxDOT will maintain a SWP3 with all pertinent records, correspondence, environmental documents, etc. at the project field office. If no field office is available, then this SWP3 shall be kept in the appropriate TxDOT Area Office.

This SWP3 is consistent with requirements specified in applicable stormwater plans and the projects environmental permits, issues, and commitments (EPICs). A copy of the CGP is included in Attachment 2.12 of the SWP3 binder.

**1.0 SITE/PROJECT DESCRIPTION**

**1.1 PROJECT CONTROL SECTION JOB (CSJ):**

**1.2 PROJECT LIMITS:**

From: 0.06 MI. E OF TOWN BRANCH AT TRINITY STREET

To: 0.08 MI. W OF TOWN BRANCH AT TRINITY STREET

**1.3 PROJECT COORDINATES:**

BEGIN: (Lat) \_\_\_\_\_, (Long) \_\_\_\_\_

END: (Lat) \_\_\_\_\_, (Long) \_\_\_\_\_

**1.4 TOTAL PROJECT AREA (Acres):** 2.10 AC

**1.5 TOTAL AREA TO BE DISTURBED (Acres):** 2.10 AC (100%)

**1.6 NATURE OF CONSTRUCTION ACTIVITY:**

FOR THE CONSTRUCTION OF BRIDGE REPLACEMENT CONSISTING OF REPLACING BRIDGE WITH BRIDGE CLASS CULVERT AND APPROACHES, GRADING, ACP BASE & SURFACE, AND MBGF.

**1.7 MAJOR SOIL TYPES:**

Soil Type	Description
CLAY	
LEAN SAND	

**1.8 PROJECT SPECIFIC LOCATIONS (PSLs):**

PSLs must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. PSLs may be identified during preconstruction meetings or during the construction process. Please choose from the options below:

- PSLs determined during preconstruction meeting
- PSLs determined during construction
- No PSLs planned for construction

Type	Sheet #s

All off-ROW PSLs required by the Contractor are the Contractor's responsibility. The Contractor shall secure all permits required by local, state, federal laws for off-ROW PSLs. The contractor shall provide diagrams, areas of disturbance, acreage, and BMPs for all off-ROW PSLs within one mile of the project.

**1.9 CONSTRUCTION ACTIVITIES:**

(Use the following list as a starting point when developing the Construction Activity Schedule and Ceasing Record in Attachment 2.5.)

- Mobilization
- Install sediment and erosion controls
- Blade existing topsoil into windrows, prep ROW, clear and grub
- Remove existing pavement
- Grading operations, excavation, and embankment
- Excavate and prepare subgrade for proposed pavement widening
- Remove existing culverts, safety end treatments (SETs)
- Remove existing metal beam guard fence (MBGF), bridge rail
- Install proposed pavement per plans
- Install culverts, culvert extensions, SETs
- Install mow strip, MBGF, bridge rail
- Place flex base
- Rework slopes, grade ditches
- Blade windrowed material back across slopes
- Revegetation of unpaved areas
- Achieve site stabilization and remove sediment and erosion control measures
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**1.10 POTENTIAL POLLUTANTS AND SOURCES:**

- Sediment laden stormwater from stormwater conveyance over disturbed area
- Fuels, oils, and lubricants from construction vehicles, equipment, and storage
- Solvents, paints, adhesives, etc. from various construction activities
- Transported soils from offsite vehicle tracking
- Construction debris and waste from various construction activities
- Contaminated water from excavation or dewatering pump-out water
- Sanitary waste from onsite restroom facilities
- Trash from various construction activities/receptacles
- Long-term stockpiles of material and waste
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**1.11 RECEIVING WATERS:**

Receiving waters must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. Include Segment # for receiving waters.

Tributaries	Classified Waterbody
TOWN BRANCH	TRIBUTARY

\* Add (\*) for impaired waterbodies with pollutant in ( ).

**1.12 ROLES AND RESPONSIBILITIES: TxDOT**

- Development of plans and specifications
- Submit Notice of Intent (NOI) to TCEQ (≥5 acres)
- Post Construction Site Notice
- Submit NOI/CSN to local MS4
- Perform SWP3 inspections
- Maintain SWP3 records and update to reflect daily operations
- Complete and submit Notice of Termination to TCEQ
- Maintain SWP3 records for 3 years
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**1.13 ROLES AND RESPONSIBILITIES: CONTRACTOR**

- Day To Day Operational Control
- Submit Notice of Intent (NOI) to TCEQ (≥5 acres)
- Post Construction Site Notice
- Submit NOI/CSN to local MS4
- Maintain schedule of major construction activities
- Install, maintain and modify BMPs
- Complete and submit Notice of Termination to TCEQ
- Maintain SWP3 records for 3 years
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**1.14 LOCAL MUNICIPAL SEPARATE STORM SEWER SYSTEM (MS4) OPERATOR COORDINATION:**

MS4 Entity



**STORMWATER POLLUTION PREVENTION PLAN (SWP3)**

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.
6	BR 2022(281)			44
STATE	STATE DIST.	COUNTY		
TEXAS	BRY	MADISON		
CONT.	SECT.	JOB	HIGHWAY NO.	
0917	31	031	CR	

**STORMWATER POLLUTION PREVENTION PLAN (SWP3):**

**2.0 BEST MANAGEMENT PRACTICES (BMPs) AND CONTROLS, INSPECTION, AND MAINTENANCE**

The Contractor shall be the responsible party for implementing the BMPs described herein and for complying with the SWP3 for control of erosion and sedimentation during day-to-day operations. The Contractor shall implement changes to this SWP3 approved by TxDOT within the times specified in this SWP3 or the CGP.

**2.1 EROSION CONTROL AND SOIL STABILIZATION BMPs:**

**T / P**

- Protection of Existing Vegetation
- Vegetated Buffer Zones
- Soil Retention Blankets
- Geotextiles
- Mulching/ Hydromulching
- Soil Surface Treatments
- Temporary Seeding
- Permanent Planting, Sodding or Seeding
- Biodegradable Erosion Control Logs
- Rock Filter Dams/ Rock Check Dams
- Vertical Tracking
- Interceptor Swale
- Riprap
- Diversion Dike
- Temporary Pipe Slope Drain
- Embankment for Erosion Control
- Paved Flumes
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**2.2 SEDIMENT CONTROL BMPs:**

**T / P**

- Biodegradable Erosion Control Logs
- Dewatering Controls
- Inlet Protection
- Rock Filter Dams/ Rock Check Dams
- Sandbag Berms
- Sediment Control Fence
- Stabilized Construction Exit
- Floating Turbidity Barrier
- Vegetated Buffer Zones
- Vegetated Filter Strips
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

Sediment control BMPs requiring design capacity calculations (See SWP3 Attachment 1.3.):

**T / P**

- Sediment Trap
  - Calculated volume runoff from 2-year, 24-hour storm for each acre of disturbed area
  - 3,600 cubic feet of storage per acre drained
- Sedimentation Basin
  - Not required (<10 acres disturbed)
  - Required (>10 acres) and implemented.
    - Calculated volume runoff from 2-year, 24-hour storm for each acre of disturbed area
    - 3,600 cubic feet of storage per acre drained
  - Required (>10 acres), but not feasible due to:
    - Available area/Site geometry
    - Site slope/Drainage patterns
    - Site soils/Geotechnical factors
    - Public safety
    - Other: \_\_\_\_\_

**2.3 PERMANENT CONTROLS:**

(Coordinate post-construction BMPs with appropriate TxDOT maintenance sections.)

BMPs To Be Left In Place Post Construction:

Type	Stationing	
	From	To

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

**2.4 OFFSITE VEHICLE TRACKING CONTROLS:**

- Excess dirt/mud on road removed daily
- Haul roads dampened for dust control
- Loaded haul trucks to be covered with tarpaulin
- Stabilized construction exit
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**2.5 POLLUTION PREVENTION MEASURES:**

- Chemical Management
- Concrete and Materials Waste Management
- Debris and Trash Management
- Dust Control
- Sanitary Facilities
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**2.6 VEGETATED BUFFER ZONES:**

Natural vegetated buffers shall be maintained as feasible to protect adjacent surface waters. If vegetated natural buffer zones are not feasible due to site geometry, the appropriate additional sediment control measures have been incorporated into this SWP3.

Type	Stationing	
	From	To

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

**2.7 ALLOWABLE NON-STORMWATER DISCHARGES:**

- Fire hydrant flushings
- Irrigation drainage
- Pavement washwater (where spills or leaks have not occurred, and detergents are not used)
- Potable water sources
- Springs
- Uncontaminated groundwater
- Water used to wash vehicles or control dust
- Other allowable non-stormwater discharges as allowed by TPDES GP TXR150000.

**2.8 INSPECTIONS:**

All disturbed areas and erosion and sediment control devices shall be inspected at least once every seven (7) days. Inspections shall be performed by TxDOT as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.5 of this SWP3 .

**2.9 MAINTENANCE:**

Control measures shall be properly installed according to specifications. If it is determined that a BMP or control measure is not operating effectively, maintenance must be accomplished as soon as possible and before the next anticipated rain event, but in no case later than 7 calendar days after being able to access the site. Maintenance shall be performed by the Contractor as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.5 of this SWP3.



**STORMWATER POLLUTION PREVENTION PLAN (SWP3)**

FED. RD. DIV. NO.	PROJECT NO.		SHEET NO.
6	BR 2022(281)		45
STATE	STATE DIST.	COUNTY	
TEXAS	BRY	MADISON	
CONT.	SECT.	JOB	HIGHWAY NO.
0917	31	031	CR

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

FILENAME: pw:\Project\Wise\AMER\jacobs.com\jacobs\_US\_B...SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\91731031\_Trinity\_SV700\_CADD\SHFT\ENV\0917-31-031\_TrinityTownBranch.draft\EPIC\_03172023.dgn

DATE: 2-12-2015  
 TIME: 4:17:31-031

**I. STORMWATER POLLUTION PREVENTION-CLEAN WATER ACT SECTION 402**

TPDES TXR 150000: Stormwater Discharge Permit or Construction General Permit required for projects with 1 or more acres disturbed soil. Projects with any disturbed soil must protect for erosion and sedimentation in accordance with Item 506.

List MS4 Operator(s) that may receive discharges from this project. They may need to be notified prior to construction activities.

- 
- No Action Required     Required Action

Action No.

- Prevent stormwater pollution by controlling erosion and sedimentation in accordance with TPDES Permit TXR 150000
- Comply with the SW3P and revise when necessary to control pollution or required by the Engineer.
- Post Construction Site Notice (CSN) with SW3P information on or near the site, accessible to the public and TCEQ, EPA or other inspectors.
- When Contractor project specific locations (PSL's) increase disturbed soil area to 5 acres or more, submit NOI to TCEQ and the Engineer.

**II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS CLEAN WATER ACT SECTIONS 401 AND 404**

USACE Permit required for filling, dredging, excavating or other work in any water bodies, rivers, creeks, streams, wetlands or wet areas.

The Contractor must adhere to all of the terms and conditions associated with the following permit(s):

- No Permit Required
- Nationwide Permit 14 - PCN not Required (less than 1/10th acre waters or wetlands affected)
- Nationwide Permit 14 - PCN Required (1/10 to <1/2 acre, 1/3 in tidal waters)
- Individual 404 Permit Required
- Other Nationwide Permit Required: NWP# \_\_\_\_\_

Required Actions: List waters of the US permit applies to, location in project and check Best Management Practices planned to control erosion, sedimentation and post-project TSS.

- Town Branch
- 
- 
- 

The elevation of the ordinary high water marks of any areas requiring work to be performed in the waters of the US requiring the use of a nationwide permit can be found on the Bridge Layouts.

**Best Management Practices:**

Erosion	Sedimentation	Post-Construction TSS
<input checked="" type="checkbox"/> Temporary Vegetation	<input checked="" type="checkbox"/> Silt Fence	<input type="checkbox"/> Vegetative Filter Strips
<input checked="" type="checkbox"/> Blankets/Matting	<input type="checkbox"/> Rock Berm	<input type="checkbox"/> Retention/Irrigation Systems
<input type="checkbox"/> Mulch	<input type="checkbox"/> Triangular Filter Dike	<input type="checkbox"/> Extended Detention Basin
<input type="checkbox"/> Sodding	<input type="checkbox"/> Sand Bag Berm	<input type="checkbox"/> Constructed Wetlands
<input type="checkbox"/> Interceptor Swale	<input type="checkbox"/> Straw Bale Dike	<input type="checkbox"/> Wet Basin
<input type="checkbox"/> Diversion Dike	<input type="checkbox"/> Brush Berms	<input type="checkbox"/> Erosion Control Compost
<input type="checkbox"/> Erosion Control Compost	<input type="checkbox"/> Erosion Control Compost	<input type="checkbox"/> Mulch Filter Berm and Socks
<input type="checkbox"/> Mulch Filter Berm and Socks	<input type="checkbox"/> Mulch Filter Berm and Socks	<input type="checkbox"/> Compost Filter Berm and Socks
<input type="checkbox"/> Compost Filter Berm and Socks	<input type="checkbox"/> Compost Filter Berm and Socks	<input type="checkbox"/> Vegetation Lined Ditches
	<input type="checkbox"/> Stone Outlet Sediment Traps	<input type="checkbox"/> Sand Filter Systems
	<input type="checkbox"/> Sediment Basins	<input checked="" type="checkbox"/> Grassy Swales

**III. CULTURAL RESOURCES**

Refer to TxDOT Standard Specifications in the event historical issues or archeological artifacts are found during construction. Upon discovery of archeological artifacts (bones, burnt rock, flint, pottery, etc.) cease work in the immediate area and contact the Engineer immediately.

- No Action Required     Required Action

Action No.

- 
- 
- 
- 

**IV. VEGETATION RESOURCES**

Preserve native vegetation to the extent practical. Contractor must adhere to Construction Specification Requirements Specs 162, 164, 192, 193, 506, 730, 751, 752 in order to comply with requirements for invasive species, beneficial landscaping, and tree/brush removal commitments.

- No Action Required     Required Action

Action No.

- Limit the clearing of vegetation and topsoil to only the areas needed to accomplish the project or activity.
- Re-vegetation of disturbed areas in compliance with Executive Order 13112 on Invasive Species and the Executive Memorandum on Beneficial Landscaping. Re-vegetation efforts would provide appropriate and sustainable cover to prevent erosion and siltation.

**V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRDS.**

- No Action Required     Required Action

Action No.

- BMPs for Federal and State Listed Species will be discussed at the preconstruction meeting.
- Migratory Birds - The contractor's attention is directed to the fact that there is the possibility that migratory birds may be nesting in any woody vegetation or existing structures within the project limits. The contractor shall remove all old migratory bird nests from any woody vegetation or structures between September 1 and March 1 while the nests are not occupied by a bird. In addition, the contractor must be prepared to prevent migratory birds from re-nesting between March 2 and August 31.

If any of the listed species are observed, cease work in the immediate area, do not disturb species or habitat and contact the Engineer immediately. The work may not remove active nests from bridges and other structures during nesting season of the birds associated with the nests. If caves or sinkholes are discovered, cease work in the immediate area, and contact the Engineer immediately.

**LIST OF ABBREVIATIONS**

BMP: Best Management Practice	SPCC: Spill Prevention Control and Countermeasure
CGP: Construction General Permit	SW3P: Storm Water Pollution Prevention Plan
DSHS: Texas Department of State Health Services	PCN: Pre-Construction Notification
FHWA: Federal Highway Administration	PSL: Project Specific Location
MOA: Memorandum of Agreement	TCEQ: Texas Commission on Environmental Quality
MOU: Memorandum of Understanding	TPDES: Texas Pollutant Discharge Elimination System
MS4: Municipal Separate Stormwater Sewer System	TPWD: Texas Parks and Wildlife Department
MBTA: Migratory Bird Treaty Act	TxDOT: Texas Department of Transportation
NOT: Notice of Termination	T&E: Threatened and Endangered Species
NWP: Nationwide Permit	USACE: U.S. Army Corps of Engineers
NOI: Notice of Intent	USFWS: U.S. Fish and Wildlife Service

**VI. HAZARDOUS MATERIALS OR CONTAMINATION ISSUES**

General (applies to all projects):

Comply with the Hazard Communication Act (the Act) for personnel who will be working with hazardous materials by conducting safety meetings prior to beginning construction and making workers aware of potential hazards in the workplace. Ensure that all workers are provided with personal protective equipment appropriate for any hazardous materials used. Obtain and keep on-site Material Safety Data Sheets (MSDS) for all hazardous products used on the project, which may include, but are not limited to the following categories: Paints, acids, solvents, asphalt products, chemical additives, fuels and concrete curing compounds or additives. Provide protected storage, off bare ground and covered, for products which may be hazardous. Maintain product labelling as required by the Act. Maintain an adequate supply of on-site spill response materials, as indicated in the MSDS. In the event of a spill, take actions to mitigate the spill as indicated in the MSDS, in accordance with safe work practices, and contact the District Spill Coordinator immediately. The Contractor shall be responsible for the proper containment and cleanup of all product spills.

Contact the Engineer if any of the following are detected:

- \* Dead or distressed vegetation (not identified as normal)
- \* Trash piles, drums, canister, barrels, etc.
- \* Undesirable smells or odors
- \* Evidence of leaching or seepage of substances

Does the project involve any bridge class structure rehabilitation or replacements (bridge class structures not including box culverts)?

- Yes     No

If "No", then no further action is required.

If "Yes", then TxDOT is responsible for completing asbestos assessment/inspection.

Are the results of the asbestos inspection positive (is asbestos

- Yes     No

If "Yes", then TxDOT must retain a DSHS licensed asbestos consultant to assist with the notification, develop abatement/mitigation procedures, and perform management activities as necessary. The notification form to DSHS must be postmarked at least 15 working days prior to scheduled demolition.

If "No", then TxDOT is still required to notify DSHS 15 working days prior to any scheduled demolition.

In either case, the Contractor is responsible for providing the date(s) for abatement activities and/or demolition with careful coordination between the Engineer and asbestos consultant in order to minimize construction delays and subsequent claims.

Any other evidence indicating possible hazardous materials or contamination discovered on site. Hazardous Materials or Contamination Issues Specific to this Project:

- No Action Required     Required Action

Action No.

- 
- 
- 

**VII. OTHER ENVIRONMENTAL ISSUES**

(includes regional issues such as Edwards Aquifer District, etc.)


- No Action Required     Required Action

Action No.

- 
- 
- 

PRINT DATE	REVISION DATE
3/20/2023	


**Jacobs** 2705 BEE CAVE RD, SUITE 300  
AUSTIN TX 78746  
FIRM REGISTRATION F-2966



**ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS (EPIC) TRINITY ST**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	46

REV DATE: 2-12-2015  
 CSJ: 0917-31-4031  
 FILENAME: p:\Project\Wise\AMER\jacobs.com\jacobs\_US\_B\_I\_SSA\Documents\WJXN4000\_BRY\_Bridge\_Program\WJXN4000g1731031\_Trinity\_SV700\_CADD\SHEDRNG\TrinitySt\_SW3P\_Layout\_Sheet.dgn

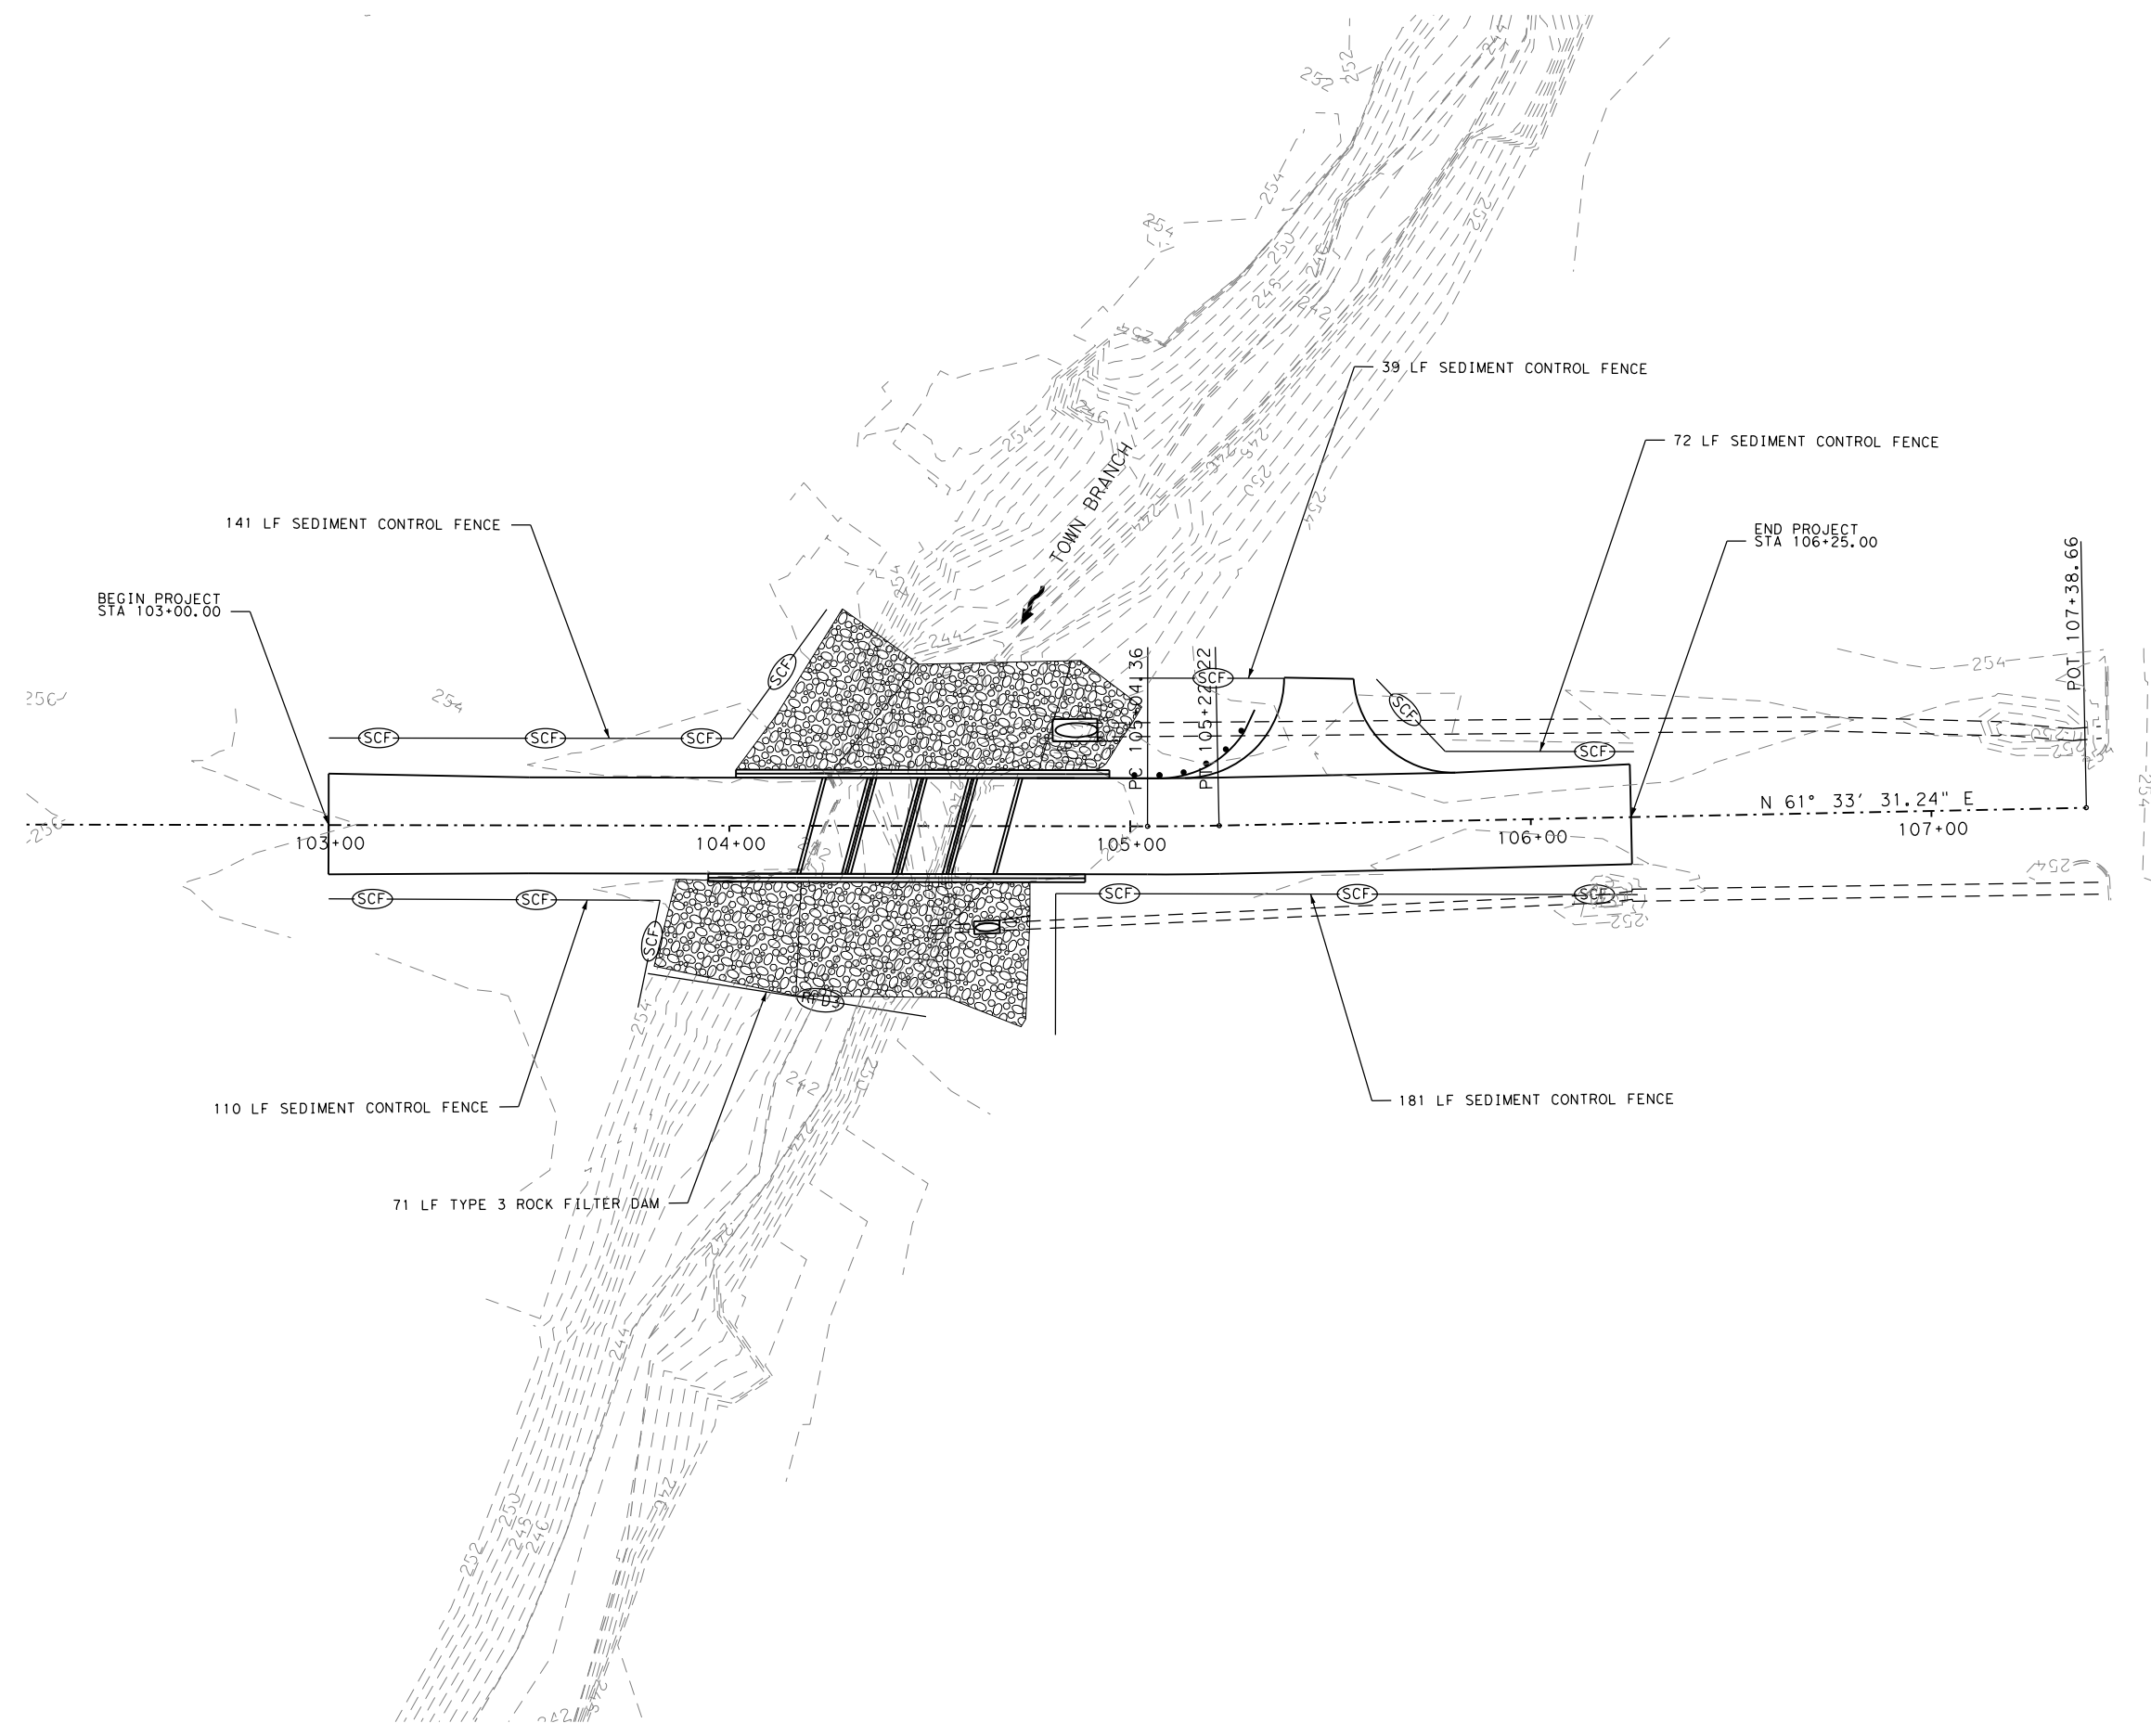

- LEGEND**
- DIRECTION OF FLOW
  - TYPE 2 ROCK FILTER DAM
  - TYPE 3 ROCK FILTER DAM
  - SEDIMENT CONTROL FENCE
  - EXIST CONTOUR

- NOTES:**
1. EROSION CONTROL DEVICE INSTALLATION, MAINTENANCE AND REMOVAL SHALL BE IN ACCORDANCE WITH TXDOT STANDARDS FOR EROSION CONTROL.
  2. EROSION CONTROL DEVICES SHALL BE INSTALLED PRIOR TO THE START OF ANY CONSTRUCTION ACTIVITY AND SHALL REMAIN IN PLACE UNTIL CONSTRUCTION IS COMPLETE.
  3. LOCATIONS OF EROSION CONTROL DEVICES ARE APPROXIMATIONS. ACTUAL LOCATIONS TO BE DETERMINED IN THE FIELD BY THE ENGINEER.
  4. OVERALL SW3P INSTALLATION SHALL FOLLOW TCP PHASING AND CONSTRUCTION SEQUENCE.



PRINT DATE	REVISION DATE
3/30/2023	

**Jacobs** 2705 BEE CAVE RD, SUITE 300  
 AUSTIN TX 78746  
 FIRM REGISTRATION F-2966




**SW3P LAYOUT**

FED. RD. DIV. NO.	PROJECT NUMBER	HIGHWAY NUMBER	
6	BR 2022(281)	CR	
STATE	DISTRICT	COUNTY	
TEXAS	BRY	MADISON	
CONTROL	SECTION	JOB	SHEET NO.
0917	31	031	47




DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 2/21/2023  
 FILE: p:\Project\WiseAMER\_jacobs.com\Jacobs\_US\_B\_I\_SS4\Document\WJXN4000\_BRY\_Bridge\_Program\WJXN4000\_91727046\_Four Notch RA\700 CADD\SH\DRNG\ec216.dgn

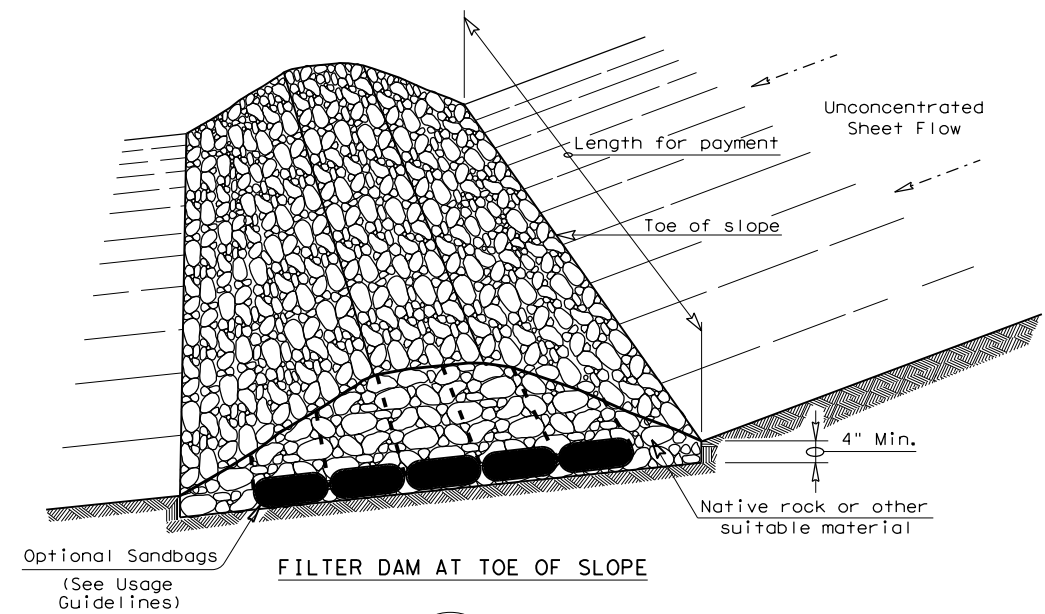


**FILTER DAM AT TOE OF SLOPE**


— (RFD1) —

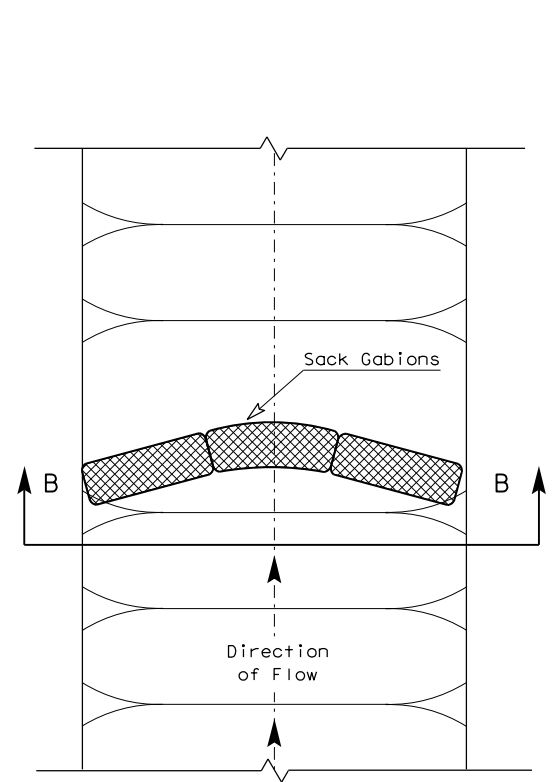


**PLAN VIEW**

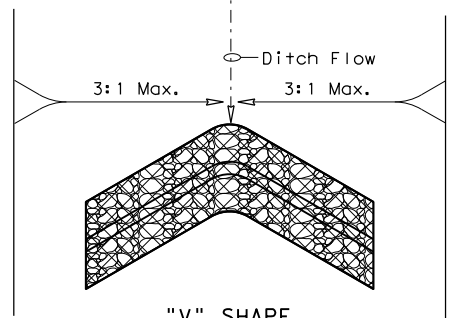

**"V" SHAPE PLAN VIEW**

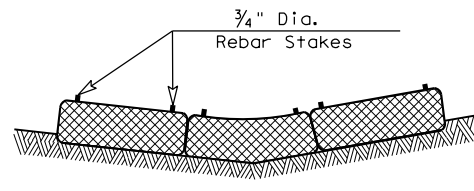


**SECTION B-B**

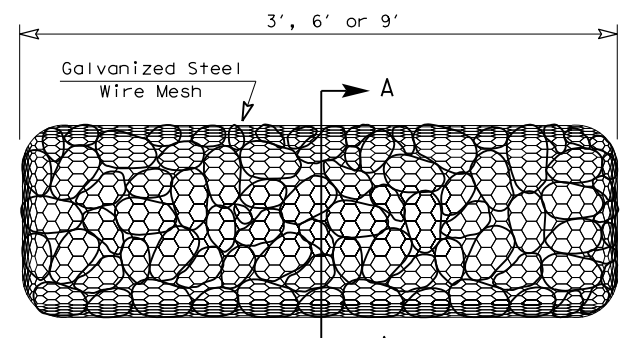


**TYPE 4 (SACK GABIONS)**

— (RFD4) —

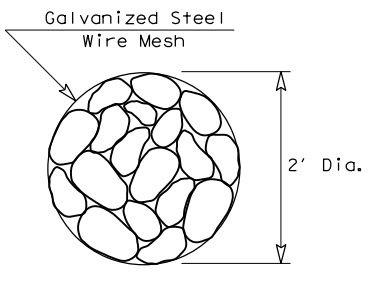


**SECTION A-A**

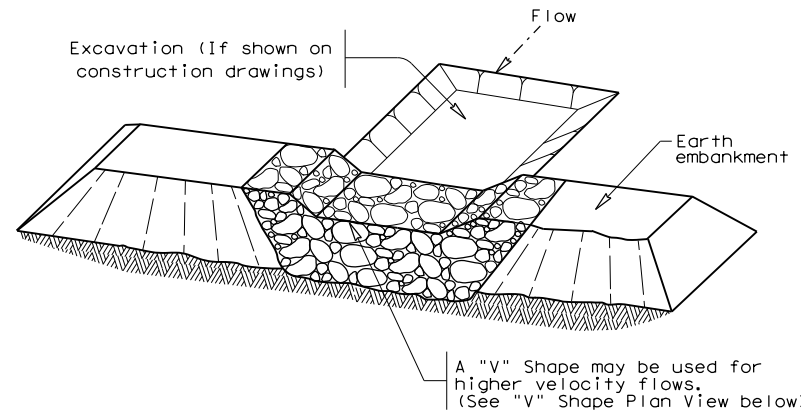


**FILTER DAM AT SEDIMENT TRAP**

— (RFD1) — OR — (RFD2) —

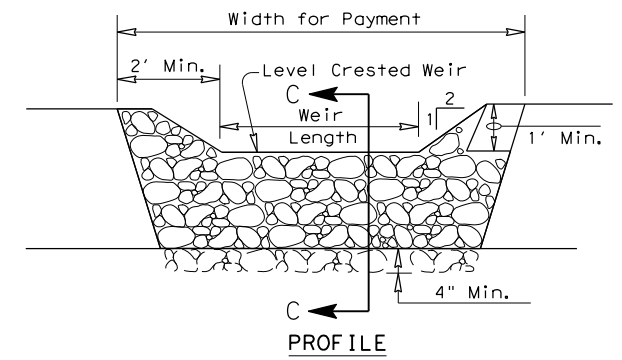

**PROFILE**

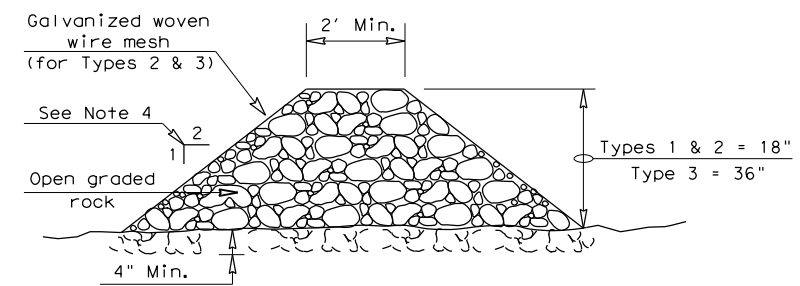

**SECTION C-C**

**ROCK FILTER DAM USAGE GUIDELINES**

Rock Filter Dams should be constructed downstream from disturbed areas to intercept sediment from overland runoff and/or concentrated flow. The dams should be sized to filter a maximum flow through rate of 60 GPM/FT<sup>2</sup> of cross sectional area. A 2 year storm frequency may be used to calculate the flow rate.


**Type 1 (18" high with no wire mesh) (3" to 6" aggregate):** Type 1 may be used at the toe of slopes, around inlets, in small ditches, and at dike or swale outlets. This type of dam is recommended to control erosion from a drainage area of 5 acres or less. Type 1 may not be used in concentrated high velocity flows (approximately 8 Ft/Sec or more) in which aggregate wash out may occur. Sandbags may be used at the embedded foundation (4" deep min.) for better filtering efficiency of low flows if called for on the plans or directed by the Engineer.

**Type 2 (18" high with wire mesh) (3" to 6" aggregate):** Type 2 may be used in ditches and at dike or swale outlets.

**Type 3 (36" high with wire mesh) (4" to 8" aggregate):** Type 3 may be used in stream flow and should be secured to the stream bed.

**Type 4 (Sack gabions) (3" to 6" aggregate):** Type 4 May be used in ditches and smaller channels to form an erosion control dam.

**Type 5:** Provide rock filter dams as shown on plans.

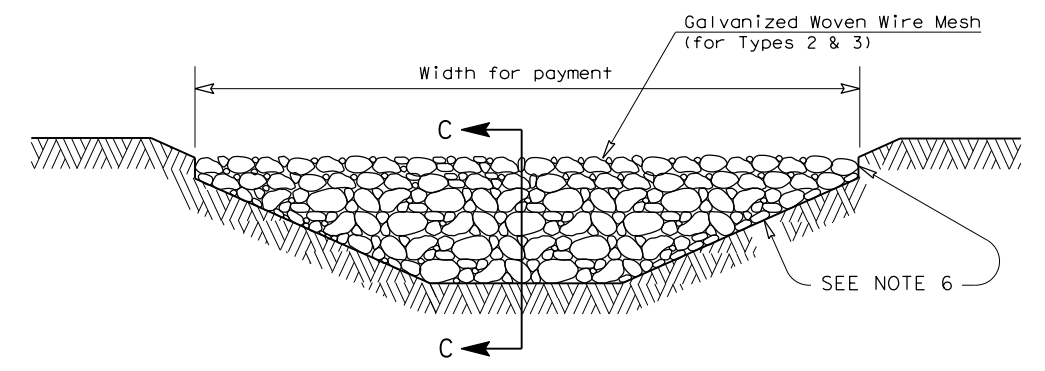

**FILTER DAM AT CHANNEL SECTIONS**

— (RFD1) — OR — (RFD2) — OR — (RFD3) —

**GENERAL NOTES**

1. If shown on the plans or directed by the Engineer, filter dams should be placed near the toe of slopes where erosion is anticipated, upstream and/or downstream at drainage structures, and in roadway ditches and channels to collect sediment.
2. Materials (aggregate, wire mesh, sandbags, etc.) shall be as indicated by the specification for "Rock Filter Dams for Erosion and Sedimentation Control".
3. The rock filter dam dimensions shall be as indicated on the SW3P plans.
4. Side slopes should be 2:1 or flatter. Dams within the safety zone shall have sideslopes of 6:1 or flatter.
5. Maintain a minimum of 1' between top of rock filter dam weir and top of embankment for filter dams at sediment traps.
6. Filter dams should be embedded a minimum of 4" into existing ground.
7. The sediment trap for ponding of sediment laden runoff shall be of the dimensions shown on the plans.
8. Rock filter dam types 2 & 3 shall be secured with 20 gauge galvanized woven wire mesh with 1" diameter hexagonal openings. The aggregate shall be placed on the mesh to the height & slopes specified. The mesh shall be folded at the upstream side over the aggregate and tightly secured to itself on the downstream side using wire ties or hog rings. For in stream use, the mesh should be secured or staked to the stream bed prior to aggregate placement.
9. Sack Gabions should be staked down with 3/4" dia. rebar stakes, and have a double-twisted hexagonal weave with a nominal mesh opening of 2 1/2" x 3 1/4".
10. Flow outlet should be onto a stabilized area (vegetation, rock, etc.).
11. The guidelines shown hereon are suggestions only and may be modified by the Engineer.

**PLAN SHEET LEGEND**

- Type 1 Rock Filter Dam — (RFD1) —
- Type 2 Rock Filter Dam — (RFD2) —
- Type 3 Rock Filter Dam — (RFD3) —
- Type 4 Rock Filter Dam — (RFD4) —

		<b>Design Division Standard</b>	
<b>TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES</b> <b>ROCK FILTER DAMS</b> <b>EC (2) - 16</b>			
FILE: ec216	DN: TxDOT	CK: TxDOT	DW: TxDOT
© TxDOT: JULY 2016	CONTRACT: 0917 31	JOB: 031	HIGHWAY: CR
REVISIONS	DIST: BRY	COUNTY: MADISON	SHEET NO.: 49