

FED. RD. DIST. NO.	PROJECT NO.	SHEET NO.
6	F 2024(579), ETC	1
STATE	STATE DIST.	COUNTY
TEXAS	YKM	VICTORIA, ETC
COUNT.	SECT.	JOB
0088	05	110, ETC US 59, ETC

SEE SHEET 2 FOR "INDEX OF SHEETS"

CONTRACTOR: _____
DATE OF LETTING: _____
DATE WORK BEGAN: _____
DATE WORK COMPLETED: _____
DATE WORK ACCEPTED: _____
FINAL CONTRACT COST: \$ _____

LIST OF APPROVED FIELD CHANGES:

STATE OF TEXAS

TEXAS DEPARTMENT OF TRANSPORTATION

PLANS OF PROPOSED STATE HIGHWAY IMPROVEMENT

FOR THE CONSTRUCTION OF A HIGHWAY SAFETY IMPROVEMENT PROJECT

CONSISTING OF INSTALL ILLUMINATION

HWY US 59, ETC



VICTORIA COUNTY, ETC

CSJ: 0088-05-110, ETC

PROJECT NO.: F 2024(579), ETC

LIMITS: VARIOUS INTERSECTIONS

HWY FUNCTIONAL CLASS: (SEE STATEWIDE PLANNING MAP)
DESIGN SPEED: N/A
ADT: N/A

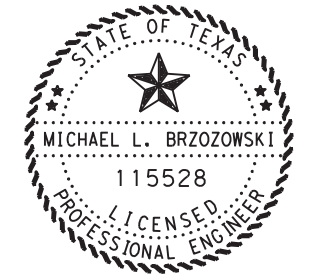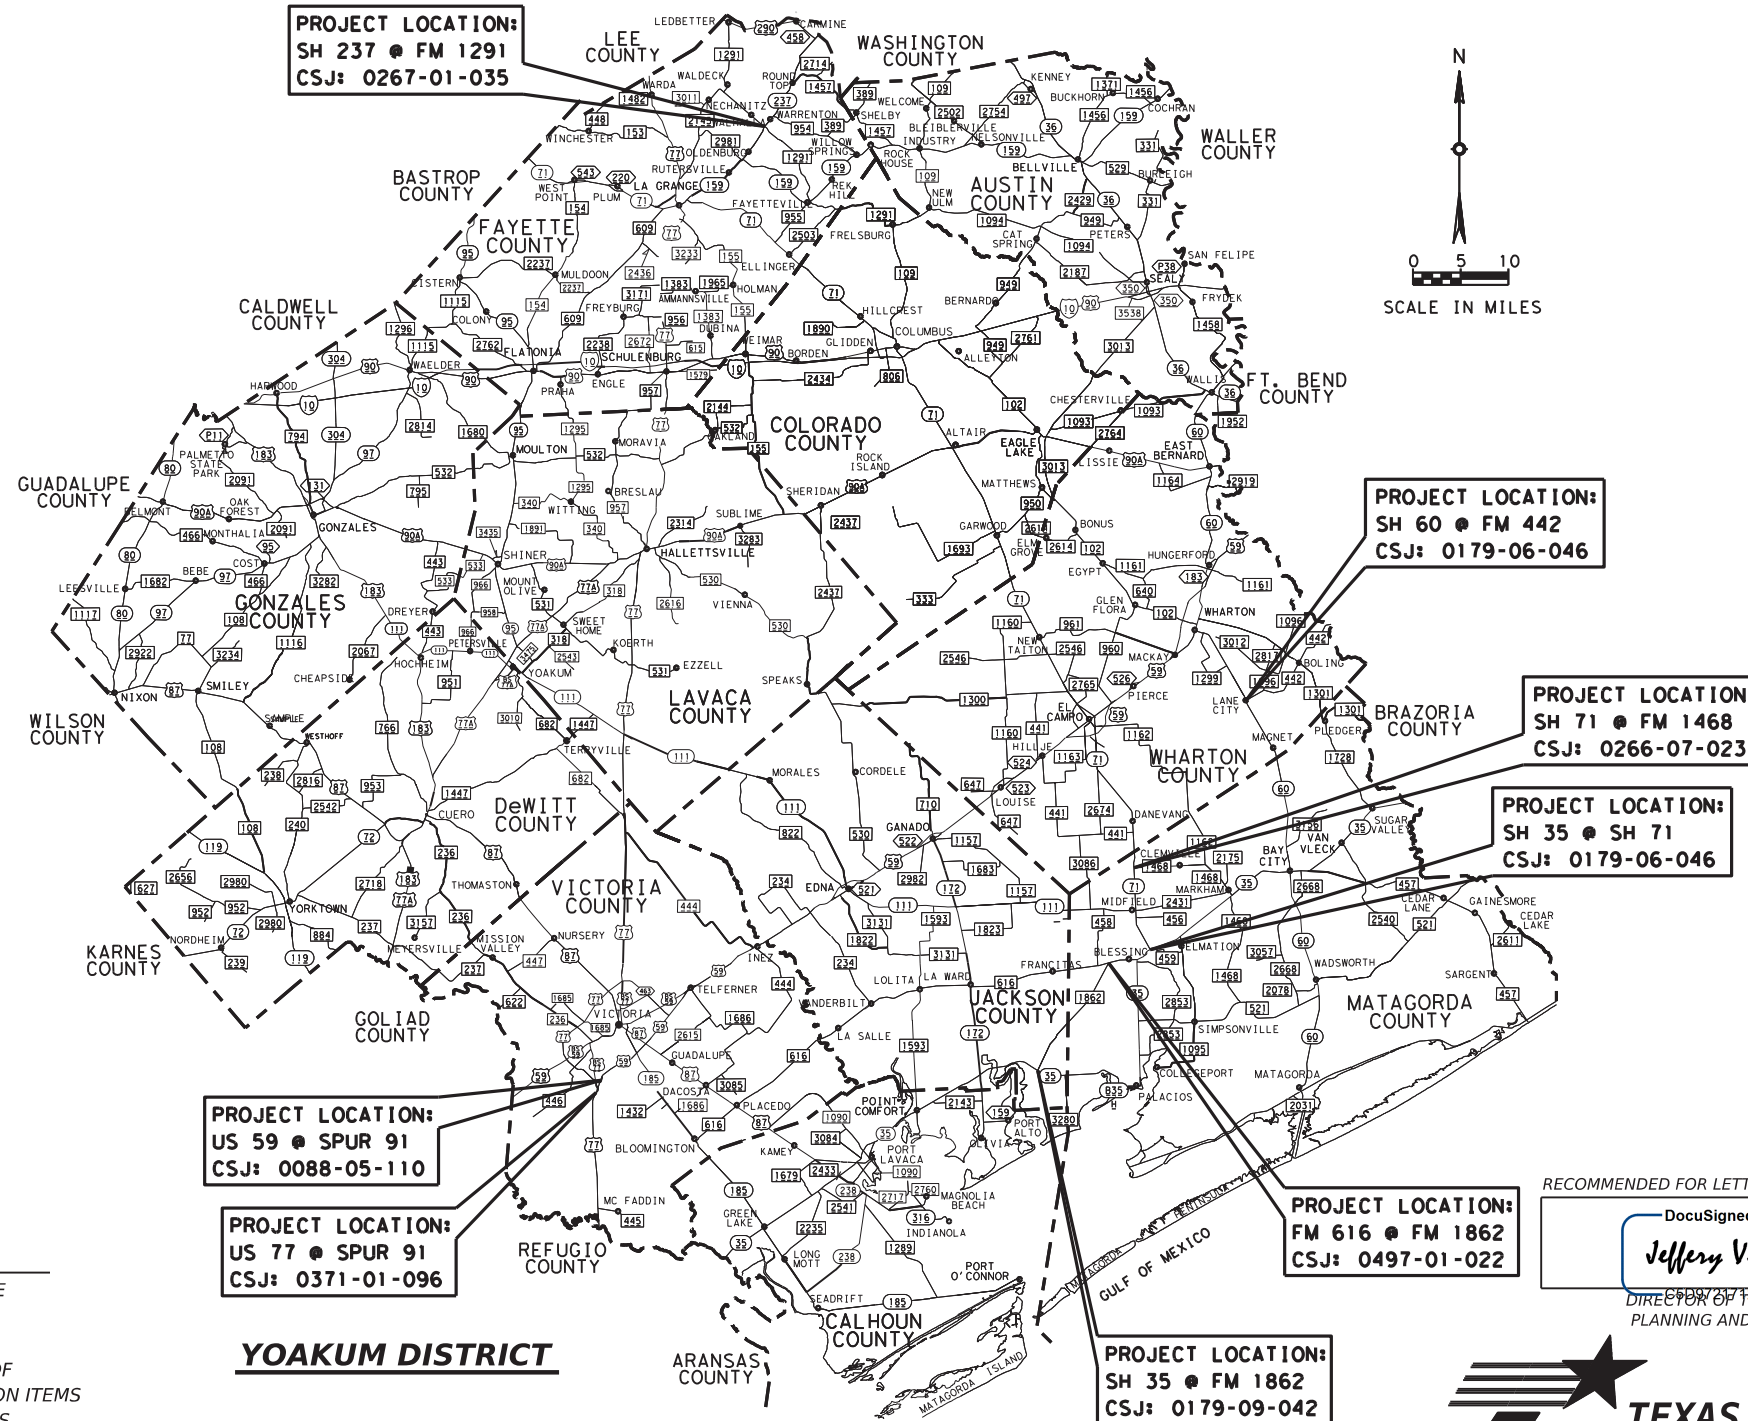

SUBMITTED FOR LETTING **10-31-23**

Michael Brzozowski
DIRECTOR OF OPERATIONS

APPROVED FOR LETTING **11/3/2023**

DocuSigned by:
Martin C. Horst PE

THIS IS TO CERTIFY THAT THE CONSTRUCTION WORK WAS PERFORMED IN ACCORDANCE WITH THE PLANS, CONTRACT AND LISTED FIELD CHANGES.

_____, P. E. _____ DATE _____

SPECIFICATIONS ADOPTED BY THE TEXAS DEPARTMENT OF TRANSPORTATION, NOVEMBER 1, 2014 AND SPECIFICATION ITEMS LISTED AND DATED AS FOLLOWS, SHALL GOVERN ON THIS PROJECT: REQUIRED CONTRACT PROVISIONS FOR ALL FEDERAL AID CONSTRUCTION CONTRACTS (FORM FHWA 1273, OCTOBER 2023).

EQUATIONS: NONE
EXCEPTIONS: NONE
RAILROAD CROSSINGS: SEE RAILROAD SCOPE OF WORK

YOAKUM DISTRICT



TEXAS DEPARTMENT OF TRANSPORTATION
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

SHEET
NO. DESCRIPTION

GENERAL

1	TITLE SHEET
2	INDEX OF SHEETS
3-6	GENERAL NOTES
7-8	ESTIMATE & QUANTITY SHEET
9-10	US 59 @ SPUR 91 ILLUMINATION LAYOUT & SUMMARIES
11	SH 35 @ SH 71 ILLUMINATION LAYOUT & SUMMARIES
12	SH 35 @ FM 1862 ILLUMINATION LAYOUT & SUMMARIES
13	SH 60 @ FM 442 ILLUMINATION LAYOUT & SUMMARIES
14	SH 71 @ FM 1468 ILLUMINATION LAYOUT & SUMMARIES
15	SH 237 @ FM 1291 ILLUMINATION LAYOUT & SUMMARIES
16-17	US 77 @ SPUR 91 ILLUMINATION LAYOUT & SUMMARIES
18	FM 616 @ FM 1862 ILLUMINATION LAYOUT & SUMMARIES
19	ELECTRICAL SERVICE DATA SHEET

TRAFFIC CONTROL

STANDARD SHEETS

20-31	BC(1-12)-21
32	TCP(2-1)-18
33	TCP(2-2)-18
34	TCP(2-6)-18
35	TCP(5-1)-18
36	TCP(6-1)-12
37	TCP(6-2)-12
38	TCP(6-3)-12
39	TCP(6-4)-12
40	TCP(6-5)-12
41	WZ(RS)-22

ROADWAY

42	SH 35 @ SH 71 MBGF LAYOUT & SUMMARY
----	-------------------------------------

STANDARD SHEETS

43	GF(31)-19
44	SGT(12S)31-18
45	SGT(15)31-20

TRAFFIC

STANDARD SHEETS

46	SMD(GEN)-08
47	ED(1)-14
48	ED(3)-14
49	ED(4)-14
50	ED(5)-14
51	ED(6)-14
52	ED(7)-14
53	RID(1)-20
54	RID(2)-20
55	RIP(1)-19
56	RIP(2)-19
57	RIP(3)-19
58	RIP(4)-19
59	RFBA-13
60-68	HMD(1-9)-03
69-70	HMIP(1-2)-16
71-72	HMIF(1-2)-98

ENVIRONMENTAL

73	ENVIRONMENTAL PERMITS, ISSUES & COMMITMENTS
----	---

RAILROAD

74	RAILROAD SCOPE OF WORK
----	------------------------



THE STANDARD SHEETS SPECIFICALLY IDENTIFIED ABOVE HAVE BEEN SELECTED BY ME OR UNDER MY RESPONSIBLE SUPERVISION AS BEING APPLICABLE TO THIS PROJECT.

Kathryn C. Marek, P.E.
October 6, 2023

INDEX OF SHEETS



FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	2

GENERAL NOTES:

GENERAL:

Contractor questions on this project are to be addressed to the following individual(s):

Clayton Harris Clayton.Harris@txdot.gov
James Janak James.Janak@txdot.gov

Contractor questions will be accepted through email, phone, and in person by the above individuals.

Questions may be submitted via the Letting Pre-Bid Q&A web page. This webpage can be accessed from the Notice to Contractors dashboard located at the following Address: <https://tableau.txdot.gov/views/ProjectInformationDashboard/NoticetoContractors>

All contractor questions will be reviewed by the Engineer. All questions and any corresponding responses that are generated will be posted through the same Letting Pre-Bid Q&A web page.

The Letting Pre-Bid Q&A web page for each project can be accessed by using the dashboard to navigate to the project you are interested in by scrolling or filtering the dashboard using the controls on the left. Hover over the blue hyperlink for the project you want to view the Q&A for and click on the link in the window that pops up.

All questions submitted that generate a response will be posted through this site. The site is organized by District, Project Type (Construction or Maintenance), Letting Date, CCSJ/Project Name.

I. UNION PACIFIC RAILROAD COMPANY

PROTECTION OF FIBER OPTIC CABLE SYSTEMS

Fiber optic cable systems may be buried on the railroad's property. Protection of the fiber optic cable systems is of extreme importance since any break could disrupt service to users resulting in business interruption and loss of revenue and profits. The state and/or its contractor shall telephone the railroad during normal business hours (7:00 a.m. to 9:00 p.m., central time, Monday through Friday, except holidays) at 1-800-336-9193 (also a 24-hour, seven-day number for emergency calls) to determine if fiber optic cable is buried on the railroad's premises to be used by the state. If it is, the state and/or its contractor will telephone the telecommunications company(ies) involved, arrange for a cable locator and make arrangements for relocation or other protection of the fiber optic cable prior to beginning any work on the railroad's premises.

Do not work on the roadway before sunrise or after sunset unless otherwise approved.

Leave all traffic lanes open to traffic at night, weekends and holidays unless otherwise approved.

Do not work on Fridays on US 59, Spur 91 and US 77, unless otherwise approved.

Lane closures on SH 159 and SH 237 will not be allowed during four consecutive weeks in the fall and four consecutive weeks in the spring during the Round Top Antique Fair.

Furnish a certified copy of the legal gross weight of each vehicle hauling materials by weight and certified measurements for all trucks hauling material by volume.

Do not cross the median except at existing crossovers.

Unless otherwise approved, maintain a minimum safety clearance from the edge of the travelway for material stockpiled in proximity of traffic lanes based on the current average traffic count of the particular highway as follows:

0 - 1500 = 16 feet
Over 1500 = 30 feet

In the event the above requirements cannot be met, make arrangements to stockpile material off the right of way.

Do not store equipment or stockpile material in the median overnight unless otherwise approved.

The Department will provide the cylinder testing machine for this project. Deliver the test specimens to the engineer's curing facilities as directed.

Do not clean out concrete trucks within the right of way.

The contractor's attention is directed to the overhead powerline near the project location. Prior to the pre-construction meeting, the contractor is required to initiate and conduct a coordination meeting with the Engineer and the power company representative(s) listed below. Construction clearance limitations, de-energization options, and advanced notice requirements will need to be determined and agreed upon prior to starting any work on the project.

ITEM 6: CONTROL OF MATERIALS

To comply with the latest provisions of Build America, Buy America Act (BABA Act) of the Bipartisan Infrastructure Law, the contractor must submit an original of the TxDOT Construction Material Buy America Certification Form for all items classified as construction materials. This form is not required for materials classified as a manufactured product.

Refer to the Buy America Material Classification Sheet for clarification on material categorization.

The Buy America Material Classification Sheet is located at the below link.

<https://www.txdot.gov/business/resources/materials/buy-america-material-classification-sheet.html> for clarification on material categorization.

ITEM 7: LEGAL RELATIONS AND RESPONSIBILITIES

The Department has determined that a USACE Nationwide or Individual Permit is not necessary for the project since all work shall be conducted outside the USACE jurisdictional areas. Any impacts to these jurisdictional areas by the Contractor without a USACE permit will be the responsibility of the Contractor. If the Contractor deems it necessary to impact the USACE jurisdictional areas, then it becomes the Contractor’s entire responsibility to consult with the USACE pertaining to the need for a Nationwide or Individual Permit. TXDOT will then hold the Contractor responsible for following all conditions of the approved permit.

No significant traffic generator events identified.

ITEM 8: PROSECUTION AND PROGRESS

Provide progress schedule as a Bar Chart.

ITEM 132: EMBANKMENT

Furnish Type C embankment consisting of suitable earth material such as loam, clay or other such material that will form a stable embankment and has a plasticity index of at least 15 but not more than 40.

ITEM 247: FLEXIBLE BASE

Unless otherwise approved, the delivered material’s moisture content at most will be two percent above optimum moisture content, determined by TEX-113-E.

For Type E material, furnish crushed limestone produced and graded from oversize quarried aggregate that originates from a single, naturally occurring source. Do not use caliche, iron ore, gravel, or multiple sources.

Compact the Type E flex base by ordinary compaction.

ITEM 502: BARRICADES, SIGNS, AND TRAFFIC HANDLING

The Contractor Force Account “Safety Contingency” that has been established for this project is intended to be utilized for work zone enhancements, to improve the effectiveness of the Traffic Control Plan, that could not be foreseen in the project planning and design stage. These enhancements will be mutually agreed upon by the Engineer and the Contractor’s Responsible Person based on weekly or more frequent traffic management reviews on the project. The Engineer may choose to use existing bid items if it does not slow the implementation of enhancement.

Law enforcement assistance for this project will be required, as approved, for major traffic control changes and lane closures. Coordinate with local law enforcement and arrange for law enforcement in a marked vehicle as approved by the Engineer. Complete the daily tracking form provided by the department, including all signatures, and submit invoices that agree with the tracking form for payment at the end of each month approved services were provided.

Use WZ(RS)-22 in conjunction with TCP(2-2) and TCP 6 Series

Use TCP 6 Series on US 59, US 77 and Spur 91.

Use TCP(2-2b) for one-lane, two-way traffic control.

When using TCP(2-2b), a pilot car is required to lead traffic through the work space with or without channelizing devices on the center line unless otherwise approved.

When using TCP(2-2b), channelizing devices may be omitted during base, subgrade and seal coat operations unless otherwise directed. Flaggers will be required at public intersections when channelizing devices are omitted.

County: VICTORIA, ETC

Control: 0088-05-110, ETC

Highway: US 59, ETC

When using TCP(2-2b), arrow boards, displaying the caution mode, may be used to enhance the flagger stations. If used, place the arrow board in advance of the flagger station a distance of $\frac{1}{2}X$, the sign spacing distance shown on BC(2). Use arrow boards as shown on BC(7).

When using TCP(2-2b), the temporary 24" stop line and the CW16-2P plaques may be omitted.

When using TCP(2-2b), an additional "Road Work Ahead" and "Be Prepared To Stop" signs will be required on each end of the lane closure unless otherwise approved.

When using TCP(6-8), the PCMS will be required unless otherwise approved. The PCMS required by TCP(6-8) will be paid for under Item 6001.

Provide suitable warning lights mounted high enough to be visible from all directions on all construction equipment, including pilot vehicles, and operate warning lights when the equipment is within the right of way. Equip other equipment such as trucks, trailers, autos, etc., with emergency flashers and use emergency flashers while within the work area.

ITEM 506: TEMPORARY EROSION, SEDIMENTATION, AND ENVIRONMENTAL CONTROLS

The storm water pollution prevention plan (SW3P) for this project will consist of utilizing existing vegetation. The disturbed area is less than one acre and use of erosion control measures is not anticipated. If physical conditions encountered at the job site require necessary controls, BMP installation, maintenance, and removal will be paid as extra work on a force account basis per Articles 4.4 and 9.7.

ITEM 540: METAL BEAM GUARD FENCE

Furnish and install only one type of timber post at each location.

Furnish Type II rail elements at all locations.

ITEMS 540 & 544: METAL BEAM GUARD FENCE AND GUARDRAIL END TREATMENTS

No exposed bridge rail ends or guard fence ends will be allowed after normal working hours. Complete all work at each location during the normal working day.

County: VICTORIA, ETC

Control: 0088-05-110, ETC

Highway: US 59, ETC

ITEM 610: ROADWAY ILLUMINATION ASSEMBLIES

Stencil the circuit and pole number, as shown on plans, on each luminaire pole with 2" black lettering.

Prior to drilling drilled shaft foundations, stake proposed foundation location for approval by the engineer. The preferred offset from the edge of the travel lane is 15-ft and the slope requirement is 6:1 or flatter as shown on RID(2). After reviewing the staked location, the engineer may adjust to meet slope requirements. This work will be considered subsidiary to Item 416.

ITEM 618: CONDUIT

Provide as-built or certified as-installed plans, including GPS coordinates, for all conduit to establish the locations, vertical elevations, and horizontal alignments based on the department's survey datum. The plans shall also show the relationship to existing highway facilities and the right of way line. Submit to the engineer on an 11x17 inch scaled plan sheet.

Where PVC, duct cable, and HDPE conduit 1" and larger is allowed and installed as per TXDOT standards, provide a PVC elbow in place of the galvanized rigid metal elbow required by the Electrical Detail standards. Ensure the PVC elbow is of the same schedule rating as the conduit to which it is connected. Ensure only a flat, high tensile strength polyester fiber pull tape is used for pulling conductors through the PVC conduit system.

All conduit elbows and rigid metal extensions required when installing PVC conduit systems, are subsidiary to the various bid items.

Repair any pavement damaged by the boring operations. Repair method shall be as approved by the Engineer. This will be considered subsidiary to this item.

Conduit bore pits a minimum of five feet from the edge of the base or pavement. Close the bore pit holes during non-working hours. Consider payment for bored conduit as the width of the roadway plus five (5) feet on each side of roadway.

Unless shown otherwise on the plans, install the underground conduit a minimum of 24 in. deep. Place conduit under driveway or roadways a minimum of 24 in. below the pavement surface.

If using casing to place bored conduit, consider the casing incidental to the conduit. Prior to backfilling conduit trenches, place a detachable underground metalized mylar marking tape above the conduit and concrete encasement. Ensure the marking tape extends continuously into the ground box at each end of all conduit runs. Consider the supplying and installation of the marking tape incidental to the various bid items.

When backfilling bore pits, ensure that the conduit is not damaged during installation or due to settling backfill material. Compact select backfill in three equal lifts to the bottom of the conduit, or if using sand, place it in 2 in. above the conduit. Ensure backfill density is equal to that of the existing soil. Prevent material from entering the conduit.

ITEM 685: ROADSIDE FLASHING BEACON ASSEMBLIES

Use screw-in type anchor foundation.

Salvage and deliver existing poles to 403 Huck, Yoakum, Texas, 77995.

Operate the completed flashing beacon assembly for at least 10 days in a satisfactory manner. If any Contractor furnished equipment fails during the 10 day test period, repair or replace that equipment. This repair or replacement will start a new 10 day test period.

ITEM 6001: PORTABLE CHANGEABLE MESSAGE SIGN

Provide Portable Changeable Message Signs (PCMS) for the duration of the project. Locations and messages or other miscellaneous uses of PCMS, shall be as approved or directed by the Engineer. These are in addition to the PCMS required by TCP(6-1). The PCMS required by TCP(6-1) are subsidiary to Item 502.

ITEM 6185: TRUCK MOUNTED ATTENUATOR (TMA) AND TRAILER ATTENUATOR (TA)

Shadow vehicle(s) with TMA are set up for stationary and/or mobile operations. The contractor will be responsible for determining if operations will be ongoing at the same time to determine the total number of TMAs needed for the project.

The TMA/TA used for installation/removal of traffic control for a work area will be subsidiary to the TMA/TA used to perform the work.



Estimate & Quantity Sheet

CONTROLLING PROJECT ID 0088-05-110

DISTRICT Yoakum
HIGHWAY FM 616, SH 237, SH 35, SH 60, SH 71, US 59, US 77

COUNTY Fayette, Jackson, Matagorda, Victoria, Wharton

CONTROL SECTION JOB				0088-05-110		0179-06-046		0179-09-042		0241-01-051		0266-07-023		0267-01-035	
PROJECT ID				A00190597		A00190585		A00190601		A00190587		A00190581		A00190589	
COUNTY				Victoria		Matagorda		Jackson		Wharton		Matagorda		Fayette	
HIGHWAY				US 59		SH 35		SH 35		SH 60		SH 71		SH 237	
ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL	EST.	FINAL	EST.	FINAL	EST.	FINAL	EST.	FINAL	EST.	FINAL
	132-6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY					50.000		20.000		20.000		80.000	
	247-6057	FL BS (CMP IN PLC)(TYE GR1-2)(FNAL POS)	CY					40.000							
	416-6026	DRILL SHAFT (HIGH MAST POLE) (60 IN)	LF	138.000		46.000		92.000							
	416-6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	LF							20.000		30.000		40.000	
	432-6006	RIPRAP (CONC)(CL B)	CY	7.700		2.600		5.100		0.700		1.050		1.400	
	500-6001	MOBILIZATION	LS	1.000											
	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	MO	5.000											
	540-6001	MTL W-BEAM GD FEN (TIM POST)	LF					350.000							
	544-6001	GUARDRAIL END TREATMENT (INSTALL)	EA					2.000							
	610-6216	IN RD IL (TY SA) 40T-10 (250W EQ) LED	EA							1.000					
	610-6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA							1.000		3.000		4.000	
	613-6006	HI MST IL POLE (150 FT)(100 MPH)	EA	3.000		1.000		2.000							
	614-6007	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	EA	3.000		1.000		2.000							
	618-6023	CONDT (PVC) (SCH 40) (2")	LF	1,727.000		125.000		2,160.000		803.000		334.000		665.000	
	618-6047	CONDT (PVC) (SCH 80) (2") (BORE)	LF	291.000		55.000		400.000		318.000		75.000		170.000	
	620-6007	ELEC CONDR (NO.8) BARE	LF	2,018.000		180.000		2,620.000		1,121.000		409.000		835.000	
	620-6008	ELEC CONDR (NO.8) INSULATED	LF	4,316.000		360.000		2,720.000		996.000		704.000		2,860.000	
	624-6002	GROUND BOX TY A (122311)W/APRON	EA	8.000		2.000		9.000		14.000		2.000		4.000	
	628-6002	REMOVE ELECTRICAL SERVICES	EA									1.000			
	628-6009	ELC SRV TY A 120/240 060(NS)SS(E)SP(O)	EA					1.000						1.000	
	628-6045	ELC SRV TY A 240/480 060(NS)SS(E)SP(O)	EA	1.000		1.000									
	628-6145	ELC SRV TY D 120/240 060(NS)SS(E)SP(O)	EA					1.000		1.000		1.000			
	636-6001	ALUMINUM SIGNS (TY A)	SF					32.000		32.000		16.000			
	684-6002	TRF SIG CBL (TY A)(10 AWG)(3 CONDR)	LF					1,550.000		835.000		57.000			
	685-6001	INSTALL RDS FLASH BEACON ASSEMBLY	EA					2.000		2.000		1.000			
	685-6006	REMOV RDS FLSH BCN AM (SOLAR PWRD)	EA					2.000		2.000					
	6001-6002	PORTABLE CHANGEABLE MESSAGE SIGN	EA	2.000											
	6185-6002	TMA (STATIONARY)	DAY	6.000		3.000		3.000		3.000		3.000		3.000	
18		LAW ENFORCEMENT: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS	1.000											
		SAFETY CONTINGENCY: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS	1.000											
		EROSION CONTROL MAINTENANCE: CONTRACTOR FORCE ACCOUNT WORK (PART)	LS	1.000											



Estimate & Quantity Sheet

CONTROLLING PROJECT ID 0088-05-110

DISTRICT Yoakum
HIGHWAY FM 616, SH 237, SH 35, SH 60, SH 71, US 59, US 77

COUNTY Fayette, Jackson, Matagorda, Victoria, Wharton

CONTROL SECTION JOB				0371-01-096		0497-01-022		TOTAL EST.	TOTAL FINAL
PROJECT ID				A00197683		A00190582			
COUNTY				Victoria		Matagorda			
HIGHWAY				US 77		FM 616			
ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL	EST.	FINAL		
	132-6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	20.000		60.000		250.000	
	247-6057	FL BS (CMP IN PLC)(TYE GR1-2)(FNAL POS)	CY					40.000	
	416-6026	DRILL SHAFT (HIGH MAST POLE) (60 IN)	LF					276.000	
	416-6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	LF	60.000		30.000		180.000	
	432-6006	RIPRAP (CONC)(CL B)	CY	2.100		1.050		21.700	
	500-6001	MOBILIZATION	LS					1.000	
	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	MO					5.000	
	540-6001	MTL W-BEAM GD FEN (TIM POST)	LF					350.000	
	544-6001	GUARDRAIL END TREATMENT (INSTALL)	EA					2.000	
	610-6216	IN RD IL (TY SA) 40T-10 (250W EQ) LED	EA					1.000	
	610-6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	6.000		3.000		17.000	
	613-6006	HI MST IL POLE (150 FT)(100 MPH)	EA					6.000	
	614-6007	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	EA					6.000	
	618-6023	CONDT (PVC) (SCH 40) (2")	LF	1,961.000		1,406.000		9,181.000	
	618-6047	CONDT (PVC) (SCH 80) (2") (BORE)	LF	266.000		219.000		1,794.000	
	620-6007	ELEC CONDR (NO.8) BARE	LF	2,227.000		1,625.000		11,035.000	
	620-6008	ELEC CONDR (NO.8) INSULATED	LF	4,820.000		808.000		17,584.000	
	624-6002	GROUND BOX TY A (122311)W/APRON	EA	4.000		6.000		49.000	
	628-6002	REMOVE ELECTRICAL SERVICES	EA					1.000	
	628-6009	ELC SRV TY A 120/240 060(NS)SS(E)SP(O)	EA	1.000				3.000	
	628-6045	ELC SRV TY A 240/480 060(NS)SS(E)SP(O)	EA					2.000	
	628-6145	ELC SRV TY D 120/240 060(NS)SS(E)SP(O)	EA			1.000		4.000	
	636-6001	ALUMINUM SIGNS (TY A)	SF			32.000		112.000	
	684-6002	TRF SIG CBL (TY A)(10 AWG)(3 CONDR)	LF			1,386.000		3,828.000	
	685-6001	INSTALL RDSB FLASH BEACON ASSEMBLY	EA			2.000		7.000	
	685-6006	REMOV RDSB FLSH BCN AM (SOLAR PWRD)	EA			2.000		6.000	
	6001-6002	PORTABLE CHANGEABLE MESSAGE SIGN	EA					2.000	
	6185-6002	TMA (STATIONARY)	DAY	6.000		3.000		30.000	
18		LAW ENFORCEMENT: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS					1.000	
		SAFETY CONTINGENCY: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS					1.000	
		EROSION CONTROL MAINTENANCE: CONTRACTOR FORCE ACCOUNT WORK (PART)	LS					1.000	

SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
0416 6026	DRILL SHAFT (HIGH MAST POLE) (60 IN)	LF	92
0432 6006	RIPRAP CONC(CL B)	CY	5.1
0613 6006	HI MST IL POLE (150 FT)(100 MPH)	EA	2
0614 6007	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	EA	2
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	4
0628 6045	ELC SRV TY A 240/480 060(NS)SS(E)SP(O)	EA	1
6001 6002	PORTABLE CHANGEABLE MESSAGE SIGN	EA	1
6185 6002	TMA (STATIONARY)	DAY	3


CONDUIT AND CONDUCTOR RUNS

RUN NO.	LENGTH OF RUN	618				620			
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)			
		TRENCH		BORE		BARE		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR
LF	LF	LF	LF	LF	LF	LF	LF		
1	30	1	30			1	30	6	180
2	40			1	40	1	40	6	240
3	32	1	32			1	32	2	64
4	390	1	390			1	390	2	780
5	440	1	440			1	440	2	880
6	195	1	195			1	195	2	390
7	141			1	141	1	141	2	282
8	115	1	115			1	115	2	230
TOTALS			1202		181		1383		3046



LEGEND

- HIGH MAST ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

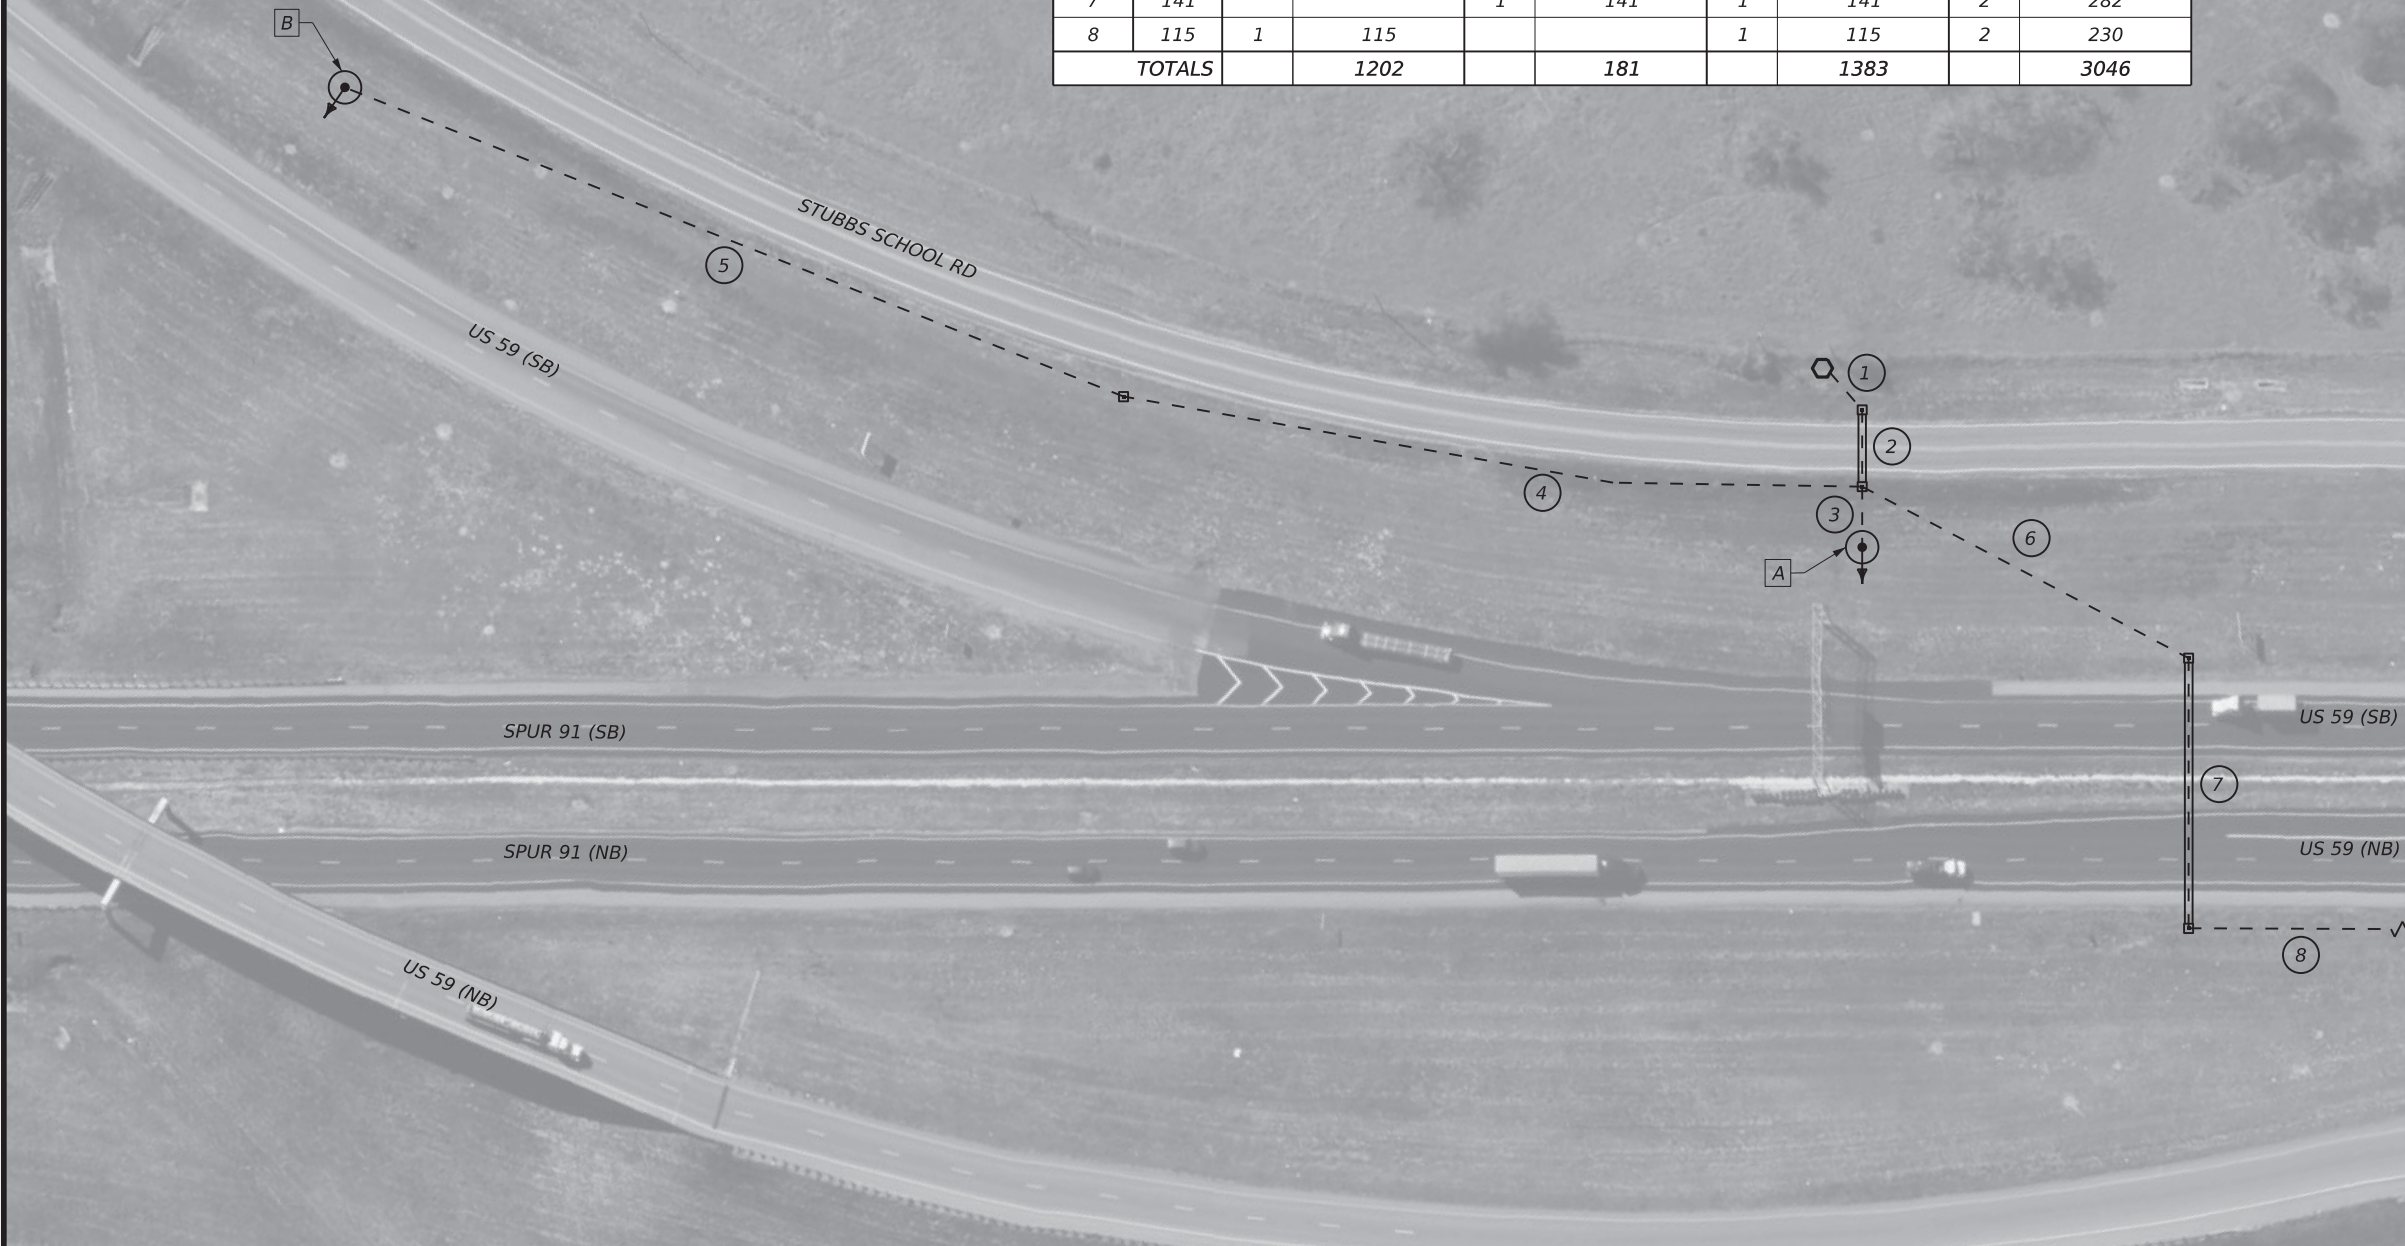

MATCHLINE



Kath C. Marek, P.E.
October 6, 2023

**US 59 @ SPUR 91
ILLUMINATION
LAYOUT
& SUMMARIES**
CSJ: 0088-05-110

SCALE: 1" = 100'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	9

ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.731443, -97.033781	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	150	46
B	28.729658, -97.035394	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	150	46

PATH: T:\YK\TRAFFIC\Design Projects\FY 24\Illumination CAT 11\SFIDGNUS 59_VICTORIA\FILE: US59_ILLUMINATION_LAYOUT(SHEET1).dgn
 DATE: 10/6/2023


CONDUIT AND CONDUCTOR RUNS

RUN NO.	LENGTH OF RUN LF	618				620			
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)			
		TRENCH		BORE		BARE		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
8	65	1	65			1	65	2	130
9	50			1	50	1	50	2	100
10	310	1	310			1	310	2	620
11	60			1	60	1	60	2	120
12	150	1	150			1	150	2	300
TOTALS			525		110		635		1270

SHEET TOTALS


BID CODE	DESCRIPTION	UNIT	QTY
0416 6026	DRILL SHAFT (HIGH MAST POLE) (60 IN)	LF	46
0432 6006	RIPRAP CONC(CL B)	CY	2.6
0613 6006	HI MST IL POLE (150 FT)(100 MPH)	EA	1
0614 6007	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	EA	1
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	4
6001 6002	PORTABLE CHANGEABLE MESSAGE SIGN	EA	1
6185 6002	TMA (STATIONARY)	DAY	3

MATCHLINE

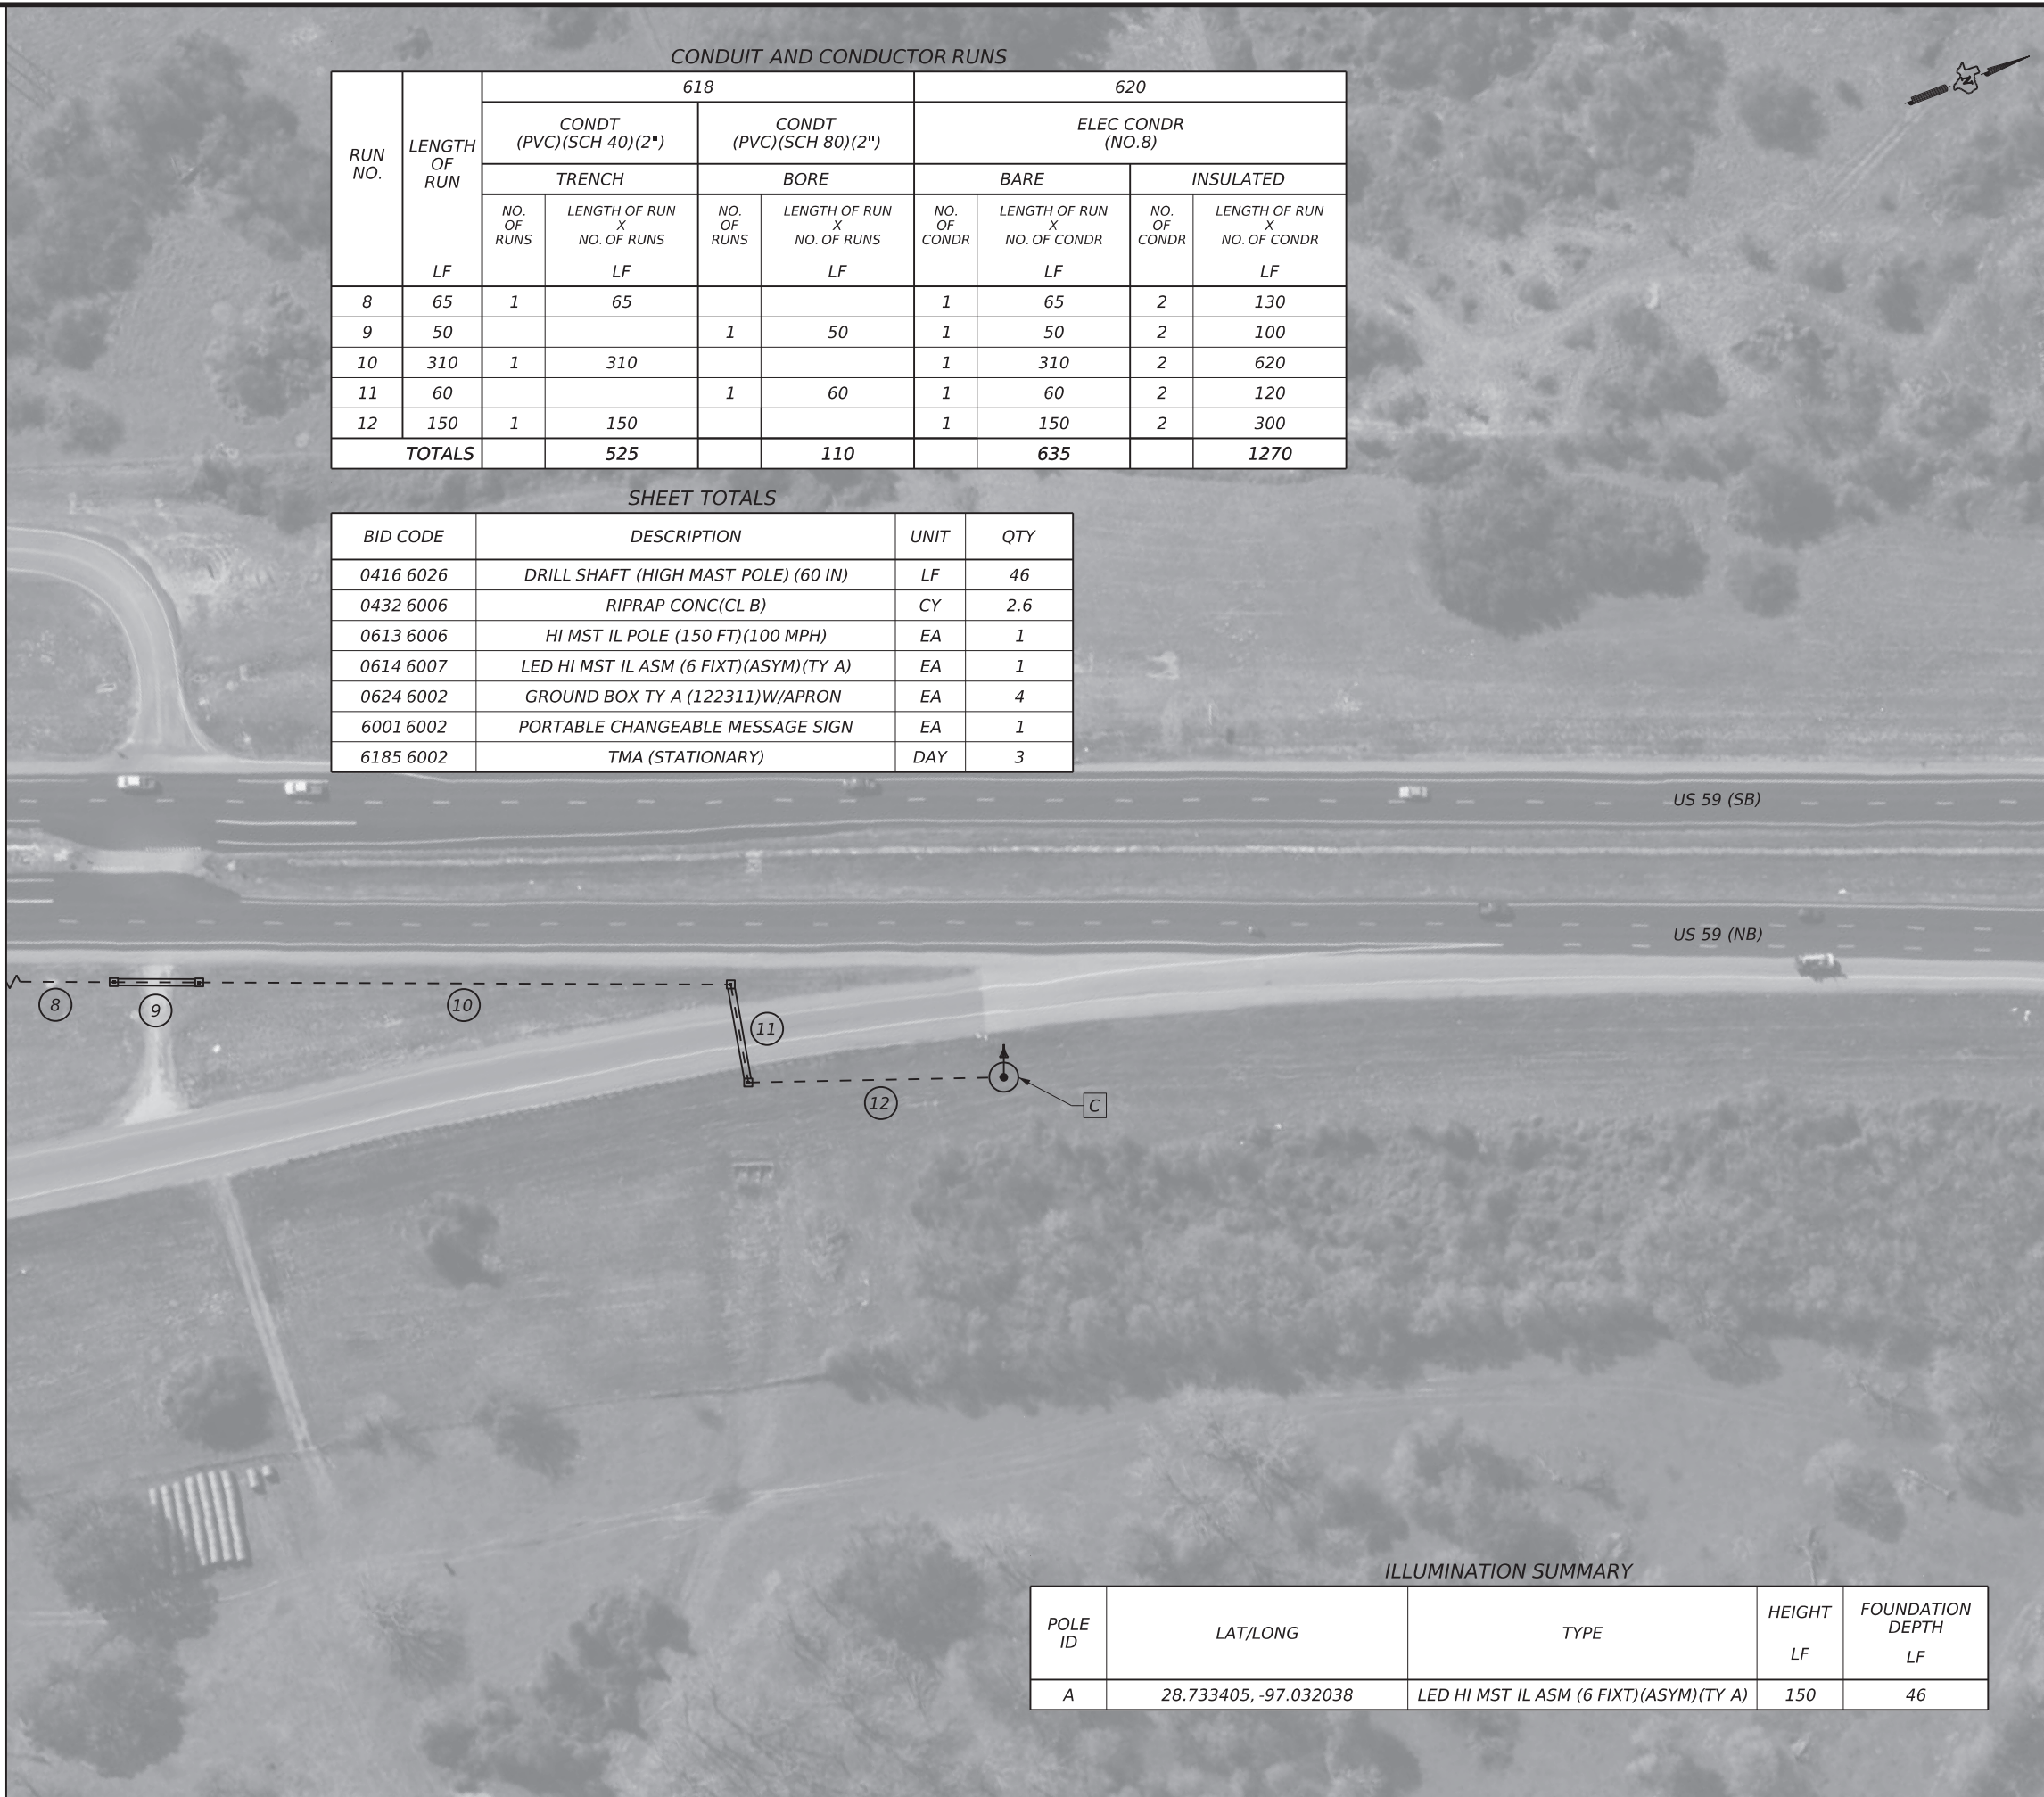

LEGEND

- HIGH MAST ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

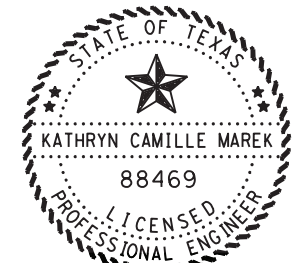

Kathryn C. Marek, P.E.
October 6, 2023

**US 59 @ SPUR 91
ILLUMINATION
LAYOUT
& SUMMARIES**
CSJ: 0088-05-110

SCALE: 1" = 100'

Texas Department of Transportation
©2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED SHEET 2 OF 2

ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.733405, -97.032038	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	150	46


SH 71

CONDUIT AND CONDUCTOR RUNS

RUN NO.	LENGTH OF RUN LF	618				620			
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)			
		TRENCH		BORE		BARE		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	30	1	30			1	30	2	60
2	55		0	1	55	1	55	2	110
3	95	1	95			1	95	2	190
TOTALS			125		55		180		360

SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
0416 6026	DRILL SHAFT (HIGH MAST POLE) (60 IN)	LF	46
0432 6006	RIPRAP CONC(CL B)	CY	2.6
0613 6006	HI MST IL POLE (150 FT)(100 MPH)	EA	1
0614 6007	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	EA	1
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	2
0628 6045	ELC SRV TY A 240/480 060(NS)SS(E)SP(O)	EA	1
6185 6002	TMA (STATIONARY)	DAY	3

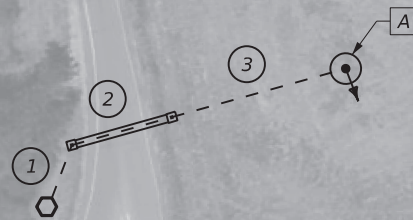

SH 35


SH 35

ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.884635, -96.188013	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	150	46

LEGEND

- HIGH MAST ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN



Kathryn C. Marek, P.E.

October 6, 2023

**SH 35 @ SH 71
ILLUMINATION
LAYOUT
& SUMMARIES**

CSJ: 0179-06-046

SCALE: 1" = 100'

Texas Department of Transportation
©2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	11

CONDUIT AND CONDUCTOR RUNS

RUN NO.	LENGTH OF RUN LF	618				620				684	
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)				TRAFFIC SIGNAL CABLE (TY A)(10 AWG)(3CONDR)	
		TRENCH		BORE		BARE		INSULATED		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	25	1	25			1	25	4	100		
2	25	1	25			1	25			2	50
3	60			1	60	2	120	4	240	2	120
4	25	1	25			1	25			1	25
5	65			1	65	1	65			1	65
6	60	1	60			1	60			1	60
7	50	1	50			1	50	4	200		
8	30			1	30	1	30	4	120		
9	40	1	40			1	40	4	160		
10	15	1	15			1	15	2	30		
11	425	1	425			1	425	2	850		
12	70			1	70	1	70	2	140		
13	440	1	440			1	440	2	880		
14	65	1	65			1	65			1	65
15	100			1	100	1	100			1	100
16	330	1	330			1	330			1	330
17	75			1	75	1	75			1	75
18	660	1	660			1	660			1	660
TOTALS			2160		400		2620		2720		1550


SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
0416 6026	DRILL SHAFT (HIGH MAST POLE) (60 IN)	LF	92
0432 6006	RIPRAP CONC(CL B)	CY	5.1
0613 6006	HI MST IL POLE (150 FT)(100 MPH)	EA	2
0614 6007	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	EA	2
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	9
0628 6045	ELC SRV TY A 240/480 060 (NS)SS(E)SP(O)	EA	1
0628 6145	ELC SRV TY D 120/240 060 (NS)SS(N)SP(O)	EA	1
0636 6001	ALUMINUM SIGNS (TY A)	SF	32
0685 6001	INSTALL RDSB FLASH BEACON ASSEMBLY	EA	2
0685 6006	REMOV RDSB FLSH BCN AM (SOLAR PWRD)	EA	2
6185 6002	TMA (STATIONARY)	DAY	3

PROP 350 LF MBGF W/ SGT BOTH ENDS
(SEE "SH 35 @ FM 1862 MBGF LAYOUT AND SUMMARY" FOR DETAILS)


ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.727325, -96.366627	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	150	46
B	28.728593, -96.369049	LED HI MST IL ASM (6 FIXT)(ASYM)(TY A)	150	46

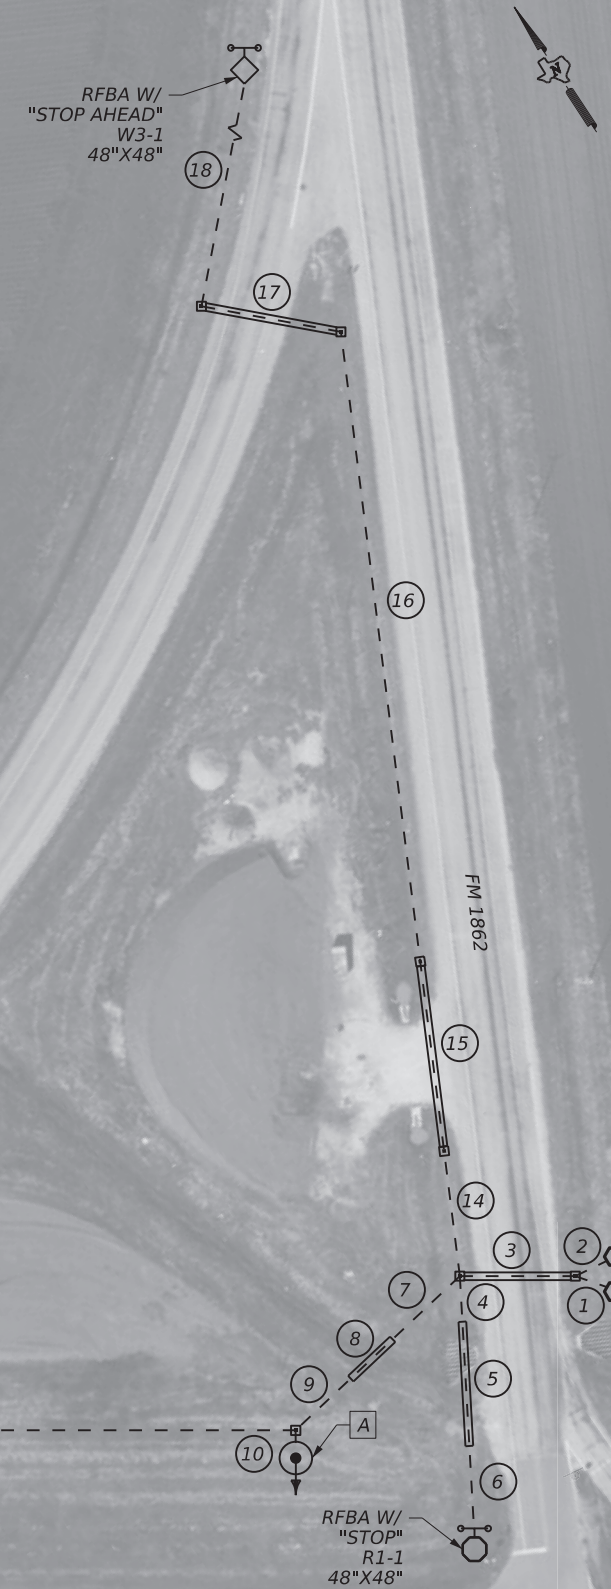

LEGEND

- HIGH MAST ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

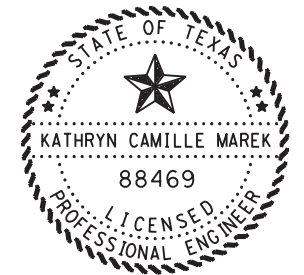

Kath C. Marek, P.E.
October 6, 2023

**SH 35 @ FM 1862
ILLUMINATION
LAYOUT
& SUMMARIES**
CSJ: 0179-09-042

SCALE: 1" = 100'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	12

ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	29.214671, -96.028166	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
B	29.214821, -96.028038	IN RD IL (TY SA) 40T-10 (250W EQ) LED	40	10


SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
132 6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	20 *
0416 6029	DRILL SHAFT (RWDY ILL POLE) (30 IN)	LF	20
0432 6006	RIPRAP CONC(CL B)	CY	0.7
0610 6216	IN RD IL (TY SA) 40T-10 (250W EQ) LED	EA	1
0610 6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	1
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	14
0628 6145	ELC SRV TY D 120/240 060(NS)SS(E)SP(O)	EA	1
0636 6001	ALUMINUM SIGNS (TY A)	SF	32
0685 6001	INSTALL RDS FLASH BEACON ASSEMBLY	EA	2
0685 6006	REMOV RDS FLSH BCN AM (SOLAR PWRD)	EA	2
6185 6002	TMA (STATIONARY)	DAY	3

* ESTIMATED QUANTITY WITH 1.4 COMPACTION FACTOR AT POLE LOCATIONS WHERE EMBANKMENT IS NEEDED TO ACHIEVE 6:1 SLOPE AS PER THE STANDARD.

LEGEND

- PROPOSED A/C POWERED ROADSIDE FLASHING BEACON ASSEMBLY (RFBA)
- ROADWAY ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT - TRENCH
- ELECTRICAL CONDUIT - BORE
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

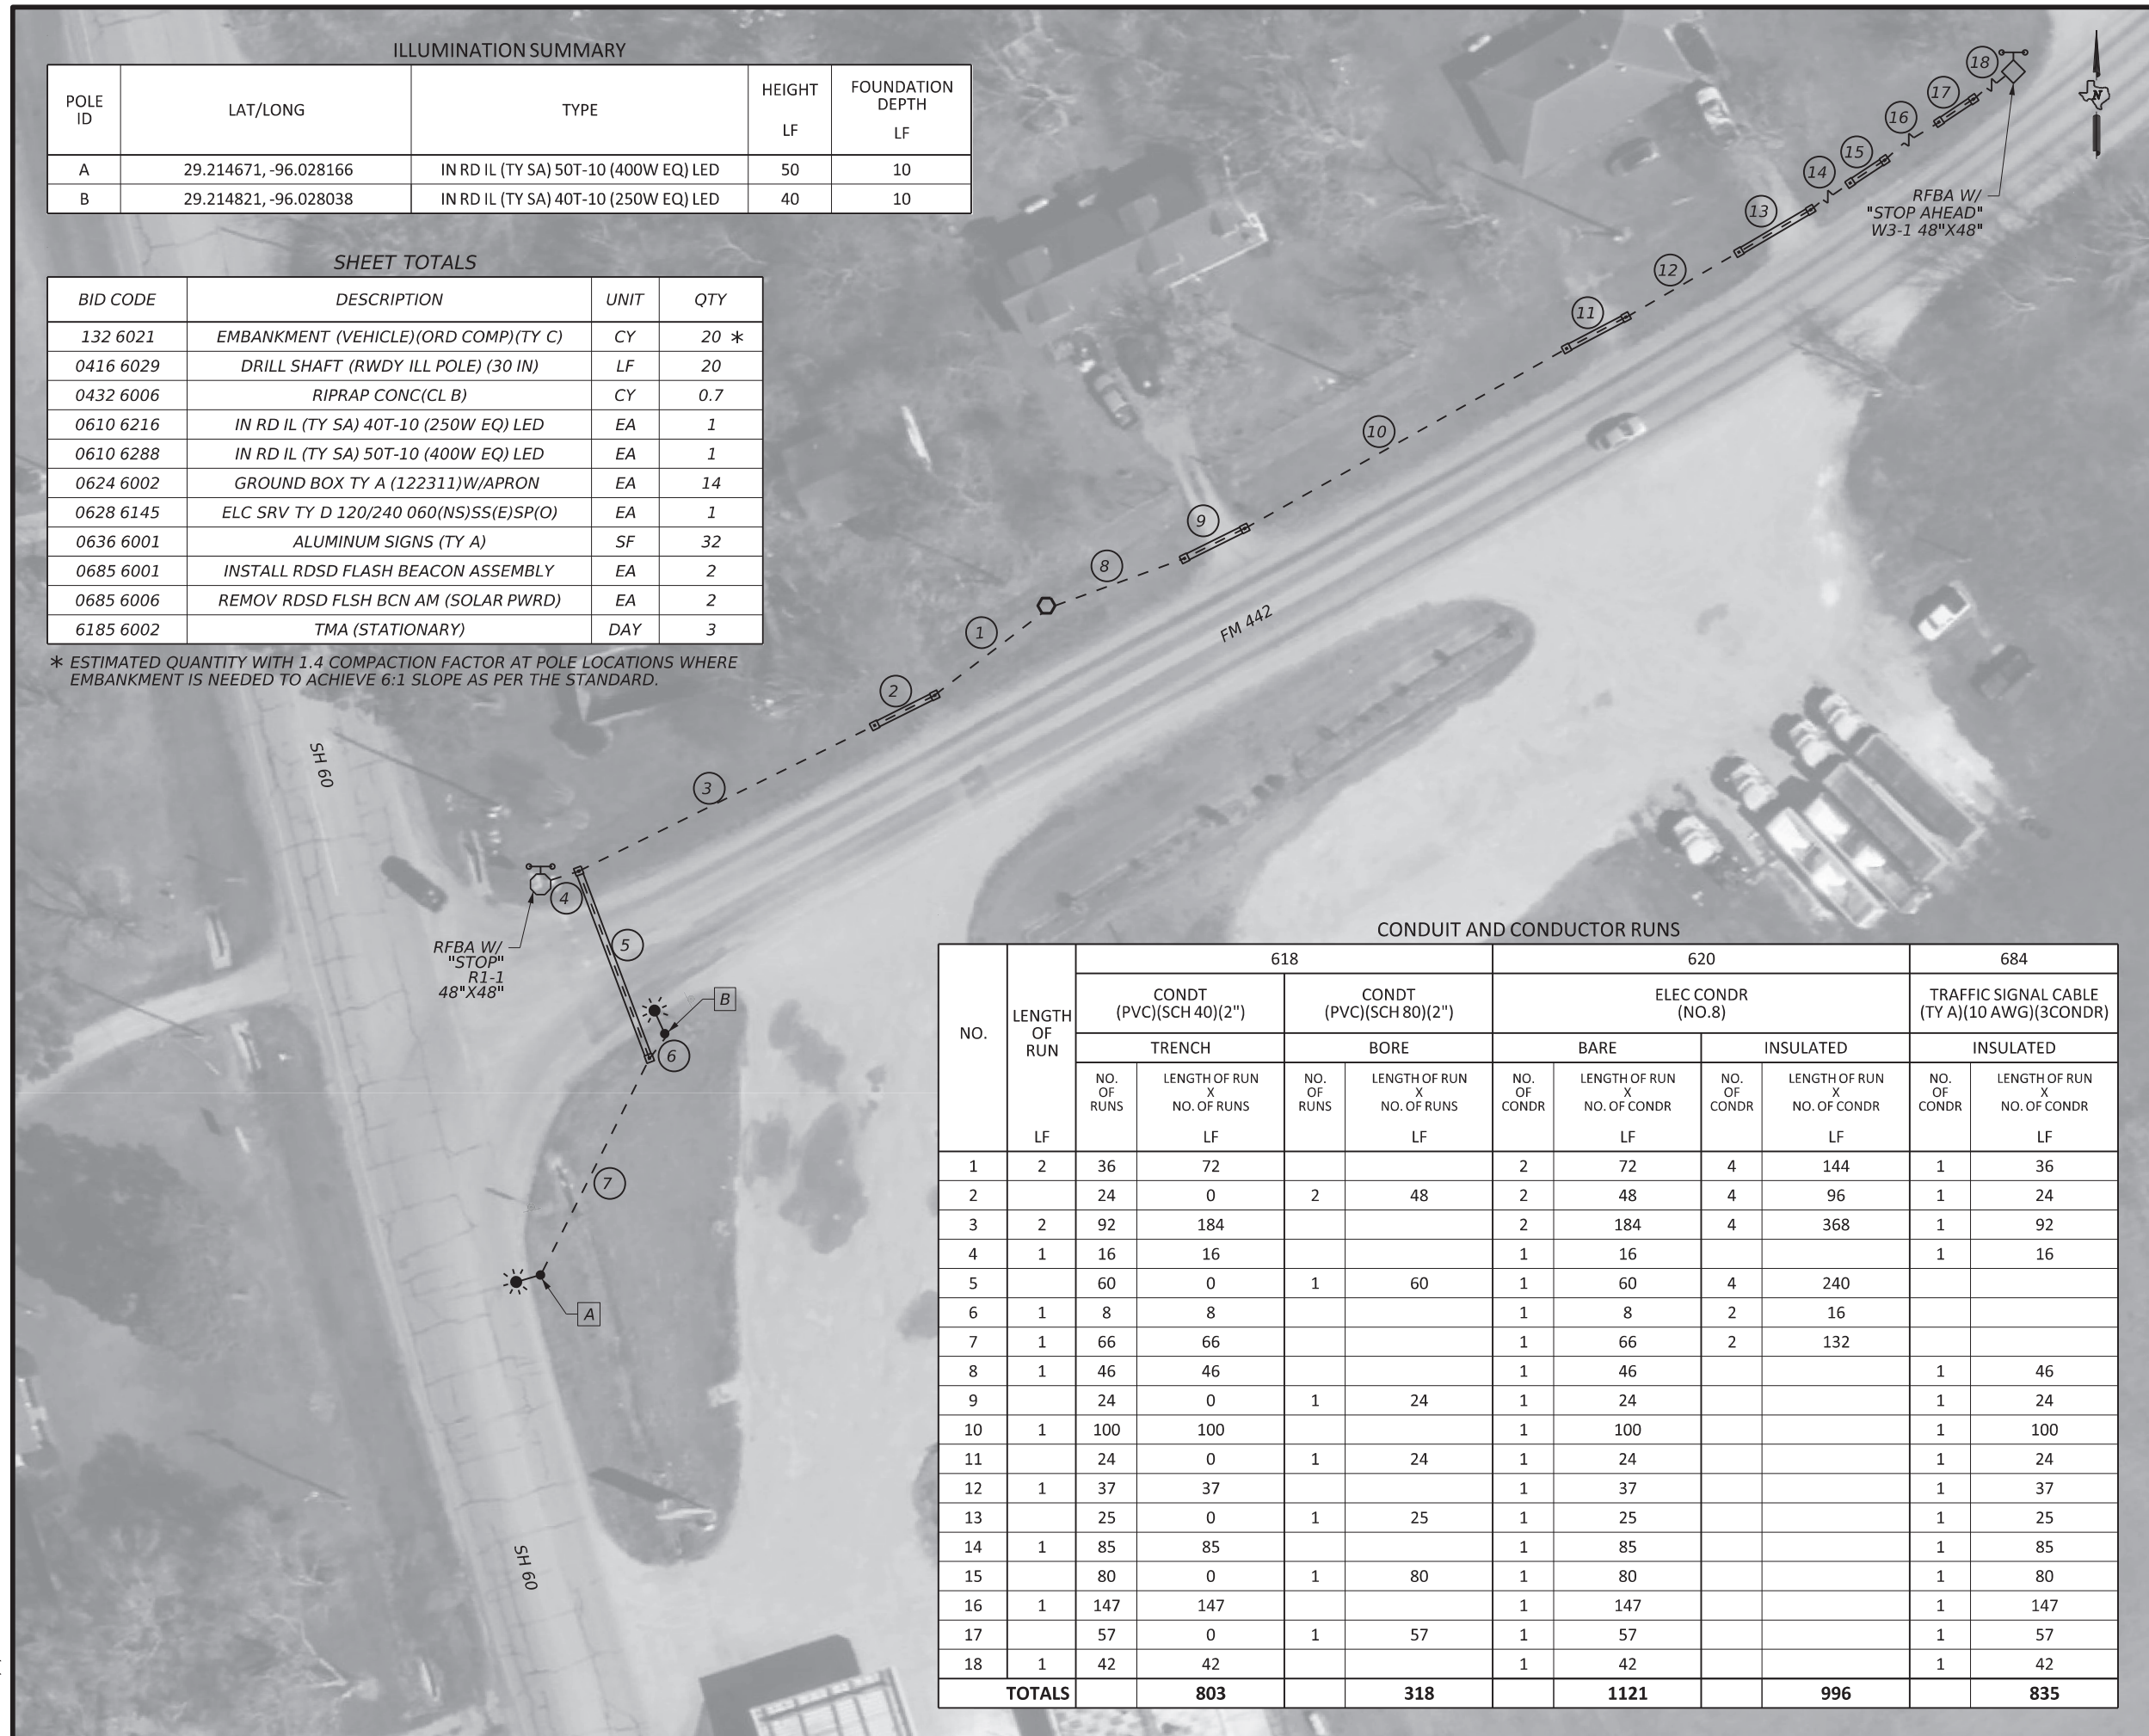

CONDUIT AND CONDUCTOR RUNS

NO.	LENGTH OF RUN LF	618				620				684	
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)				TRAFFIC SIGNAL CABLE (TY A)(10 AWG)(3CONDR)	
		TRENCH		BORE		BARE		INSULATED		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	2	36	72			2	72	4	144	1	36
2		24	0	2	48	2	48	4	96	1	24
3	2	92	184			2	184	4	368	1	92
4	1	16	16			1	16			1	16
5		60	0	1	60	1	60	4	240		
6	1	8	8			1	8	2	16		
7	1	66	66			1	66	2	132		
8	1	46	46			1	46			1	46
9		24	0	1	24	1	24			1	24
10	1	100	100			1	100			1	100
11		24	0	1	24	1	24			1	24
12	1	37	37			1	37			1	37
13		25	0	1	25	1	25			1	25
14	1	85	85			1	85			1	85
15		80	0	1	80	1	80			1	80
16	1	147	147			1	147			1	147
17		57	0	1	57	1	57			1	57
18	1	42	42			1	42			1	42
TOTALS			803		318		1121		996		835



Kathryn C. Marek, P.E.
October 6, 2023

**SH 60 @ FM 442
ILLUMINATION
LAYOUT
& SUMMARIES**
CSJ: 0241-01-051

SCALE: 1" = 50'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED
SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	13

PATH: T:\YK\TRAFFIC\Design Projects\FY 24\Illumination CAT 11\SH60@FM442.dgn
FILE: SH60_FM442_ILLUMINATION_LAYOUT.dgn
DATE: 10/6/2023

CONDUIT AND CONDUCTOR RUNS

NO.	LENGTH OF RUN LF	618				620				684	
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)				TRAFFIC SIGNAL CABLE (TY A)(10 AWG)(3CONDR)	
		TRENCH		BORE		BARE		INSULATED		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	94	1	94			1	94	2	188		
2	57	1	57			1	57			1	57
3	22	1	22			1	22	2	44		
4	75			1	75	1	75	2	150		
5	46	1	46			1	46	2	92		
6	115	1	115			1	115	2	230		
TOTALS			334		75		409		704		57


ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.995576, -96.208631	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
B	28.995093, -96.208474	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
C	28.994797, -96.208604	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10

SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
132 6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	20 *
0416 6029	DRILL SHAFT (RWDY ILL POLE) (30 IN)	LF	30
0432 6006	RIPRAP CONC(CL B)	CY	1.05
0610 6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	3
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	2
0628 6145	ELC SRV TY D 120/240 060(NS)SS(E)SP(O)	EA	1
0628 6002	REMOVE ELECTRICAL SERVICES	EA	1
0636 6001	ALUMINUM SIGNS (TY A)	SF	16
0685 6001	INSTALL RDS FLASH BEACON ASSEMBLY	EA	1
6185 6002	TMA (STATIONARY)	DAY	3


* ESTIMATED QUANTITY WITH 1.4 COMPACTION FACTOR AT POLE LOCATIONS WHERE EMBANKMENT IS NEEDED TO ACHIEVE 6:1 SLOPE AS PER THE STANDARD.

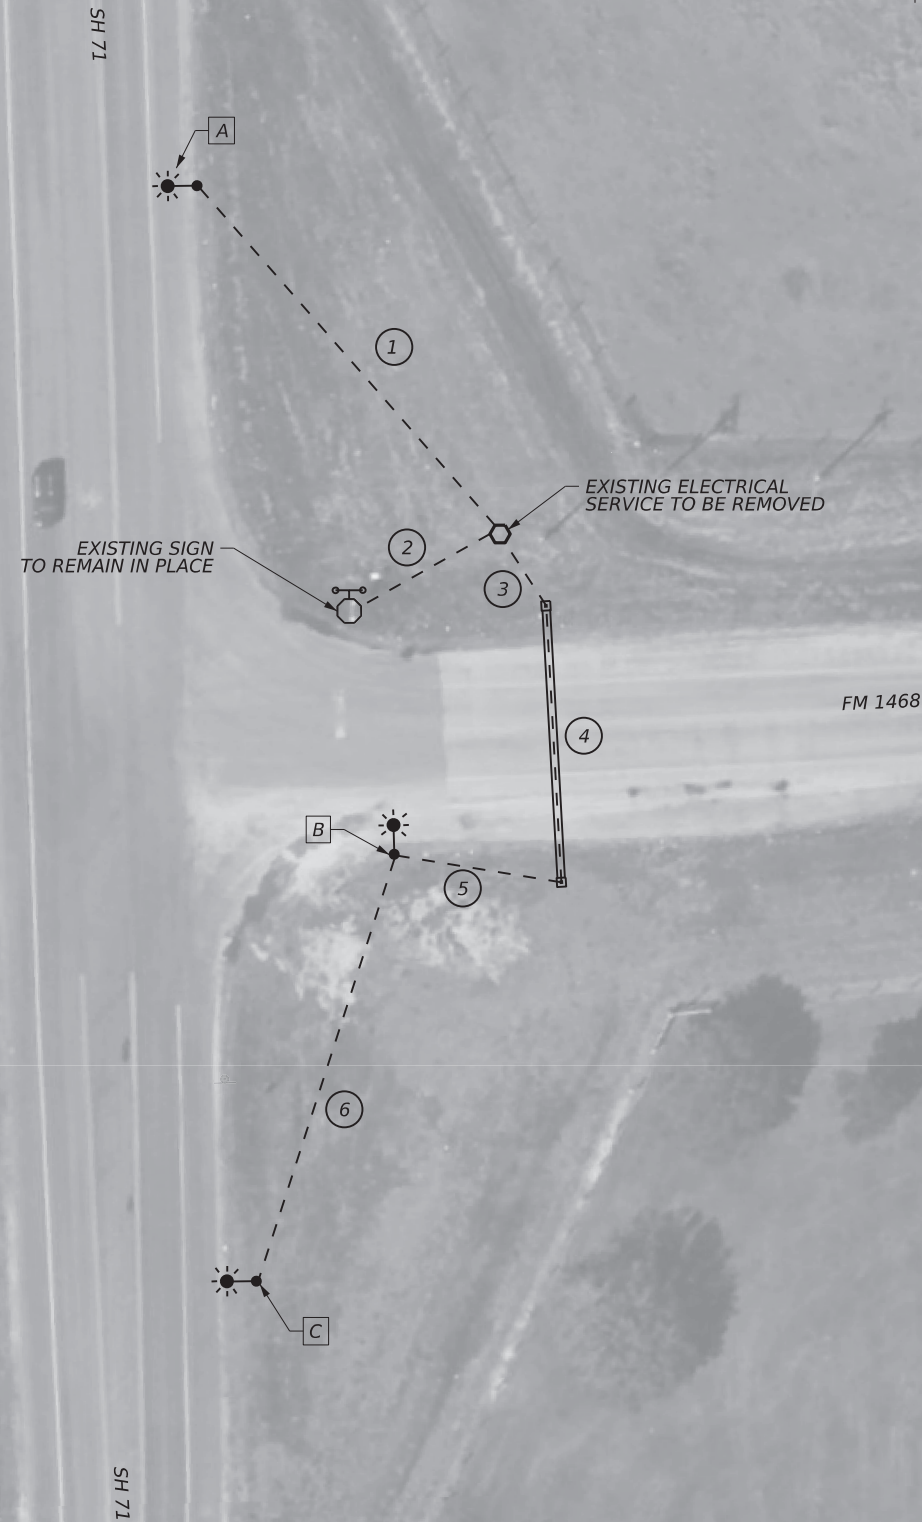

LEGEND

- ROADWAY ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

NOTE: ENSURE EXISTING FLASHING BEACONS REMAIN FLASHING. SWITCH TO NEW ELECTRICAL SERVICE ON SAME DAY.

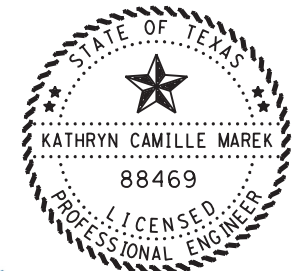

Kathryn C. Marek, P.E.
October 6, 2023

**SH 71 @ FM 1468
ILLUMINATION
LAYOUT
& SUMMARIES**

CSJ: 0266-07-023

SCALE: 1" = 50'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	14

CONDUIT AND CONDUCTOR RUNS

No.	LENGTH OF RUN LF	618				620			
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)			
		TRENCH		BORE		BARE		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	85	1	85			1	85	8	680
2	5	1	5			1	5	2	10
3	100	1	100			1	100	2	200
4	110			1	110	1	110	4	440
5	230	1	230			1	230	4	920
6	125	1	125			1	125	2	250
7	60			1	60	1	60	2	120
8	120	1	120			1	120	2	240
TOTALS			665		170		835		2860

LEGEND

- ROADWAY ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN



ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	30.008800, -96.741731	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
B	30.0085714, -96.741508	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
C	30.009538, -96.740538	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
D	30.009108, -96.740316	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10

SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
0132 6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	80 *
0416 6029	DRILL SHAFT (RWDY ILL POLE) (30 IN)	LF	40
0432 6006	RIPRAP CONC(CL B)	CY	1.4
0610 6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	4
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	4
0628 6009	ELC SRV TY A 120/240 060(NS)SS(E)SP(O)	EA	1
6185 6002	TMA (STATIONARY)	DAY	3

* ESTIMATED QUANTITY WITH 1.4 COMPACTION FACTOR AT POLE LOCATIONS WHERE EMBANKMENT IS NEEDED TO ACHIEVE 6:1 SLOPE AS PER THE STANDARD.



Kathryn C. Marek, P.E.
October 6, 2023

**SH 237 @ FM 1291
ILLUMINATION
LAYOUT
& SUMMARIES**
CSJ: 0267-01-035

SCALE: 1" = 50'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	15


PATH: T:\YK\TRAFFIC\Design Projects\FY 24\Illumination CAT 11\SFIDGNISH 237 @ FM 1291
FILE: SH237_FM1291_ILLUMINATION_LAYOUT.dgn
DATE: 10/6/2023

ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.714166, -97.041059	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
B	28.714733, -97.040710	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
C	28.715261, -97.040305	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10

LEGEND

- ROADWAY ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

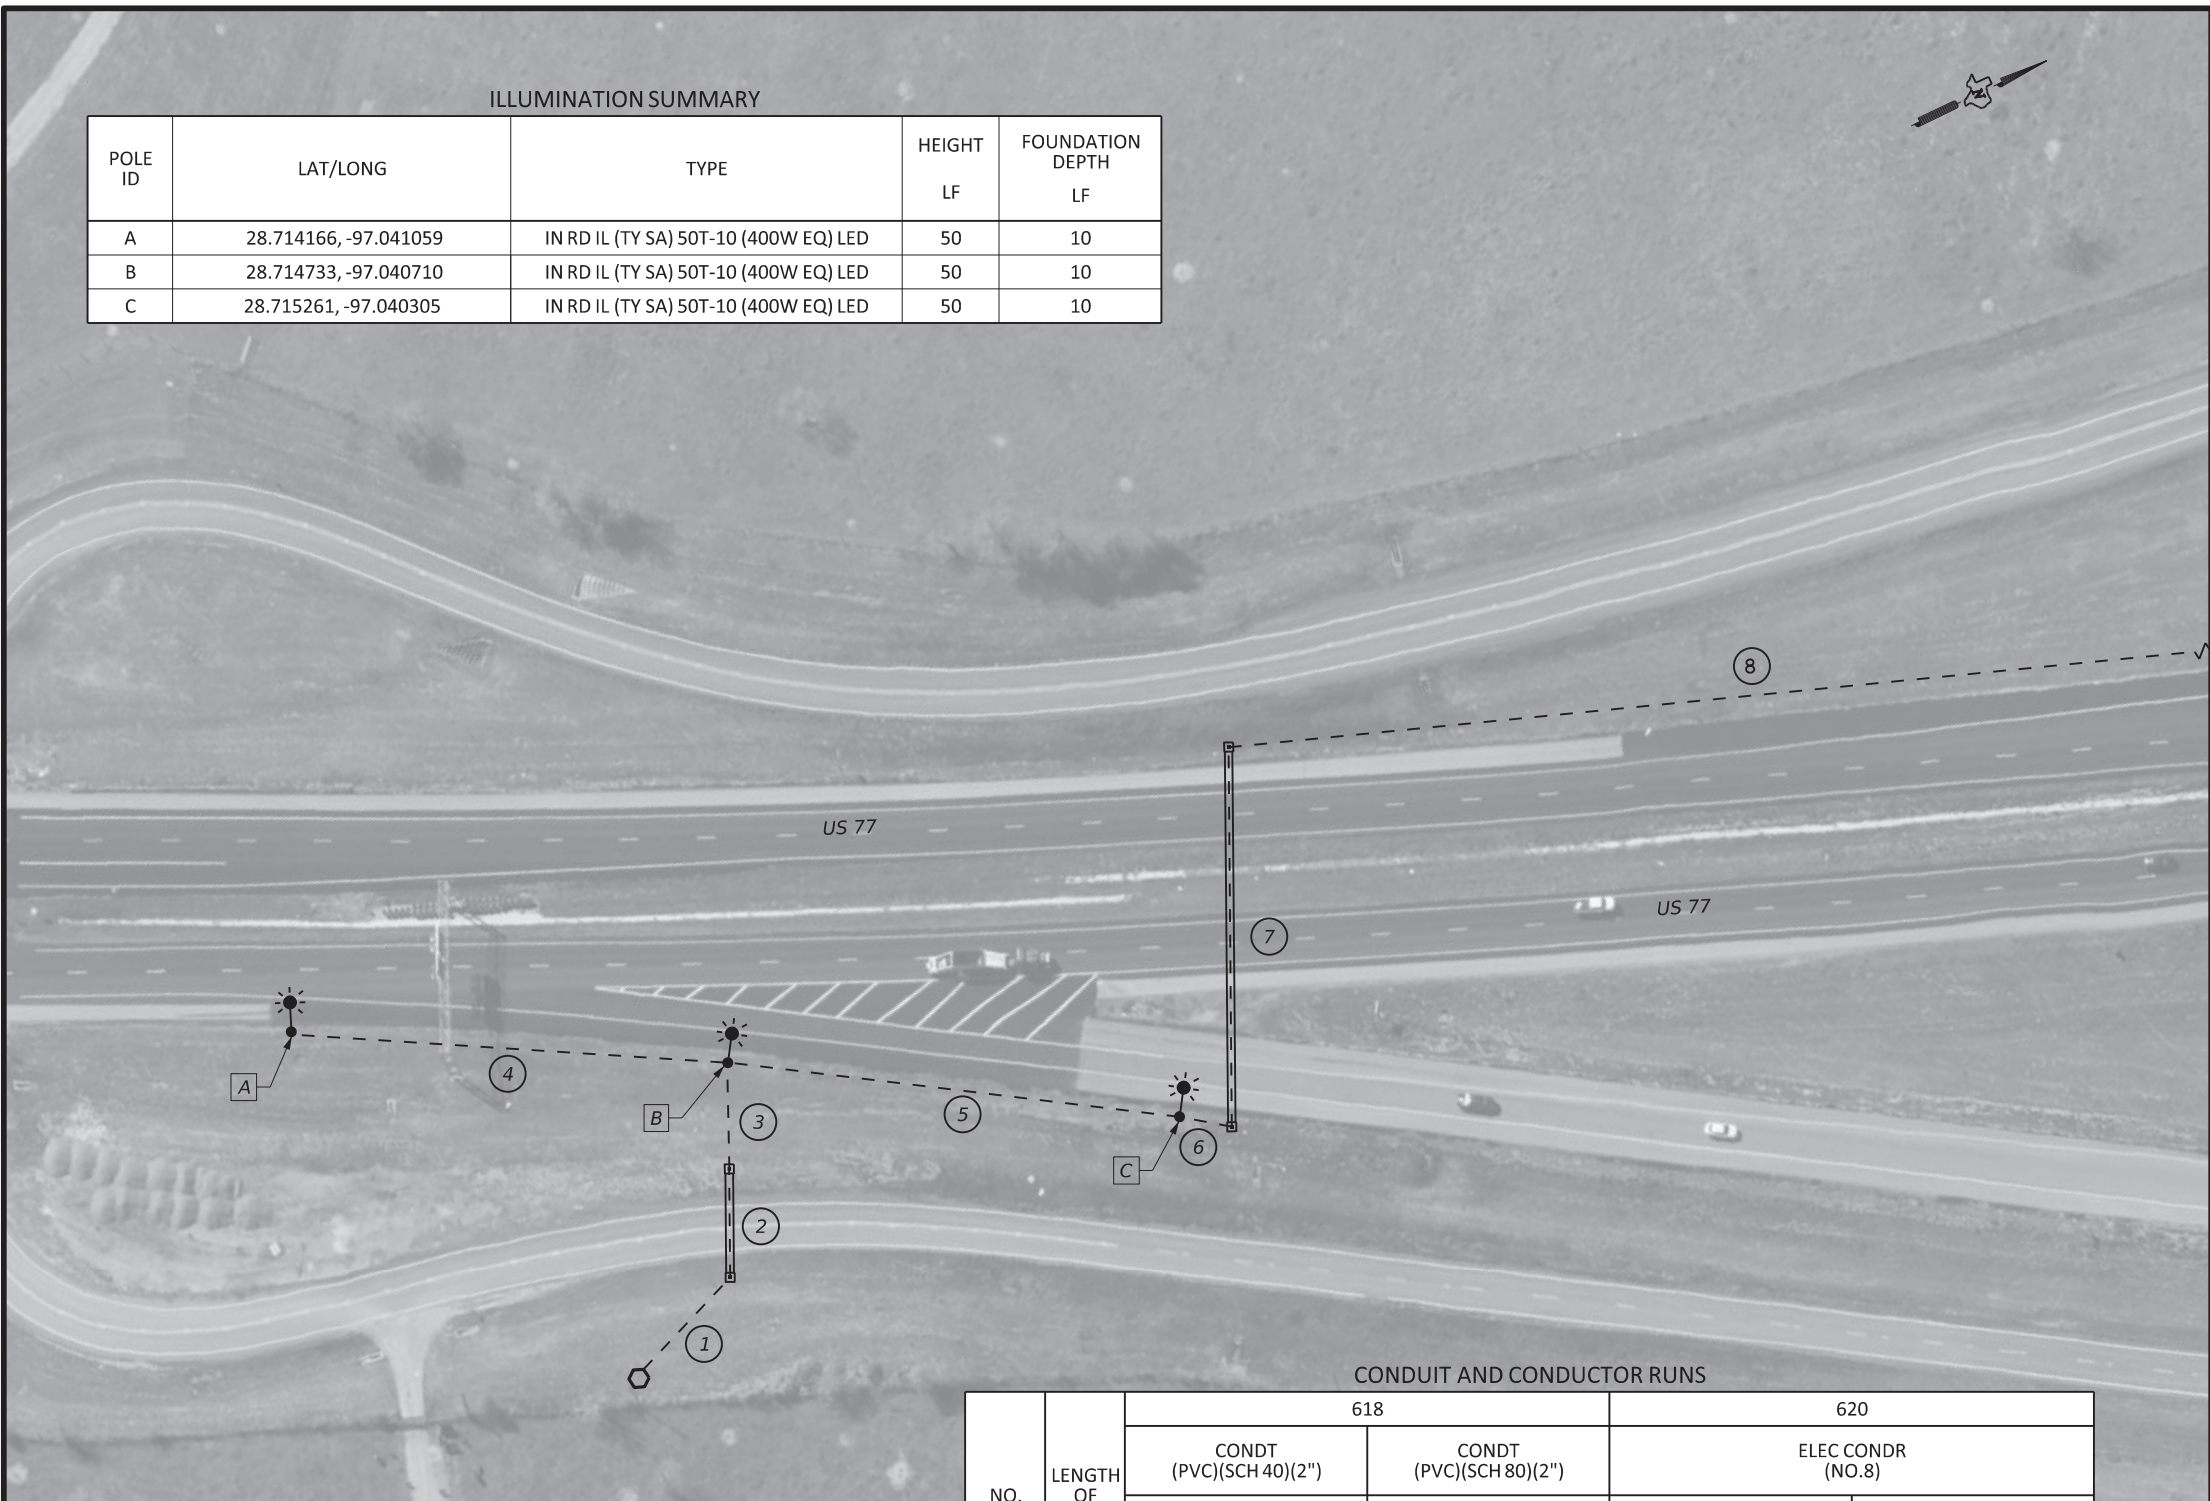


CONDUIT AND CONDUCTOR RUNS

NO.	LENGTH OF RUN LF	618				620			
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)			
		TRENCH		BORE		BARE		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	60	1	60			1	60	4	240
2	62			1	62	1	62	4	248
3	61	1	61			1	61	4	244
4	233	1	233			1	233	2	466
5	240	1	240			1	240	2	480
6	32	1	32			1	32	2	64
7	204			1	204	1	204	2	408
8	515	1	515			1	515	2	1030
TOTALS			1141		266		1407		3180

SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY *
0132 6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	20
0416 6029	DRILL SHAFT (RWDY ILL POLE) (30 IN)	LF	30
0432 6006	RIPRAP CONC(CL B)	CY	1.05
0610 6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	3
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	4
0628 6009	ELC SRV TY A 120/240 060(NS)SS(E)SP(O)	EA	1
6185 6002	TMA (STATIONARY)	DAY	3

* ESTIMATED QUANTITY WITH 1.4 COMPACTION FACTOR AT POLE LOCATIONS WHERE EMBANKMENT IS NEEDED TO ACHIEVE 6:1 SLOPE AS PER THE STANDARD.



Kathryn C. Marek, P.E.
October 6, 2023

**US 77 @ SPUR 91
ILLUMINATION
LAYOUT
& SUMMARIES**
CSJ: 0371-01-096

SCALE: 1" = 100'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

SHEET 1 OF 2

FED. RD. DIV. NO.	PROJECT NO.		
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	16

PATH: T:\YK\TRAFFIC\Design Projects\FY 24\Illumination CAT 11\SFIDGNUS 77_VICTORIA\FILE: US 77_ILLUMINATION_LAYOUT 1 of 2.dgn
 DATE: 10/6/2023

PATH: T:\YK\TRAFMAINT\Design Projects\FY 24\Illumination CAT 11\SFIDGNUS 77_VICTORIA\FILE: US 77_ILLUMINATION_LAYOUT 2 of 2.dgn
DATE: 10/31/2023

MATCHLINE

CONDUIT AND CONDUCTOR RUNS

NO.	LENGTH OF RUN LF	618				620			
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)			
		TRENCH		BORE		BARE		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
9	355	1	355			1	355	2	710
10	240	1	240			1	240	2	480
11	225	1	225			1	225	2	450
TOTALS			820				820		1640

SHEET TOTALS


BID CODE	DESCRIPTION	UNIT	QTY
0416 6029	DRILL SHAFT (RWDY ILL POLE) (30 IN)	LF	30
0432 6006	RIPRAP CONC(CL B)	CY	1.05
0610 6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	3
6185 6002	TMA (STATIONARY)	DAY	3

ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
D	28.717826, -97.039841	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
E	28.718421, -97.039630	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
F	28.719019, -97.039495	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10

LEGEND

- ROADWAY ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT (TRENCH)
- ELECTRICAL CONDUIT (BORE)
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

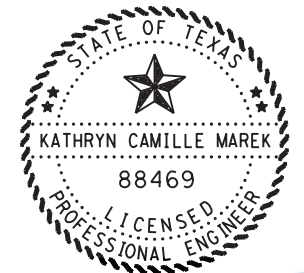

Kathryn C. Marek, P.E.
October 31, 2023

**US 77 @ SPUR 91
ILLUMINATION
LAYOUT
& SUMMARIES**

CSJ: 0371-01-096

SCALE: 1" = 100'

Texas Department of Transportation
©2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	17

CONDUIT AND CONDUCTOR RUNS

NO.	LENGTH OF RUN LF	618				620				684	
		CONDT (PVC)(SCH 40)(2")		CONDT (PVC)(SCH 80)(2")		ELEC CONDR (NO.8)				TRAFFIC SIGNAL CABLE (TY A)(10 AWG)(3CONDR)	
		TRENCH		BORE		BARE		INSULATED		INSULATED	
		NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF RUNS	LENGTH OF RUN X NO. OF RUNS LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF	NO. OF CONDR	LENGTH OF RUN X NO. OF CONDR LF
1	27	1	27			1	27	2	54		
2	20	1	20			1	20	4	80		
3	57			1	57	1	57	4	228		
4	75	1	75			1	75	2	150		
5	148	1	148			1	148	2	296		
6	16	1	16			1	16			2	32
7	72			1	72	1	72			2	144
8	43	1	43			1	43			1	43
9	784	1	784			1	784			1	784
10	90			1	90	1	90			1	90
11	293	1	293			1	293			1	293
TOTALS			1406		219		1625		808		1386

LEGEND

- PROPOSED A/C POWERED ROADSIDE FLASHING BEACON ASSEMBLY (RFBA)
- ROADWAY ILLUMINATION ASSEMBLY
- ELECTRICAL CONDUIT - TRENCH
- ELECTRICAL CONDUIT - BORE
- GROUND BOX
- ELECTRICAL SERVICE
- CONDUIT RUN NUMBER
- POLE ID NUMBER
- EXISTING SIGN

PATH: T:\YK\TRAFFIC\MAINT\Design Projects\FY 24\Illumination CAT 11\SF\IGN\FM 616 @ FM 1862
 FILE: FM616_FM1862_ILLUMINATION_LAYOUT.dgn
 DATE: 10/6/2023


ILLUMINATION SUMMARY

POLE ID	LAT/LONG	TYPE	HEIGHT LF	FOUNDATION DEPTH LF
A	28.868146, -96.252465	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
B	28.868327, -96.252755	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10
C	28.868479, -96.252088	IN RD IL (TY SA) 50T-10 (400W EQ) LED	50	10

SHEET TOTALS

BID CODE	DESCRIPTION	UNIT	QTY
0132 6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	60 *
0416 6029	DRILL SHAFT (RWDY ILL POLE) (30 IN)	LF	30
0432 6006	RIPRAP CONC(CL B)	CY	1.05
0610 6288	IN RD IL (TY SA) 50T-10 (400W EQ) LED	EA	3
0624 6002	GROUND BOX TY A (122311)W/APRON	EA	6
0628 6145	ELC SRV TY D 120/240 060(NS)SS(E)SP(O)	EA	1
0636 6001	ALUMINUM SIGNS (TY A)	SF	32
0685 6001	INSTALL RDS FLASH BEACON ASSEMBLY	EA	2
0685 6006	REMOV RDS FLSH BCN AM (SOLAR PWRD)	EA	2
6185 6002	TMA (STATIONARY)	DAY	3

* ESTIMATED QUANTITY WITH 1.4 COMPACTION FACTOR AT POLE LOCATIONS WHERE EMBANKMENT IS NEEDED TO ACHIEVE 6:1 SLOPE AS PER THE STANDARD.

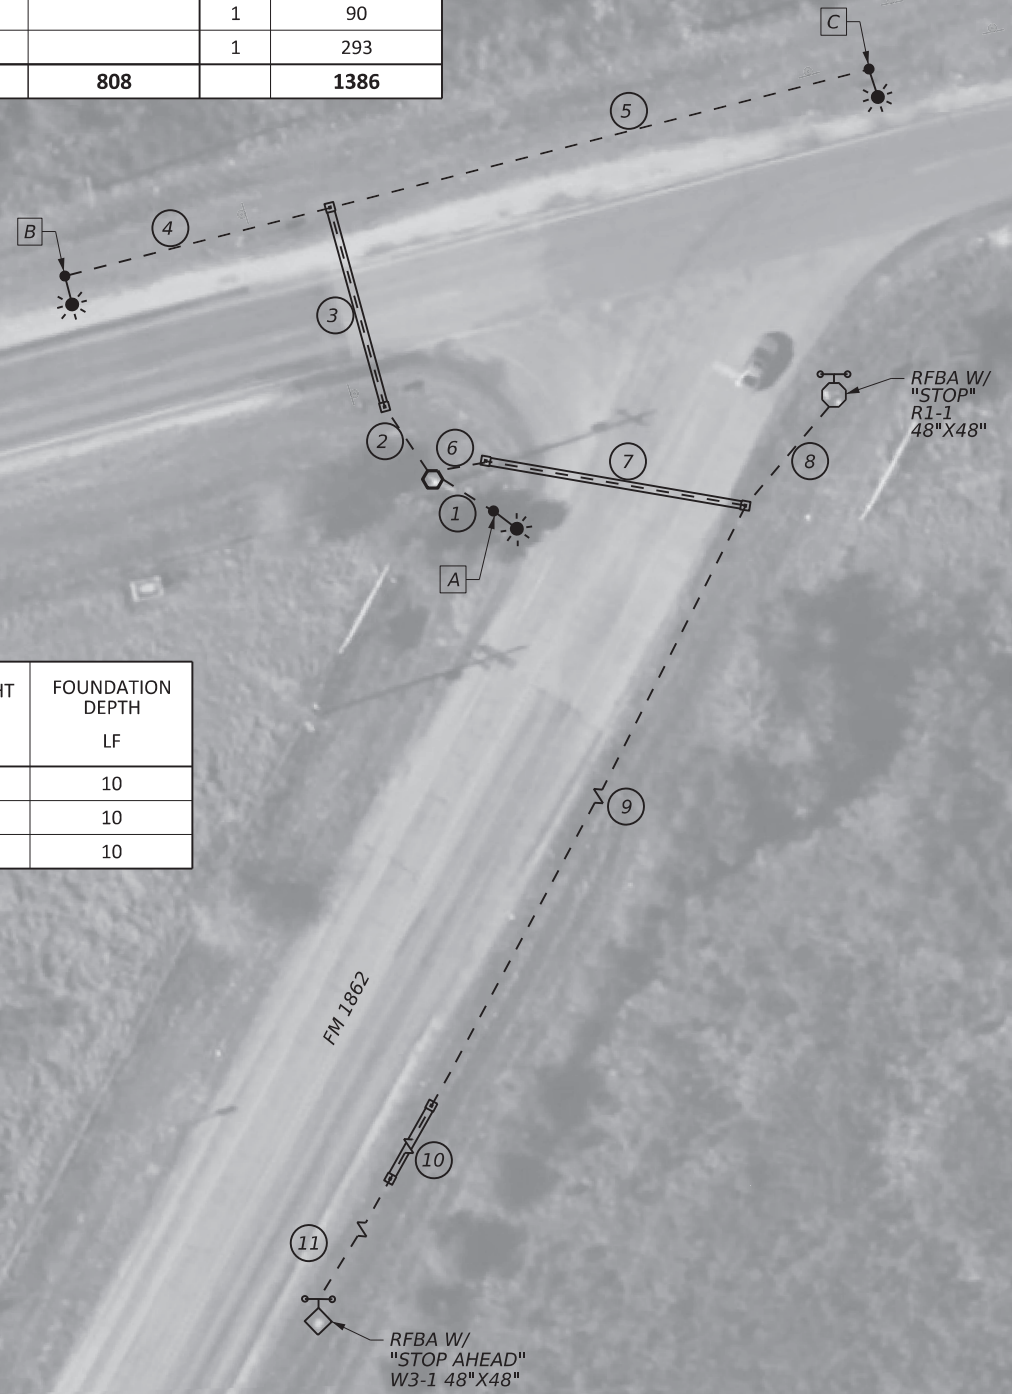

Kathryn C. Marek, P.E.
 October 6, 2023

**FM 616 @ FM 1862
 ILLUMINATION
 LAYOUT
 & SUMMARIES**
 CSJ: 0497-01-022

SCALE: 1" = 50'

Texas Department of Transportation
 © 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
 ALL RIGHTS RESERVED
 SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	18

ELECTRICAL SERVICE DATA

ELEC. SERVICE ID	PLAN SHEET NUMBER	ELECTRIC SERVICE DESCRIPTION	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. POLE/AMPS	LIGHTING CONTACTOR AMPS	PANELBD/LOADCENTER AMP RATING	BRANCH CIRCUIT ID	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
US 59 @ SPUR 91		ELC SRV TY A 240/480 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	HIGH MAST ILLUMINATION	2P/30	22.5	10.8
SH 35 @ SH 71		ELC SRV TY A 240/480 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	HIGH MAST ILLUMINATION	2P/20	7.5	3.6
SH 35 @ FM 1862		ELC SRV TY A 240/480 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	HIGH MAST ILLUMINATION	2P/20	15	7.2
		ELC SRV TY D 120/240 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	N/A	100	RFBA	1P/15	2	0.2
FM 60 @ FM 442		ELC SRV TY D 120/240 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 30	100	ILLUMINATION	2P/15	2	0.7
									RFBA	1P/15	2	
SH 71 @ FM 1468		ELC SRV TY D 120/240 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 30	100	ILLUMINATION	2P/15	3	0.8
									RFBA	1P/15	1	
SH 237 @ FM 1291		ELC SRV TY A 120/240 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	ILLUMINATION	2P/15	4	1.0
US 77 @ SPUR 91		ELC SRV TY A 120/240 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	ILLUMINATION	2P/15	6	1.4
FM 616 @ FM 1862		ELC SRV TY D 120/240 060 (NS)SS(E)SP(O)	1 1/4"	3/#6	N/A	2P/60	2P/ 30	100	ILLUMINATION	2P/15	3	1.0
									RFBA	1P/15	2	



Kath C. Marek, P.E.
October 6, 2023

ELECTRICAL SERVICE DATA SHEET

Texas Department of Transportation
©2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	19

PATH: T:\YK\TRAFFIC\Design Projects\FY 24\Illumination CAT 1\SFIDGN
FILE: ILLUMINATION_ELECTRICAL_SERVICE_DATA_SHEET.dgn
DATE: 10/6/2023

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:

1. The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
2. The development and design of the Traffic Control Plan (TCP) is the responsibility of the Engineer.
3. The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
4. The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
5. Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.
6. When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
7. The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
9. The temporary traffic control devices shown in the illustrations of the BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.
10. Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
11. Traffic control devices should be in place only while work is actually in progress or a definite need exists.
12. The Engineer has the final decision on the location of all traffic control devices.
13. Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

WORKER SAFETY NOTES:

1. Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
2. Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.


COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES

1. Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources.
2. Work zone traffic control devices shall be compliant with the Manual for Assessing safety Hardware (MASH).

<p>THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT http://www.txdot.gov</p>
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS


DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

SHEET 1 OF 12

 Texas Department of Transportation		Traffic Safety Division Standard
<p>BARRICADE AND CONSTRUCTION GENERAL NOTES AND REQUIREMENTS</p> <p>BC (1) -21</p>		
FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT SECT	JOB HIGHWAY
4-03 7-13	0088 05	110, ETC US 59, ETC
9-07 8-14	DIST	COUNTY SHEET NO.
5-10 5-21	YKM	VICTORIA, ETC 20

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


TYPICAL LOCATION OF CROSSROAD SIGNS

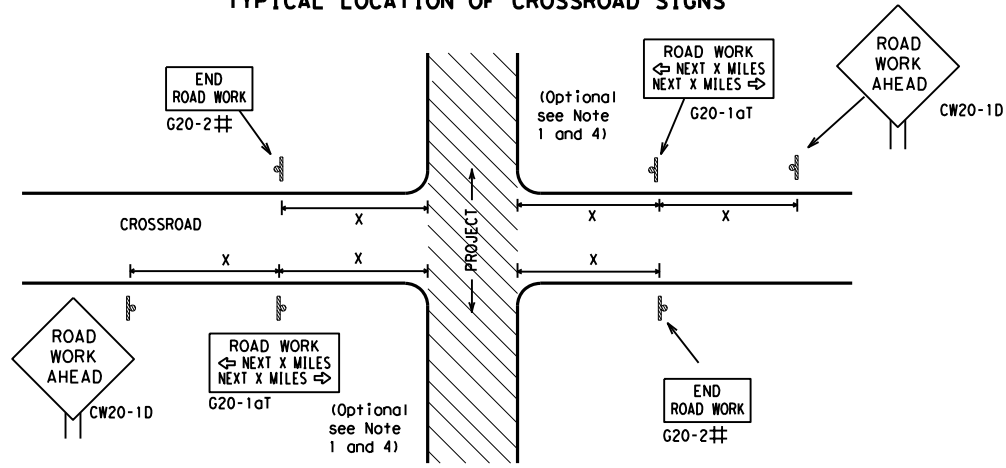

May be mounted on back of "ROAD WORK AHEAD" (CW20-1D) sign with approval of Engineer. (See note 2 below)

- The typical minimum signing on a crossroad approach should be a "ROAD WORK AHEAD" (CW20-1D) sign and a (G20-2) "END ROAD WORK" sign, unless noted otherwise in plans.
- The Engineer may use the reduced size 36" x 36" ROAD WORK AHEAD (CW20-1D) sign mounted back to back with the reduced size 36" x 18" "END ROAD WORK" (G20-2) sign on low volume crossroads (see Note 4 under "Typical Construction Warning Sign Size and Spacing"). See the "Standard Highway Sign Designs for Texas" manual for sign details. The Engineer may omit the advance warning signs on low volume crossroads. The Engineer will determine whether a road is low volume as per TMUTCD Part 5. This information shall be shown in the plans.
- Based on existing field conditions, the Engineer/Inspector may require additional signs such as FLAGGER AHEAD, LOOSE GRAVEL, or other appropriate signs. When additional signs are required, these signs will be considered part of the minimum requirements. The Engineer/Inspector will determine the proper location and spacing of any sign not shown on the BC sheets, Traffic Control Plan sheets or the Work Zone Standard Sheets.
- The "ROAD WORK NEXT X MILES" (G20-1aT) sign shall be required at high volume crossroads to advise motorists of the length of construction in either direction from the intersection. The Engineer will determine whether a roadway is considered high volume.
- Additional traffic control devices may be shown elsewhere in the plans for higher volume crossroads.
- When work occurs in the intersection area, appropriate traffic control devices, as shown elsewhere in the plans or as determined by the Engineer/Inspector, shall be in place.

T-INTERSECTION

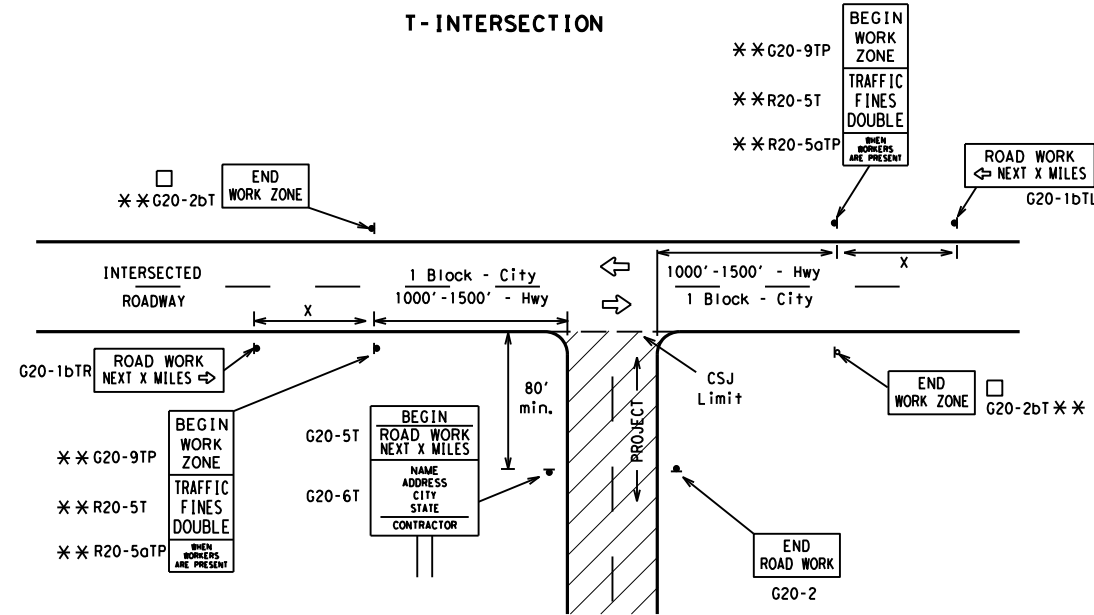

CSJ LIMITS AT T-INTERSECTION

- The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
- If construction closes the road at a T-intersection, the Contractor shall place the "CONTRACTOR NAME" (G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(10) also). The "ROAD WORK NEXT X MILES" left arrow (G20-1bTL) and "ROAD WORK NEXT X MILES" right arrow (G20-1bTR) signs shall be replaced by the detour signing called for in the plans.

TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING^{1,5,6}

Sign Number or Series	SIZE		SPACING	
	Conventional Road	Expressway/Freeway	Posted Speed MPH	Sign Δ Spacing "x" Feet (Apprx.)
CW20 ⁴	48" x 48"	48" x 48"	30	120
CW21			35	160
CW22			40	240
CW23			45	320
CW25			50	400
CW1, CW2, CW7, CW8, CW9, CW11, CW14	36" x 36"	48" x 48"	55	500 ²
CW3, CW4, CW5, CW6, CW8-3, CW10, CW12	48" x 48"	48" x 48"	60	600 ²
			65	700 ²
			70	800 ²
			75	900 ²
			80	1000 ²
			*	* ³


* For typical sign spacings on divided highways, expressways and freeways, see Part 6 of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) typical application diagrams or TCP Standard Sheets.

Δ Minimum distance from work area to first Advance Warning sign nearest the work area and/or distance between each additional sign.

GENERAL NOTES


- Special or larger size signs may be used as necessary.
- Distance between signs should be increased as required to have 1500 feet advance warning.
- Distance between signs should be increased as required to have 1/2 mile or more advance warning.
- 36" x 36" "ROAD WORK AHEAD" (CW20-1D) signs may be used on low volume crossroads at the discretion of the Engineer as per TMUTCD Part 5. See Note 2 under "Typical Location of Crossroad Signs".
- Only diamond shaped warning sign sizes are indicated.
- See sign size listing in "TMUTCD", Sign Appendix or the "Standard Highway Sign Designs for Texas" manual for complete list of available sign design sizes.

WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS

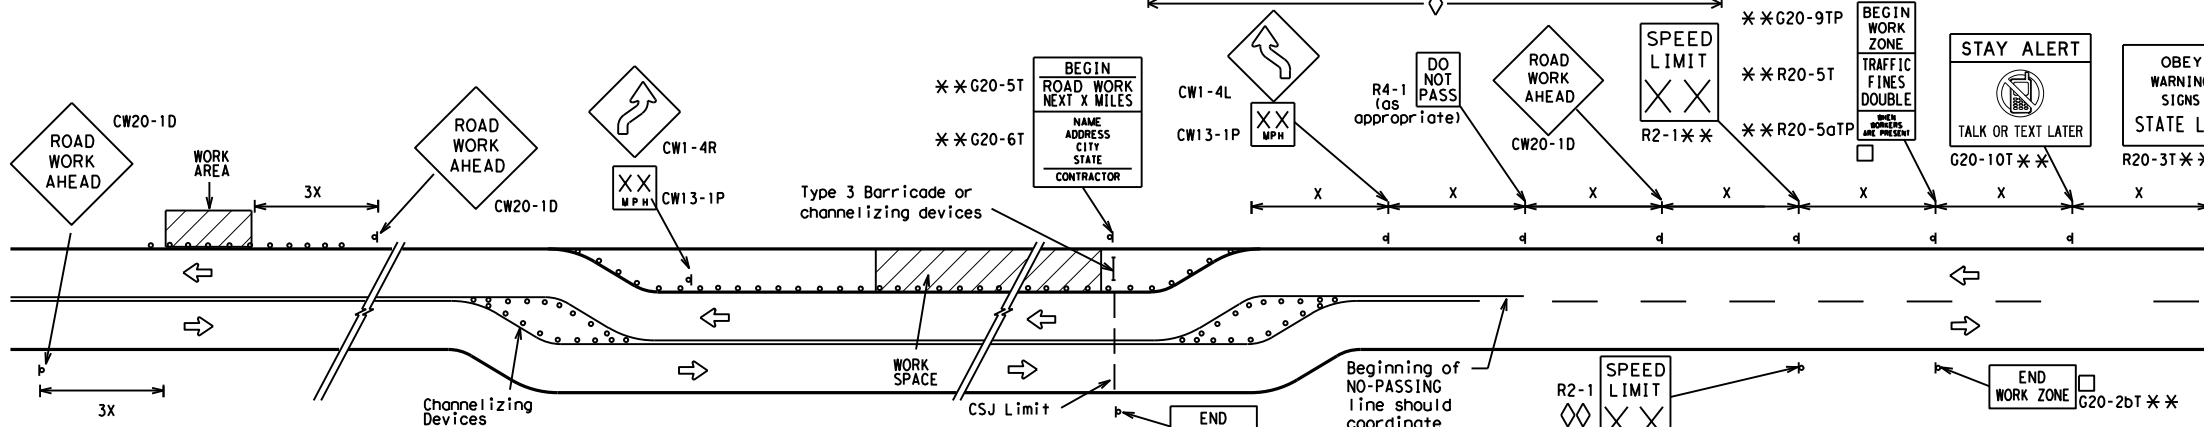


When extended distances occur between minimal work spaces, the Engineer/Inspector should ensure additional "ROAD WORK AHEAD" (CW20-1D) signs are placed in advance of these work areas to remind drivers they are still within the project limits. See the applicable TCP sheets for exact location and spacing of signs and channelizing devices.

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS

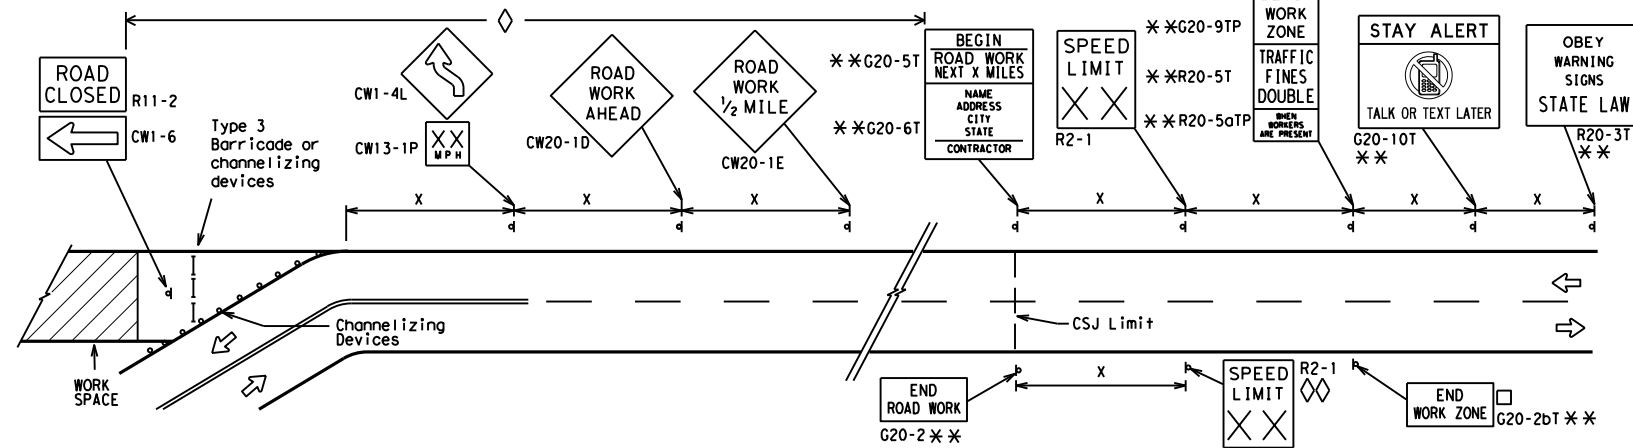

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING AT THE CSJ LIMITS

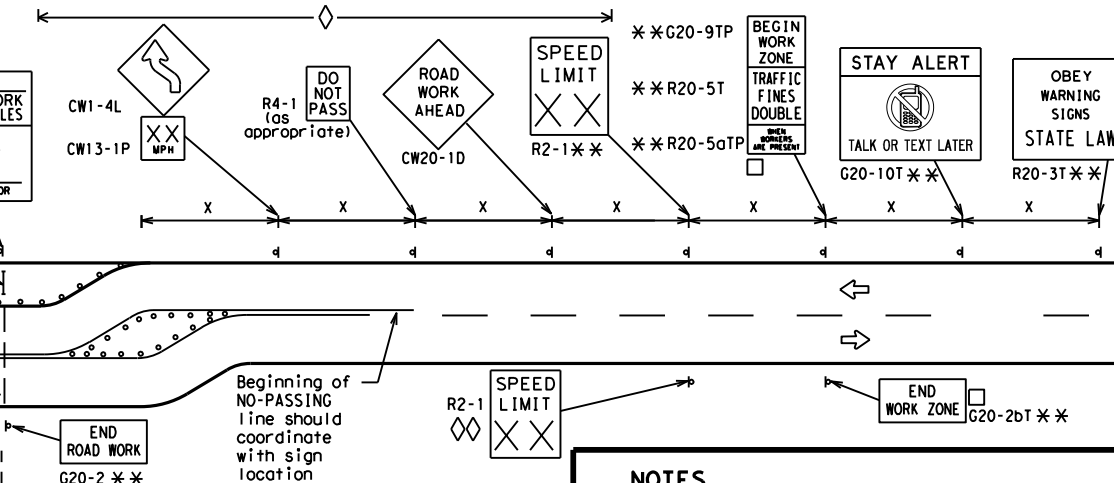

NOTES

- The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and "BEGIN ROAD WORK NEXT X MILES" (G20-5T) sign for each specific project. This distance shall replace the "x" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- The "BEGIN WORK ZONE" (G20-9TP) and "END WORK ZONE" (G20-2bT) shall be used as shown on the sample layout when advance signs are required outside the CSJ Limits. They inform the motorist of entering or leaving a part of the work zone lying outside the CSJ Limits where traffic fines may double if workers are present.
- CSJ limit signing is required for highway construction and maintenance work, with the exception of mobile operations.
- Area for placement of "ROAD WORK AHEAD" (CW20-1D) sign and other signs or devices as called for on the Traffic Control Plan.
- Contractor will install a regulatory speed limit sign at the end of the work zone.

LEGEND	
—	Type 3 Barricade
○ ○ ○	Channelizing Devices
■	Sign
X	See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.

SHEET 2 OF 12



BARRICADE AND CONSTRUCTION PROJECT LIMIT

BC(2)-21


FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	YKM	VICTORIA, ETC	21	

DATE: 10/6/2023 \$TIME\$ FILE: \$FILES\$

TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within Incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project. Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.

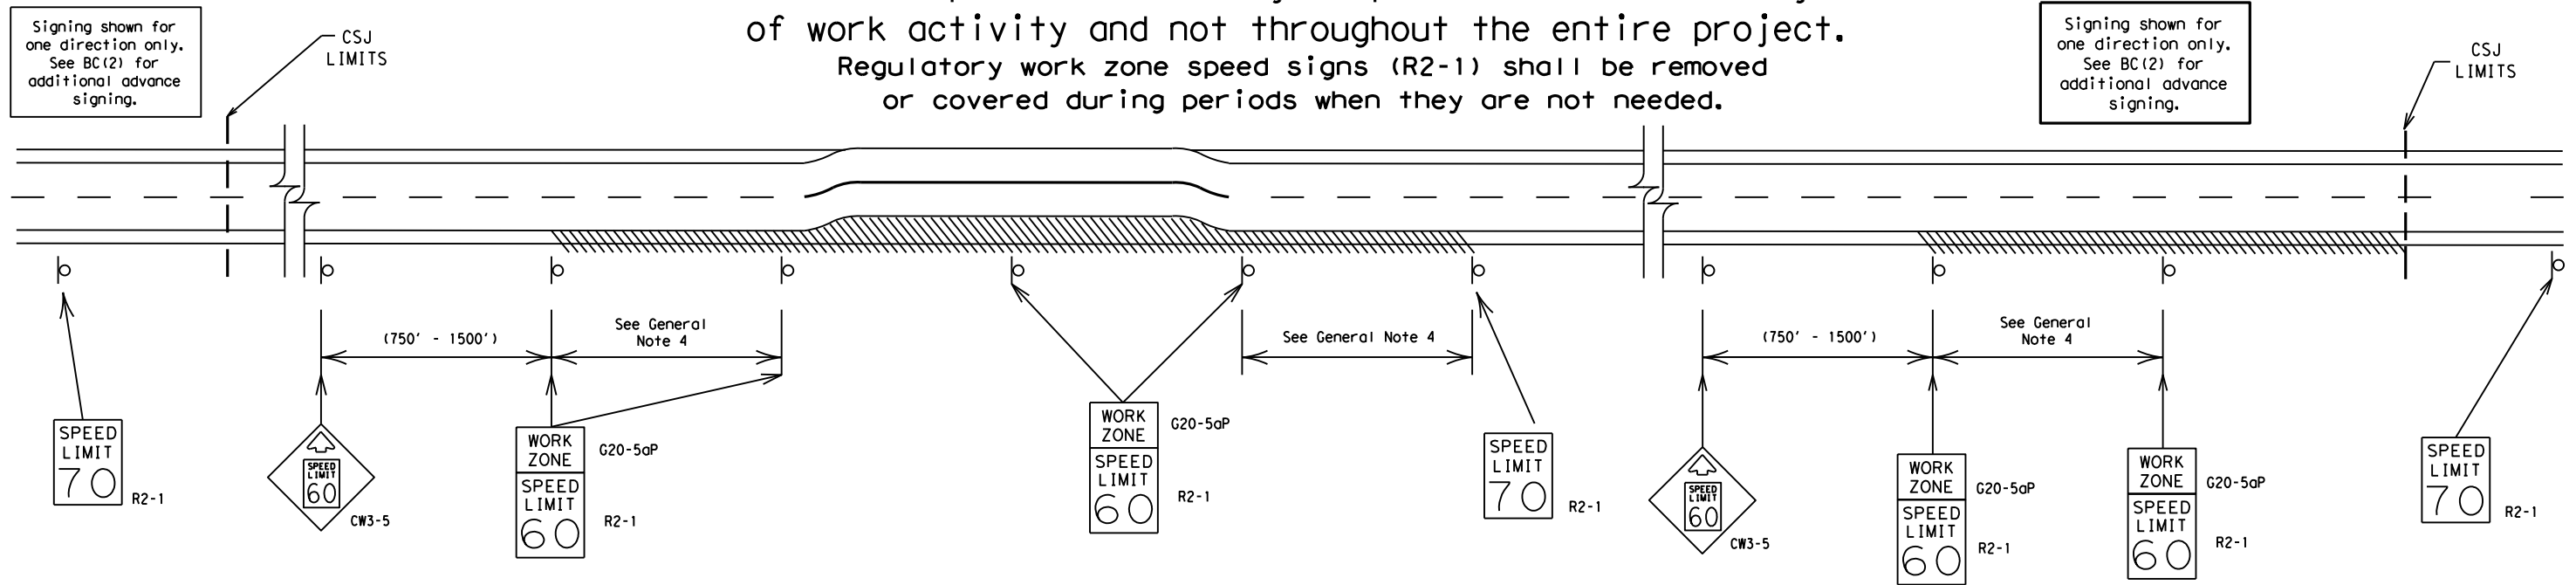

GUIDANCE FOR USE:

LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including:

- rough road or damaged pavement surface
- substantial alteration of roadway geometrics (diversions)
- construction detours
- grade
- width
- other conditions readily apparent to the driver

As long as any of these conditions exist, the work zone speed limit signs should remain in place.

SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the traveled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered. (See Removing or Covering on BC(4)).

GENERAL NOTES

- Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
- Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
- Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
- Frequency of work zone speed limit signs should be:

40 mph and greater	0.2 to 2 miles
35 mph and less	0.2 to 1 mile
- Regulatory speed limit signs shall have black legend and border on a white reflective background (See "Reflective Sheeting" on BC(4)).
- Fabrication, erection and maintenance of the "ADVANCE SPEED LIMIT" (CW3-5) sign, "WORK ZONE" (G20-5aP) plaque and the "SPEED LIMIT" (R2-1) signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
- Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
- Techniques that may help reduce traffic speeds include but are not limited to:
 - Law enforcement.
 - Flagger stationed next to sign.
 - Portable changeable message sign (PCMS).
 - Low-power (drone) radar transmitter.
 - Speed monitor trailers or signs.
- Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
- For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form #1204 in the TxDOT e-form system.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

SHEET 3 OF 12

		Traffic Safety Division Standard	
<h2>BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT</h2>			
<h3>BC (3) - 21</h3>			
FILE:	bc-21.dgn	DW:	TxDOT
© TxDOT	November 2002	CONT SECT:	JOB HIGHWAY
REVISIONS		0088 05	110, ETC US 59, ETC
9-07	8-14	DIST:	COUNTY SHEET NO.
7-13	5-21	YKM	VICTORIA, ETC 22

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


TYPICAL MINIMUM CLEARANCES FOR LONG TERM AND INTERMEDIATE TERM SIGNS

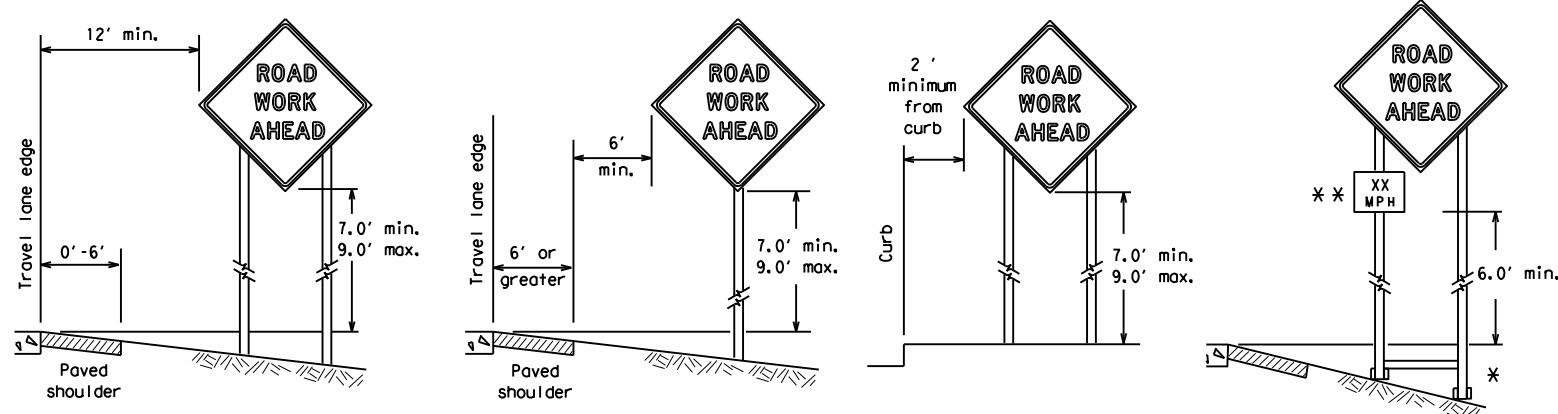

* When placing skid supports on unlevel ground, the leg post lengths must be adjusted so the sign appears straight and plumb. Objects shall NOT be placed under skids as a means of leveling.

** When plaques are placed on dual-leg supports, they should be attached to the upright nearest the travel lane. Supplemental plaques (advisory or distance) should not cover the surface of the parent sign.

ATTACHMENT FOR SIGN SUPPORTS

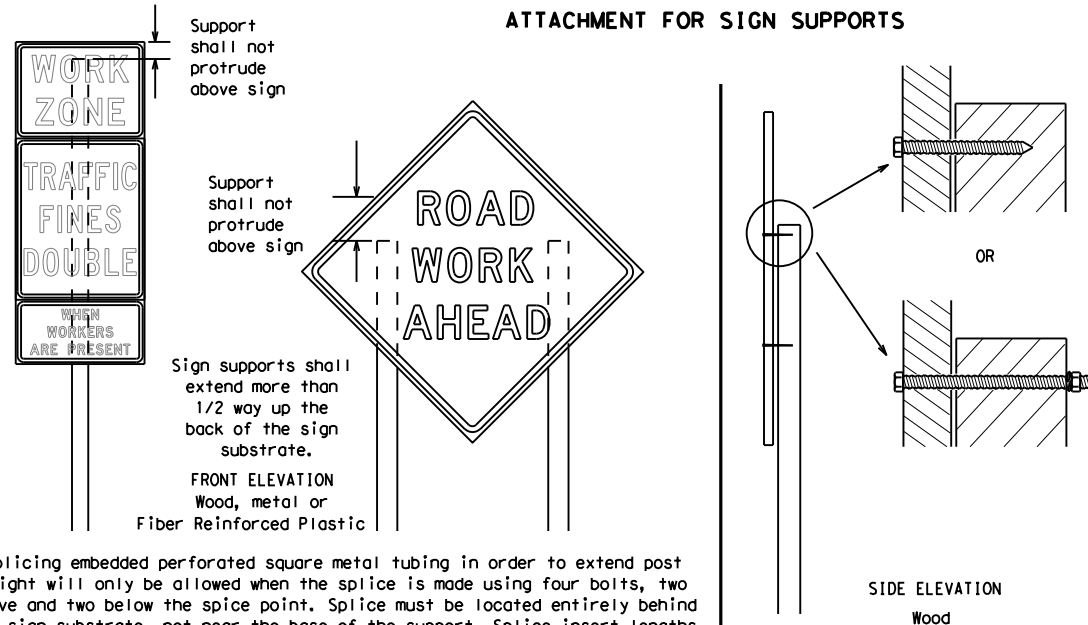

Nails shall NOT be allowed. Each sign shall be attached directly to the sign support. Multiple signs shall not be joined or spliced by any means. Wood supports shall not be extended or repaired by splicing or other means.

Splicing embedded perforated square metal tubing in order to extend post height will only be allowed when the splice is made using four bolts, two above and two below the splice point. Splice must be located entirely behind the sign substrate, not near the base of the support. Splice insert lengths should be at least 5 times nominal post size, centered on the splice and of at least the same gauge material.

GENERAL NOTES FOR WORK ZONE SIGNS

- Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer.
- Wooden sign posts shall be painted white.
- Barricades shall NOT be used as sign supports.
- All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and guide the traveling public safely through the work zone.
- The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
- The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD) for small roadside signs. Supports for temporary large roadside signs shall meet the requirements detailed on the Temporary Large Roadside Signs (TLRS) standard sheets. The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so the Engineer can verify the correct procedures are being followed.
- The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or damaged or marred reflective sheeting as directed by the Engineer/Inspector.
- Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1 inch.
- The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)

- The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in regard to crashworthiness and duration of work requirements.
 - Long-term stationary - work that occupies a location more than 3 days.
 - Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting more than one hour.
 - Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period.
 - Short, duration - work that occupies a location up to 1 hour.
 - Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

SIGN MOUNTING HEIGHT

- The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except as shown for supplemental plaques mounted below other signs.
- The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above the ground.
- Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
- Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to appropriate Long-term/Intermediate sign height.
- Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

SIZE OF SIGNS

- The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

SIGN SUBSTRATES

- The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports.
- "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave.
- All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6" centers. The Engineer may approve other methods of splicing the sign face.

REFLECTIVE SHEETING

- All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1).
- White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background.
- Orange sheeting, meeting the requirements of DMS-8300 Type B_{FL} or Type C_{FL}, shall be used for rigid signs with orange backgrounds.

SIGN LETTERS

- All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of first class workmanship in accordance with Department Standards and Specifications.

REMOVING OR COVERING

- When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
- Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any intersections where the sign may be seen from approaching traffic.
- Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely covered when not required.
- When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.
- Burlap shall NOT be used to cover signs.
- Duct tape or other adhesive material shall NOT be affixed to a sign face.
- Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

SIGN SUPPORT WEIGHTS


- Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used.
- The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
- Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights.
- Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
- Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall NOT be used.
- Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
- Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
- Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

FLAGS ON SIGNS

- Flags may be used to draw attention to warning signs. When used, the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.

STOP/SLOW PADDLES

- STOP/SLOW paddles are the primary method to control traffic by flaggers. The STOP/SLOW paddle size should be 24" x 24".
- STOP/SLOW paddles shall be retroreflectized when used at night.
- STOP/SLOW paddles may be attached to a staff with a minimum length of 6' to the bottom of the sign.
- Any lights incorporated into the STOP or SLOW paddle faces shall only be as specifically described in Section 6E.03 Hand Signaling Devices in the TMUTCD.

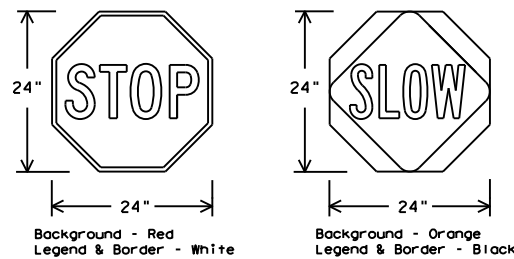

SHEETING REQUIREMENTS (WHEN USED AT NIGHT)		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	ORANGE	TYPE B _{FL} OR C _{FL} SHEETING
LEGEND & BORDER	WHITE	TYPE B OR C SHEETING
LEGEND & BORDER	BLACK	ACRYLIC NON-REFLECTIVE FILM



CONTRACTOR REQUIREMENTS FOR MAINTAINING PERMANENT SIGNS WITHIN THE PROJECT LIMITS

- Permanent signs are used to give notice of traffic laws or regulations, call attention to conditions that are potentially hazardous to traffic operations, show route designations, destinations, directions, distances, services, points of interest, and other geographical, recreational, specific service (LOGO), or cultural information. Drivers proceeding through a work zone need the same, if not better route guidance as normally installed on a roadway without construction.
- When permanent regulatory or warning signs conflict with work zone conditions, remove or cover the permanent signs until the permanent sign message matches the roadway condition. For details for covering large guide signs see the TS-CD standard.
- When existing permanent signs are moved and relocated due to construction purposes, they shall be visible to motorists at all times.
- If existing signs are to be relocated on their original supports, they shall be installed on crashworthy bases as shown on the SMD Standard sheets. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards. This work should be paid for under the appropriate pay item for relocating existing signs.
- If permanent signs are to be removed and relocated using temporary supports, the Contractor shall use crashworthy supports as shown on the BC standard sheets, TLRS standard sheets or the CWZTCD list. The signs shall meet the required mounting heights shown on the BC, or the SMD standard sheets during construction. This work should be paid for under the appropriate pay item for relocating existing signs.
- Any sign or traffic control device that is struck or damaged by the Contractor or his/her construction equipment shall be replaced as soon as possible by the Contractor to ensure proper guidance for the motorists. This will be subsidiary to Item 502.

SHEET 4 OF 12


		Traffic Safety Division Standard	
<h2>BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES</h2>			
<h3>BC (4) - 21</h3>			
FILE:	bc-21.dgn	DN:	TxDOT
© TxDOT	November 2002	CR:	TxDOT
REVISIONS		OW:	TxDOT
9-07	8-14	CK:	TxDOT
7-13	5-21	CONT	SECT
		JOB	
		HIGHWAY	
		0088 05 110, ETC US 59, ETC	
		DIST	COUNTY
		SHEET NO.	
		YKM	VICTORIA, ETC
		23	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

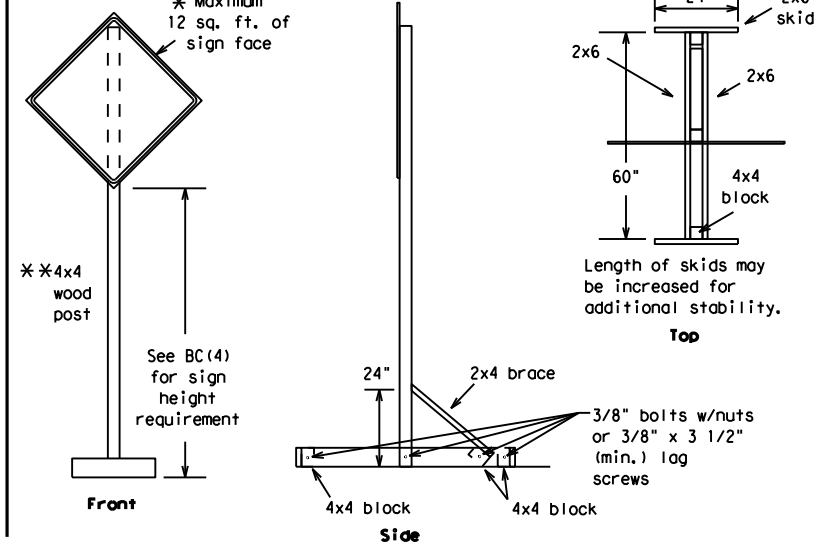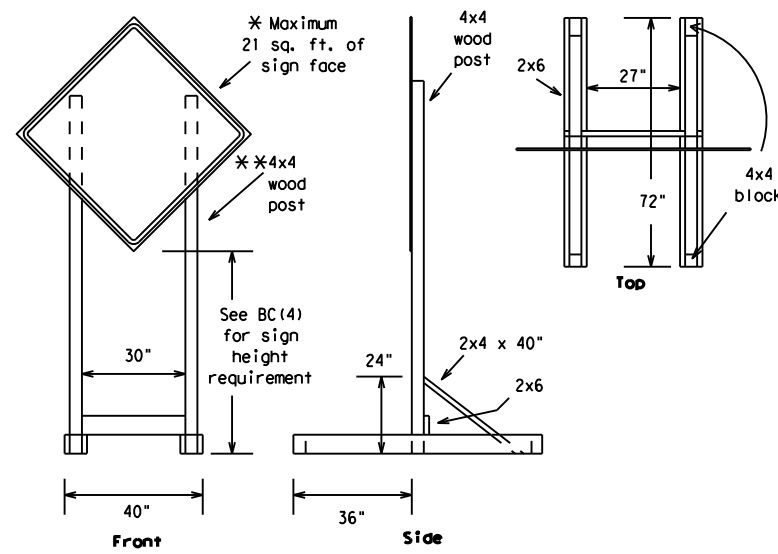



SKID MOUNTED WOOD SIGN SUPPORTS

* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

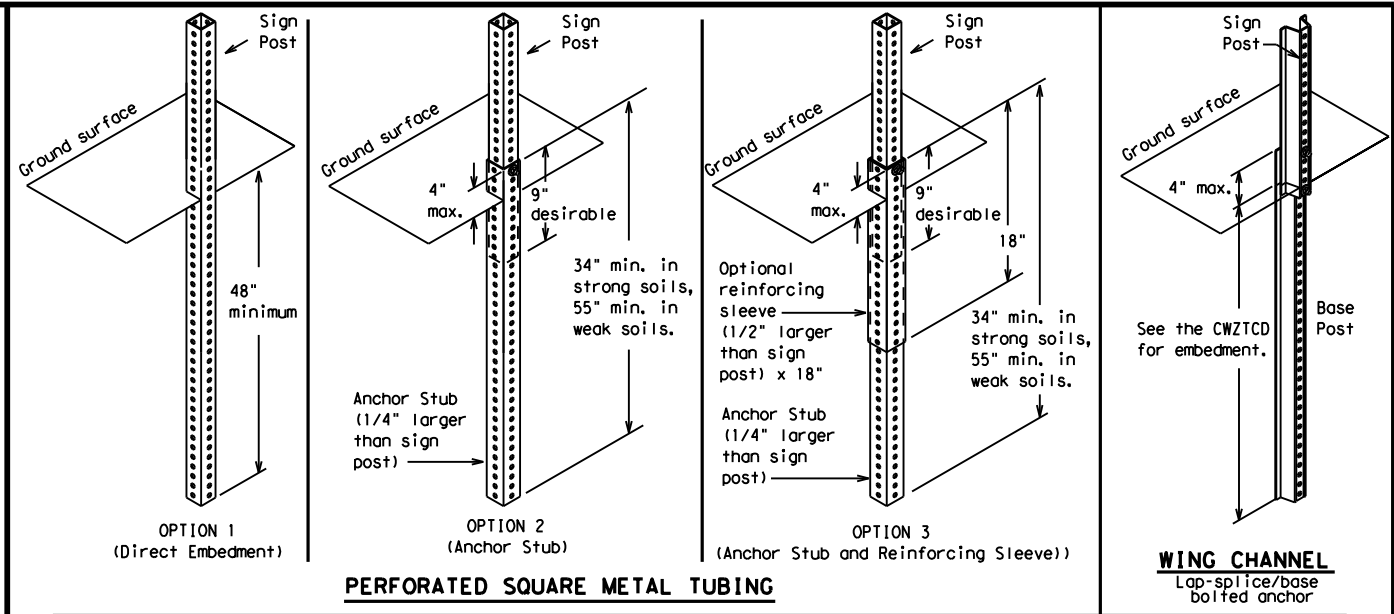

GROUND MOUNTED SIGN SUPPORTS

Refer to the CWZTCD and the manufacturer's installation procedure for each type sign support. The maximum sign square footage shall adhere to the manufacturer's recommendation. Two post installations can be used for larger signs.

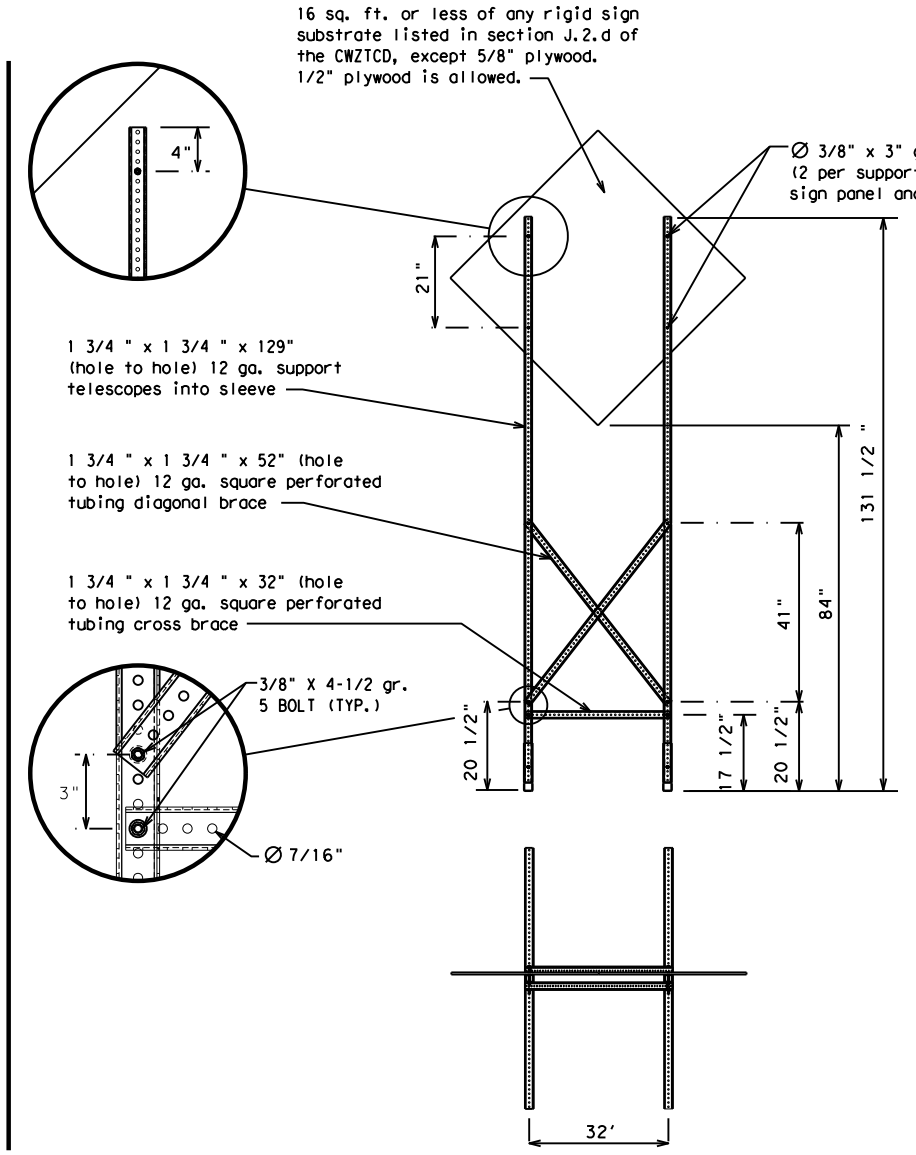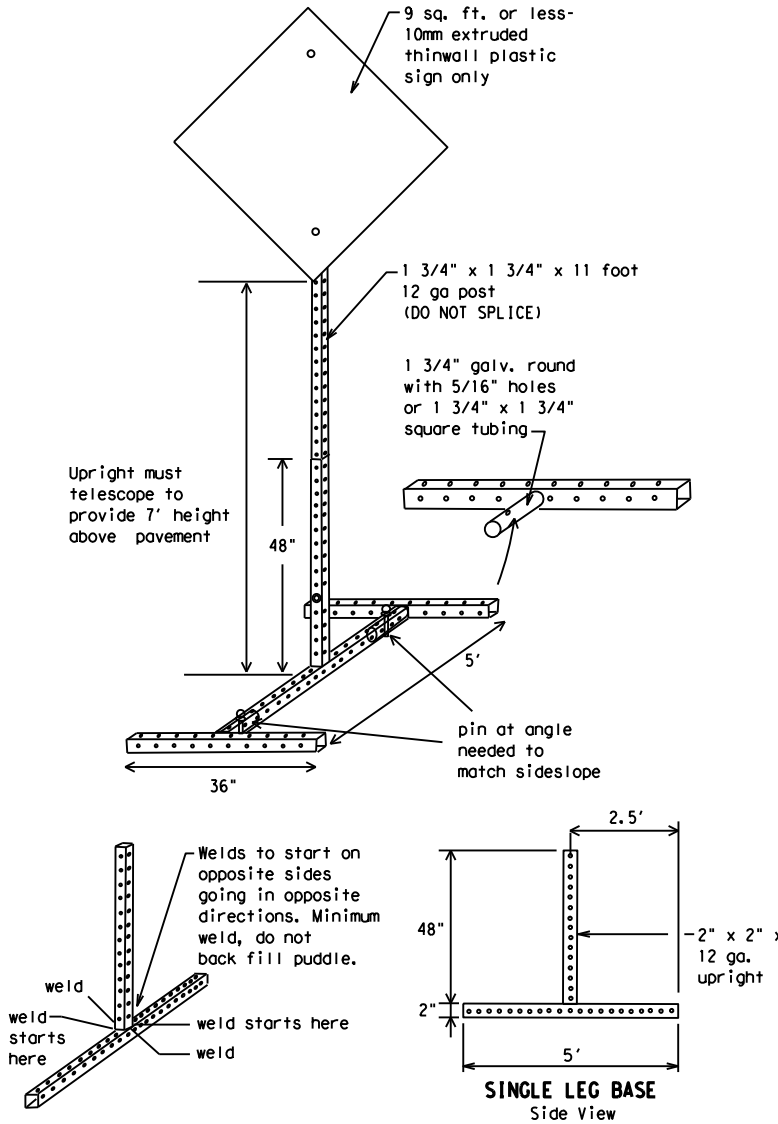

SKID MOUNTED PERFORATED SQUARE STEEL TUBING SIGN SUPPORTS

* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

WEDGE ANCHORS
Both steel and plastic Wedge Anchor Systems as shown on the SMD Standard Sheets may be used as temporary sign supports for signs up to 10 square feet of sign face. They may be set in concrete or in sturdy soils if approved by the Engineer. (See web address for "Traffic Engineering Standard Sheets" on BC(1)).

OTHER DESIGNS
MORE DETAILS OF APPROVED LONG/INTERMEDIATE AND SHORT TERM SUPPORTS CAN BE FOUND ON THE CWZTCD LIST. SEE BC(1) FOR WEBSITE LOCATION.

- GENERAL NOTES**
- Nails may be used in the assembly of wooden sign supports, but 3/8" bolts with nuts or 3/8" x 3 1/2" lag screws must be used on every joint for final connection.
 - No more than 2 sign posts shall be placed within a 7 ft. circle, except for specific materials noted on the CWZTCD List.
 - When project is completed, all sign supports and foundations shall be removed from the project site. This will be considered subsidiary to Item 502.
- * See BC(4) for definition of "Work Duration."
** Wood sign posts MUST be one piece. Splicing will NOT be allowed. Posts shall be painted white.
□ See the CWZTCD for the type of sign substrate that can be used for each approved sign support.

SHEET 5 OF 12
Texas Department of Transportation
Traffic Safety Division Standard

BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT

BC(5) - 21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS	0088 05	110, ETC	US 59, ETC						
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	YKM	VICTORIA, ETC	24					

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

WHEN NOT IN USE, REMOVE THE PCMS FROM THE RIGHT-OF-WAY OR PLACE THE PCMS BEHIND BARRIER OR GUARDRAIL WITH SIGN PANEL TURNED PARALLEL TO TRAFFIC

RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES

(The Engineer may approve other messages not specifically covered here.)

PORTABLE CHANGEABLE MESSAGE SIGNS

- The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
- Messages on PCMS should contain no more than 8 words (about four to eight characters per word), not including simple words such as "TO," "FOR," "AT," etc.
- Messages should consist of a single phase, or two phases that alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
- Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
- Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
- When in use, the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
- The message term "WEEKEND" should be used only if the work is to start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
- The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
- Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
- Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
- Do not use the word "Danger" in message.
- Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
- Do not display messages that scroll horizontally or vertically across the face of the sign.
- The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
- PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
- Each line of text should be centered on the message board rather than left or right justified.
- If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act." No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

Phase 1: Condition Lists

Road/Lane/Ramp Closure List

FREEWAY CLOSED X MILE	FRONTAGE ROAD CLOSED
ROAD CLOSED AT SH XXX	SHOULDER CLOSED XXX FT
ROAD CLSD AT FM XXXX	RIGHT LN CLOSED XXX FT
RIGHT X LANES CLOSED	RIGHT X LANES OPEN
CENTER LANE CLOSED	DAYTIME LANE CLOSURES
NIGHT LANE CLOSURES	I-XX SOUTH EXIT CLOSED
VARIOUS LANES CLOSED	EXIT XXX CLOSED X MILE
EXIT CLOSED	RIGHT LN TO BE CLOSED
MALL DRIVEWAY CLOSED	X LANES CLOSED TUE - FRI
XXXXXXXX BLVD CLOSED	

Other Condition List

ROADWORK XXX FT	ROAD REPAIRS XXXX FT
FLAGGER XXXX FT	LANE NARROWS XXXX FT
RIGHT LN NARROWS XXXX FT	TWO-WAY TRAFFIC XX MILE
MERGING TRAFFIC XXXX FT	CONST TRAFFIC XXX FT
LOOSE GRAVEL XXXX FT	UNEVEN LANES XXXX FT
DETOUR X MILE	ROUGH ROAD XXXX FT
ROADWORK PAST SH XXXX	ROADWORK NEXT FRI-SUN
BUMP XXXX FT	US XXX EXIT X MILES
TRAFFIC SIGNAL XXXX FT	LANES SHIFT *

* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

Phase 2: Possible Component Lists

Action to Take/Effect on Travel List

MERGE RIGHT	FORM X LINES RIGHT
DETOUR NEXT X EXITS	USE XXXXX RD EXIT
USE EXIT XXX	USE EXIT I-XX NORTH
STAY ON US XXX SOUTH	USE I-XX E TO I-XX N
TRUCKS USE US XXX N	WATCH FOR TRUCKS
WATCH FOR TRUCKS	EXPECT DELAYS
EXPECT DELAYS	PREPARE TO STOP
REDUCE SPEED XXX FT	END SHOULDER USE
USE OTHER ROUTES	WATCH FOR WORKERS
STAY IN LANE *	

Location List

AT FM XXXX
BEFORE RAILROAD CROSSING
NEXT X MILES
PAST US XXX EXIT
XXXXXXXX TO XXXXXXX
US XXX TO FM XXXX

Warning List

SPEED LIMIT XX MPH
MAXIMUM SPEED XX MPH
MINIMUM SPEED XX MPH
ADVISORY SPEED XX MPH
RIGHT LANE EXIT
USE CAUTION
DRIVE SAFELY
DRIVE WITH CARE

** Advance Notice List

TUE-FRI XX AM-X PM
APR XX-XX X PM-X AM
BEGINS MONDAY
BEGINS MAY XX
MAY X-X XX PM - XX AM
NEXT FRI-SUN
XX AM TO XX PM
NEXT TUE AUG XX
TONIGHT XX PM-XX AM

** See Application Guidelines Note 6.

WORD OR PHRASE	ABBREVIATION	WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD	Major	MAJ
Alternate	ALT	Miles	MI
Avenue	AVE	Miles Per Hour	MPH
Best Route	BEST RTE	Minor	MNR
Boulevard	BLVD	Monday	MON
Bridge	BRDG	Normal	NORM
Canal	CANT	North	N
Center	CTR	Northbound	(route) N
Construction Ahead	CONST AHD	Parking	PKING
CROSSING	XING	Road	RD
Detour Route	DETOUR RTE	Right Lane	RT LN
Do Not	DONT	Saturday	SAT
East	E	Service Road	SERV RD
Eastbound	(route) E	Shoulder	SHLDR
Emergency	EMER	Slippery	SLIP
Emergency Vehicle	EMER VEH	South	S
Entrance, Enter	ENT	Southbound	(route) S
Express Lane	EXP LN	Speed	SPD
Expressway	EXPWY	Street	ST
XXXX Feet	XXXX FT	Sunday	SUN
Fog Ahead	FOG AHD	Telephone	PHONE
Freeway	FRWY, FWY	Temporary	TEMP
Freeway Blocked	FWY BLKD	Thursday	THURS
Friday	FRI	To Downtown	TO DWNTN
Hazardous Driving	HAZ DRIVING	Traffic	TRAF
Hazardous Material	HAZMAT	Travelers	TRVLR
High-Occupancy Vehicle	HOV	Tuesday	TUES
Highway	Hwy	Time Minutes	TIME MIN
Hour(s)	HR, HRS	Upper Level	UPR LEVEL
Information	INFO	Vehicles (s)	VEH, VEHS
It Is	ITS	Warning	WARN
Junction	JCT	Wednesday	WED
Left	LFT	Weight Limit	WT LIMIT
Left Lane	LFT LN	West	W
Lane Closed	LN CLOSED	Westbound	(route) W
Lower Level	LWR LEVEL	Wet Pavement	WET PVMT
Maintenance	MAINT	Will Not	WONT

Roadway designation # IH-number, US-number, SH-number, FM-number

APPLICATION GUIDELINES

- Only 1 or 2 phases are to be used on a PCMS.
- The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
- A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
- A Location Phase is necessary only if a distance or location is not included in the first phase selected.
- If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS shall be limited to two phases, and should be understandable by themselves.
- For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

WORDING ALTERNATIVES

- The words RIGHT, LEFT and ALL can be interchanged as appropriate.
- Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
- EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
- Highway names and numbers replaced as appropriate.
- ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
- AHEAD may be used instead of distances if necessary.
- FT and MI, MILE and MILES interchanged as appropriate.
- AT, BEFORE and PAST interchanged as needed.
- Distances or AHEAD can be eliminated from the message if a location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC, THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

FULL MATRIX PCMS SIGNS

- When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
- When symbol signs, such as the "Flagger Symbol" (CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
- When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute for, or replace that sign.
- A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.

SHEET 6 OF 12



BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS)


BC (6) - 21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	YKM	VICTORIA, ETC	25	

DATE: 10/6/2023 \$TIME\$ FILE: \$FILES\$


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

- Barrier Reflectors shall be pre-qualified, and conform to the color and reflectivity requirements of DMS-8600. A list of prequalified Barrier Reflectors can be found at the Material Producer List web address shown on BC(1).
- Color of Barrier Reflectors shall be as specified in the TMUTCD. The cost of the reflectors shall be considered subsidiary to Item 512.

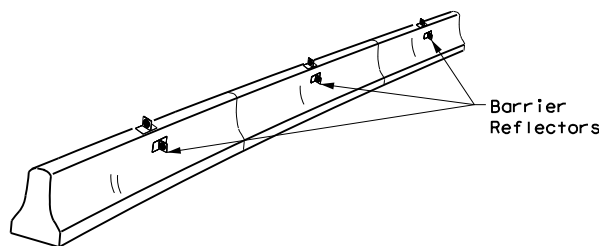

CONCRETE TRAFFIC BARRIER (CTB)

- Where traffic is on one side of the CTB, two (2) Barrier Reflectors shall be mounted in approximately the midsection of each section of CTB. An alternate mounting location is uniformly spaced at one end of each CTB. This will allow for attachment of a barrier grapple without damaging the reflector. The Barrier Reflector mounted on the side of the CTB shall be located directly below the reflector mounted on top of the barrier, as shown in the detail above.
- Where CTB separates two-way traffic, three barrier reflectors shall be mounted on each section of CTB. The reflector unit on top shall have two yellow reflective faces (Bi-Directional) while the reflectors on each side of the barrier shall have one yellow reflective face, as shown in the detail above.
- When CTB separates traffic traveling in the same direction, no barrier reflectors will be required on top of the CTB.
- Barrier Reflector units shall be yellow or white in color to match the edgeline being supplemented.
- Maximum spacing of Barrier Reflectors is forty (40) feet.
- Pavement markers or temporary flexible-reflective roadway marker tabs shall NOT be used as CTB delineation.
- Attachment of Barrier Reflectors to CTB shall be per manufacturer's recommendations.
- Missing or damaged Barrier Reflectors shall be replaced as directed by the Engineer.
- Single slope barriers shall be delineated as shown on the above detail.

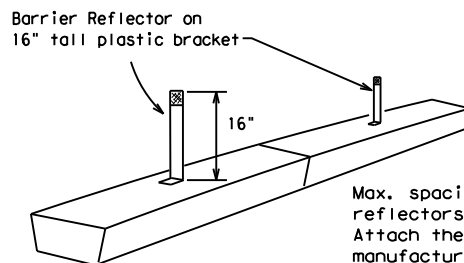


LOW PROFILE CONCRETE BARRIER (LPCB) USED IN WORK ZONES

LPCB is approved for use in work zone locations, where the posted speed is 45mph, or less. See Roadway Standard Sheet LPCB.

Max. spacing of barrier reflectors is 20 feet. Attach the delineators as per manufacturer's recommendations.

LOW PROFILE CONCRETE BARRIER (LPCB)

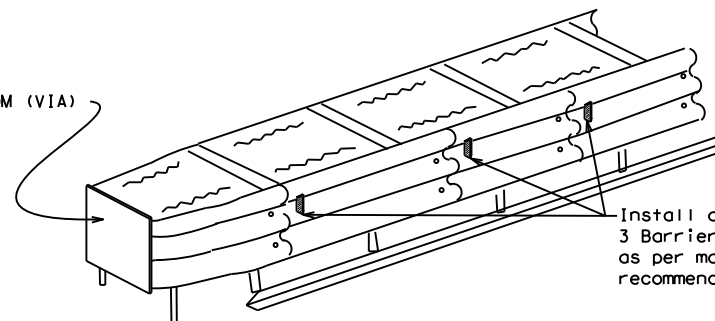

DELINEATION OF END TREATMENTS

END TREATMENTS FOR CTB'S USED IN WORK ZONES

End treatments used on CTB's in work zones shall meet the appropriate crashworthy standards as defined in the Manual for Assessing Safety Hardware (MASH). Refer to the CWZTCD List for approved end treatments and manufacturers.

BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS

WARNING LIGHTS


- Warning lights shall meet the requirements of the TMUTCD.
- Warning lights shall NOT be installed on barricades.
- Type A-Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall not be used with signs manufactured with Type B_{FL} or C_{FL} Sheeting meeting the requirements of Departmental Material Specification DMS-8300.
- Type-C and Type D 360 degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".
- The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.
- When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights.
- When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.
- The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

WARNING LIGHTS MOUNTED ON PLASTIC DRUMS


- Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.
- Type A random flashing warning lights are not intended for delineation and shall not be used in a series.
- A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used, the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.
- Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane changes, on lane closures, and on other similar conditions.
- Type A, Type C and Type D warning lights shall be installed at locations as detailed on other sheets in the plans.
- Warning lights shall not be installed on a drum that has a sign, chevron or vertical panel.
- The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS

- A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the discretion of the Contractor unless otherwise noted in the plans.
- The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed on the CWZTCD.
- The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches.
- Round reflectors shall be fully reflectorized, including the area where attached to the drum.
- Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it attaches to the drum.
- The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for DMS 8300-Type B or Type C.
- When used near two-way traffic, both sides of the warning reflector shall be reflectorized.
- The warning reflector should be mounted on the side of the handle nearest approaching traffic.
- The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

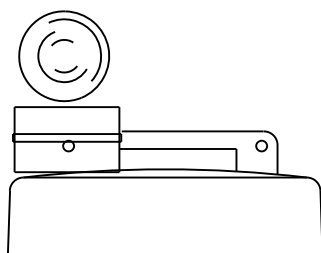

Type C Warning Light or approved substitute mounted on a drum adjacent to the travel way.

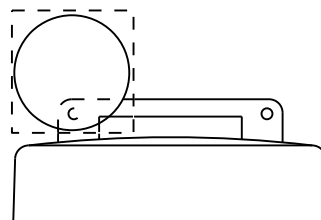


Warning reflector may be round or square. Must have a yellow reflective surface area of at least 30 square inches

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

Arrow Boards may be located behind channelizing devices in place for a shoulder taper or merging taper, otherwise they shall be delineated with four (4) channelizing devices placed perpendicular to traffic on the upstream side of traffic.

- The Flashing Arrow Board should be used for all lane closures on multi-lane roadways, or slow moving maintenance or construction activities on the travel lanes.
- Flashing Arrow Boards should not be used on two-lane, two-way roadways, detours, diversions or work on shoulders unless the "CAUTION" display (see detail below) is used.
- The Engineer/Inspector shall choose all appropriate signs, barricades and/or other traffic control devices that should be used in conjunction with the Flashing Arrow Board.
- The Flashing Arrow Board should be able to display the following symbols:

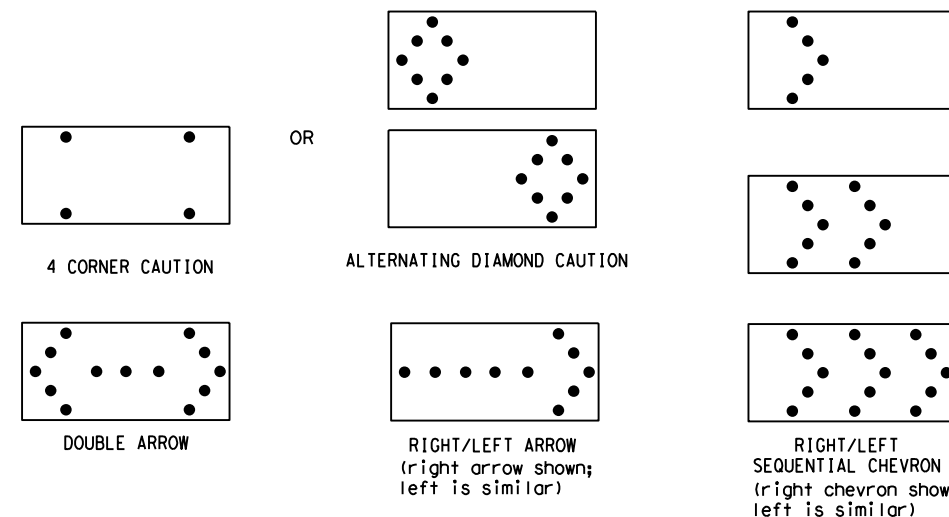

- The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
- The straight line caution display is NOT ALLOWED.
- The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.
- Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.
- The sequential arrow display is NOT ALLOWED.
- The flashing arrow display is the TxDOT standard; however, the sequential chevron display may be used during daylight operations.
- The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.
- A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.
- A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.
- Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway to bottom of panel.

REQUIREMENTS			
TYPE	MINIMUM SIZE	MINIMUM NUMBER OF PANEL LAMPS	MINIMUM VISIBILITY DISTANCE
B	30 x 60	13	3/4 mile
C	48 x 96	15	1 mile

ATTENTION
 Flashing Arrow Boards shall be equipped with automatic dimming devices.

WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE ARROW BOARD BEHIND CONCRETE TRAFFIC BARRIER OR GUARDRAIL.

FLASHING ARROW BOARDS

SHEET 7 OF 12

TRUCK-MOUNTED ATTENUATORS

- Truck-mounted attenuators (TMA) used on TxDOT facilities must meet the requirements outlined in the Manual for Assessing Safety Hardware (MASH).
- Refer to the CWZTCD for the requirements of Level 2 or Level 3 TMAs.
- Refer to the CWZTCD for a list of approved TMAs.
- TMAs are required on freeways unless otherwise noted in the plans.
- A TMA should be used anytime that it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.
- The only reason a TMA should not be required is when a work area is spread down the roadway and the work crew is an extended distance from the TMA.



BARRICADE AND CONSTRUCTION ARROW PANEL, REFLECTORS, WARNING LIGHTS & ATTENUATOR

BC (7) -21

FILE: bc-21.dgn	DN: TxDOT	CR: TxDOT	OW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	YKM	VICTORIA, ETC	26	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

GENERAL NOTES

- For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
- For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections, one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
- For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
- Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
- The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

GENERAL DESIGN REQUIREMENTS

Pre-qualified plastic drums shall meet the following requirements:




- Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
- The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
- Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
- Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
- The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
- The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectORIZED space between any two adjacent stripes shall not exceed 2 inches in width.
- Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
- Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
- Drum body shall have a maximum unballasted weight of 11 lbs.
- Drum and base shall be marked with manufacturer's name and model number.

RETROREFLECTIVE SHEETING

- The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials." Type A or Type B reflective sheeting shall be supplied unless otherwise specified in the plans.
- The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.


BALLAST

- Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
- Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
- Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
- The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
- When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
- Ballast shall not be placed on top of drums.
- Adhesives may be used to secure base of drums to pavement.

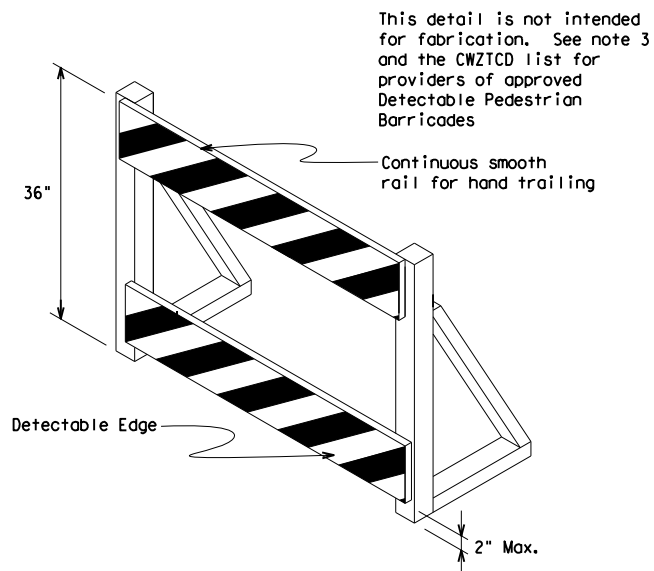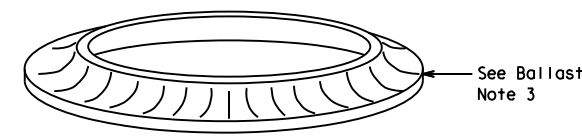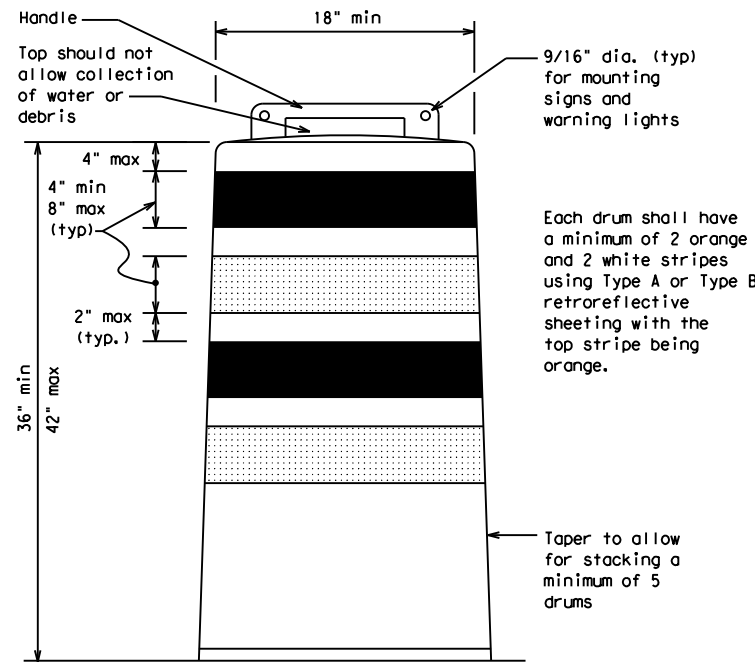

DETECTABLE PEDESTRIAN BARRICADES

- When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility. Refer to WZ(BTS-2) for Pedestrian Control requirements for Sidewalk Diversions, Sidewalk Detours and Crosswalk Closures.
- Where pedestrians with visual disabilities normally use the closed sidewalk, a Detectable Pedestrian Barricade shall be placed across the full width of the closed sidewalk instead of a Type 3 Barricade.
- Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
- Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines (ADAAG)" and should not be used as a control for pedestrian movements.
- Warning lights shall not be attached to detectable pedestrian barricades.
- Detectable pedestrian barricades should use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.

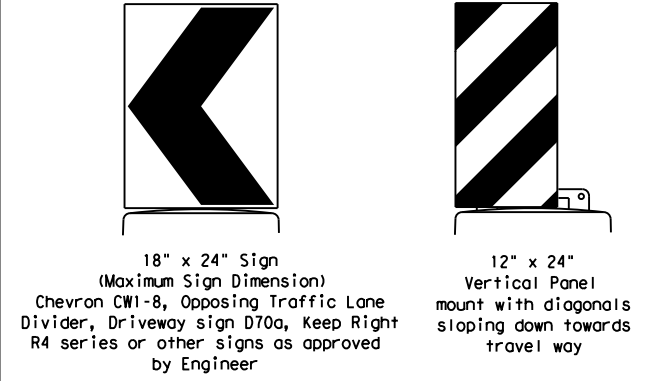

Plywood, Aluminum or Metal sign substrates shall NOT be used on plastic drums


SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS

- Signs used on plastic drums shall be manufactured using substrates listed on the CWZTCD.
- Chevrons and other work zone signs with an orange background shall be manufactured with Type B_{FL} or Type C_{FL} Orange sheeting meeting the color and retroreflectivity requirements of DMS-8300, "Sign Face Material," unless otherwise specified in the plans.
- Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A or Type B. Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane.
- Other sign messages (text or symbolic) may be used as approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below.
- Signs shall be installed using a 1/2 inch bolt (nominal) and nut, two washers, and one locking washer for each connection.
- Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2 inch beyond nuts.
- Chevrons may be placed on drums on the outside of curves, on merging tapers or on shifting tapers. When used in these locations, they may be placed on every drum or spaced not more than on every third drum. A minimum of three (3) should be used at each location called for in the plans.
- R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.

SHEET 8 OF 12


		<i>Traffic Safety Division Standard</i>	
BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES			
BC (8) - 21			
FILE: bc-21.dgn	DWG: TxDOT	CHK: TxDOT	APP: TxDOT
© TxDOT November 2002	CONT: 0088	SECT: 05	JOB: 110, ETC
REVISIONS		DATE	BY
4-03	8-14	9-07	5-21
7-13		YKM	VICTORIA, ETC
			27

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

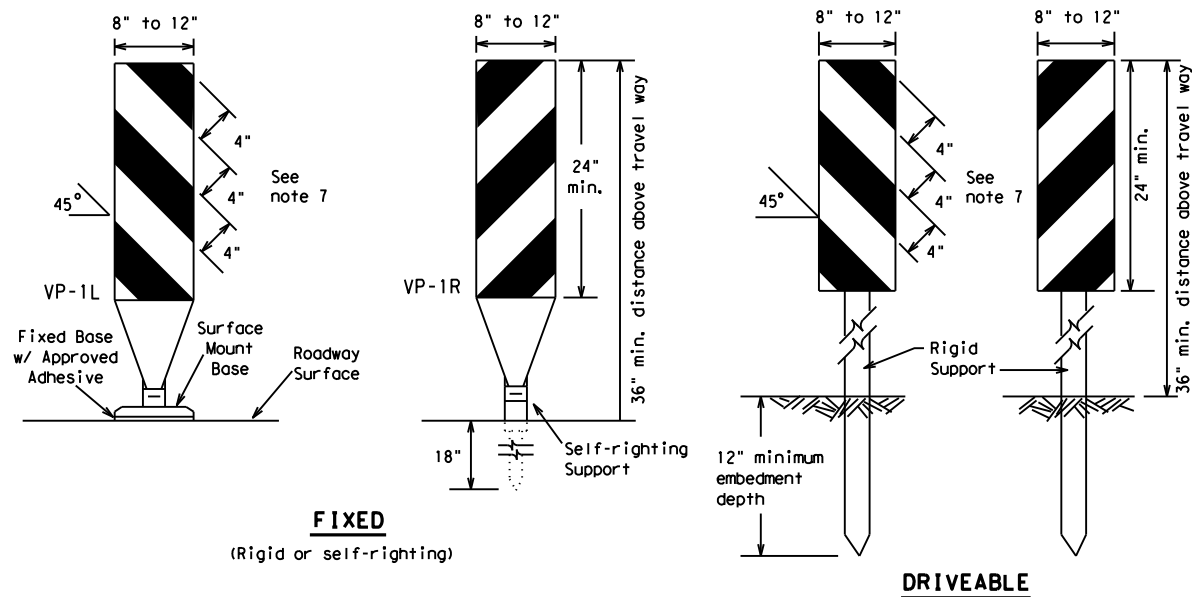

FIXED
(Rigid or self-righting)


DRIVEABLE

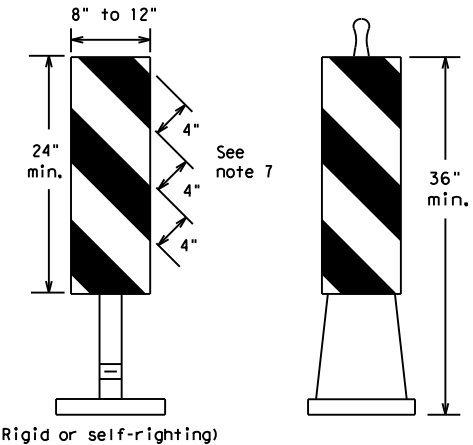

PORTABLE


VERTICAL PANELS (VPs)

- Vertical Panels (VP's) are normally used to channelize traffic or divide opposing lanes of traffic.
- VP's may be used in daytime or nighttime situations. They may be used at the edge of shoulder drop-offs and other areas such as lane transitions where positive daytime and nighttime delineation is required. The Engineer/Inspector shall refer to the Roadway Design Manual for additional requirements on the use VP's for drop-offs.
- VP's should be mounted back to back if used at the edge of cuts adjacent to two-way two lane roadways. Stripes are to be reflective orange and reflective white and should always slope downward toward the travel lane.
- VP's used on expressways and freeways or other high speed roadways, may have more than 270 square inches of retroreflective area facing traffic.
- Self-righting supports are available with portable base. See "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Sheeting for the VP's shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300, unless noted otherwise.
- Where the height of reflective material on the vertical panel is 36 inches or greater, a panel stripe of 6 inches shall be used.

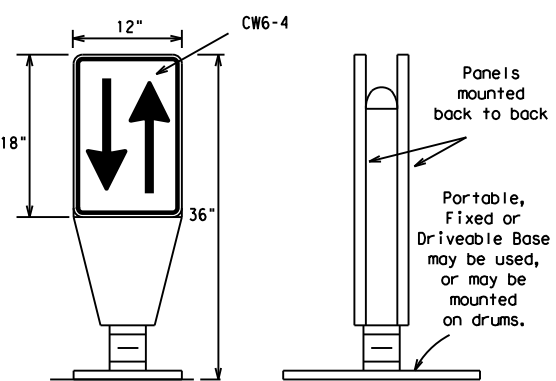


OPPOSING TRAFFIC LANE DIVIDERS (OTLD)

- Opposing Traffic Lane Dividers (OTLD) are delineation devices designed to convert a normal one-way roadway section to two-way operation. OTLD's are used on temporary centerlines. The upward and downward arrows on the sign's face indicate the direction of traffic on either side of the divider. The base is secured to the pavement with an adhesive or rubber weight to minimize movement caused by a vehicle impact or wind gust.
- The OTLD may be used in combination with 42" cones or VPs.
- Spacing between the OTLD shall not exceed 500 feet. 42" cones or VPs placed between the OTLD's should not exceed 100 foot spacing.
- The OTLD shall be orange with a black non-reflective legend. Sheeting for the OTLD shall be retroreflective Type B_{FL} or Type C_{FL} conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.

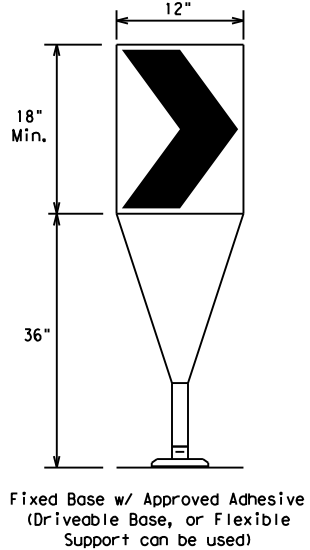

- The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
- Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
- Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
- To be effective, the chevron should be visible for at least 500 feet.
- Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type B_{FL} or Type C_{FL} conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
- For Long Term Stationary use on tapers or transitions on freeways and divided highways, self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

CHEVRONS

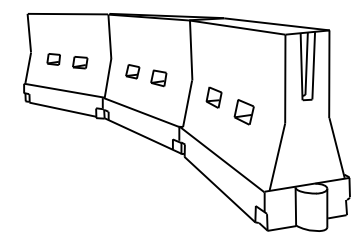

LONGITUDINAL CHANNELIZING DEVICES (LCD)

- LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
- LCDs may be used instead of a line of cones or drums.
- LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
- LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
- LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10). Place reflective sheeting near the top of the LCD along the full length of the device.

WATER BALLASTED SYSTEMS USED AS BARRIERS

- Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate Manual for Assessing Safety Hardware (MASH) crashworthiness requirements based on roadway speed and barrier application.
- Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
- Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
- When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long canes and the top of the unit shall not be less than 32 inches in height.

HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS

GENERAL NOTES

- Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
- Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
- Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
- Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
- The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.

Posted Speed	Formula	Minimum Desirable Taper Lengths * *			Suggested Maximum Spacing of Channelizing Devices	
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent
30	L = WS ² / 60	150'	165'	180'	30'	60'
35		205'	225'	245'	35'	70'
40		265'	295'	320'	40'	80'
45	L = WS	450'	495'	540'	45'	90'
50		500'	550'	600'	50'	100'
55		550'	605'	660'	55'	110'
60		600'	660'	720'	60'	120'
65		650'	715'	780'	65'	130'
70		700'	770'	840'	70'	140'
75		750'	825'	900'	75'	150'
80		800'	880'	960'	80'	160'

* * * Taper lengths have been rounded off.
L=Length of Taper (FT.) W=Width of Offset (FT.)
S=Posted Speed (MPH)

SUGGESTED MAXIMUM SPACING OF CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS

SHEET 9 OF 12



BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC (9) - 21

FILE: bc-21.dgn	DW: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	YKM	VICTORIA, ETC	28	

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

TYPE 3 BARRICADES

1. Refer to the Compliant Work Zone Traffic Control Devices List (CWZTCD) for details of the Type 3 Barricades and a list of all materials used in the construction of Type 3 Barricades.
2. Type 3 Barricades shall be used at each end of construction projects closed to all traffic.
3. Barricades extending across a roadway should have stripes that slope downward in the direction toward which traffic must turn in detouring. When both right and left turns are provided, the chevron striping may slope downward in both directions from the center of the barricade. Where no turns are provided at a closed road, striping should slope downward in both directions toward the center of roadway.
4. Striping of rails, for the right side of the roadway, should slope downward to the left. For the left side of the roadway, striping should slope downward to the right.
5. Identification markings may be shown only on the back of the barricade rails. The maximum height of letters and/or company logos used for identification shall be 1".
6. Barricades shall not be placed parallel to traffic unless an adequate clear zone is provided.
7. Warning lights shall NOT be installed on barricades.
8. Where barricades require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand is recommended. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight. Sand bags shall not be stacked in a manner that covers any portion of a barricade rails reflective sheeting. Rock, concrete, iron, steel or other solid objects will NOT be permitted. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall not be used for sandbags. Sandbags shall only be placed along or upon the base supports of the device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners.
9. Sheeting for barricades shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300 unless otherwise noted.

Barricades shall NOT be used as a sign support.




TYPICAL STRIPING DETAIL FOR BARRICADE RAIL



Stiffener may be inside or outside of support, but no more than 2 stiffeners shall be allowed on one barricade.

TYPICAL PANEL DETAIL FOR SKID OR POST TYPE BARRICADES

Each roadway of a divided highway shall be barricaded in the same manner.

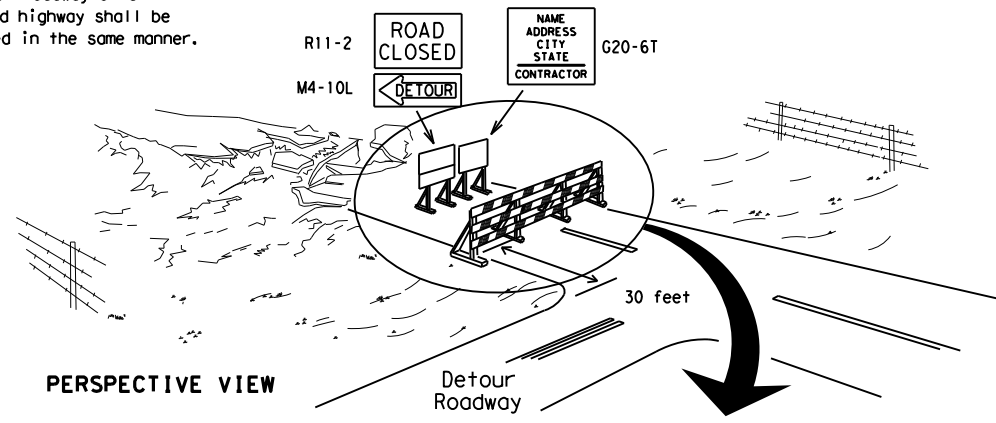

PERSPECTIVE VIEW


The three rails on Type 3 barricades shall be reflectorized orange and reflective white stripes on one side facing one-way traffic and both sides for two-way traffic. Barricade striping should slant downward in the direction of detour.




PLAN VIEW

1. Signs should be mounted on independent supports at a 7 foot mounting height in center of roadway. The signs should be a minimum of 10 feet behind Type 3 Barricades.
2. Advance signing shall be as specified elsewhere in the plans.

TYPE 3 BARRICADE (POST AND SKID) TYPICAL APPLICATION

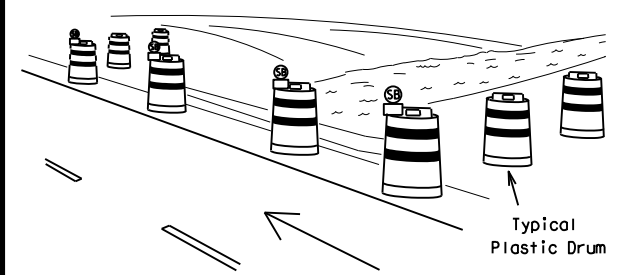

PERSPECTIVE VIEW

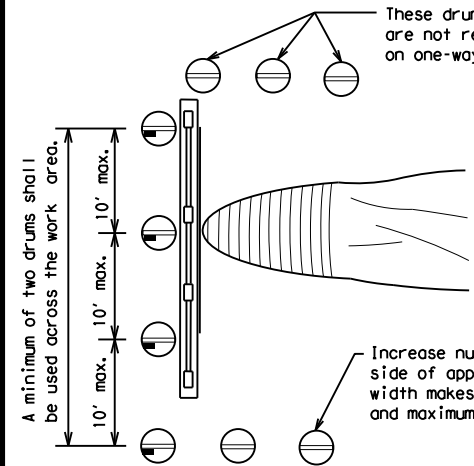


PLAN VIEW

Increase number of plastic drums on the side of approaching traffic if the crown width makes it necessary. (minimum of 2 and maximum of 4 drums)

1. Where positive redirection capability is provided, drums may be omitted.
2. Plastic construction fencing may be used with drums for safety as required in the plans.
3. Vertical Panels on flexible support may be substituted for drums when the shoulder width is less than 4 feet.
4. When the shoulder width is greater than 12 feet, steady-burn lights may be omitted if drums are used.
5. Drums must extend the length of the culvert widening.

LEGEND	
	Plastic drum
	Plastic drum with steady burn light or yellow warning reflector
	Steady burn warning light or yellow warning reflector

CULVERT WIDENING OR OTHER ISOLATED WORK WITHIN THE PROJECT LIMITS

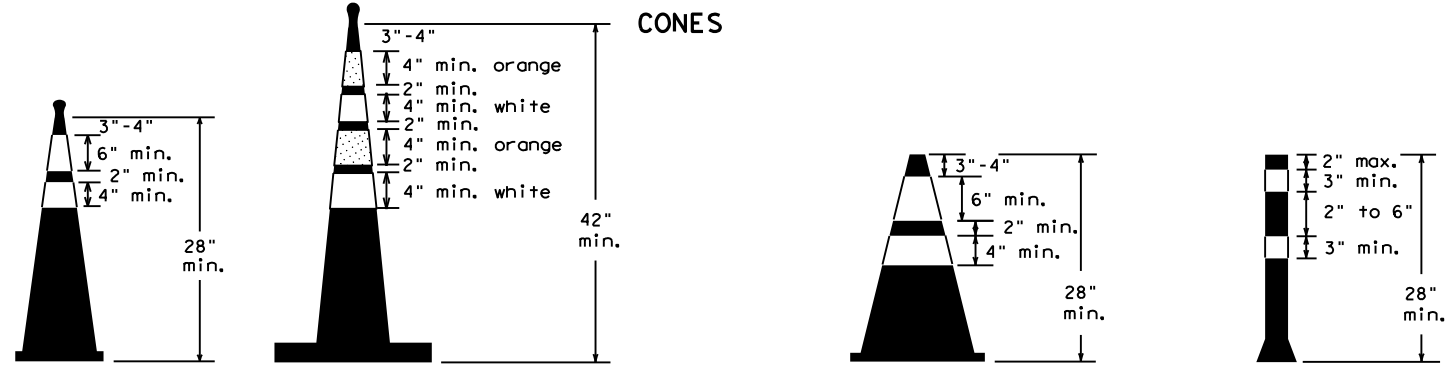


Two-Piece cones

One-Piece cones

Tubular Marker

28" Cones shall have a minimum weight of 9 1/2 lbs.
42" 2-piece cones shall have a minimum weight of 30 lbs. including base.

1. Traffic cones and tubular markers shall be predominantly orange, and meet the height and weight requirements shown above.
2. One-piece cones have the body and base of the cone molded in one consolidated unit. Two-piece cones have a cone shaped body and a separate rubber base, or ballast, that is added to keep the device upright and in place.
3. Two-piece cones may have a handle or loop extending up to 8" above the minimum height shown, in order to aid in retrieving the device.
4. Cones or tubular markers shall have white or white and orange reflective bands as shown above. The reflective bands shall have a smooth, sealed outer surface and meet the requirements of Departmental Material Specification DMS-8300 Type A or Type B.
5. 28" cones and tubular markers are generally suitable for short duration and short-term stationary work as defined on BC(4). These should not be used for intermediate-term or long-term stationary work unless personnel is on-site to maintain them in their proper upright position.
6. 42" two-piece cones, vertical panels or drums are suitable for all work zone durations.
7. Cones or tubular markers used on each project should be of the same size and shape.

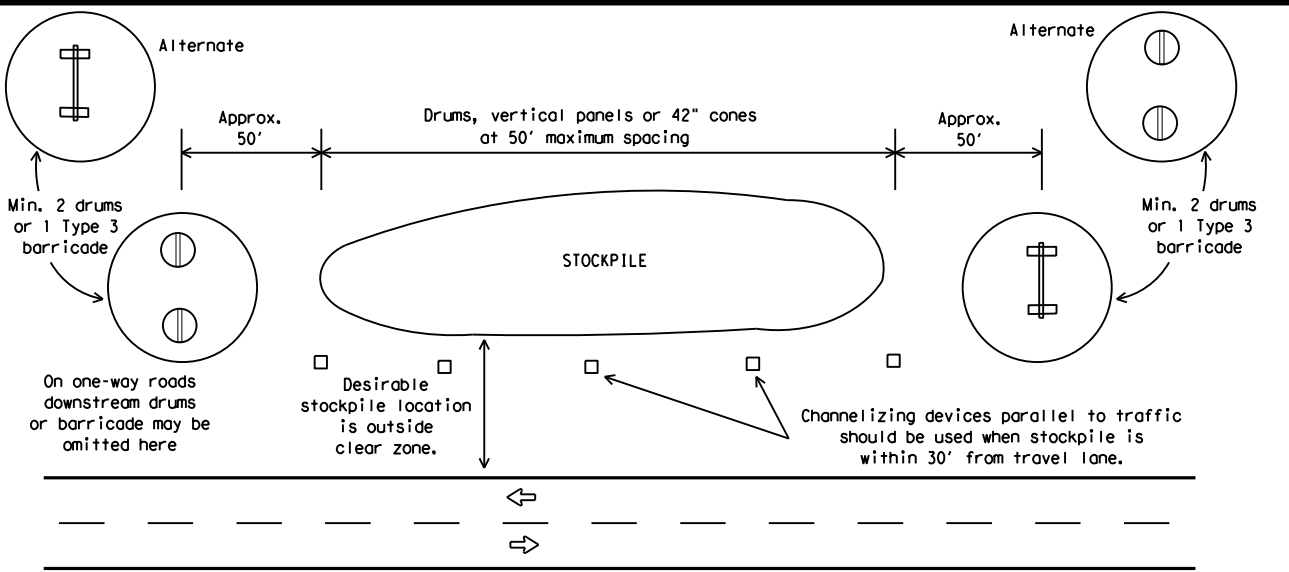

TRAFFIC CONTROL FOR MATERIAL STOCKPILES



BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC (10) - 21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	OW:	TxDOT	CR:	TxDOT
©TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0088	05	110, ETC	US 59, ETC				
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	YKM	VICTORIA, ETC	29					

WORK ZONE PAVEMENT MARKINGS

GENERAL

- The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
- Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Additional supplemental pavement marking details may be found in the plans or specifications.
- Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
- When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
- When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
- All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

RAISED PAVEMENT MARKERS

- Raised pavement markers are to be placed according to the patterns on BC(12).
- All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

PREFABRICATED PAVEMENT MARKINGS

- Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
- Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


MAINTAINING WORK ZONE PAVEMENT MARKINGS

- The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
- Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
- The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
- Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

REMOVAL OF PAVEMENT MARKINGS

- Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
- The above shall not apply to detours in place for less than three days, where flaggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
- Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
- The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
- Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
- Blast cleaning may be used but will not be required unless specifically shown in the plans.
- Over-painting of the markings SHALL NOT BE permitted.
- Removal of raised pavement markers shall be as directed by the Engineer.
- Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
- Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

Temporary Flexible-Reflective Roadway Marker Tabs

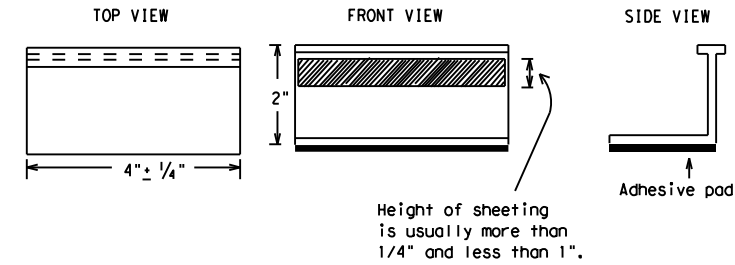

**STAPLES OR NAILS SHALL NOT BE USED TO SECURE
TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARKER
TABS TO THE PAVEMENT SURFACE**

- Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242.
- Tabs detailed on this sheet are to be inspected and accepted by the Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" or "B" below may be imposed to assure quality before placement on the roadway.
 - Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance.
 - Select five (5) tabs and perform the following test. Affix five (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed of 35 to 40 miles per hour, four (4) times in each direction. No more than one (1) out of the five (5) reflective surfaces shall be lost or displaced as a result of this test.
- Small design variances may be noted between tab manufacturers.
- See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work.

RAISED PAVEMENT MARKERS USED AS GUIDEMARKS

- Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200.
- All temporary construction raised pavement markers provided on a project shall be of the same manufacturer.
- Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete surfaces.

Guidemarks shall be designated as:
 YELLOW - (two amber reflective surfaces with yellow body).
 WHITE - (one silver reflective surface with white body).

DEPARTMENTAL MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
TRAFFIC BUTTONS	DMS-4300
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8241
TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242

A list of prequalified reflective raised pavement markers, non-reflective traffic buttons, roadway marker tabs and other pavement markings can be found at the Material Producer List web address shown on BC(1).

SHEET 11 OF 12



BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS

BC(11)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS		0088	05	110, ETC
2-98	9-07	5-21		US 59, ETC
1-02	7-13			
11-02	8-14			
	DIST	COUNTY		SHEET NO.
	YKM	VICTORIA, ETC		30


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

PAVEMENT MARKING PATTERNS




REFLECTORIZED PAVEMENT MARKINGS - PATTERN A

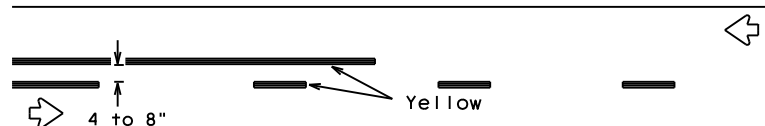


REFLECTORIZED PAVEMENT MARKINGS - PATTERN B

Pattern A is the TXDOT Standard, however Pattern B may be used if approved by the Engineer. Prefabricated markings may be substituted for reflectORIZED pavement markings.

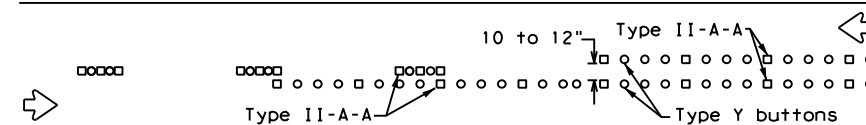

RAISED PAVEMENT MARKERS - PATTERN A

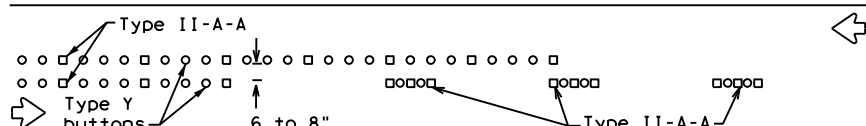


RAISED PAVEMENT MARKERS - PATTERN B

CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO-LANE, TWO-WAY HIGHWAYS




REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

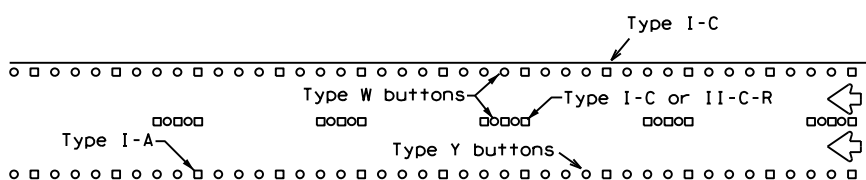


RAISED PAVEMENT MARKERS

EDGE & LANE LINES FOR DIVIDED HIGHWAY

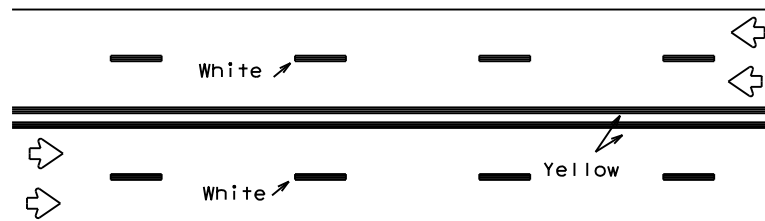


REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

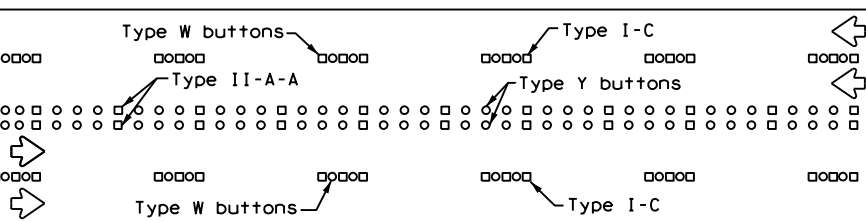


RAISED PAVEMENT MARKERS

LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

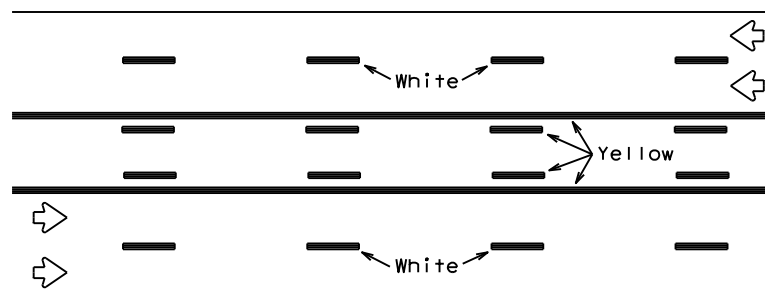

REFLECTORIZED PAVEMENT MARKINGS


Prefabricated markings may be substituted for reflectORIZED pavement markings.

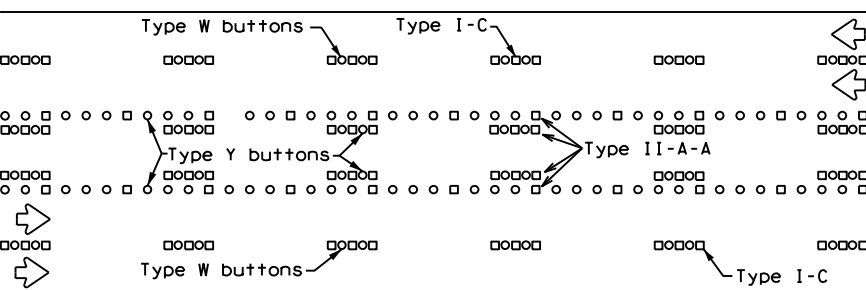



RAISED PAVEMENT MARKERS

TWO-WAY LEFT TURN LANE


STANDARD WORK ZONE PAVEMENT MARKINGS DETAILS

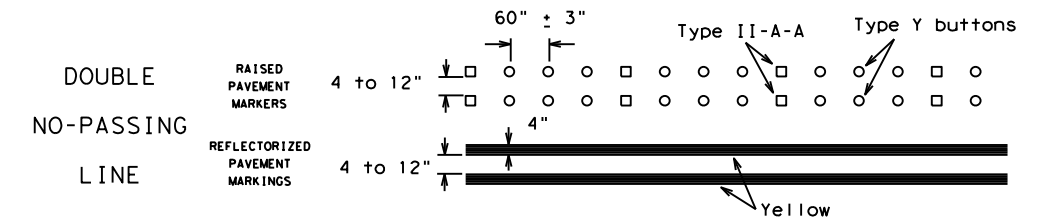


SOLID LINES

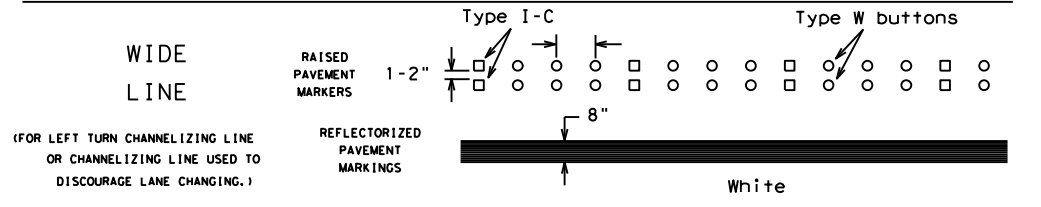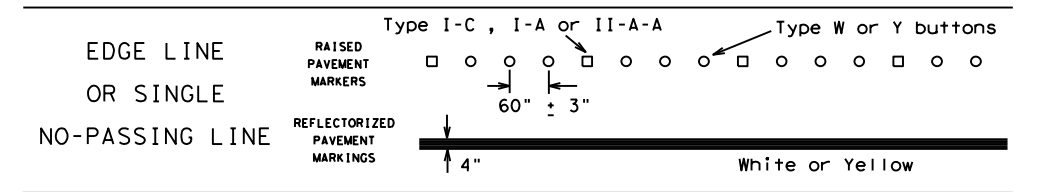

BROKEN LINES

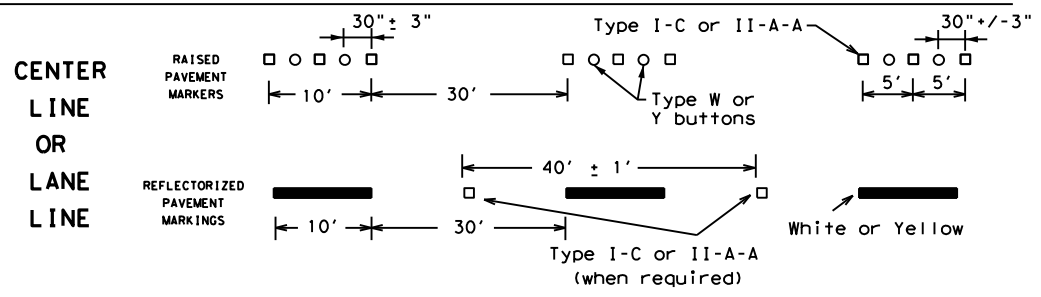


AUXILIARY OR LANEDROP LINE

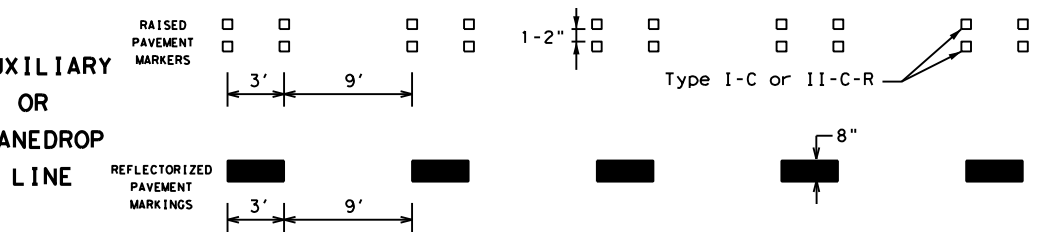

REMOVABLE MARKINGS WITH RAISED PAVEMENT MARKERS

If raised pavement markers are used to supplement REMOVABLE markings, the markers shall be applied to the top of the tape at the approximate mid length of tape used for broken lines or at 20 foot spacing for solid lines. This allows an easier removal of raised pavement markers and tape.

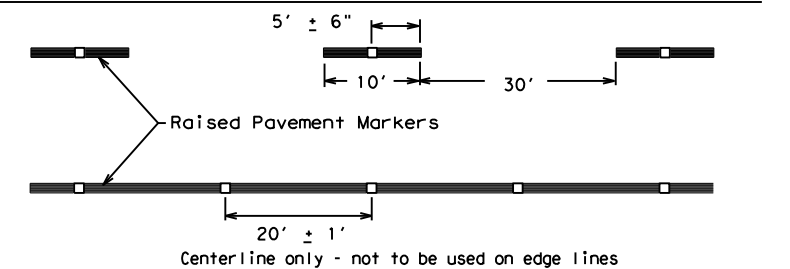

SHEET 12 OF 12



BARRICADE AND CONSTRUCTION PAVEMENT MARKING PATTERNS

BC(12)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	OW: TxDOT	CK: TxDOT
©TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
1-97 9-07 5-21	DIST	COUNTY	SHEET NO.	
2-98 7-13	YKM	VICTORIA, ETC	31	
11-02 8-14				


Raised pavement markers used as standard pavement markings shall be from the approved products list and meet the requirements of Item 672 "RAISED PAVEMENT MARKERS."

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TXDOT for any purpose whatsoever. TXDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

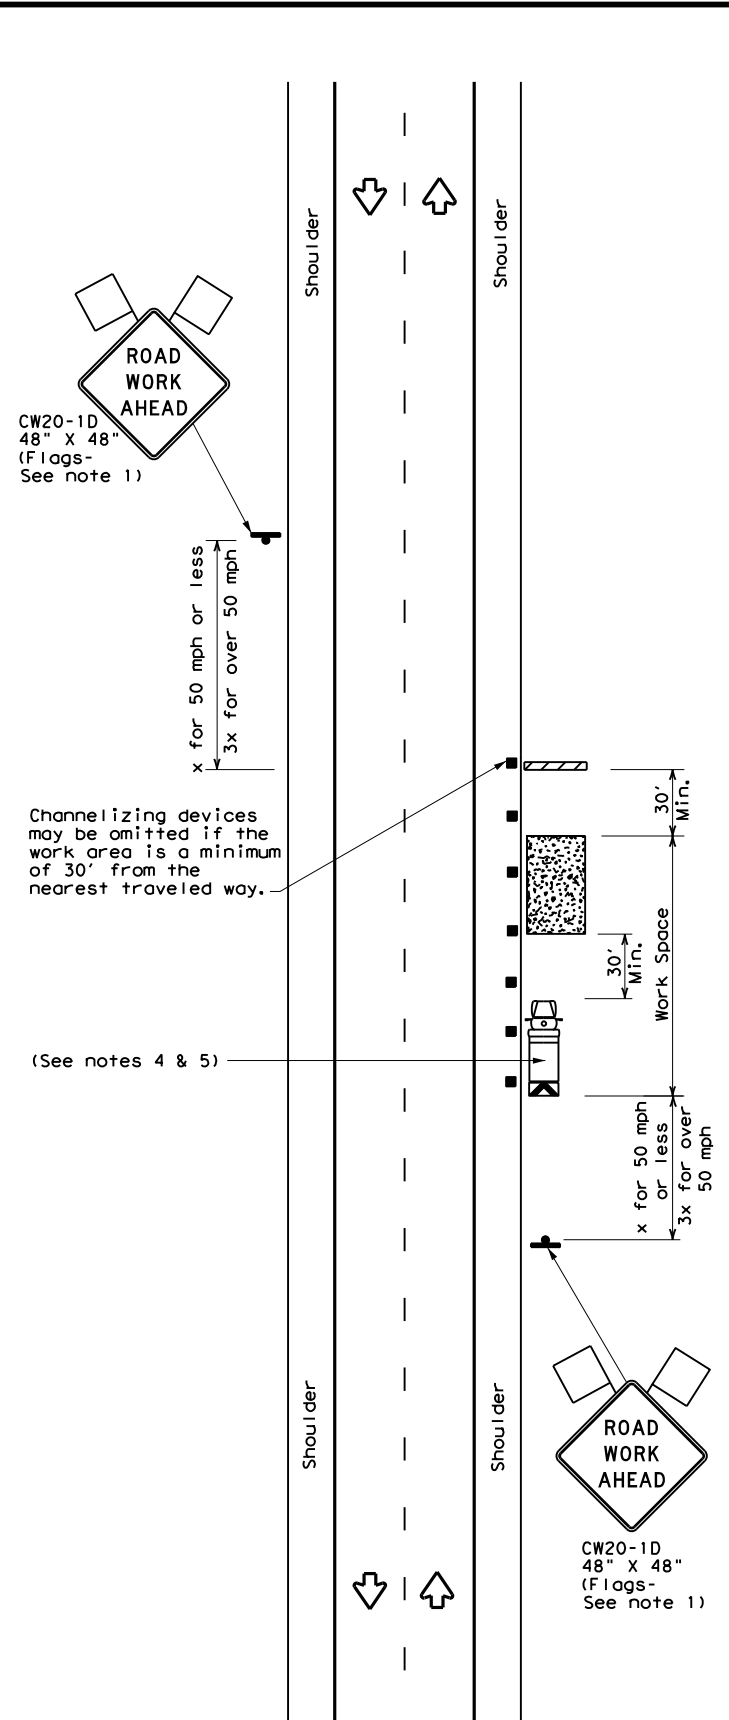


TCP (2-1a)

WORK SPACE NEAR SHOULDER
Conventional Roads

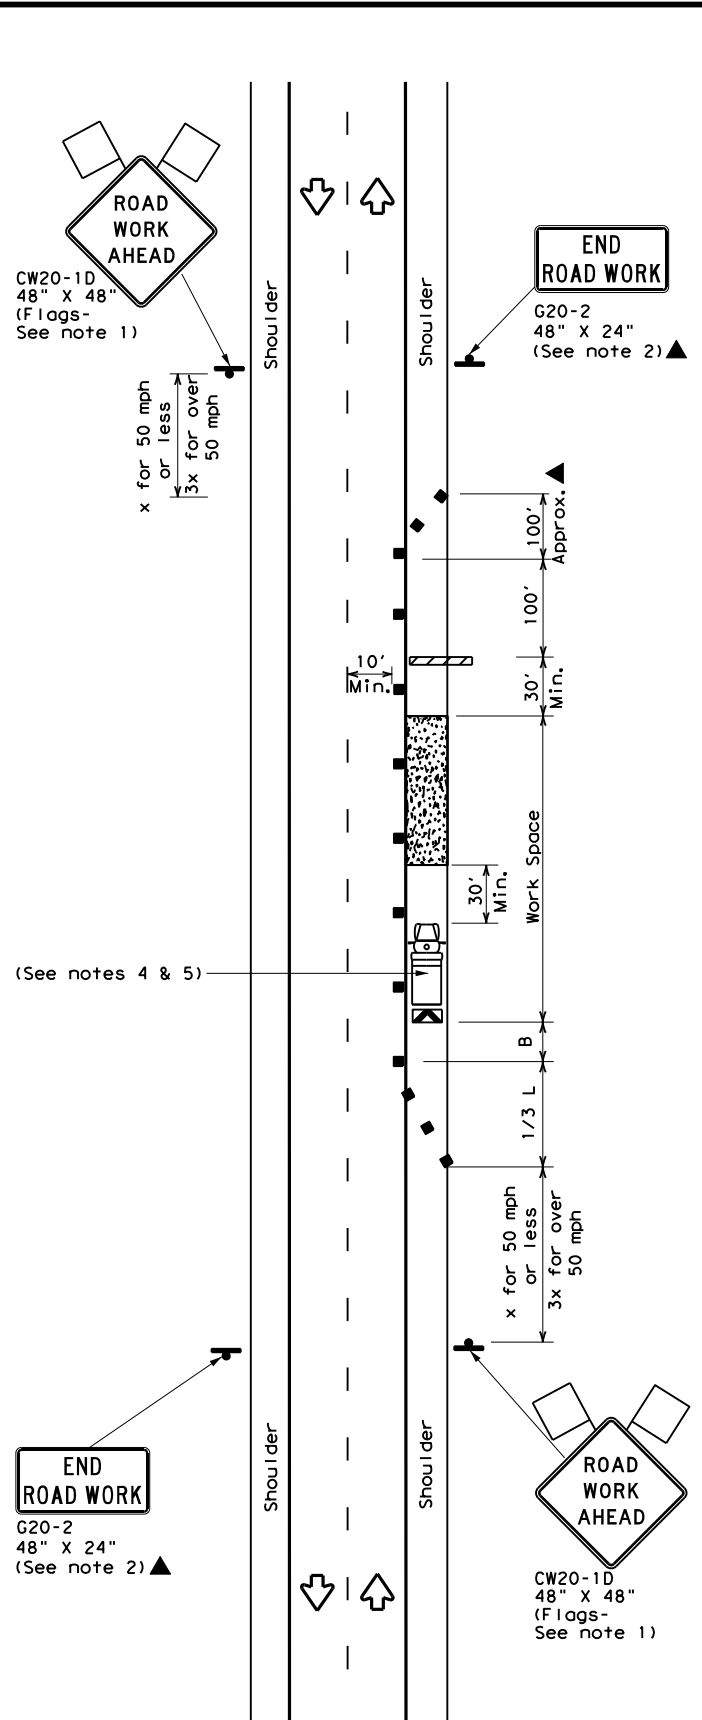

TCP (2-1b)

WORK SPACE ON SHOULDER
Conventional Roads

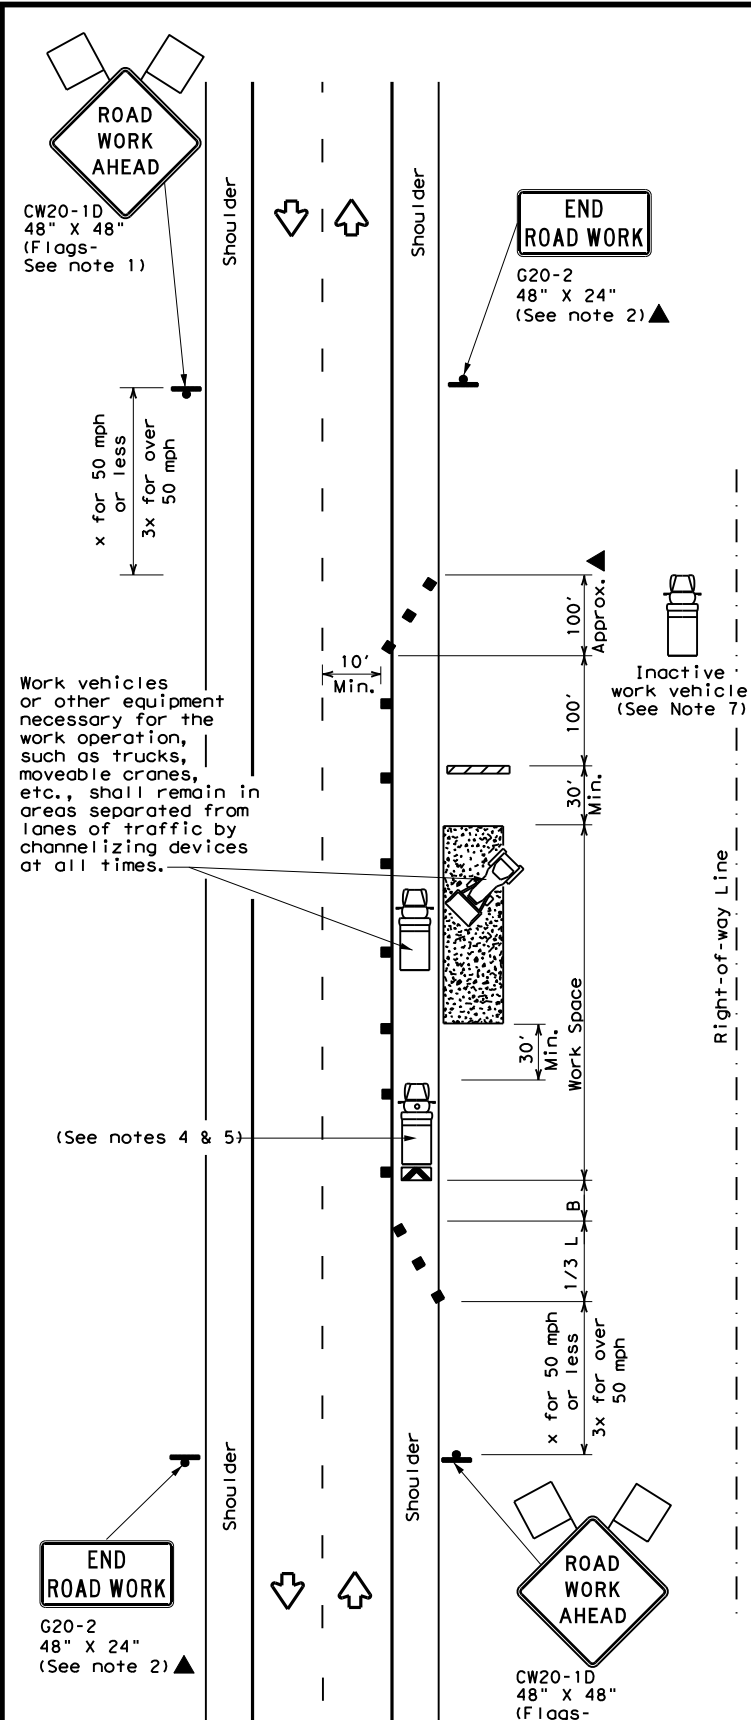

TCP (2-1c)

WORK VEHICLES ON SHOULDER
Conventional Roads

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70	700'	770'	840'	70'	140'	800'	475'	
75	750'	825'	900'	75'	150'	900'	540'	

* Conventional Roads Only
** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	✓

GENERAL NOTES

- Flags attached to signs where shown, are REQUIRED.
- All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated in the plans, or for routine maintenance work, when approved by the Engineer.
- Stockpiled material should be placed a minimum of 30 feet from nearest traveled way.
- Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
- Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
- See TCP(5-1) for shoulder work on divided highways, expressways and freeways.
- Inactive work vehicles or other equipment should be parked near the right-of-way line and not parked on the paved shoulder.
- CW21-5 "SHOULDER WORK" signs may be used in place of CW20-1D "ROAD WORK AHEAD" signs for shoulder work on conventional roadways.




TRAFFIC CONTROL PLAN
CONVENTIONAL ROAD
SHOULDER WORK

TCP (2-1) - 18


FILE: tcp2-1-18.dgn	DN:	CK:	DW:	CK:
© TxDOT December 1985	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
2-94 4-98	DIST	COUNTY	SHEET NO.	
8-95 2-12	YKM	VICTORIA, ETC	32	
1-97 2-18				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

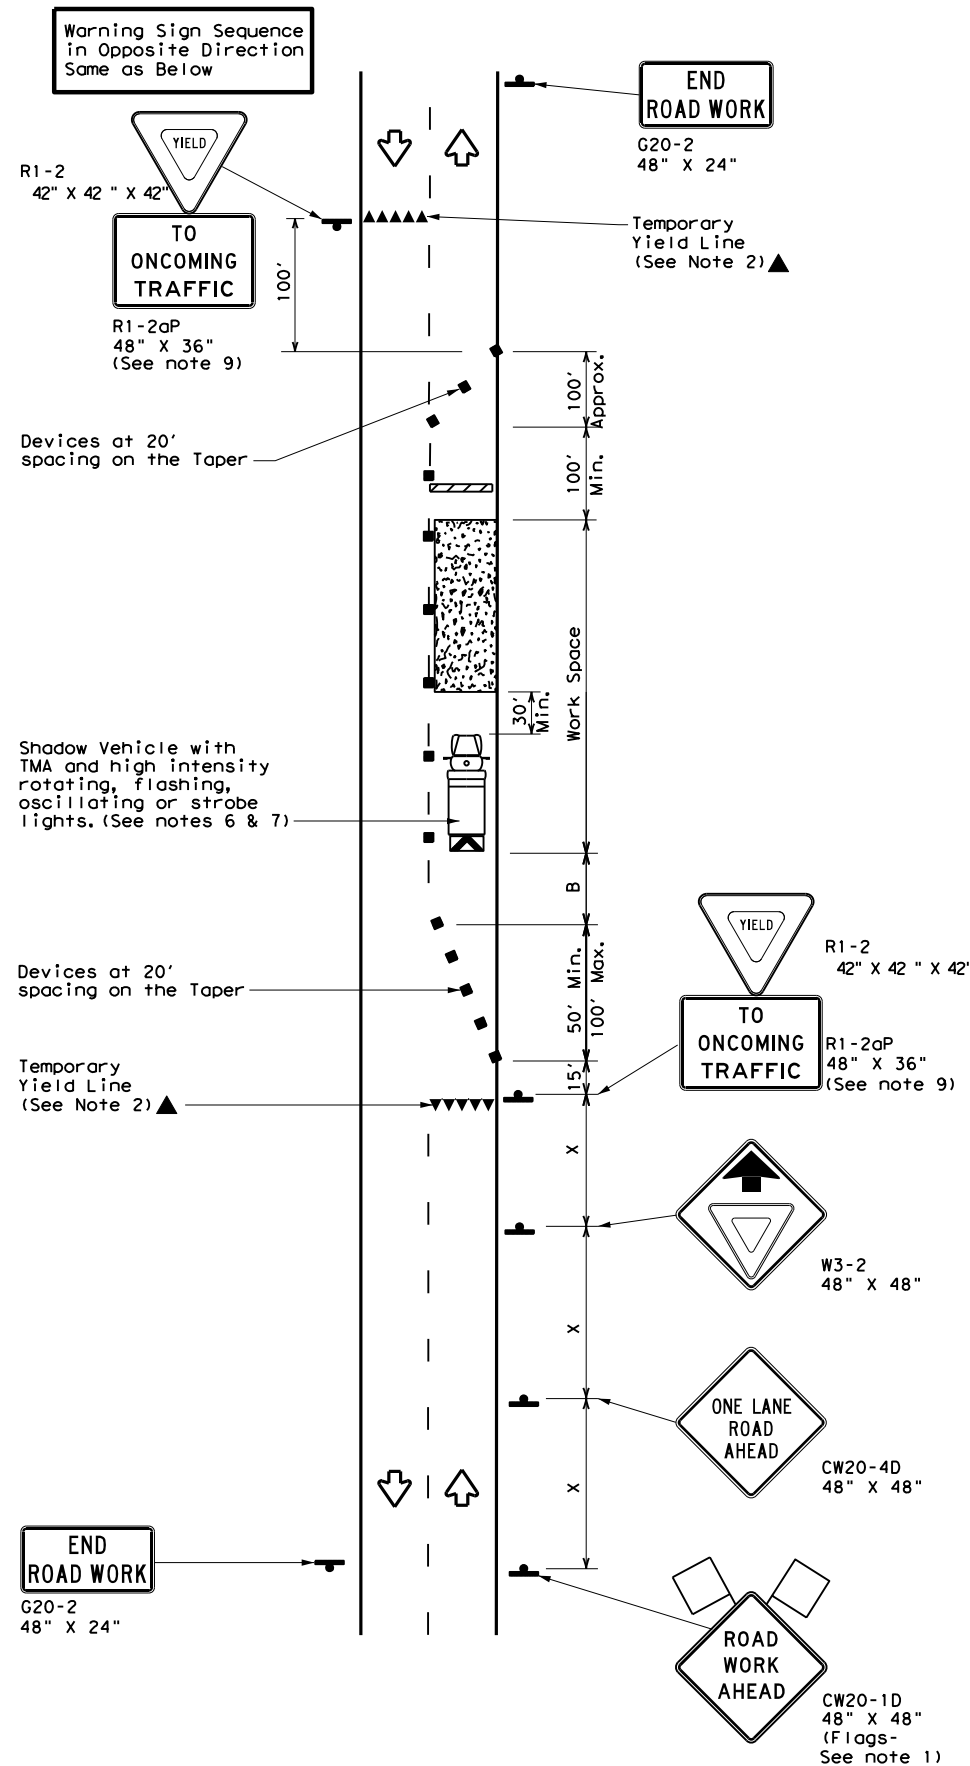

TCP (2-2a)
2-LANE ROADWAY WITHOUT PAVED SHOULDERS
ONE LANE TWO-WAY
CONTROL WITH YIELD SIGNS
(Less than 2000 ADT - See Note 9)

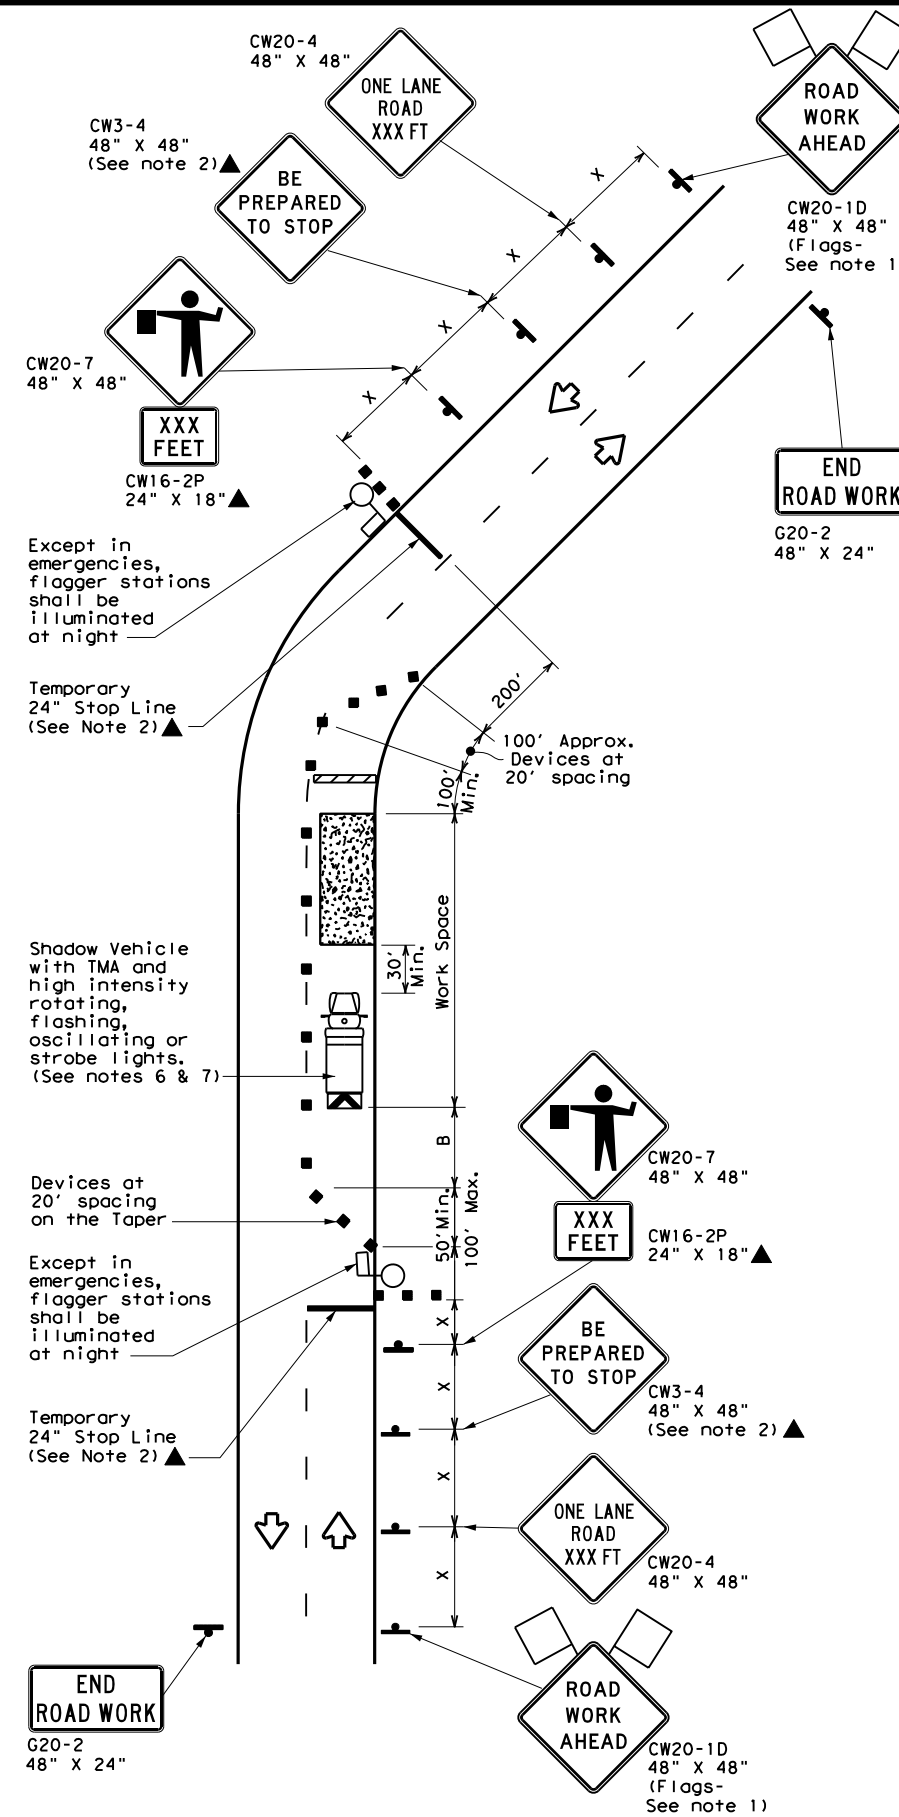

TCP (2-2b)
2-LANE ROADWAY WITHOUT PAVED SHOULDERS
ONE LANE TWO-WAY
CONTROL WITH FLAGGERS

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "x" Distance	Suggested Longitudinal Buffer Space "B"	Stopping Sight Distance
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent			
30	L = WS ² / 60	150'	165'	180'	30'	60'	120'	90'	200'
35		205'	225'	245'	35'	70'	160'	120'	250'
40		265'	295'	320'	40'	80'	240'	155'	305'
45	L = WS	450'	495'	540'	45'	90'	320'	195'	360'
50		500'	550'	600'	50'	100'	400'	240'	425'
55		550'	605'	660'	55'	110'	500'	295'	495'
60		600'	660'	720'	60'	120'	600'	350'	570'
65		650'	715'	780'	65'	130'	700'	410'	645'
70		700'	770'	840'	70'	140'	800'	475'	730'
75		750'	825'	900'	75'	150'	900'	540'	820'

* Conventional Roads Only
** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	


GENERAL NOTES

- Flags attached to signs where shown, are REQUIRED.
 - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
 - The CW3-4 "BE PREPARED TO STOP" sign may be installed after the CW20-4 "ONE LANE ROAD XXX FT" sign, but proper sign spacing shall be maintained.
 - Flaggers should use two-way radios or other methods of communication to control traffic.
 - Length of work space should be based on the ability of flaggers to communicate.
 - A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
 - Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
- TCP (2-2a)**
- The R1-2 "YIELD" sign traffic control may be used on projects with approaches that have adequate sight distance. For projects in urban areas, work space should be no longer than one half city block. In rural areas, roadways with less than 2000 ADT, work space should be no longer than 400 feet.
 - The R1-2aP "YIELD TO ONCOMING TRAFFIC" sign shall be placed on a support at a 7 foot minimum mounting height.
- TCP (2-2b)**
- Channelizing devices on the center line may be omitted when a pilot car is leading traffic and approved by the Engineer.
 - If the work space is located near a horizontal or vertical curve, the buffer distances should be increased in order to maintain stopping sight distance to the flagger and a queue of stopped vehicles. (See table above).
 - Flaggers should use 24" STOP/SLOW paddles to control traffic. Flags should be limited to emergency situations.


		Traffic Operations Division Standard	
TRAFFIC CONTROL PLAN ONE-LANE TWO-WAY TRAFFIC CONTROL			
TCP (2-2) - 18			
FILE: tcp2-2-18.dgn	DN:	CK:	DW: CK:
© TxDOT	REVISIONS	CONT	SECT
8-95 3-03	0088 05	110, ETC	US 59, ETC
1-97 2-12		DIST	COUNTY
4-98 2-18		YKM	VICTORIA, ETC
			SHEET NO. 33

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

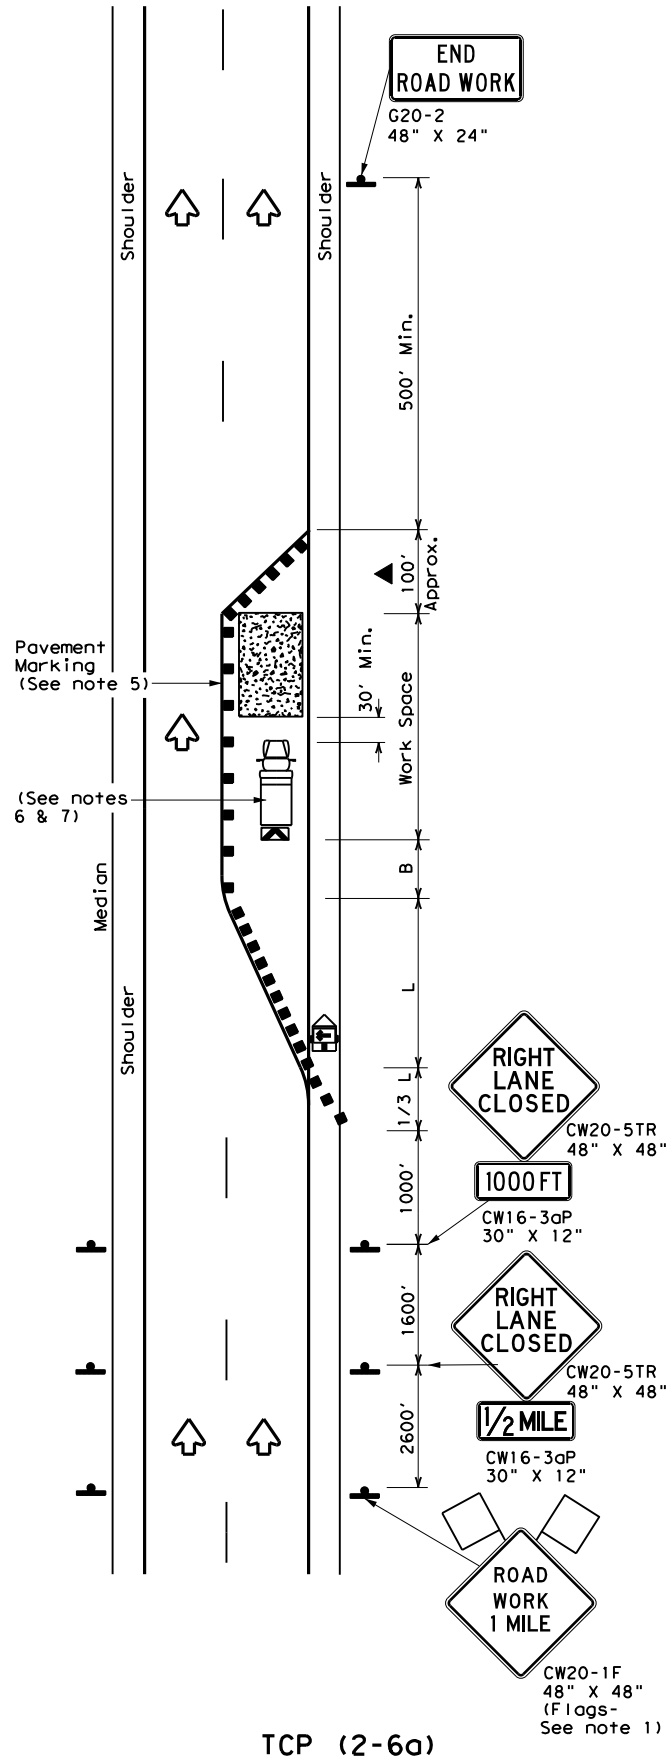

TCP (2-6a)
ONE LANE CLOSURE

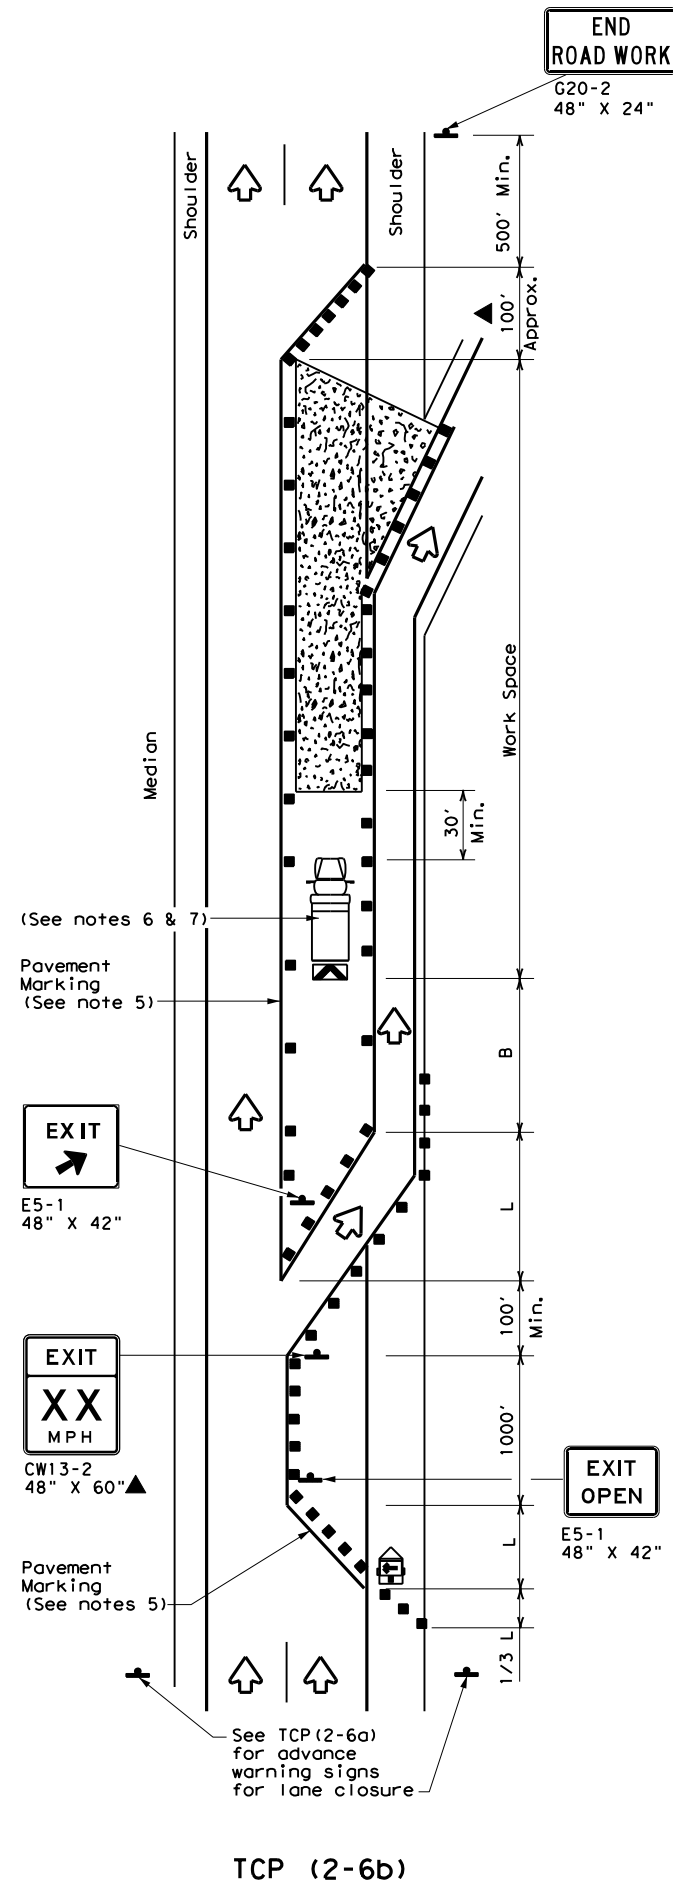

TCP (2-6b)
LANE CLOSURE NEAR EXIT RAMPS

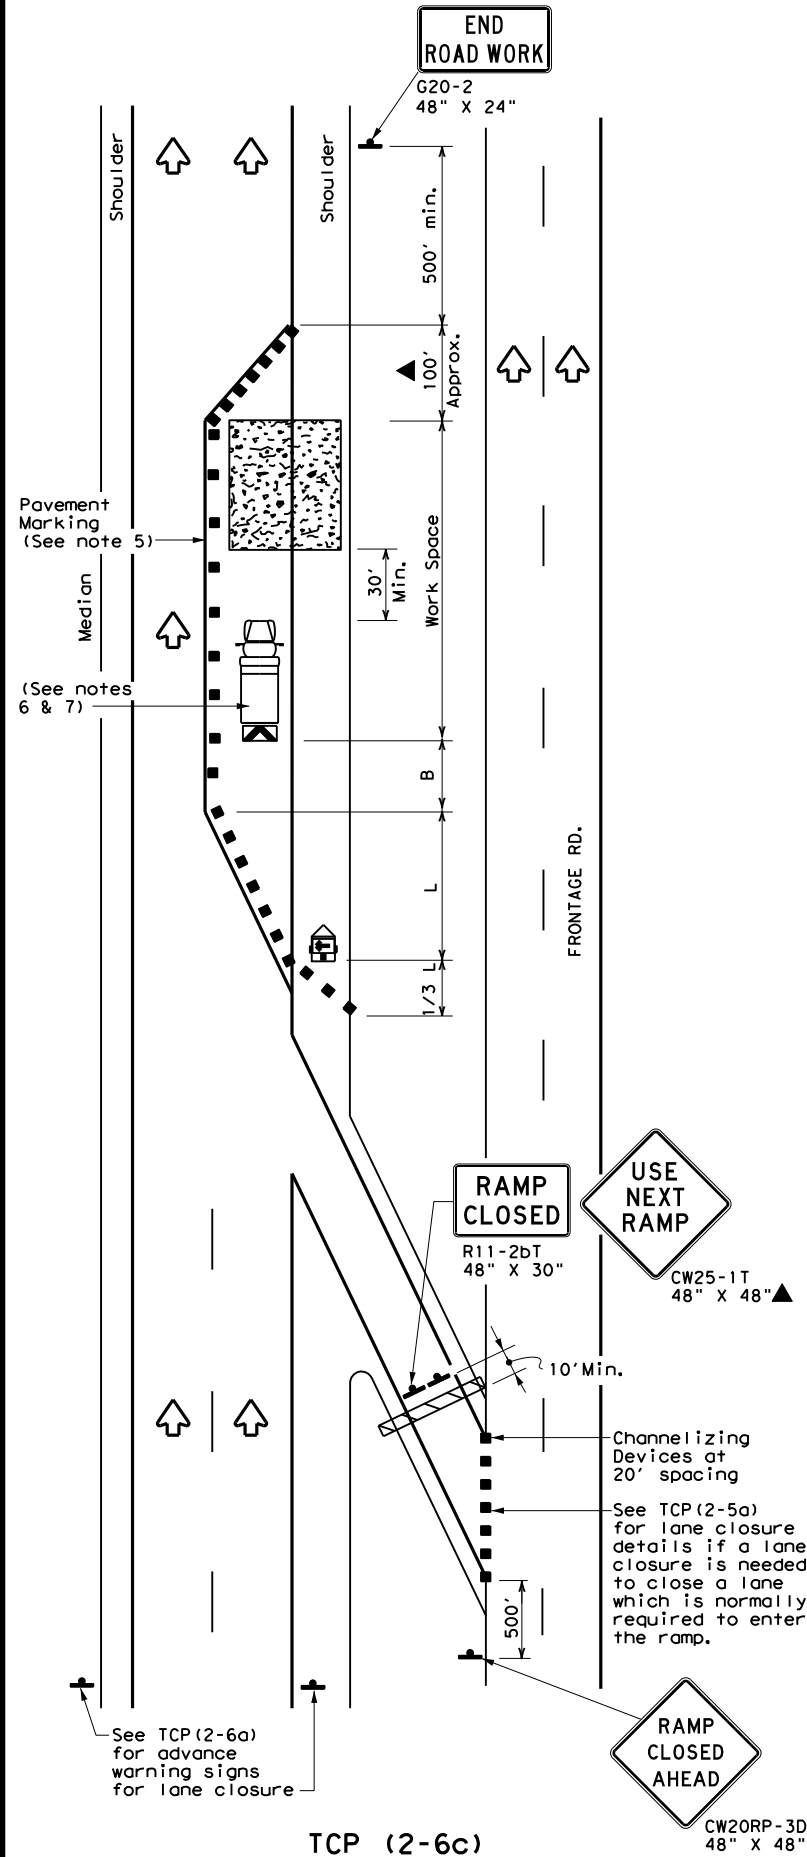

TCP (2-6c)
LANE CLOSURE NEAR ENTRANCE RAMPS

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

* Conventional Roads Only
** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
			✓	✓

- GENERAL NOTES**
- Flags attached to signs where shown, are REQUIRED.
 - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
 - Channelizing devices used to close lanes may be supplemented with the Chevron Alignment Sign placed on every other channelizing device. Chevrons may be attached to plastic drums as per BC Standards.
 - Channelizing devices used along the work space or along tangent sections may be supplemented with vertical panels (VP) placed on every other channelizing device. If night time conditions make it difficult to see at least two VPs, the VPs may be placed on each channelizing device.
 - The placement of pavement markings may be omitted on intermediate-term stationary work zones with the approval of the Engineer.
 - Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
 - Additional Shadow Vehicles with TMAs may be positioned in each closed lane, on the shoulder or off the paved surface, next to those shown in order to protect a wider work space.

Traffic Operations Division Standard

TRAFFIC CONTROL PLAN LANE CLOSURES ON DIVIDED HIGHWAYS


TCP (2-6) - 18

FILE: tcp2-6-18.dgn	DN:	CK:	DW:	CK:
© TxDOT December 1985	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
2-94 4-98	DIST	COUNTY	SHEET NO.	
8-95 2-12	YKM	VICTORIA, ETC	34	
1-97 2-18				

166


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

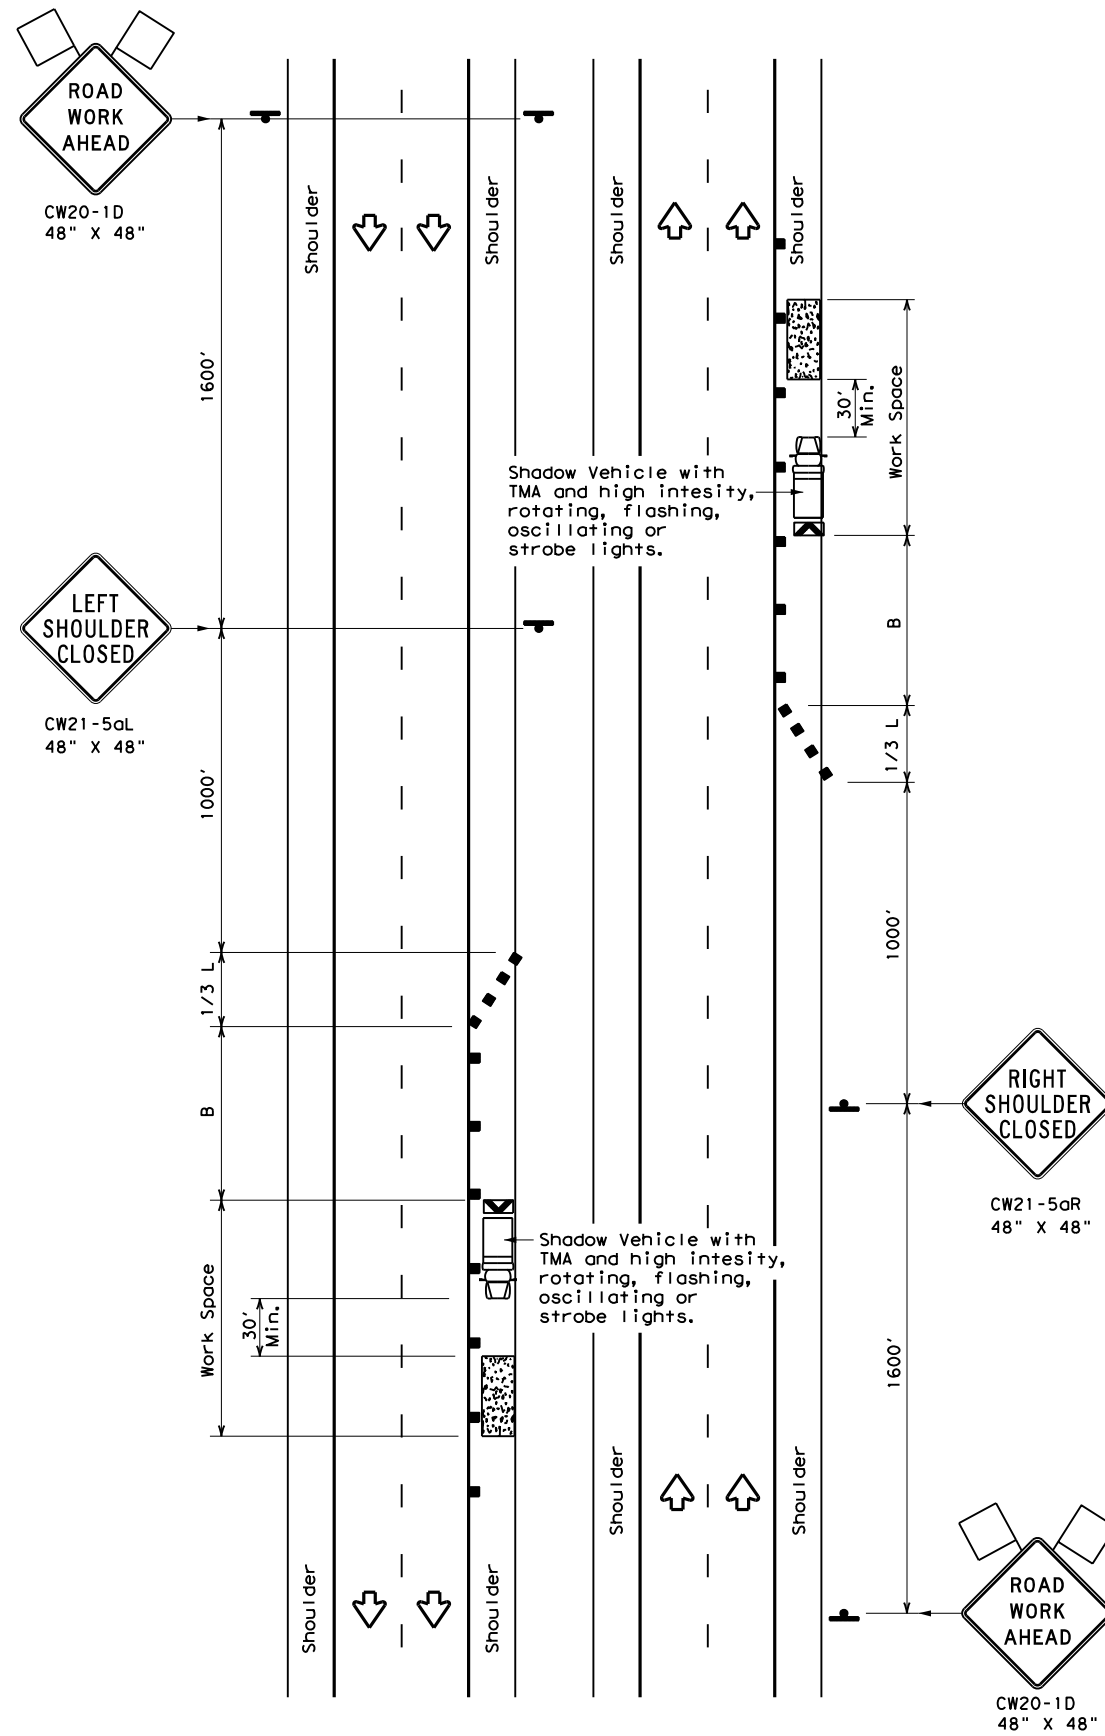

TCP (5-1a)

WORK AREA ON SHOULDER

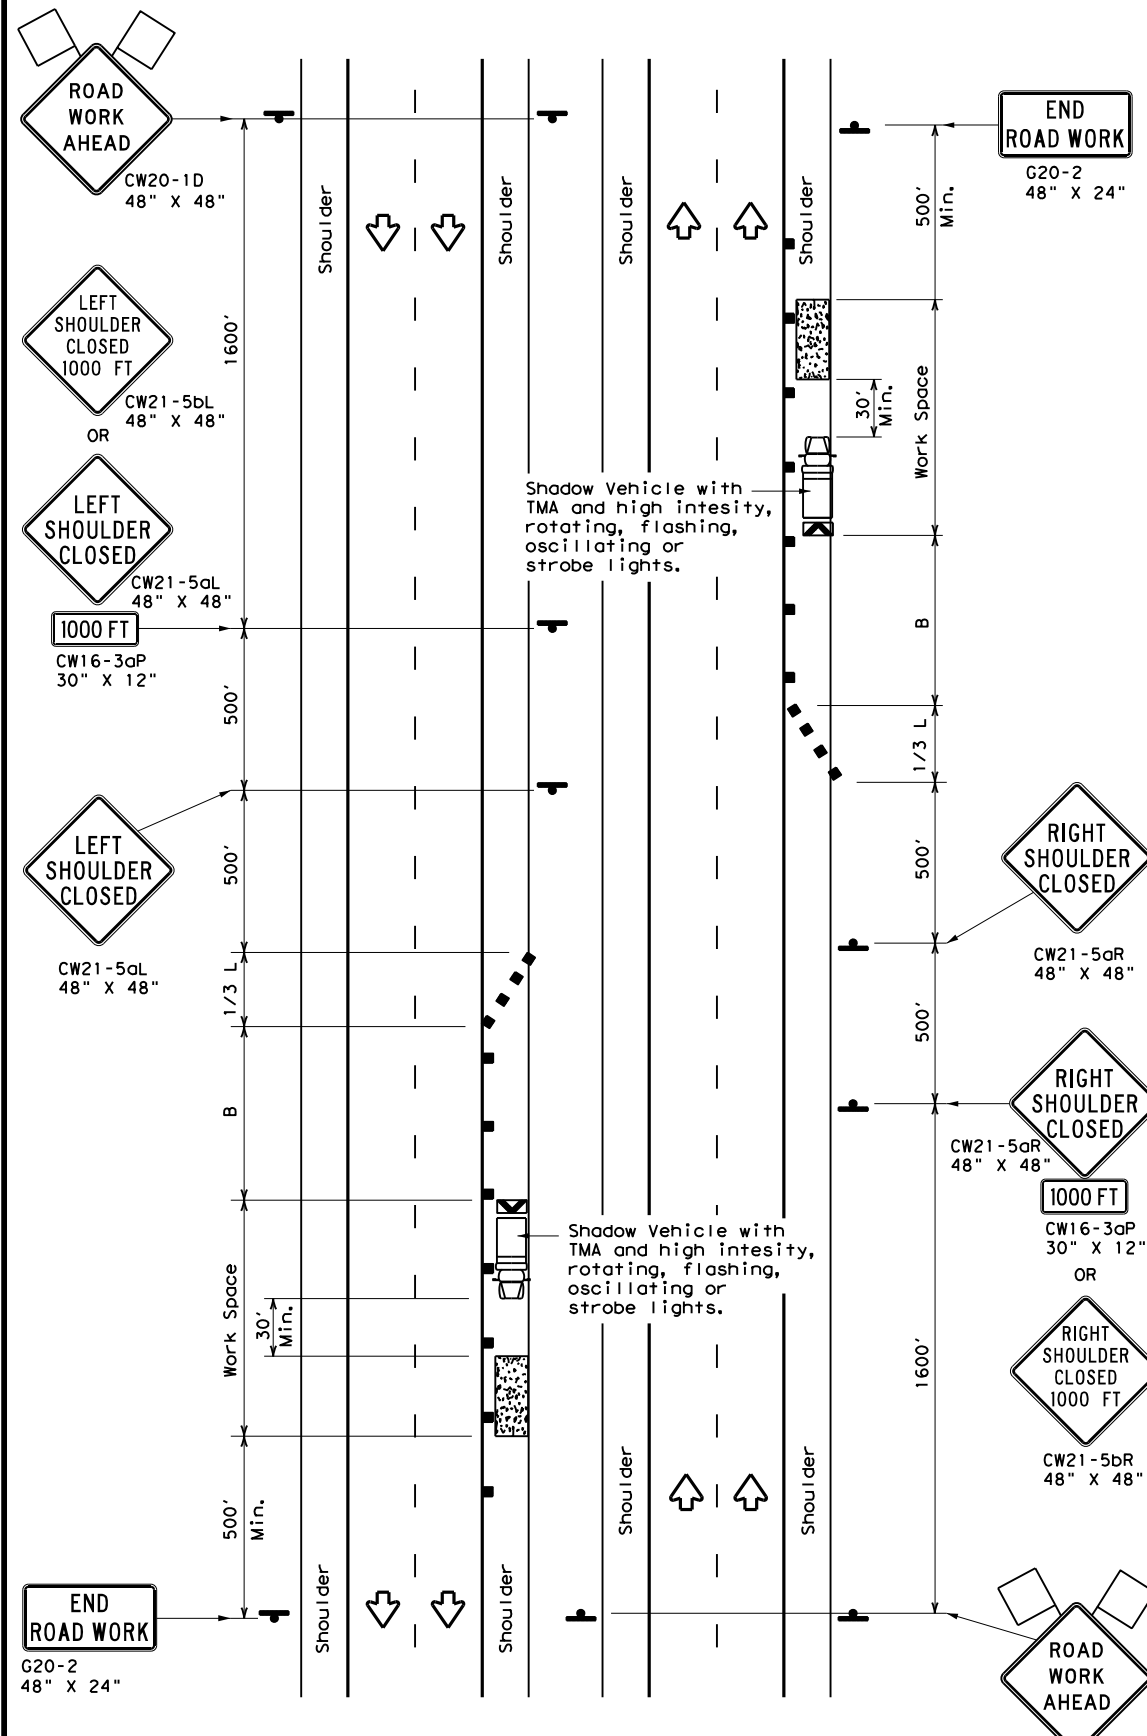

TCP (5-1b)

WORK AREA ON SHOULDER

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
30	L = WS ² / 60	150'	165'	180'	30'	60'	90'
35		205'	225'	245'	35'	70'	120'
40		265'	295'	320'	40'	80'	155'
45	L = WS	450'	495'	540'	45'	90'	195'
50		500'	550'	600'	50'	100'	240'
55		550'	605'	660'	55'	110'	295'
60		600'	660'	720'	60'	120'	350'
65		650'	715'	780'	65'	130'	410'
70		700'	770'	840'	70'	140'	475'
75		750'	825'	900'	75'	150'	540'
80		800'	880'	960'	80'	160'	615'

* Conventional Roads Only
** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	TCP (5-1a)	TCP (5-1b)	TCP (5-1b)	

GENERAL NOTES

1. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30' to 100' in advance of the area of crew exposure without adversely affecting the performance or quality of the work. Type 3 barricades or drums may be substituted when workers on foot are no longer present when approved by the Engineer.
2. 28" tall or taller one-piece cones will be allowed only for Short Duration or Short Term stationary operations when workers are present to maintain the devices upright and in proper location. Intermediate Term stationary work areas should use Drums, Vertical Panels or 42" tall two-piece cones.




**TRAFFIC CONTROL PLAN
SHOULDER WORK FOR
FREEWAYS / EXPRESSWAYS**

TCP (5-1) - 18


FILE: tcp5-1-18.dgn	DN:	CK:	DW:	CK:
© TxDOT February 2012	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
2-18	DIST	COUNTY	SHEET NO.	
	YKM	VICTORIA, ETC	35	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

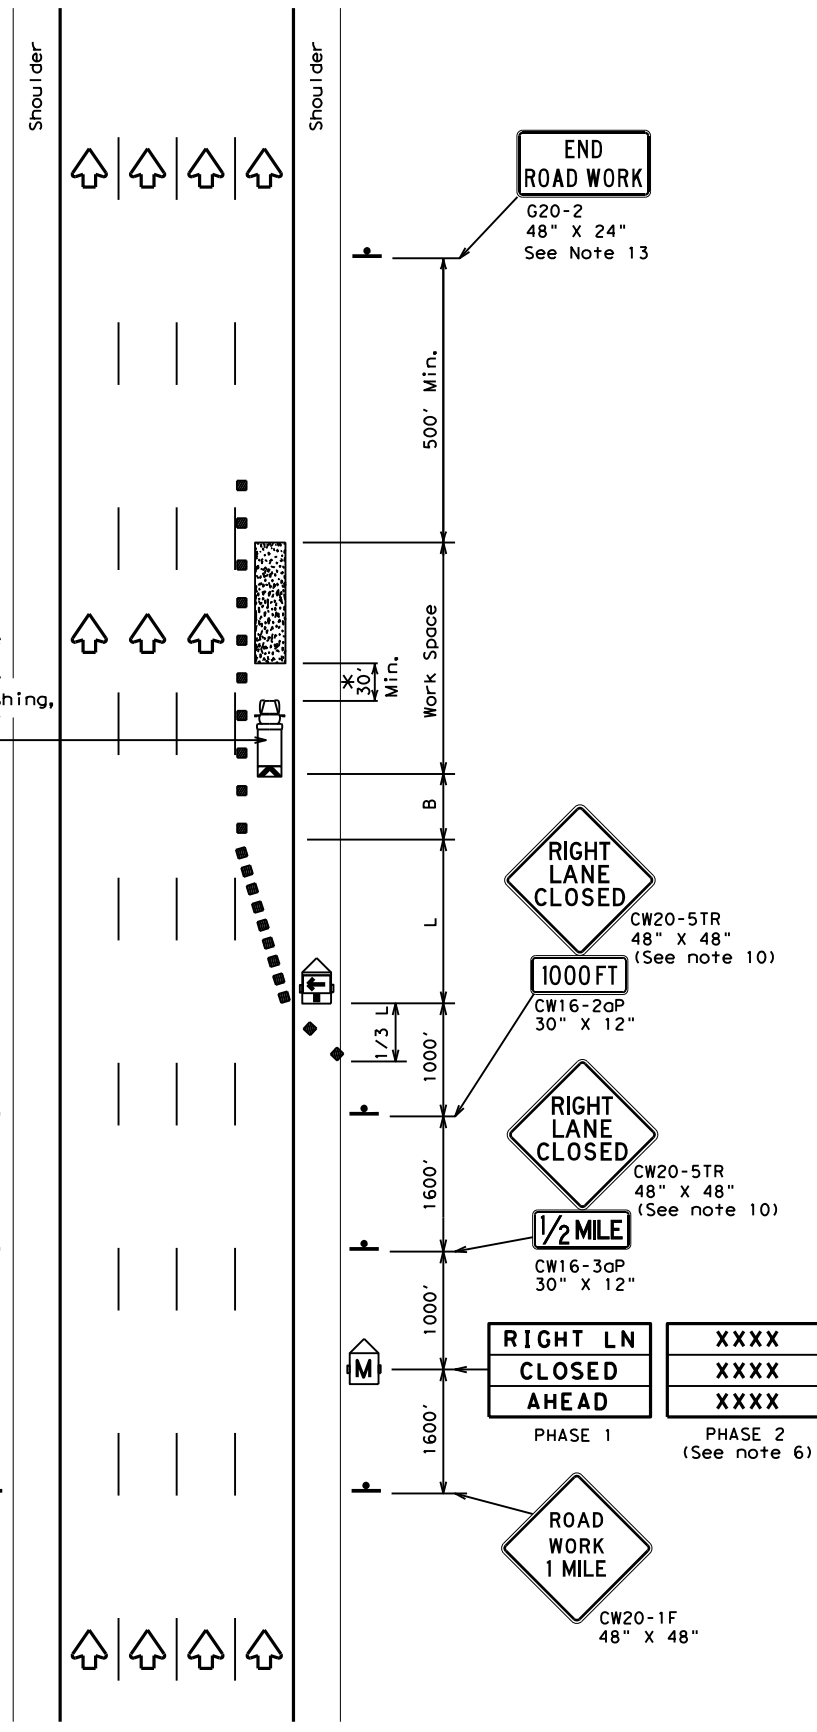

TCP (6-1a)
TYPICAL FREEWAY ONE LANE CLOSURE

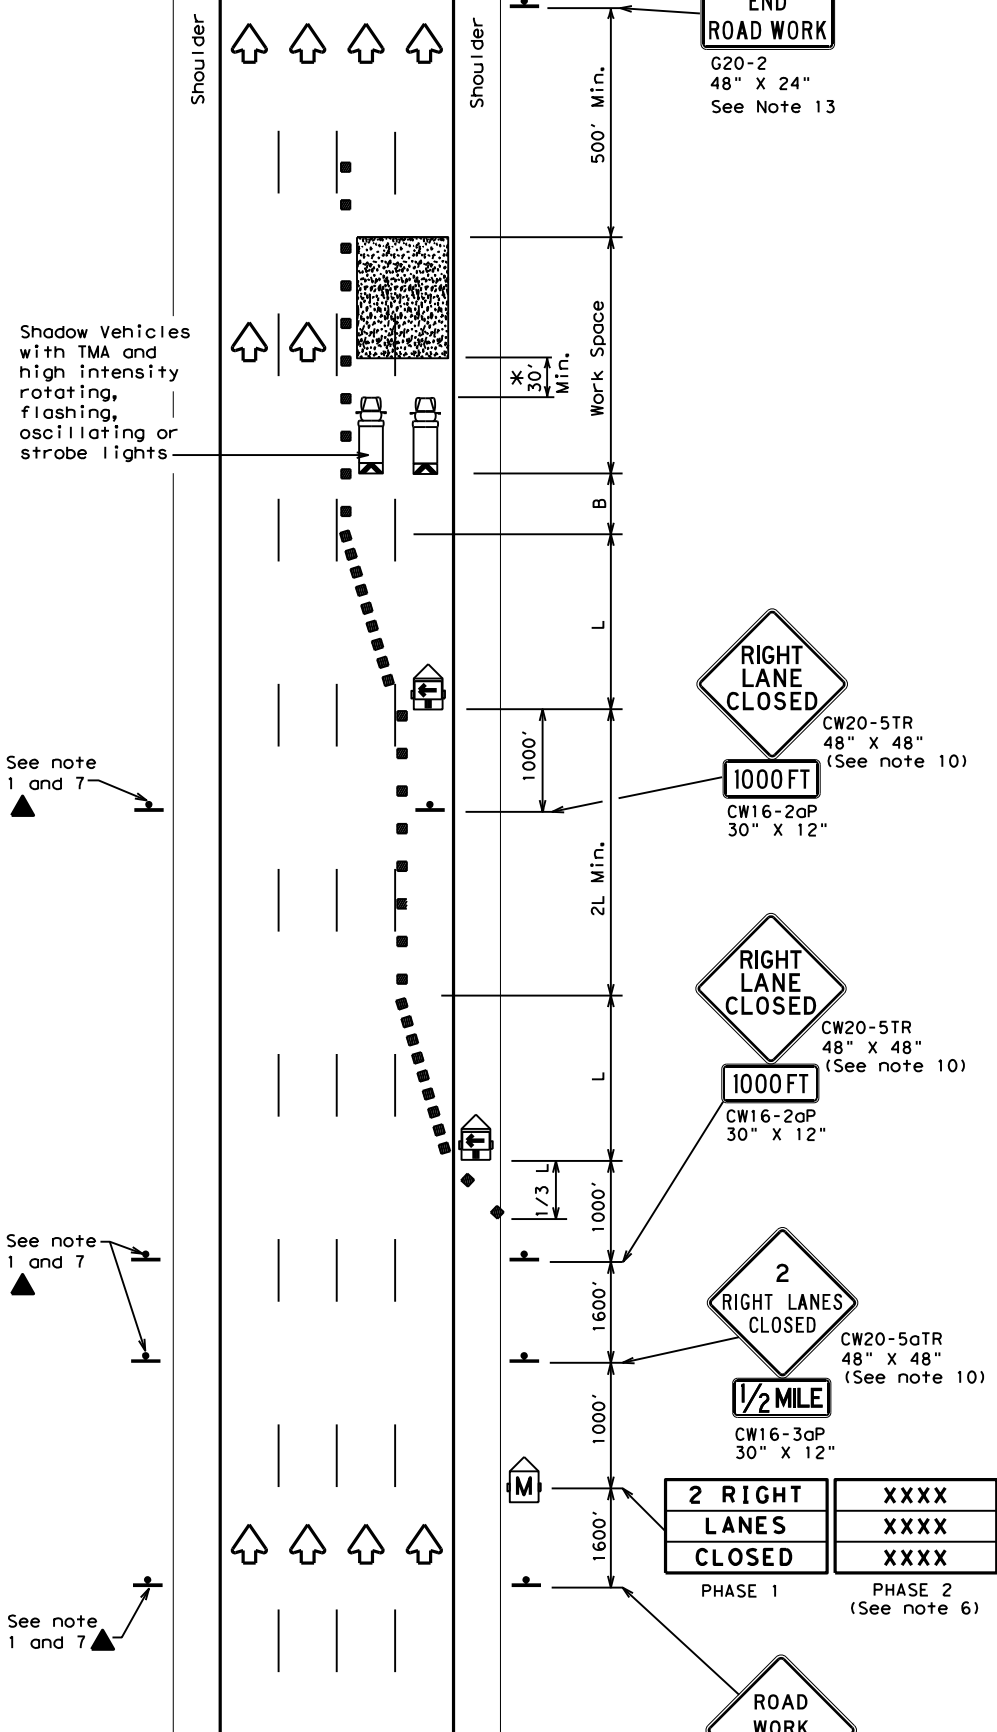

TCP (6-1b)
TYPICAL FREEWAY TWO LANE CLOSURE

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed	Formula	Minimum Desirable Taper Lengths "L"			Suggested Maximum Spacing of Channelizing Devices		Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
45	L = WS	450'	495'	540'	45'	90'	195'
50		500'	550'	600'	50'	100'	240'
55		550'	605'	660'	55'	110'	295'
60		600'	660'	720'	60'	120'	350'
65		650'	715'	780'	65'	130'	410'
70		700'	770'	840'	70'	140'	475'
75		750'	825'	900'	75'	150'	540'
80	800'	880'	960'	80'	160'	615'	

** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	

GENERAL NOTES

- All traffic control devices illustrated are REQUIRED. Devices denoted with the triangle symbol may be omitted when stated elsewhere in the plans.
- Drums or 42" cones are the typical channelizing devices. For Intermediate Term Stationary work, drums shall be used on tapers with drums or 42" cones used on tangent sections. Other channelizing devices may be used as directed by the Engineer.
- All construction signs and barricades placed during any phase of work shall remain in place until removal is approved by the Engineer.
- The Engineer may direct the Contractor to furnish additional signs and barricades as required to maintain traffic flow, detours and motorist safety during construction.
- Static message boards or changeable message signs stating the date and duration of ramp or freeway lane closures shall be placed a minimum of seven (7) calendar days in advance of the actual closure.
- Phase 2 of the PCMS message should include appropriate information formatted as shown on BC(6), such as "MERGE LEFT," recommended advisory speed, delay information, or other specific warnings.
- Duplicate construction warning signs should be erected on the medians side of freeways where median width will permit and traffic volume justifies the signing.
- The number of closed lanes may be increased provided the spacing of traffic control devices, taper lengths and tangent lengths meet the requirements of the TMUTCD.
- Warning signs for intermediate term stationary work should be mounted at 7' to the bottom of the sign.
- Warning signs shown shall be appropriately altered for left lane closures. When signs are mounted at 1' height for short term stationary or short duration work, sign versions shown in the SHSD for Texas with distances on the sign face rather than mounted on a plaque below the sign may be used.
- When possible, PCMS units should be located in advance of the last available exit ramp prior to the lane closure to allow motorists an alternate route. They may also be relocated to improve advance warning in case of unanticipated queuing or congestion.
- For Intermediate Term Stationary work at night, floodlights should be used to illuminate the work area and equipment crossings. Floodlights shall not produce a disabling glare condition for road users or workers.
- The END ROAD WORK (G20-2) sign may be omitted when it conflicts with G20-2 signs already in place on the project.

* A shadow vehicle equipped with a Truck Mounted Attenuator is typically required. A shadow vehicle equipped with a TMA shall be used if it can be positioned 30' to 100' in advance of the area of crew exposure without adversely affecting the work performance.




TRAFFIC CONTROL PLAN FREEWAY LANE CLOSURES

TCP (6-1) - 12


FILE:	tcp6-1.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	February 1998	CONT	SECT	JOB	HIGHWAY				
8-12	REVISIONS	0088	05	110, ETC	US 59, ETC				
	DIST	COUNTY		SHEET NO.					
	YKM	VICTORIA, ETC		36					

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

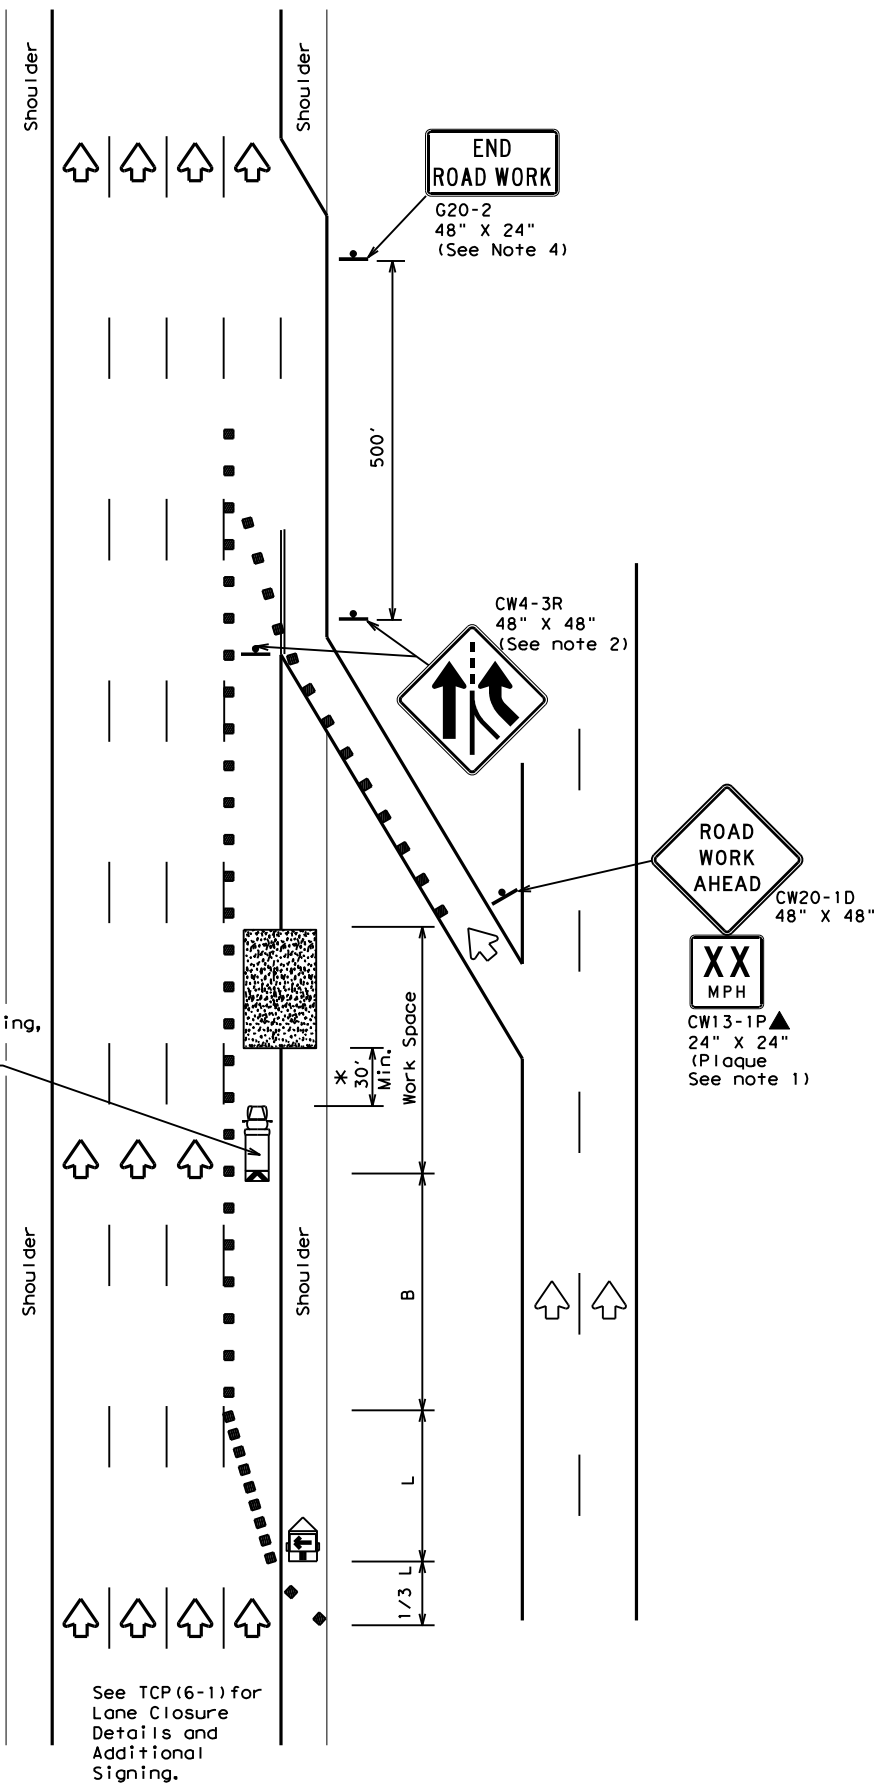

TCP (6-2a)
ENTRANCE RAMP OPEN
WORK WITHIN 500' OF RAMP

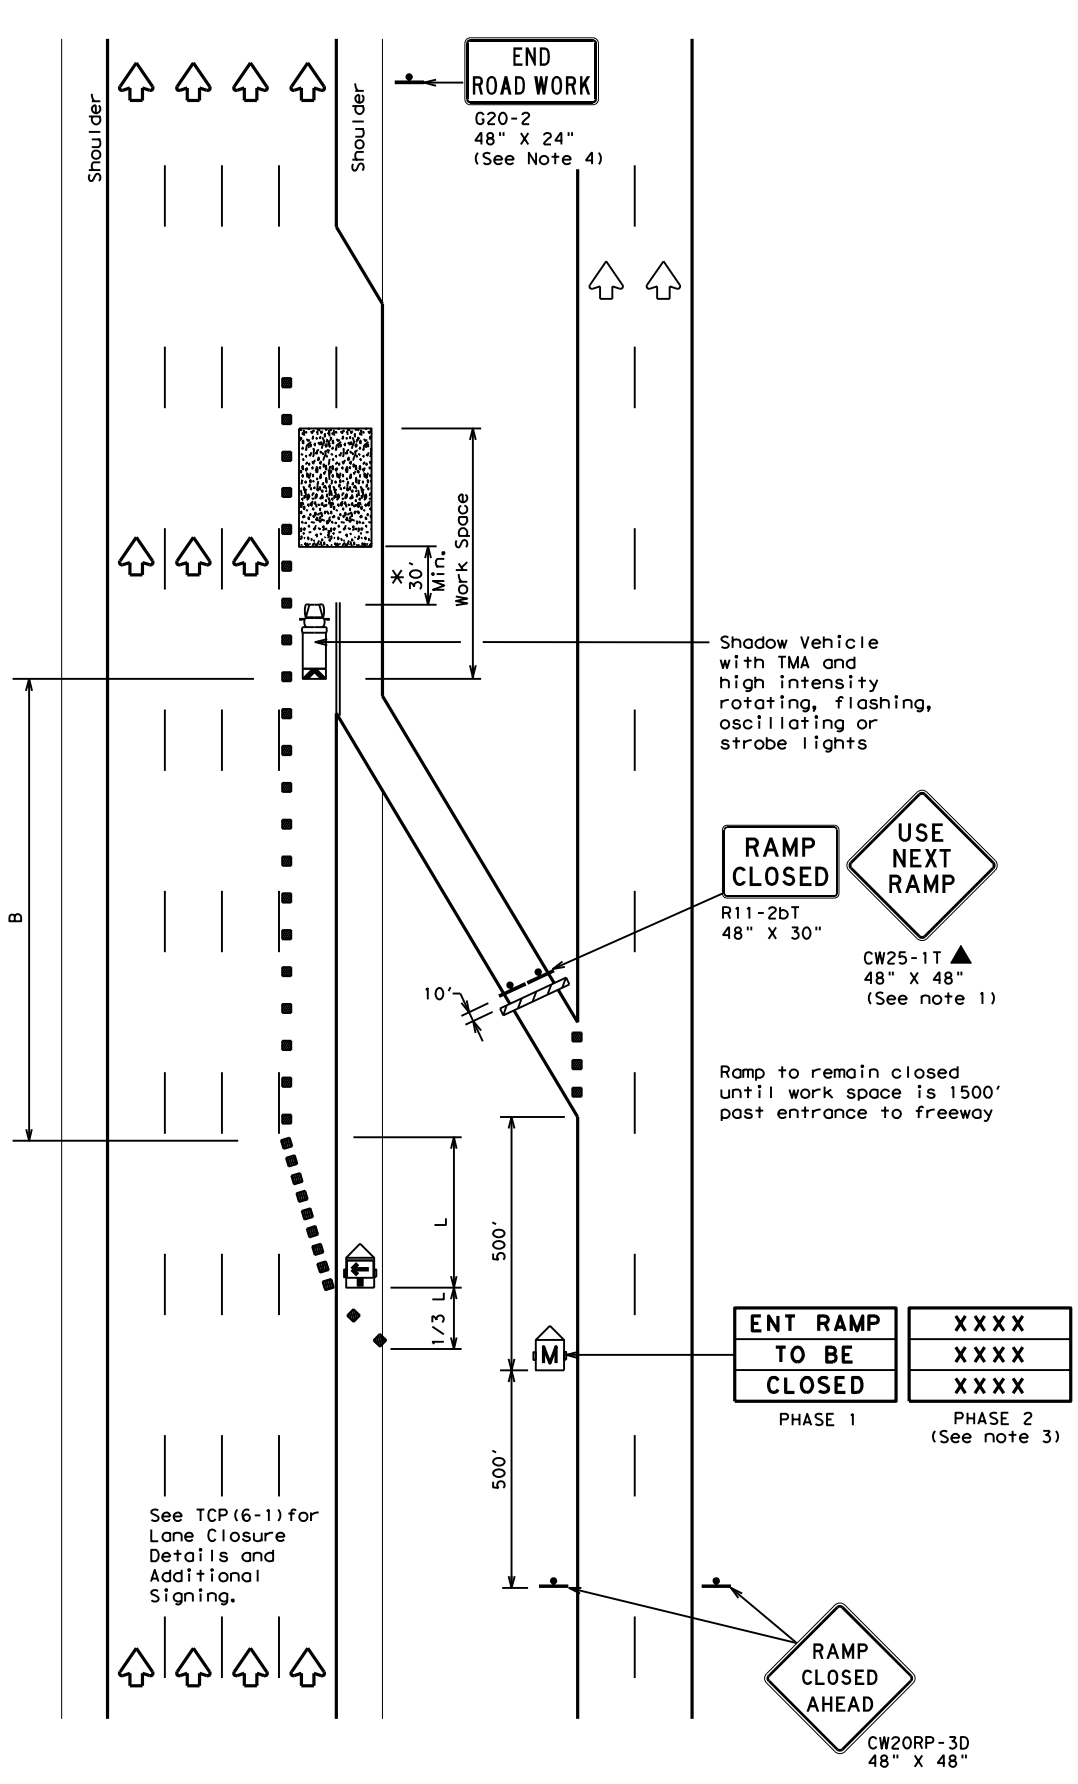

TCP (6-2b)
ENTRANCE RAMP CLOSED

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed	Formula	Minimum Desirable Taper Lengths "L"			Suggested Maximum Spacing of Channelizing Devices		Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
45	L = WS	450'	495'	540'	45'	90'	195'
50		500'	550'	600'	50'	100'	240'
55		550'	605'	660'	55'	110'	295'
60		600'	660'	720'	60'	120'	350'
65		650'	715'	780'	65'	130'	410'
70		700'	770'	840'	70'	140'	475'
75		750'	825'	900'	75'	150'	540'
80		800'	880'	960'	80'	160'	615'

** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset(FT) S=Posted Speed(MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	

GENERAL NOTES

- All traffic control devices illustrated are REQUIRED. Devices denoted with the triangle symbol may be omitted when stated elsewhere in the plans.
- ADDED LANE Symbol (CW4-3) sign may be omitted when sign between ramp and mainlane can be seen from both roadways.
- See "Advance Notice List" on BC(6) for recommended date and time formatting options for PCMS Phase 2 message.
- The END ROAD WORK (G20-2) sign may be omitted when it conflicts with G20-2 signs already in place on the project.

*A shadow vehicle equipped with a Truck Mounted Attenuator is typically required. A shadow vehicle equipped with a TMA shall be used if it can be positioned 30' to 100' in advance of the area of crew exposure without adversely affecting the work performance.

Additional requirements for lane closures and advance signing shall be as shown on TCP (6-1) or as directed by the Engineer.




TRAFFIC CONTROL PLAN
WORK AREA NEAR RAMP

TCP (6-2) - 12


FILE: tcp6-2.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 1994	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
1-97 8-98		DIST	COUNTY	SHEET NO.
4-98 8-12		YKM	VICTORIA, ETC	37

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

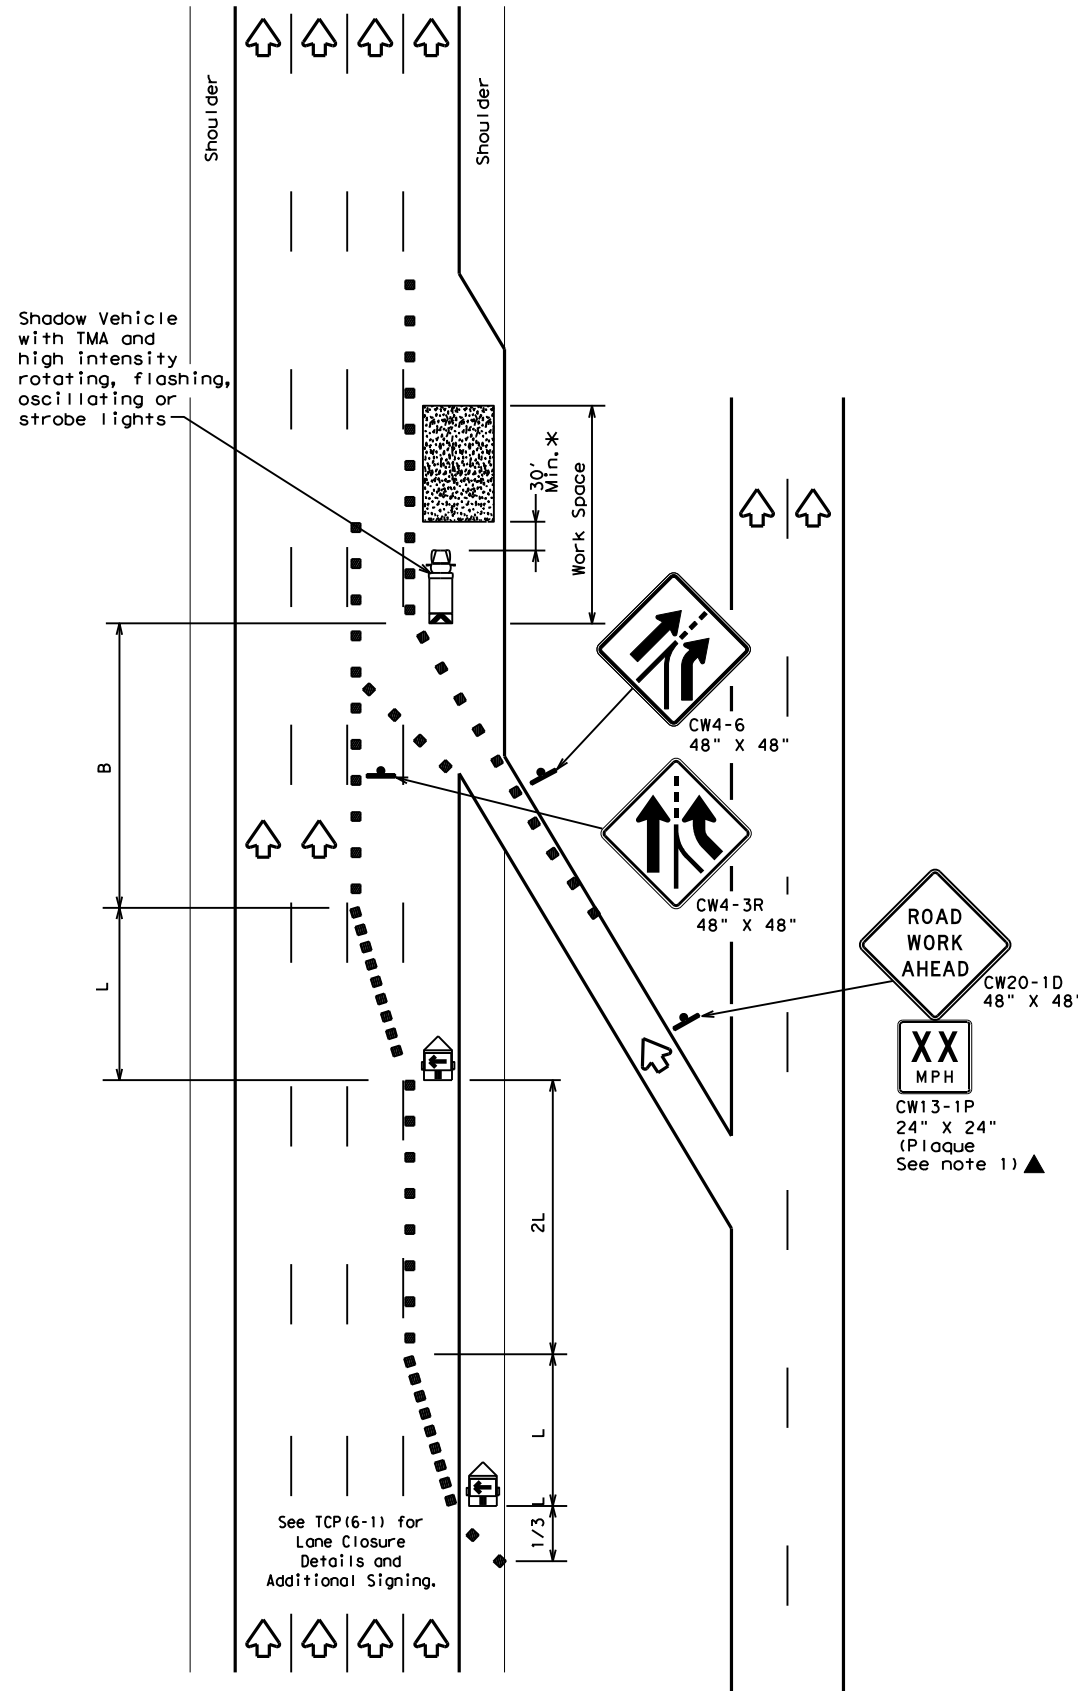

TCP (6-3a)
ENTRANCE RAMP OPEN

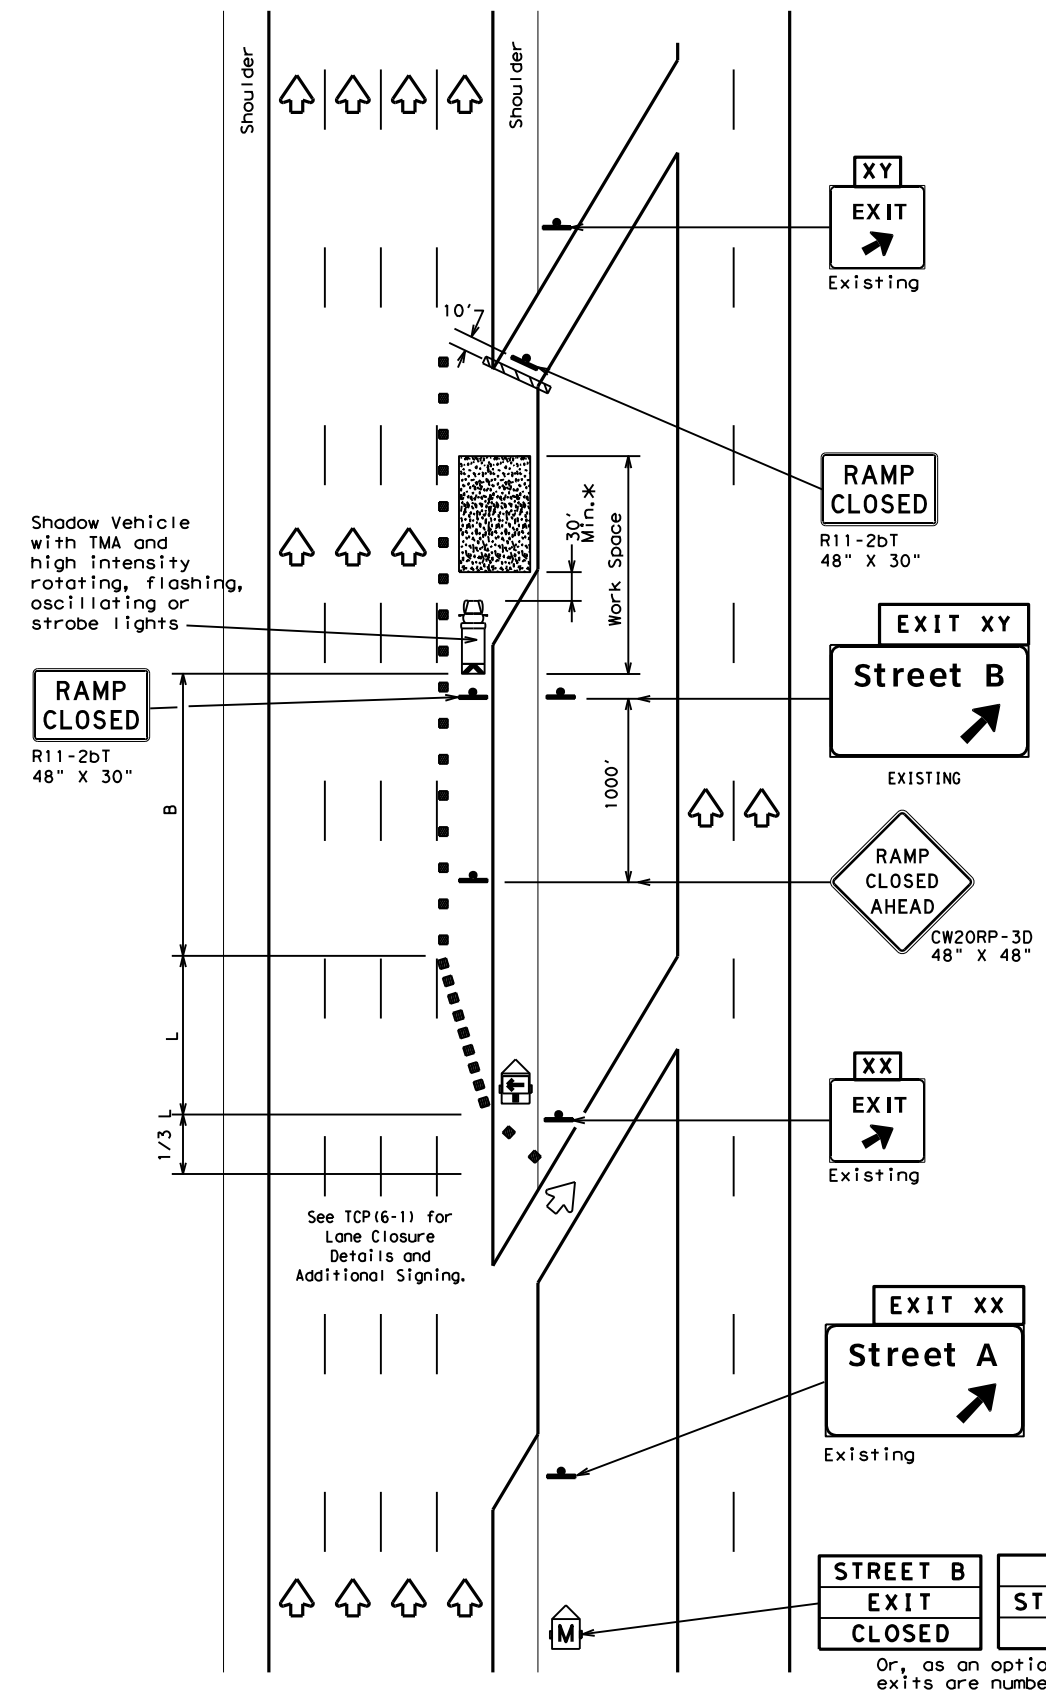

TCP (6-3b)
EXIT RAMP CLOSED
TRAFFIC EXITS PRIOR TO CLOSED RAMP

STREET B
EXIT
CLOSED

USE
STREET A
EXIT

EXIT XY
CLOSED

USE
EXIT XX

Or, as an option when exits are numbered

Place 1 mile (approx.) in advance of Street A exit.

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed	Formula	Minimum Desirable Taper Lengths "L" **			Suggested Maximum Spacing of Channelizing Devices		Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
45	L = WS	450'	495'	540'	45'	90'	195'
50		500'	550'	600'	50'	100'	240'
55		550'	605'	660'	55'	110'	295'
60		600'	660'	720'	60'	120'	350'
65		650'	715'	780'	65'	130'	410'
70		700'	770'	840'	70'	140'	475'
75		750'	825'	900'	75'	150'	540'
80		800'	880'	960'	80'	160'	615'

** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	

GENERAL NOTES:
1. All traffic control devices illustrated are REQUIRED. Devices denoted with the triangle symbol may be omitted when stated elsewhere in the plans.

*A shadow vehicle equipped with a Truck Mounted Attenuator is typically required. A shadow vehicle equipped with a TMA shall be used if it can be positioned 30' to 100' in advance of the area of crew exposure without adversely affecting the work performance.

Additional requirements for lane closures and advance signing shall be as shown on TCP (6-1) or as directed by the Engineer.

Texas Department of Transportation
Traffic Operations Division Standard



**TRAFFIC CONTROL PLAN
WORK AREA BEYOND RAMP**

TCP (6-3) - 12

FILE: tcp6-3.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
©TxDOT February 1994	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
1-97 8-98	DIST	COUNTY	SHEET NO.	
4-98 8-12	YKM	VICTORIA, ETC	38	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

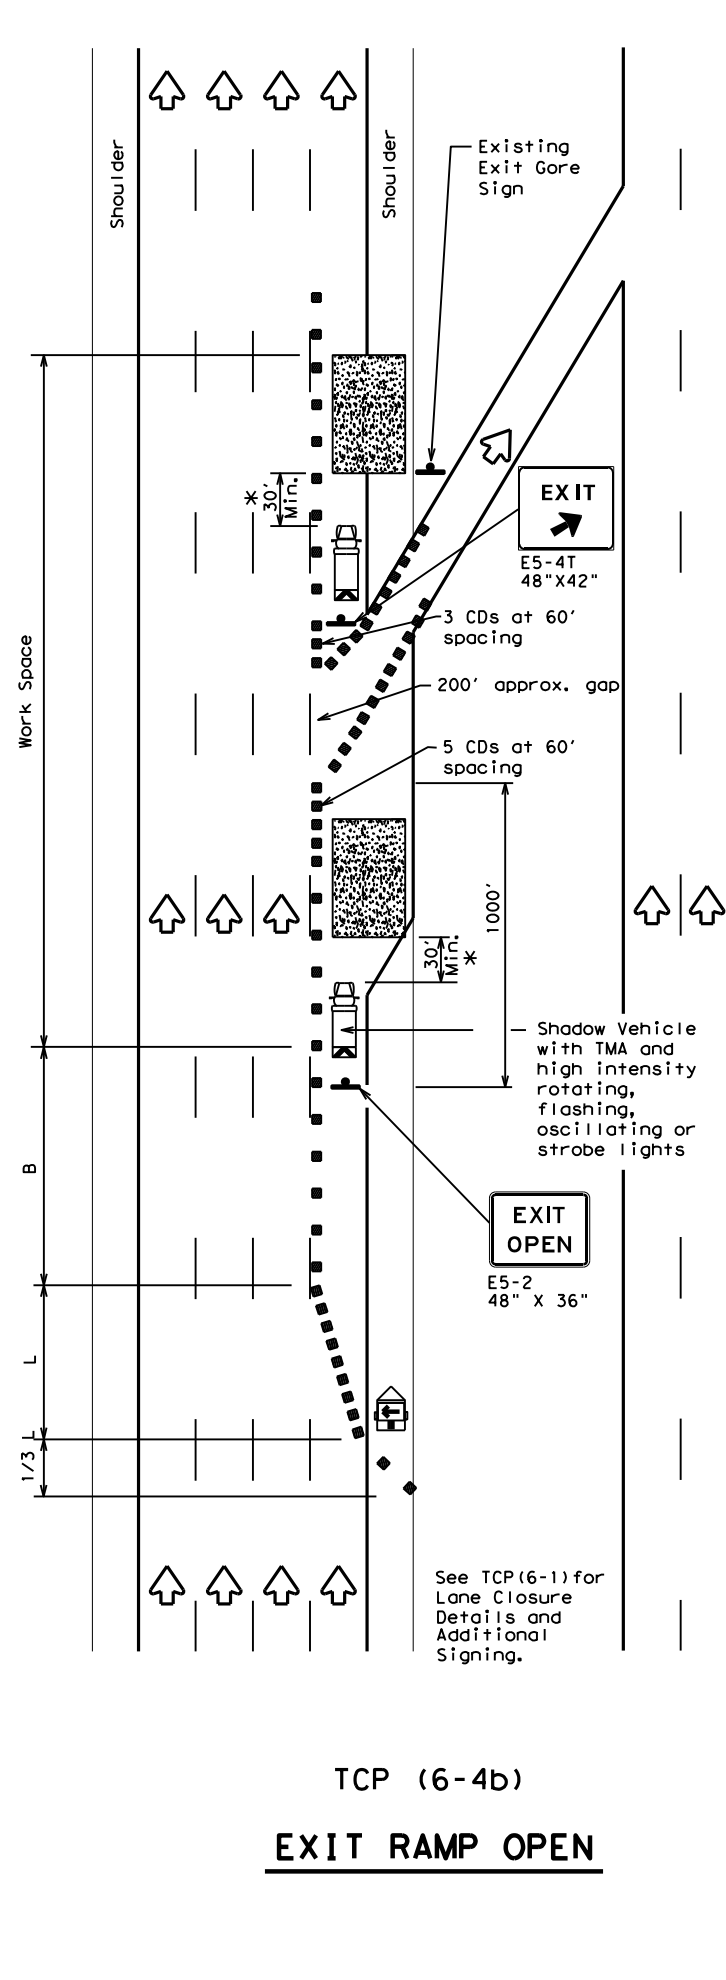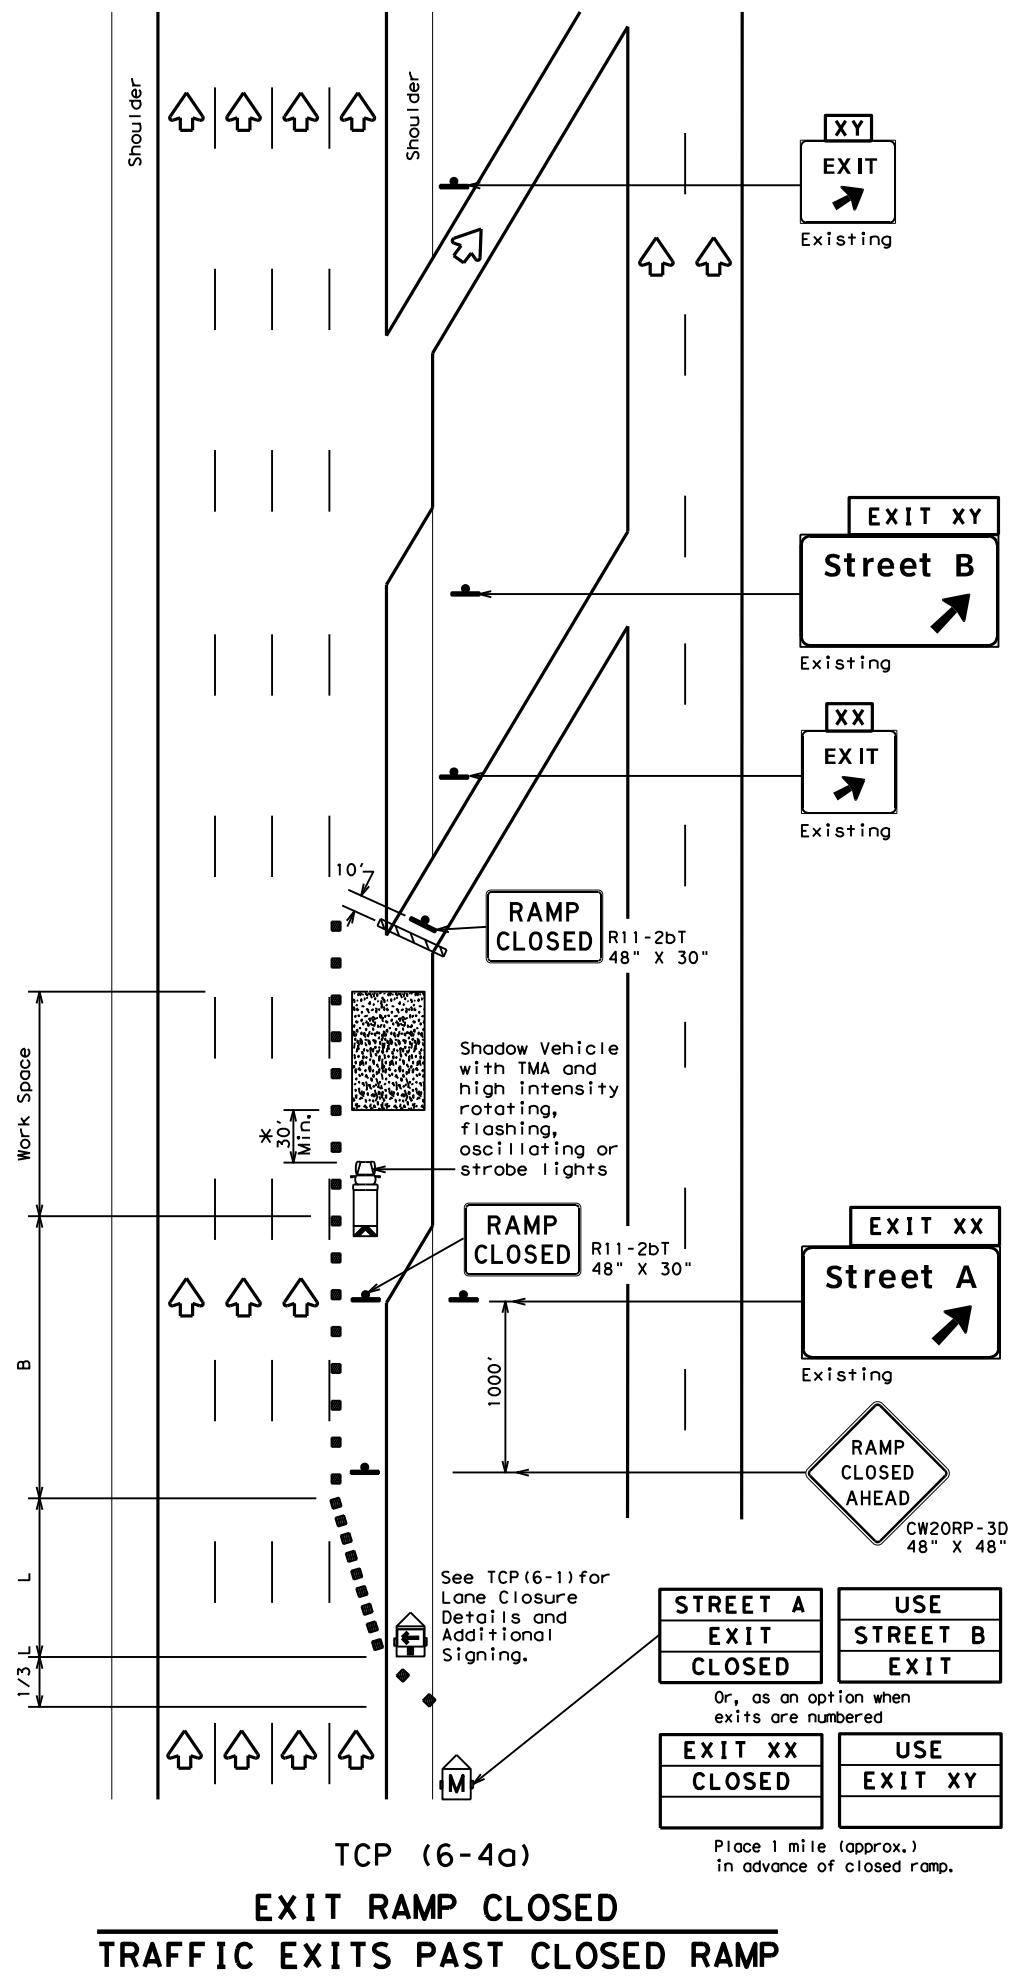

LEGEND			
	Type 3 Barricade		Channelizing Devices (CDs)
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed	Formula	Minimum Desirable Taper Lengths "L"			Suggested Maximum Spacing of Channelizing Devices		Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
45	L = WS	450'	495'	540'	45'	90'	195'
50		500'	550'	600'	50'	100'	240'
55		550'	605'	660'	55'	110'	295'
60		600'	660'	720'	60'	120'	350'
65		650'	715'	780'	65'	130'	410'
70		700'	770'	840'	70'	140'	475'
75		750'	825'	900'	75'	150'	540'
80		800'	880'	960'	80'	160'	615'

**Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	

- GENERAL NOTES**
- All traffic control devices illustrated are REQUIRED. Devices denoted with the triangle symbol may be omitted when stated elsewhere in the plans.
 - See BC Standards for sign details.

*A shadow vehicle equipped with a Truck Mounted Attenuator is typically required. A shadow vehicle equipped with a TMA shall be used if it can be positioned 30' to 100' in advance of the area of crew exposure without adversely affecting the work performance.

Additional requirements for lane closures and advance signing shall be as shown on TCP (6-1) or as directed by the Engineer.

Texas Department of Transportation
Traffic Operations Division Standard


TRAFFIC CONTROL PLAN
WORK AREA AT EXIT RAMP

TCP (6-4) - 12


FILE: tcp6-4.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
©TxDOT February 1994	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
1-97 8-98	DIST	COUNTY	SHEET NO.	
4-98 8-12	YKM	VICTORIA, ETC	39	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

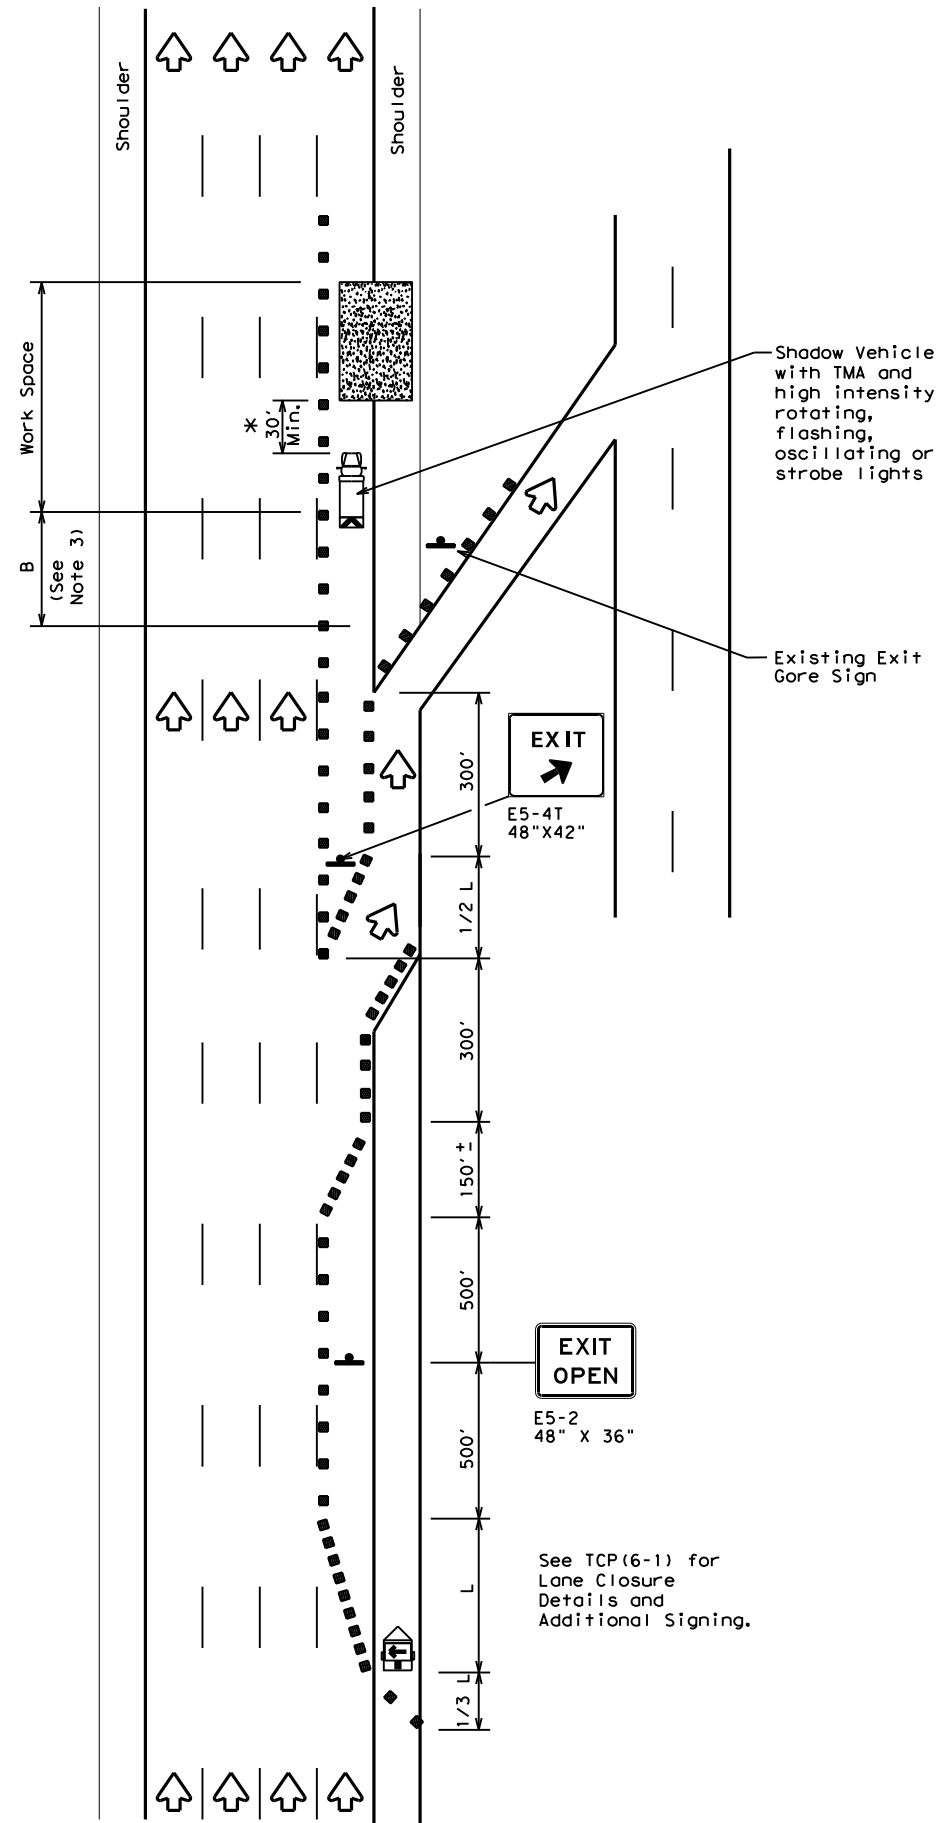

TCP (6-5a)
EXIT RAMP OPEN

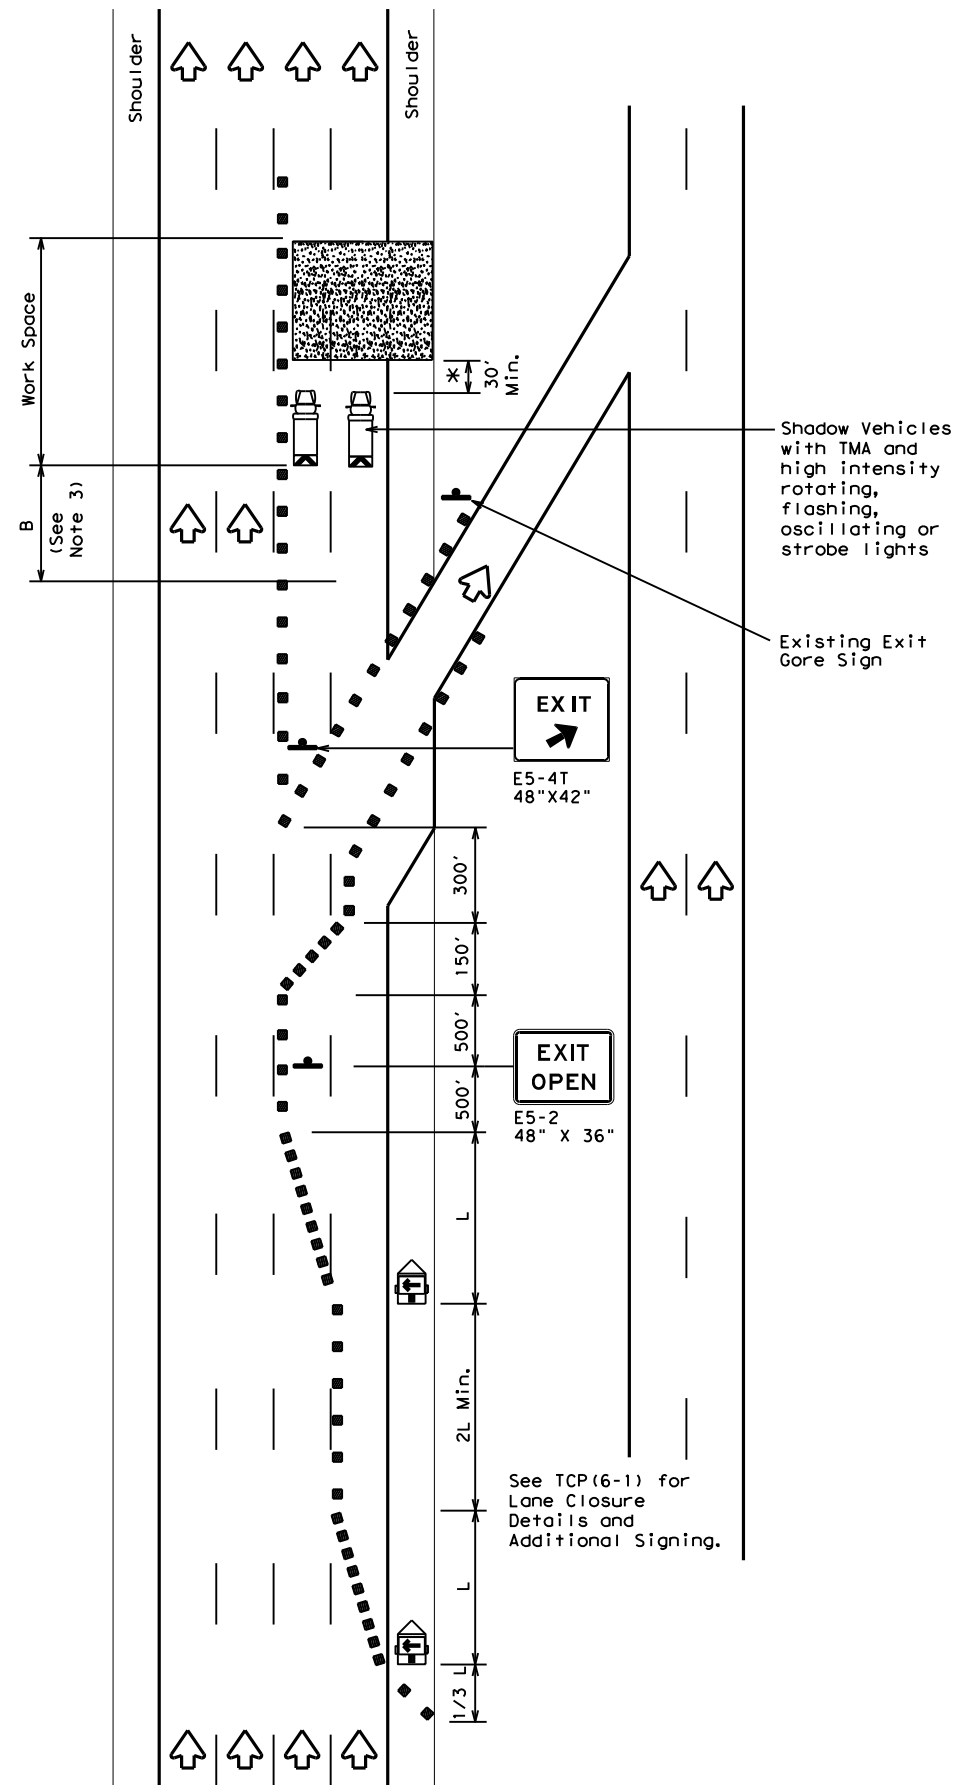

TCP (6-5b)
EXIT RAMP OPEN
TWO LANE CLOSURE WITHIN
1500' PAST EXIT RAMP

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed	Formula	Minimum Desirable Taper Lengths "L" * * *			Suggested Maximum Spacing of Channelizing Devices		Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
45	L = WS	450'	495'	540'	45'	90'	195'
50		500'	550'	600'	50'	100'	240'
55		550'	605'	660'	55'	110'	295'
60		600'	660'	720'	60'	120'	350'
65		650'	715'	780'	65'	130'	410'
70		700'	770'	840'	70'	140'	475'
75		750'	825'	900'	75'	150'	540'
80		800'	880'	960'	80'	160'	615'

* * * Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	

GENERAL NOTES

- All traffic control devices illustrated are REQUIRED. Devices denoted with the triangle symbol may be omitted when stated elsewhere in the plans.
- See BC standards for sign details.
- If adequate longitudinal buffer length "B" does not exist between the work space and the exit ramp, consideration should be given to closing the ramp.

*A shadow vehicle equipped with a Truck Mounted Attenuator is typically required. A shadow vehicle equipped with a TMA shall be used if it can be positioned 30' to 100' in advance of the area of crew exposure without adversely affecting the work performance.

Additional requirements for lane closures and advance signing shall be as shown on TCP (6-1) or as directed by the Engineer.



TRAFFIC CONTROL PLAN
WORK AREA BEYOND EXIT RAMP

TCP (6-5) - 12


FILE: tcp6-5.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
1-97 8-98	DIST	COUNTY	SHEET NO.	
4-98 8-12	YKM	VICTORIA, ETC	40	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

Warning sign and rumble strip sequence in opposite direction is same as below.

Flagger to Flagger (Length of Work Area)	ADT	# of Rumble Strip Arrays
1/8 Mile	< 4,500	1
	≥ 4,500	2
1/4 Mile	< 3,500	1
	≥ 3,500	2
1/2 Mile	< 2,600	1
	≥ 2,600	2
1 Mile	< 1,600	1
	≥ 1,600	2
> 1 Mile	N/A	2

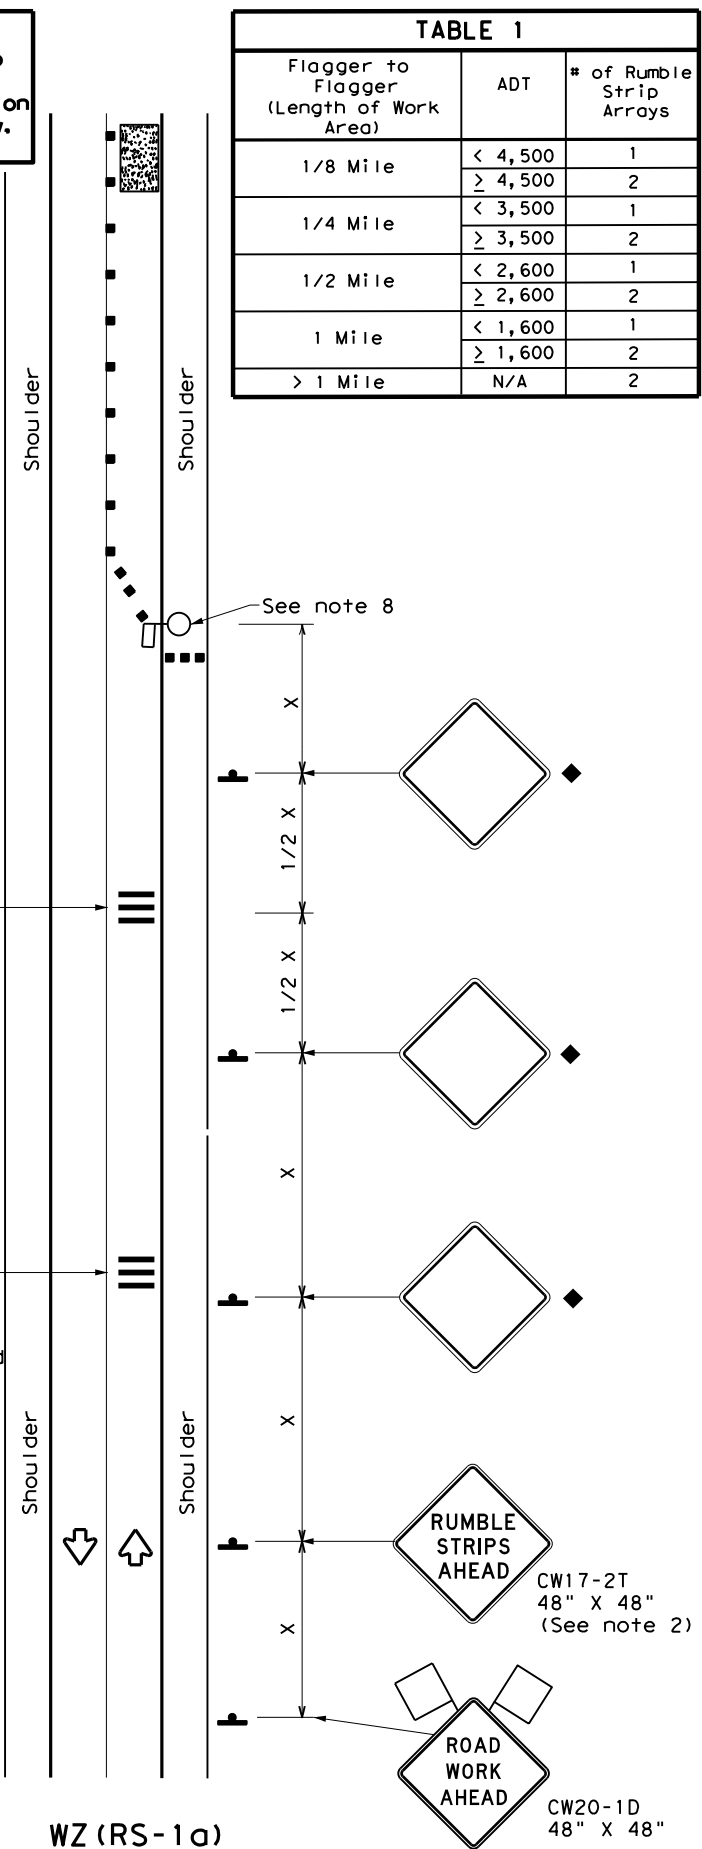

RUMBLE STRIPS ON ONE-LANE TWO-WAY APPLICATION

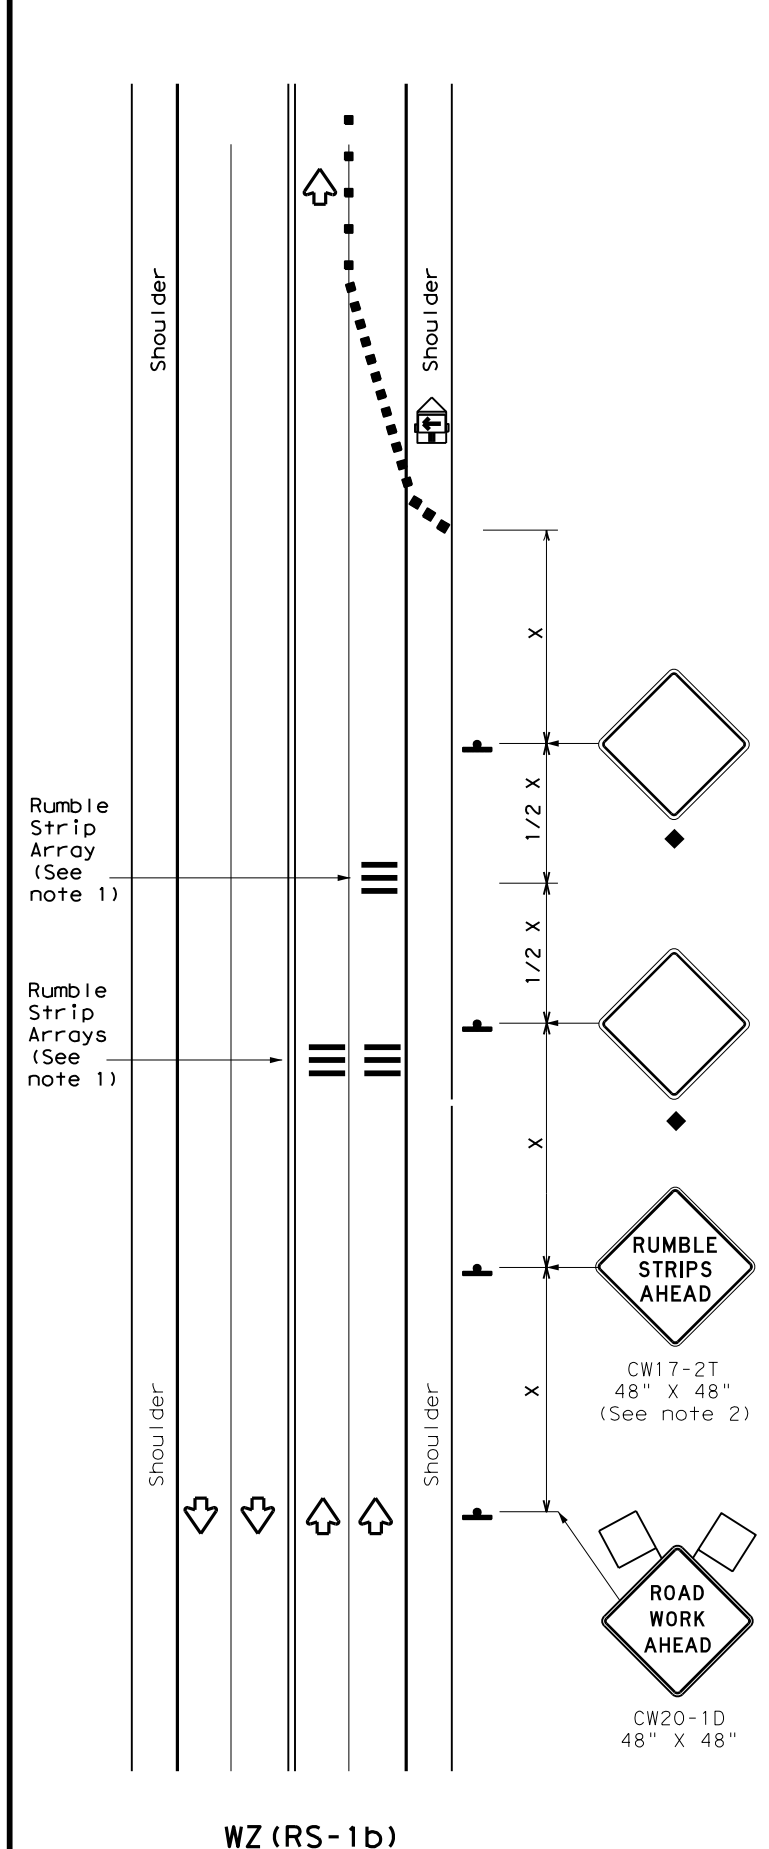

RUMBLE STRIPS FOR LANE CLOSURE ON CONVENTIONAL ROADWAY

GENERAL NOTES

- Each Rumble Strip Array should consist of three rumble strips spaced center to center at the spacing shown in Table 2, placed transverse across the lane at locations shown.
- The CW17-2T "RUMBLE STRIPS AHEAD" sign should be located after the CW20-1D "ROAD WORK AHEAD" sign and spaced as shown. If traffic is observed to be queuing, or is expected to queue beyond the Rumble Strips, the CW17-2T sign and the first Rumble Strip Array may be located upstream of the CW20-1D sign as necessary to provide needed warning.
- Temporary Rumble Strips will be considered subsidiary to Item 502, and shall be a product listed on the Compliant Work Zone Traffic Control Devices.
- Remove Temporary Rumble Strips before removing the advanced warning signs.
- Temporary Rumble Strips should not be used on horizontal curves, loose gravel, soft or bleeding asphalt, heavily rutted pavements or unpaved surfaces.
- Temporary Rumble Strips shall be installed and maintained as per manufacturer's recommendations.
- This standard sheet shall be used in conjunction with other appropriate TCP standard, TMUTCD typical application or project specific detail for the project.
- The one-lane two-way application may utilize a flagger, an Automated Flagger Assistance Device (AFAD) or a Portable Traffic Signal (PTS).
- Replace defective Temporary Rumble Strips as directed by the Engineer.
- Temporary Rumble Strips may be used on freeways or expressways based on engineering judgment and written direction from the Engineer.

Speed	Approximate distance between strips in an array
≤ 40 MPH	10'
> 40 MPH & ≤ 55 MPH	15'
= 60 MPH	20'
≥ 65 MPH	* 35' +

	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Panel		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "x" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	L = WS/2 60	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

* Conventional Roads Only
** Taper lengths have been rounded off.
L=Length of Taper (FT) W=Width of Offset (FT)
S=Posted Speed (MPH)

MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓		

◆ Signs are for illustrative purposes only. Signs required may vary depending on the TCP, TMUTCD Typical Application, or project specific details for the project.
* For posted speeds in excess of 65 MPH, it is recommended that spacing is increased as speed limits increase. Increasing space between rumble strips will improve effectiveness.

Texas Department of Transportation Traffic Safety Division Standard



TEMPORARY RUMBLE STRIPS

WZ (RS) - 22

FILE: wzrs22.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2012	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
2-14 1-22	DIST	COUNTY	SHEET NO.	
4-16	YKM	VICTORIA, ETC	41	

SHEET TOTALS


BID CODE	DESCRIPTION	UNIT	QTY
0132 6021	EMBANKMENT (VEHICLE)(ORD COMP)(TY C)	CY	50
0247 6370	FL BS (CMP IN PLC)(TY E GR 5)(FNL POS)	CY	40
0540-6001	MTL W-BEAM GD FEN (TIM POST)	LF	350
0544 6001	GUARDRAIL END TREATMENT (INSTALL)	EA	2

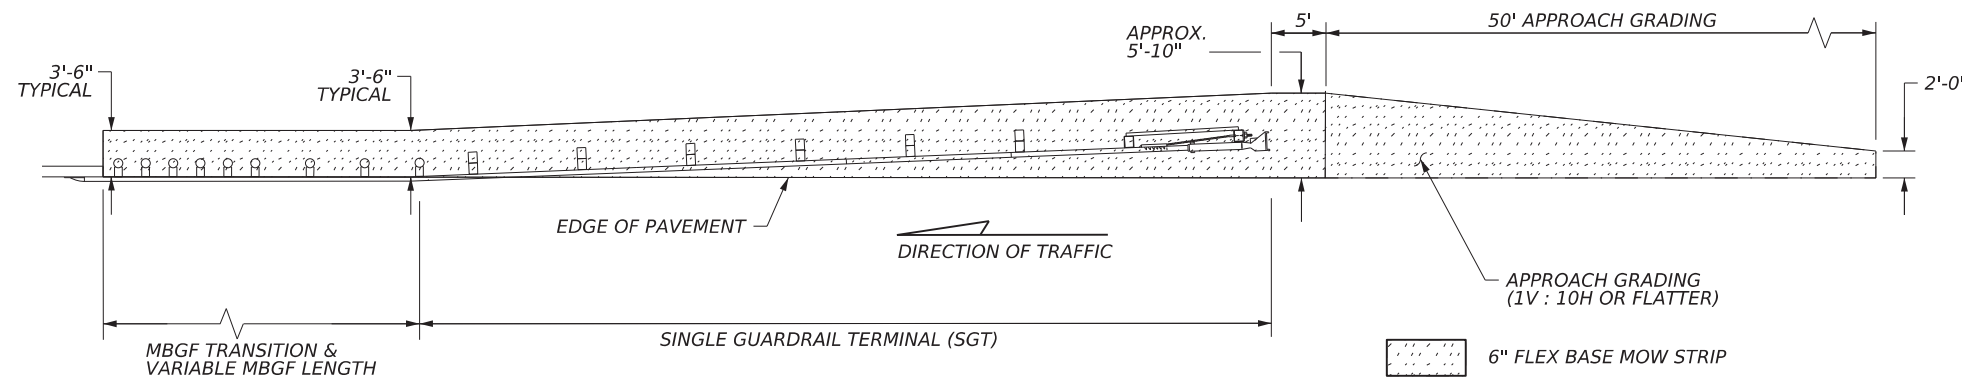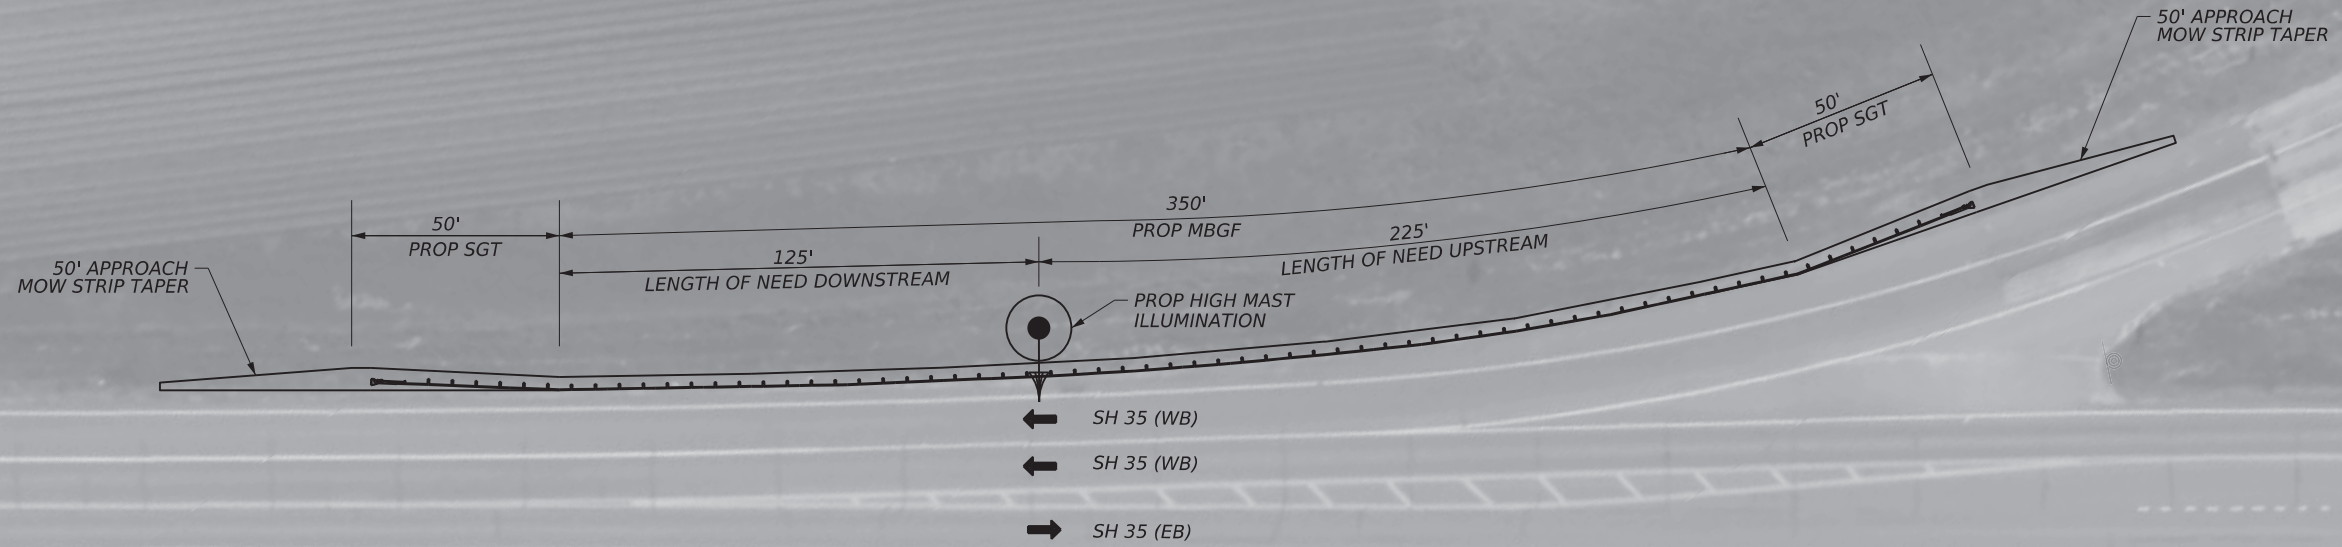

GRADING AT GUARDRAIL END TREATMENTS (FLEX BASE)

NOT TO SCALE

(SEE APPLICABLE STANDARDS FOR DETAILS NOT SHOWN)



Kathryn C. Marek, P.E.

October 6, 2023

**SH 35 @ FM 1862
MBGF LAYOUT
& SUMMARY**

SCALE: 1" = 50'

Texas Department of Transportation
© 2023 BY TEXAS DEPARTMENT OF TRANSPORTATION
ALL RIGHTS RESERVED


SHEET 1 OF 1

FED. RD. DIV. NO.		PROJECT NO.	
6			
CONT.	SECT.	JOB	HIGHWAY NO.
0088	05	110, ETC	US 59, ETC
STATE	DIST.	COUNTY	SHEET NO.
TEXAS	YKM	VICTORIA, ETC	42


PATH: T:\YK\TRAFFIC\MAINT\Design Projects\FY 24\Illumination CAT 11\SFIDGNISH 35 @ FM 1862
 FILE: SH35_FM1862_MBGF_LAYOUT.dgn
 DATE: 10/6/2023

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TXDOT FOR ANY PURPOSE WHATSOEVER. TXDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.


DATE: FILE:

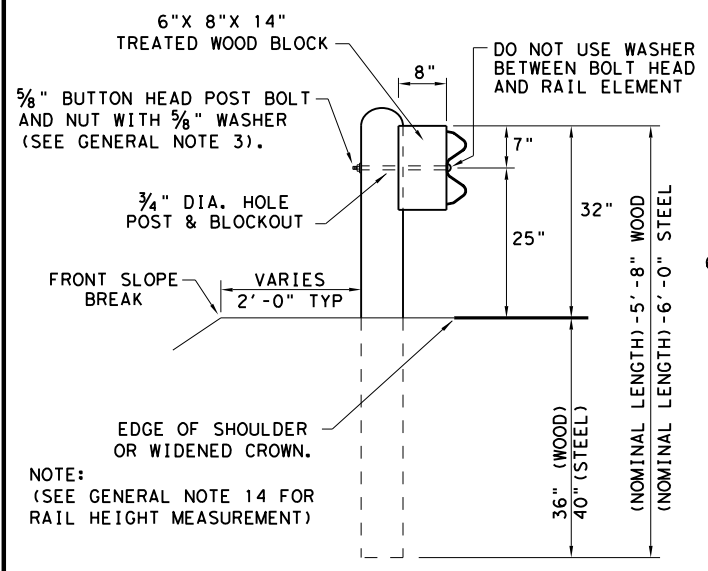


TYPICAL POST PLACEMENT

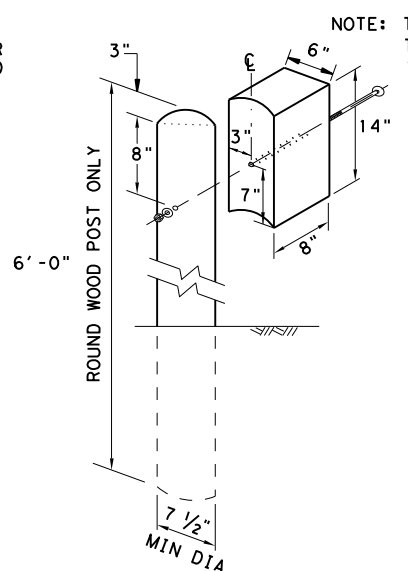

WOOD BLOCK TO ROUND WOOD POST

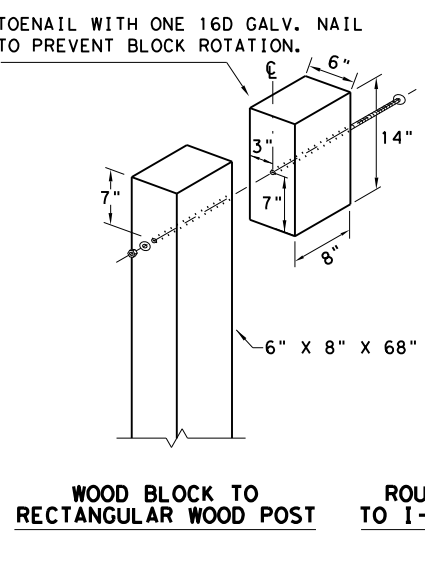


WOOD BLOCK TO RECTANGULAR WOOD POST

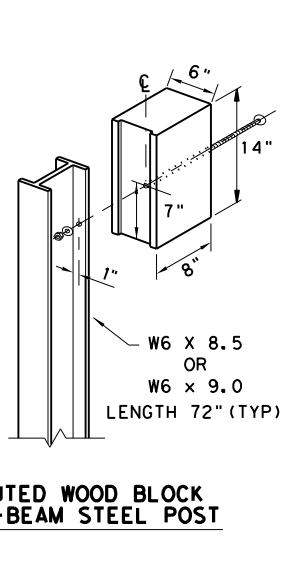


ROUTED WOOD BLOCK TO I-BEAM STEEL POST

- GENERAL NOTES**
1. THE TYPE OF POST (ROUND WOOD POST, RECTANGULAR WOOD POST, OR STEEL POST) WILL BE AS SHOWN IN THE PLANS. THE EXACT POSITION OF MBGF SHALL BE SHOWN IN THE PLANS OR AS DIRECTED BY THE ENGINEER. STEEL POSTS TO BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING."
 2. RAIL ELEMENTS SHALL MEET THE REQUIREMENTS OF ITEM 540, "METAL BEAM GUARD FENCE" EXCEPT AS MODIFIED IN THE PLANS. THE CONTRACTOR MAY FURNISH RAIL ELEMENTS OF 25'-0", OR 12'-6" (NOM.) LENGTHS. RAIL ELEMENTS MAY HAVE SLOTTED HOLES AT 3'-1 1/2" C-C OR 6'-3" C-C. A SPECIAL LENGTH OF RAIL MAY BE MANUFACTURED TO ACCOMMODATE THE DOWNSTREAM ANCHOR TERMINAL (DAT) AND THE TRANSITION SECTIONS OF GUARDRAIL.
 3. BUTTON HEAD "POST BOLTS & NUTS" SHALL MEET THE REQUIREMENTS OF (ASTM A307), AND SHALL BE OF SUFFICIENT LENGTH TO EXTEND THROUGH THE FULL THICKNESS OF THE NUT AND 3/8" WASHER (FWC160) AND NOT MORE THAN 1" BEYOND IT. TRIM REMAINING BOLT LENGTH TO MEET REQUIRED LENGTH.
 4. FITTINGS (BOLTS, NUTS, AND WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING." FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM.
 5. CROWN SHALL BE WIDENED TO ACCOMMODATE THE METAL BEAM GUARD FENCE.
 6. THE LATERAL APPROACH TO THE GUARD FENCE, SHALL HAVE A MAXIMUM SLOPE OF 1V:10H.
 7. IF SHOWN ELSEWHERE IN THE PLANS OR AS DIRECTED BY THE ENGINEER, THE GUARD FENCE MAY BE FLARED AT A RATE OF 25:1 OR FLATTER.
 8. UNLESS OTHERWISE SHOWN IN THE PLANS, GUARD FENCE PLACED IN THE VICINITY OF CURBS SHALL BE POSITIONED SO THAT THE FACE OF CURB IS LOCATED DIRECTLY BELOW OR BEHIND THE FACE OF THE RAIL. RAIL PLACED OVER CURBS SHALL BE INSTALLED SO THAT THE POST BOLT IS LOCATED APPROXIMATELY 25 INCHES ABOVE THE GUTTER PAN OR EDGE OF SHOULDER.
 9. APPLICATIONS IN SOLID ROCK ARE ONLY ALLOWED WITH STEEL POSTS. IF SOLID ROCK IS ENCOUNTERED WITHIN 0 TO 18" OF THE FINISHED GRADE, DRILL A 24" DIA. HOLE, 24" INTO THE ROCK. IF SOLID ROCK IS ENCOUNTERED BELOW 18", DRILL A 12" DIA. HOLE, 12" INTO THE ROCK OR TO THE STANDARD EMBEDMENT DEPTH, WHICHEVER MAYBE LESS. ANY EXCESS POST LENGTH, AFTER MEETING THESE DEPTHS, MAY BE FIELD CUT TO ENSURE PROPER GUARDRAIL MOUNTING HEIGHT. BACKFILL WITH COARSE AGGREGATE MATERIAL.
 10. POSTS SHALL NOT BE SET IN CONCRETE, OF ANY DEPTH.
 11. SPECIAL FABRICATION WILL BE REQUIRED AT INSTALLATION LOCATIONS HAVING A CURVATURE OF LESS THAN 150 FT. RADIUS.
 12. UNLESS OTHERWISE SHOWN IN THE PLANS, A COMPOSITE MATERIAL BLOCK THAT MEETS THE REQUIREMENTS OF DMS-7210, "COMPOSITE MATERIAL POSTS AND BLOCKS FOR METAL BEAM GUARD FENCE" MAY BE SUBSTITUTED FOR BLOCKS OF SIMILAR DIMENSIONS. THE CONSTRUCTION DIVISION, TXDOT MAINTAINS A MATERIAL PRODUCER LIST (MPL) FOR PRODUCERS OF MATERIALS CONFORMING TO DMS-7210 ONLY PRODUCERS ON THE MPL MAY FURNISH COMPOSITE MATERIAL BLOCKS.
 13. FOR THE LOW FILL CULVERT OPTION, POSTS LOCATED PARTIALLY OR WHOLLY BETWEEN PRECAST BOX CULVERT UNITS, THE USE OF A CAST-IN-PLACE CONCRETE CLOSURE BETWEEN BOXES IS REQUIRED. THE LENGTH OF THE CAST-IN-PLACE CONCRETE CLOSURE SHALL ACCOMMODATE THE PLACEMENT OF THE LOW FILL CULVERT OPTION. SEE CONCRETE CLOSURE DETAILS ON BRIDGE STANDARD SCP-MD.
 14. GUARDRAIL HEIGHT MEASUREMENT: WHEN THE GUARDRAIL IS LOCATED ABOVE PAVEMENT, MEASURE THE HEIGHT FROM THE PAVEMENT TO THE TOP OF THE W-BEAM RAIL. WHEN THE GUARDRAIL IS LOCATED UP TO 2 FT. OFF OF THE EDGE OF PAVEMENT OR FOR A PAVEMENT OVERLAY, USE A 10-FOOT STRAIGHTEDGE TO EXTEND THE PAVEMENT/SOULDER SLOPE TO THE BACK OF RAIL, MEASURE FROM THE BOTTOM OF STRAIGHTEDGE TO THE TOP OF RAIL. FOR GUARDRAIL LOCATED DOWN A 10:1 SLOPE, MEASURE FROM THE NOMINAL TERRAIN.

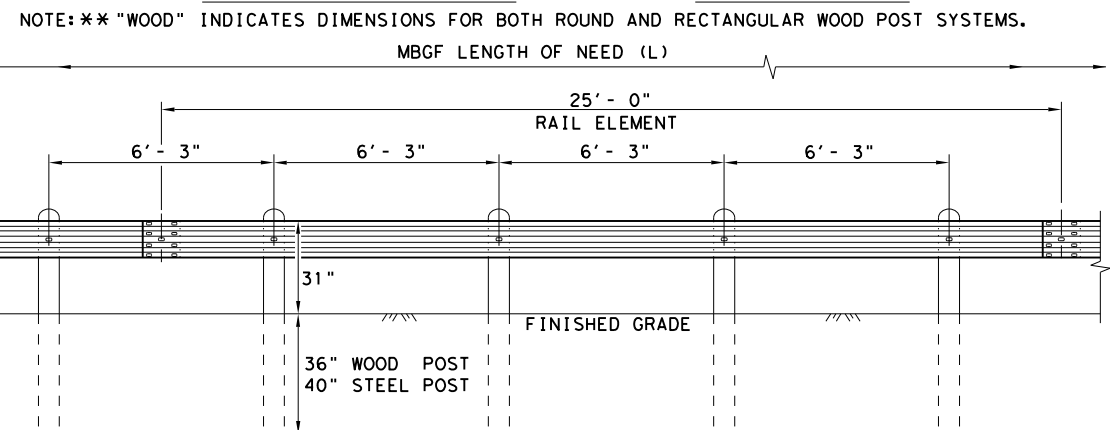

ELEVATION MID-SPAN RAIL SPLICE


SHOWING A 25'-0" SECTION OF W-BEAM RAIL. (SEE GENERAL NOTE 2)

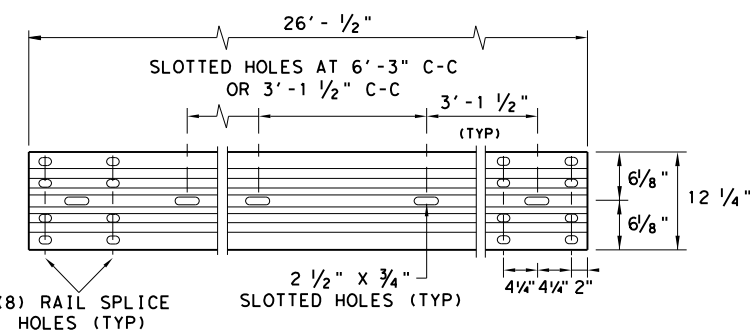

ELEVATION 25'-0" (NOM.) W-BEAM SECTION

NOTES: SEE GENERAL NOTE 2 FOR ALLOWABLE RAIL TYPES. SEE RAIL SPLICE DETAIL FOR REQUIRED HARDWARE.


* POST(S) MAY REQUIRE FIELD MODIFICATION TO ENSURE PROPER GUARDRAIL HEIGHT.

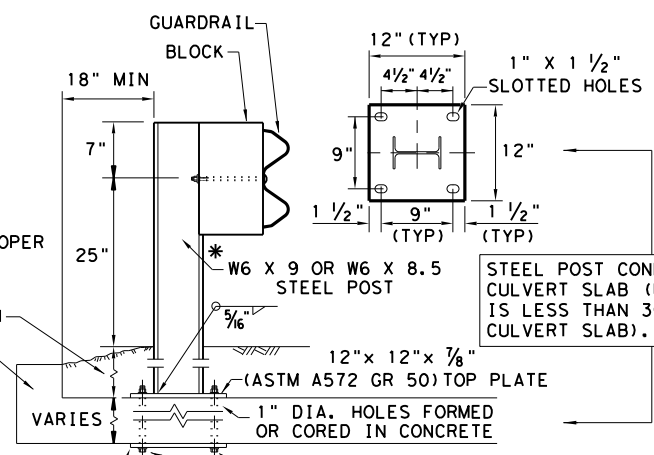

LOW FILL CULVERT POST


1. **BOLT-THROUGH OPTION:** REQUIRES A 6" MIN. SLAB THICKNESS. 7/8" DIA (ASTM A449) HEAVY HEX BOLTS WITH TWO HARDENED WASHER EACH AND HEAVY HEX NUTS. NOTE: BOLT LENGTH = SLAB PLUS 2 1/4" MIN.
2. **EPOXY ANCHOR OPTION:** THIS OPTION MAY ONLY BE USED IF THE CULVERT SLAB IS 9" MIN. THICK. THREADED ANCHOR RODS MUST BE 7/8" DIA. ASTM A449 OR A193 GRADE B7 WITH HEAVY HEX NUT, AND ONE HARDENED WASHER EACH. EMBED ANCHOR RODS 6" WITH HILTI HIT RE 500 EPOXY ADHESIVE. OTHER TYPE III CLASS C EPOXY ADHESIVES MEETING THE REQUIREMENTS OF DMS-6100, "EPOXIES AND ADHESIVES", MAY BE USED IF IT CAN BE DEMONSTRATED THAT THEY MEET OR EXCEED THE STRENGTH OF HILTI HIT RE 500 WITH THE SAME EMBEDMENT DEPTH AND THREADED ROD DIA. FOLLOW THE MANUFACTURER'S REQUIREMENTS FOR INSTALLING EPOXIED THREADED RODS. EXTEND RODS 1/4" MIN. BEYOND NUT.

NOTE: CULVERTS OF 25 FT. OR LESS, SEE GF(31)LS STANDARD FOR "LONG SPAN" OPTION.

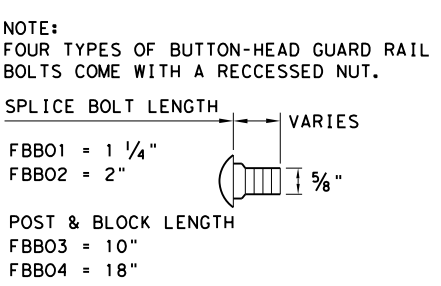

BUTTON HEAD BOLT

NOTE: SEE GENERAL NOTE 3 FOR SPLICE & POST BOLT DETAILS.

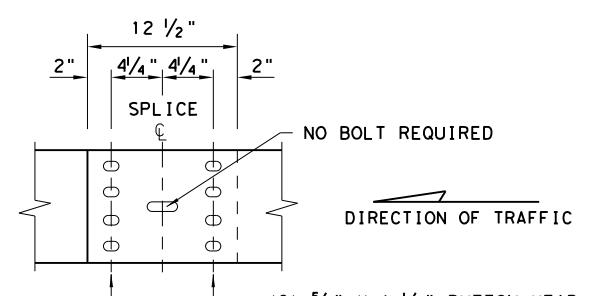


MID-SPAN RAIL SPLICE DETAIL

NOTE: GF(31), MID-SPAN RAIL SPLICES ARE REQUIRED WITH 6'-3" POST SPACINGS.

		Design Division Standard	
<h2>METAL BEAM GUARD FENCE</h2> <h3>TL-3 MASH COMPLIANT</h3> <h1>GF(31)-19</h1>			
FILE: gf3119.dgn	DN: TXDOT	CK: KM	DW: VP
© TXDOT: NOVEMBER 2019	CONT	SECT	JOB
REVISIONS	0088	05	110, ETC
	DIST	COUNTY	SHEET NO.
	YKM	VICTORIA, ETC	43




DISCLAIMER: THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TXDOT FOR ANY PURPOSE WHATSOEVER. TXDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

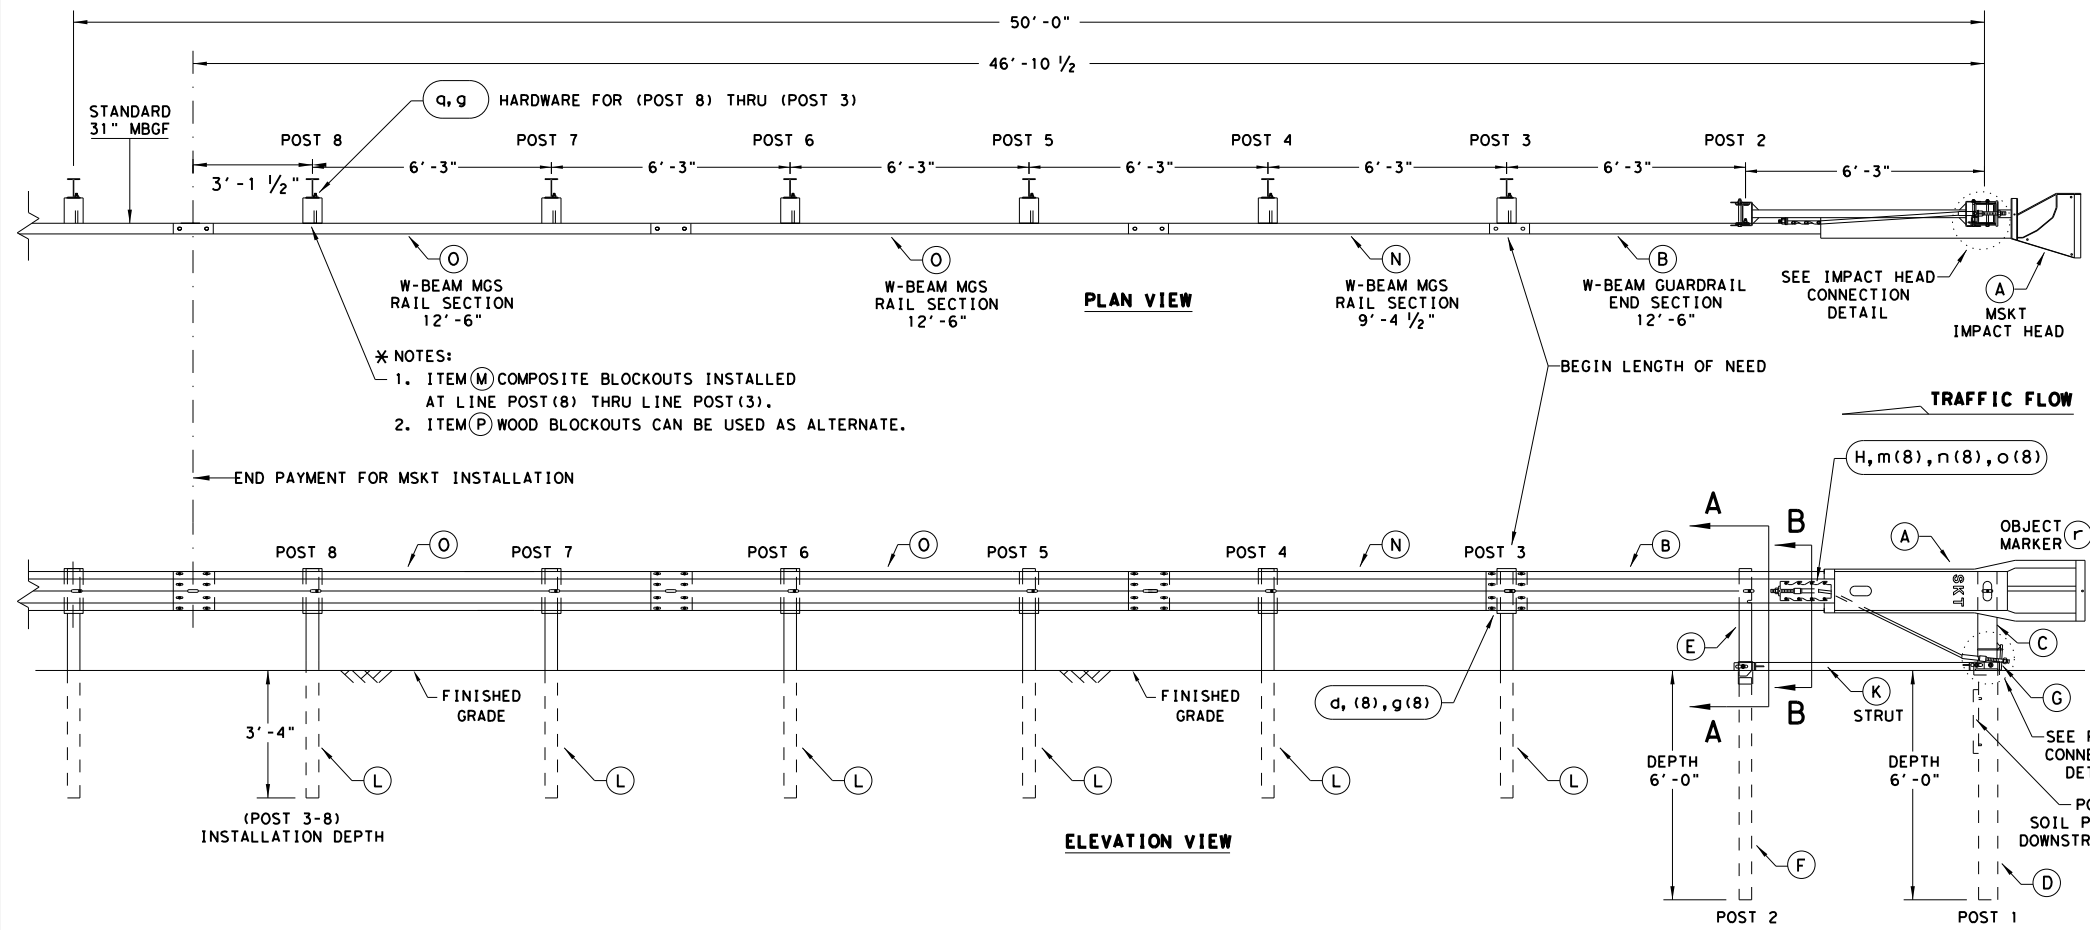


- * NOTES:**
- ITEM (M) COMPOSITE BLOCKOUTS INSTALLED AT LINE POST (8) THRU LINE POST (3).
 - ITEM (P) WOOD BLOCKOUTS CAN BE USED AS ALTERNATE.

- GENERAL NOTES**
- FOR SPECIFIC INFORMATION REGARDING INSTALLATION AND TECHNICAL GUIDANCE OF THE SYSTEM, CONTACT: ROAD SYSTEMS, INC. (432)263-2435. 3616 OLD HOWARD COUNTY AIRPORT, BIG SPRING, TX 79720
 - FOR INSTALLATION, REPAIR AND MAINTENANCE REFER TO THE: MSKT END TERMINAL, PRODUCT DESCRIPTION ASSEMBLY MANUAL (PUBLICATION-062717).
 - APPLY HIGH INTENSITY REFLECTIVE SHEETING, "OBJECT MARKER" ON THE FRONT FACE OF THE DEVICE PER MANUFACTURER'S RECOMMENDATIONS. OBJECT MARKER SHALL CONFORM TO THE STANDARDS REQUIRED IN TEXAS MUTCD.
 - FOR POST (LEAVE-OUT) INSTALLATION AND GUIDANCE SEE TXDOT'S LATEST ROADWAY MOW STRIP STANDARD.
 - HARDWARE (BOLTS, NUTS, & WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING". FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM.
 - SYSTEM SHOWN USING STEEL WIDE FLANGE POSTS WITH COMPOSITE BLOCKOUTS.
 - A COMPOSITE MATERIAL BLOCKOUTS THAT MEETS THE REQUIREMENTS OF DMS-7210, MAY BE SUBSTITUTED FOR BLOCKOUTS OF SIMILAR DIMENSIONS. SEE CONSTRUCTION DIVISION MATERIAL PRODUCER LIST (MPL) FOR CERTIFIED PRODUCERS.
 - IF SOLID ROCK IS ENCOUNTERED IN THE AREA OF (POST 1) AND / OR (POST 2) CONTACT THE MANUFACTURER, & REFER TO THE LATEST ROADWAY MOW STRIP STANDARD FOR INSTALLATION GUIDANCE.
 - POSTS SHALL NOT BE SET IN CONCRETE.
 - SYSTEM MUST BE ATTACHED TO STANDARD 31" MBGF.
 - UNDER NO CIRCUMSTANCES SHALL THE GUARDRAIL WITHIN THE MSKT SYSTEM BE CURVED.
 - A FLARE RATE OF UP TO 25:1 MAY BE USED TO PREVENT THE TERMINAL HEAD FROM ENCRANCHING ON THE SHOULDER. THE FLARE MAY BE DECREASED OR ELIMINATED FOR SPECIFIC INSTALLATIONS, IF DIRECTED BY THE ENGINEER.
 - THE SYSTEM IS SHOWN WITH TWO 12'-6" MBGF PANELS, ONE 25'-0" MBGF PANEL IS ALSO ALLOWED IN ITS PLACE.
 - A DRIVING CAP WITH A TIMBER OR PLASTIC INSERT SHALL BE USED WHEN DRIVING POSTS 3-8 TO PREVENT DAMAGE TO THE GALVANIZING ON TOP OF THE POST. SPECIAL DRIVING CAP TO BE USED ON LOWER POSTS 1 & 2 TO PREVENT DAMAGE TO THE WELDED PLATES.

ITEM	QTY	MAIN SYSTEM COMPONENTS	ITEM NUMBERS
A	1	MSKT IMPACT HEAD	MS3000
B	1	W-BEAM GUARDRAIL END SECTION, 12 Go.	SF1303
C	1	POST 1 - TOP (6" x 6" x 1/8" TUBE)	MTPHP1A
D	1	POST 1 - BOTTOM (6' W6X15)	MTPHP1B
E	1	POST 2 - ASSEMBLY TOP	UHP2A
F	1	POST 2 - ASSEMBLY BOTTOM (6' W6X9)	HP2B
G	1	BEARING PLATE	E750
H	1	CABLE ANCHOR BOX	S760
J	1	BCT CABLE ANCHOR ASSEMBLY	E770
K	1	GROUND STRUT	MS785
L	6	W6X9 OR W6X8.5 STEEL POST	P621
M	6	COMPOSITE BLOCKOUTS	CBSP-14
N	1	W-BEAM MGS RAIL SECTION (9'-4 1/2")	G12025
O	2	W-BEAM MGS RAIL SECTION (12'-6")	G1203A
P	6	WOOD BLOCKOUT 6" X 8" X 14"	P675
Q	1	W-BEAM MGS RAIL SECTION (25'-0")	G1209
SMALL HARDWARE			
o	2	5/8" x 1" HEX BOLT (GRD 5)	B5160104A
b	4	5/8" WASHER	W0516
c	2	5/8" HEX NUT	N0516
d	25	5/8" Dia. x 1 1/4" SPLICE BOLT (POST 2)	B580122
e	2	5/8" Dia. x 9" HEX BOLT (GRD A449)	B580904A
f	3	5/8" WASHER	W050
g	33	5/8" Dia. H.G.R NUT	N050
h	1	3/4" Dia. x 8 1/2" HEX BOLT (GRD A449)	B340854A
j	1	3/4" Dia. HEX NUT	N030
k	2	1 ANCHOR CABLE HEX NUT	N100
i	2	1 ANCHOR CABLE WASHER	W100
m	8	1/2" x 1 1/4" A325 BOLT WITH CAPTIVE WASHER	SB12A
n	8	1/2" STRUCTURAL NUTS	N012A
o	8	1 1/8" O.D. x 3/8" I.D. STRUCTURAL WASHERS	W012A
p	1	BEARING PLATE RETAINER TIE	CT-100ST
q	6	5/8" x 10" H.G.R. BOLT	B581002
r	1	OBJECT MARKER 18" X 18"	E3151

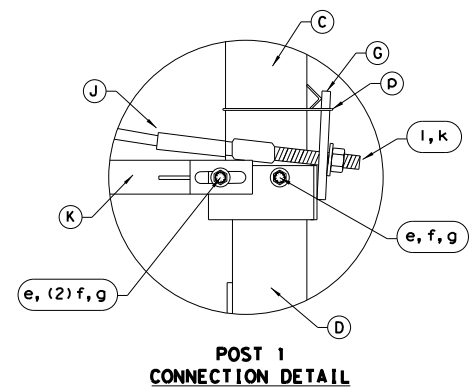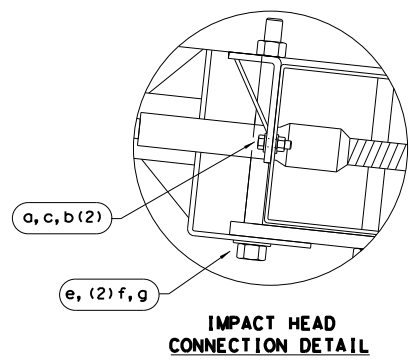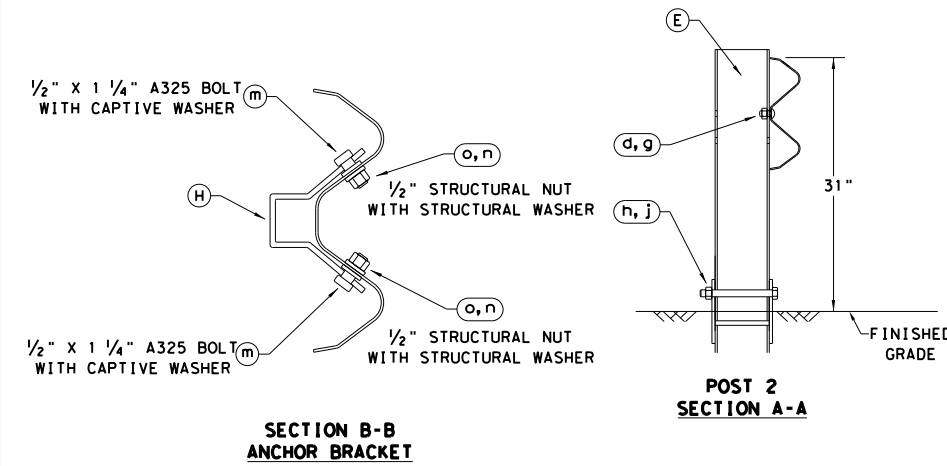

ALTERNATIVE ITEMS NOT SHOWN. * *
 * ITEM (P) 8" WOOD-BLOCKOUT
 * * ITEM (Q) 25' GUARD FENCE PANEL

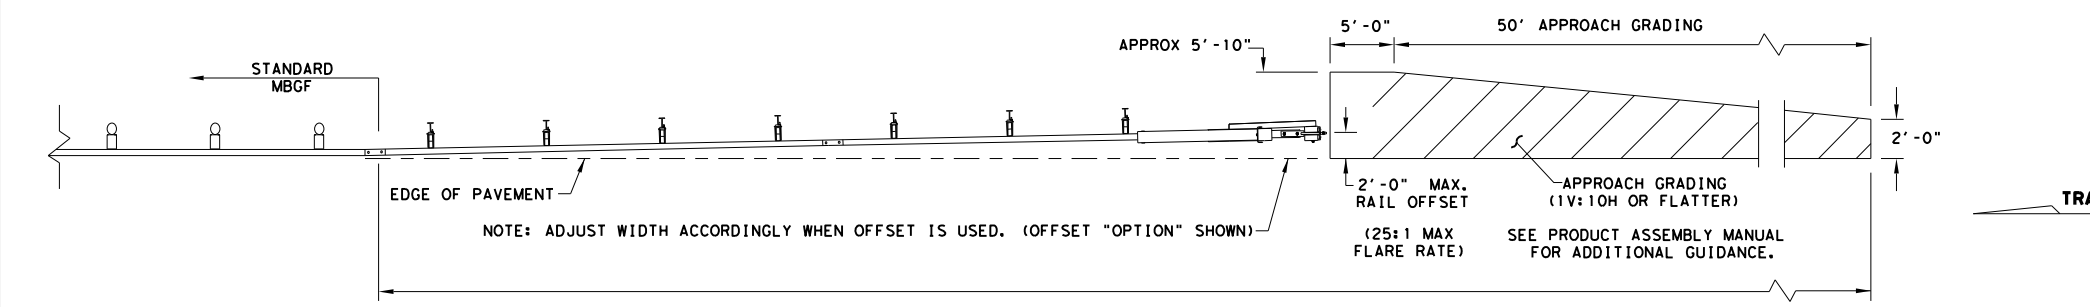

NOTE: TXDOT GENERIC APPROACH GRADING LAYOUT USED FOR ALL TANGENT TYPE END TREATMENTS.

NOTE: THIS STANDARD IS A BASIC REPRESENTATION OF THE MSKT END TERMINAL, IT IS NOT INTENDED TO REPLACE THE PRODUCT DESCRIPTION ASSEMBLY MANUAL.

Design Division Standard

SINGLE GUARDRAIL TERMINAL








MSKT-MASH-TL-3

SGT (12S) 31-18

FILE: sgt12s3118.dgn	DN: TXDOT	CK: KM	DW: VP	CK: CL
© TXDOT: APRIL 2018	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
	DIST	COUNTY	SHEET NO.	
	YKM	VICTORIA, ETC	44	

DATE: FILE:

DISCLAIMER: THE USE OF THIS STANDARD IS GOVERNED BY THE "TEXAS ENGINEERING PRACTICE ACT". NO WARRANTY OF ANY KIND IS MADE BY TXDOT FOR ANY PURPOSE WHATSOEVER. TXDOT ASSUMES NO RESPONSIBILITY FOR THE CONVERSION OF THIS STANDARD TO OTHER FORMATS OR FOR INCORRECT RESULTS OR DAMAGES RESULTING FROM ITS USE.

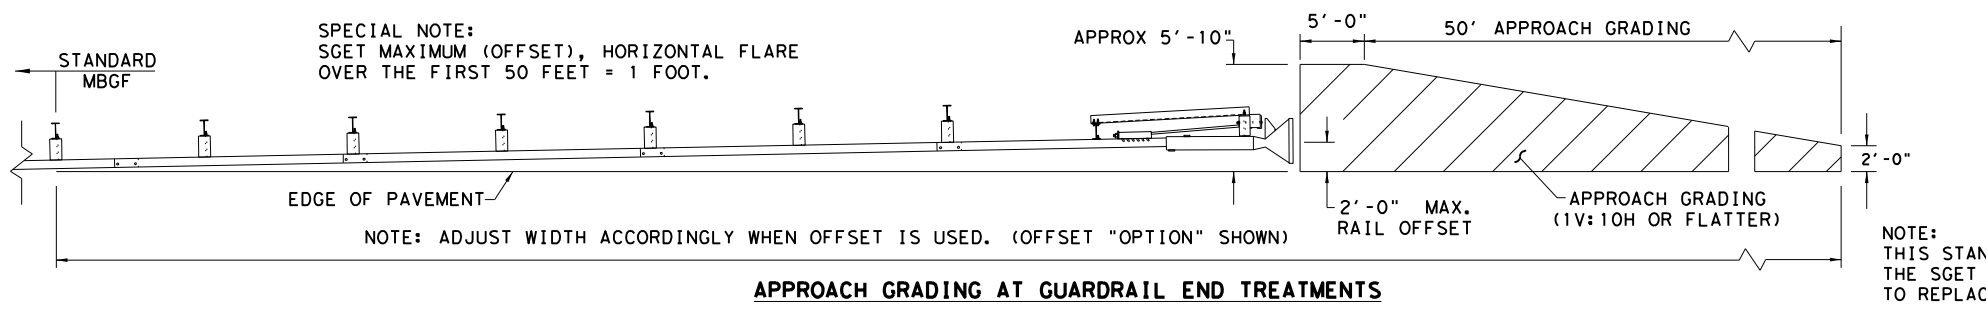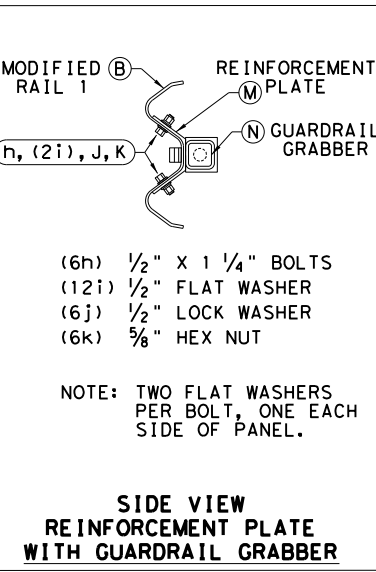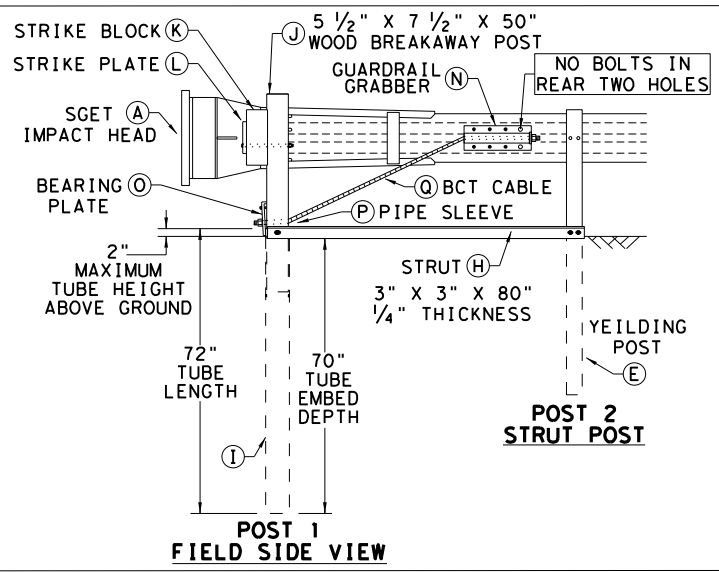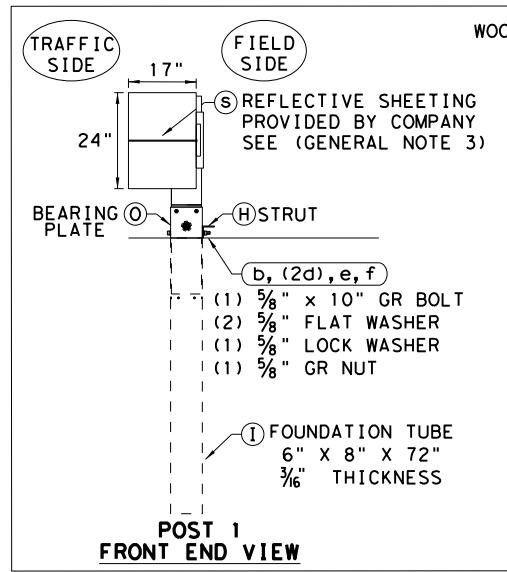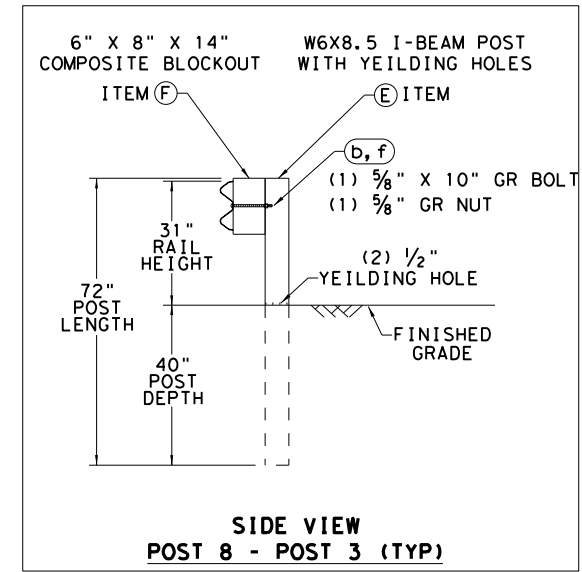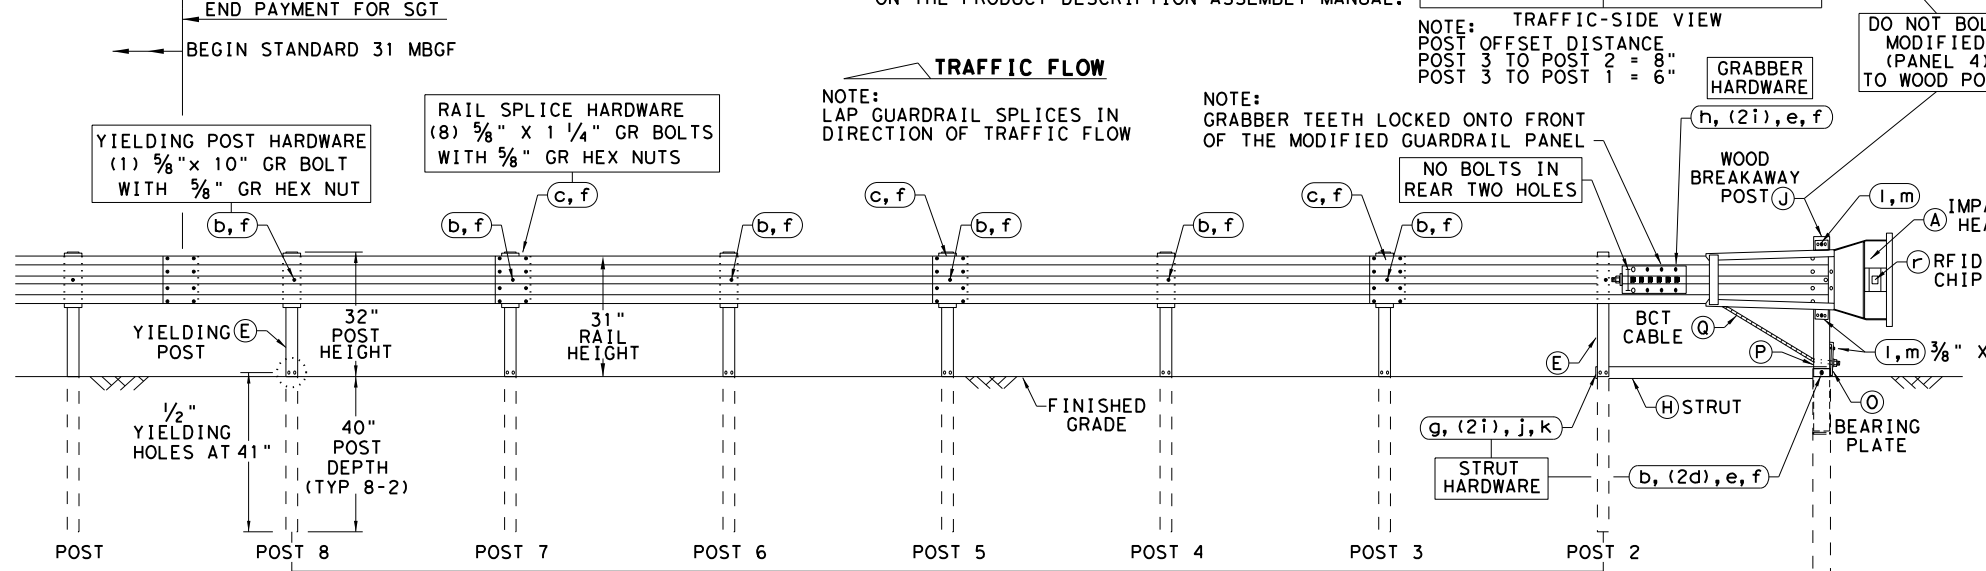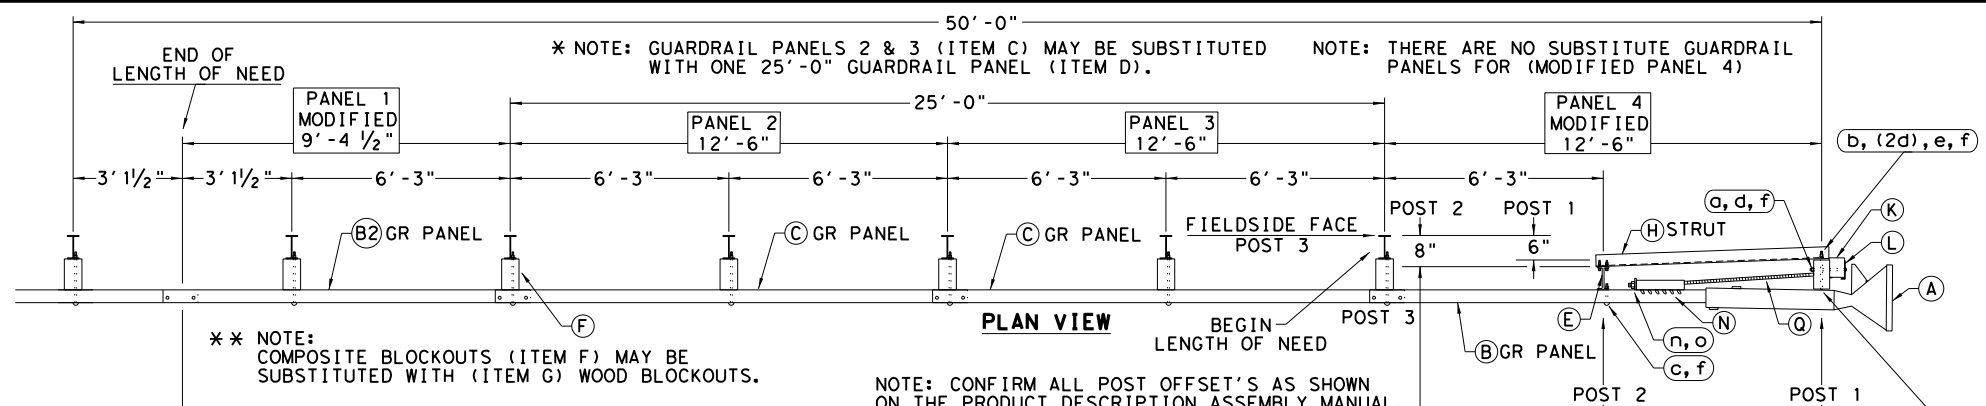

- ### GENERAL NOTES
- FOR SPECIFIC INFORMATION REGARDING INSTALLATION AND TECHNICAL GUIDANCE OF THE SYSTEM, CONTACT: SPIG INDUSTRY, INC. AT 1(267) 644-9510. 14675 INDUSTRIAL PARK RD; BRISTOL, VA 24202
 - FOR INSTALLATION, REPAIR AND MAINTENANCE REFER TO THE MANUFACTURER'S; SGET END TERMINAL, PRODUCT DESCRIPTION ASSEMBLY MANUAL.
 - MANUFACTURER WILL APPLY HIGH INTENSITY REFLECTIVE SHEETING, "OBJECT MARKER" TO THE FACE PLATE OF THE DEVICE PER MANUFACTURER'S RECOMMENDATIONS. THE OBJECT MARKER SHALL CONFORM TO THE STANDARDS REQUIRED IN TEXAS MUTCD.
 - THE NOMINAL HEIGHT OF THE GUARDRAIL BEAM IS 31 INCHES WITH A TOLERANCE OF +/- ONE INCH.
 - FOR POST (LEAVE-OUT) INSTALLATION AND GUIDANCE SEE TXDOT'S LATEST ROADWAY MOW STRIP STANDARD.
 - (POST 2 THROUGH POST 8) ARE MODIFIED STEEL-YIELDING POSTS WITH YIELDING HOLES AT GROUND LEVEL. THERE ARE NO SUBSTITUTE POSTS.
 - POSTS SHALL NOT BE SET IN CONCRETE.
 - IF SOLID ROCK IS ENCOUNTERED FOR ANY OF THE POSTS IN THE SYSTEM, CONTACT THE MANUFACTURER FOR SPECIFIC INSTALLATION GUIDANCE.
 - HARDWARE (BOLTS, NUTS, & WASHERS) SHALL BE GALVANIZED IN ACCORDANCE WITH ITEM 445, "GALVANIZING". FITTINGS SHALL BE SUBSIDIARY TO THE BID ITEM.
 - A COMPOSITE MATERIAL BLOCKOUT THAT MEETS DMS-7210 REQUIREMENTS MAY BE SUBSTITUTED FOR AN APPROVED WOOD BLOCKOUT. SEE CONSTRUCTION DIVISION MATERIAL PRODUCER LIST (MPL) FOR CERTIFIED PRODUCERS.
 - THE ENTIRE SYSTEM MUST BE INSTALLED IN A STRAIGHT LINE WITHOUT ANY CURVE. HOWEVER, THE SYSTEM CAN BE OFFSET BY TWO FEET AS SHOWN ON THE APPROACH GRADING DETAIL TO HELP OFF-SET THE IMPACT HEAD FROM SHOULDER OF THE ROAD.

ITEM	QTY	MAIN SYSTEM COMPONENTS	ITEM #
A	1	SGET IMPACT HEAD	SIH1A
B	1	MODIFIED GUARDRAIL PANEL 12'-6" 12GA	126SPZGP
B2	1	MODIFIED GUARDRAIL PANEL 9'-4 1/2" 12GA	GP94
C	2	STANDARD GUARDRAIL PANEL 12'-6" 12GA	GP126
D	1	STANDARD GUARDRAIL PANEL 25'-0" 12GA	GP25
E	7	MODIFIED YIELDING I-BEAM POST W6x8.5	YP6MOD
F	6	COMPOSITE BLOCKOUT 6" X 8" X 14"	CBO8
G	6	WOOD BLOCKOUT 6" X 8" X 14"	WBO8
H	1	STRUT 3" X 3" X 80" X 1/4" A36 ANGLE	STR80
I	1	FOUNDATION TUBE 6" X 8" X 72" X 3/8"	FNDT6
J	1	WOOD BREAKAWAY POST 5 1/2" X 7 1/2" X 50"	WBRK50
K	1	WOOD STRIKE BLOCK	WSBK14
L	1	STRIKE PLATE 1/4" A36 BENT PLATE	SPLT8
M	1	REINFORCEMENT PLATE 12 GA. GR55	REPLT17
N	1	GUARDRAIL GRABBER 2 1/2" X 2 1/2" X 16 1/2"	GGR17
O	1	BEARING PLATE 8" X 8 5/8" X 5/8" A36	BPLT8
P	1	PIPE SLEEVE 4 1/4" X 2 3/8" O.D. (2 1/8" I.D.)	PSLV4
Q	1	BCT CABLE 3/4" X 81" LENGTH	CBL81
SMALL HARDWARE			
o	1	5/8" X 12" GUARDRAIL BOLT 307A HDG	12GRBLT
b	7	5/8" X 10" GUARDRAIL BOLT 307A HDG	10GRBLT
c	33	5/8" X 1 1/4" GR SPlice BOLTS 307A HDG	1GRBLT
d	3	5/8" FLAT WASHER F436 A325 HDG	58FW436
e	1	5/8" LOCK WASHER HDG	58LW
f	39	5/8" GUARDRAIL HEX NUT HDG	58HN563
g	2	1/2" X 2" STRUT BOLT A325 HDG	2BLT
h	6	1/2" X 1 1/4" PLATE BOLT A325 HDG	125BLT
i	16	1/2" FLAT WASHER F436 A325 HDG	12FWF436
j	8	1/2" LOCK WASHER HDG	12LW
k	8	1/2" HEX NUT A563 HDG	12HN563
l	4	3/8" X 3" HEX LAG SCREW GR5 HDG	38LS
m	4	3/8" FLAT WASHER F436 A325 HDG	38FW844
n	2	1" FLAT WASHER F436 A325 HDG	1FWF436
o	2	1" HEX NUT A563DH HDG	1HN563
p	1	18" TO 24" LONG ZIP TIE RATED 175-200LB	ZPT18
q	1	1 1/2" X 4" SCH-40 PVC PIPE	PSPCR4
r	1	RFID CHIP RATED MIL-STD-810F	RFID810F
s	1	IMPACT HEAD REFLECTIVE SHEETING	RS30M

Design Division Standard

SPIG INDUSTRY, LLC

SINGLE GUARDRAIL TERMINAL

SGET - TL-3 - MASH

SGT (15) 31-20

FILE: sg+153120.dgn	DN: TXDOT	CK: KM	DW: VP	CK: VP
© TXDOT: APRIL 2020	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
	DIST	COUNTY	SHEET NO.	
	YKM	VICTORIA, ETC	45	

DATE: FILE:

NOTE: THIS STANDARD IS A BASIC REPRESENTATION OF THE SGET TERMINAL SYSTEM AND IS NOT INTENDED TO REPLACE THE MANUFACTURER'S ASSEMBLY MANUAL.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

SIGN SUPPORT DESCRIPTIVE CODES

(Descriptive Codes correspond to project estimate and quantities sheets)

SM RD SGN ASSM TY XXXXX(X)XX(X-XXXX)

Post Type

- FRP = Fiberglass Reinforced Plastic Pipe (see SMD(FRP))
- TWT = Thin-Walled Tubing (see SMD(TWT))
- 10BWG = 10 BWG Tubing (see SMD(SLIP-1) to (SLIP-3))
- S80 = Schedule 80 Pipe (see SMD(SLIP-1) to (SLIP-3))

Number of Posts (1 or 2)


Anchor Type

- UA = Universal Anchor - Concreted (see SMD(FRP) and (TWT))
- UB = Universal Anchor - Bolted down (see SMD(FRP) and (TWT))
- WS = Wedge Anchor Steel - (see SMD(TWT))
- WP = Wedge Anchor Plastic (see SMD(TWT))
- SA = Slipbase - Concreted (see SMD(SLIP-1) to (SLIP-3))
- SB = Slipbase - Bolted Down (see SMD(SLIP-1) to (SLIP-3))

Sign Mounting Designation

- P = Prefab. "Plain" (see SMD(SLIP-1) to (SLIP-3), (TWT), (FRP))
- T = Prefab. "T" (see SMD(SLIP-1) to (SLIP-3), (TWT))
- U = Prefab. "U" (see SMD(SLIP-1) to (SLIP-3))
- IF REQUIRED
- 1EXT or 2EXT = Number of Extensions (see SMD(SLIP-1) to (SLIP-3), (TWT))
- BM = Extruded Wind Beam (see SMD(SLIP-1) to (SLIP-3))
- WC = 1.12 #/ft Wing Channel (see SMD(SLIP-1) to (SLIP-3))
- EXAL = Extruded Aluminum Sign Panels (see SMD(SLIP-3))


REQUIRED CLEARANCE FOR BREAKAWAY SUPPORT

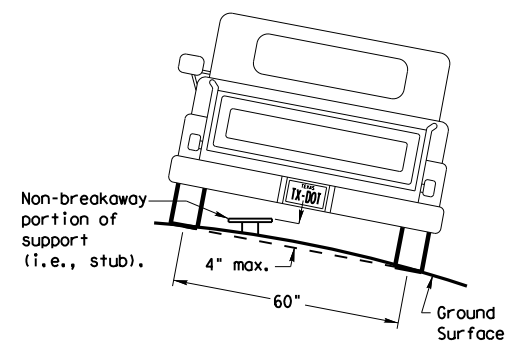

To avoid vehicle undercarriage snagging, any substantial remains of a breakaway support, when it is broken away, should not project more than 4 inches above a 60-inch chord (i.e., typical space between wheel paths).


SIGN LOCATION

PAVED SHOULDERS

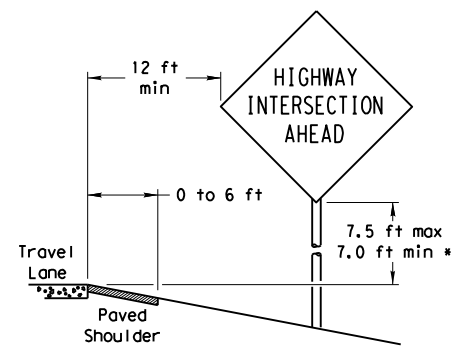

LESS THAN 6 FT. WIDE


When the shoulder is 6 ft. or less in width, the sign must be placed at least 12 ft. from the edge of the travel lane.

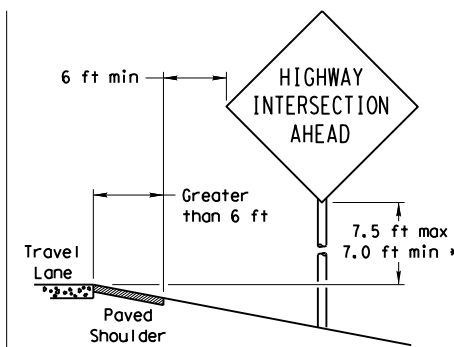

GREATER THAN 6 FT. WIDE


When the shoulder is greater than 6 ft in width, the sign must be placed at least 6 ft. from the edge of the shoulder.

T-INTERSECTION

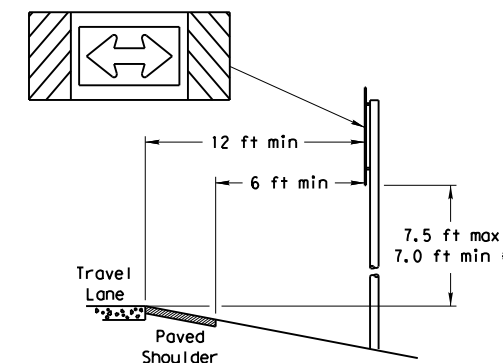


When this sign is needed at the end of a two-lane, two way roadway, the right edge of the sign should be in line with the centerline of the roadway. Place as close to ROW as practical.


No more than 2 sign posts should be located within a 7 ft. circle.

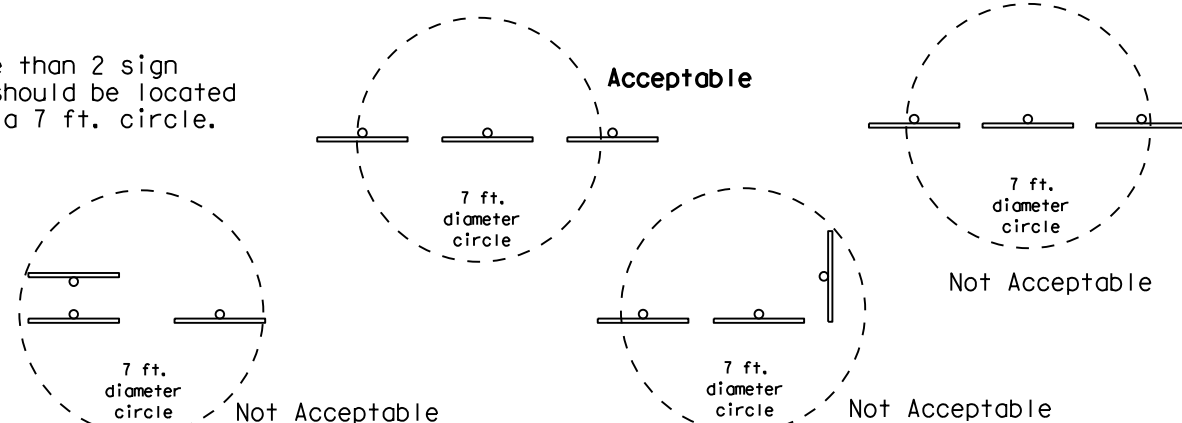

BEHIND BARRIER

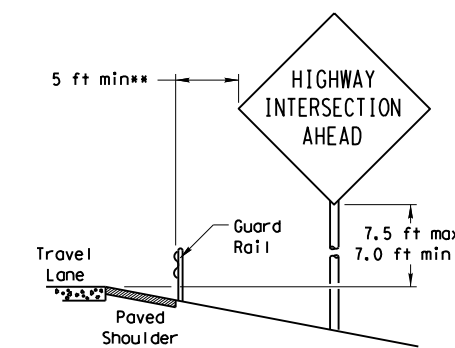


BEHIND GUARDRAIL

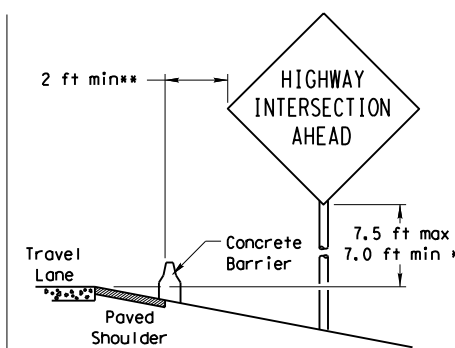

BEHIND CONCRETE BARRIER

**Sign clearance based on distance required for proper guard rail or concrete barrier performance.

TYPICAL SIGN ATTACHMENT DETAIL

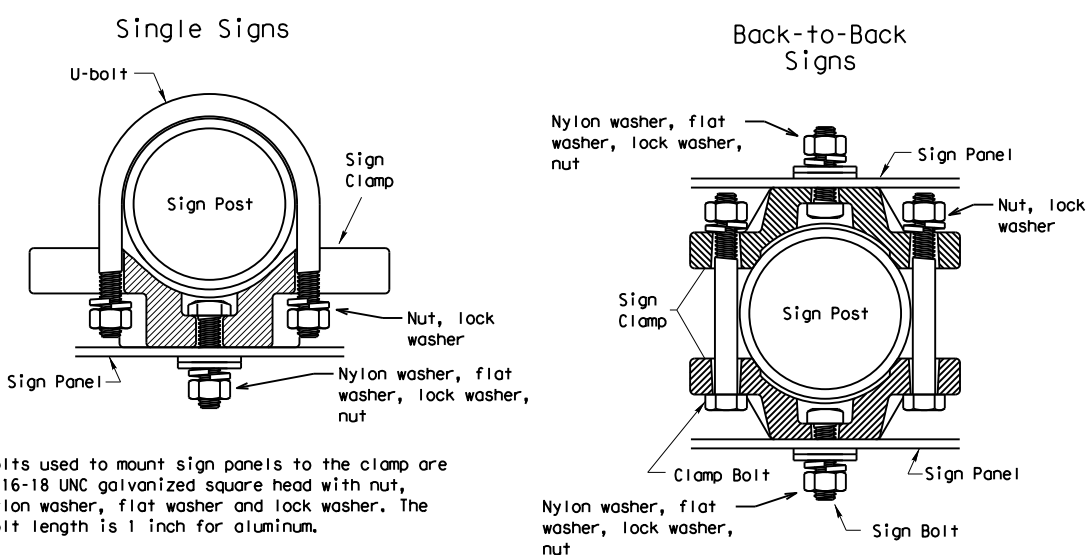


Bolts used to mount sign panels to the clamp are 5/16-18 UNC galvanized square head with nut, nylon washer, flat washer and lock washer. The bolt length is 1 inch for aluminum.

When two sign clamps are used to mount signs back-to-back, use a 5/16-18 UNC galvanized hex head per ASTM A307 with nut and helical-spring lock washer. The approximate bolt lengths for various post sizes and sign clamp types are given in the table at right. The bolt length may need to be adjusted depending upon field conditions.

Sign clamps may be either the specific size clamp or the universal clamp.


Pipe Diameter	Approximate Bolt Length	
	Specific Clamp	Universal Clamp
2" nominal	3"	3 or 3 1/2"
2 1/2" nominal	3 or 3 1/2"	3 1/2 or 4"
3" nominal	3 1/2 or 4"	4 1/2"

SIGNS WITH PLAQUES

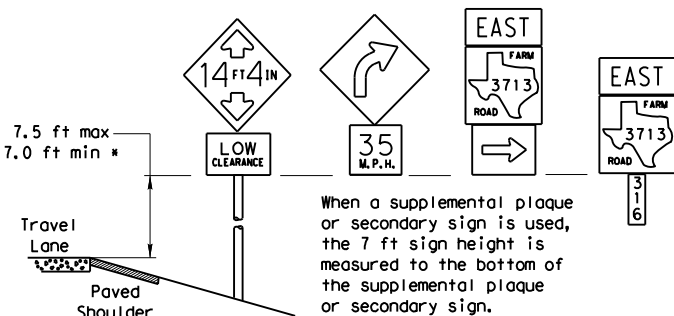


When a supplemental plaque or secondary sign is used, the 7 ft sign height is measured to the bottom of the supplemental plaque or secondary sign.

CURB & GUTTER OR RAISED ISLAND

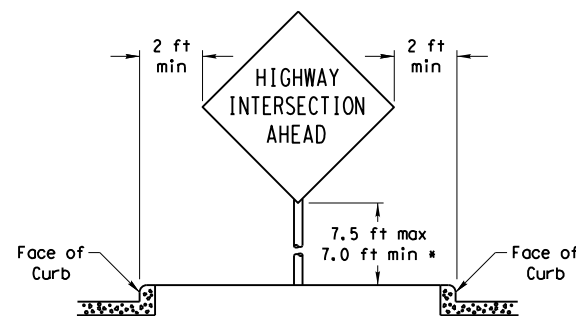

RESTRICTED RIGHT-OF-WAY (When 6 ft min. is not possible.)

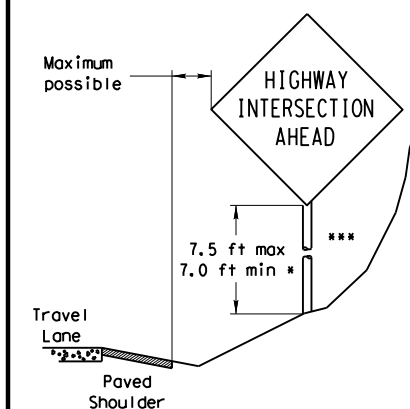

Right-of-way restrictions may be created by rocks, water, vegetation, forest, buildings, a narrow island, or other factors.

In situations where a lateral restriction prevents the minimum horizontal clearance from the edge of the travel lane, signs should be placed as far from the travel lane as practical.

*** Post may be shorter if protected by guardrail or if Engineer determines the post could not be hit due to extreme slope.

* Signs shall be mounted using the following condition that results in the greatest sign elevation:

- (1) a minimum of 7 to a maximum of 7.5 feet above the edge of the travel lane or
- (2) a minimum of 7 to a maximum of 7.5 feet above the grade at the base of the support when sign is installed on the backslope.

The maximum values may be increased when directed by the Engineer.

See the Traffic Operations Division website for detailed drawings of sign clamps, Triangular Slipbase System components and Wedge Anchor System components.

The website address is:
<http://www.txdot.gov/publications/traffic.htm>

Texas Department of Transportation
Traffic Operations Division

SIGN MOUNTING DETAILS SMALL ROADSIDE SIGNS GENERAL NOTES & DETAILS

SMD(GEN)-08

© TxDOT July 2002		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
9-08	REVISIONS	CONT	SECT	JOB	HIGHWAY
		0088	05	110, ETC	US 59, ETC
		DIST	COUNTY		SHEET NO.
		YKM	VICTORIA, ETC		46

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

GENERAL NOTES FOR ALL ELECTRICAL WORK

1. The location of all conduits, junction boxes, ground boxes, and electrical services is diagrammatic and may be shifted to accommodate field conditions.
2. Provide new and unused materials. Ensure that all materials and installations comply with the applicable articles of the National Electrical Code (NEC), TxDOT standards and specifications, National Electrical Manufacturers Association (NEMA), and are listed by Underwriters Laboratories (UL) or a Nationally Recognized Testing Lab (NRTL). NRTLs such as Canadian Standard Association (CSA), Intertek Testing Services NA Inc., or FM Approvals LLC can be considered equivalent to UL. Where reference is made to NEMA listed devices, International Electrotechnical Commission (IEC) listed devices will not be considered an acceptable equal to a NEMA listed device. Acceptable devices may have both a NEMA and IEC listing. Faulty fabrication or poor workmanship in any material, equipment, or installation is justification for rejection. Replace or reinstall rejected material or equipment at no additional cost to the Department.
3. Miscellaneous nuts, bolts and hardware, except for high strength bolts, may be stainless steel when plans specify galvanized, provided the bolt size is 1/2 in. or less in diameter.
4. Provide the following test equipment as required by the Engineer to confirm compliance with the contract and the NEC: voltmeter, ammeter, megohm meter (1000 volt DC), ground resistance tester, torque wrenches, and torque screwdrivers. Ensure all equipment has been properly calibrated within the last year. Provide calibration certification to the Engineer upon request. Operate test equipment during inspection as requested by the Engineer.
5. Install grounding as shown on the plans and in accordance with the NEC. Ensure all metallic conduits; metal poles; luminaires; and metal enclosures are bonded to the equipment grounding conductor. Provide stranded bare copper or green insulated grounding conductors. Ground rods, connectors, and bonding jumpers are subsidiary to the various bid items.
6. When required by the Engineer, notify the Department in writing of materials from the Material Producers List (MPL) intended for use on each project. Prequalified materials are listed on the MPL on TxDOT's website under "Roadway Illumination and Electrical Supplies." No substitutions will be allowed for materials on this list.

CONDUIT

A. MATERIALS

1. Provide conduit, junction boxes, fittings, and hardware as per TxDOT Departmental Material Specification (DMS) 11030 "Conduit" and Item 618 "Conduit" of TxDOT's "Standard Specifications For Construction And Maintenance Of Highways, Streets, And Bridges," latest edition. Provide conduits listed under Item 618 on the MPL under "Roadway Illumination and Electrical Supplies." Provide conduit types according to the descriptive code or as shown on the plans. Do not substitute other types of conduits for those shown. Provide liquidtight flexible metal conduit (LFMC) when flexible conduit is called for on galvanized steel rigid metallic conduit (RMC) systems. Provide liquidtight flexible nonmetallic conduit (LFNC) when flexible conduit is called for on polyvinyl chloride (PVC) systems.
2. Provide galvanized steel RMC for all exposed conduits, unless otherwise shown on the plans. Properly bond all metal conduits.
3. Unless otherwise shown on the plans, provide junction boxes with a minimum size as shown in the following table, which applies to the greatest number of conductors entering the box through one conduit with no more than four conduits per box. When a mixture of conductor sizes is present, count the conductors as if all are of the larger size. For situations not applicable to the table, size junction boxes in accordance with NEC.



AWG	3 CONDUCTORS	5 CONDUCTORS	7 CONDUCTORS
#1	10" x 10" x 4"	12" x 12" x 4"	16" x 16" x 4"
#2	8" x 8" x 4"	10" x 10" x 4"	12" x 12" x 4"
#4	8" x 8" x 4"	10" x 10" x 4"	10" x 10" x 4"
#6	8" x 8" x 4"	8" x 8" x 4"	10" x 10" x 4"
#8	8" x 8" x 4"	8" x 8" x 4"	8" x 8" x 4"

4. Junction boxes with an internal volume of less than 100 cu. in. and supported by entering raceways must have threaded entries or hubs identified for the intended purpose and supported by connection of two or more rigid metal conduits. Secure conduit within 3 ft. of the enclosure or within 18 in. of the enclosure if all conduit entries are on the same side. Mechanically secure all junction boxes with an internal volume greater than 100 cu. inches.
5. Provide hot dipped galvanized cast iron or sand cast aluminum outlet boxes for junction boxes containing only 10 AWG or 12 AWG conductors. Do not use die cast aluminum boxes. Size outlet boxes according to the NEC.
6. Do not use intermediate metal conduit (IMC) or electrical metallic tubing (EMT) unless specifically required by the plan sheets. When EMT is called for, provide junction boxes made from galvanized steel sheeting, listed and approved for outdoor use, unless otherwise noted on the plans. Size all galvanized steel junction boxes in accordance with the NEC. Provide junction boxes for IMC conduit systems that meet the same requirements for junction boxes used with RMC systems.
7. Provide PVC junction boxes intended for outdoor use on PVC conduit systems, unless otherwise noted on the plans.

8. Provide PVC elbows in PVC conduit systems, unless otherwise shown on the plans. Use only a flat, high tensile strength polyester fiber pull tape for pulling conductors through the PVC conduit system. When galvanized steel RMC elbows are specifically called for in the plans and any portion of the RMC elbow is buried less than 18 in., ground the RMC elbow by means of a grounding bushing on a rigid metal extension. Grounding of the rigid metal elbow is not required if the entire RMC elbow is encased in a minimum of 2 in. of concrete. PVC extensions are allowed on these concrete encased rigid metal elbows. RMC or PVC elbows are subsidiary to various bid items.
9. When required, provide High-Density Polyethylene (HDPE) conduit with factory installed internal conductors according to Item 622 "Duct Cable." At the Contractor's request and with approval by the Engineer, substitute HDPE conduit with no conductors for bored schedule 40 or schedule 80 PVC conduit bid under Item 618. Ensure bored HDPE substituted for PVC is schedule 40 and of the same size PVC called for in the plans. Ensure the substituted HDPE meets the requirements of Item 622, except that the conduit is supplied without factory-installed conductors. Make the transition of the HDPE conduit to PVC (or RMC elbow when required) at the bore pit. Provide conduit of the size and schedule as shown on the plans. Do not extend substituted conduit into ground boxes or foundations. Provide PVC or galvanized steel RMC elbows as called for at all ground boxes and foundations.
10. Use two-hole straps when supporting 2 in. and larger conduits. On electrical service poles, properly sized stainless steel or hot dipped galvanized one-hole standoff straps are allowed on the service riser conduit.

B. CONSTRUCTION METHODS

1. Provide and install expansion joint conduit fittings on all structure-mounted conduits at the structure's expansion joints to allow for movement of the conduit. In addition, provide and install expansion joint fittings on all continuous runs of galvanized steel RMC conduit externally exposed on structures such as bridges at maximum intervals of 150 ft. When requested by the project Engineer, supply manufacturer's specification sheet for expansion joint conduit fittings. Repair or replace expansion joint fittings that do not allow for movement at no additional cost to the Department. Provide the method of determining the amount of expansion to the Engineer upon request. Do not use LFMC or LFNC as a substitute for the required expansion conduit fittings.
2. Space all conduit supports at maximum intervals of 5 ft. Install conduit spacers when attaching metal conduit to surface of concrete structures. See "Conduit Mounting Options" on ED(2). Install conduit support within 3 ft. of all enclosures and conduit terminations.
3. Do not attach conduit supports directly to pre-stressed concrete beams except as shown specifically in the plans or as approved by the Engineer.
4. Unless otherwise shown on the plans, jack or bore conduit placed beneath existing roadways, driveways, sidewalks, or after the base or surfacing operation has begun. Backfill and compact the bore pits below the conduit per Item 476 "Jacking, Boring, or Tunneling Pipe or Box" prior to installing conduit or duct cable to prevent bending of the connections.
5. When placing conduit in the sub-grade of new roadways, backfill all trenches with excavated material unless otherwise noted on the plans. When placing conduit in the sub-base of new roadways, backfill all trenches with cement-stabilized base as per requirements of Items 110 "Excavation", 400 "Excavation and Backfill for Structures", 401 "Flowable Backfill", 402 "Trench Excavation Protection", and 403 "Temporary Special Shoring."
6. Provide and place warning tape approximately 10 in. above all trenched conduit as per Item 618.
7. During construction, temporarily cap or plug open ends of all conduit and raceways immediately after installation to prevent entry of dirt, debris and animals. Temporary caps constructed of durable duct tape are allowed. Tightly fix the tape to the conduit opening. Clean out the conduit and prove it clear in accordance with Item 618 prior to installing any conductors.
8. Ensure conduit entry into the top of any enclosure is waterproof by installing conduit sealing hubs or using boxes with threaded bosses. This includes surface mounted safety switches, meter cans, service enclosures, auxiliary enclosures and junction boxes. Grounding bushings on water tight sealing hubs are not required.
9. Fit the ends of all PVC conduit terminations with bushings or bell end fittings. Provide and install a grounding type bushing on all metal conduit terminations.
10. Install a bonding jumper from each grounding bushing to the nearest ground rod, grounding lug, or equipment grounding conductor. Ensure all bonding jumpers are the same size as the equipment grounding conductor. Bonding of conduit used as a casing under roadways for duct cable is not required, if the duct extends the full length through the casing.
11. At all electrical services, install a 6 AWG solid copper grounding electrode conductor.
12. Place conduits entering ground boxes so that the conduit openings are between 3 in. and 6 in. from the bottom of the box. See the ground box detail on sheet ED(4).
13. Seal ends of all conduits with duct seal, expandable foam, or by other methods approved by the Engineer. Seal conduit immediately after completion of conductor installation and pull tests. Do not use duct tape as a permanent conduit sealant. Do not use silicone caulk as a conduit sealant.
14. File smooth the cut ends of all mounting strut and conduit. Before installing, paint the field cut ends of all mounting strut and RMC (threaded or non-threaded) with zinc rich paint (94% or more zinc content) to alleviate overspray. Use zinc rich paint to touch up galvanized material as allowed under Item 445 "Galvanizing." Do not paint non-galvanized material with a zinc rich paint as an alternative for materials required to be galvanized.

			
<p>ELECTRICAL DETAILS CONDUITS & NOTES</p> <p>ED(1) - 14</p>			
FILE:	ed1-14.dgn	DW:	CK:
© TxDOT	October 2014	CONT	SECT
REVISIONS		0088 05	110, ETC
		DIST	COUNTY
		YKM	VICTORIA, ETC
		US	59, ETC
		SHEET NO.	47

ELECTRICAL CONDUCTORS

A. MATERIAL INFORMATION

1. Provide Type XHHW insulated conductors in accordance with Departmental Material Specification (DMS) 11040 "Conductors" and Item 620 "Electrical Conductors." Provide conductors as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies" Item 620. Color code insulated conductors in conformance with the NEC. Identify grounded (neutral) conductors with white insulation. Identify grounding conductors (ground wires) with green insulation or bare conductors. Identify ungrounded (hot) conductors with any color insulation except green, white, or gray. Keep color scheme consistent throughout the wiring system. Identify conductors 6 American Wire Gauge (AWG) and smaller by continuous color jacket. Identify electrical conductors 4 AWG and larger by continuous color jacket or by colored tape. When identifying conductors with colored tape, mark at least 6 in. of the conductor's insulation with half laps of tape.
2. Provide a solid copper 6 AWG grounding electrode conductor to bond the electrical service equipment to the concrete encased grounding electrode or the ground rod at the service location. Connect the grounding electrode conductor to the ground rod with a UL listed connector in accordance with DMS 11040. Connect the grounding electrode conductor to the concrete encased grounding electrode as shown in the plans.
3. Where two or more circuits are present in one conduit or enclosure, permanently identify the conductors of each branch circuit by attaching a non-metallic tag around both circuit conductors at each accessible location. Provide tags with two straps, large enough to indicate circuit number, letter, or other identification as shown in the plans. Print circuit identification on the tag with a permanent marker.
4. Use listed compression or screw type pressure connectors, terminal blocks, or split bolt connectors for splicing as specified in DMS 11040. Use hot melt adhesive tape to fill the gap and seal the ends of heat shrink tubing. Provide UL listed gel-filled insulating splice covers. Splicing materials, insulating materials, breakaway disconnects, splice covers, and fuse holders are subsidiary to various bid items.


B. CONSTRUCTION METHODS

1. Use only a flat, high tensile strength polyester fiber pull tape for pulling conductors through the conduit system. After installing conductors in conduit, perform conductor pull test. If a conductor cannot be freely pulled, make any needed alterations or repairs at no additional cost to the department. Perform insulation resistance tests in accordance with Item 620. Coordinate with the Engineer to witness the tests.
2. Leave 2 ft. minimum, 3 ft. maximum length for each conductor up to the splice in ground boxes. Leave 3 ft. minimum, 4 ft. maximum length of conductor in ground boxes when pulled through with no splice. Leave 1 ft. minimum, 1.5 ft. maximum length of conductor at enclosures, weatherheads and pole bases.
3. Make splices only in junction boxes, ground boxes, pole bases, or electrical enclosures and use only listed compression or screw type pressure connectors, terminal blocks, or split bolt connectors. Insulate splices with heavy wall heat shrink tubing or gel-filled insulating splice covers to provide a watertight seal. Overlap conductor insulation with heat shrink tubing a minimum of 2 in. past both sides of the splice. Where heat shrink tubing may not shrink sufficiently to provide a watertight seal around the individual conductors, prior to heating the tubing, increase the diameter of the conductor insulation using hot melt adhesive tape to provide a watertight seal between the individual conductors and the heat shrink tubing. Ensure the tape extends past the heat shrink tubing. Use hot melt adhesive tape to fill the gap and seal the ends of heat shrink tubing. Heat shrink tubing that appears to have been burned, or overheated, is considered defective and must be replaced.
4. Size and install gel-filled insulating splice covers according to manufacturer's specifications when used in place of heat shrink tubing.
5. Wire nuts with factory applied waterproof sealant may be used for 8 AWG or smaller conductors in above ground junction boxes, but not in pole bases or ground boxes. Install wire nuts in an upright position to prevent the accumulation of water.
6. Support conductors in illumination poles with a J-hook at the top of the pole.
7. When terminating conductors, remove the insulation and jacketing material without nicking the individual strands of the conductor. Conductors with nicked individual conductor strands or removed strands will be considered damaged.
8. Replace conductors and cables that are damaged beyond repair or that fail an insulation resistance test at no additional cost to the department.
9. Do not repair damaged conductors with duct tape, electrical tape, or wire nuts. Use only approved splicing methods.
10. Do not terminate more than one conductor under a single connector, unless the connector is rated for multiple conductors. Do not exceed the pressure connector's listing for maximum number and size of conductors allowed.
11. Install breakaway connectors on conductors bid under Item 620 whenever those conductors pass through a breakaway support device. Follow manufacturer's instructions when terminating conductors to breakaway connectors. Properly torque threaded connections. Proper terminations are critical to the safe operation of breakaway devices. Trim waterproofing boots on breakaway connectors to fit snugly around the conductor to ensure waterproof connection. Only one conductor may enter a single opening in a boot. Provide waterproof boots with the correct number of openings. Leave unused openings factory sealed. Use prequalified breakaway connectors as shown on the MPL.

12. Provide and install a separate stranded equipment grounding conductor (EGC) in all conduits that contain circuit wiring of 50 volts or more. Unless shown elsewhere, size the EGC to be the same size as the largest current carrying conductor contained in the conduit. Ensure all EGCs are bonded together at every accessible location. For traffic signal installations, provide a minimum size 8 AWG EGC. The EGC is paid for under Item 620.

C. TEMPORARY WIRING

1. Install temporary conductors and electrical equipment in accordance with the NEC article "Temporary Installations" and Department standard sheets.
2. Provide a ground fault circuit interrupter (GFCI) for power outlets for portable electrical equipment, power tools, ice machines, ice storage bins and refrigerators located outdoors at grade. GFCI may be any one of the following: molded cord and plug set, receptacle, or circuit breaker type.
3. Use listed wire nuts with factory applied sealant for temporary wiring where approved.
4. Enclose conductor splices within a listed enclosure or ground box, or ensure the splices are more than 10 ft. above grade vertically and more than 5 ft. horizontally from any metal structure. Where installing temporary conductors in areas subject to vehicle traffic or mobile construction equipment, ensure the vertical clearance to ground is at least 18 ft. when measured at the lowest point. Ground messenger wires that support power conductors in conformance with the NEC.
5. Protect and when necessary repair any existing electrical conduits uncovered during the construction process in a timely manner and in conformance with the NEC.

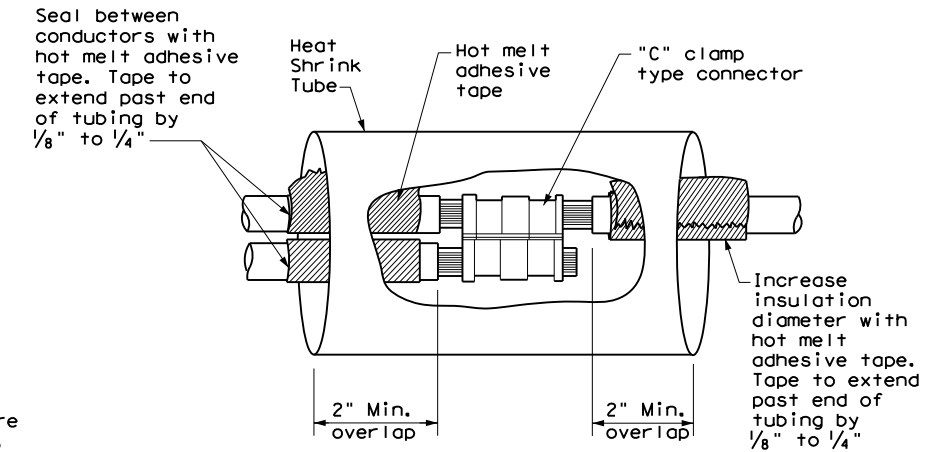

**SPLICE OPTION 1
Compression Type**


GROUND RODS & GROUNDING ELECTRODES

A. MATERIAL INFORMATION


1. Provide and install a grounding electrode at electrical services. Provide ground rods according to DMS 11040 and the plans. Larger diameter or longer length rods may be called for in some specific locations, see the individual plans sheets. Concrete encased grounding electrodes may be called for in specific locations including electrical service, see individual plan sheets.

B. CONSTRUCTION METHODS

1. Furnish auxiliary ground rods for lightning protection and install in soil, concrete, or both, as called for in the plans. For ground rods installed in concrete, ensure the connection of the conductor to the ground rod is readily accessible for inspection or repairs. For ground rods installed in soil, ensure that the upper end is between 2 to 4 in. below finished grade.
2. Do not place ground rods in the same drilled hole as a timber pole.
3. Install ground rods so the imprinted part number is at the upper end of the rod.
4. Remove all non-conductive coatings such as concrete splatter from the rod at the clamp location.
5. Route all conductors as short and straight as possible for connection to lightning protection ground rods. When a bend is required, ensure a minimum radius bend of four inches for these conductors.
6. Unless otherwise called for in the plans, protect grounding electrode conductors with non-metallic conduit. When protecting grounding electrode conductors with metal conduit, provide and install a grounding type bushing and properly sized bonding jumper on each end of the metal conduit.
7. Written authorization is required before installing a ground rod in a horizontal trench for rocky soil or a solid rock bottom.

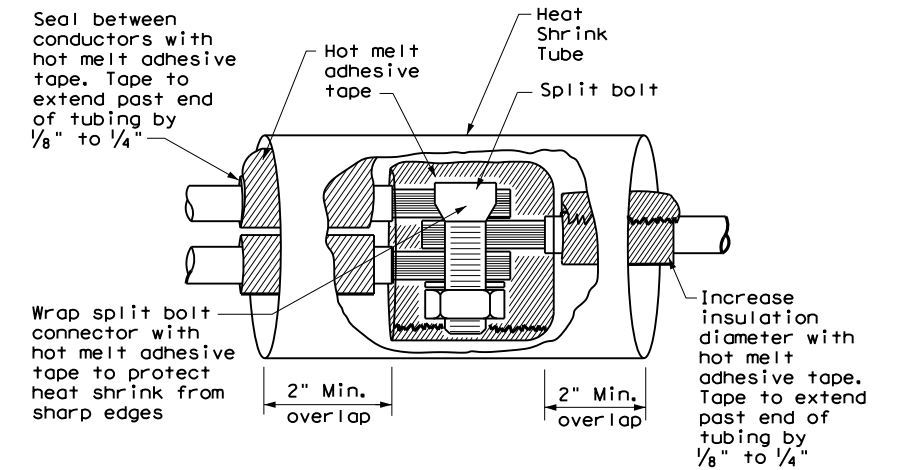

**SPLICE OPTION 2
Split Bolt Type**

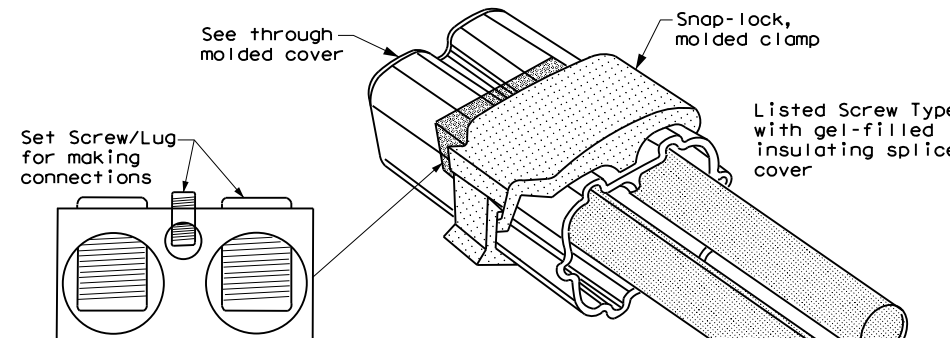


**SPLICE OPTION 3
Listed Screw Type**

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

		Texas Department of Transportation		Traffic Operations Division Standard	
<h1>ELECTRICAL DETAILS CONDUCTORS</h1>					
<h2>ED(3) - 14</h2>					
FILE:	ed3-14.dgn	DN:	TxDOT	CK:	TxDOT
© TxDOT	October 2014	CONT:	SECT:	JOB:	HIGHWAY
REVISIONS		0088	05	110, ETC	US 59, ETC
DIST:	YKM	COUNTY:	VICTORIA, ETC	SHEET NO. 48	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

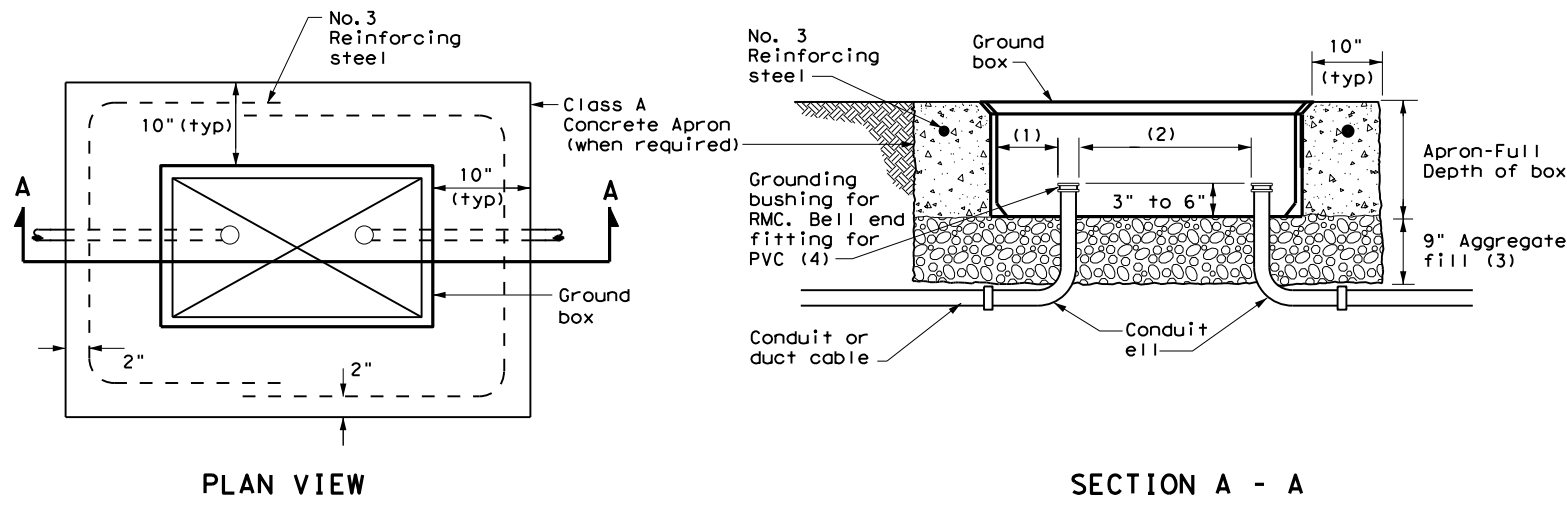

APRON FOR GROUND BOX


- (1) Uniformly space ends of conduits within the ground box. Position ends of conduits so that ground box walls do not interfere with the installation of grounding bushings or bell end fittings.
- (2) Maintain sufficient space between conduits to allow for proper installation of bushing.
- (3) Place aggregate under the box, not in the box. Aggregate should not encroach on the interior volume of the box.
- (4) Install a grounding bushing on the upper end of all RMC terminating in a ground box. Ground RMC elbows when any part of the elbow is less than 18 in. below the bottom of the ground box. Install a PVC bushing or bell end fitting on the upper end of all PVC conduits terminating in a ground box.

GROUND BOX DIMENSIONS

TYPE	OUTSIDE DIMENSIONS (INCHES) (Width x Length X Depth)
A	12 X 23 X 11
B	12 X 23 X 22
C	16 X 29 X 11
D	16 X 29 X 22
E	12 X 23 X 17

GROUND BOX COVER DIMENSIONS

TYPE	DIMENSIONS (INCHES)							
	H	I	J	K	L	M	N	P
A, B & E	23 1/4	23	13 3/4	13 1/2	9 7/8	5 1/8	1 3/8	2
C & D	30 1/2	30 1/4	17 1/2	17 1/4	13 1/4	6 3/4	1 3/8	2

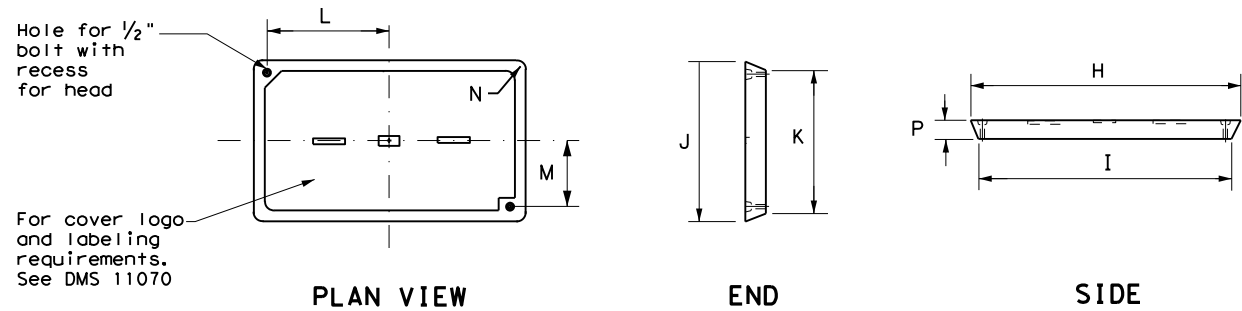

GROUND BOX COVER

GROUND BOXES

A. MATERIALS

1. Provide polymer concrete ground boxes measuring 16x30x24 in. (WxLxD) or smaller in accordance with Departmental Material Specification (DMS) 11070 "Ground Boxes" and Item 624 "Ground Boxes."
2. Provide Type A, B, C, D, and E ground boxes as shown in the plans, and as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies," Item 624.

3. Ensure ground box cover is correctly labeled in accordance with DMS 11070.

4. Provide larger ground boxes in accordance with Item 624 and as shown in the plans.

B. CONSTRUCTION METHODS

1. Remove all gravel and dirt from conduit. Cap all conduits prior to placing aggregate and setting ground box. Provide Grade 3 or 4 coarse aggregate as shown on Table 2 of Item 302 "Aggregates for Surface Treatments." Ensure aggregate bed is in place and at least 9 inches deep, prior to setting the ground box. Install ground box on top of aggregate.
2. Cast ground box aprons in place. Reinforcing steel may be field bent. Ensure the depth of concrete for the apron extends from finished grade to the top of the aggregate bed under the box. Ground box aprons, including concrete and reinforcing steel, are subsidiary to ground boxes when called for by descriptive code.
3. Keep bolt holes in the box clear of dirt. Bolt covers down when not working in ground boxes.
4. Install all conduits and ells in a neat and workmanlike manner. Uniformly space conduits so grounding bushings and bell end fittings can easily be installed.
5. Temporarily seal all conduits in the ground box until conductors are installed.
6. Permanently seal conduits immediately after the completion of conductor installation and pull tests. Permanently seal the ends of all conduits with duct seal, expandable foam, or other method as approved. Do not use duct tape as a permanent conduit sealant. Do not use silicone caulk as a sealant.
7. When a ground rod is present in a ground box, bond all equipment grounding conductors together and to the ground rod with listed connectors.
8. When a type B or D ground box is stacked to meet volume requirements, it is allowable to cut an appropriately sized hole for conduit entry in the side wall at least 18 inches below grade.
9. If an existing ground box in the contract has a metal cover, bond the cover to the equipment grounding conductor with a 3 ft. long stranded bonding jumper the same size as the grounding conductor. The bonding jumper is subsidiary to various bid items. Verify existing ground boxes with metal covers are shown on the plans, with notes fully describing the work required.
10. If other ground boxes with metal covers are within the project limits but are not part of the contract, the Engineer may direct the Contractor to bond the metal covers, identifying the specific boxes in writing. This work will be paid for separately.
11. Bond metal ground box covers to the grounding conductor with a tank ground type lug.

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

				Traffic Operations Division Standard	
<h1>ELECTRICAL DETAILS</h1> <h2>GROUND BOXES</h2> <h3>ED(4) - 14</h3>					
FILE:	ed4-14.dgn	DN:	TxDOT	CK:	TxDOT
© TxDOT	October 2014	CONT:	SECT:	JOB:	HIGHWAY:
REVISIONS		0088	05	110, ETC	US 59, ETC
DIST:	YKM	COUNTY:	VICTORIA, ETC	SHEET NO.:	49

ELECTRICAL SERVICES NOTES

- Provide new materials. Ensure installation and materials comply with the applicable provisions of the National Electrical Code (NEC) and National Electrical Manufacturers Association (NEMA) standards. Ensure material is Underwriters Laboratories (UL) listed. Provide and install electrical service conduits, conductors, disconnects, contactors, circuit breaker panels, and branch circuit breakers as shown on the Electrical Service Data chart in the plans. Faulty fabrication or poor workmanship in material, equipment, or installation is justification for rejection. Where manufacturers provide warranties and guarantees as a customary trade practice, furnish these to the State.
- Provide electrical services in accordance with Electrical Details standard sheets, Departmental Material Specification (DMS) 11080 "Electrical Services," DMS 11081 "Electrical Services-Type A," DMS 11082 "Electrical Services-Type C," DMS 11083 "Electrical Services-Type D," DMS 11084 "Electrical Services-Type T," DMS 11085 "Electrical Services-Pedestal (PS)", and Item 628 "Electrical Services" of the Standard Specifications. Provide electrical service types A, C, and D, as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies," Item 628. Provide other service types as detailed on the plans.
- Provide all work, materials, services, and any incidentals needed to install a complete electrical service as specified in the plans.
- Coordinate with the Engineer and the utility provider for metering and compliance with utility requirements. Primary line extensions, connection charges, meter charges, and other charges by the utility company to provide power to the location are paid for in accordance with Item 628. Get approval for the costs associated with these charges prior to engaging the utility company to do the work. Consult with the utility provider to determine costs and requirements, and coordinate the work as approved.
- The enclosure manufacturer will provide Master Lock Type 2 with brass tumblers keyed #2195 for all custom electrical enclosures. Installing Contractor is to provide Master Lock #2195 Type 2 with brass tumblers for "off the shelf" enclosures. Master Lock #2195 keys and locks become property of the State. Unless otherwise approved, do not energize electrical service equipment until locks are installed.
- Enclosures with external disconnects that de-energize all equipment inside the enclosure do not need a dead front trim. Protect incoming line terminations from incidental contact as required by the NEC.
- When galvanized is specified for nuts, screws, bolts or miscellaneous hardware, stainless steel may be used.
- Provide wiring and electrical components rated for 75°C. Provide red, black, and white colored XHHW service entrance conductors of minimum size 6 American Wire Gauge (AWG). Identify size 6 AWG conductors by continuous color jacket. Identify electrical conductors sized 4 AWG and larger by continuous color jacket or by colored tape. Mark at least 6 inches of the conductor's insulation with half laps of colored tape, when identifying conductors. Ensure each service entrance conductor exits through a separately bushed non-metallic opening in the weatherhead. The lengths of the conductors outside the weatherhead are to be 12 inches minimum, 18 inches maximum, or as required by utility.
- All electrical service conduit and conductors attached to the electrical service including the riser or the elbow below ground are subsidiary to the electrical service. For an underground utility feed, all service conduit and conductors after the elbow, including service conduit and conductors for the utility pole riser when furnished by the Contractor, will be paid for separately.
- Provide rigid metal conduit (RMC) for all conduits on service, except for the 1/2 in. PVC conduit containing the electrical service grounding electrode conductor. Size the service entrance conduit as shown in the plans. Ensure conduit for branch circuit entry to enclosure is the same size as that shown on the layout sheets for branch circuit conduit. Extend all rigid metal conduits a minimum of 6 inches underground and then couple to the type and schedule of the conduit shown on the layout for that particular branch circuit. Install a grounding bushing on the RMC where it terminates in the service enclosure.
- Use of liquidtight flexible metal conduit (LFMC) is allowed between the meter and service enclosure when they are mounted 90 to 180 degrees to each other. Size the LFMC the same size as service entrance conduit. LFMC must not exceed 3 feet in length. Strap LFMC within 1 foot of each end. LFMC less than 12 inches in length need not be strapped. Each end of LFMC must have a grounding bushing or be terminated with a grounding fitting. The LFMC must contain a grounded (neutral) conductor. Ensure any bend in LFMC never exceeds 180 degrees. A pull test is required on all installed conductors, with at least six inches of free conductor movement demonstrated to the satisfaction of the Engineer.
- Ensure all mounting hardware and installation details of services conform to utility company specifications.
- For all electrical service enclosures listed under Item 628 on the MPL, the UL 508 enclosure manufacturers will prepare and submit a schematic drawing unique to each service. Before shipment to the job site, place the applicable laminated schematic drawings and the laminated plan sheet showing the electrical service data chart used to build the enclosure in the enclosure's data pocket. The installing contractor will copy and laminate the actual project plan sheets detailing all equipment and branch circuits supplied by that service. The laminated plan sheets are to be placed in the service enclosure's document pocket. Reduce 11 in. x 17 in. plan sheets to 8 1/2 in. x 11 in. before laminating. If the installation differs from the plan sheets, the installing contractor is to redline plan sheets before laminating.
- When providing an "Off The Shelf" Type D or Type T service, provide laminated plan sheets detailing equipment and branch circuits supplied by that service. Reduce 11 in. x 17 in. plan sheets to 8 1/2 in. x 11 in. before laminating. Deliver these drawings before completion of the work to the Engineer, instead of placing in enclosure that has no door pocket.
- Do not install conduit in the back wall of a service enclosure where it would penetrate the equipment mounting panel inside the enclosure. Provide grounding bushings on all metal conduits, and terminate bonding jumpers to grounding bus. Grounding bushings are not required when the end of the metal conduit is fitted with a conduit sealing hub or threaded boss, such as a meter base hub.

SERVICE ASSEMBLY ENCLOSURE

- Provide threaded hub for all conduit entries into the top of enclosure.
- Type galvanized steel (GS) enclosures may be used for Type C panelboards and for Type D and T services that do not use an enclosure mounted photoceII or lighting contactor. Provide GS enclosures in accordance with DMS 11080, 11082, 11083, and 11084.
- Provide aluminum (AL) and stainless steel (SS) enclosures for Types A, C, and D in accordance with DMS 11080, 11081, 11082, 11083, and 11084. Do not paint stainless steel.
- Provide pedestal service (PS) enclosures in accordance with ED(9) and DMS 11080 and 11085. Do not provide GS pedestal services. If GS is shown in the PS descriptive code, provide an AL enclosure.

MAIN DISCONNECT & BRANCH CIRCUIT BREAKERS

- Field drill flange-mounted remote operator handle if needed, to ensure handle is lockable in both the "On" and "Off" positions.
- When the utility company provides a transformer larger than 50 KVA, verify that the available fault current is less than the circuit breaker's ampere interrupting capacity (AIC) rating and provide documentation from the electric utility provider to the Engineer.



PHOTOELECTRIC CONTROL

- Provide photocell as listed on the MPL. Move, adjust, or shield the photocell from stray or ambient night time light to ensure proper operation. Mount photocell facing north when practical. Mount top of pole photocells as shown on Top Mounted Photocell Detail.

* ELECTRICAL SERVICE DATA												
Elec. Service ID	Plan Sheet Number	Electrical Service Description	Service Conduit *xSize	Service Conductors No./Size	Safety Switch Amps	Main Ckt. Bkr. Pole/Amps	Two-Pole Contractor Amps	Panelbd/ Loadcenter Amp Rating	Branch Circuit ID	Branch Ckt. Bkr. Pole/Amps	Branch Circuit Amps	KVA Load
SB 183	289	ELC SRV TY A 240/480 100(SS)AL(E)SF(U)	2"	3/#2	100	2P/100	100	N/A	Lighting NB	2P/40	26	28.1
									Lighting SB	2P/40	25	
									Underpass	1P/20	15	
NB Access	30	ELC SRV TY D 120/240 060(NS)SS(E)TS(O)	1 1/4"	3/#6	N/A	2P/60		100	Sig. Controller	1P/30	23	5.3
							30		Luminaires	2P/20	9	
									CCTV	1P/20	3	
2nd & Main	58	ELC SRV TY T 120/240 000(NS)GS(N)SP(O)	1 1/4"	3/#6	N/A	N/A	N/A	70	Flashing Beacon 1	1P/20	4	1.0
									Flashing Beacon 2	1P/20	4	

* Example only, not for construction. All new electrical services must have electrical service data chart specific to that service as shown in the plans.
 ** Verify service conduit size with utility. Size may change due to utility meter requirements. Ensure conduit size meets the National Electrical Code.

EXPLANATION OF ELECTRICAL SERVICE DESCRIPTIVE CODE

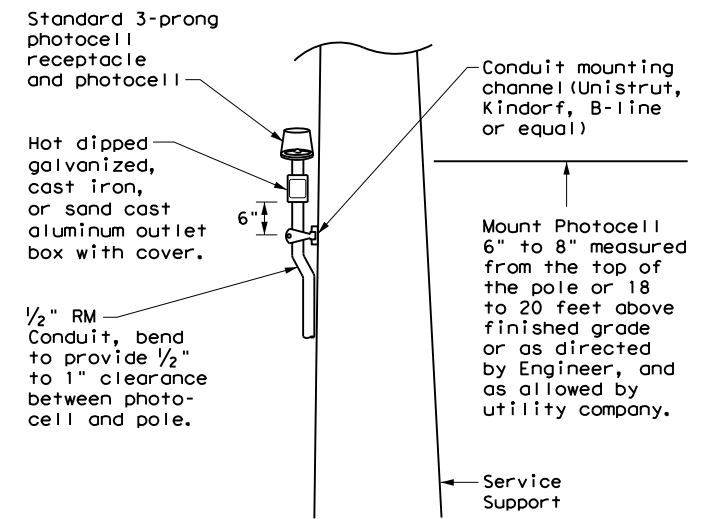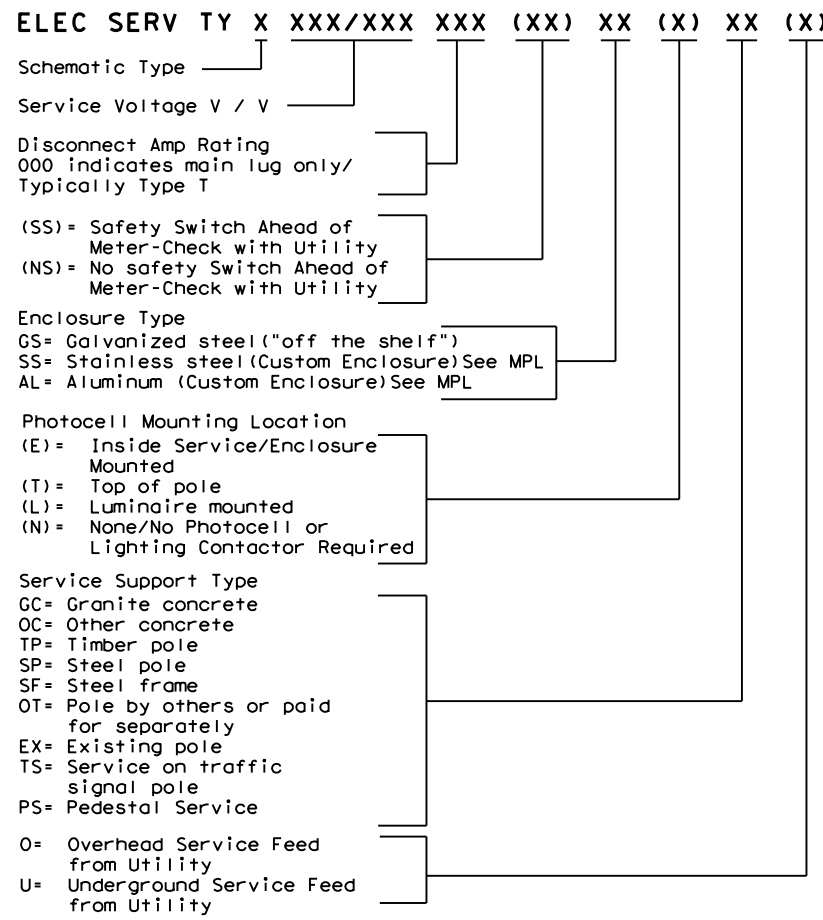

TOP MOUNTED PHOTOCELL

Install conduit strap maximum 3 feet from box. 5 foot maximum spacing between straps supporting conduit.

Texas Department of Transportation Traffic Operations Division Standard


ELECTRICAL DETAILS SERVICE NOTES & DATA

ED(5) - 14


FILE: ed5-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT October 2014	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
DIST	YKM	COUNTY	VICTORIA, ETC	SHEET NO. 50

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.
 DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

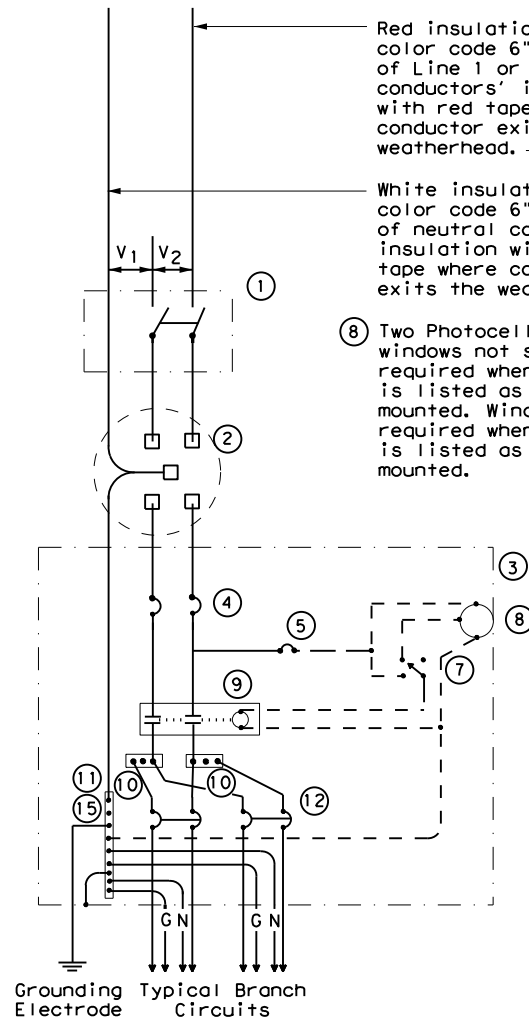


**SCHEMATIC TYPE A
THREE WIRE**

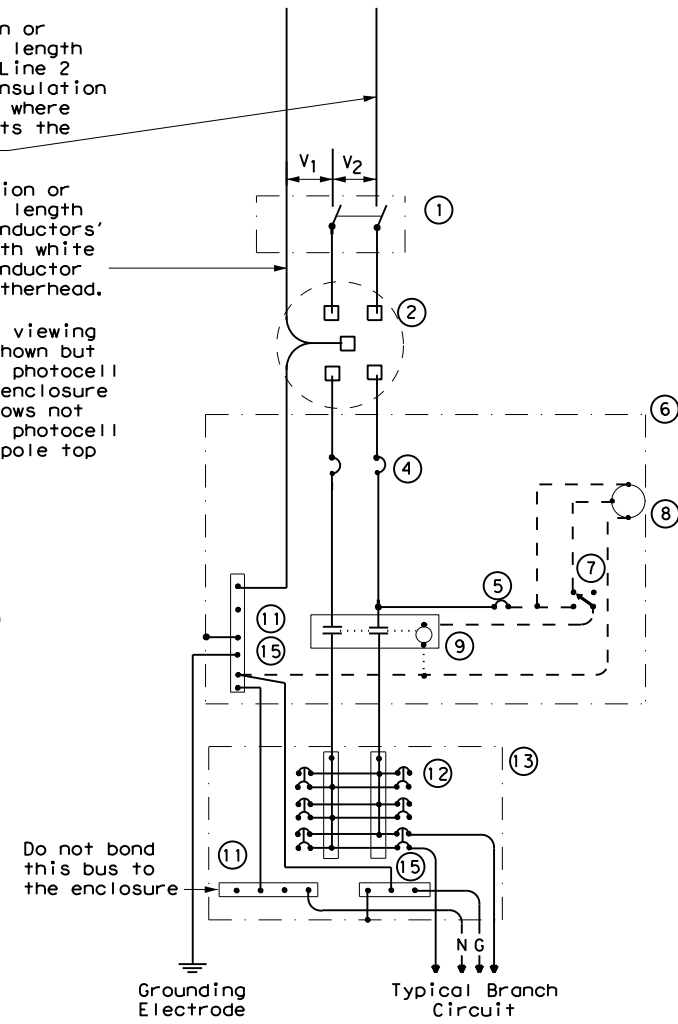

**SCHEMATIC TYPE C
THREE WIRE**

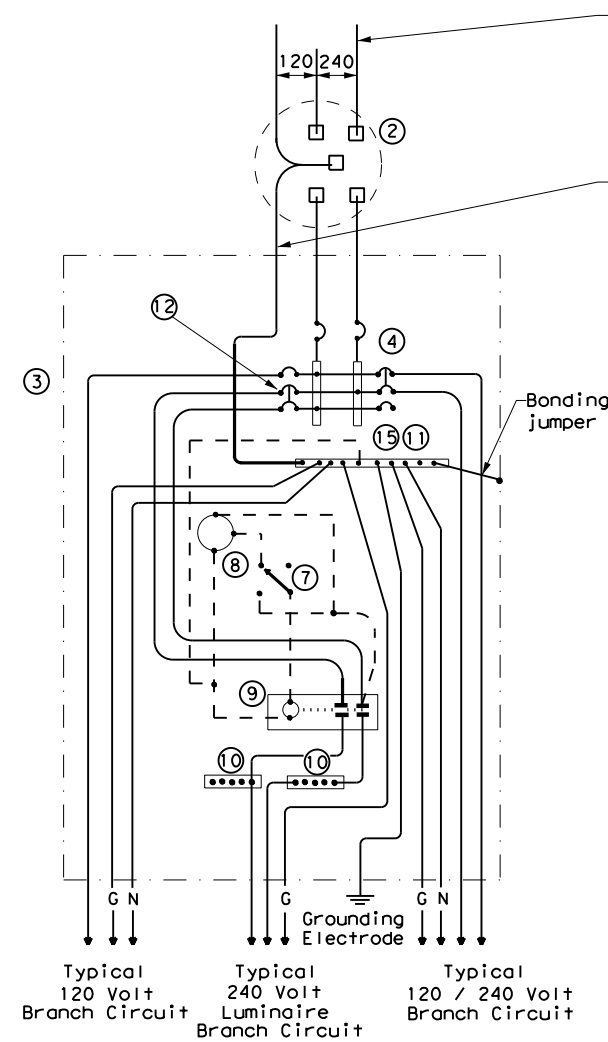

**SCHEMATIC TYPE D - CUSTOM
120/240 VOLTS - THREE WIRE**

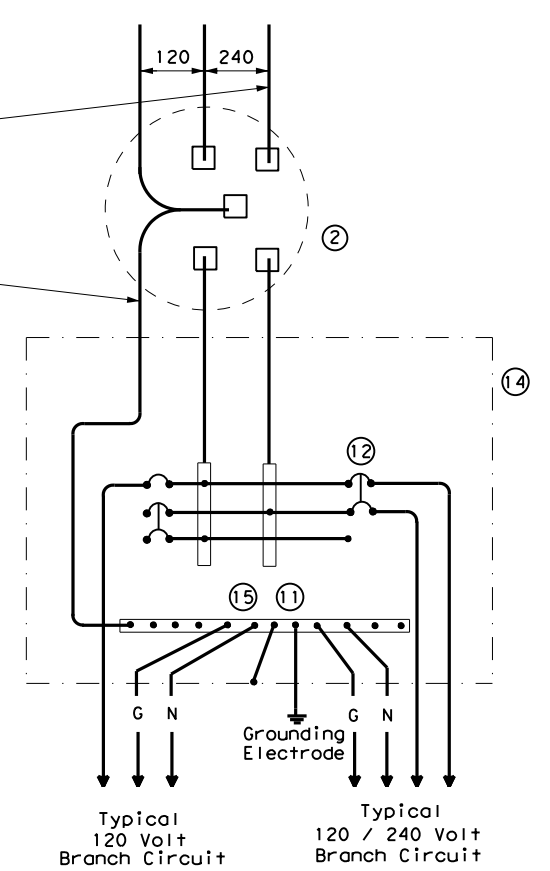

**SCHEMATIC TYPE T
120/240 VOLTS - THREE WIRE**
Galvanized steel - "Buy Off The Shelf" only. When required install photo cell top of the pole or on luminaire only, no lighting contractor will be installed.

WIRING LEGEND	
————	Power Wiring
- - - -	Control Wiring
—N—	Neutral Conductor
—G—	Equipment grounding conductor-always required

SCHEMATIC LEGEND	
1	Safety Switch (when required)
2	Meter (when required-verify with electric utility provider)
3	Service Assembly Enclosure
4	Main Disconnect Breaker (See Electrical Service Data)
5	Circuit Breaker, 15 Amp (Control Circuit)
6	Auxiliary Enclosure
7	Control Station ("H-O-A" Switch)
8	Photo Electric Control (enclosure-mounted shown)
9	Lighting Contactor
10	Power Distribution Terminal Blocks
11	Neutral Bus
12	Branch Circuit Breaker (See Electrical Service Data)
13	Separate Circuit Breaker Panelboard
14	Load Center
15	Ground Bus

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

		Traffic Operations Division Standard	
ELECTRICAL DETAILS SERVICE ENCLOSURE AND NOTES			
ED(6) - 14			
FILE: ed6-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT
©TxDOT October 2014	CONT	SECT	JOB
REVISIONS	0088	05	110, ETC US 59, ETC
DIST	COUNTY		SHEET NO.
YKM	VICTORIA, ETC		51


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

SUPPORT TYPE STEEL POLE (SP) AND STEEL FRAME (SF)

1. Provide steel pole and steel frame supports as per TxDOT Departmental Material Specification (DMS) 11080 "Electrical Services." Mount all equipment and conduit on 12 gauge galvanized steel or stainless steel channel strut, 1 1/2 in. or 1 3/8 in. wide by 1 in. up to 3 3/4 in. deep Unistrut, Kindorf, B-line or equal. Bolt or weld all channel and hardware to vertical members as approved. Do not stack channel. File smooth and paint field cut ends of all channel with zinc-rich paint before installing.
2. Provide poles for overhead service with an eyebolt or similar fitting for attachment of the service drop to the pole in conformance with the electric utility provider's specifications.
3. Provide and install galvanized 3/4 in. x 18 in. x 4 in. (dia. x length x hook length) anchor bolts for underground service supports. Provide and install galvanized 3/4 in. x 56 in. x 4 in. anchor bolts for overhead service supports. Ensure anchor bolts have 3 in. of thread, with 3 1/4 in. to 3 1/2 in. of the exposed anchor bolt projecting above finished foundation. Provide and install leveling nuts for all anchor bolts.
4. Bond one of the anchor bolts to the rebar cage with 6 AWG bare stranded copper conductor. Use listed mechanical connectors rated for embedment in concrete. See Inset B.
5. Furnish and install rigid metallic ellis in all steel pole and steel frame foundations for all conduits entering the service from underground.
6. Use class C concrete for foundations. Ensure reinforcing steel is Grade 60 with 3" of unobstructed concrete cover.
7. Drill and tap steel poles and frames for 1/2 in. X 13 UNC tank ground fitting. For steel pole service supports, provide and install tank ground fitting 4 in. to 6 in. below electrical service enclosure. Provide properly sized hole through the bottom of the enclosure for the service grounding electrode conductor. Ensure electrical service grounding electrode conductor is as short and straight as possible from the enclosure to the tank ground fitting. For steel frame service supports, provide and install tank ground fitting on steel frame post. Install service grounding electrode conductor in a non-metallic conduit or tubing from the enclosure to the steel frame post. Connect electrical service grounding electrode conductor to the tank ground fitting. See steel frame and steel pole details and Inset A for more information. Size service entrance conduit and branch circuit conduit as shown in the plans. For underground conduit runs from the electrical service, extend RMC from the service enclosure to an RMC elbow, and then connect the schedule type and size of conduit shown in the plans. Provide and install grounding bushings where RMC terminates in the enclosure. Grounding bushings are not required when RMC is fitted into a sealing hub or threaded boss.
8. If Steel pole or frame is painted, bond each separate painted piece with a bonding jumper attached to a tapped hole.
9. Provide 1/4" - 20 machine screws for bonding. Do not use sheet metal screws. Remove all non-conductive material at contact points. Terminate bonding jumpers with listed devices. Install minimum size 6 AWG stranded copper bonding jumpers. Make up all threaded bonding connections wrench tight.
10. Avoid contact of the service drop and service entrance conductors with the metal pole to prevent abrasion of the insulated conductors.
11. Shop drawings are not required for service support structure unless specifically stated elsewhere or directed by the Engineer.


White insulation or color code 6" of neutral conductor's insulation with white tape where conductor exits weatherhead.

Red insulation or color code 6" length of Line 1 or Line 2 conductor's insulation with red tape where conductor exits the weatherhead. Conductor slack length, 12" min., 18" max.

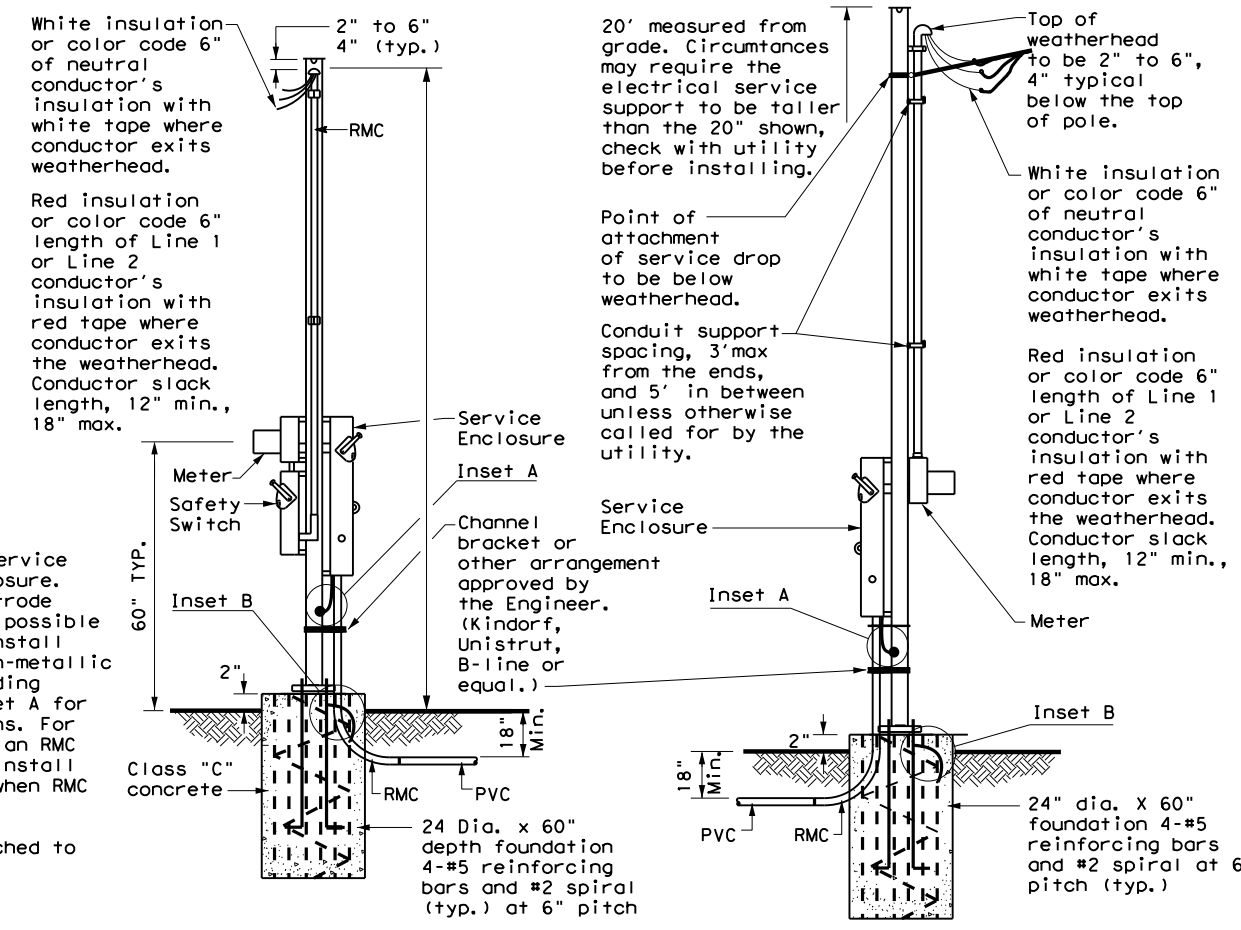


WITH SAFETY SWITCH
WITHOUT SAFETY SWITCH
SERVICE SUPPORT TYPE SP (O) - OVERHEAD SERVICE


Drill, tap, and thread 1/2" X 13 UNC. Install tank ground fitting, connect electrical service grounding electrode conductor. See Note 7.

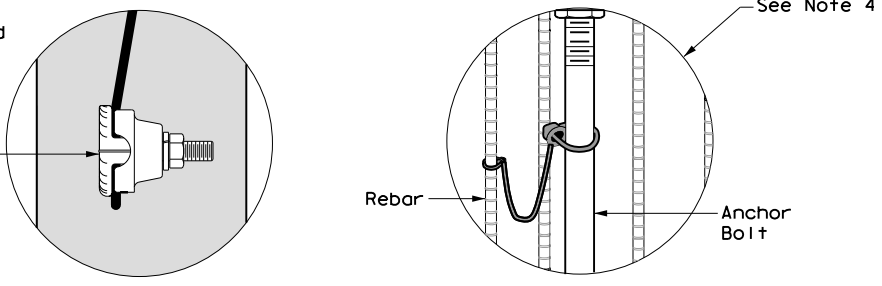


FRONT VIEW
INSET A
INSET B

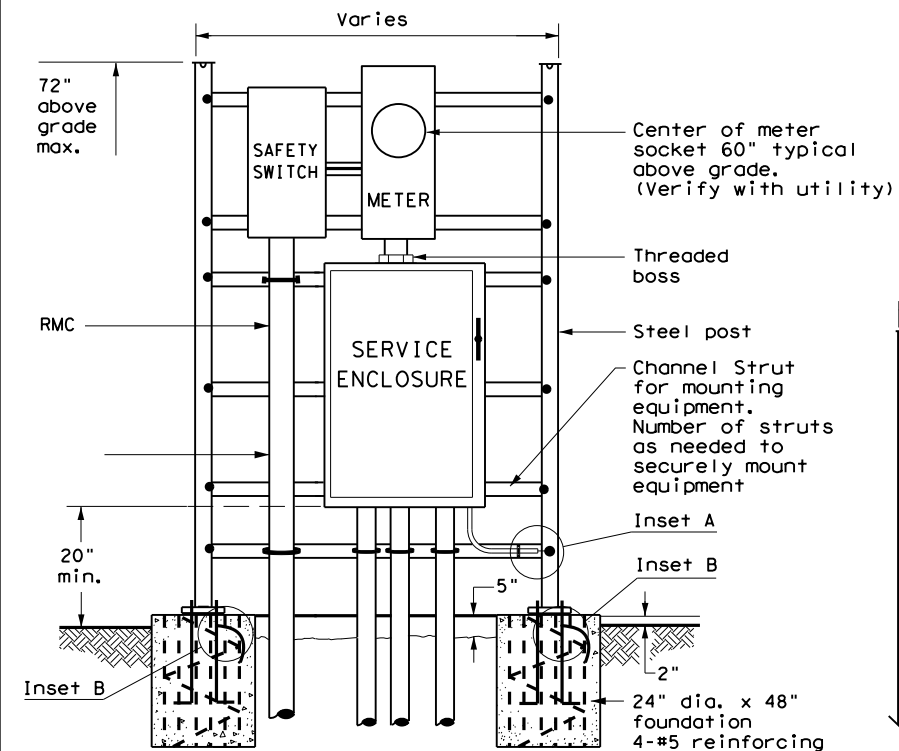


WITH SAFETY SWITCH
WITHOUT SAFETY SWITCH
SERVICE SUPPORT TYPE SF (U) - UNDERGROUND SERVICE

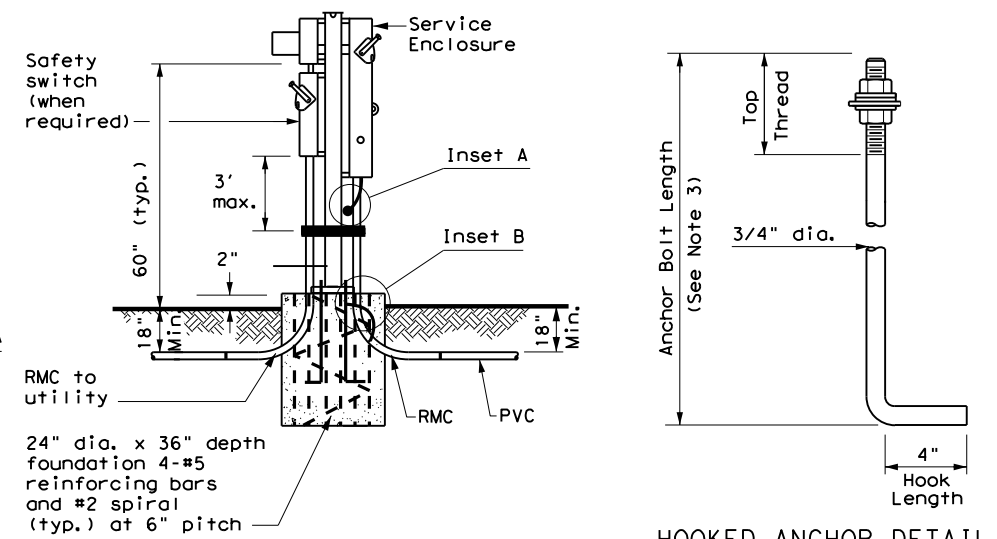


WITH SAFETY SWITCH
HOOKED ANCHOR DETAIL
SERVICE SUPPORT TYPE SP (U) - UNDERGROUND SERVICE

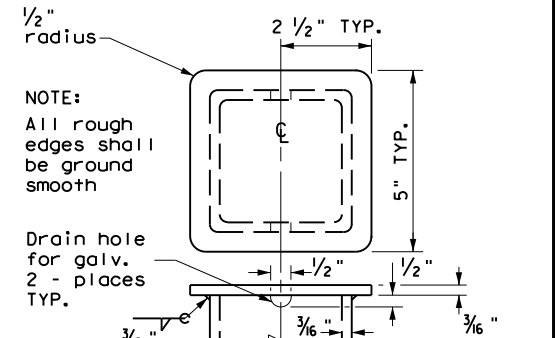

POLE TOP PLATE

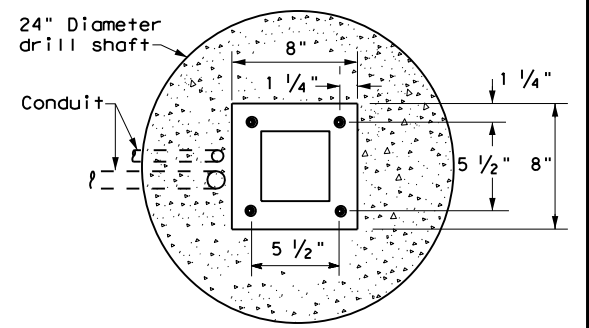


BASE PLATE DETAIL

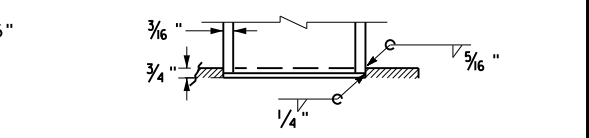

BOTTOM OF POLE

SERVICE SUPPORT TYPE SF & SP

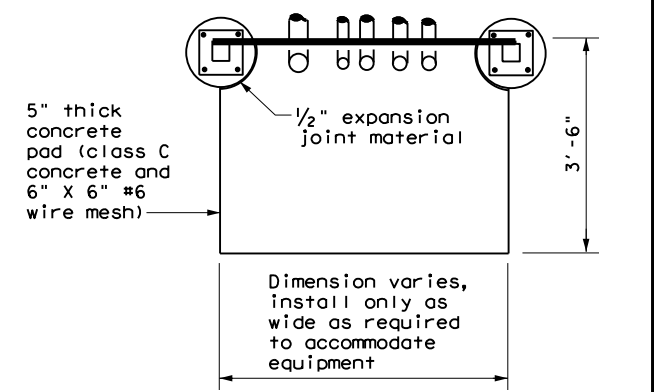

TOP VIEW
SERVICE SUPPORT TYPE SF (O) & SF (U)

		Traffic Operations Division Standard	
ELECTRICAL DETAILS SERVICE SUPPORT TYPES SF & SP ED(7)-14			
FILE: ed7-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT
©TxDOT October 2014	CON: 0088 05	SECT: 110, ETC	JOB: US 59, ETC
REVISIONS	DIST: YKM	COUNTY: VICTORIA, ETC	SHEET NO. 52

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

ROADWAY ILLUMINATION ASSEMBLY NOTES

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

1. Details apply to roadway lighting installations bid or referenced under Item 610, "Roadway Illumination Assemblies." Provide, furnish, and install all other materials not shown on the plans which may be necessary for complete and proper construction. Where manufacturers provide warranties or guarantees as a customary trade practice, furnish to the State such warranties or guarantees.
2. The locations of poles and fixtures may be shifted by the Engineer to accommodate local conditions. Install or remove poles and luminaires located near overhead electrical lines using established industry and utility safety practices and in accordance with laws governing such work. Consult with the appropriate utility company prior to beginning such work.
3. Provide new and unused materials. Ensure that all materials and installations comply with the applicable articles of the National Electrical Code (NEC), TxDOT standards and specifications, National Electrical Manufacturers Association (NEMA), and are listed by Underwriters Laboratories (UL) or a Nationally Recognized Testing Lab (NRTL). NRTLs such as Canadian Standard Association, Intertek Testing Services NA Inc., or FM Approvals LLC can be considered equivalent to UL. Faulty fabrication or poor workmanship in any material, equipment, or installation is justification for rejection.
4. Provide Roadway Illumination Light Fixtures as per TxDOT Departmental Material Specification (DMS) 11010, Item 610, and as shown on the Material Producers List (MPL) for Roadway Illumination and Electrical Supplies.
5. Fabricate steel roadway illumination poles in accordance with Roadway Illumination Poles (RIP) standards and Item 610. Poles fabricated according to RIP standards do not require shop drawing submittals.
 - a. Alternate designs to RIP standards or the use of aluminum to fabricate poles will require the submission of shop drawings electronically. For instructions on submitting shop drawings electronically see "Guide to Electronic Shop Drawing Submittal" on the TxDOT web site.
 - b. Limitations on use of the RIP standard: The RIP standard details were developed for installations in locations where the 3-second gust basic maximum wind speed is 110 mph, and where the elevation of the base of the pole is less than (i.e. not more than) 25' above the elevation of the surrounding terrain, in accordance with the "AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals," 6th Edition (2013) of the AASHTO Design Specifications. For poles to be installed in regions where the maximum basic wind speed exceeds 110 mph or to be mounted more than 25' above the surrounding terrain, provide poles meeting the following requirements:
 - i. Submittals. Following the electronic shop drawing submittal process (see Guide to Electronic Shop Drawing Submittal on the TxDOT web site), submit to the Engineer for approval fabrication drawings and calculations for the poles, sealed by a Texas licensed professional engineer (P.E.).
 - ii. Luminaire Structural Support Requirements. Provide light poles, arms, and anchor bolt assemblies with a 25 year design life to safely resist dead loads, ice loads and the required basic wind speeds at the location of installation in accordance with the 6th edition (2013) of the AASHTO Design Specifications. For transformer base poles, include transformer base and connecting hardware in calculations and shop drawing submittals. Structurally test all transformer bases to resist the theoretical plastic moment capacity of the pole. Submit certification of the plastic moment load test and FHWA breakaway requirement test of the model of base being furnished with the shop drawings. Show breakaway base model number, manufacturer's name, and logo on shop drawings. Include on manufacturer's shop drawings the ASTM designations for all materials to be used.
6. For both transformer and shoe-base type illumination poles, provide and install double-pole breakaway fuse holders as specified by DMS-11040. Breakaway fuse holders are listed on the MPL for Roadway Illumination and Electrical Supplies under Items 610 & 620. Provide 10 amp time delay fuses for breakaway connectors in light poles, or inside the light fixture for underpass luminaires. In each pole, connect luminaires to the breakaway connector with continuous stranded 12 AWG copper conductors as listed on the MPL. Bond all equipment grounding conductors together and to the ground lug in the transformer base or hand hole.
7. Tighten anchor bolts for shoe base, concrete traffic barrier base, and bridge mount roadway illumination poles, in accordance with Item 449.
8. Install T-Base with following procedure:
 - a. Anchor Bolt Tightening.
 - i. Coat the threads of the anchor bolts with electrically conductive lubricant.
 - ii. Place the T-base over the anchor bolts. Foundation must be level and flat. The maximum permissible gap under any one corner of the t-base is 1/8" before nuts are tightened.
 - iii. Coat the bearing surfaces of the nuts and washers with electrically conductive lubricant. Install (1) 1/2" hold down washer, (1) lock washer, and (1) nut on each anchor bolt. Turn the nuts onto the bolts so that each is hand-tight against the washer.
 - iv. Using a torque wrench, tighten each nut to 150 ft-lb. Uniform contact is required between the foundation and the T-base in the corner regions of the T-base, and all corner gaps must be closed after applying torque. If a gap still exists after torquing to 150 ft-lbs, continue torquing each bolt incrementally until gap is closed or maximum allowable torque of 250 ft. pound is reached, whichever comes first. If 250 ft-lbs is not enough to close the gap the foundation must be leveled. Gaps along the straight sides of the T-bases and the foundation are permissible. Ensure that no high point of contact occurs between the straight sides of the T-base and the foundation.
 - v. Check top of T-base for level. If not level then foundation must be leveled.
 - b. Top Bolt Procedure
 - i. Erect pole over T-base with crane. Coat bolts, nuts, washers, and lock washers with electrically conductive lubricant.


- ii. Install bolts and 1/2" connecting washers from the inside of the T-base, thread up through the pole base. Install flat washers, lock washers and nuts snug tight according to Item 447, "Structural Bolting."
 - iii. Tighten each nut to 150 ft-lb. using a torque wrench.
- c. Level and Plumb
- i. Ensure pole is plumb and mast arm is perpendicular to the roadway according to plans to within 5 degrees.
9. Construct luminaire pole foundations in accordance with Item 416, "Drilled Shaft Foundations," and TxDOT standard sheet RID(2).
 10. Provide and install underpass luminaires in accordance with Item 610, DMS-11010, and TxDOT standard sheet RID(3). Typical luminaire size for underpass luminaires is 150W HPS or 150W EQ LED.
 11. Mount luminaires on arms level as shown by the luminaire level indicator.
 12. Orient luminaires perpendicular to the roadway intended to be lit unless otherwise shown on the plans.

Wiring Diagram Notes:

- ① Use 1/2 in. -13 UNC threaded, copper or tin-plated copper, pole bonding connector, sized appropriately for conductors, bonded to T-base, or use ground lug in handhole as available.
- ② Use pre-qualified two-pole breakaway connectors for all luminaire pole installations. For luminaires fed by a circuit with a neutral conductor, use double pole breakaway connectors with the neutral side unfused and marked white.
- ③ Split Bolt or other connector.


Decorative LED Lighting Notes:

1. LED Drivers in Remote Outdoor enclosures (for drivers that do not include an enclosure as part of a factory assembly):
 - a. Provide NEMA 3R outdoor enclosure or as approved.
 - b. Install enclosure at least 12" above ground or other horizontal surface. Mount vertically or on ceiling, and avoid direct sun where possible.
 - c. Install drivers with at least 2 inches of space from enclosure walls.
 - d. For multiple drivers in an enclosure, provide at least 4 inches side to side and 1 inch end to end from other drivers or electronic equipment
 - e. For drivers mounted on back wall of enclosure, mount enclosure on 1 5/8" strut or other standoff to dissipate heat, or mount driver to side of the enclosure or to the metal cover.
 - f. Provide remote drivers with a maximum of 100 watts
 - g. Provide drivers with documentation of 100,000 hr lifetime at Tcase of 65C or higher.

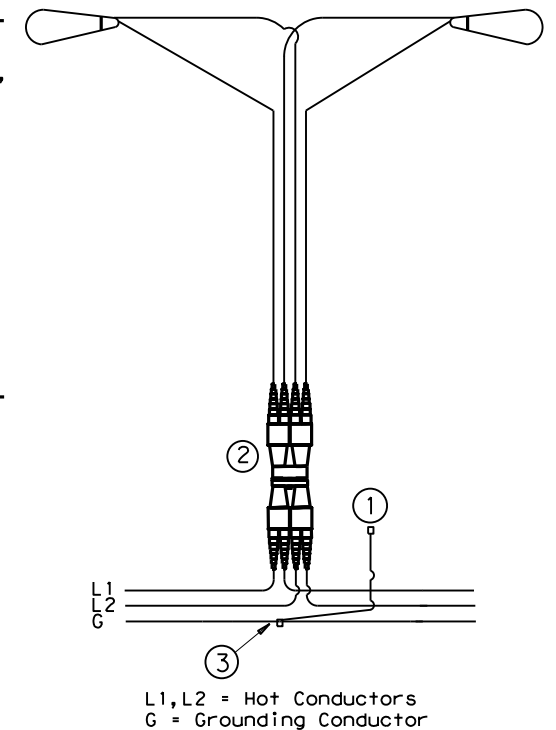

TYPICAL WIRING DIAGRAM

LUMINAIRES SERVED AT 480V ON 240/480 VOLT SERVICE OR LUMINAIRES SERVED AT 240V FOR 120/240 VOLT SERVICE.

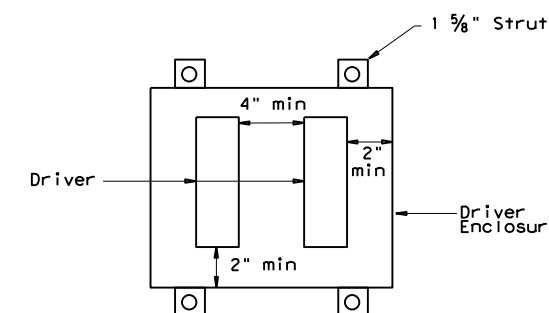


Driver Spacing In Remote Enclosure

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$


		Traffic Safety Division Standard	
<h1>ROADWAY ILLUMINATION DETAILS</h1> <h2>RID(1)-20</h2>			
FILE:	rid1-20.dgn	DN:	CK:
© TxDOT	January 2007	CONT	SECT
REVISIONS		0088	05
7-17		110, ETC	US 59, ETC
12-20		DIST	COUNTY
		YKM	VICTORIA, ETC
			SHEET NO. 53

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

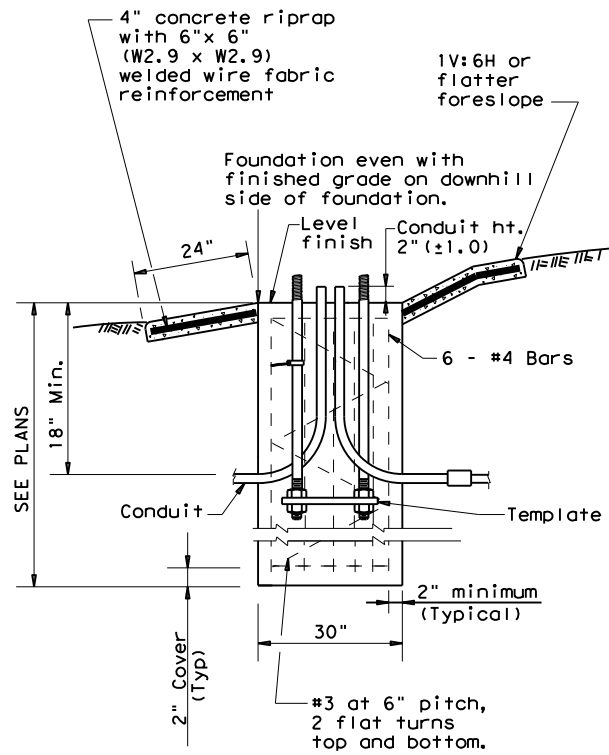

SECTION A-A
SHOWING SLOPED GRADE

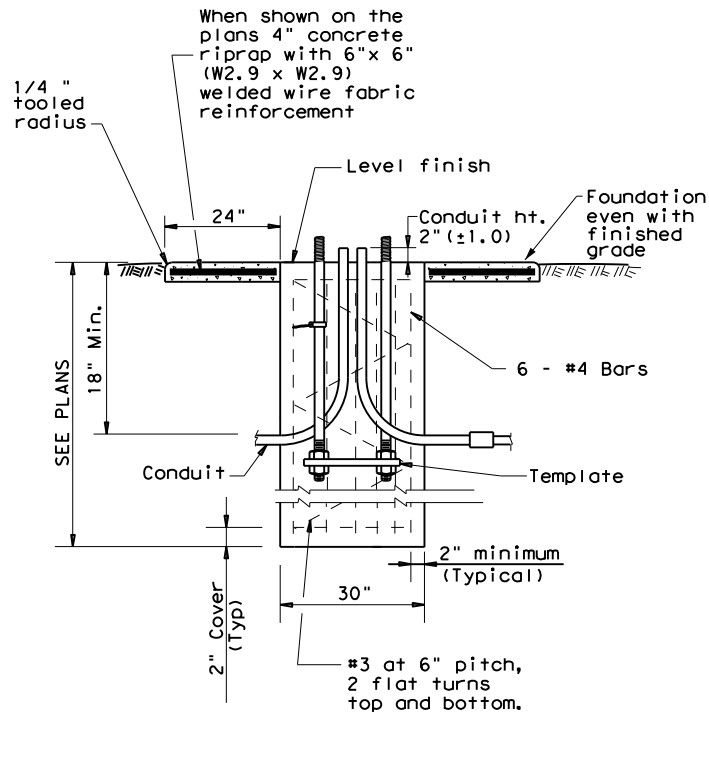

SECTION A-A
SHOWING CONSTANT GRADE

TABLE 1
ANCHOR BOLTS

POLE MOUNTING HEIGHT	BOLT CIRCLE		ANCHOR BOLT SIZE
	Shoe Base	T-Base	
<40 ft.	13 in.	14 in.	1 in. x 30 in.
40-50 ft.	15 in.	17 1/4 in.	1 1/4 in. x 30 in.

TABLE 2
RECOMMENDED FOUNDATION LENGTHS
(See note 1)


MOUNTING HEIGHT	TEXAS CONE PENETROMETER N Blows/ft		
	10	15	40
≤20 ft.	6'	6'	6'
>20 ft. to 30 ft.	8'	6'	6'
>30 ft. to 40 ft.	8'	8'	6'
>40 ft. to 50 ft.	10'	8'	6'

TABLE 3
PAY QUANTITY OF RIPRAP PER FOUNDATION
(Install only when shown on the plans)


Foundation Diameter	RIPRAP DIAMETER	RIPRAP (CONC) (CL B)
30 in.	78 in.	0.35 CY

GENERAL NOTES:

1. "Recommended Foundation Lengths" table is for information purposes only. Foundation lengths shall be as shown on the plans, or as directed by the Engineer. Foundations will be paid for under Item 416, "Drilled Shaft Foundations," unless otherwise shown on the plans.
2. Erect roadway illumination assembly poles plumb and true. Form and level the top 6" of the foundation so the pole will be plumb. Use leveling nuts to plumb shoe base poles. Do not use shims or leveling nuts under transformer bases. Do not grout between baseplate and the foundation.
3. Ensure Class 2A and 2B fit for anchor bolts and nuts. Tap and chase nuts after galvanizing. Anchor bolt body with rolled threads need not be full size.
4. Use appropriate class of concrete as specified in Items 416 and 432. Concrete for riprap may be upgraded to Class C at no extra cost to the Department.
5. Place riprap around the foundation when called for elsewhere in the plans. Riprap will be paid for under Item 432.
6. Locate breakaway roadway illumination assemblies as shown in the placement table, unless otherwise dimensioned on the plans. Protect non-breakaway illumination assemblies from vehicular impact (i.e. 2.5 ft. behind guard rail or mounted on traffic barrier), or located outside the clear zone, except that 2.5 ft. from curb face is minimum desired for light poles on city streets, 45 mph or less. See Roadway Design Manual for further information.
7. Use 4 hold down and 4 connecting washers on transformer base poles as recommended by the manufacturer and supplied with base.
8. Install a minimum of 2 conduits in each foundation. See lighting layout sheets for locations of foundations with more than 2 conduits. Cap unused conduits in foundations on both ends.
9. Conduit location in foundations is critical for breakaway devices. Place conduits 2 in. apart on centerline as shown.
10. Bond anchor bolt to rebar cage with #6 bare stranded copper conductor. Use listed mechanical connectors rated for embedment in concrete. The bonded steel in the foundation creates a concrete encased grounding electrode which replaces the ground rod.
11. Grade earthwork around T-base foundations even with the finished grade as shown in Section A-A to ensure proper function of the breakaway device. Use riprap on T-base foundations that are located on sloped grades, and as shown on the plans for level grades.

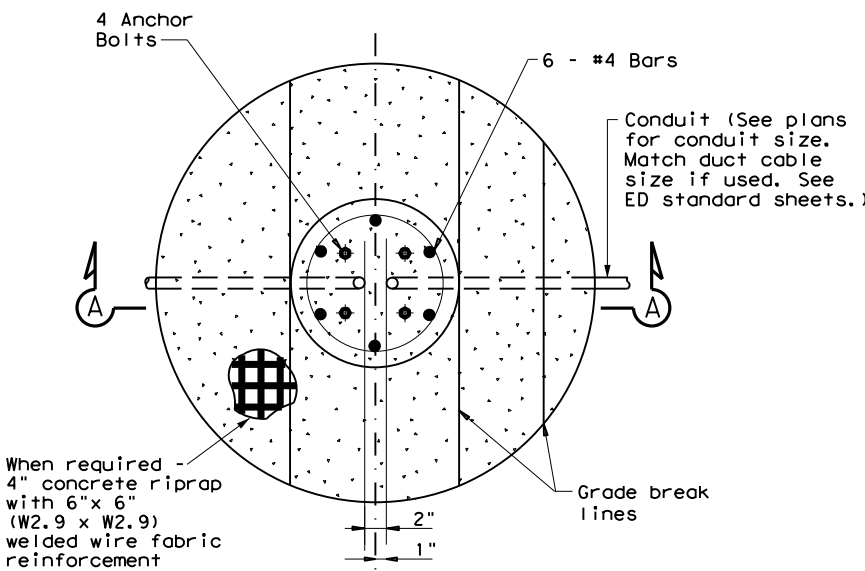

FOUNDATION DETAIL

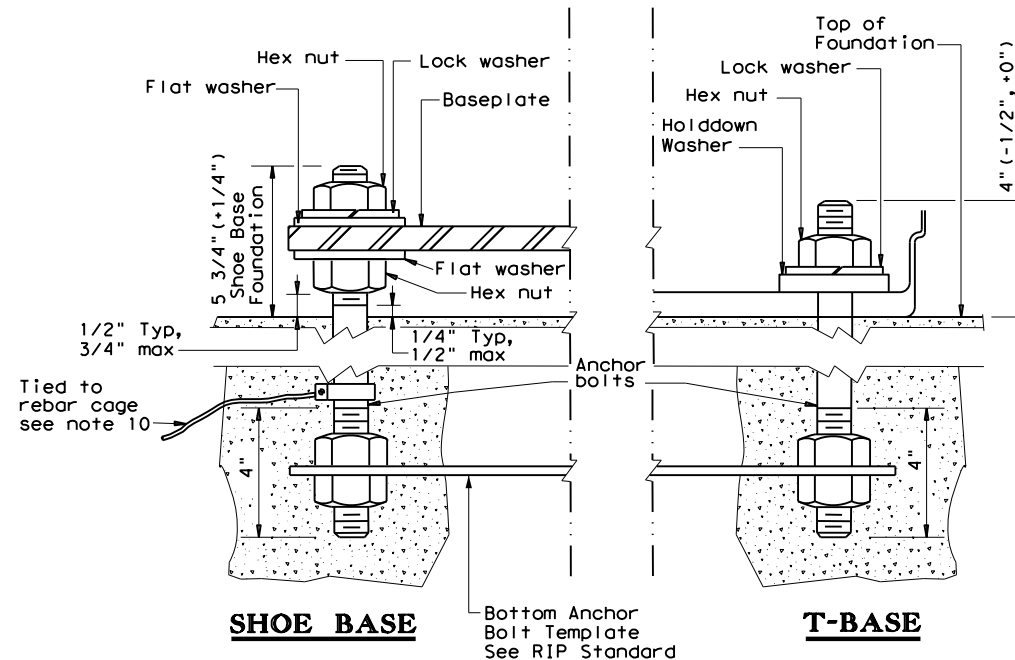

ANCHOR BOLT DETAIL

TABLE 4
BREAKAWAY POLE PLACEMENT (See note 6)

ROADWAY FUNCTIONAL CLASSIFICATION	** POLE OFFSET (DISTANCE TO FACE OF TRANSFORMER BASE)
Freeway Mainlanes (roadway with full control of access)	15 ft. (minimum and typical) from lane edge
All curbed, 45 mph or less design speed	2.5 ft. minimum (15 ft. desirable) from curb face
All others	10 ft. minimum*(15 ft. desirable) from lane edge

* or as close to ROW line as is practical
** provide 2/5 of the luminaire mounting height behind the pole for "falling area" to prevent encroachment on the other travel lanes. See design guidelines.

ROADWAY ILLUMINATION DETAILS
(RDWY ILLUM FOUNDATIONS)
RID(2)-20

FILE: rid2-20.dgn	DN:	CK:	DW:	CK:
©TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
1-11	DIST	COUNTY	SHEET NO.	
7-17	YKM	VICTORIA, ETC	54	
12-20				

SHIPPING PARTS LIST - POLES AND LUMINAIRE ARMS

Nominal Mounting Ht. (ft)	Shoe Base					T-Base					CSB/SSCB Mounted				
	Designation				Quantity	Designation				Quantity	Designation				Quantity
	Pole	A1	A2	Luminaire		Pole	A1	A2	Luminaire		Pole	A1	A2	Luminaire	
20	(Type SA 20 S - 4)			(150W EQ) LED		(Type SA 20 T - 4)			(150W EQ) LED						
	(Type SA 20 S - 4 - 4)			(150W EQ) LED		(Type SA 20 T - 4 - 4)			(150W EQ) LED						
30	(Type SA 30 S - 4)			(250W EQ) LED		(Type SA 30 T - 4)			(250W EQ) LED			(Type SP 28 S - 4)	(250W EQ) LED		
	(Type SA 30 S - 4 - 4)			(250W EQ) LED		(Type SA 30 T - 4 - 4)			(250W EQ) LED			(Type SP 28 S - 4 - 4)	(250W EQ) LED		
40	(Type SA 30 S - 8)			(250W EQ) LED		(Type SA 30 T - 8)			(250W EQ) LED			(Type SP 28 S - 8)	(250W EQ) LED		
	(Type SA 30 S - 8 - 8)			(250W EQ) LED		(Type SA 30 T - 8 - 8)			(250W EQ) LED			(Type SP 28 S - 8 - 8)	(250W EQ) LED		
	(Type SA 40 S - 4)			(250W EQ) LED		(Type SA 40 T - 4)			(250W EQ) LED			(Type SP 38 S - 4)	(250W EQ) LED		
	(Type SA 40 S - 4 - 4)			(250W EQ) LED		(Type SA 40 T - 4 - 4)			(250W EQ) LED			(Type SP 38 S - 4 - 4)	(250W EQ) LED		
	(Type SA 40 S - 8)			(250W EQ) LED		(Type SA 40 T - 8)			(250W EQ) LED			(Type SP 38 S - 8)	(250W EQ) LED		
	(Type SA 40 S - 8 - 8)			(250W EQ) LED		(Type SA 40 T - 8 - 8)			(250W EQ) LED			(Type SP 38 S - 8 - 8)	(250W EQ) LED		
	(Type SA 40 S - 10)			(250W EQ) LED		(Type SA 40 T - 10)			(250W EQ) LED			(Type SP 38 S - 10)	(250W EQ) LED		
	(Type SA 40 S - 10 - 10)			(250W EQ) LED		(Type SA 40 T - 10 - 10)			(250W EQ) LED			(Type SP 38 S - 10 - 10)	(250W EQ) LED		
50	(Type SA 40 S - 12)			(250W EQ) LED		(Type SA 40 T - 12)			(250W EQ) LED			(Type SP 38 S - 12)	(250W EQ) LED		
	(Type SA 40 S - 12 - 12)			(250W EQ) LED		(Type SA 40 T - 12 - 12)			(250W EQ) LED			(Type SP 38 S - 12 - 12)	(250W EQ) LED		
	(Type SA 50 S - 4)			(400W EQ) LED		(Type SA 50 T - 4)			(400W EQ) LED			(Type SP 48 S - 4)	(400W EQ) LED		
	(Type SA 50 S - 4 - 4)			(400W EQ) LED		(Type SA 50 T - 4 - 4)			(400W EQ) LED			(Type SP 48 S - 4 - 4)	(400W EQ) LED		
	(Type SA 50 S - 8)			(400W EQ) LED		(Type SA 50 T - 8)			(400W EQ) LED			(Type SP 48 S - 8)	(400W EQ) LED		
	(Type SA 50 S - 8 - 8)			(400W EQ) LED		(Type SA 50 T - 8 - 8)			(400W EQ) LED			(Type SP 48 S - 8 - 8)	(400W EQ) LED		
	(Type SA 50 S - 10)			(400W EQ) LED		(Type SA 50 T - 10)			(400W EQ) LED			(Type SP 48 S - 10)	(400W EQ) LED		
	(Type SA 50 S - 10 - 10)			(400W EQ) LED		(Type SA 50 T - 10 - 10)			(400W EQ) LED			(Type SP 48 S - 10 - 10)	(400W EQ) LED		
(Type SA 50 S - 12)			(400W EQ) LED		(Type SA 50 T - 12)			(400W EQ) LED			(Type SP 48 S - 12)	(400W EQ) LED			
(Type SA 50 S - 12 - 12)			(400W EQ) LED		(Type SA 50 T - 12 - 12)			(400W EQ) LED			(Type SP 48 S - 12 - 12)	(400W EQ) LED			

OTHER				
Designation				Quantity
Pole	A1	A2	Luminaire	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

GENERAL NOTES:

- All work, materials and services not shown on the plans which may be necessary for complete and proper construction shall be performed, furnished and installed by the Contractor. Faulty fabrication or poor workmanship in any material, equipment or installation will be considered justification for rejection. Where manufacturers provide warranties or guarantees as a customary trade practice, furnish to the Department such warranties or guarantees.
- The location of poles and fixtures are diagrammatic only and may be shifted by the Engineer to accommodate local conditions. Install or remove poles and luminaires located near overhead electrical lines using established industry and utility safety practices and in accordance with laws governing such work. Consult with the appropriate utility company prior to beginning such work.
- Standard Steel Pole Designs. Steel poles fabricated in accordance with the details and dimensions shown herein, shall be considered standard designs. Submission of shop drawings and design calculations for standard designs is not required.
- Optional Steel Pole Designs. Multi-sided steel poles may be allowed as optional designs, if steel poles are permitted or required, pending approval by the Department as outlined below.
 - Shop Drawings. Optional designs require submission of shop drawings and design calculations bearing the seal of an engineer licensed in the State of Texas, in accordance with Item 441, "Steel Structures." The Department may elect to pre-approve some shop drawings for optionally designed poles. Submission of shop drawings and design calculations is not required for structures fabricated in accordance with the details of shop drawings on the pre-approved list maintained by the TxDOT Traffic Operations Division. Any deviation from the pre-approved shop drawings will require submission of shop drawings of the complete assembly and design calculations as described above.
 - Structural Support Design for Luminaires. Lighting support structures shall be designed for a 25 year design life in accordance with the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto. All poles shall be designed for 110 mph 3-second gust wind speeds. The Gust Factor, G, and Wind Importance Factor, Ir, shall be applied as per the AASHTO Specifications assuming a 25-year design life. The design wind pressure for hurricane wind velocities greater than 100 mph shall not be less than the design wind pressure using 100 mph with the non-hurricane Wind Importance Factor, Ir, value. For transformer base poles, fabricator shall include transformer base and connecting hardware in design calculations and shop drawing submittals. All transformer bases shall have been structurally tested to resist the theoretical plastic moment capacity of the pole. Certification of the plastic moment load test and FHWA breakaway requirement test of the model of base being furnished shall be submitted with the shop drawings. Shop drawings shall show breakaway base model number, and manufacturer's name and logo. Manufacturer's shop drawings shall include the ASTM designations for all materials to be used.
 - Mast Arm Attachments. All poles and attachments shall be structurally designed to support two 12-foot mast arms and luminaires. Poles shall be supplied with mast arm combinations as shown in the plans. All mast arms shall be designed for a 60-pound luminaire having an effective projected area of 1.6 square feet.
 - Anchor Bolt Assembly. Anchor bolt assemblies for optionally designed poles shall be the same as those shown herein.
- Aluminum Pole Designs. Aluminum pole designs may be allowed, if aluminum poles are permitted or required, pending approval by the Department as outlined below.
 - Meet all of the requirements stated above for optional steel pole designs and the following:
 - Aluminum poles shall be fabricated in accordance with "Structural Welding Code-Aluminum" AWS D1.2.
 - Aluminum pole designs shall use the same anchor bolt assembly and be subject to the same geometric restraints and other requirements for steel poles specified herein.
 - Aluminum poles shall be equipped with vibration mitigation devices, as approved by the engineer.
 - Pole components shall be constructed using the following material:
 - Shaft: ASTM B221 or B241 Alloy 6063-T6, ASTM B209 Alloy 5086-H34, ASTM B221 Alloy 6005-T5.
 - Base Flange: ASTM B26 Alloy 356.0-T6 or ASTM B108 Alloy 356.0-T6 (Yield strength test required).
 - Mast Arm Fitting: ASTM B209 Alloy 6061-T6 or ASTM B221 Alloy 6005-T5.
 - Mast Arms: ASTM B241 Alloy 6061-T6 or Alloy 6063-T6.
 - Pole Cap: ASTM B209 Alloy 5086-H32 or ASTM B108 or B26 Alloy 356.0-T6.
 - Bolts: Stainless Steel AISI 300 series. Bolts threading into aluminum threads shall be treated with anti-seize compound, Never-Seez Compound, Permatex 133K or equal.
- Special Designs. Poles with architectural treatments shall meet the requirements shown elsewhere in the plans.
- Luminaire Mounting Height. Actual luminaire mounting height shall be the nominal mounting height given on RIP(2) for all pole-arm combinations except for poles with 4 ft. luminaire arms, which shall be 3'-0" lower than the nominal height, unless otherwise shown or directed.


EXPLANATION OF ROADWAY ILLUMINATION ASSEMBLY DESIGNATIONS

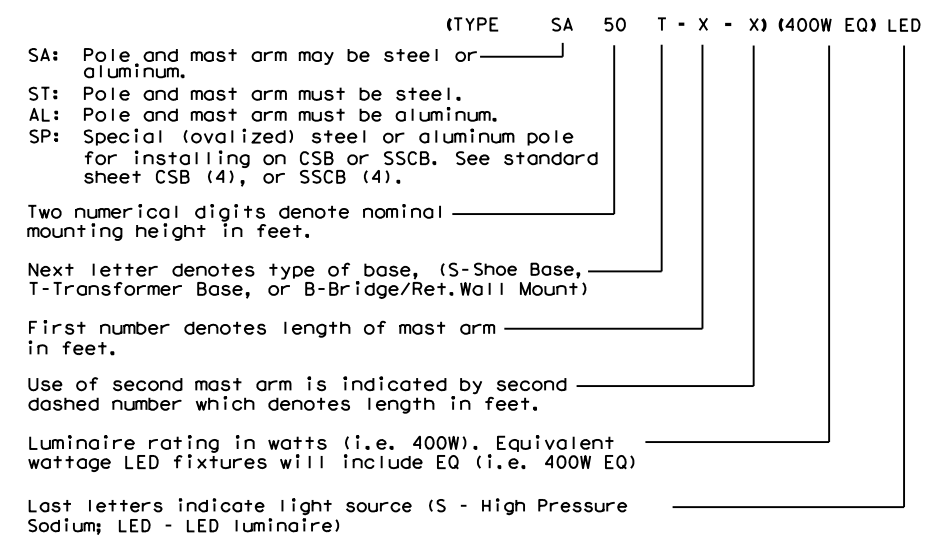

		Traffic Safety Division Standard	
<h2 style="margin: 0;">ROADWAY ILLUMINATION POLES</h2> <h3 style="margin: 0;">RIP(1)-19</h3>			
FILE: rip-19.dgn	DN:	CK:	DW:
© TxDOT January 2007		CONT	SECT
7-17	REVISIONS	JOB	HIGHWAY
12-19	0088 05	110, ETC	US 59, ETC
DIST	COUNTY	SHEET NO.	
YKM	VICTORIA, ETC	55	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

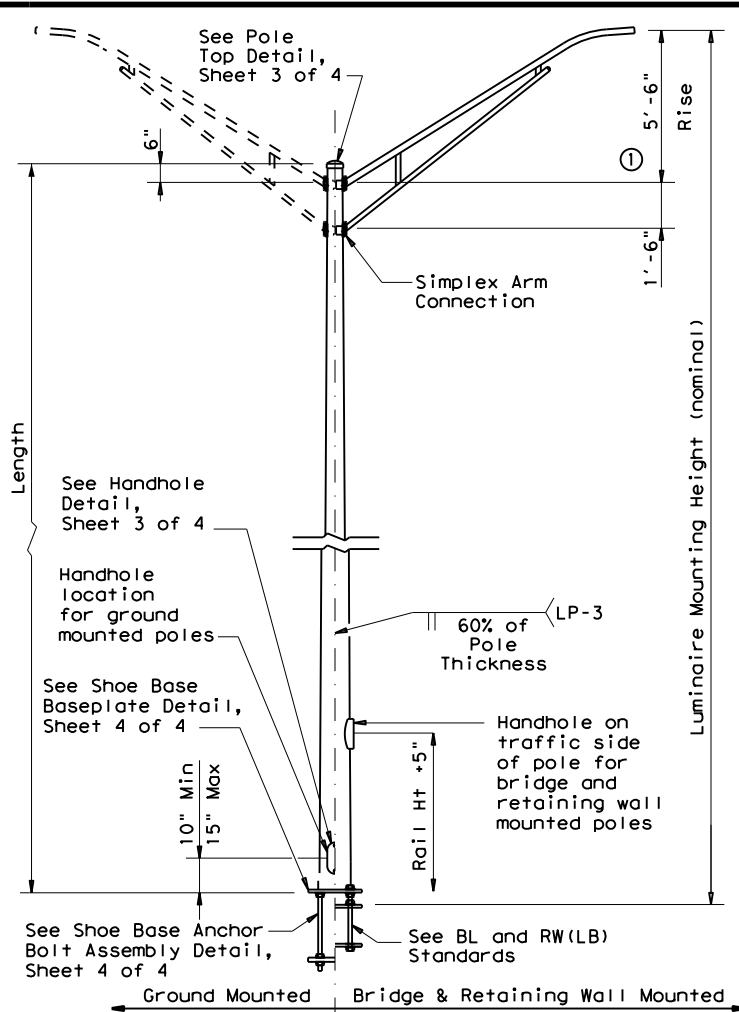


SHOE BASE POLE

SHOE BASE POLE					
Luminaire Mounting Height (Nominal) (ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)
20.00	7.00	4.90	15.00	0.1196	7.1
30.00	7.50	4.00	25.00	0.1196	13.2
31.00-39.00	8.00	4.36-3.24	26.00-34.00	0.1196	20.7
40.00	8.50	3.60	35.00	0.1196	20.7
50.00	10.50	4.20	45.00	0.1196	30.3

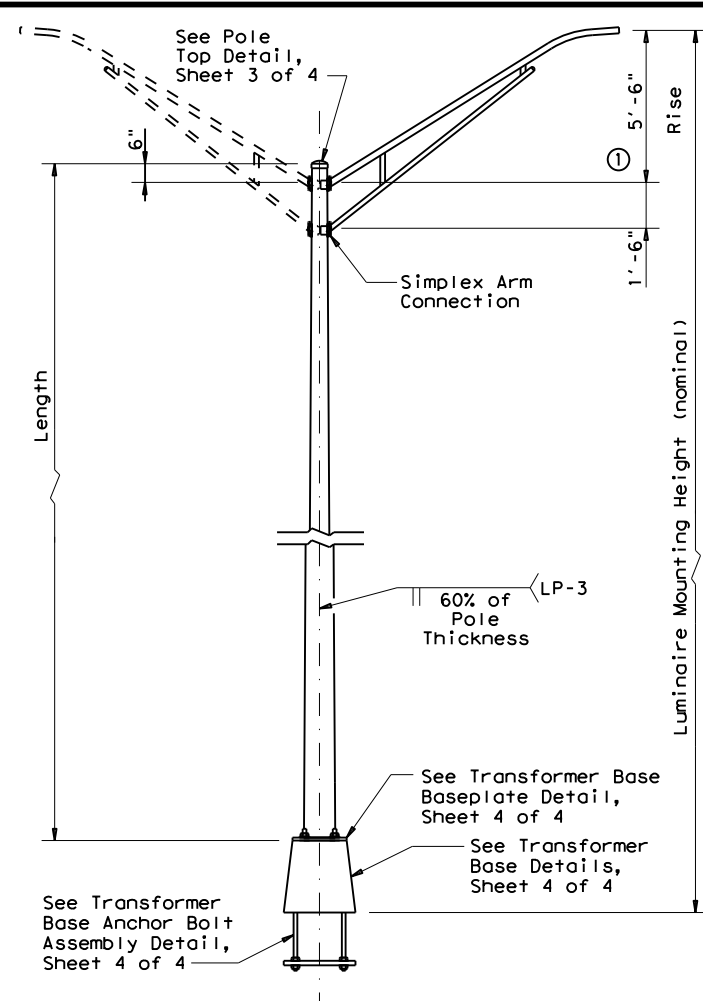

TRANSFORMER BASE POLE

TRANSFORMER BASE POLE					
Luminaire Mounting Height (Nominal) (ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)
20.00	7.00	5.11	13.50	0.1196	7.1
30.00	7.50	4.21	23.50	0.1196	13.2
31.00-39.00	8.00	4.57-3.45	24.50-32.50	0.1196	20.7
40.00	8.50	3.81	33.50	0.1196	20.7
50.00	10.00	3.91	43.50	0.1196	30.3

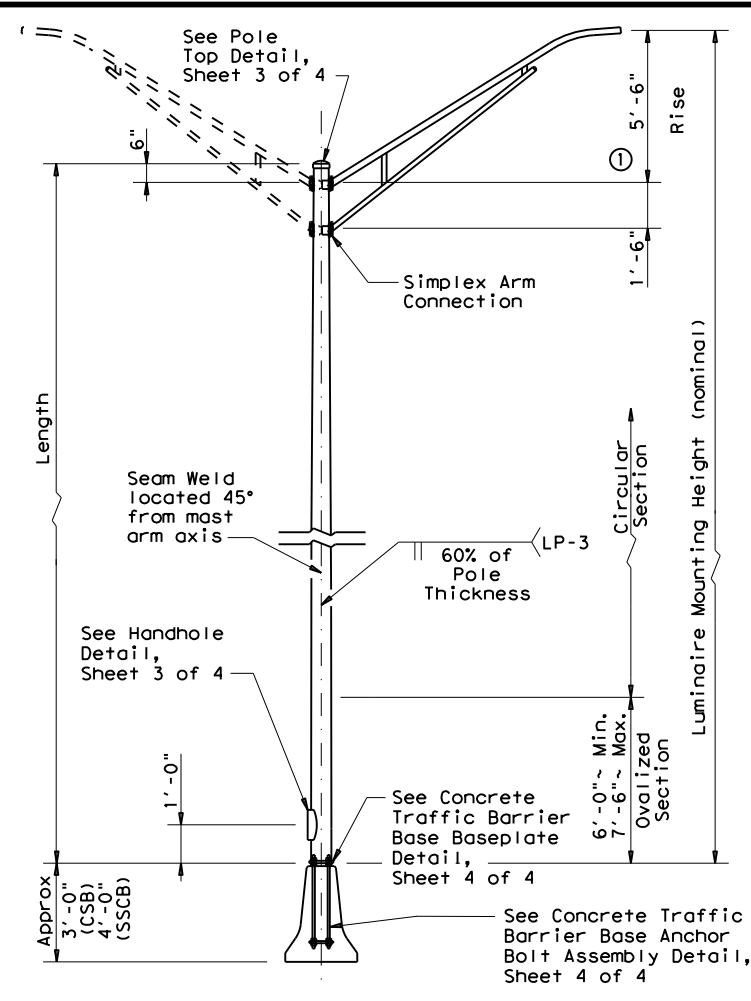

CONCRETE TRAFFIC BARRIER BASE POLE

CONCRETE TRAFFIC BARRIER BASE POLE (CSB/SSCB)						
Luminaire Mounting Height (Nominal) (ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)	
					About C of Rail	Perp. to Rail
28.00	9.00	5.78	23.00	0.1196	10.3	13.2
38.00	9.00	4.38	33.00	0.1196	16.6	20.8
48.00	10.50	4.48	43.00	0.1345	25.1	30.5

GENERAL NOTES:

- Designs conform to AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto. Design 3-Second Gust Wind Speed equals 110 mph with a 1.14 gust factor. A wind importance factor of 0.80 is applied to adjust the wind speed to a 25 year recurrence interval. Design moments listed in tables assume base of pole is 25' above natural ground level.
- Structures are designed to support two 12' luminaire mast arms and luminaires. Mast arms are designed to support a 60-pound luminaire having an effective projected area of 1.6 square feet.
- Fabrication shall be in accordance with the Specifications and with the details, dimensions, and weld procedures shown herein. Do not submit shop drawings for roadway illumination pole assemblies fabricated in accordance with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. Materials, fabrication tolerances, and shipping practices shall meet the requirements of these sheets and the Specifications. In the absence of specified fabrication tolerances, dimensions shall be within the tolerances generally obtainable in normal fabrication practice.
- For mounting heights between values shown in the tables, use base diameter and thickness values for the larger height.
- Unless otherwise noted, all steel parts shall be galvanized in accordance with Item 445, "Galvanizing."
- Steel poles shall be fabricated in accordance with Item 441, "Steel Structures." Longitudinal seam welds for pole sections shall have 60% minimum penetration. All welding shall be in accordance with AWS D1.1, Structural Welding Code-Steel.
- Two-section poles joined by circumferential welds will not be permitted, unless otherwise shown on the plans. Poles may be fabricated in two sections and field-assembled by the lap-joint method. The two sections shall telescope together with a lap length of not less than 1-1/2 times the shaft diameter at the lap joint.
- Alternate material equal to or better than material specified may be substituted with the approval of the Engineer.
- Lubricate and tighten anchor bolts, when erecting shoe base poles and concrete traffic barrier base poles, in accordance with Item 449, "Anchor Bolts."
- All poles, except Transformer Base Poles, shall have hand holes with reinforcing frames and covers. For ground mounted shoe base poles, hand holes shall be placed 90 degrees to mast arm unless otherwise noted on the plans. For poles mounted on a concrete traffic barrier with one luminaire arm, hand holes shall be located 180 degrees from luminaire arm. For poles mounted on a concrete traffic barrier with two luminaire arms, all hand holes shall be on the same side of the barrier. For poles mounted on a bridge lighting bracket or a retaining wall lighting bracket, hand hole shall be on traffic side of the pole, at a height that will clear the barrier.
- The finished pole shall have a smooth, uniform finish free of pits, blisters, or other defects. Scratched, chipped, and other damaged galvanized areas on poles and mast arms shall be repaired in accordance with Item 445, "Galvanizing."
- Pole length is based on a 5'-6" luminaire arm rise. 4 ft. luminaire arms have a 2'-6" rise. A pole with 4 ft. luminaire arms will have an actual mounting height 3'-0" less than the nominal mounting height. Increasing the pole length to meet the nominal mounting height is allowed, but unnecessary unless otherwise directed by the engineer.
- Erect transformer base poles in accordance with sheet RID(1).

MATERIAL DATA

COMPONENT	ASTM DESIGNATION	MIN. YIELD (ksi)
Pole Shaft (0.14"/ft. Taper)	A572 Gr 50, A595 Gr A, A1011 HSLAS Gr 50 Cl 2 ③, or A1008 HSLAS Gr 50 Cl 2	50
Base Plate and Handhole Frame	A572 Gr.50, or A36	36
T-Base Connecting Bolts	F3125 Gr A325	92
Anchor Bolts	F1554 Gr 55, A193-B7 or A321	55 105
Anchor Bolt Templates	A36	36
Heavy Hex (H.H.) Nuts	A194 Gr 2H, or A563 Gr DH	
Flat Washers	F436	

NOTES:

- 2'-6" rise for 4 ft. luminaire arms.
- Before ovalized as shown on Concrete Traffic Barrier Base Baseplate details, Sheet 4 of 4.
- A1011 SS Gr 50 may be used instead of HSLAS, provided the material meets the elongation requirements for HSLAS.

POLE ASSEMBLY FABRICATION TOLERANCES TABLE

DIMENSION	TOLERANCE
Shaft length	+1"
I.D. of outside piece of slip fitting pieces	+1/8", -1/16"
O.D. of inside piece of slip fitting pieces	+1/32", -1/8"
Shaft diameter: other	+3/16"
Out of "round"	1/4"
Straightness of shaft	±1/4" in 10 ft
Twist in multi-sided shaft	4° in 50 ft
Perpendicular to baseplate	1/8" in 24"
Pole centered on baseplate	±1/4"
Location of Attachments	±1/4"
Bolt hole spacing	±1/16"

SHEET 2 OF 4




**ROADWAY ILLUMINATION POLES
RIP(2)-19**

FILE: rip-19.dgn	DN:	CK:	DW:	CK:
© TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
7-17	DIST	COUNTY	SHEET NO.	
12-19	YKM	VICTORIA, ETC	56	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

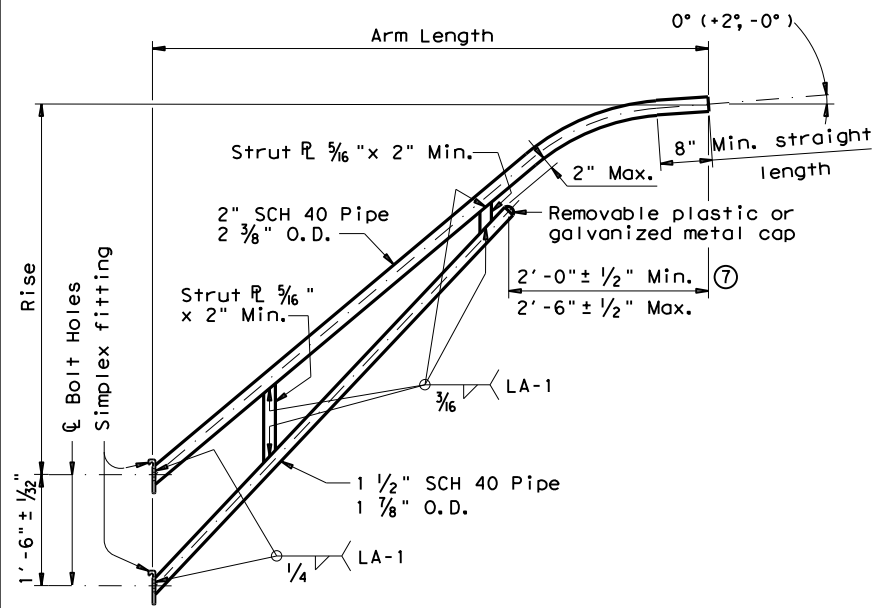


LUMINAIRE ARM

LUMINAIRE ARM DIMENSIONS		
Nominal Arm Length	Arm Length	Rise
4'-0"	3'-6"	2'-6"
6'-0"	5'-6"	5'-6"
8'-0"	7'-6"	5'-6"
10'-0"	9'-6"	5'-6"
12'-0"	11'-6"	5'-6"


ARM ASSEMBLY FABRICATION TOLERANCES TABLE	
DIMENSION	TOLERANCE
Arm Length	±1"
Arm Rise	±1"
Deviation from flat	1/8" in 12"
Spacing between holes	±1/32"

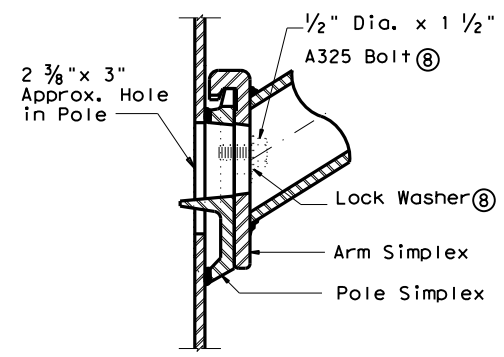


UPPER SIMPLEX FITTING
(Gusset not shown for clarity)

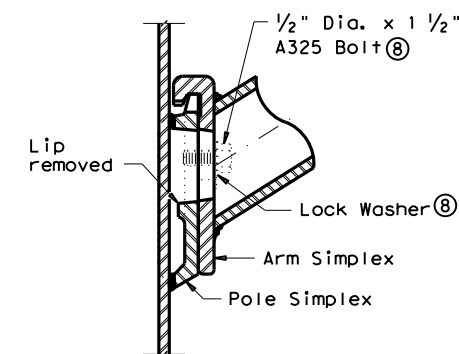




LOWER SIMPLEX FITTING
(Gusset not shown for clarity)
SECTION B-B

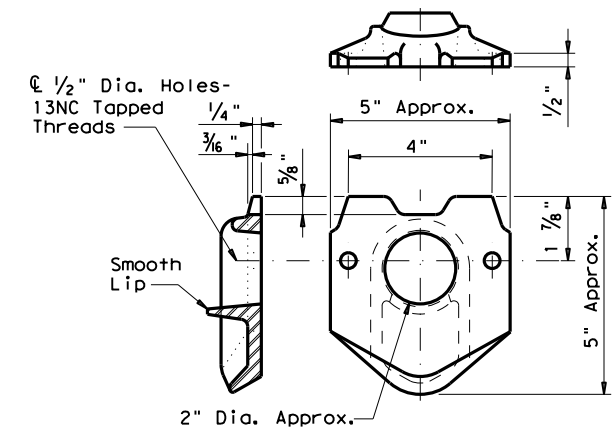


POLE SIMPLEX DETAIL

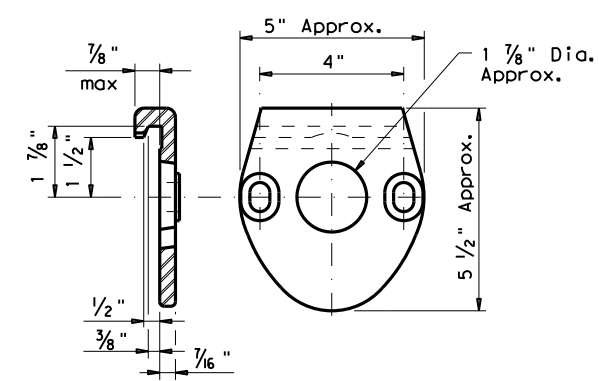


ARM SIMPLEX DETAIL

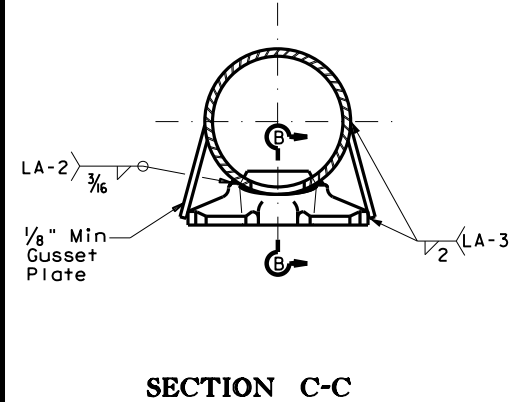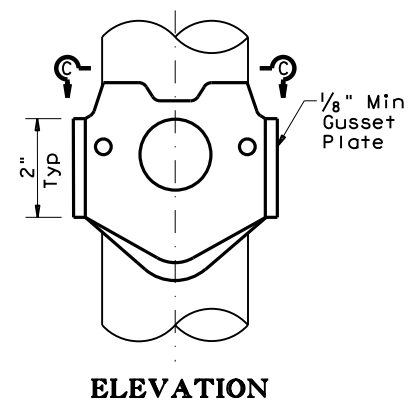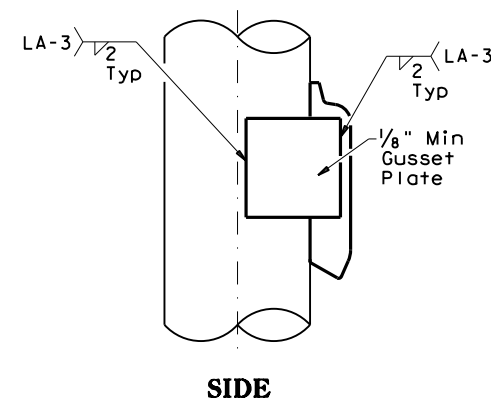


SIMPLEX ATTACHMENT DETAIL

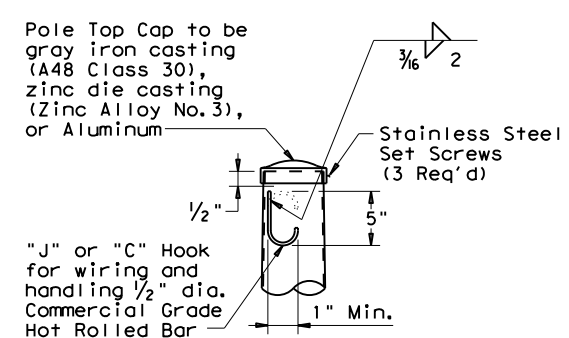

POLE TOP

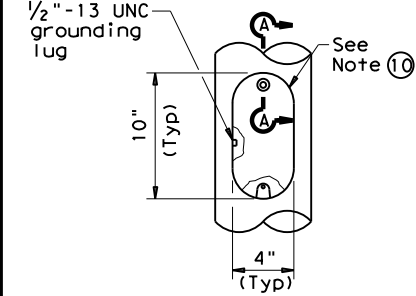

ELEVATION

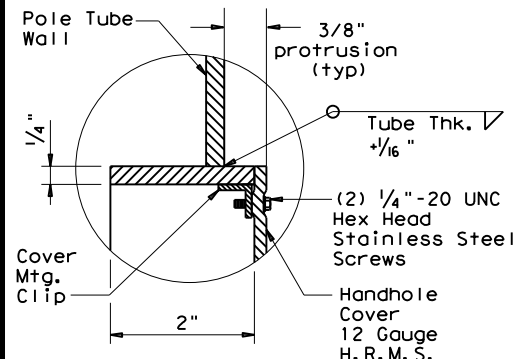

SECTION A-A

HANDHOLE

NOTES:

- ④ Any of the materials listed for plates may be used where the drawings do not specify a particular ASTM designation.
- ⑤ A576 must be suitable for forging and also meet minimum tensile strength of 65 ksi, minimum yield of 35 ksi, and elongation in 2 inches of 22 percent.
- ⑥ A572, A1008 HSLAS-F, and A1011 HSLAS-F materials may have higher yield strengths but shall not have less elongation than the grade indicated.
- ⑦ Dimensional limits are given to show acceptable variation in design. All of a Fabricator's production of a particular arm length shall have the same dimensions within specified tolerances.
- ⑧ Each pole simplex fitting shall be supplied with 2 bolts and 2 lock washers of the size specified. The bolts and lock washers shall be secured to the pole with the other hardware items called for in the plans.
- ⑨ Proposed deviations in arm simplex dimensions or materials must be submitted to the Department for approval.
- ⑩ A welded handhole frame is permissible. Maximum of two (2) CJP weld splices is allowed.

MATERIALS


Pole or Arm Simplex	ASTM A27 Gr 65-35 or Gr 70-36, A148 Gr 80-50, A576 Gr 1021 ⑤, or A36 (Arm only)
Arm Pipes	ASTM A53 Gr A or B, A500 Gr B, A501, A 1008 HSLAS-F Gr 50 ⑥, or A1011 HSLAS-F Gr 50 ⑥
Arm Struts and Gusset Plates ④	ASTM A36, A572 Gr 50 ⑥, or A588
Misc.	ASTM designations as noted

ROADWAY ILLUMINATION POLES
RIP(3) - 19

FILE: rip-19.dgn	DN:	CK:	DW:	CK:
©TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088 05	110, ETC	US 59, ETC	
7-17 12-19	DIST	COUNTY	SHEET NO.	
	YKM	VICTORIA, ETC	57	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

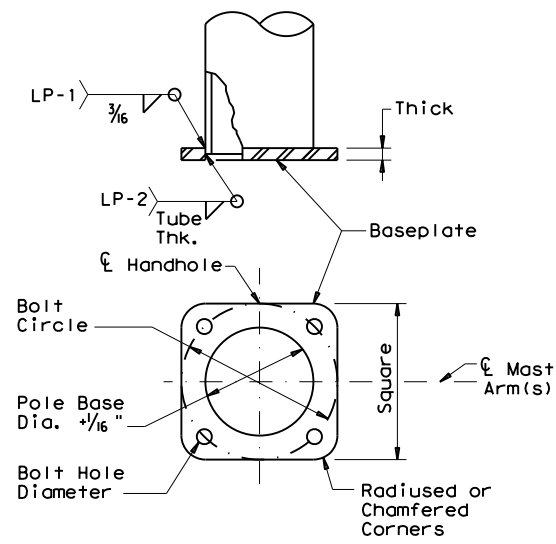


SHOE BASE BASEPLATE

SHOE BASE BASEPLATE TABLE				
MOUNTING HEIGHTS (nominal)	BOLT CIRCLE	SQUARE	THICK	BOLT HOLE DIAMETER
20' - 39'	13"	13"	1 1/4"	1 1/4"
40'	15"	15"	1 1/4"	1 1/2"
50'	15"	15"	1 1/2"	1 1/2"

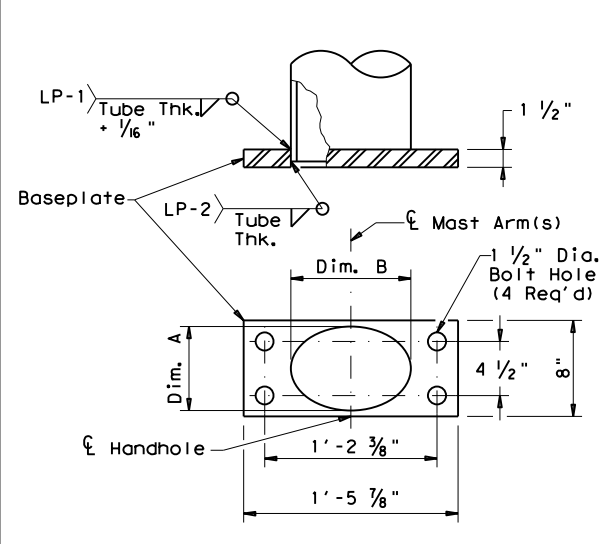


CONCRETE TRAFFIC BARRIER BASE BASEPLATE

CONCRETE TRAFFIC BARRIER BASE BASEPLATE TABLE			
MOUNTING HEIGHTS (nominal)	POLE DIA. (12)	DIM. A	DIM. B
28' - 38'	9"	7" ± 1/4"	10" ± 1/4"
48'	10 1/2"	7" ± 1/4"	13" ± 1/4"

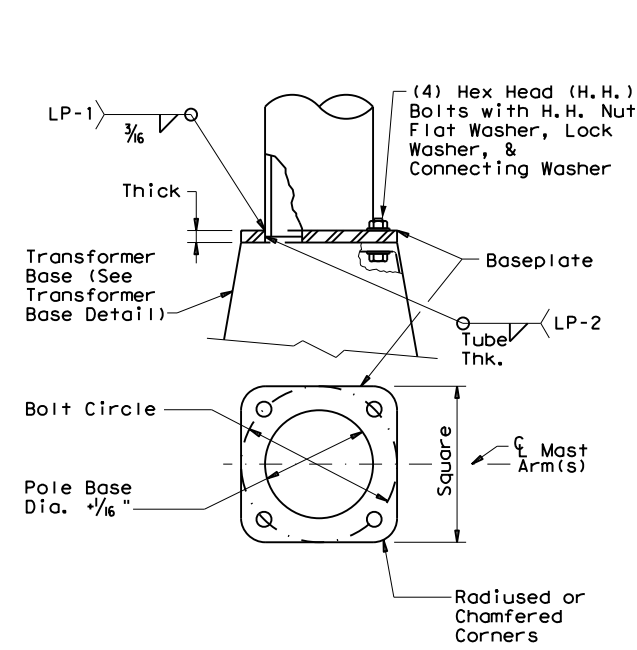


TRANSFORMER BASE BASEPLATE

TRANSFORMER BASE BASEPLATE TABLE						
MOUNTING HEIGHTS (nominal)	BOLT CIRCLE	SQUARE	THICK	CONNECTING BOLT DIA.	BOLT HOLE DIAMETER	TRANSFORMER BASE TYPE
20' - 39'	13"	13"	1 1/4"	1"	1 1/4"	A
40'	15"	15"	1 1/4"	1 1/4"	1 1/2"	B
50'	15"	15"	1 1/2"	1 1/4"	1 1/2"	B

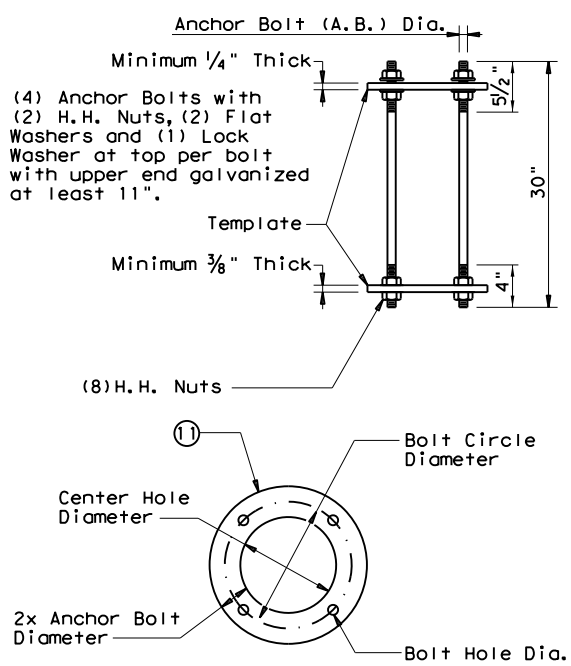


SHOE BASE ANCHOR BOLT ASSEMBLY

SHOE BASE ANCHOR BOLT ASSEMBLY TABLE				
MOUNTING HEIGHTS (nominal)	A.B. Dia.	BOLT CIRCLE DIAMETER	CTR. HOLE DIAMETER	BOLT HOLE DIAMETER
20' - 39'	1"	13"	11"	1 1/16"
40' - 50'	1 1/4"	15"	12 1/2"	1 5/16"

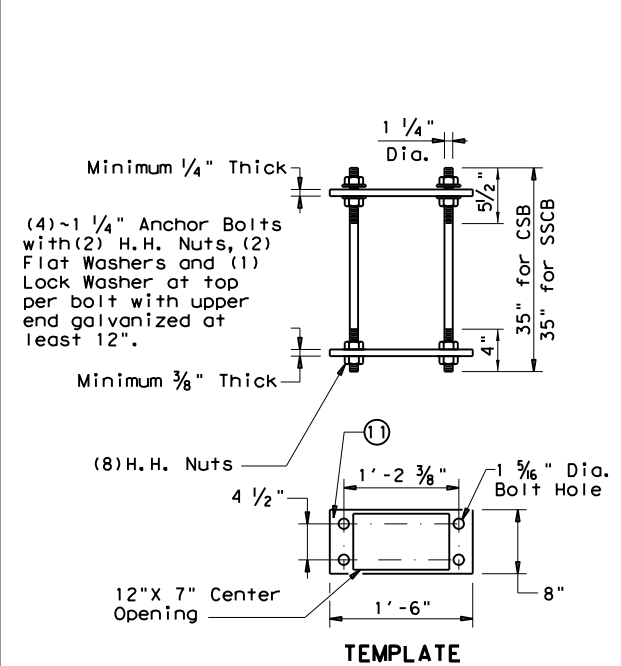


CONCRETE TRAFFIC BARRIER BASE ANCHOR BOLT ASSEMBLY

CONCRETE TRAFFIC BARRIER BASE ANCHOR BOLT ASSEMBLY TABLE				
MOUNTING HEIGHTS (nominal)	A.B. Dia.	BOLT CIRCLE DIAMETER	CTR. HOLE DIAMETER	BOLT HOLE DIAMETER
20' - 39'	1"	14"	12"	1 1/16"
40' - 50'	1 1/4"	17 1/4"	14 3/4"	1 5/16"

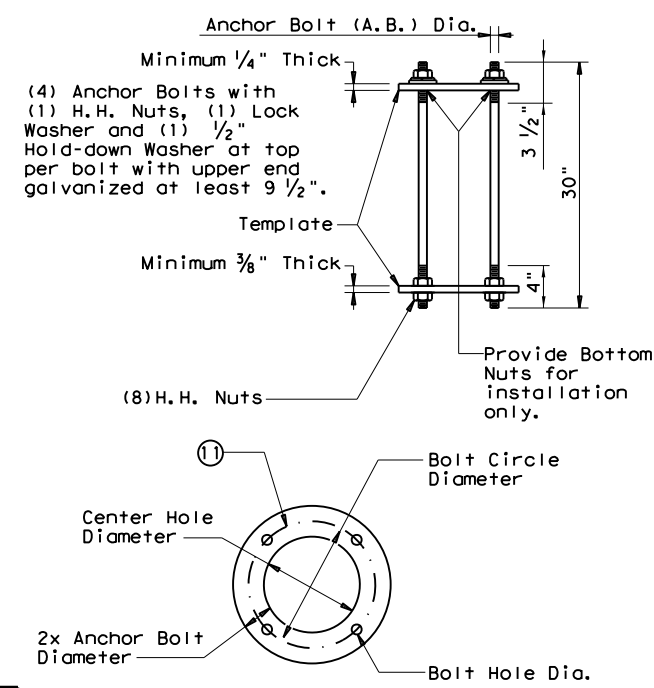


TRANSFORMER BASE ANCHOR BOLT ASSEMBLY


TRANSFORMER BASE TABLE		
TYPE	TOP B.C.	BTM. B.C.
A	13"	14"
B	15"	17 1/4"

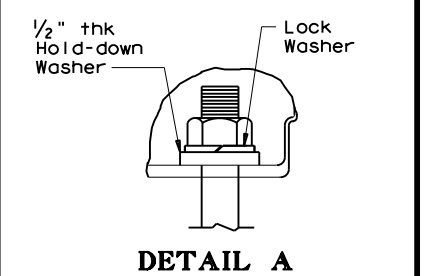


DETAIL A

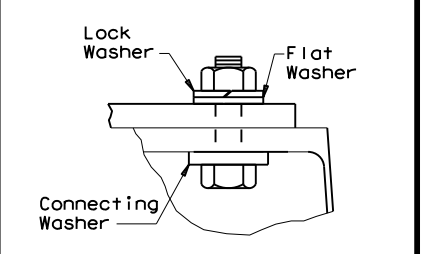


DETAIL B

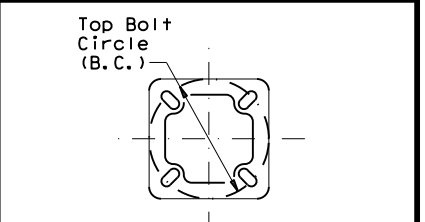

TOP PLAN

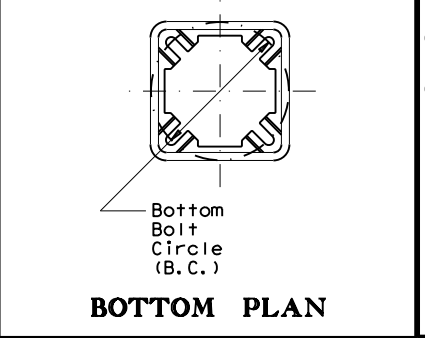

BOTTOM PLAN

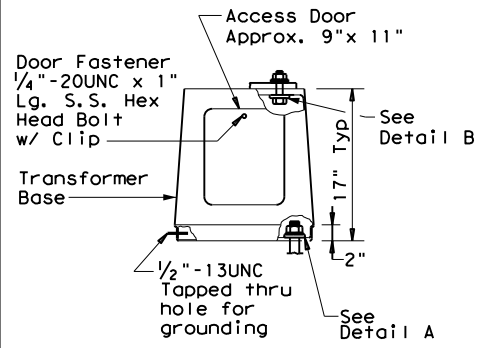

ELEVATION

TRANSFORMER BASE DETAILS

- GENERAL NOTES:**
- For mounting heights between those shown in the table, use the values in the table for the larger mounting height.
 - All breakaway bases shall meet the breakaway requirements of the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto, and shall have been tested by FHWA-approved methods. All bases shall have been structurally tested to resist 150% of the design moment.
 - Transformer bases shall be cast from aluminum, ASTM B108 or B26 Alloy 356.0-T6, or other material approved by the Engineer. Four Hex Head (H.H.) bolts with four H.H. nuts, four lock washers, four flat washers, and connecting and hold-down washers as recommended by the manufacturer, galvanized to ASTM A153 Class C or D, or B695 Class 50, shall be provided with each transformer base for connecting the pole. Bolts shall be ASTM A325 or approved equal. Nuts shall be ASTM A563 grade DH galvanized.
 - Bases shall be stamped, incised or by other approved permanent means, marked to show fabricator's name or logo, and model number. Such information shall be placed in a readily seen location, inside or outside the base, but shall not be placed on the door.
 - Doors for transformer bases shall be made of plastic, fiberglass or other non-metallic material approved by the Engineer and shall be attached with stainless steel screws or bolts. Transformer bases shall be cleaned by grit blast cleaning after heat treatment. Certification by the manufacturer of heat treatment shall be furnished with transformer bases. The certification shall show the metal alloy and temper and that the base meets those requirements, chemical and physical. The certification shall also show the material ASTM specification. Transformer bases shall be cast with a removable tab bar for material testing. Some bars may have been removed by the manufacturer for testing.

NOTES:

- Anchor Bolt Templates do not need to be galvanized.
- Pole diameter before ovalized.

ANCHOR BOLT FABRICATION TOLERANCES TABLE	
DIMENSION	TOLERANCE
Length	± 1/2"
Threaded length	± 1/2"
Galvanized length (if required)	- 1/4"

SHEET 4 OF 4

Texas Department of Transportation
Traffic Safety Division Standard

ROADWAY ILLUMINATION POLES


RIP(4) - 19

FILE: rip-19.dgn	DW: CK:	DW: CK:
©TxDOT January 2007	REV: 0088 05	JOB: 110, ETC US 59, ETC
7-17 12-19	DIST: YKM	COUNTY: VICTORIA, ETC
		SHEET NO. 58


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

GENERAL NOTES:


1. Details show a typical warning sign with two flashing beacon heads, other arrangements are possible. When only one beacon is required, install the upper beacon.
2. See Item 685, "Roadside Flashing Beacon Assemblies" for further requirements.
3. See SMD standard sheets for lateral and vertical clearances and sign mounting details. Install signs as shown on the sign layout sheets.
4. Use either a Screw-In Type Anchor Foundation or a Drilled Shaft Foundation as shown elsewhere in the plans. When plans require a Drilled Shaft Foundation, see standard sheet TS-FD. Install the Screw-In Type Anchor Foundation as per manufacturer's recommendations. On a slope, install one edge at ground level. Screw-In/Drilled Shaft Foundation is subsidiary to Item 685. Installation of a ground rod is not required for solar powered flashing beacon assemblies.
5. When used, provide Screw-In Type Anchor Foundations as shown on TxDOT's Material Producer List (MPL) in the file "Highway Traffic Signals".
6. Install beacon heads as shown here, as shown elsewhere on the plans, or as directed. Use hardware specifically designed for mounting beacon heads on poles.
7. Conduit in foundation and within 6 in. of foundation is subsidiary to the Item 685, "Roadside Flashing Beacon Assemblies."
8. Unless otherwise shown on the plans, pole shaft shall be one piece, Schedule 40 Aluminum pipe, ASTM B429 or B221 (Alloy 6061-T6 only). Aluminum conduit will not develop the necessary strength and will not be allowed.
9. Per manufacturer's recommendations, engage all threads on the pedestal pole base and pipe unless the pipe is fully seated into base. In high winds, use a pole and base collar assembly to add strength and prevent loosening of connection.
10. Provide single pole non-fused watertight breakaway electrical connectors for frangible pedestal pole bases, as shown on TxDOT's MPL in the file "Roadway Illumination and Electrical Supplies." Approved models are listed under Item 685. For ungrounded (hot) conductors, install a breakaway connector with a dummy fuse slug. For grounded (neutral) conductors, install a breakaway connector with a white colored marking and a permanently installed dummy fuse (slug).
11. Provide clearance as shown above the sidewalk or pavement grade at the edge of the road. When a bottom beacon is not used, mount the bottom of the sign at least 7 ft. above the sidewalk or pavement grade at the edge of the road.
12. Make connections to ground rods according to NEC. Ground rod clamps shall be listed for their intended purpose.
13. Ensure height of conduit and ground rod is below top of anchor bolts.

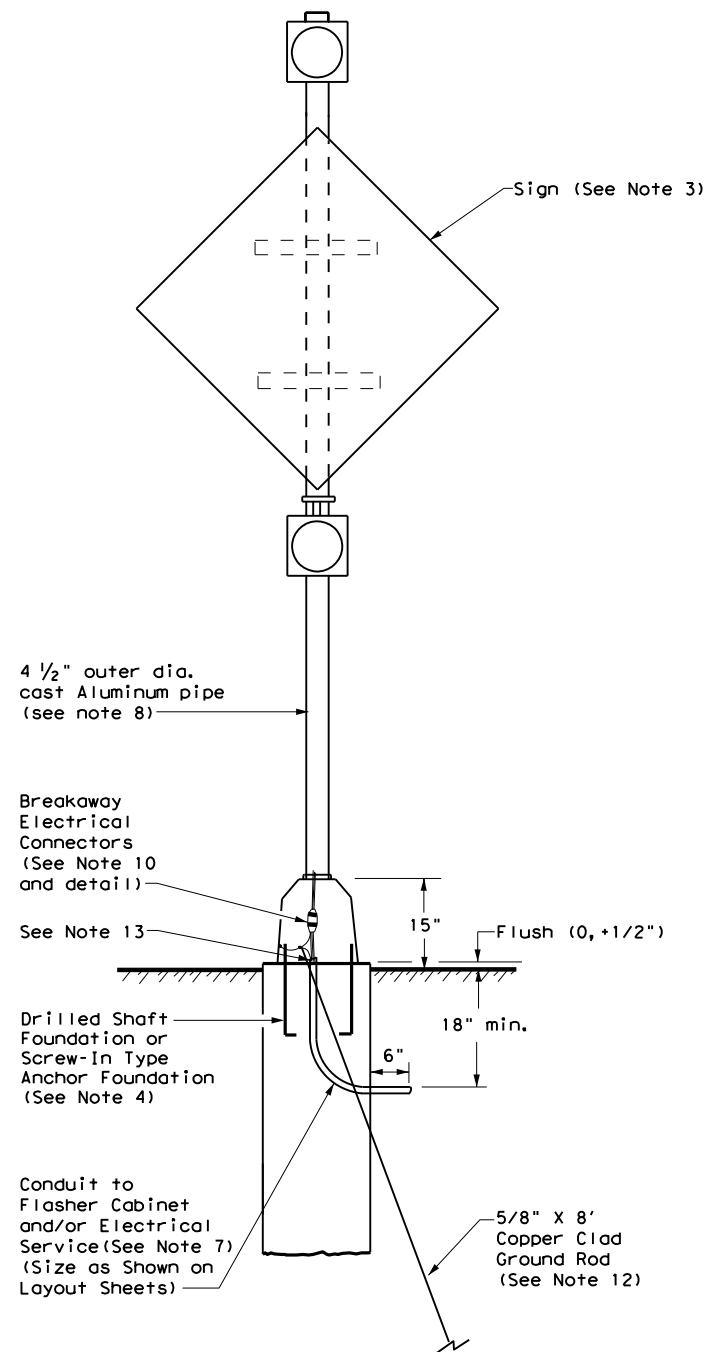


FRONT

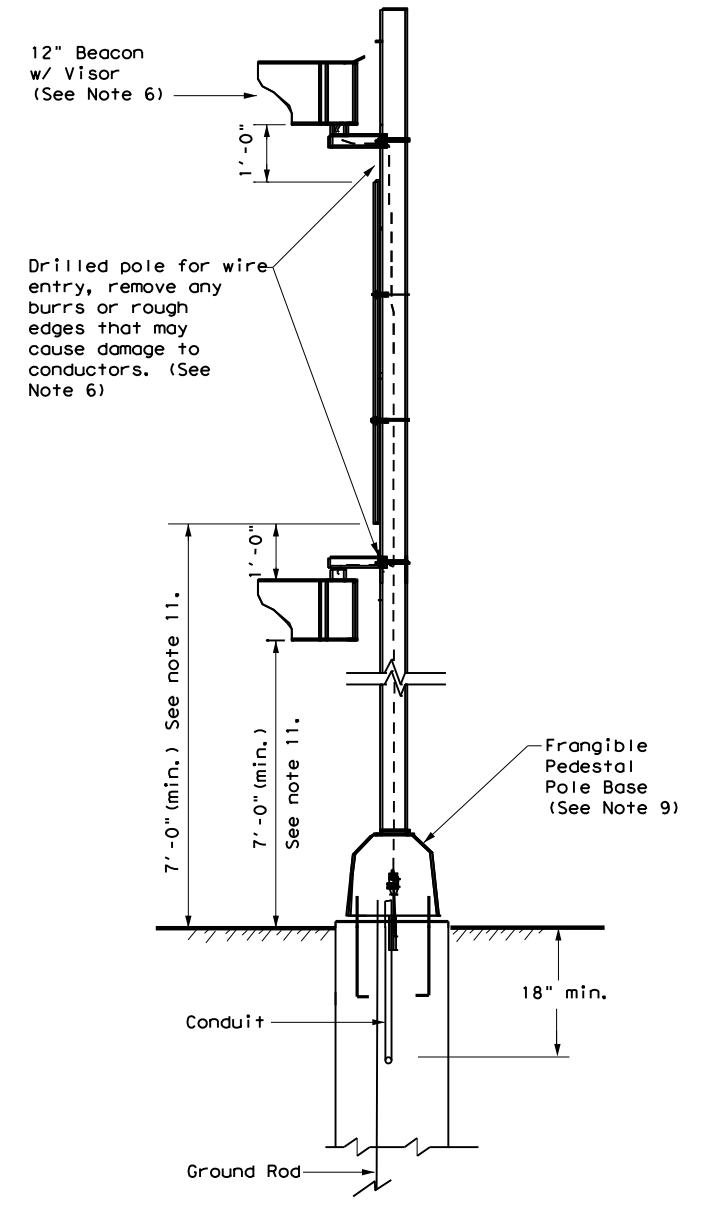

SIDE

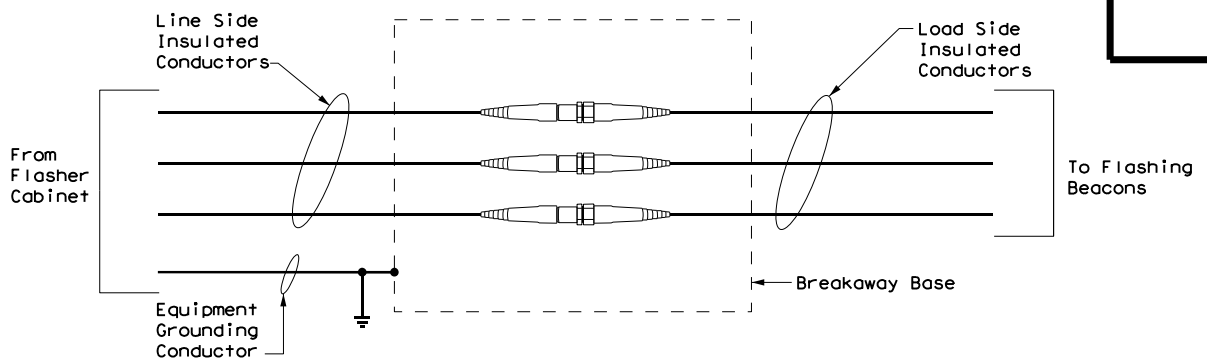

NON-FUSED BREAKAWAY ELECTRICAL CONNECTORS

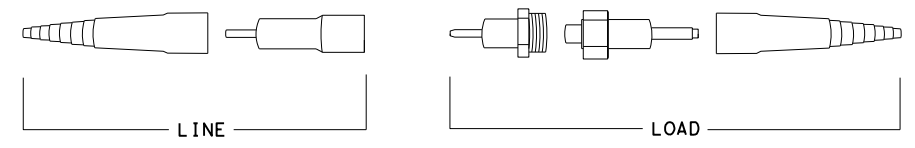

**NON-FUSED BREAKAWAY ELECTRICAL CONNECTORS
EXPLODED VIEW**

ROADSIDE FLASHING BEACON ASSEMBLY

RFBA-13

FILE: rfa-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT January 1992	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
5-93 12-04	DIST	COUNTY	SHEET NO.	
10-93 3-13	YKM	VICTORIA, ETC	59	
4-98				


DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

NOTES:


1. Pole, Ring, and Ring Support shall be assembled and erected so that Reference Line is parallel to center line of roadway or as shown on "Lighting Layouts" sheets.
2. Fixture Placement on ring shall provide a min. Clearance of 7" between Fixtures.

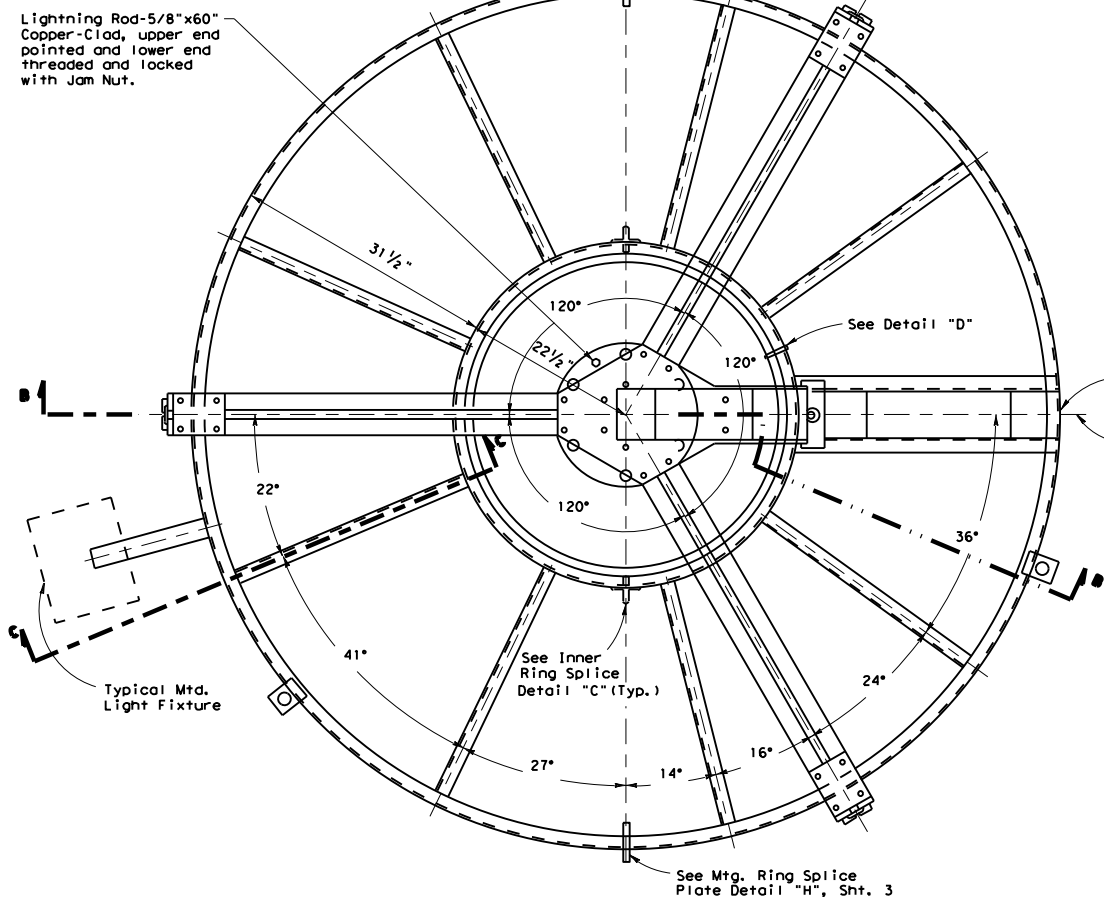

LIGHT MOUNTING RING & SUPPORT ASSEMBLY

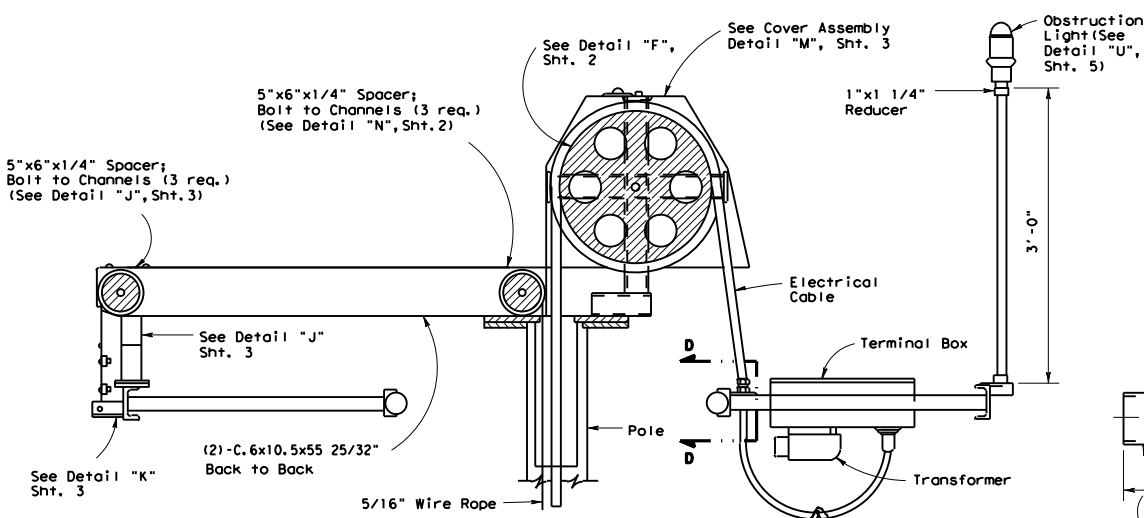


SECTION B-B

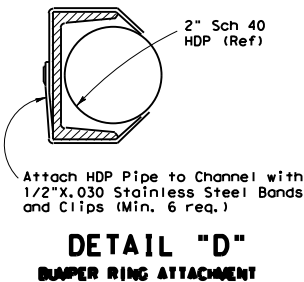


**DETAIL "D"
BUMPER RING ATTACHMENT**


Handhole Located on Reference Line. See Lighting Layout.
Reference Line (See Light Setting Diagrams)

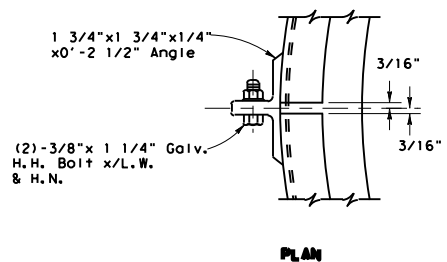

PLAN


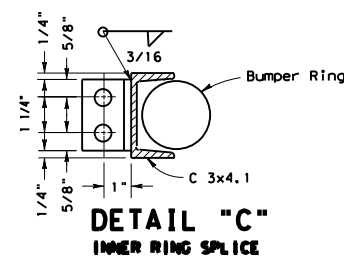


**DETAIL "C"
INNER RING SPLICE**

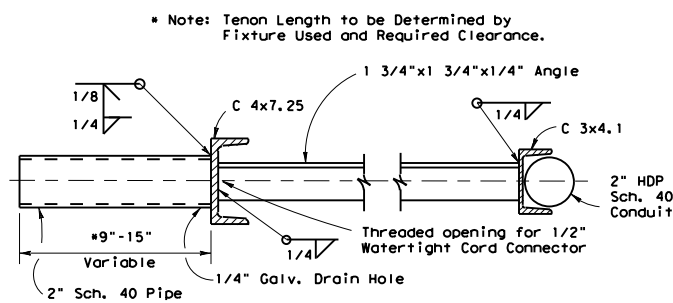


**SECTION C-C
(FOR AREAL LIGHTS)**

* As required by Trunnion Adapter supplied.

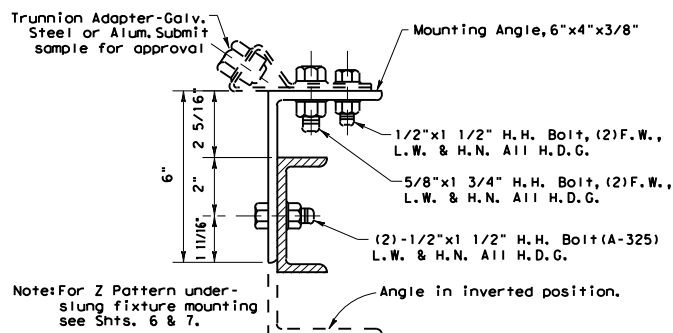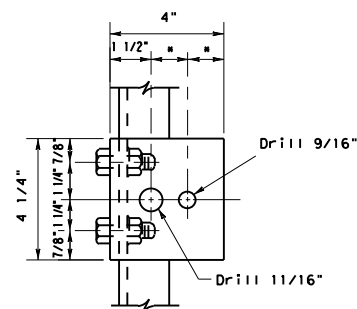


**SECTION C-C
(FOR TRUNNION MOUNT)**


NOTE: Provide S.S. or galv. cable safety lanyard for Light Fixture when Trunnion Mount is used.

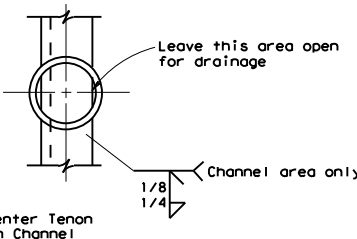


**SECTION C-C
(FOR FLOODLIGHTS)**

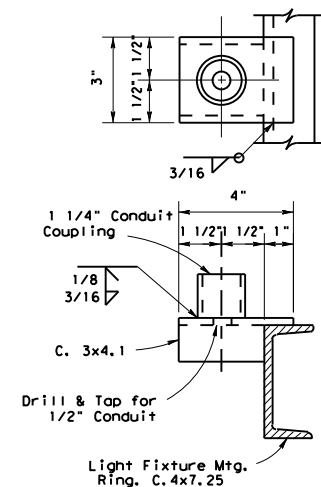

**DETAIL "E"
(CONDUIT ATTACHMENT FOR OBSTRUCTION LIGHTS, TYPICAL (3) PLACES)**

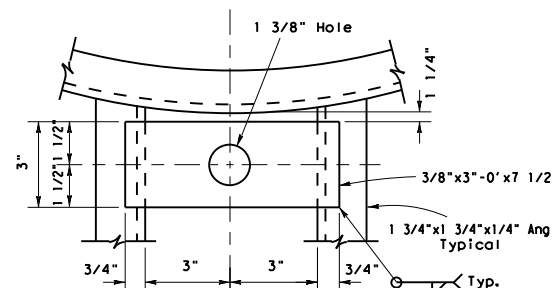

Note: Confirm Connector Size. Use 1\"/>

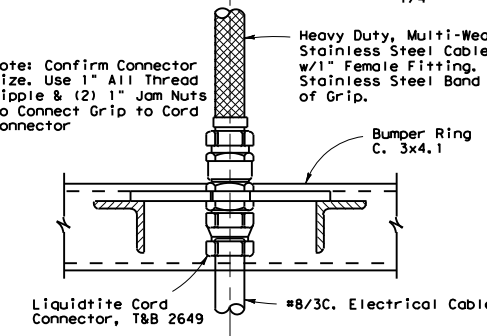

NOTE: COVER CORD WITH HEAT SHRINK TUBING FROM CABLE GRIP TO WITHIN ONE INCH OF GRIP TO CONNECTOR TRANSITION PRIOR TO INSTALLING CABLE GRIP.

Texas Department of Transportation
Traffic Operations Division


HIGH MAST ILLUMINATION DETAILS

HMID(1)-03


© TxDOT January 1986		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
5-86	REVISIONS	CONT	SECT	JOB	HIGHWAY
4-87	10-14-87	0088	05	110, ETC	US 59, ETC
5-87	4-96				
10-1-87		DIST	COUNTY		SHEET NO.
		YKM	VICTORIA, ETC		60

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

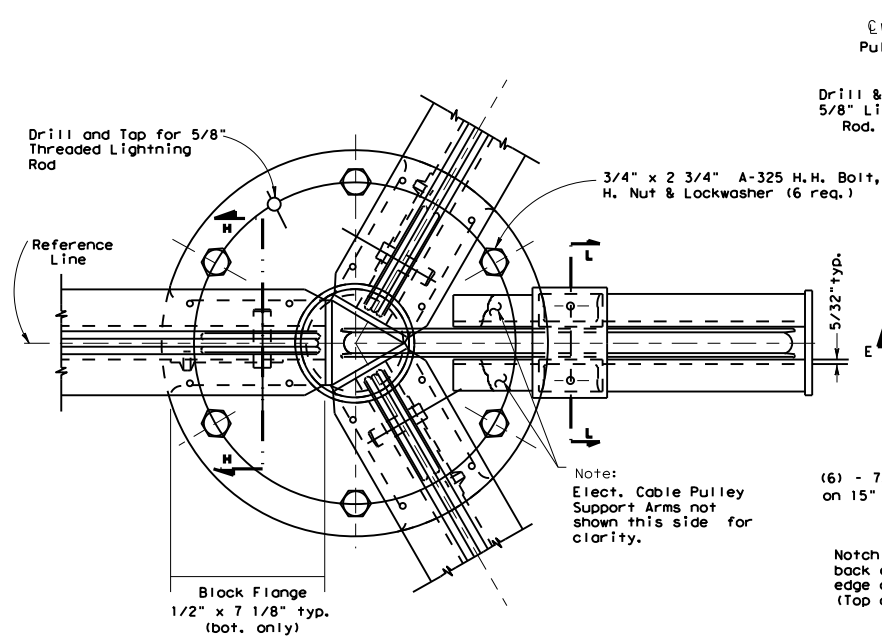


PLAN VIEW

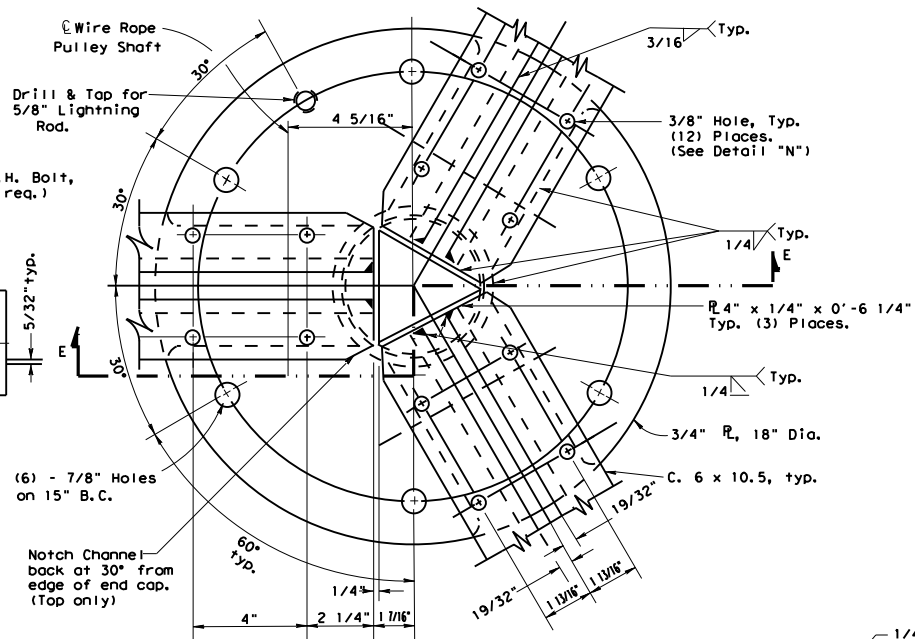


DETAIL "G"
TOP PLATE CONNECTION
(LESS ELECT. CABLE PULLEY SUPPORT)
(SEE DETAIL "L")

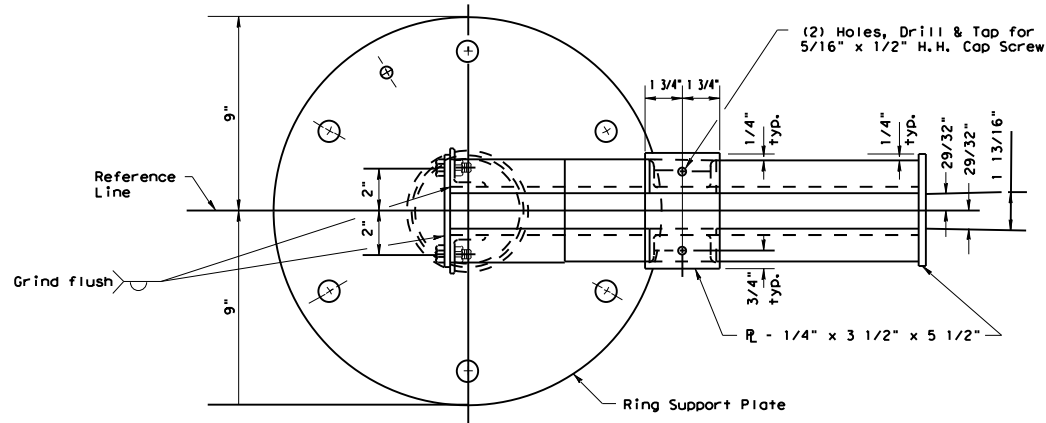


PLAN VIEW

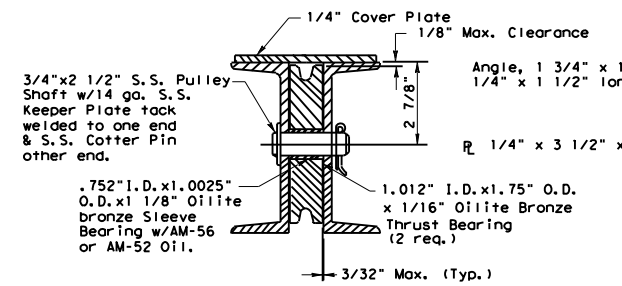


SECTION "H-H"
PULLEY MOUNTING FOR
RING SUPPORT ARMS

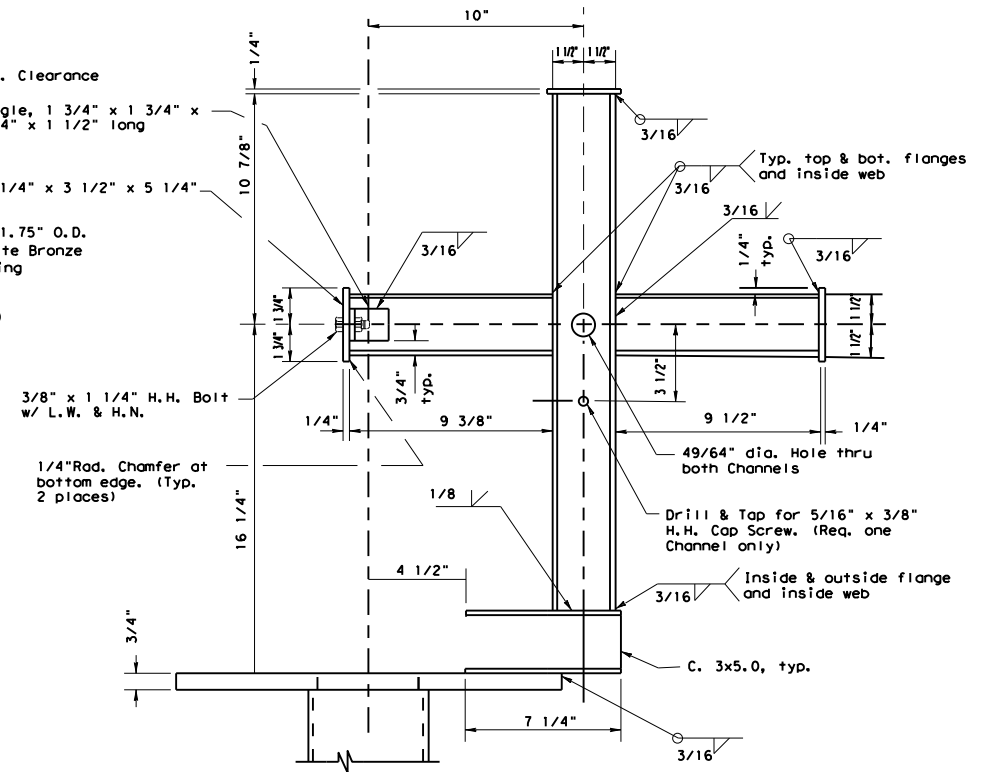


DETAIL "L"
ELECT. CABLE PULLEY SUPPORT
(RING SUPPORT ARMS NOT SHOWN FOR CLARITY)

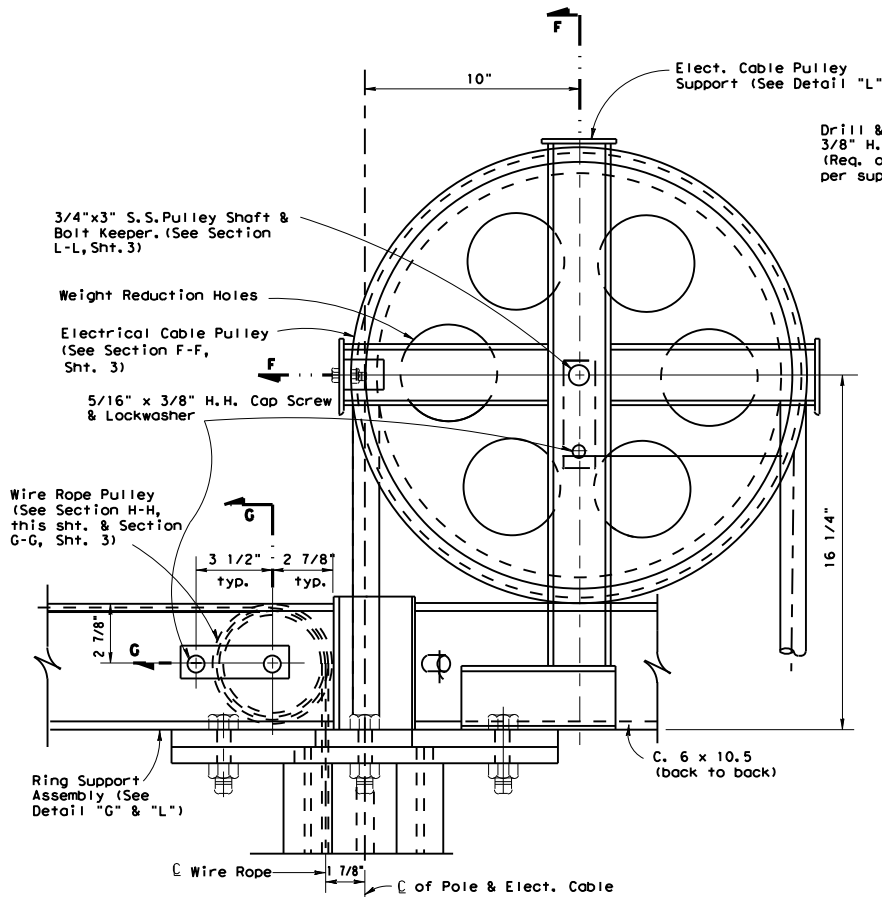

DETAIL "F"
RING SUPPORT ASSEMBLY
(NEAR SIDE SUPPORT ARM & ELECT. CABLE
PULLEY COVER NOT SHOWN FOR CLARITY)

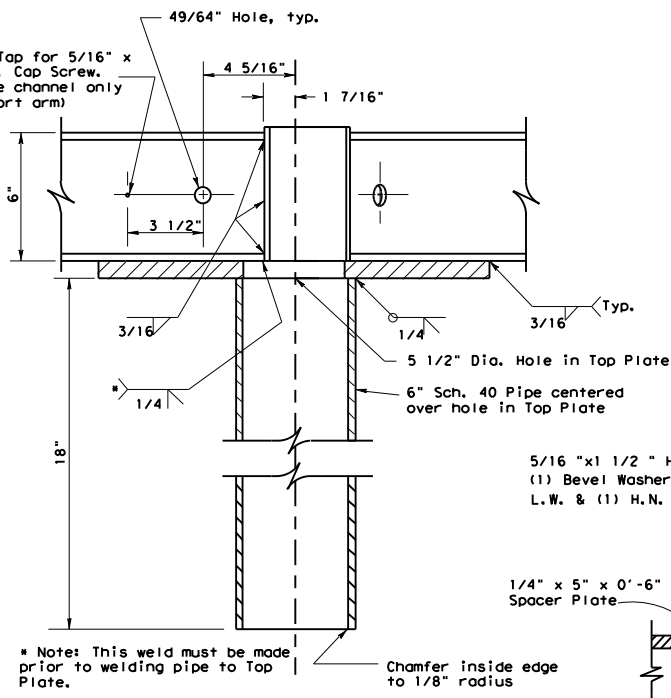

SECTION "E - E"

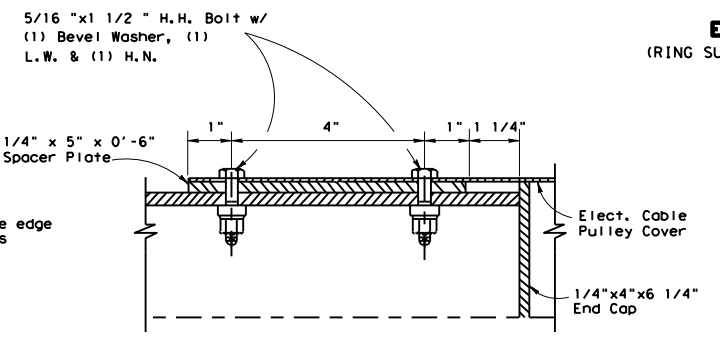

DETAIL "N"

Texas Department of Transportation
Traffic Operations Division


HIGH MAST
ILLUMINATION
DETAILS

HMID (2) -03


© TxDOT January 1986		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
4-86	REVISIONS	CON	SECT	JOB	HIGHWAY
5-86	4-96	0088	05	110, ETC	US 59, ETC
5-87		DIST	COUNTY		SHEET NO.
12-87		YKM	VICTORIA, ETC		61

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

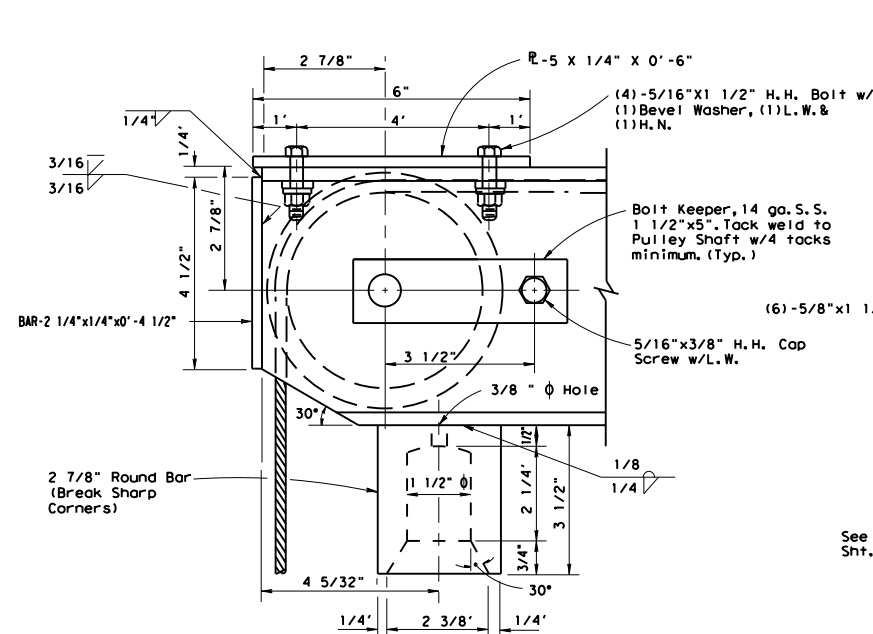


DETAIL "J"

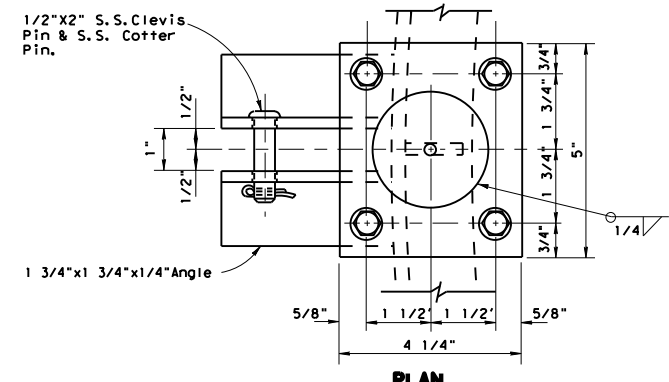


DETAIL "K"
MOUNTING RING CONNECTION & STABILIZER

* EXTRA 2'-0" of wire cable to be attached to ring with SS Bands as directed by Engineer.

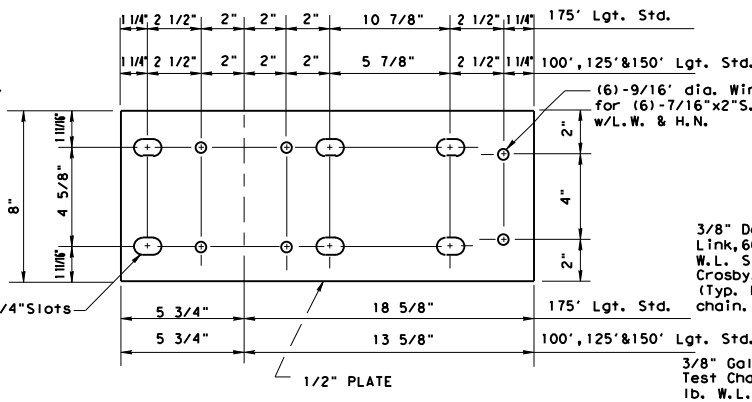


DETAIL "V"
WINCH MOUNTING PLATE


NOTE: Dimensions may vary-Verify with winch manufacturer.

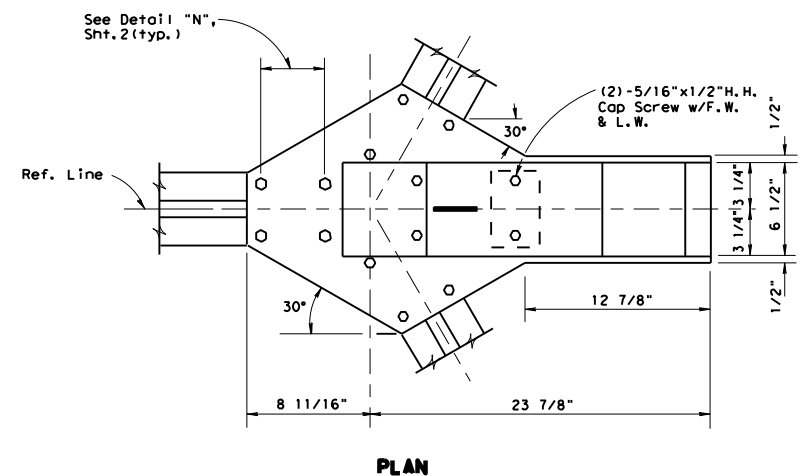

DETAIL "M"
COVER CAP ASSEMBLY

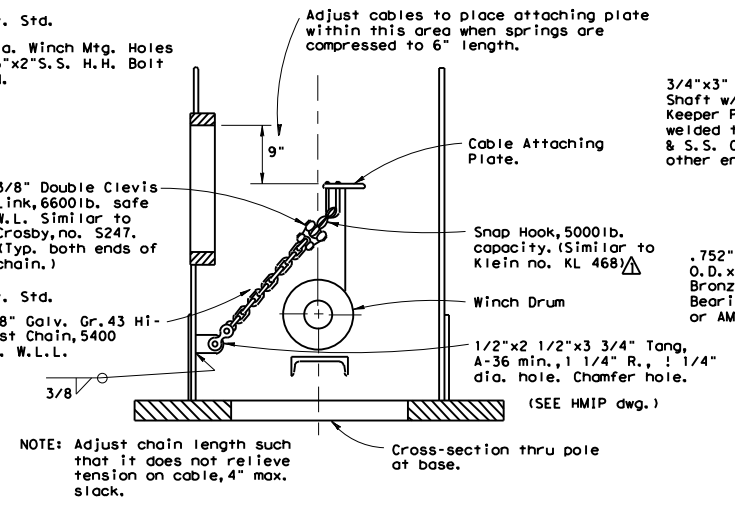


SAFETY LANYARD DETAIL

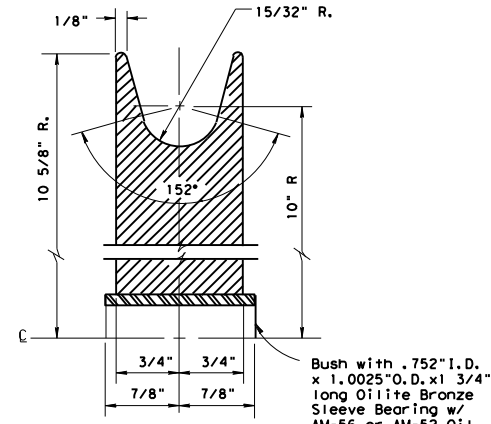


SECTION F-F
ELECTRICAL CABLE PULLEY

(Pulley material to be aluminum alloy, Type 356-T6 or equal)

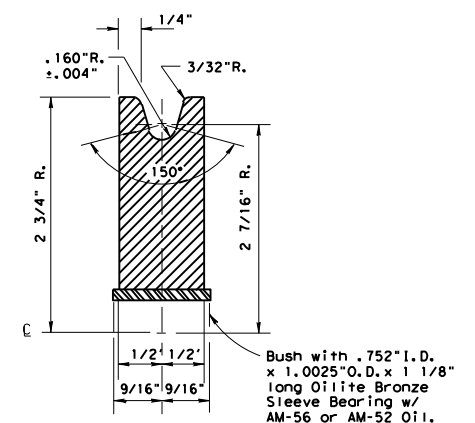


SECTION G-G
WIRE ROPE PULLEY


(Pulley material to be plated steel or Stainless Steel)

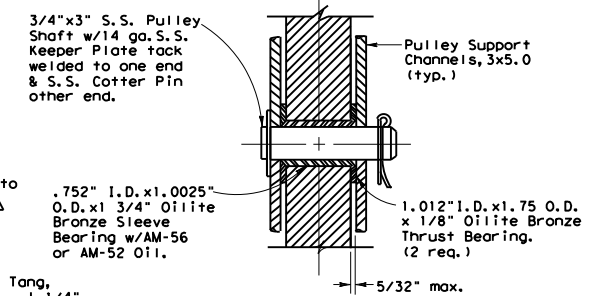

SECTION L-L
ELECTRICAL CABLE PULLEY MOUNTING

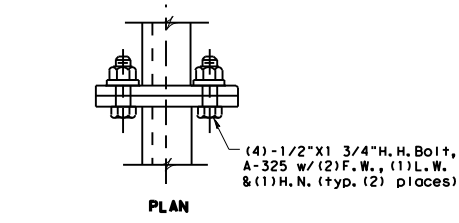

PLAN

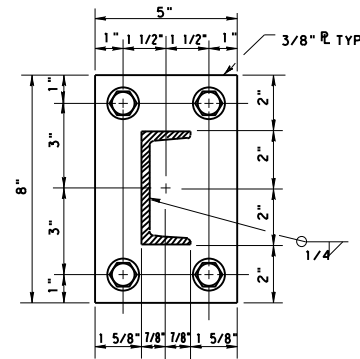

DETAIL "H"
MOUNTING RING SPLICE PLATE

Texas Department of Transportation
Traffic Operations Division



HIGH MAST ILLUMINATION DETAILS

HMID (3) - 03

© TxDOT January 1986		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
5-5-86	REVISIONS	CONTRACT	SECTION	JOB	HIGHWAY
5-10-86	4-96	0088	05	110, ETC	US 59, ETC
10-87		DIST	COUNTY		SHEET NO.
10-88		YKM	VICTORIA, ETC		62


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

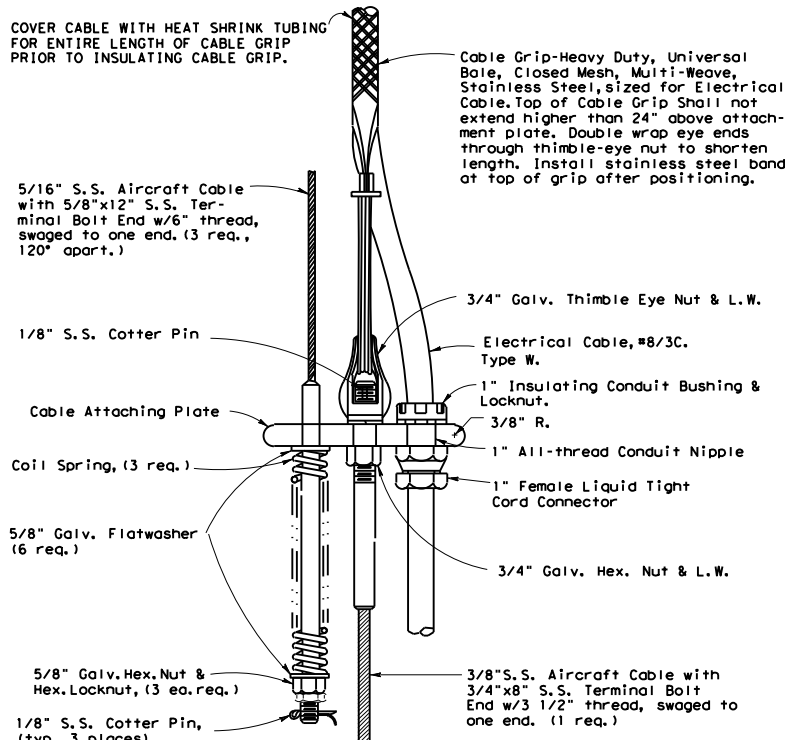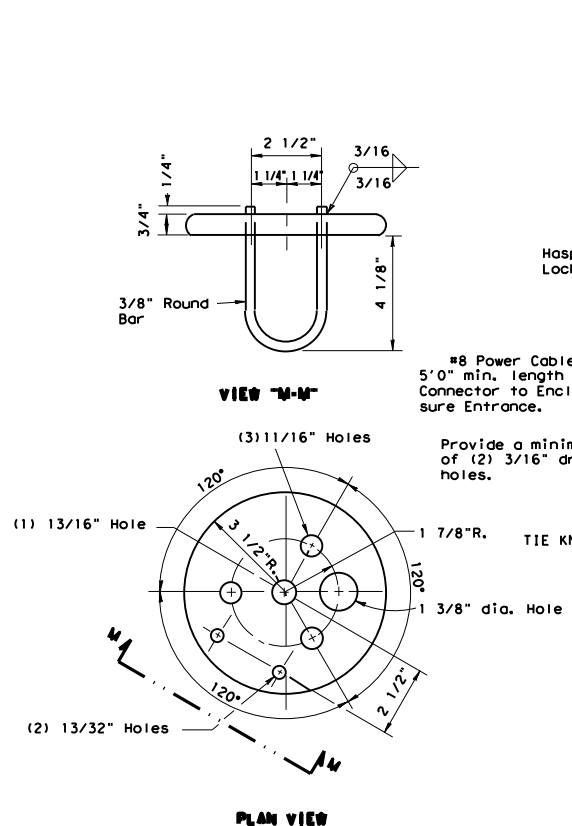


DETAIL "O"
(CABLE ATTACHING PLATE)

50 A 480V. Circuit Breaker, NEMA 4 for total lamp watts exceeding 9000, 30A, 480V. Circuit Breaker, NEMA 4 for 9000 or less total lamp watts. Enclosure shall be stainless steel, 14 ga., weatherproof with full length vertical door hinge, welded hasp, lock and two sets of keys. Hinge pin shall be tack-welded to prevent removal. Lock (Master # 2195) and keys shall be furnished by the contractor and shall be the same type as used for the service enclosures. Enclosure dimensions shall be approx. 20" high x 9" wide x 5" deep. Attach enclosure with (4) 1/4" S.S. Bolts & Nuts w/ 1/4" Spacers. Breakers are to be mounted on a dielectric mounting board or high voltage insulating paper.

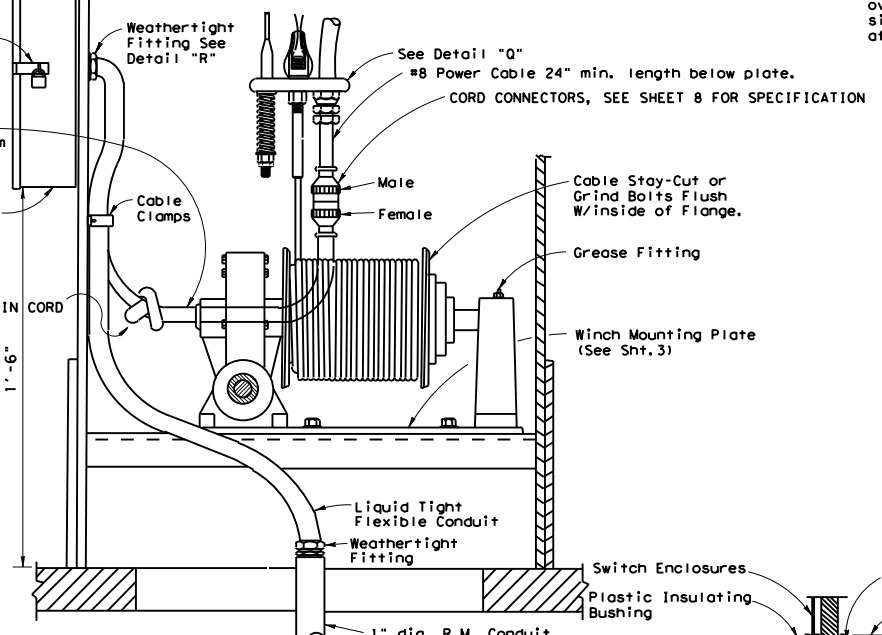

SECTION J-J
(WINCH ASSEMBLY)

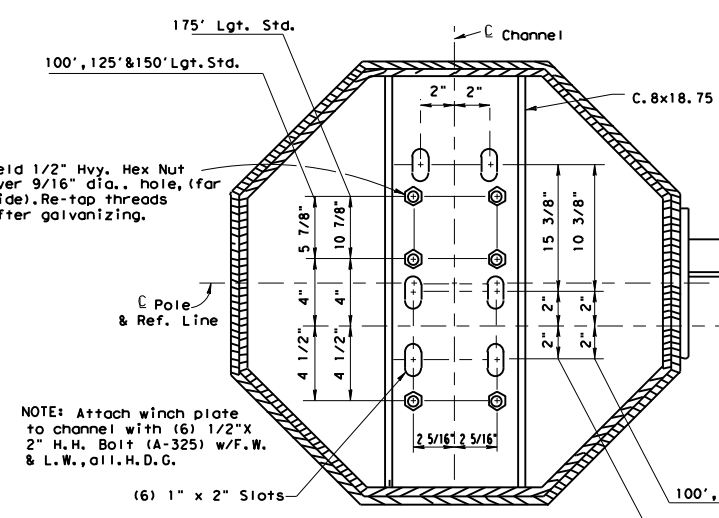

DETAIL "P"
(WINCH MOUNTING CHANNEL)
Dimensions may vary-Verify with winch manufacturer.



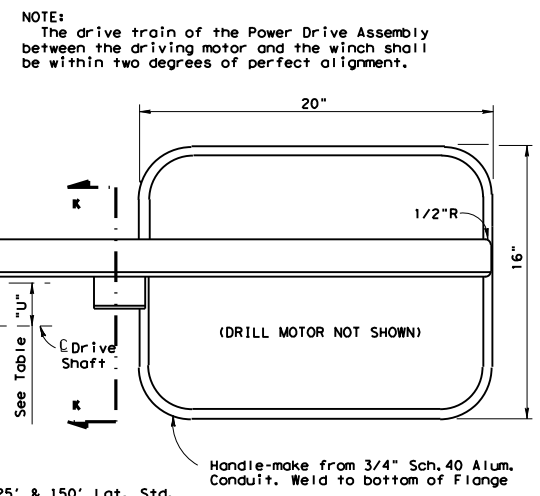


TABLE OF "U" DIMENSIONS


Pole Ht. Ft.	8 Sided 80 MPH	8 Sided 100 MPH	12 Sided 80 MPH	12 Sided 100 MPH
100	3 1/2"	3 1/2"	2 1/2"	2 1/2"
125	3 1/2"	3 1/2"	2 1/2"	2 1/2"
150	3 1/2"	3 1/2"	2 1/2"	2 1/2"
175	4 1/2"	4 1/2"	3 1/2"	3 1/2"




(POWER FEED FROM GROUND BOX)

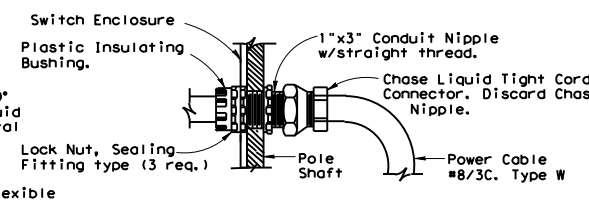


(POWER OUT TO LIGHT RING)

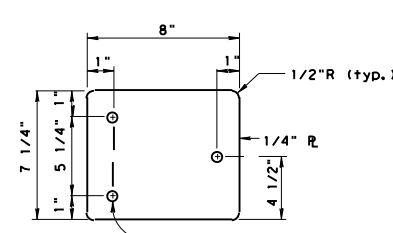

DETAIL "S"
(WINCH DRIVE ACCESS COVER)

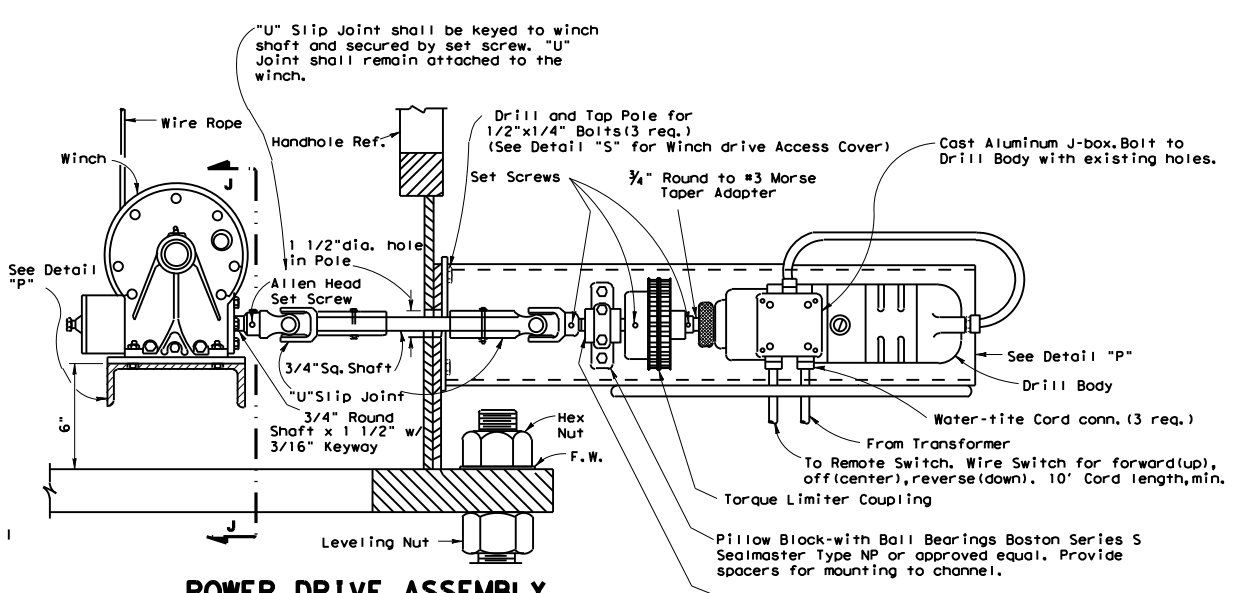

POWER DRIVE ASSEMBLY

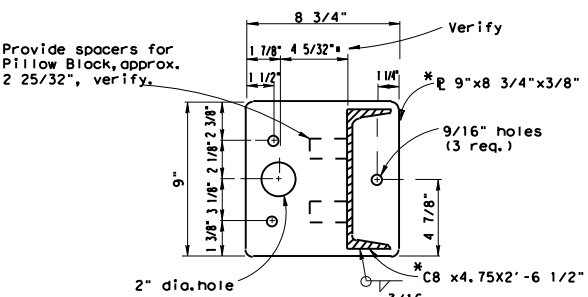

SECTION K-K
(DRILL MOTOR MOUNTING PLATE)
* Make from 6061-T6 Aluminum

Texas Department of Transportation
Traffic Operations Division





HIGH MAST ILLUMINATION DETAILS

HMID (4) -03



© TxDOT January 1986		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
4-86	REVISIONS	CON	SECT	JOB	HIGHWAY
5-86	12-87	0088	05	110, ETC	US 59, ETC
12-3-86	4-89	DIST	COUNTY		SHEET NO.
12-8-86	10-93	YKM	VICTORIA, ETC		63

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

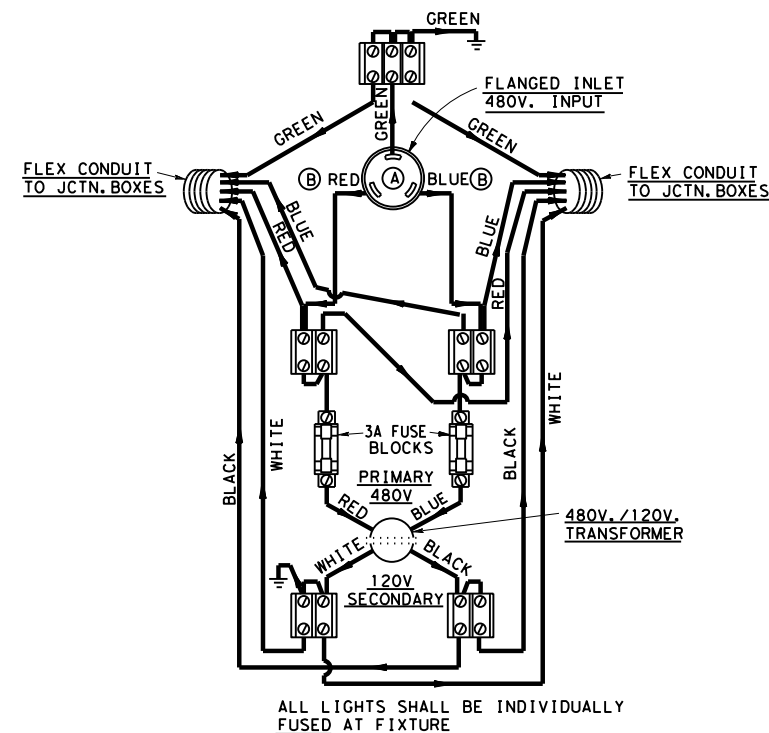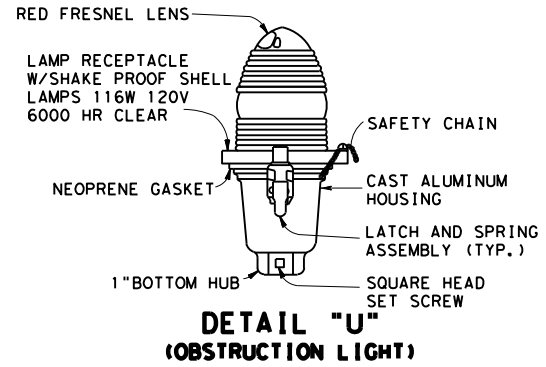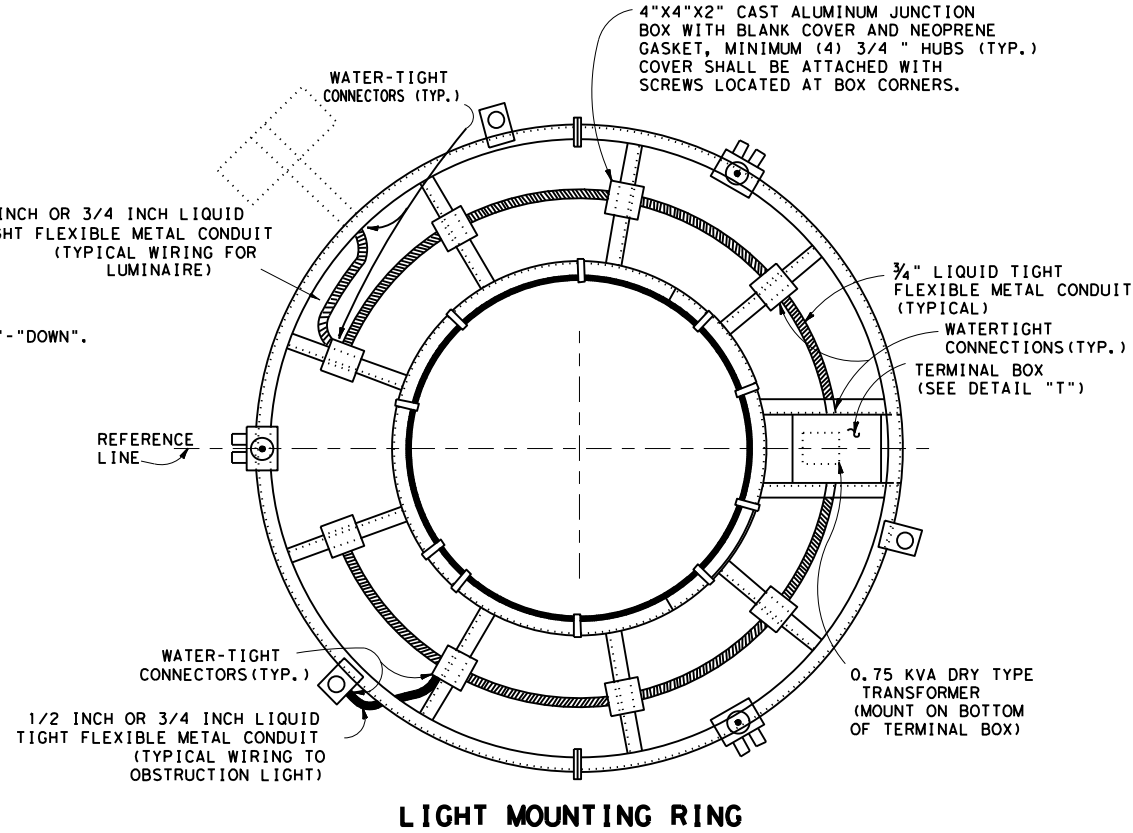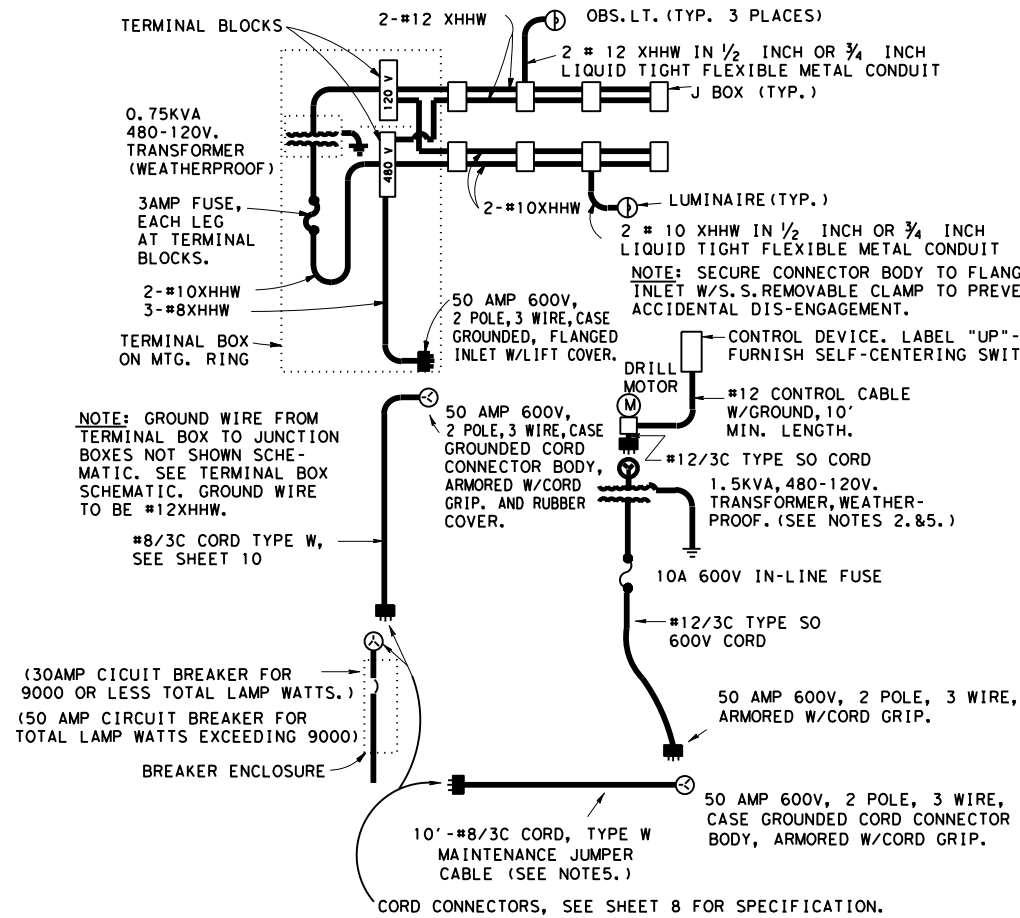

- NOTES:
1. OBSTRUCTION LIGHTS COLOR CODE: FROM SECONDARY SIDE OF TRANSFORMER THROUGH-OUT-CIRCUIT TO SOCKET, WHITE-NEUTRAL, BLACK-LOAD.
 2. POWER SUPPLY CORD TO FLANGED INLET: GREEN-GROUND, WHITE LINE, BLACK LINE. FROM FLANGED INLET (A) TO TERMINAL BLOCKS: GREEN-GROUND, RED LINE, BLUE-LINE. FROM THERE ON ALL 480V. CIRCUIT WIRES TO BE RED AND BLUE TO JUNCTION BOXES.
 3. WIRE SIZE FROM POWER SUPPLY TO TERMINAL BLOCKS SHALL BE #8 AWG-SEE (B).
 4. WIRE SIZE FROM TERMINAL BLOCKS TO JUNCTION BOXES SHALL BE #12 AWG.
 5. MOUNT TERMINAL BLOCKS ON 3/4" EXTERIOR GRADE PLYWOOD.
 6. FOR 2-WIRE, 480V. SERVICE, OMIT FUSE IN GROUNDED CONDUCTOR IN LEADS TO TRANSFORMER.

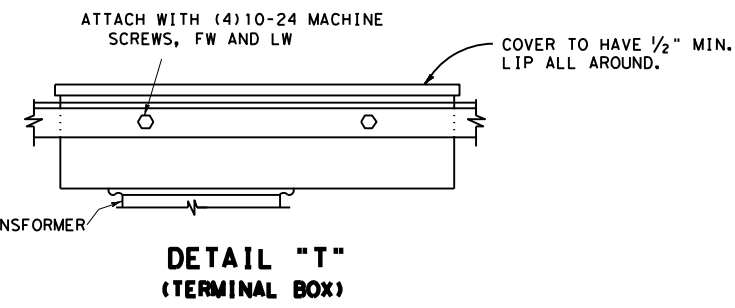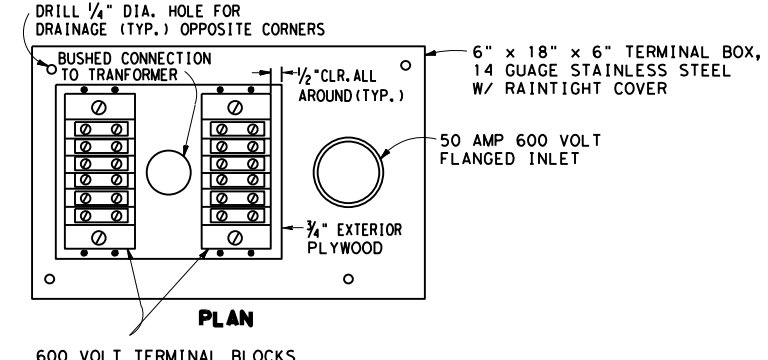

- NOTES:
1. PLUGS, CONNECTOR BODIES AND FLANGED INLETS AT CORD TO RING CONNECTION SHALL BE "TWIST LOCK" TYPE, 3-PRONG, RATED 50 AMPS AT 600V, AND 20 AMPS FOR 120 V. 50 AMP CONNECTORS SHALL BE 3 WIRE CASE GROUNDED, ARMORED, WITH CORD GRIP, 20 AMP CONNECTOR SHALL BE 3 WIRE GROUNDING WITH CORD GRIP, NEMA TYPE L5-20.
 2. PROVIDE HANDLE ON 1.5KVA TRANSFORMER FOR PORTABILITY. (SEE ONE-LINE SCHEMATIC)
 3. CIRCUIT BREAKERS SHALL BE ITE #E43B030 OR #E43B050, SQUARE "D" #FAL24030 S/N OR #FAL24050 S/N, OR EQUAL.
 4. CONDUIT ENTRIES INTO TERMINAL BOX SHALL BE INTO THE SIDE OF THE BOX.
 5. A MINIMUM OF ONE (1) MAINTENANCE JUMPER CABLE SHALL BE SUPPLIED FOR EACH PROJECT. SUPPLY ONE (1) PORTABLE TRANSFORMER FOR EACH POWER DRIVE UNIT REQUIRED FOR PROJECT.

Texas Department of Transportation
Traffic Operations Division

HIGH MAST ILLUMINATION DETAILS


HMID (5) -03

© TxDOT January 1986		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
6-87	REVISIONS	CONTRACT	SECTION	JOB	HIGHWAY
11-87	4-96	0088	05	110, ETC	US 59, ETC
10-88		DIST	COUNTY		SHEET NO.
10-93		YKM	VICTORIA, ETC		64

76E

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

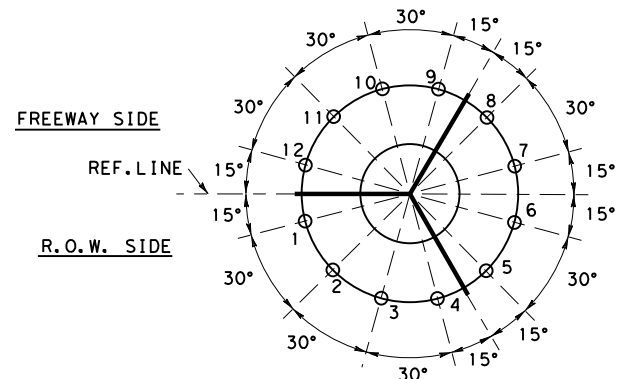

12-LIGHT SETTING


LUMINAIRE LOCATIONS

NOTE: AIRCRAFT OBSTRUCTION LIGHT LOCATIONS NOT SHOWN. THREE ARE REQUIRED LOCATED APPROX. 120° APART. LOCATIONS WILL VARY DEPENDENT ON THE LIGHT SETTING USED.

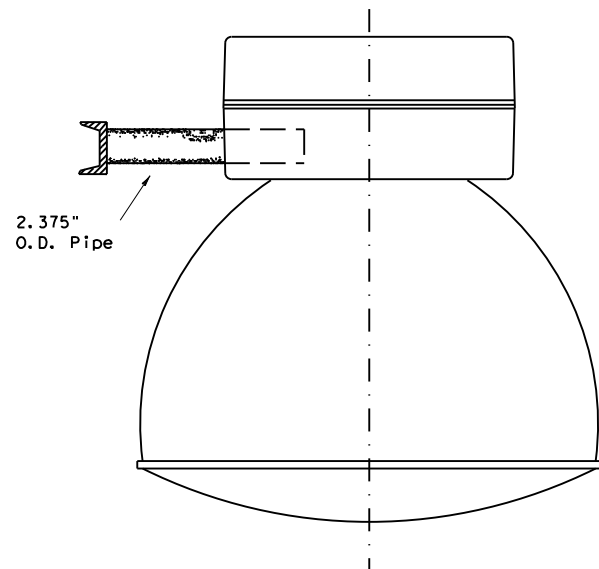


**AREALIGHT MOUNTING ASSEMBLY
(SYMMETRIC AND ASYMMETRIC)**

NOTES: IF ASYMMETRIC FIXTURES ARE USED, THE REFRACTORS SHALL BE ORIENTED TO PROPERLY ILLUMINATE THE ADJACENT ROADWAYS. ORIENTATION SHALL BE AS SHOWN IN PLANS.

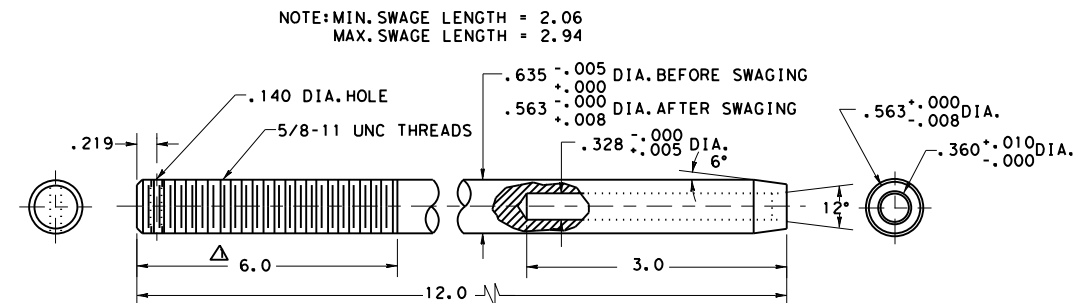

NOTE: MIN. SWAGE LENGTH = 2.06
MAX. SWAGE LENGTH = 2.94

TERMINAL FOR 3/8" WIRE ROPE
MATERIAL: STAINLESS STEEL, TYPE 303SE OR 304
WITH 115,000 P. S. I. MAX. ULTIMATE TENSILE STRENGTH.

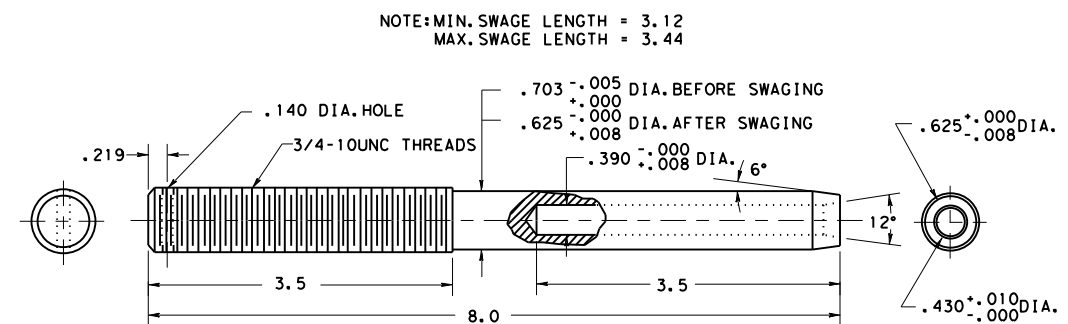

NOTE: MIN. SWAGE LENGTH = 3.12
MAX. SWAGE LENGTH = 3.44

TERMINAL FOR 3/8" WIRE ROPE
MATERIAL: STAINLESS STEEL, TYPE 303SE OR 304
WITH 115,000 P. S. I. MAX. ULTIMATE TENSILE STRENGTH.

GENERAL NOTES:

1. AFTER FINAL AIMING HAS BEEN COMPLETED AND APPROVED BY THE ENGINEER, FIXTURES MUST BE LOCKED IN POSITION. CONTRACTOR MUST SUBMIT PROPOSED LOCKING SCHEME WITH THE FIXTURE SUBMITTAL. (FLOODLIGHTS ONLY).

3/03 Revision



Removed obsolete diagrams and updated drawings.

Texas Department of Transportation
Traffic Operations Division

**HIGH MAST
ILLUMINATION
DETAILS**

HMID (6) -03

© TxDOT January 1986		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
10-93	REVISIONS	CONT	SECT	JOB	HIGHWAY
10-95		0088	05	110, ETC	US 59, ETC
4-96		DIST		COUNTY	SHEET NO.
3-03		YKM		VICTORIA, ETC	65

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$



1. AREA LIGHTING (Bid under Item 614, "High Mast Illumination Assemblies")

A. Area lighting shall be symmetric or asymmetric, as shown on the descriptive code. The number and wattage of the fixtures on each pole shall be as shown on the lighting layouts. The lighting pattern for symmetric fixtures shall be IES Type V; for asymmetric fixtures, it shall be IES Type II, III, or IV.

B. All luminaires shall be pre-qualified before installation. A sample of each type of luminaire to be considered for pre-qualification shall be submitted to TxDOT's Traffic Operations Division - Traffic Engineering Section (TRF-TE).

Traffic Operations Division - TE
 Texas Department of Transportation
 125 East 11th Street
 Austin, TX 78701-2483

Sample luminaires are non-returnable. A list of pre-qualified luminaires may be obtained by contacting TRF-TE. In addition, luminaires will be sampled and tested in accordance with Item 614. Luminaires that inconsistently pass testing or that are inconsistent with published photometric information will be removed from the pre-qualified list at the discretion of the Engineer. Once a fixture has been approved, no changes shall be made in any material or manufacturing methods without prior approval of the Department. Unapproved changes will result in rejection of all fixtures.

C. Symmetric and Asymmetric fixtures shall meet the following requirements unless otherwise approved by the Engineer:

1. Luminaire Construction

a) The luminaire housing shall be formed, cast or drawn from low copper aluminum and shall be free of cracks and excessive porosity. Formed aluminum shall have a minimum thickness of 0.090, and shall have all seams welded. The minimum thickness of cast parts shall be as approved by the Engineer. Nuts, screws, and washers shall be made of Type 316 stainless steel. The housing shall be marked with minimum 2" letters to indicate the photometric type as being either A, B, C, or S as specified. Marking shall be permanent and shall be by stencil or stick on labels similar to "wattage" label on cobra heads. Wattage label will not be required on high mast fixtures. The fixture housing shall be constructed separate from the fixture reflector.

b) Fixtures shall be natural aluminum in color or shall be painted gray.

c) The slipfitter shall securely attach the luminaire to the tenon on the ring assembly with a minimum of 2 bolts and clamp. A positive means of vertical adjustment shall be provided.

d) For optical assemblies with lenses, reflectors shall be polished aluminum with Alzak or equal coating and shall not be painted. The optic assembly shall be sealed. The lens shall be tempered glass or prismatic glass, either flat or sag. The optic assembly shall be provided with a resilient seamless or sonically welded silicone rubber gasket, and constructed so that a positive seal against weather and other contaminants will be maintained. The latches shall be stainless steel, spring loaded, and hand operated (2 latches minimum, 3 attachment points), and shall provide a positive means of maintaining closure of the luminaire.

e) For optical assemblies without lenses, optical assembly shall consist of an open ventilated borosilicate glass reflector. The reflecting prisms shall be protected from dirt depreciation by a spun on hermetically sealed aluminum cover. There shall be no glass lens/refractor on this optical assembly.

f) Asymmetric fixtures shall have field rotatable optics with accurate degree of rotation markings. Reflector shall have "house side" and "street side" markings.

g) The socket shell shall be nickel plated and shall be rigidly attached to a high grade porcelain mogul base, which shall extend and enclose the metal shell. A locking means shall be incorporated in the shell of the socket to positively resist the removal of the lamp. This locking means shall be a spring loaded center tip. Lamp socket shall be non-adjustable and shall be riveted, welded, or otherwise permanently installed. Lamps shall be held securely in the proper position with a lamp support.

h) The terminal block shall use nickel plated brass connectors.

i) Fixture weight including ballast shall not exceed 80 pounds, and effective projected area (EPA) shall not exceed 2.62 square feet.

j) The Contractor may be responsible for fixture testing costs. See TxDOT's "Manual of Testing Procedures," Chapter 11 - "Traffic Systems and Illumination," TEX-1110-T - "Sampling Lighting Assemblies," at <http://manuals.dot.state.tx.us/dynaweb/>.

2. Photometrics

a) The Contractor shall submit a computer generated light level array of the area to be lighted by high mast poles. All computer generated arrays shall have 400 watt fixtures derated to 40,000 lumens per lamp.

b) The Type "A" 400 watt asymmetric fixture shall be IES cutoff. The Department will use the measured photometric data of sampled fixtures to run the following tests on a computer simulation:

(1) When mounted in the level position, 50 ft. above the midpoint and 20 ft outside of either long side of a rectangular area measuring 340 ft. by 50 ft., the fixture shall pass the following tests:

(a) The fixture shall provide a measured minimum intensity of 0.15 horizontal foot-candles at any point on the surface of this area.

(b) The fixture shall provide a measured maximum to minimum light ratio, based on horizontal foot-candles, of less than 25.

(c) The fixture shall provide an average measured intensity of 0.6 horizontal foot-candles on the surface area.

(2) When mounted in the level position, 50 ft. above the midpoint and 20 ft outside of either long side of a rectangular area measuring 260 ft. by 30 ft., the fixture shall provide a measured minimum intensity of 0.30 horizontal foot-candles at any point on the surface of this area.

c) The Type "B" 400 watt asymmetric fixture shall be IES cutoff. The Department will use the measured photometric data of sampled fixtures to run the following tests on a computer simulation:

(1) When mounted in the level position, 50 ft. above the midpoint and 20 ft outside of either long side of a rectangular area measuring 260 ft. by 65 ft., the fixture shall pass the following tests:

(a) The fixture shall provide a measured minimum intensity of 0.15 horizontal foot-candles at any point on the surface of this area.

(b) The fixture shall provide a measured maximum to minimum light ratio, based on horizontal foot-candles, of less than 25.

(c) The fixture shall provide an average measured intensity of 0.6 horizontal foot-candles on the surface area.

(2) When mounted in the level position, 50 ft. above the midpoint and 20 ft outside of either long side of a rectangular area measuring 200 ft. by 40 ft., the fixture shall provide a measured minimum intensity of 0.30 horizontal foot-candles at any point on the surface of this area.

d) The Type "C" 400 watt asymmetric fixture shall be IES cutoff. The Department will use the measured photometric data of sampled fixtures to run the following tests on a computer simulation:

(1) When mounted in the level position, 50 ft. above the midpoint and 20 ft. outside of either long side of a rectangular area measuring 220 ft. by 80 ft., the fixture shall pass the following tests:

(a) The fixture shall provide a measured minimum intensity of 0.15 horizontal foot-candles at any point on the surface of this area.

(b) The fixture shall provide a measured maximum to minimum light ratio, based on horizontal foot-candles, of less than 25.

(c) The fixture shall provide an average measured intensity of 0.6 horizontal foot-candles on the surface area.

(2) When mounted in the level position, 50 ft. above the midpoint and 20 ft. outside of either long side of a rectangular area measuring 160 ft. by 50 ft., the fixture shall provide a measured minimum intensity of 0.30 horizontal foot-candles at any point on the surface of this area.

e) The Type "S" 400 watt Symmetric fixture shall be IES cutoff. The Department will use the measured photometric data of sampled fixtures to run the following tests on a computer simulation:

(1) When mounted in the level position at 50 foot mounting height, the fixture shall provide the minimum light levels as shown below:

(a) 0.15 horizontal foot-candles within a 130 foot radius.

(b) 0.30 horizontal foot-candles within a 100 foot radius.

(c) 0.50 horizontal foot-candles within a 60 foot radius.

3. Ballasts

a) All ballasts shall be isolated-winding lag-type magnetic regulators designed to operate 400 watt high pressure sodium lamps rated 480 volts. Ballasts shall be capable of starting lamps at an ambient temperature of -20 degrees F. Ballast wiring shall include a grounding terminal bonded to metal housing. Ballasts shall be fused with a 5 amp time-delay fuse in an insulated fuse holder. Fuse holders shall be internal to the housing. Ballast wiring to the terminal board shall be through a quick-disconnect plug. Windings shall be made from copper wire.

b) When the circuit voltage indicated on the plans is applied, the ballast input wattage during fluctuations of the test voltage of +10% and -10% shall not exceed 552 watts for a 400 watt HPS lamp.

3/03 Revision



Revised Area Lighting Requirements

Texas Department of Transportation
Traffic Operations Division

HIGH MAST ILLUMINATION DETAILS

HMID(7) -03

© TxDOT January 1986		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
9-91	REVISIONS	CONT	SECT	JOB	HIGHWAY
10-93		0088	05	110, ETC	US 59, ETC
4-96		DIST		COUNTY	SHEET NO.
3-03		YKM		VICTORIA, ETC	66

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
FILE: \$FILES\$

- c) During fluctuation of the line voltage of +10% or -10%, the lamp wattage fluctuation shall not exceed a total of 20%. Ballast shall maintain lamp wattage between 280 and 475 watts for a 400 watt HPS lamp.
- d) The power factor of any ballast when tested at the circuit voltage indicated in the plans shall not be less than 90% at any point in life. Ballast factor shall be between .95 and 1.0.
- e) The electronic starting aid shall provide a starting pulse with an amplitude of 2500 volts minimum, 4000 volts maximum. The pulse width shall be a minimum of 0.8 microseconds at 2250 volts. The pulse shall occur when the open-circuit voltage is equal to or greater than 90 percent of peak open-circuit voltage. Pulse repetition rate shall be a minimum of one per cycle and pulse current shall be a minimum of 0.18 amperes. Electronic starting aids shall be replaceable without the use of tools. The starting aid shall discontinue to pulse when the lamp starts. Starter shall sense an inoperative or missing HPS lamp and automatically shut down luminaire to protect ballast after 10 minutes.
- f) Ballasts shall permanently and clearly indicate the following: lamp type, catalog number, voltage rating, connection diagram, and manufacturer. Capacitors in all luminaires shall be non-PCB type.

4. Lamps

- a) All lamps shall be new and of recent manufacture.
- b) Lamps shall be high pressure sodium and shall meet ANSI C78 requirements. Lamps shall be the type that extinguish at the end of usable lamp life and remain extinguished without cycling. 400 watt lamps shall contain less than 4.0 mg of mercury. Lamps shall be lead free and shall pass the Federal Toxic Characteristic Leachate Procedure (TCLP). Lamp shall be Osram-Sylvania LU400/Eco Plus. No alternatives will be approved.
- c) 400 watt high pressure sodium lamps shall have average initial lumens of 50000 and average rated life of 24000 hours.

2. GENERAL

- A. All material shall be in accordance with the applicable sections of the NEC. All conduit and conductors shall be in accordance with the materials and construction methods requirements of Items 618 and 620. Heat shrink tubing for use with cable grips and cable splicing shall meet the requirements of Item 620.
- B. Where stainless steel bands are called for on the HMID sheets, stainless steel hose clamps may be provided. Stainless steel bands and stainless steel hose clamps shall be provided with stainless steel clips or stainless steel screws.

C. Obstruction Lights

- 1. When obstruction lights are required by layout sheets, summary sheets or general notes, the entire high mast assembly shall be controlled by an FAA approved photocell mounted inside the service enclosure. Ring mounted luminaires shall be controlled by up to 4 additional ring mounted photocells, with each photocell controlling up to 3 fixtures. Photocells shall meet the following requirements:
 - a) All photocells shall consist of a photoelectric cell, an internal lightning arrester, and a relay or bimetallic switch mounted inside a weather proof enclosure with standard 3-prong twist lock photocell plug and receptacle. The enclosure shall be made of poly-acrylic with clear acrylic window. Enclosure chassis shall be molded thermosetting plastic. The photocell shall have an arrester rated 2.0kV sparkover with 5000 amps follow-through. Relay or switch shall be time delay type with normally closed contacts. Photocell shall be rated a minimum of 1800 VA.
 - b) Service enclosure mounted photocell (FAA photocell) shall turn on at light levels below 35 foot-candles and off at levels above 58 foot-candles, in accordance with FAA requirements. This photocell shall be rated for operation at 240 volts. A permanent placard shall be installed on the inside of the service enclosure door to indicate that an FAA approved photocell is required.
 - c) High mast assembly ring mounted photocells (one foot-candle photocells) shall turn on at light levels below 1.0 (plus or minus 0.5) foot-candle, and shall turn off at 2 foot-candles higher than this level. These photocells shall be rated for operation at 480 volts. Photocells shall be mounted upright on the terminal box or on various junction boxes around the ring as approved by the Engineer. Conduit entries shall not be made into the top of the terminal box or junction boxes. The Contractor shall submit mounting details to the Engineer for approval.

2. When obstruction lights are not required, eliminate the 3 obstruction light fixtures, 3 mounting posts, 480/120 volt transformer, 120 volt wiring, and 3 mounting post support connections shown on detail "E", sheet 1.

D. The male cord connector on the lower end of the Type W cord running up the pole, the female cord connector for the Type W cord running to the circuit breaker enclosure and the male connector on the maintenance jumper shall meet the following or approved equal specifications:

- 1. Arrow Hart pin and sleeve watertight connectors UL listed, catalog numbers AH330C7W and AH330P6W.
- 2. Bryant watertight pin and sleeve connectors UL listed, catalog numbers 330C6W and 330P6W.

- 3. Hubble pin and sleeve connectors UL listed, catalog numbers HBL330C7W and HBL 330P7W.
 - 4. The male connector for use with the Type W maintenance jumper shall be a pin and sleeve connector of one of the above types. The Contractor shall attach a 50 amp twist lock receptacle to the opposite end of the maintenance jumper to match the flange mounted plug on the ring and the portable transformer.
 - 5. The Contractor shall make a brochure submittal on the cord connectors.
- E. When shown on the plans, spill light shall be restricted to less than 0.15 horizontal footcandles.
- F. The Contractor shall provide shop drawings for high mast illumination assemblies in accordance with this Item and Item 441. An Engineer licensed in the State of Texas shall seal the shop drawings.

3. TESTING

- A. Fixtures, lamps and ballasts will be sampled and tested in accordance with the Department "Manual of Testing Procedures" except as noted in these specifications.
- B. Ballasts and fixtures will be tested using a reference lamp.
- C. The Department will bear the cost of all testing of equipment that complies with the specification requirements. However, the source of supply of fixtures and ballasts must be approved as required in Article 6.1 of the Standard Specifications. Such approval will be contingent on the supplier agreeing to bear the cost of testing any equipment that fails to comply with the specification requirements listed in this specification.
- D. All other equipment will be tested in accordance with Item 614 of the Standard Specifications and Materials and Test Division Test Standards.
- E. After High Mast Assembly has been completely assembled, the Engineer may require Contractor to fully lower and raise each high mast ring one time to demonstrate proper operation of the lowering mechanism, or may require the ring to be lowered for ring or fixture inspection. If any malfunction occurs, the problem shall be corrected at the Contractor's expense and the lowering test will be repeated.

4. MOUNTING RING AND SUPPORT ASSEMBLY


- A. Ring and support assembly shall be fabricated from steel having a minimum yield strength of 36 KSI.
- B. Cover assemblies, fittings and miscellaneous parts shall be as outlined on the plans.
- C. All hardware shall be hot-dipped galvanized per ASTM A153 or shall be stainless steel, unless noted otherwise on the plans.

5. WINCH

- A. Housing shall be high tensile strength die-cast silicon aluminum. Cable drum shall be fabricated from seamless steel tubing with stamped steel flanges and shall be hot-dipped galvanized. Drum shall have a minimum diameter of 4.5 inches. Drum shall be keyed to drum shaft. Drum and flanges shall be sized so that, when the fixture mounting ring is in the raised position, the cable including one full layer will fill the drum to no more than two-thirds of full capacity. Drum shaft shall be ground from stainless steel and mounted on lubricated bronze bearings with seals. Wormgear shall be made of nickel-bronze and worm shaft shall be high-strength stress-proofed steel, ground and polished and supported by tapered roller bearings.
- B. Gear ratio shall be 36:1 with safe hoisting capacity of not less than 4000 pounds.
- C. Winch shall incorporate adjustable automatic brake to assure positive load suspension. Brake shall be multiple disc with friction plates running in oil bath and one-direction clutch which operates only when load is suspended or lowered. Winch shall not have throw-out clutch.
- D. Any winch that is operated without oil shall be considered damaged and shall be replaced by the contractor at the contractor's expense.

6. WIRE ROPE AND TERMINALS

- A. 5/16 and 3/8 wire rope shall be 19x7 Rotation Resistant IWRC stainless steel. 19x7 rotation resistant wire rope shall meet the construction requirements of Fed. Spec. RR-W-410D, Type IV, class 2, modified for stainless steel with a nominal breaking strength of 11,100 lbs. All wire rope shall be pre-formed and factory lubricated. Wire rope shall meet the requirements of the applicable specification except where modified by this specification. Quality Assurance testing shall be the responsibility of the manufacturer and shall meet recognized wire rope industry standards. No special tensile or torsion testing will be required. Mill Test Reports shall be furnished.
- B. Winch cable shall be of sufficient length to leave a minimum of one full layer of cable on the drum when the fixture mounting ring is in the full down position.
- C. Wire rope terminals shall be stainless steel, solid stud type as shown on Sheet 7. All terminals shall be drilled for cotter pin. Material to be 303 SE or 304 stainless steel with a maximum tensile strength of 115,000 p.s.i. Mill Test Reports shall be furnished.

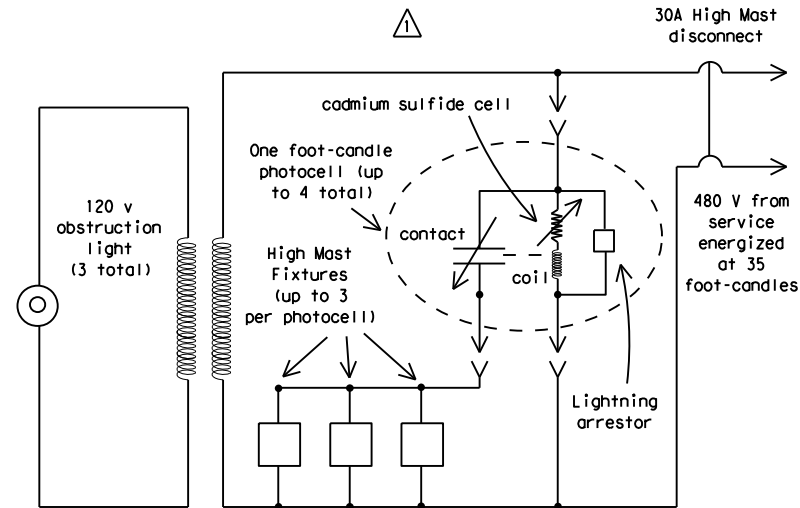

One foot-candle photocell keeps High Mast fixtures off when FAA photocell energizes circuit at 35 foot-candles. Fixtures come on when sun goes down at 1 foot-candle.

One Foot-candle PhotoCell Schematic

Use on ring when obstruction lights are installed and FAA photocell is installed in electrical service.

3/03 Revision

- ⚠ Revised General requirements; add diagram
- ⚠ Revised Wire Rope and Terminals

Texas Department of Transportation
Traffic Operations Division

HIGH MAST ILLUMINATION DETAILS

HMID (8) -03

© TxDOT January 1986		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
4-89	REVISIONS	CONT	SECT	JOB	HIGHWAY
10-93		0088	05	110, ETC	US 59, ETC
4-96		DIST	COUNTY		SHEET NO.
3-03		YKM	VICTORIA, ETC		67

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILES\$

D. All terminals shall be proof-tested by the manufacturer to 40% of rated strength of the wire rope. Each terminal shall be identified by manufacturer's logo permanently incised on terminal. Manufacturer shall furnish certification of tests. Contractor shall also furnish one sample of each size of terminal with 5 ft. of wire rope for load tests by the State. Samples tested must withstand test load not less than 100% of rated breaking strength of wire rope. If sample fails test, all terminals of same size will be rejected.

E. Wire rope shall be delivered from the manufacturer on a reel.

7. SPRINGS

- A. Provide three steel springs as shown on plans.
- B. Springs shall have an uncompressed length of approximately 8 inches and shall compress 3 inches under 700-pound load.
- C. Springs shall contain approximately 19 total coils with ID of 0.875 and OD of 1.375 inches. Ends shall be closed and ground. Springs shall be zinc-plated.
- D. Springs shall be made from 1/4" diameter oil-tempered MB Steel treated for overstress. Springs shall not develop permanent set from 3-inch compression.

8. ELECTRICAL POWER CABLE

- A. Power cable shall be No. 8 AWG three-conductor round Type W, rated 90 degrees C, 600 volt or 2000 volt. Each conductor shall be tinned copper and shall consist of 133 strands. Insulation shall be ethylene propylene rubber. Jacket shall be chlorosulfonated polyethylene (CSPE), with glass fiber or nylon reinforcing mesh between two layers of CSPE. Nominal diameter shall be 0.91". Filler shall be rubber compound or other approved non-hygroscopic compound. Jacket shall be Hypalon Power Flex 90, with no substitutions allowed.

9. POWER DRIVE ASSEMBLY (ONE ONLY THIS CONTRACT UNLESS OTHERWISE SHOWN ELSEWHERE ON THE PLANS)

A. Drive Motor

- 1. Drive motor shall be 1-1/4" heavy-duty reversible portable electric drill modified as shown on plans.
- 2. Shall have a minimum of 6 radial ball bearings, one thrust bearing, and one needle bearing.
- 3. Shall have No. 3 Morse Taper socket.
- 4. Shall be designed for 115 volt 60 Hertz single phase operation 250 RPM at no load.
- 5. Shall be designed for continuous rated duty of 160 RPM and 15 amperes at 115 volts with delivery of 33-pound-feet of torque. Drill motor to be operated only at low speed range. (i.e. 150 to 160 RPM)
- 6. Shall develop 240 pound-feet of torque at stalled rotor condition.

B. Torque Limiter Coupling

- 1. Torque limiter coupling shall consist of standard torque limiter with Type A sprocket center member coupled to a Type B sprocket by an ASA double strand roller chain. Type A sprocket shall be chrome-plated.
- 2. Coupling shall have torque capacity minimum of 15 pound-feet and a maximum of 55 pound-feet.
- 3. Limiter section of coupling shall consist of integral hub and pressure plate, two friction facings, sintered iron bushing, pilot plate, disk spring, lock washer and hex adjustment nut. All major components except spring and friction facings shall be cadmium-plated with dichromate treatment.
- 4. Type A center sprocket shall have ground face (63 micro-inch) and shall be run-in for 4 minutes at approximately 60 RPM at a torque setting 70% to 80% of spring rating. Contractor shall provide written certification that run-in has been accomplished.
- 5. The torque limiter coupling shall, after run-in, be set to a torque limit of 35 pound-feet or as directed by the Engineer. The proper setting of the coupling shall be demonstrated to the Engineer.

C. Universal Joints

- 1. Shall be slip-type with 4-inch barrel. A grease fitting shall be so located in the spider that all caps and needle bearings may be adequately serviced. The assembly shall be disassembled and zinc-plated, then reassembled and properly lubricated.
- 2. Shall have a minimum torque rating of 1270 inch-pounds at 200 RPM.
- 3. Shall have set screw and keyed coupling as shown on plans.



10. CONSTRUCTION METHODS

A. Fabrication

- 1. Fabrication and welding shall be in accordance with Item 441, "Steel Structures".
- 2. All holes supporting pulley shafts shall be drilled (not punched) prior to galvanizing.
- 3. All component parts shall be galvanized where galvanizing is applicable, after fabrication.
- 4. Galvanizing on all parts which have become scratched, chipped or otherwise damaged shall be thoroughly cleaned and the cleaned area painted with two coats of zinc dust-zinc oxide paint conforming to the requirements of repair compounds meeting Federal Specification TT-P-641 b.
- 5. Mounting rings and ring support assemblies shall be fabricated with the use of jigs that have been inspected and approved by Material and Test Division personnel prior to their usage.
- 6. The fabricator shall submit his proposed welding procedures in accordance with Item 441, "Steel Structures".

B. Installing Wire Rope

- 1. Extreme care shall be used to prevent wire rope from kinking, nicking, or from sustaining other damage during installation. Rope shall not be installed by pulling from flat coil, but shall be carefully unrolled its full length or placed on a horizontal axis and unreel according to wire rope industry standards.
- 2. For right lay rope, the rope shall be attached to the drum on the end opposite the winch gear train, and wound on drum so that the free end of the rope comes off the backside of the drum during normal operation of the winch. Rope must be unreel carefully as stated above. Care must be taken to insure that all layers lay full and tight on drum.
- 3. Installation of all wire rope shall be accomplished only under direct supervision of the Engineer or his authorized representative. Contractor shall not remove wire rope from manufacturer's reel until authorized by the Engineer. Installation of wire rope on winch shall be in accordance with the above and accepted industry practice. Installation of the three hoist cables shall be made from the top end of the pole and as directed by the Engineer or his representative.

C. Installing Wire Rope Clips

- 1. Turn back approx. 2' 3" of rope, measured from the top of thimble. Apply seizing to pigtail end of wire rope prior to cutting to length. See detail "K", Sheet 3. Apply first clip approx. 3" from the dead end of the wire rope with U-bolt over dead end and live end in clip saddle. Tighten nuts evenly to 30 pound-feet of torque, or as recommended by manufacturer.
- 2. Install second clip as near loop as possible, take out slack and torque nuts evenly to 30 pound-feet or as recommended by manufacturer.
- 3. After final erection and assembly of the pole and high mast assembly, retighten nuts to required torque.

D. Installing Light Ring and Luminaires

- 1. Prior to mounting luminaires to the light ring, Contractor shall ensure the ring is level. Luminaires shall be mounted level on the light ring. Luminaires shall be oriented as shown on plans.

3/03 Revision
 Revised Construction Methods.




Texas Department of Transportation
 Traffic Operations Division

**HIGH MAST
 ILLUMINATION
 DETAILS**


HMID (9) -03

© TxDOT January 1986		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
10-93	REVISIONS	CONT	SECT	JOB	HIGHWAY
10-95		0088	05	110, ETC	US 59, ETC
4-96		DIST		COUNTY	SHEET NO.
3-03		YKM		VICTORIA, ETC	68




DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

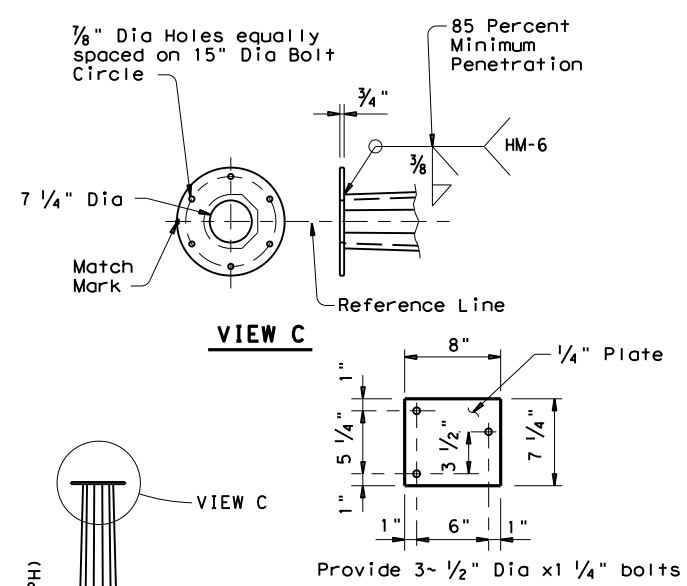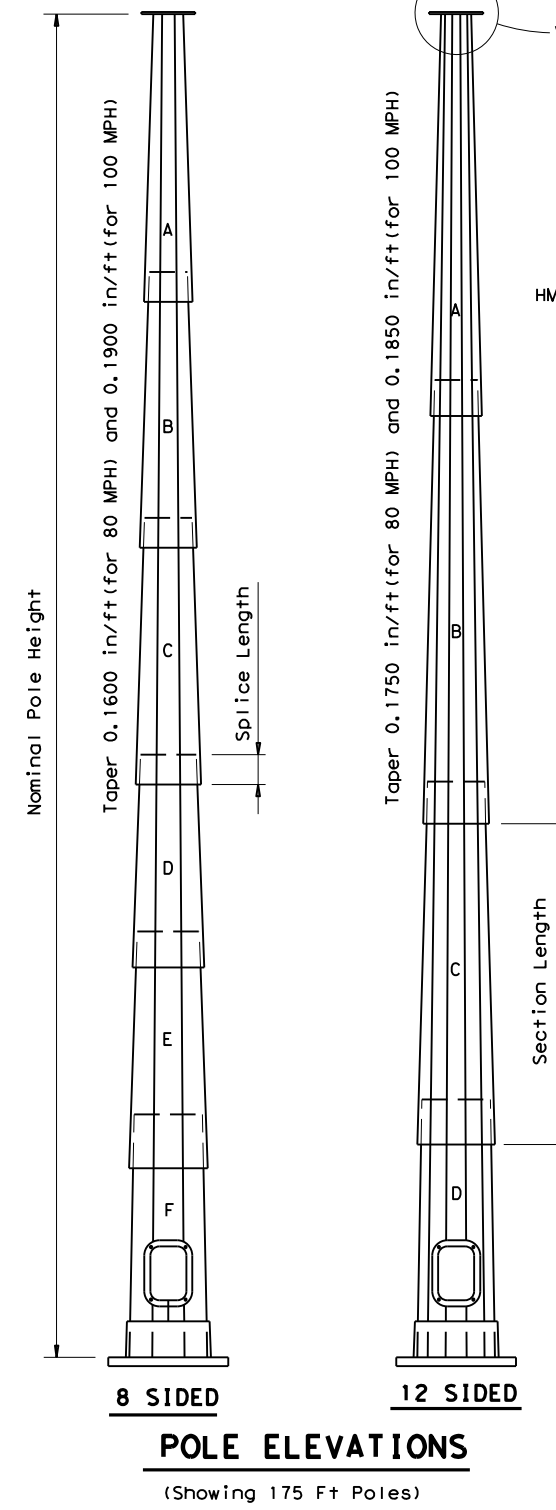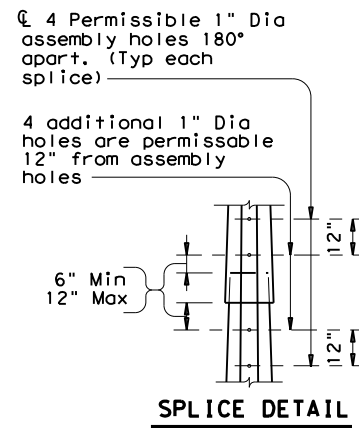






WINCH DRIVE ACCESS COVER

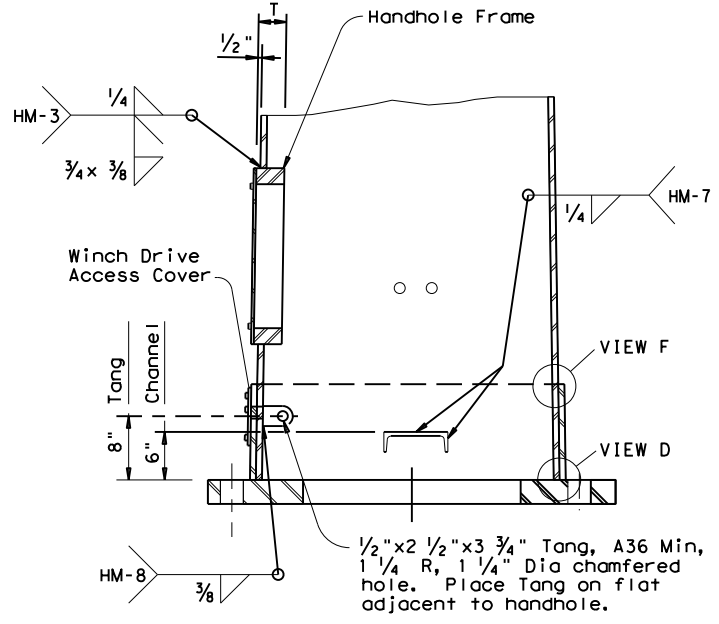

SECTION B-B

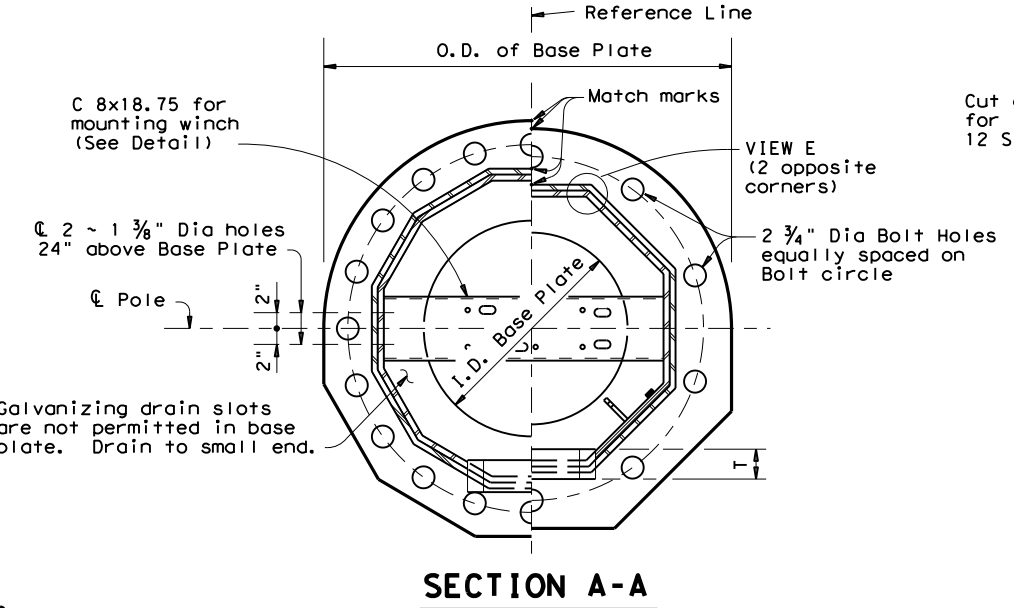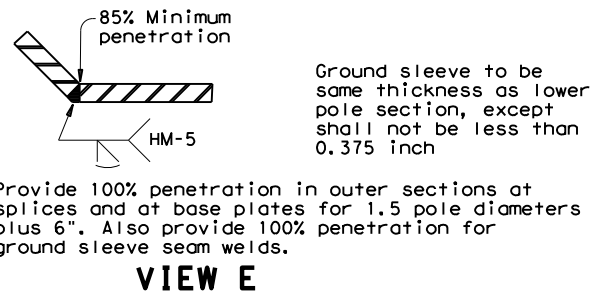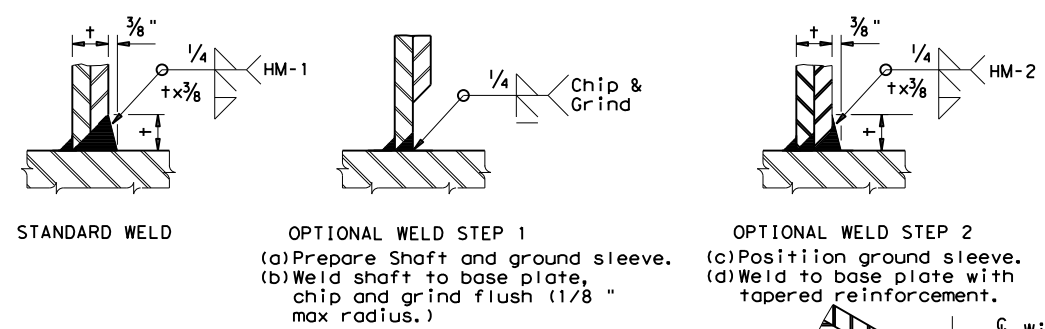

SECTION A-A

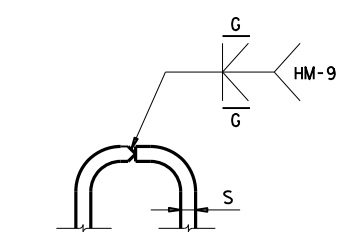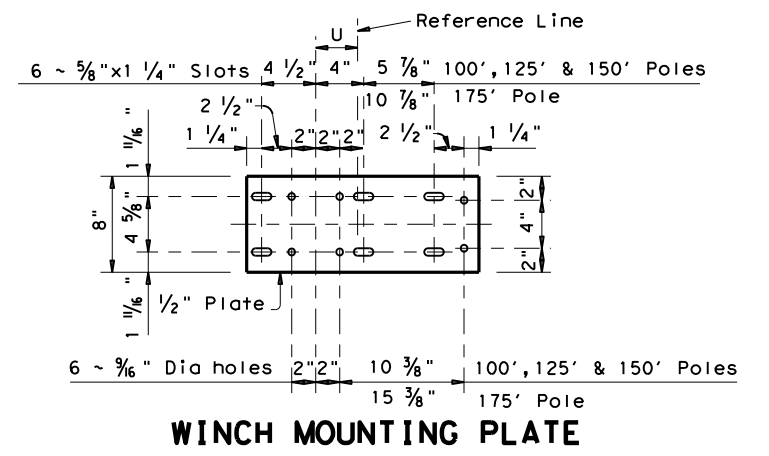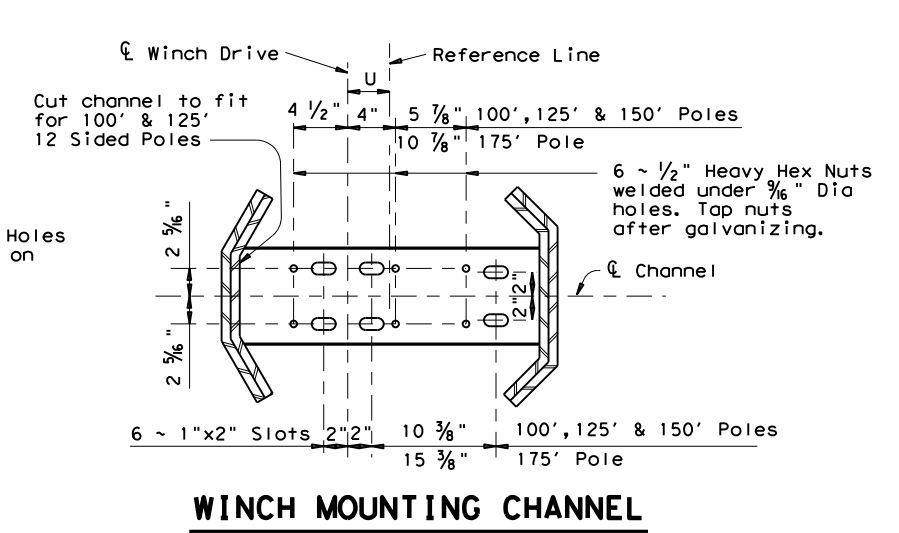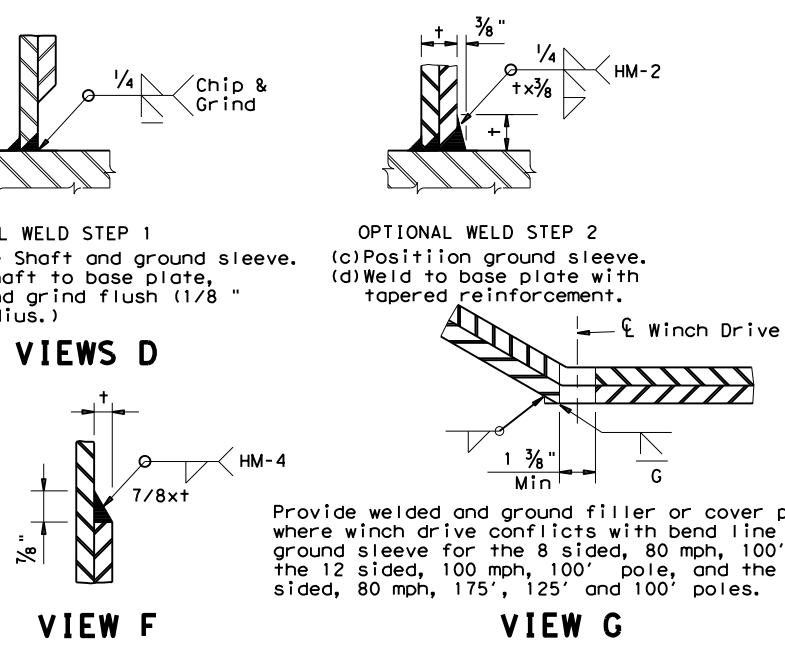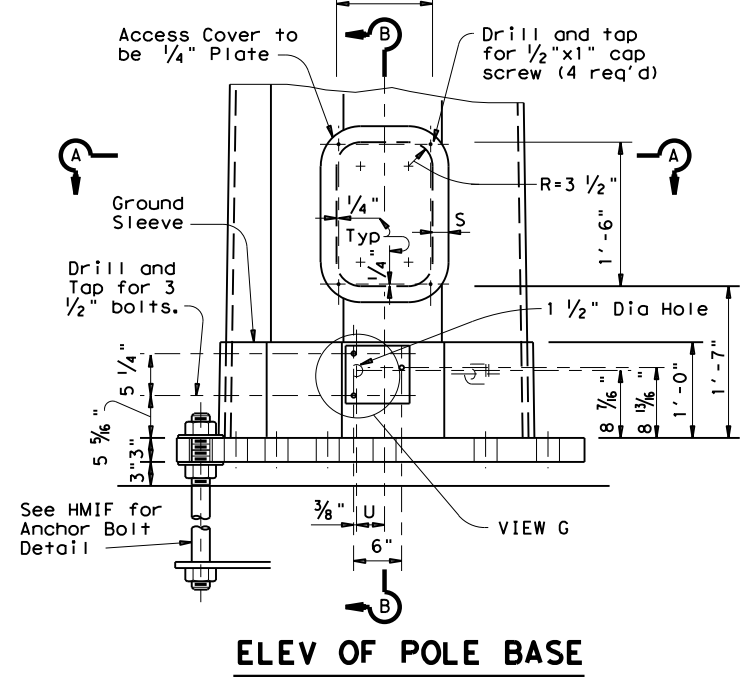

A bent and welded handhole frame is permissible. Heating, bending, and finish grinding must be approved with the HM-9 weld procedure.

OPTIONAL HANDHOLE FRAME

SHEET 1 OF 2

		Traffic Operations Division Standard	
HIGH MAST ILLUMINATION POLES 100' - 125' - 150' - 175'			
HMIP(1)-16			
FILE: hmip-16.dgn	DN:	CK:	DW:
© TxDOT August 1995	CONT	SECT	JOB
5-98	0088 05 110, ETC US 59, ETC		HIGHWAY
8-16	DIST	COUNTY	SHEET NO.
	YKM VICTORIA, ETC		69

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:
FILE:

TABLE OF VARIABLE POLE DIMENSIONS											
8 SIDED POLE							12 SIDED POLE				
Ht (ft)	Section	Diameter (Inches)		Thickness (inches)	Length (feet)	Splice (inches)	Diameter (Inches)		Thickness (inches)	Length (feet)	Splice (inches)
		Bottom	Top				Bottom	Top			
175	A	13.083	7.750	.250	33.33	19	16.792	7.750	.250	51.67	24
	B	17.792	12.205	.375	34.92	25	24.858	15.817	.313	51.67	36
	C	22.250	16.583	.375	35.42	32	32.625	23.583	.313	51.67	48
	D	25.375	20.948	.438	27.67	36	36.250	31.175	.375	29.00	~
	E	28.375	23.895	.500	28.00	41					
	F	31.250	26.703	.500	28.42	~					
150	A	13.083	7.750	.250	33.33	19	16.792	7.750	.250	51.67	24
	B	17.792	12.205	.375	34.92	25	24.858	15.817	.313	51.67	36
	C	22.250	16.583	.375	35.42	32	32.625	23.583	.313	51.67	~
	D	25.375	20.948	.438	27.67	36					
	E	28.375	23.895	.500	28.00	~					
125	A	13.083	7.750	.250	33.33	19	16.792	7.750	.250	51.67	24
	B	17.792	12.205	.375	34.92	25	24.858	15.817	.313	51.67	36
	C	22.250	16.583	.375	35.67	32	28.250	23.583	.313	26.67	~
	D	25.375	20.948	.438	27.67	~					
100	A	13.083	7.750	.250	33.33	19	16.792	7.750	.250	51.67	24
	B	17.792	12.205	.375	34.67	25	24.625	15.817	.313	50.33	~
	C	22.250	16.583	.375	35.67	~					
175	A	14.208	7.875	.313	33.33	20	17.433	7.875	.375	51.67	25
	B	19.792	13.142	.375	35.00	28	25.747	16.173	.438	51.75	37
	C	25.250	18.473	.438	35.67	36	33.750	24.176	.438	51.75	49
	D	29.000	23.680	.500	28.00	42	37.375	31.995	.500	29.08	~
	E	32.625	27.210	.563	28.50	47					
	F	36.125	30.631	.563	28.92	~					
150	A	14.208	7.875	.313	33.33	20	17.433	7.875	.375	51.67	25
	B	19.792	13.142	.375	35.00	28	25.747	16.173	.438	51.75	37
	C	25.250	18.473	.438	35.67	36	33.750	24.176	.438	51.75	~
	D	29.00	23.680	.500	28.00	42					
	E	32.625	27.210	.563	28.50	~					
125	A	14.208	7.875	.313	33.33	20	17.433	7.875	.375	51.67	25
	B	19.792	13.142	.375	35.00	28	25.747	16.173	.438	51.75	37
	C	25.250	18.473	.438	35.67	36	29.125	24.176	.438	26.75	~
	D	29.00	23.680	.500	28.00	~					
100	A	14.208	7.875	.313	33.33	20	17.433	7.875	.375	51.67	25
	B	19.792	13.142	.375	35.00	28	25.500	16.173	.375	50.42	~
	C	25.250	18.473	.438	35.67	~					

Diameters are measured across the flats.

MATERIALS	
Polygonal Shafts Ground Sleeves	ASTM A709 Grade 50 A572 Grade 50 ①②
Base Plate and Handhole Frame	ASTM A709 Grade 50 A572 Grade 50 ① A633 Grade C ①
Miscellaneous Steel	ASTM A36 or equal

- ① ASTM A572 and A633 may have higher yield strength but shall not have less elongation than the grade indicated.
- ② The silicon content of all steel shall be controlled to ensure high quality galvanizing and to avoid discoloration.

TABLE OF VARIABLE BASE DIMENSIONS							
Ht (ft)	O.D. (inches)	I.D. (inches)	Bolt Cir (inches)	No. Bolts	S (inches)	T (inches)	U (inches)
80 MPH DESIGNS							
8 SIDED POLE							
175'	47	22	41	16	2.00	3.75	4.50
150'	44	18	38	12	2.00	4.00	3.50
125'	41	16	35	8	2.00	4.50	3.50
100'	37	14	31	6	2.00	5.00	3.50
12 SIDED POLE							
175'	50	24	44	12	1.75	3.50	3.50
150'	47	22	41	10	1.75	3.50	2.50
125'	42	18	36	8	1.75	3.75	2.50
100'	38	13	32	6	1.75	4.00	2.50
100 MPH DESIGNS							
8 SIDED POLE							
175'	52	27	46	20	1.75	3.50	4.50
150'	49	23	43	16	1.75	4.00	3.50
125'	45	21	39	12	1.75	4.50	3.50
100'	40	17	34	10	1.75	4.50	3.50
12 SIDED POLE							
175'	52	27	46	16	1.75	3.25	3.50
150'	50	25	44	12	1.75	3.50	2.50
125'	46	22	40	10	1.75	3.75	2.50
100'	42	19	36	6	1.75	4.00	2.50

NOTE: Base Plate may be round or with 8 or 12 equal segments matching the pole.


GENERAL NOTES:

- Design conforms to AASHTO 1994 Standard Specifications for Structural Supports for Highway Signs, Luminaries, and Traffic Signals and Interim Revisions thereto. The Design Wind Speed is 80 mph or 100 mph.
- The required design height and wind speed shall be as shown elsewhere in the plans.
- Each pole section, top flange plate and base plate shall be permanently marked on the reference line. The required mark locations are shown on the baseplate, top plate, and foundation plan details. These marks shall be used in pole assembly and erection alignment. The reference line and anchor bolt orientation shall be parallel to roadway centerline unless otherwise shown on Lighting Layouts.


SHEET 2 OF 2

		Traffic Operations Division Standard	
HIGH MAST ILLUMINATION POLES 100' - 125' - 150' - 175'			
HMIP (2) - 16			
FILE: hmip-16.dgn	DN:	CK:	DW:
© TxDOT August 1995	CONT	SECT	JOB
REVISIONS		HIGHWAY	
5-98	0088 05	110, ETC US 59, ETC	
8-16	DIST	COUNTY	SHEET NO.
	YKM	VICTORIA, ETC	70


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

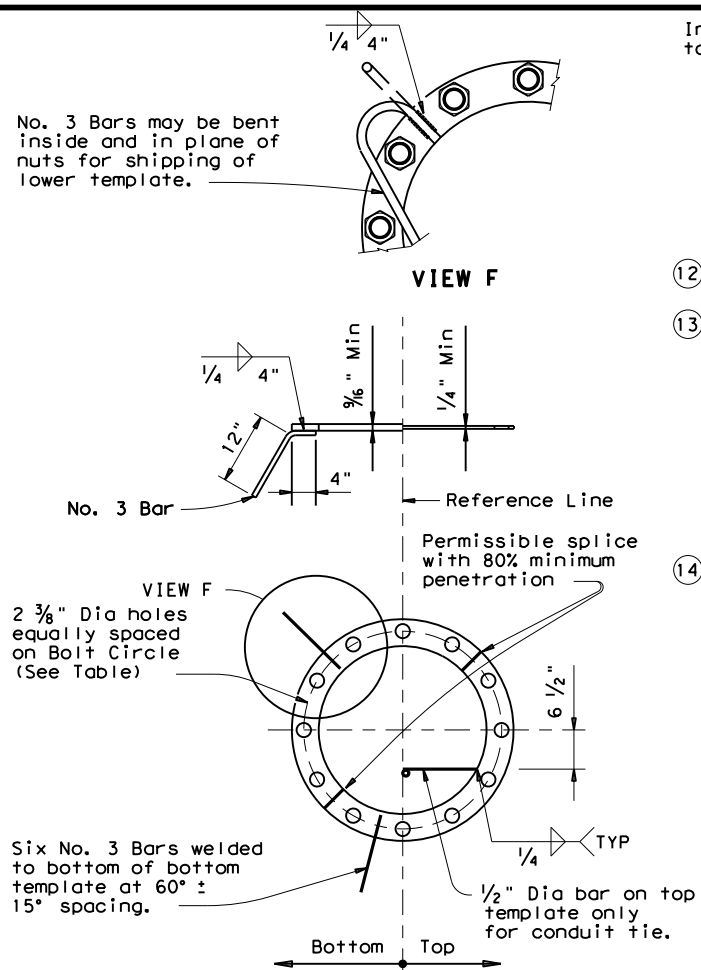


ANCHOR BOLT TEMPLATES

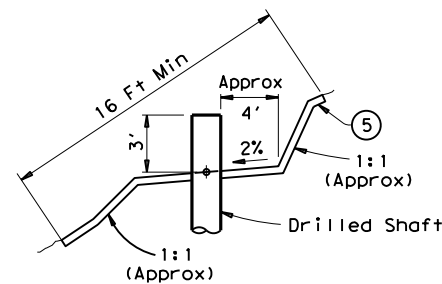


RIPRAP ON SLOPES

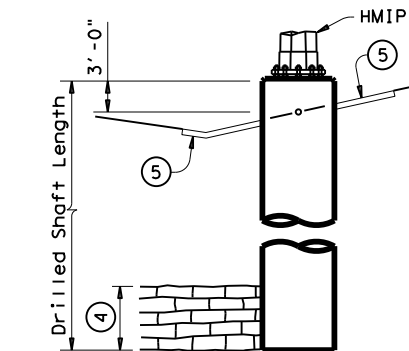

- ⑤ Match slope of finished ground if slope is less than approx 4 to 1. For steeper slopes, bench to provide work area with approx 2% slope around pole base. Other configurations may be shown elsewhere on the plans.
- ④ If rock is encountered, the Drilled Shaft shall extend a minimum of two diameters into solid rock.

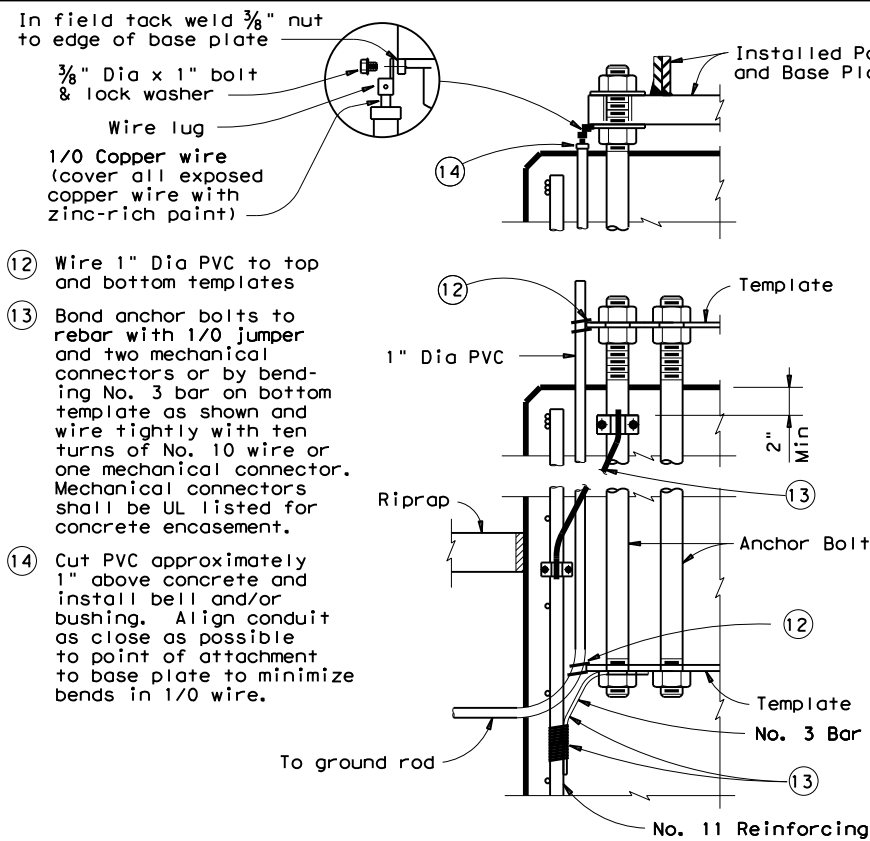

LIGHTNING PROTECTION SYSTEM

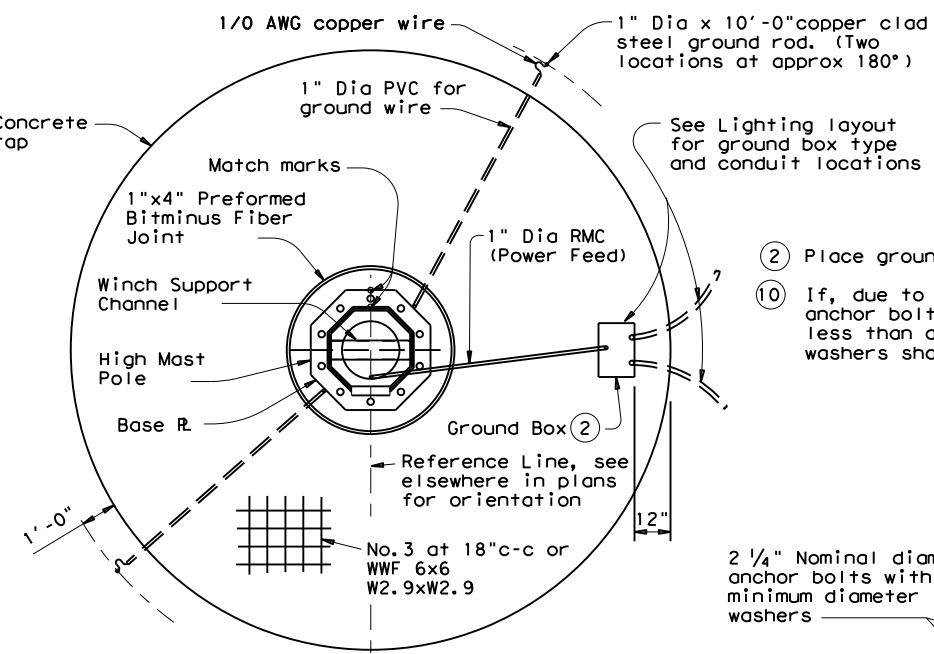

- ② Place ground box cover flush with riprap.
- ⑩ If, due to tolerances in fabrication, the anchor bolt hole to ground sleeve weld is less than approx 7/8", clipped 1/2" thick washers shall be supplied at those




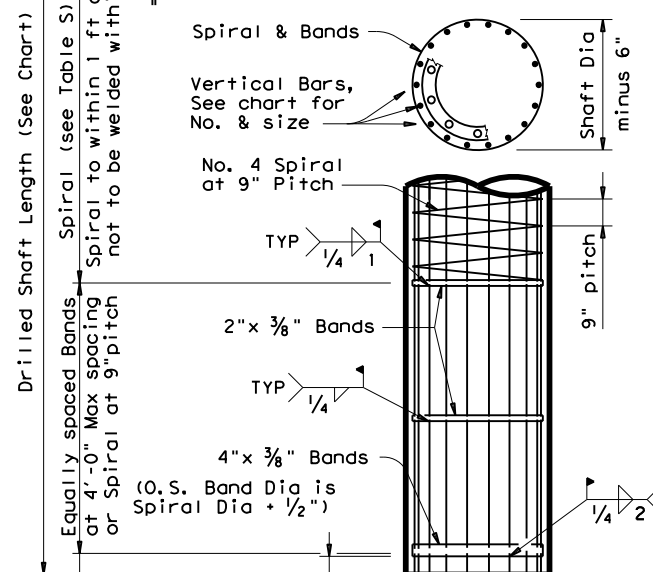


TABLE 5	
Shaft Dia (inches)	Min Spiral Length (feet)
48	19
54	21
60	23
66	26

Vertical bars may be supported on bottom of drilled hole if material is firm enough to do so when concrete is placed

DRILLED SHAFT FOUNDATION DETAIL

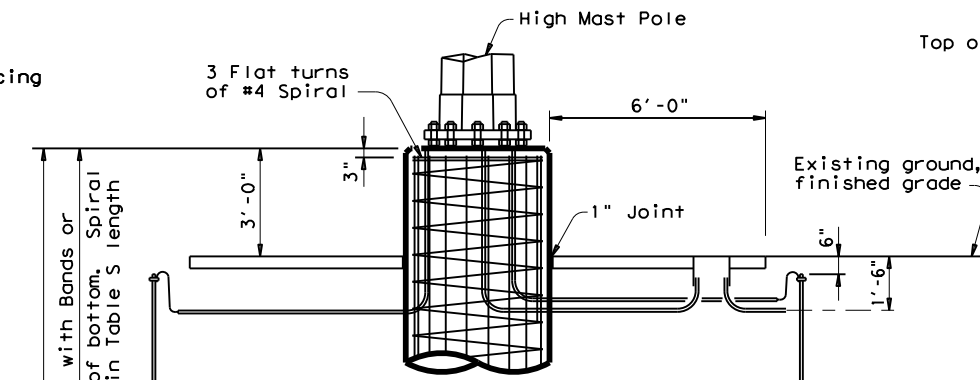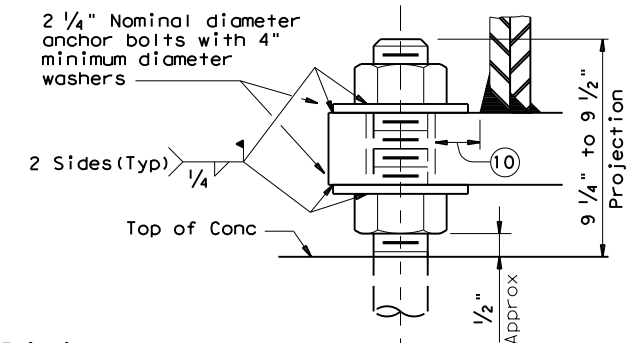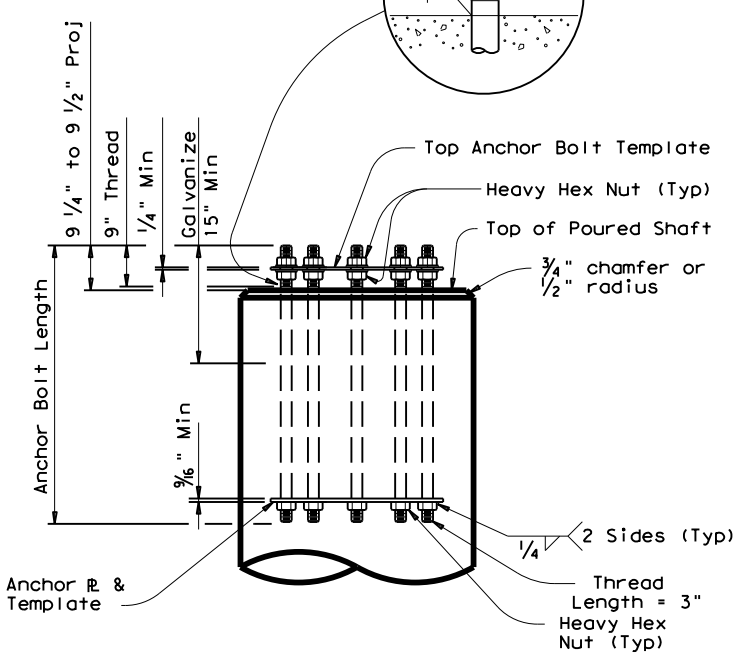

ANCHOR BOLT ASSEMBLY

(See Anchor Bolt Table for number of bolts required)

Texas Department of Transportation
Traffic Operations Division

HIGH MAST ILLUMINATION POLE FOUNDATIONS



SHEET 1 OF 2 HMIF (1) -98

© TxDOT August 1995		DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
11-97	REVISIONS	CONT	SECT	JOB	HIGHWAY
5-98	Anchor Bolt Circle Dia	0088	05	110, ETC	US 59, ETC
		DIST	COUNTY	SHEET NO.	
		YKM	VICTORIA, ETC	71	

DATE: 10/6/2023 \$TIMES
FILE: \$FILES

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

⑥ Includes normal 3 Ft exposure. Shafts with more than 3 Ft exposure must have additional length.

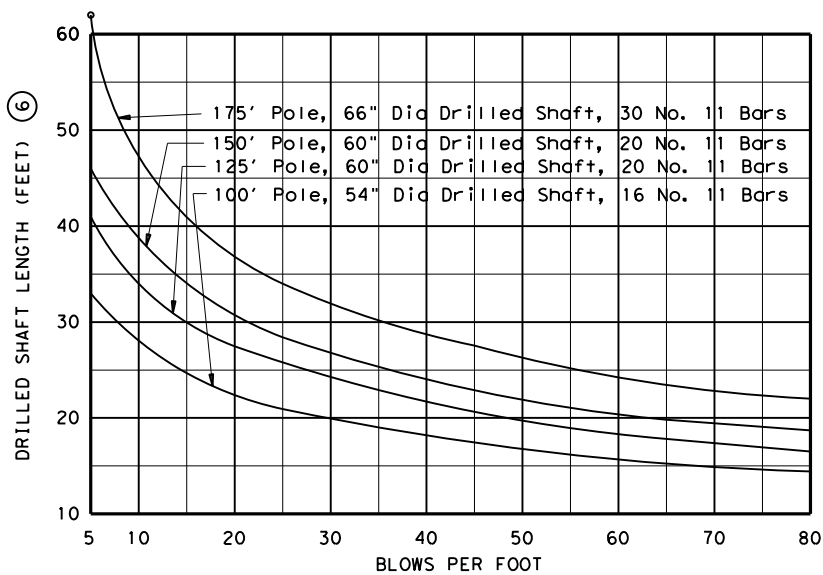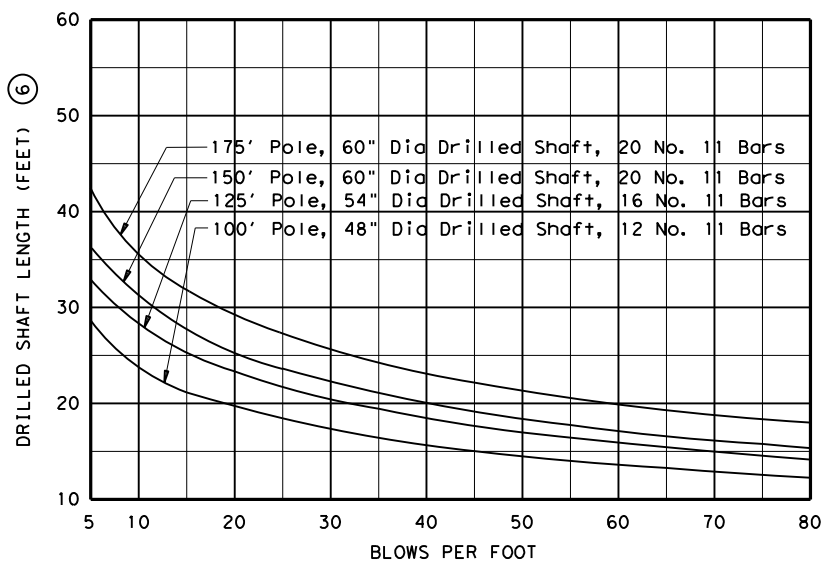

TEXAS CONE PENETROMETER TEST TABLES

NOTE: Use average "N" value over the top third of the embedded shaft. Ignore the top 2' of soil.

ANCHOR BOLT TABLE						
Pole Height (feet)	Bolt Diameter (inches)	Bolt Length (feet)	Bolt Templates		No. of Bolts	Bolt Cir Dia (inches)
			O D (inches)	I D (inches)		
8 SIDED POLE						
175	2.25	4.83	45.5	36.5	16	41
150	2.25	4.83	42.5	33.5	12	38
125	2.25	4.83	39.5	30.5	8	35
100	2.25	4.83	35.5	26.5	6	31
12 SIDED POLE						
175	2.25	4.83	48.5	39.5	12	44
150	2.25	4.83	45.5	36.5	10	41
125	2.25	4.83	40.5	31.5	8	36
100	2.25	4.83	36.5	27.5	6	32
8 SIDED POLE						
175	2.25	4.83	50.5	41.5	20	46
150	2.25	4.83	47.5	38.5	16	43
125	2.25	4.83	43.5	34.5	12	39
100	2.25	4.83	38.5	29.5	10	34
12 SIDED POLE						
175	2.25	4.83	50.5	41.5	16	46
150	2.25	4.83	48.5	39.5	12	44
125	2.25	4.83	44.5	35.5	10	40
100	2.25	4.83	40.5	31.5	6	36

MISCELLANEOUS QUANTITIES - ONE HMIF			
Shaft Diameter (in) ⑦	48	54	60
Concrete Riprap (CY)	2.33	2.44	2.56
Reinforcing (Lbs) ⑧	94	99	103
Ground Box (ea)	1	1	1
R O W Marker (ea) ⑨	1	1	1

- ⑦ See elsewhere on plans for length of Drilled Shaft required.
- ⑧ For Contractors information only.
- ⑨ Designated elsewhere on plans if required.

GENERAL NOTES:

Unless otherwise noted, the welded steel bands may be replaced with spiral as shown on the foundation details.

Anchor bolts shall be placed in foundation so there are always two bolts on reference line.

Drilled shaft lengths as determined from the foundation design chart or other acceptable methods are to be as shown elsewhere on the plans.


ODSR may not be used for HMIF drilled shafts.

Concrete for drilled shafts shall be Class C.

Repair welded areas with zinc-rich paint.

All Anchor Bolts, Nuts and Washers shall be galvanized in accordance with Item 445, "Galvanizing".

DATE: 10/6/2023 \$TIME\$
 FILE: \$FILE\$



Texas Department of Transportation
Traffic Operations Division

HIGH MAST ILLUMINATION POLE FOUNDATIONS

SHEET 2 OF 2 HMIF (2) - 98

© TxDOT August 1995		DN: TXDOT	CK: TXDOT	DW: TXDOT	CK: TXDOT
5-98 - Anchor Bolt	REVISIONS	CONT	SECT	JOB	HIGHWAY
Circle Dia	0088 05	110, ETC	US 59, ETC		
	DIST	COUNTY	SHEET NO.		
	YKM	VICTORIA, ETC	72		

I. STORMWATER POLLUTION PREVENTION

Texas Pollutant Discharge Elimination System (TPDES) TXR 150000: Stormwater Discharge Permit or Construction General Permit is required for projects with 1 or more acres disturbed soil. Projects with any disturbed soil must protect for erosion and sedimentation in accordance with Item 506. If applicable list MS4 operator that may receive discharges from this project. MS4 operator should be notified prior to construction activities.

Prevent stormwater pollution erosion and sedimentation in accordance with TPDES Permit TXR 150000.

Comply with the SW3P and revise when necessary to control pollution or as required by the Engineer.

Post Construction Site Notice (CSN) with SW3P information on or near the site, accessible to the public and TCEQ, EPA, or other inspectors.

When Contractor project specific locations (PSL) increase disturbed soil area to 5 acres or more, submit Notice of Intent (NOI) to TCEQ and Engineer.

MS4 Operator(s):

No Additional Comments

II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS

United States Army Corps of Engineers (USACE) Permit is required for filling, dredging, excavating or other work in water bodies, rivers, creeks, streams, wetlands or wet areas. The Contractor must adhere to all of the terms and general conditions associated with the following permit(s). If additional work not represented in the plans is required, contact the Engineer immediately.

No USACE Permit Required

Work is authorized by the USACE under a Nationwide Permit _____ without a Pre-Construction Notification (PCN). Project specific permit was not issued by USACE, therefore is not in the plan set.

Work is authorized by the USACE under a Nationwide Permit _____ with a Pre-Construction Notification (PCN). The project specific permit issued by the USACE is included in the plan set.

Work is authorized by the USACE under a Individual Permit (IP). The project specific permit issued by the USACE is included in the plan set.

Work would be authorized by the USACE. The project specific permit issued by the USACE or Nationwide Permit will be provided to the contractor.

United States Coast Guard (USCG) Permit is required for projects that involve the construction or modification (including changes to lighting) of a bridge or causeway across a water body determined to be navigable by the United States Coast Guard (USCG) under Section 9 of the Rivers and Harbors Act. If additional work not represented in the plans is required, contact the Engineer immediately.

No United States Coast Guard (USCG) Coordination Required

United States Coast Guard (USCG) Permit

United States Coast Guard (USCG) Exemption

Best Management Practices

Erosion	Sedimentation	Post Construction TSS
<input checked="" type="checkbox"/> Temporary Vegetation	<input type="checkbox"/> Silt Fence	<input checked="" type="checkbox"/> Vegetative Filter Strips
<input type="checkbox"/> Vegetation Lined Ditches	<input type="checkbox"/> Rock Filter Dam	<input type="checkbox"/> Vegetation Lined Ditches
<input type="checkbox"/> Sodding	<input type="checkbox"/> Sand Bag Berm	<input type="checkbox"/> Grassy Swales

No Additional Comments

III. CULTURAL RESOURCES

Refer to TxDOT Standard Specifications in the event historical issues or archeological artifacts are found during construction. Upon discovery of archeological artifacts (bones, burnt rock, flint, pottery, etc.) cease work in the area and contact the Engineer immediately.

No Additional Comments

IV. VEGETATION RESOURCES

Preserve native vegetation to the extent practical. Refer to TxDOT Standard Specifications 162, 164, 192, 193, 506, 730, 751, and 752 in order to comply with requirements for invasive species, beneficial landscaping and tree/brush removal.

No Additional Comments

V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRDS

If any of the listed species below are observed, cease work in the area, do not disturb species or habitat and contact the Engineer immediately.

The work may not remove active nests (from bridges, structures, or vegetation adjacent to the roadway, etc.) during nesting season (February 15 to October 1). If removal of structures or vegetation is necessary during the nesting season, the Contractor shall conduct a bird survey no more than 3 days in advance of the clearing/demolish start date. All bird surveys shall be conducted by a Field Biologist and adhere to the guidance document "Avoiding Migratory Birds and Handling Potential Violations" found in the TxDOT Environmental Compliance Toolkits at the time of the survey. (See below for Field Biologist and Ornithologist qualifications)

No Additional Comments

Field Biologist, Ornithologist – a field biologist is defined as an individual qualified to perform field investigations, presence/absence surveys and habitat surveys for protected avian species or species of concern. A mandatory bachelor's degree in biology or a related science is required. At a minimum, the Field Biologist, Ornithologist, shall have completed and reported a minimum of three presence/absence and habitat surveys for protected avian species in the past five years. A minimum of three projects must have been conducted in Texas. Surveys shall have been performed for documentation of species in accordance with a protocol approved by USFWS or TPWD, or following generally accepted methodologies.

VI. HAZARDOUS MATERIALS OR CONTAMINATION ISSUES

Refer to TxDOT Standard Specifications in the event potentially contaminated materials are observed, such as dead or distressed vegetation, trash disposal areas, drums, canisters, barrels, leaching or seepage of substances, unusual smells or odors, or stained soil, cease work in the area and contact the Engineer immediately.

Does the project involve any bridge class structure rehabilitation or replacements (bridge class structures not including box culverts)? Yes No

No further action required.


TxDOT is still required to notify DSHS 14 working days prior to any scheduled demolition.

The Contractor is responsible for providing the date(s) for abatement activities and/or demolition with careful coordination between the Engineer and asbestos consultant in order to minimize construction delays and subsequent claims.

No Additional Comments

VII. GENERAL NOTES

TxDOT has determined that a USACE Nationwide or Individual Permit is not necessary for the project since all work shall be conducted outside the USACE jurisdictional areas. Any impacts to these jurisdictional areas by the contractor without a USACE permit will be the responsibility of the contractor. If the contractor deems it necessary to impact the USACE jurisdictional areas, then it becomes the contractor's entire responsibility to consult with the USACE pertaining to the need for a Nationwide or Individual Permit. TxDOT will then hold the contractor responsible for following all conditions of the approved Permit.

				TxDOT Yoakum District
ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS				
EPIC				
FILE: EPIC Sheet.dgn	DN:	CK:	DW:	CK:
© TxDOT: March 2017	CONT	SECT	JOB	HIGHWAY
REVISIONS		0088	05	110,Etc
				US 59,Etc
		DIST		COUNTY
		YKM		VICTORIA,Etc
				SHEET NO.
				73

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act." No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

I. WORK AT CROSSING LOCATIONS (AT GRADE, HIGHWAY OVERPASS, HIGHWAY UNDERPASS, PEDESTRIAN, OR CLOSED/ABANDONED)

This project is adjacent or parallel work, not within RR ROW:
 DOT No.: 448712S
 Crossing Type: AT GRADE
 RR Company Operating Track at Crossing: UNION PACIFIC RAILROAD
 RR Company Owning Track at Crossing: UNION PACIFIC RAILROAD
 RR MP: 261.680
 RR Subdivision: ANGLETON
 City: BLESSING
 County: MATAGORDA
 CSJ at this Crossing: 0497-01-022
 Latitude: 28.8652453
 Longitude: -96.2691432

Scope of Work, including any TCP, to be performed by State Contractor:

WE WILL BE INSTALLING ILLUMINATION ON FM 616 AT FM 1862, PARALLEL TO THE RAILROAD, FROM MP 262.65 TO 262.79. ALL WORK, EQUIPMENT, AND TCP WILL BE OUTSIDE OF RAILROAD RIGHT OF WAY.

Scope of Work to be performed by Railroad Company:

NONE

II. FLAGGING & INSPECTION

No. of Days of Railroad Flagging Expected: N/A
 On this project, night or weekend flagging is:
 Expected
 Not Expected

Flagging services will be provided by:

Railroad Company: 1) Txdot will pay flagging invoices. Flagging Agreement with railroad will be needed or, 2) Permitted crossing. Railroad company to provide flagging.
 Outside Party: Contractor will pay flagging invoices to be reimbursed by TxDOT

Contractor must incorporate flaggers into anticipated construction schedule. The Railroad requires a 30-day notice if their flaggers are to be utilized. If Contractor falls behind schedule due to their own negligence and is not ready for scheduled flaggers, any flagging charges will be paid by Contractor.

Contact Information for Flagging:

UPRR UP.info@railpros.com
 Call Center 877-315-0513, Select #1 for flagging
 UP.request@nrssinc.net
 Call Center 877-984-6777

BNSF BNSFinfo@railprofs.com
 Call Center 877-315-0513, Select #1 for flagging

CPKCR KCS.info@railpros.com
 Call Center 877-315-0513, Select #1 for flagging
 Bottom Line On-Track Safety Services
 bottomline076@aol.com, 903-767-7630

OTHERS:

Contractor must incorporate railroad construction inspection into anticipated construction schedule.

Not Required
 Required. Contact Information for Construction Inspection:

III. CONSTRUCTION WORK TO BE PERFORMED BY THE RAILROAD

Required.
 Not Required
 Railroad Point of Contact: _____

Coordinate with TxDOT for any work to be performed by the Railroad Company. TxDOT must issue a work order for any work done by the Railroad Company prior to the work being performed.

IV. RAILROAD INSURANCE REQUIREMENTS

The Contractor shall confirm the insurance requirements with the Railroad as the insurance limits are subject to change without notice.

Insurance policies and corresponding certificates of insurance must be issued by the contractor on behalf of the Railroad. Separate insurance policies and certificates are required when more than one Railroad Company is operating on the same right of way, or when several Railroad Companies are involved and operate on their own separate right of ways.

No direct compensation will be made to the Contractor for providing the insurance coverages shown below or any deductibles. These costs are incidental to the various bid items.

Escalated Limits	
Type of Insurance	Amount of Coverage (Minimum)
Workers Compensation	\$500,000 / \$500,000 / \$500,000
Commercial General Liability	\$2,000,000 / \$4,000,000
Business Automobile	\$2,000,000

Railroad Protective Liability Limits	
<input checked="" type="checkbox"/> Not Required	
<input type="checkbox"/> Non - Bridge/Typical Maintenance Projects. Includes repairs to overpass/underpass and culvert structures	\$2,000,000 / \$6,000,000
<input type="checkbox"/> Bridge Structure Projects. Includes new construction or replacement of overpass/underpass structures	\$5,000,000 / \$10,000,000
<input type="checkbox"/> Other: _____	

V. CONTRACTOR'S RIGHT OF ENTRY (CROE)

Not Required
 Required: UPRR Maintenance Consent Letter. TxDOT to assist
 Required: TxDOT to assist in obtaining the UPRR CROE
 Required: Contractor to obtain

- BNSF: _____
https://bnsf.railpermitting.com
- CPKCR
https://jllrpg.360works.com/fmi/webd/rpo_web_kcs.fmp12
- Other Railroads: _____

To view previously approved CROE templates agreed upon between the State and Railroad, see: <https://www.txdot.gov/business/resources/railroad-highway-crossing/sample-right-of-entry-agreements.html>

Approved CROE templates are not to be modified by the Contractor.

Contractor shall not operate within Railroad Right of Way without an executed Construction & Maintenance Agreement between the State and the Railroad and an executed CROE between the Contractor and the Railroad if required on project.

VI. RAILROAD COORDINATION MEETING

A Railroad Coordination Meeting is required. See item 5, Article 8.1, of the Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges Manual for more details.

VII. RAILROAD SAFETY ORIENTATION

A. Complete the Railroad's course "Orientation for Contractor's Safety," and maintain registration prior to working on the Railroad's property. This course is required to be completed annually by Contractor and Subcontractor personnel working on site.

UPRR, BNSF, CPKCR will not accept on-track safety training certificates from other Railroads. Refer to each Railroad's specific contractor right of entry for training information.

Know and follow the Contractor's Right of Entry Agreement EXHIBIT D, MINIMUM SAFETY REQUIREMENTS regarding clothing, personal protective equipment, and general safety requirements.

VIII. SUBCONTRACTORS

Contractor shall not subcontract work without written consent of TxDOT. Subcontractors are subject to the same insurance requirements as the Prime Contractor.

IX. EMERGENCY NOTIFICATION

In Case of Railroad Emergency
 Call: UNION PACIFIC RAILROAD
 Railroad Emergency Line at: 888-877-7267
 Location: DOT PARALLEL/NEAR TO DOT 448712S
 RR Milepost: 262.65
 Subdivision: ANGLETON

RRD Review Only
 Initials: [Signature]
 Date: 08/22/2023

Rail Division

RAILROAD SCOPE OF WORK

PROJECT SPECIFIC DETAILS

FILE: rr-scope-of-work.pdf	DN: TxDOT	CK:	DW:	CK:
© TxDOT June 2014	CONT	SECT	JOB	HIGHWAY
REVISIONS	0088	05	110, ETC	US 59, ETC
6/2023	DIST	COUNTY		SHEET NO.
	YKM	VICTORIA, ETC		74