

FHWA TEXAS DIVISION		SHEET NO. <b>1</b>	
STATE	DISTRICT	COUNTY	
TEXAS	PAR	HUNT, ETC.	
CONTROL	SECTION	JOB	HIGHWAY NO.
0009	13	197, ETC	IH 30, ETC

**INDEX OF SHEETS**  
SEE SHEET 2 FOR INDEX OF SHEETS

**STATE OF TEXAS**  
**DEPARTMENT OF TRANSPORTATION**

**PLANS OF PROPOSED**  
**STATE HIGHWAY IMPROVEMENT**

FEDERAL AID PROJECT NO. F 2B24 (374), ETC.

**IH 30, ETC**  
**HUNT, ETC.**

NET LENGTH OF ROADWAY = VARIES  
NET LENGTH OF BRIDGE = VARIES  
NET LENGTH OF PROJECT = VARIES

LIMITS : SEE SAFETY LIGHTING LIMITS ON LOCATION MAPS  
FOR THE CONSTRUCTION OF SAFETY LIGHTING

**FINAL PLANS**

LETTING DATE: \_\_\_\_\_  
DATE CONTRACTOR BEGAN WORK: \_\_\_\_\_  
DATE WORK WAS COMPLETED: \_\_\_\_\_  
DATE WORK WAS ACCEPTED: \_\_\_\_\_  
ORIGINAL CONTRACT WORKING DAYS: \_\_\_\_\_  
USED \_\_\_\_\_ OF \_\_\_\_\_ WORKING DAYS  
NO. OF CHANGE ORDERS: \_\_\_\_\_  
FINAL CONTRACT COST: \_\_\_\_\_  
PERCENT OVER/UNDER RUN: \_\_\_\_\_  
CONTRACTOR: \_\_\_\_\_

SEE ADDITIONAL LOCATION MAPS ON SHEETS  
3, 4, 5, 6, and 7  
FOR SAFETY LIGHTING PROJECT LOCATIONS  
AND PROJECT LIMITS

REQUIRED SIGNS SHALL BE IN ACCORDANCE WITH  
BC (1)- 21 THRU BC (12)- 21 AND THE "TEXAS  
MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES".

I CERTIFY THAT THIS PROJECT WAS BUILT IN  
ACCORDANCE WITH PLANS AND SPECIFICATIONS.

AREA ENGINEER \_\_\_\_\_ DATE \_\_\_\_\_

EXCEPTIONS: NONE  
EQUATIONS: NONE  
RAILROAD CROSSINGS: NONE

SPECIFICATIONS ADOPTED BY THE TEXAS DEPARTMENT OF  
TRANSPORTATION, NOVEMBER 1, 2014 AND SPECIFICATION ITEMS  
LISTED AND DATED AS FOLLOWS, SHALL GOVERN ON THIS PROJECT: REQUIRED  
CONTRACT PROVISIONS FOR ALL FEDERAL-AID CONSTRUCTION CONTRACTS  
(FORM FHWA 1273, OCTOBER 23, 2023)

© 2024  
BY TEXAS DEPARTMENT OF TRANSPORTATION  
ALL RIGHTS RESERVED.



SUBMITTED FOR LETTING: 4/19/2024

*[Signature]*  
TRAFFIC ENGINEER

RECOMMENDED FOR LETTING: 4/26/2024

DocuSigned by:  
*James Atkins*  
A2C81980FB88444 AREA ENGINEER

APPROVED FOR LETTING: 4/30/2024


DocuSigned by:  
*Noel Paramanantam*  
AF7AF41AFE80495 DISTRICT ENGINEER

FILE: T:\PARTRAF\ASHLEY\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\TITLE SHEET.dgn  
DATE: 4/18/2024 9:40:16 AM

DATE: 4/18/2024 10:25:37 AM  
 FILE: \\FS-PARHO.dot.state.tx.us\Dot1\Dot0\PAR\Groups\PARTRAF\ASHLEY\PROJECTS\Safety Lighting\let\_8-24\DESIGN PLANS\INDEX\SHEET.dgn

# INDEX OF SHEETS

<u>SHEET #</u>	<u>DESCRIPTION</u>	<u>SHEET #</u>	<u>DESCRIPTION</u>	<u>SHEET #</u>	<u>DESCRIPTION</u>
	<b>GENERAL</b>		<b>GENERAL</b>		<b>STANDARDS</b>
1	TITLE SHEET		<b>SH 24 AT BS 24D</b>		
2	INDEX OF SHEETS	35	ILLUMINATION LAYOUT1	>>	71 EC(1)-16
3	HUNT COUNTY PROJECT LOCATION MAP	36	QUANTITY SUMMARY		72-74 SWP3
4	LAMAR COUNTY PROJECT LOCATION MAP		<b>SH 24 AT FM 198</b>		75 EPIC
5	DELTA COUNTY PROJECT LOCATION MAP	37	ILLUMINATION LAYOUT		
6	HOPKINS COUNTY PROJECT LOCATION MAP	38	QUANTITY SUMMARY		
7	RAINS COUNTY PROJECT LOCATION MAP		<b>SH 19 AT FM 1536</b>		
8,8A-8B	GENERAL NOTES	39	ILLUMINATION LAYOUT		
9	ESTIMATE & QUANTITY	40	QUANTITY SUMMARY		
	<b>IH 30 AT FM 513</b>		<b>FM 1567 AT FM 2297</b>		
10	ILLUMINATION LAYOUT	41	ILLUMINATION LAYOUT		
11	QUANTITY SUMMARY	42	QUANTITY SUMMARY		
	<b>FM 512 AT FM 2874</b>		<b>SH 154 AT CR 2174</b>		
12	ILLUMINATION LAYOUT	43	ILLUMINATION LAYOUT		
13	QUANTITY SUMMARY	44	QUANTITY SUMMARY		
	<b>SH 276 AT CR 3611</b>		<b>FM 2737 AT SH 276</b>		
14	ILLUMINATION LAYOUT	45	ILLUMINATION LAYOUT		
15	QUANTITY SUMMARY	46	QUANTITY SUMMARY		
	<b>SH 24 AT FM 2736</b>				
16	ILLUMINATION LAYOUT		<b>STANDARDS</b>		
17	QUANTITY SUMMARY				
	<b>SH 276 AT BS 276</b>				
18	ILLUMINATION LAYOUT	>>	47 BC (1)-21		
19	QUANTITY SUMMARY	>>	48 BC (2)-21		
	<b>US 82 AT FM 38</b>	>>	49 BC (3)-21		
20	ILLUMINATION LAYOUT	>>	50 BC (4)-21		
21	QUANTITY SUMMARY	>>	51 BC (5)-21		
	<b>US 271 AT FM 1499</b>	>>	52 BC (6)-21		
22	ILLUMINATION LAYOUT	>>	53 BC (7)-21		
23	QUANTITY SUMMARY	>>	54 BC (8)-21		
	<b>US 271 AT TIMBERLAKES RD / BEAVER CREEK</b>	>>	55 BC (9)-21		
24	ILLUMINATION LAYOUT	>>	56 BC (10)-21		
25	QUANTITY SUMMARY	>>	57 BC (11)-21		
	<b>US 271 AT GATE II RD</b>	>>	58 BC (12)-21		
26	ILLUMINATION LAYOUT	>>	59 TCP(2-1)-18		
27	QUANTITY SUMMARY	>>	60 TCP(2-2)-18		
	<b>FM 195 AT FM 196</b>	>>	61 ED(1)-14		
28	ILLUMINATION LAYOUT	>>	62 ED(5)-14		
29	QUANTITY SUMMARY	>>	63 ED(6)-14		
	<b>SL 286 AT FM 1507</b>	>>	64 ED(7)-14		
30	ILLUMINATION LAYOUT	>>	65 RID(1)-20		
31	QUANTITY SUMMARY	>>	66 RID(2)-20		
	<b>SH 24 AT FM 1528</b>	>>	67 RIP(1)-19		
32	ILLUMINATION LAYOUT 1 OF 2	>>	68 RIP(2)-19		
33	ILLUMINATION LAYOUT 2 OF 2	>>	69 RIP(3)-19		
34	QUANTITY SUMMARY	>>	70 RIP(4)-19		



THE STANDARD SHEETS SPECIFICALLY IDENTIFIED WITH A ">>" HAVE BEEN ISSUED BY ME AND ARE APPLICABLE TO THIS PROJECT.

4/19/2024  
 NAME \_\_\_\_\_ DATE


## IH 30, ETC. INDEX OF SHEETS

© 2024


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		2

FILE: \\fs-parhq.dot.state.tx.us\data\data\groups\par\tr\ashley\projects\safety\lighting\let\*8-24\design\plans\Hunt\HUNT COUNTY PROJECT LOCATION MAP.dgn  
 DATE: 4/18/2024

# HUNT COUNTY


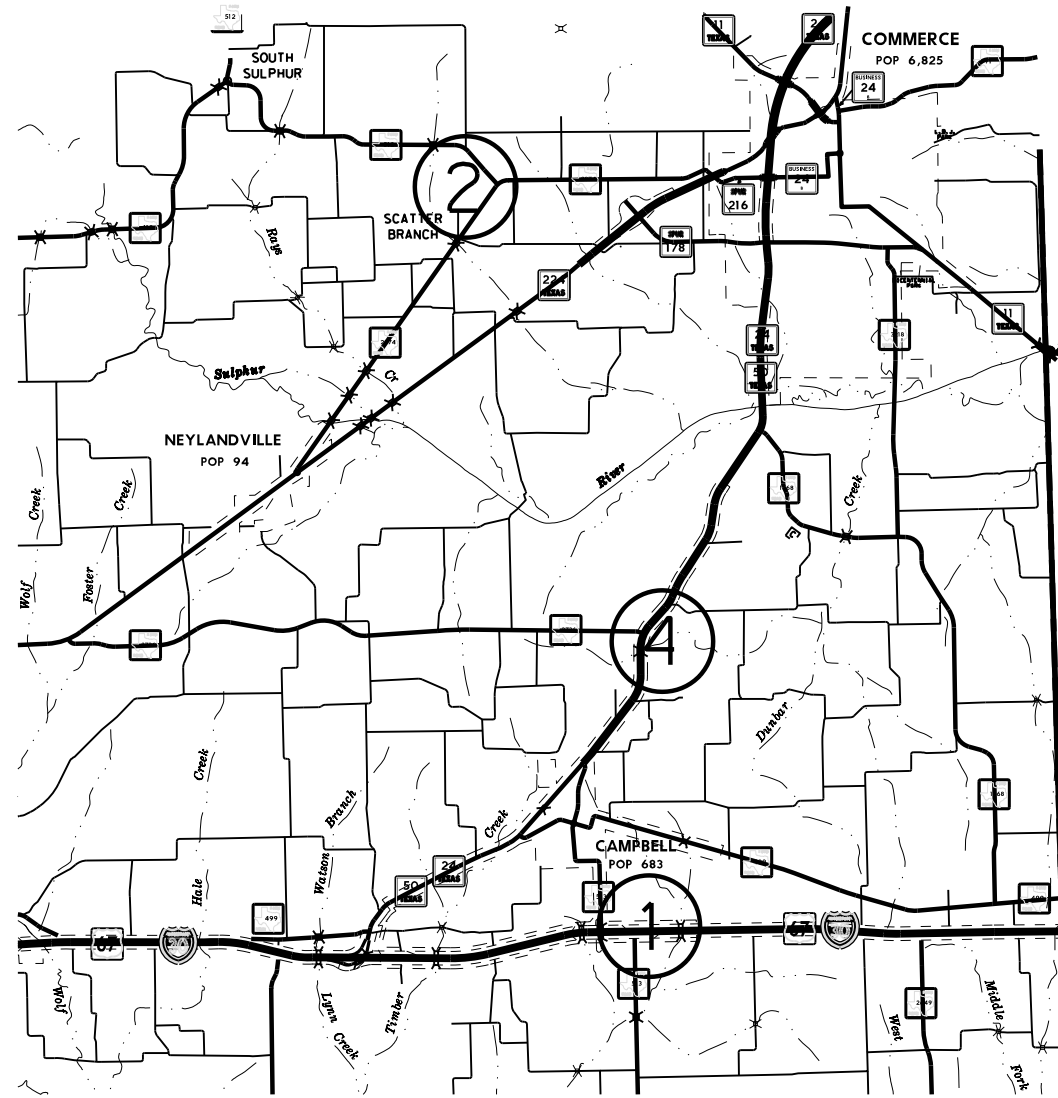


SCALE



## SAFETY LIGHTING LOCATIONS

HUNT COUNTY			LIMITS		
REFERENCE NUMBER	HIGHWAY	C-S-J	DESCRIPTION	TRM BEGIN	TRM END
①	IH 30	0009-13-197	IH 30 AT FM 513	104+0.098	104+0.098
②	FM 512	0579-02-015	FM 512 AT FM 2874	236+1.089	236+1.089
③	SH 276	0641-01-039	SH 276 AT CR 3611	632+0.931	632+0.931
④	SH 24	0768-01-059	SH 24 AT FM 2736	246+1.982	246+1.982
⑱	SH 276	1290-09-002	SH 276 AT BS 276	624+0.756	624+0.756

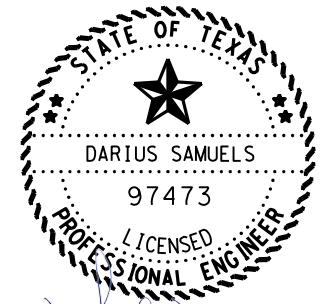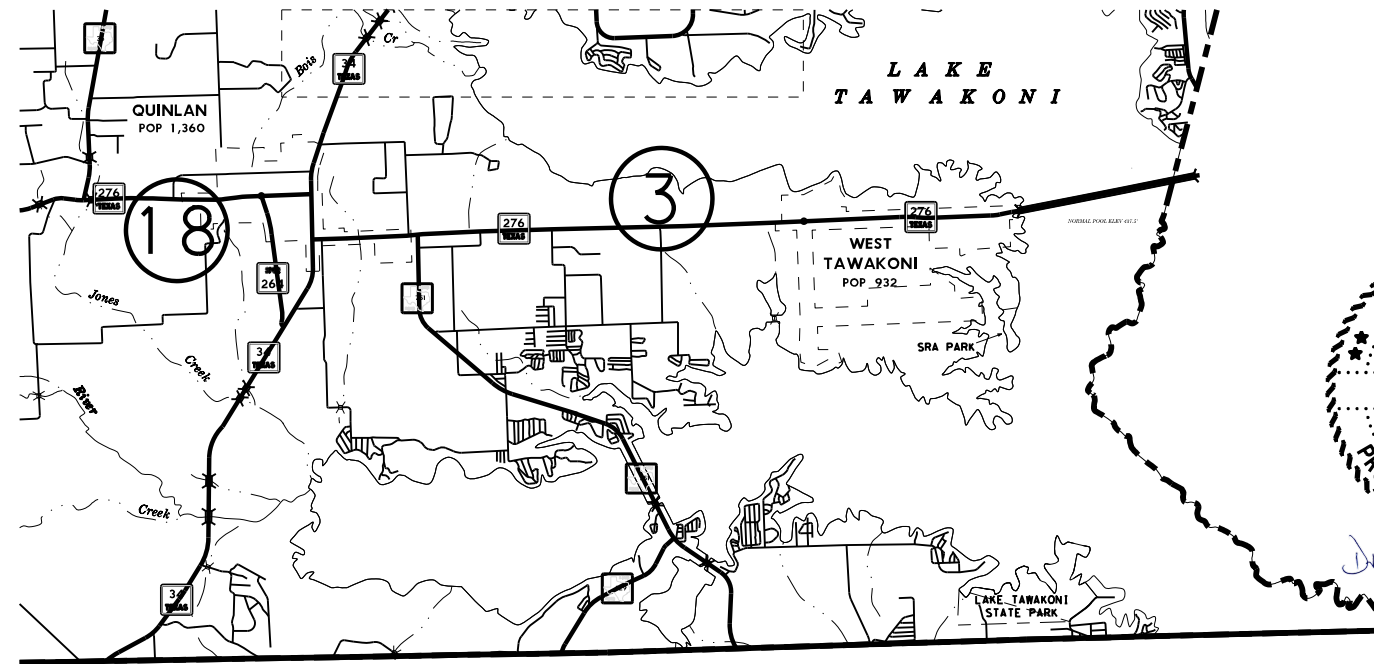

4/19/2024



### HUNT COUNTY PROJECT LOCATION MAP




CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		3

# SAFETY LIGHTING LOCATIONS

## LAMAR COUNTY

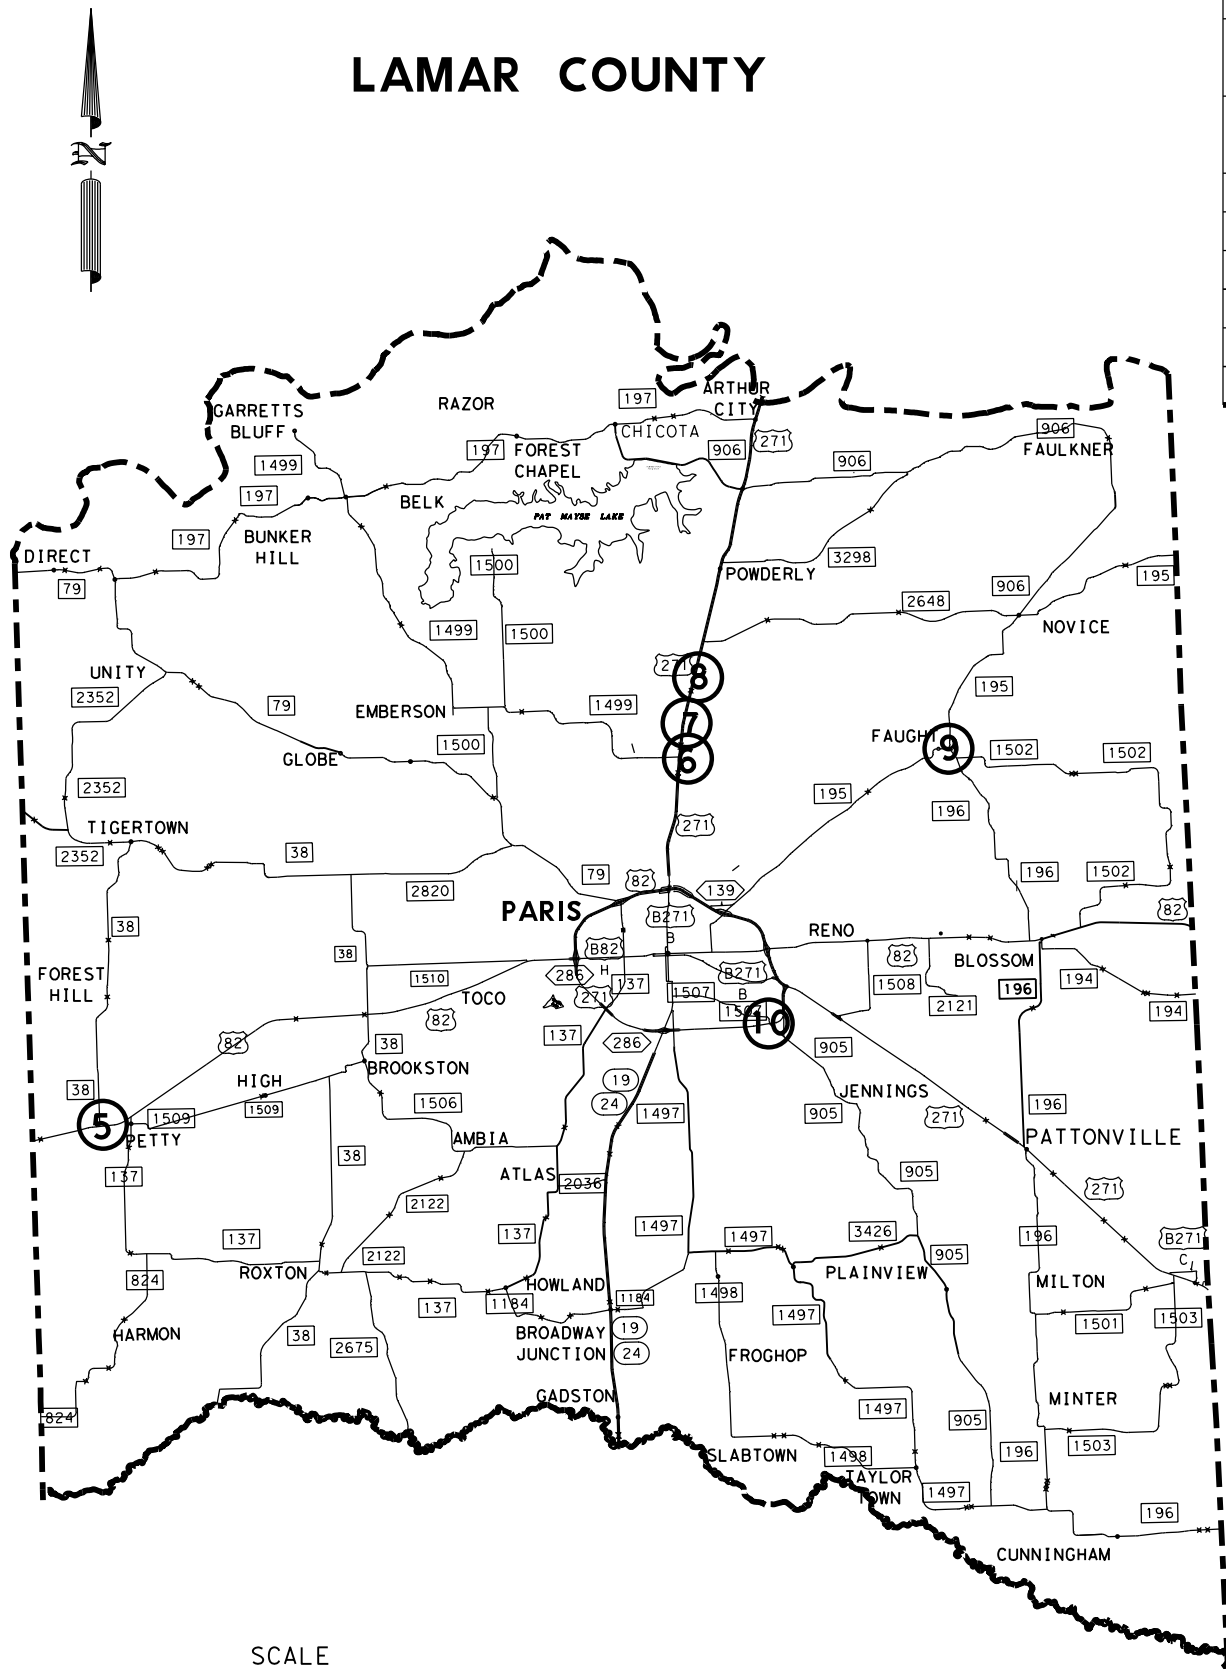


LAMAR COUNTY			LIMITS		
REFERENCE NUMBER	HIGHWAY	C-S-J	DESCRIPTION	TRM BEGIN	TRM END
⑤	US 82	0045-08-042	US 82 AT FM 38	688+1.842	688+1.842
⑥	US 271	0136-07-054	US 271 AT FM 1499	194+1.842	194+1.842
⑦	US 271	0136-08-048	US 271 AT TIMBERLAKES RD/BEAVER CREEK	194+0.915	194+0.915
⑧	US 271	0136-08-049	US 271 AT GATE II RD	194+0.281	194+0.281
⑨	FM 195	0730-02-061	FM 195 AT FM 196	664+0.921	664+0.921
⑩	SL 286	1690-01-143	SL 286 AT FM 1507	656+1.962	656+1.962

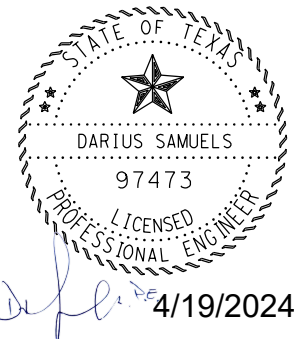

### LAMAR COUNTY PROJECT LOCATION MAP


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		4

# DELTA COUNTY

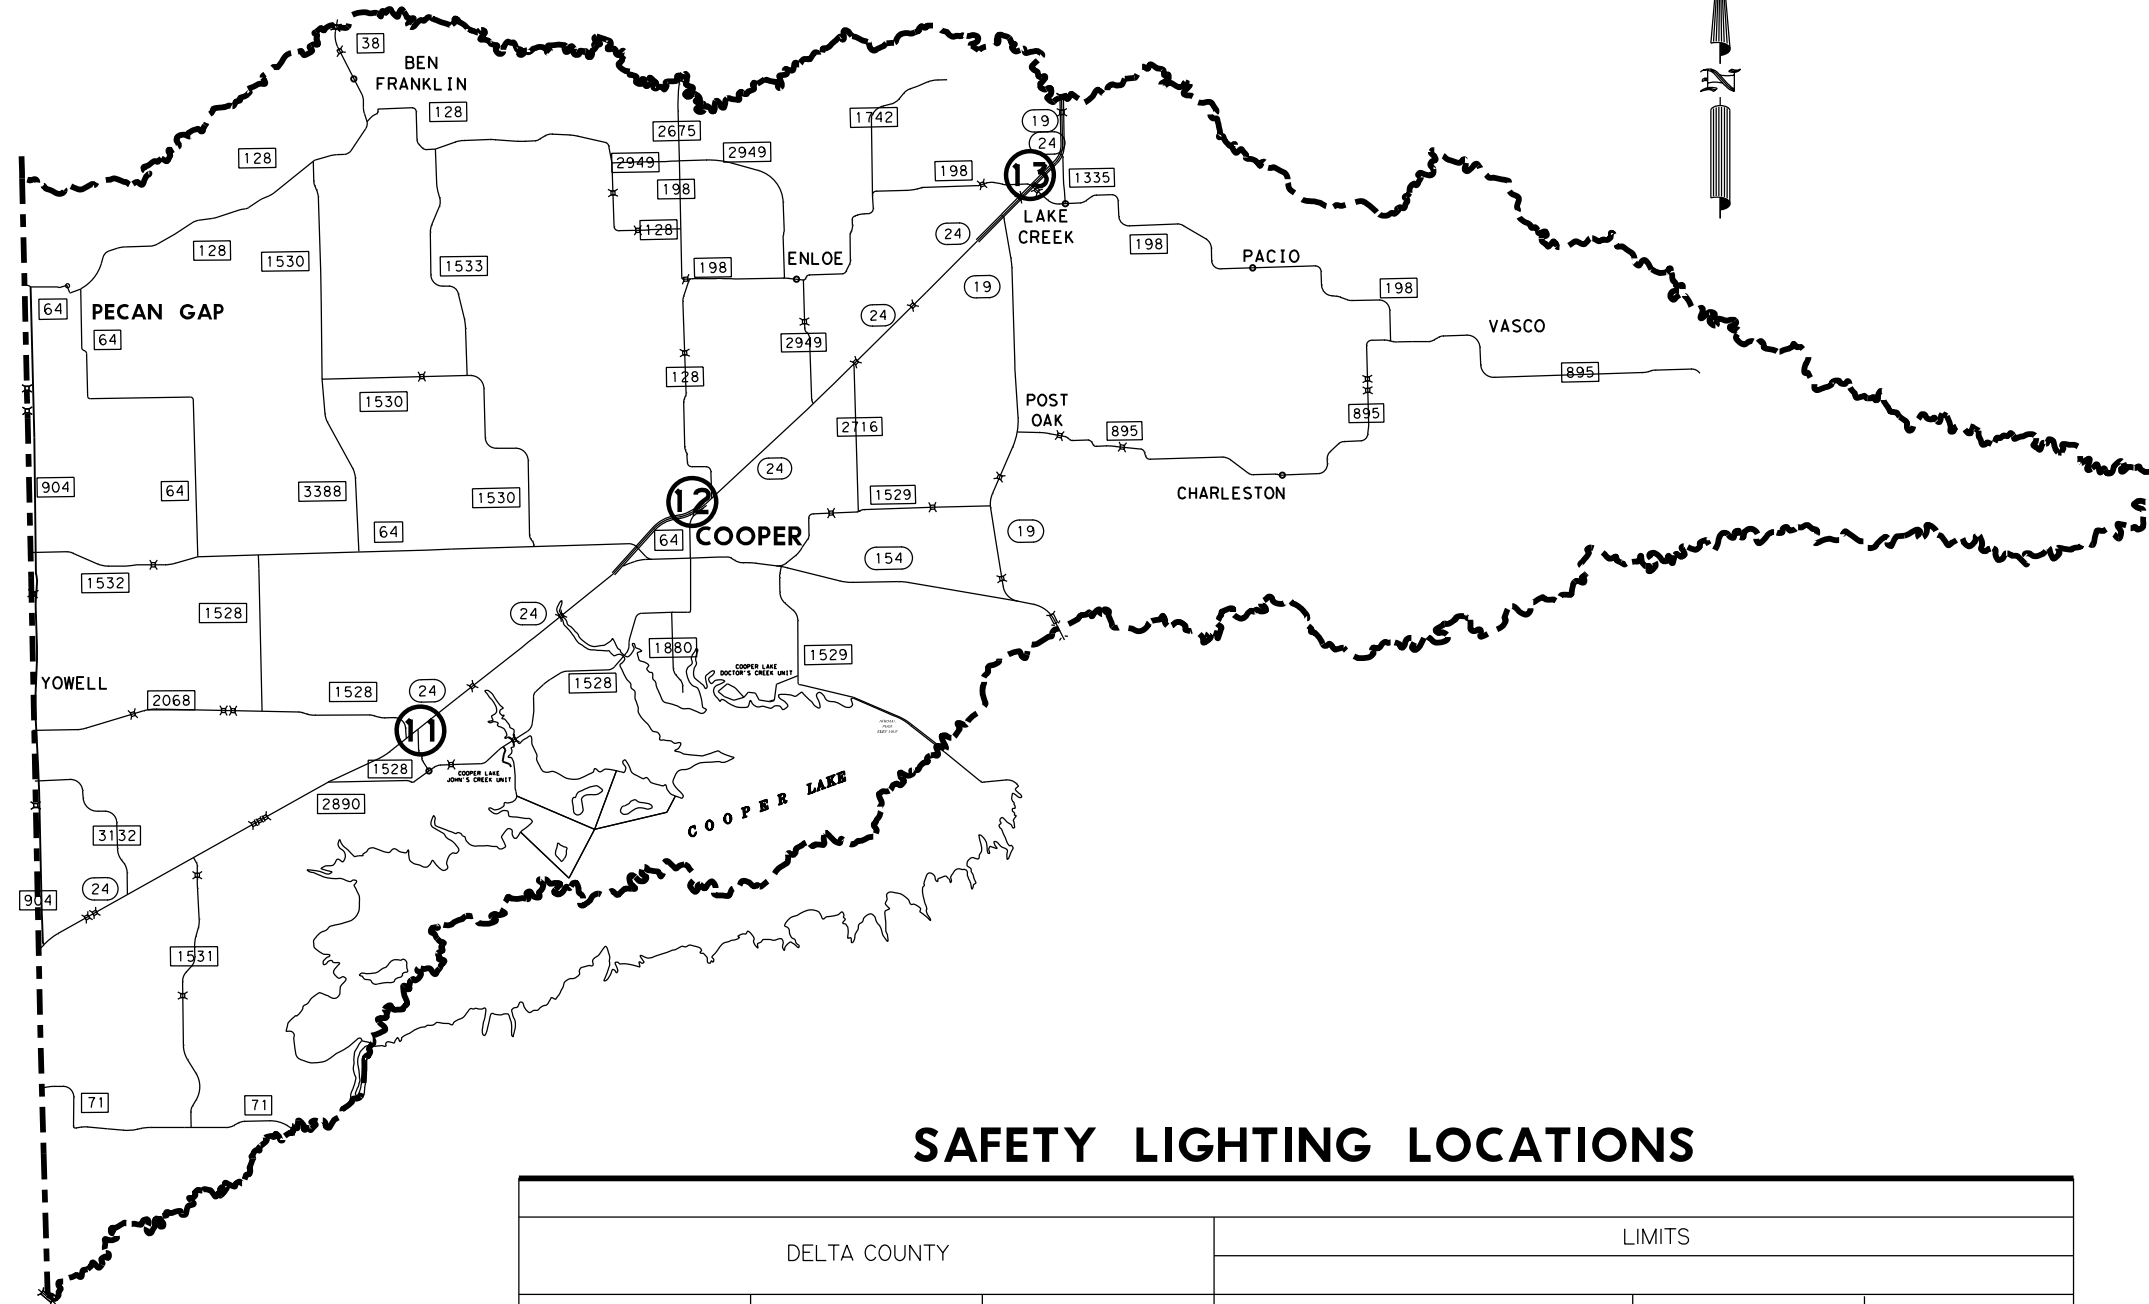

## SAFETY LIGHTING LOCATIONS

DELTA COUNTY			LIMITS		
REFERENCE NUMBER	HIGHWAY	C-S-J	DESCRIPTION	TRM BEGIN	TRM END
①	SH 24	0136-03-068	SH 24 AT FM 1528	230+0.023	230+0.023
②	SH 24	0136-03-069	SH 24 AT BS 24D	224+0.418	224+0.418
③	SH 24	0136-04-051	SH 24 AT FM 198	216+1.455	216+1.455

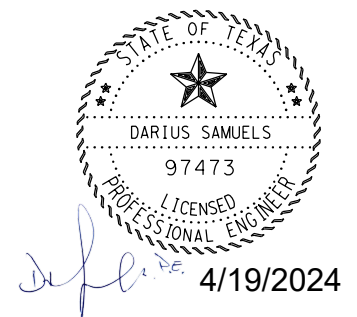




### DELTA COUNTY PROJECT LOCATION MAP

© 2024 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		5


FILE: \\fs-parhq.dot.state.tx.us\data1\data\par\groups\par\tr\af\ashley\projects\safety\lighting\let\*8-24\des\ign\plans\Hopkins\HOPKINS COUNTY PROJECT LOCATION MAP.dgn  
 DATE: 4/18/2024

# HOPKINS COUNTY

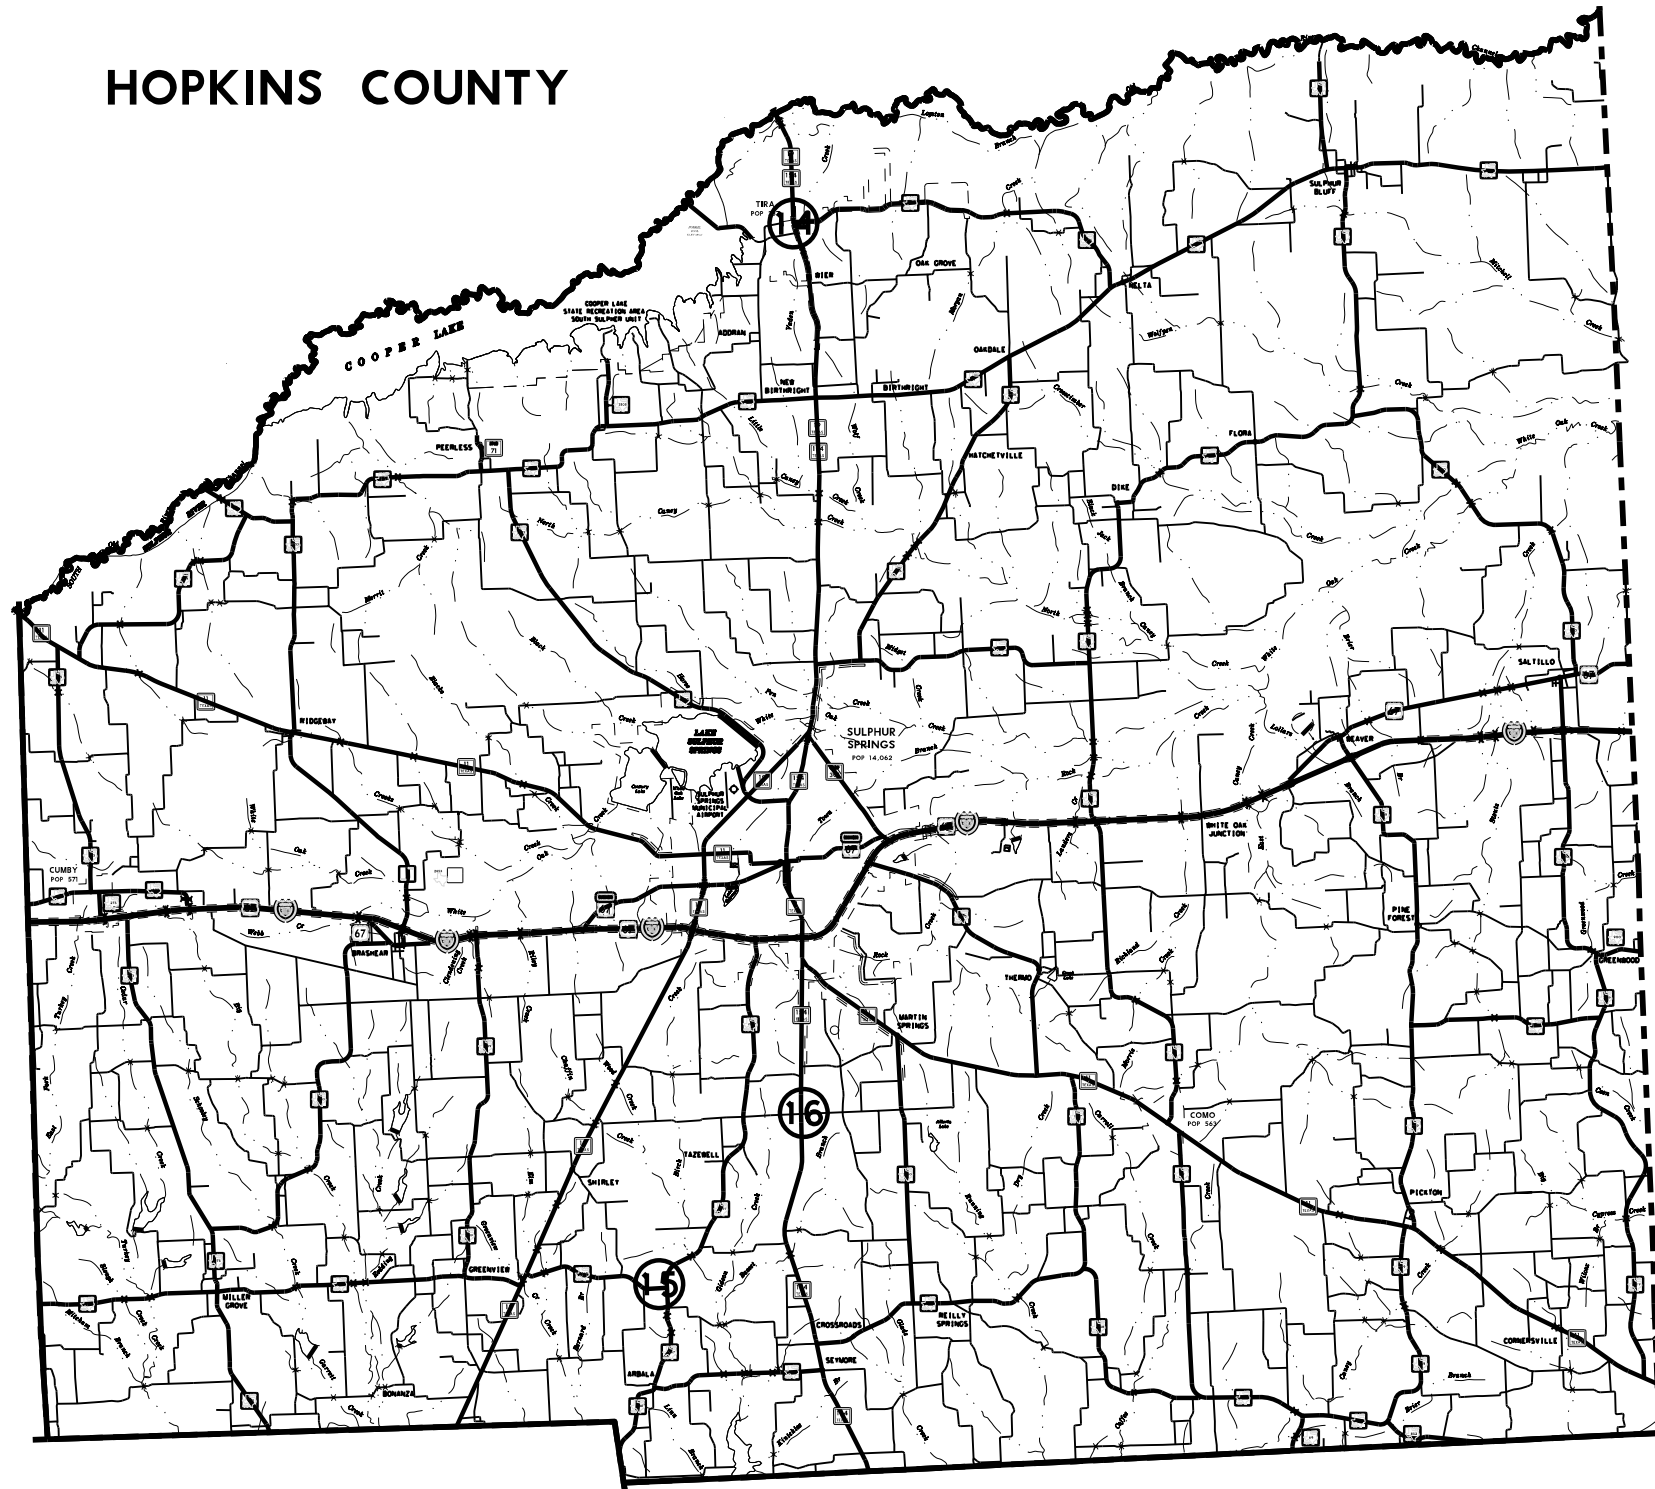


## SAFETY LIGHTING LOCATIONS

HOPKINS COUNTY			LIMITS		
REFERENCE NUMBER	HIGHWAY	C-S-J	DESCRIPTION	TRM BEGIN	TRM END
14	SH 19	0400-02-059	SH 19 AT FM 1536	228+0.092	228+0.092
15	FM 1567	0641-04-021	FM 1567 AT FM 2297	654+0.917	654+0.917
16	SH 154	0401-01-036	SH 154 AT CR 2174	674+0.15	674+0.15

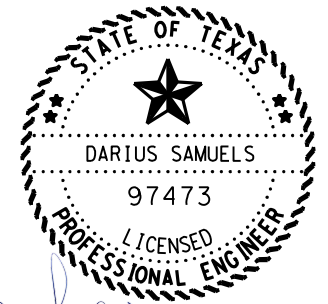


*Darius Samuels*  
 4/19/2024

### HOPKINS COUNTY PROJECT LOCATION MAP

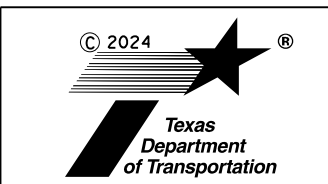


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		6

# RAINS COUNTY

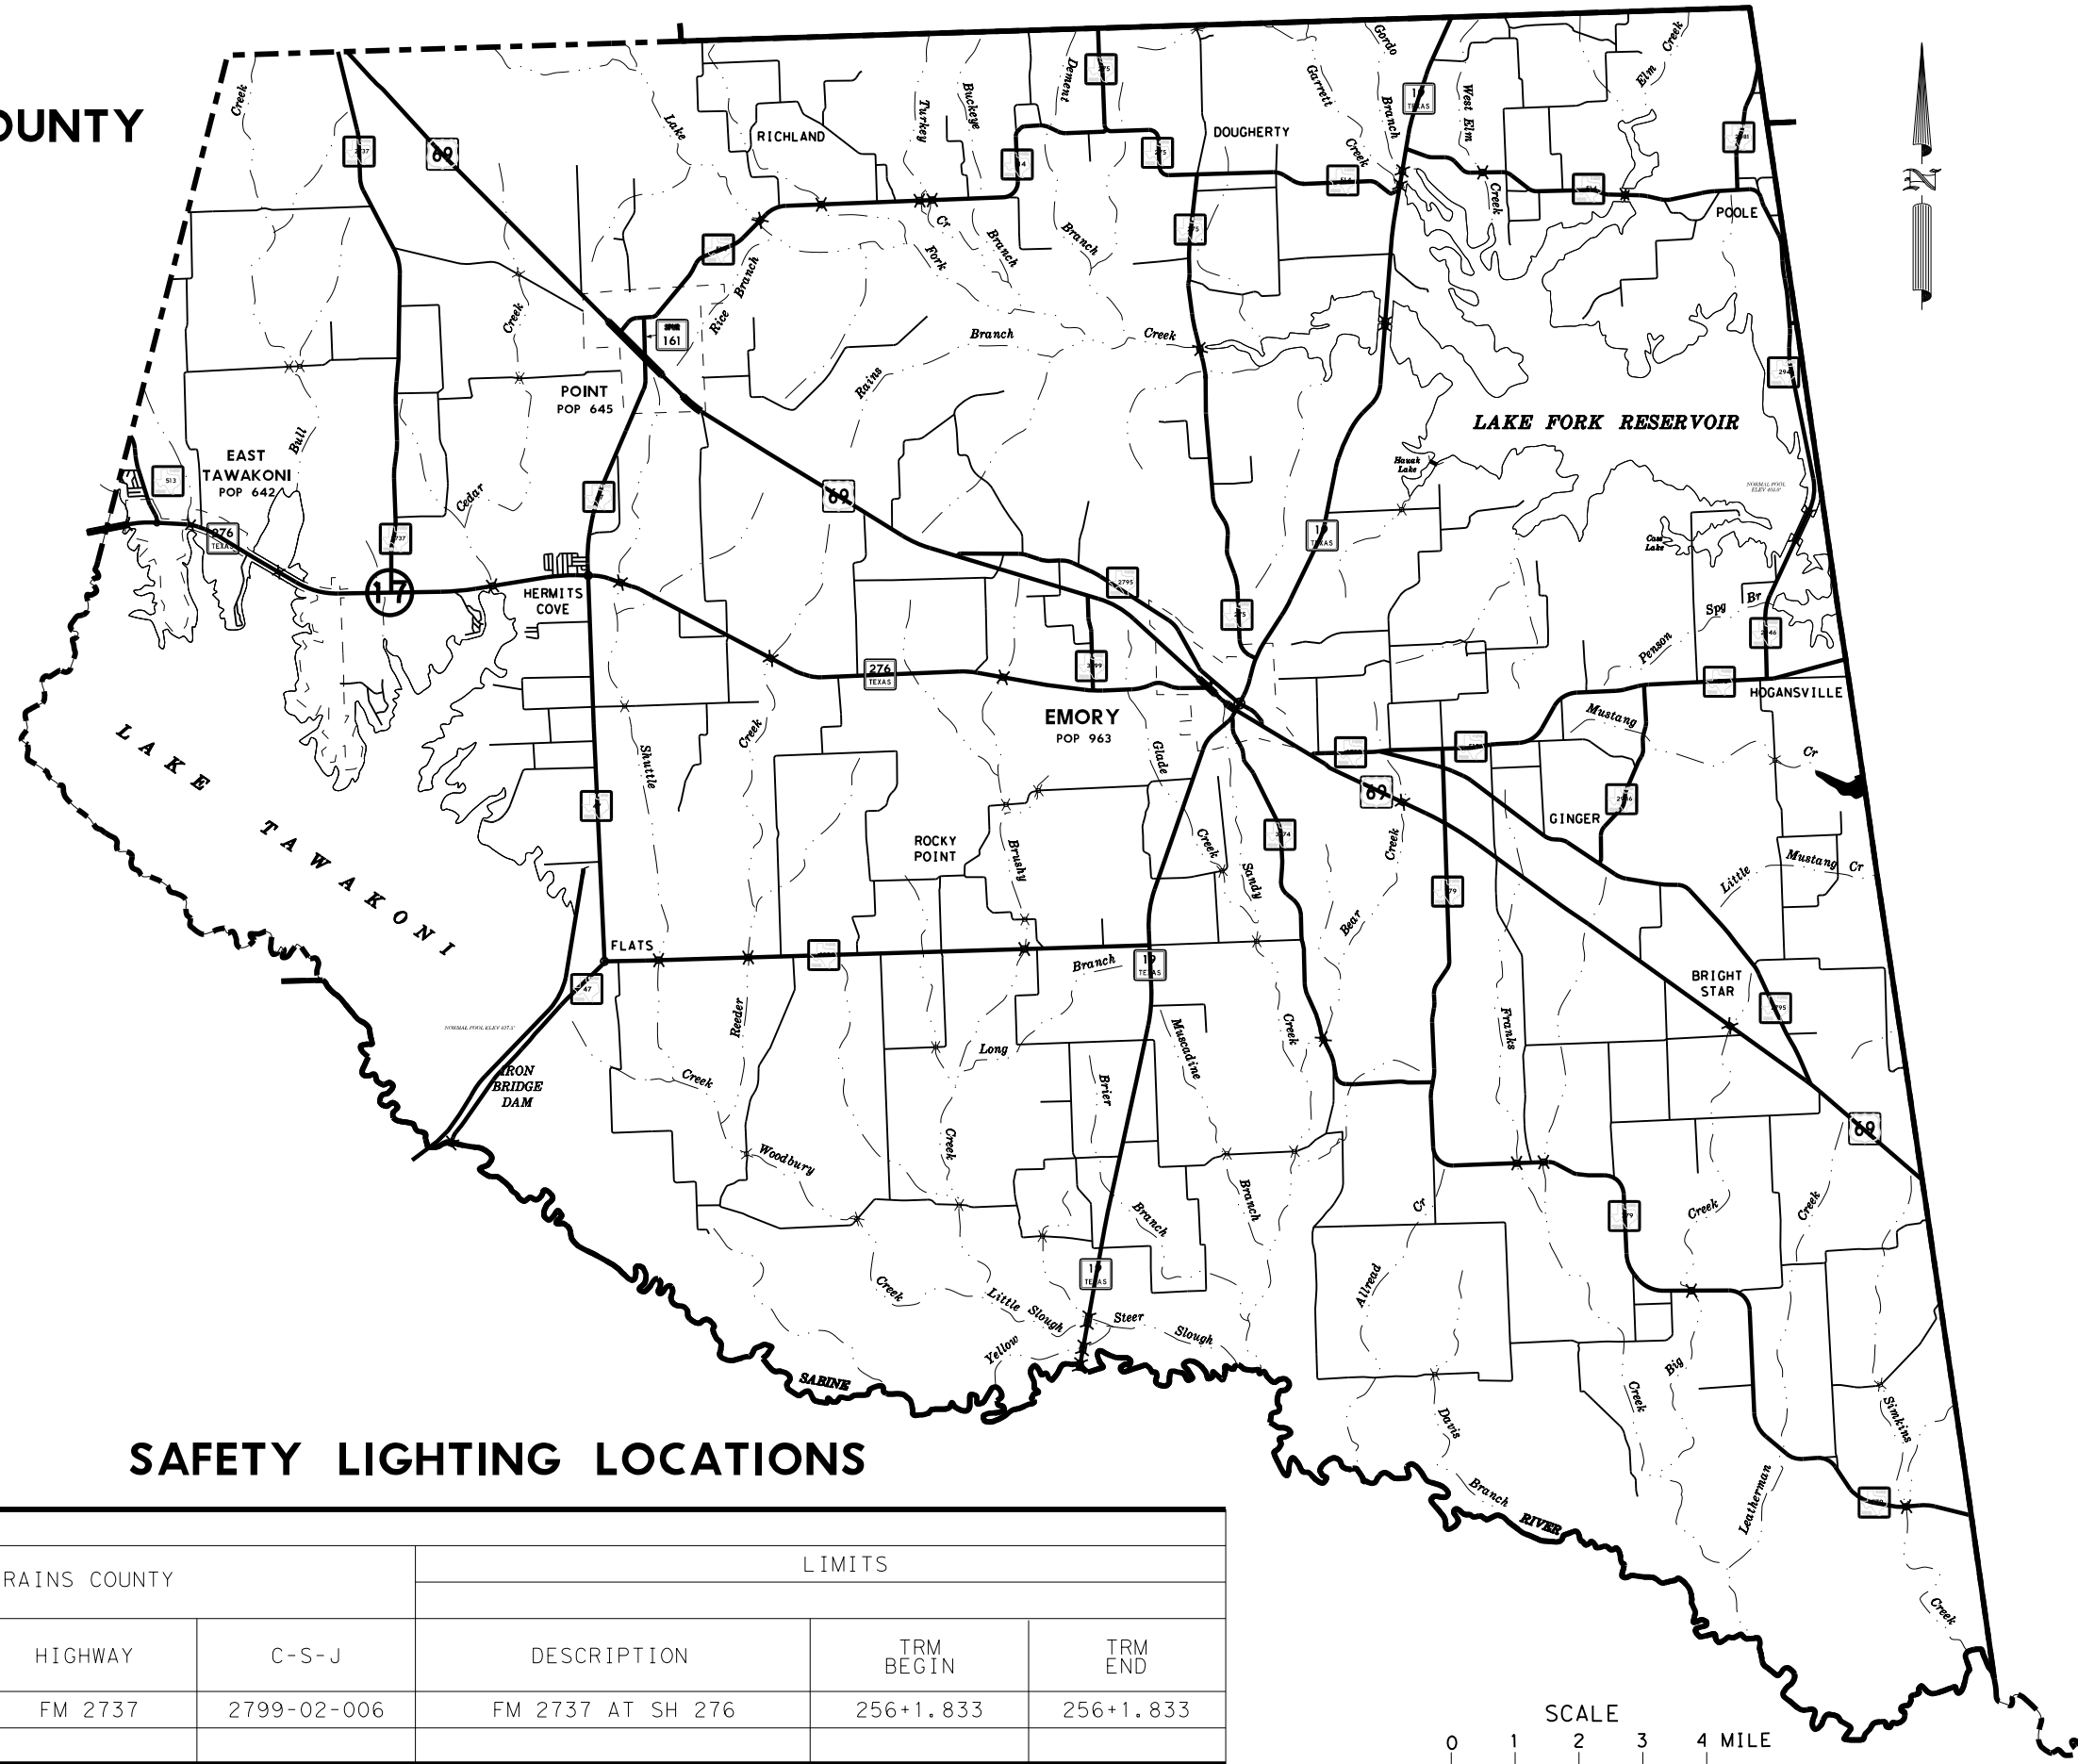

## SAFETY LIGHTING LOCATIONS

RAINS COUNTY			LIMITS		
REFERENCE NUMBER	HIGHWAY	C-S-J	DESCRIPTION	TRM BEGIN	TRM END
17	FM 2737	2799-02-006	FM 2737 AT SH 276	256+1.833	256+1.833



STATE OF TEXAS  
 DARIUS SAMUELS  
 97473  
 LICENSED PROFESSIONAL ENGINEER  
*D.S.* 4/19/2024

### RAINS COUNTY PROJECT LOCATION MAP

© 2024 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		7

County: HUNT, ETC.

Control: 0009-13-197, ETC.

Highway: IH 30, ETC.

Sheet:

## GENERAL NOTES

### General:

Install lighting system in accordance with the current Texas Manual on Uniform Traffic Control Devices and the current National Electrical Code unless otherwise specified on the plans.

Electrical licenses and certifications for this project will be as per Item 7 of the current Texas Standard Specifications and any special provisions to Item 7.

Contractor questions on this project are to be addressed to the following individual(s):

#### Greenville Area Office

James Atkins II, P.E. - [James.Atkins@txdot.gov](mailto:James.Atkins@txdot.gov)

Willie Bolden II, P.E. - [Willie.Bolden@txdot.gov](mailto:Willie.Bolden@txdot.gov)

#### Traffic Operations

Darius Samuels - [Darius.Samuels@txdot.gov](mailto:Darius.Samuels@txdot.gov)

Questions may be submitted via the Letting Pre-Bid Q&A web page. This webpage can be accessed from the Notice to Contractors dashboard located at the following Address:

<https://tableau.txdot.gov/views/ProjectInformationDashboard/NoticetoContractors>

All contractor questions will be reviewed by the Engineer. All questions and any corresponding responses that are generated will be posted through the same Letting Pre-Bid Q&A web page.

The Letting Pre-Bid Q&A web page for each project can be accessed by using the dashboard to navigate to the project you are interested in by scrolling or filtering the dashboard using the controls on the left. Hover over the blue hyperlink for the project you want to view the Q&A for and click on the link in the window that pops up.

On Contractor request, construction timelines will be posted to TxDOT's Public FTP at the following Address:

<https://ftp.dot.state.tx.us/pub/txdot-info/Pre-Letting%20Responses/>

The site is organized by District, Project Type (Construction or Maintenance), Letting Date, CCSJ/Project Name.

Dispose of waste materials at an approved site. Furnish written approval from the property owner before disposal of waste materials.

Locate equipment a minimum of 30 feet from roadway when possible. Place signs and barricades as approved.

Stockpile sites for construction materials must be approved. Give at least 48 hours notification prior to stockpiling material.

County: HUNT, ETC.

Control: 0009-13-197, ETC.

Highway: IH 30, ETC.

Sheet: 8

Furnish all materials and repair any sod, pavement, sidewalk, or other property damaged during the course of the construction, this is according to Article 7.15 of the standard specification. Ensure that all materials furnished are corrosion resistant and exhibit no rust.

Verify actual location of utilities and take adequate precautions to prevent damage to utilities, storm sewers, and existing signal equipment.

### Item 5 Control of the Work:

The responsibility for the construction surveying on this contract will be in accordance with Section 5.9.3, Method C.

Working days will be computed and charged in accordance with Article 8.3.1.4 Standard Work Week.

FINAL CLEANUP, prior to requesting final inspection the Contractor shall leave the work locations in a neat and presentable condition. This may include but is not limited to mowing, trimming and removal litter, debris, objectionable material, temporary structures, excess materials, and equipment from the work locations.

### Item 6 Control of Materials:

To comply with the latest provisions of Build America, Buy America Act (BABA Act) of the Bipartisan Infrastructure Law, the contractor must submit an original of the TxDOT Construction Material Buy America Certification Form for all items classified as construction materials. This form is not required for materials classified as a manufactured product.

Refer to the Buy America Material Classification Sheet for clarification on material categorization.

The Buy America Material Classification Sheet is located at the below link.

<https://www.txdot.gov/business/resources/materials/buy-america-material-classification-sheet.html>

### Item 7 Legal Relations and Responsibilities:

No significant traffic generator events identified.

### Item 8 Prosecution and Progress:

Before beginning work on this project submit in writing, for approval, a plan of construction operations outlining in detail a sequence of work to be followed.

Provide a Bar Chart progress schedule for this project.

This project includes SP 008--056 which allows up to a 90-day delay to begin work on the project to acquire materials such as illumination poles.



County: HUNT, ETC.

Control: 0009-13-197, ETC.

Highway: IH 30, ETC.

Sheet:

**Item 9 Measurement and Payment:**

Items of work for the Monthly Estimate will be cut off on the 25<sup>th</sup> of each month. Items of work performed after the 25<sup>th</sup> will be processed and paid on the following month's estimate. Material On Hand (MOH) will cut off on the 20<sup>th</sup> of each month. Special circumstances will be considered on a case-by-case basis.

Maintain all new equipment on the project until accepted by TxDOT.

**Item 416 Drill shaft foundations:**

The locations shown on the plans for pole foundations are approximate. Extend all illumination pole foundations at least ten feet below ground.

Dispose of all excavated material off right-of-way at an approved location.

Concrete riprap is required for drill shaft foundations for Roadway Illumination Assemblies as shown on standard sheet RID (2-20).

Provide single pole watertight breakaway electrical connectors shown on the TxDOT's Material Producer List (MPL) in the file "Roadway Illumination and Electrical Supplies." See the latest RID (1-20) standard for additional details.

**Item 502 Barricades, Signs and Traffic Handling:**

The Contractor Force Account "Safety Contingency" that has been established for this project is intended to be utilized for work zone enhancements, to improve the effectiveness of the Traffic Control Plan, that could not be foreseen in the project planning and design stage. These enhancements will be mutually agreed upon by the Engineer and the Contractor's Responsible Person based on weekly or more frequent traffic management reviews on the project. The Engineer may choose to use existing bid items if it does not slow the implementation of enhancement.

The following items will be required for flagger on this project:

1. Flaggers are required to wear a white hard hat while performing flagging operations.
2. Flaggers will be required at the intersection of all State maintained roadways.
3. Flaggers may be required at other high traffic generating intersections as deemed necessary by the Area Engineer.

The traffic control plan for this contract consists of the installation and maintenance of warning signs and other traffic control devices shown in the plans, specification data which may be included in the general notes, applicable provisions of the Texas Manual on Uniform Traffic Control Devices (TMUTCD), traffic control plan sheets included in the plans, standard BC sheets and Item 502 of the Standard Specifications.

County: HUNT, ETC.

Control: 0009-13-197, ETC.

Highway: IH 30, ETC.

Sheet: 8A

Do not begin Item 502, Barricades, Signs, and Traffic Handling, on the roadway until both of the following conditions are met:

1. The work schedule is approved.
2. No more than 5 workdays will pass between the beginning of Item 502 and the actual commencement of roadway work bid items.

Furnish a phone number reachable 24 hours a day. Be available to return call within two hours.

Ensure that all travel lanes are open at night.

The final estimate will be withheld until all disturbed areas are covered with at least 70% perennial vegetative cover.

Correct all deficiencies within the time frame noted on the Traffic Control Device Inspection Form 599. Failure to make corrections within time frame specified may result in no payment for this Item for the month of the noted deficiency.

Provide shadow vehicles equipped with Truck Mounted Attenuators (TMA) as shown on Traffic Control Plan (TCP) standards.

**Item 506 Temporary Erosion, Sedimentation & Environmental Controls:**

The Storm Water Pollution Prevention Plan (SWP3) consists of temporary erosion control measures needed and provided for under this Item. The disturbed area is less than one acre and use of erosion control measures is not anticipated. If physical conditions encountered at the job site require necessary controls, BMP installation, maintenance, and removal will be paid as extra work on a force account basis per Articles 4.4 and 9.7. (Total project: 900 LF TEMP SEDMT CONT FENCE)

It is the intent of this contract that no disturbance of vegetation occurs as a result of the roadway operations. However, if vegetation is disturbed, treat the disturbed area as follows at no additional costs to the department.

Place temporary sediment control fence, or an alternative material as approved, to minimize and control the amount of sediment that might enter receiving waters from the disturbed area(s). Maintain the sediment controls in a satisfactory manner until the disturbed area(s) is stabilized. After the area(s) has been stabilized, remove the sediment controls. The location and length of the sediment controls will be determined.

The work performed, materials furnished, equipment, labor, tools, and incidentals will not be measured or paid for directly but will be considered subsidiary to the various bid items.

County: HUNT, ETC.

Control: 0009-13-197, ETC.

Highway: IH 30, ETC.

Sheet:

**Item 610 Roadway Illumination Assemblies:**

Luminaries are located as shown on plans.

Label each luminaire pole and controller cabinet with a number according to the plans. Provide 4 in. black vinyl characters or stenciled painted characters.

Fabricate steel roadway illumination poles in accordance with TxDOT RIP standard sheets. Poles fabricated according to the RIP Standards require no shop drawings.

Alternate designs to RIP 2019 or the use of aluminum to fabricate poles will require the submission of shop drawings electronically. For instructions on submitting shop drawings electronically go to TxDOT home page, Business with TxDOT, Bridge information, Shop drawings. File is titled: "Guide to Electronic Shop Drawing Submittal."

After construction is complete, all circuits are checked, and it is determined that the luminaires are ready to turn on, notify District Transportation Operations to perform a preliminary check of all illumination plan details. When District Transportation Operations deem the system is complete, begin the test period.

**Item 618 Conduit:**

Use rigid metal sweep ells for all conduits entering the controller base.

Rigid metallic conduit elbows that are required to be installed on conduit system will not be paid for directly but will be considered subsidiary to the various bid items.

Where the rigid metal conduit is exposed at any point, and where rigid metal conduit extends into ground boxes, bond the metal conduit to the grounding conductor with grounding type bushings or by other UL listed grounding connectors as approved.

Attach all conduits to any type of pole with conduit straps spaced at maximum intervals of five feet and within three feet of each side of any enclosure.

Provide boring equipment capable of tracking location and depth of bore head at all times. Bore head must be able to change bore direction without removing bore head. Mark depth of conduit at ten foot intervals along the length of bore and provide a copy of depth and location information.

Make all threaded conduit and conduit fittings wrench tight.

Shore pits for jacking or boring conduit when closer than five feet to the back of the curb. Consider shoring subsidiary to this item.

County: HUNT, ETC.

Control: 0009-13-197, ETC.

Highway: IH 30, ETC.

Sheet: 8B

Maintain a minimum vertical cover of 24 inches on all conduits except when it crosses flow line at which point it is a minimum of 36 inches.

Maximum depth of sweep ells will be 36 inches unless otherwise shown.

**Item 628 Electrical services:**

Install according to utility company requirements. Coordinate service with Engineer.

Install the supplied streetlight monitoring and control system on each electrical service. Each system will be furnished by the state. The installation will not be paid for directly but will be subsidiary to this item.

**Item 6185 Truck Mounted Attenuators:**

Use TMAs for in situations where work vehicles may encroach active traffic lanes or as directed.

Shadow vehicles with truck mounted attenuator (TMA) are required on the traffic control plan and TCP standards for this project. The contractor will be responsible for determining if one or more of these traffic control operations will be ongoing at the same time to determine the total number of TMAs needed for the project.



CONTROLLING PROJECT ID 0009-13-197

DISTRICT Paris

COUNTY Delta, Hopkins, Hunt, Lamar, Rains

HIGHWAY FM 1567, FM 195, FM 2737, FM 512, IH 30, SH 154, SH 19, SH 24, SH 276, SL 286, US 271, US 82

# Estimate & Quantity Sheet

ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL
	416-6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	LF	624.000	
	432-6001	RIPRAP (CONC)(4 IN)	CY	27.300	
	500-6001	MOBILIZATION	LS	1.000	
	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	MO	11.000	
	506-6038	TEMP SEDMT CONT FENCE (INSTALL)	LF	900.000	
	506-6039	TEMP SEDMT CONT FENCE (REMOVE)	LF	900.000	
	610-6214	IN RD IL (TY SA) 40T-8 (250W EQ) LED	EA	78.000	
	618-6075	CONDT (RM) (3") (BORE)	LF	2,085.000	
	622-6002	DCT CBL (3 NO.8) (2 INSULATED 1 BARE)	LF	13,870.000	
	628-6009	ELC SRV TY A 120/240 060(NS)SS(E)SP(O)	EA	18.000	
	6185-6002	TMA (STATIONARY)	DAY	126.000	
	16	MATERIAL FURNISHED BY THE STATE (PARTICIPATING)	LS	1.000	
	18	SAFETY CONTINGENCY: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS	1.000	
		EROSION CONTROL MAINTENANCE: CONTRACTOR FORCE ACCOUNT WORK (PART)	LS	1.000	

## ESTIMATE & QUANTITY






DISTRICT	COUNTY	CCSJ	SHEET
Paris	Hunt	0009-13-197	<b>9</b>

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hunt\IH30 AT FM 513.dgn  
 DATE: 4/18/2024 9:40:44 AM


**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ══ 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ⌈ 30' ⌋ 3" BORED RMC
- OVERHEAD POWERLINES

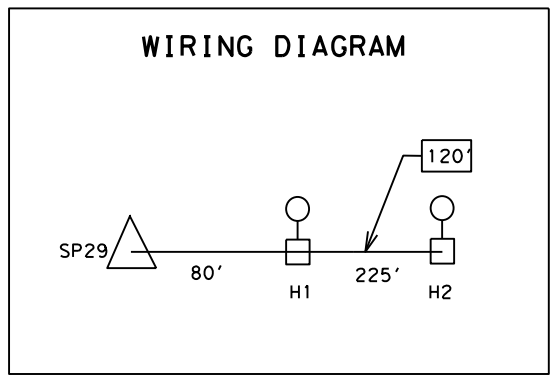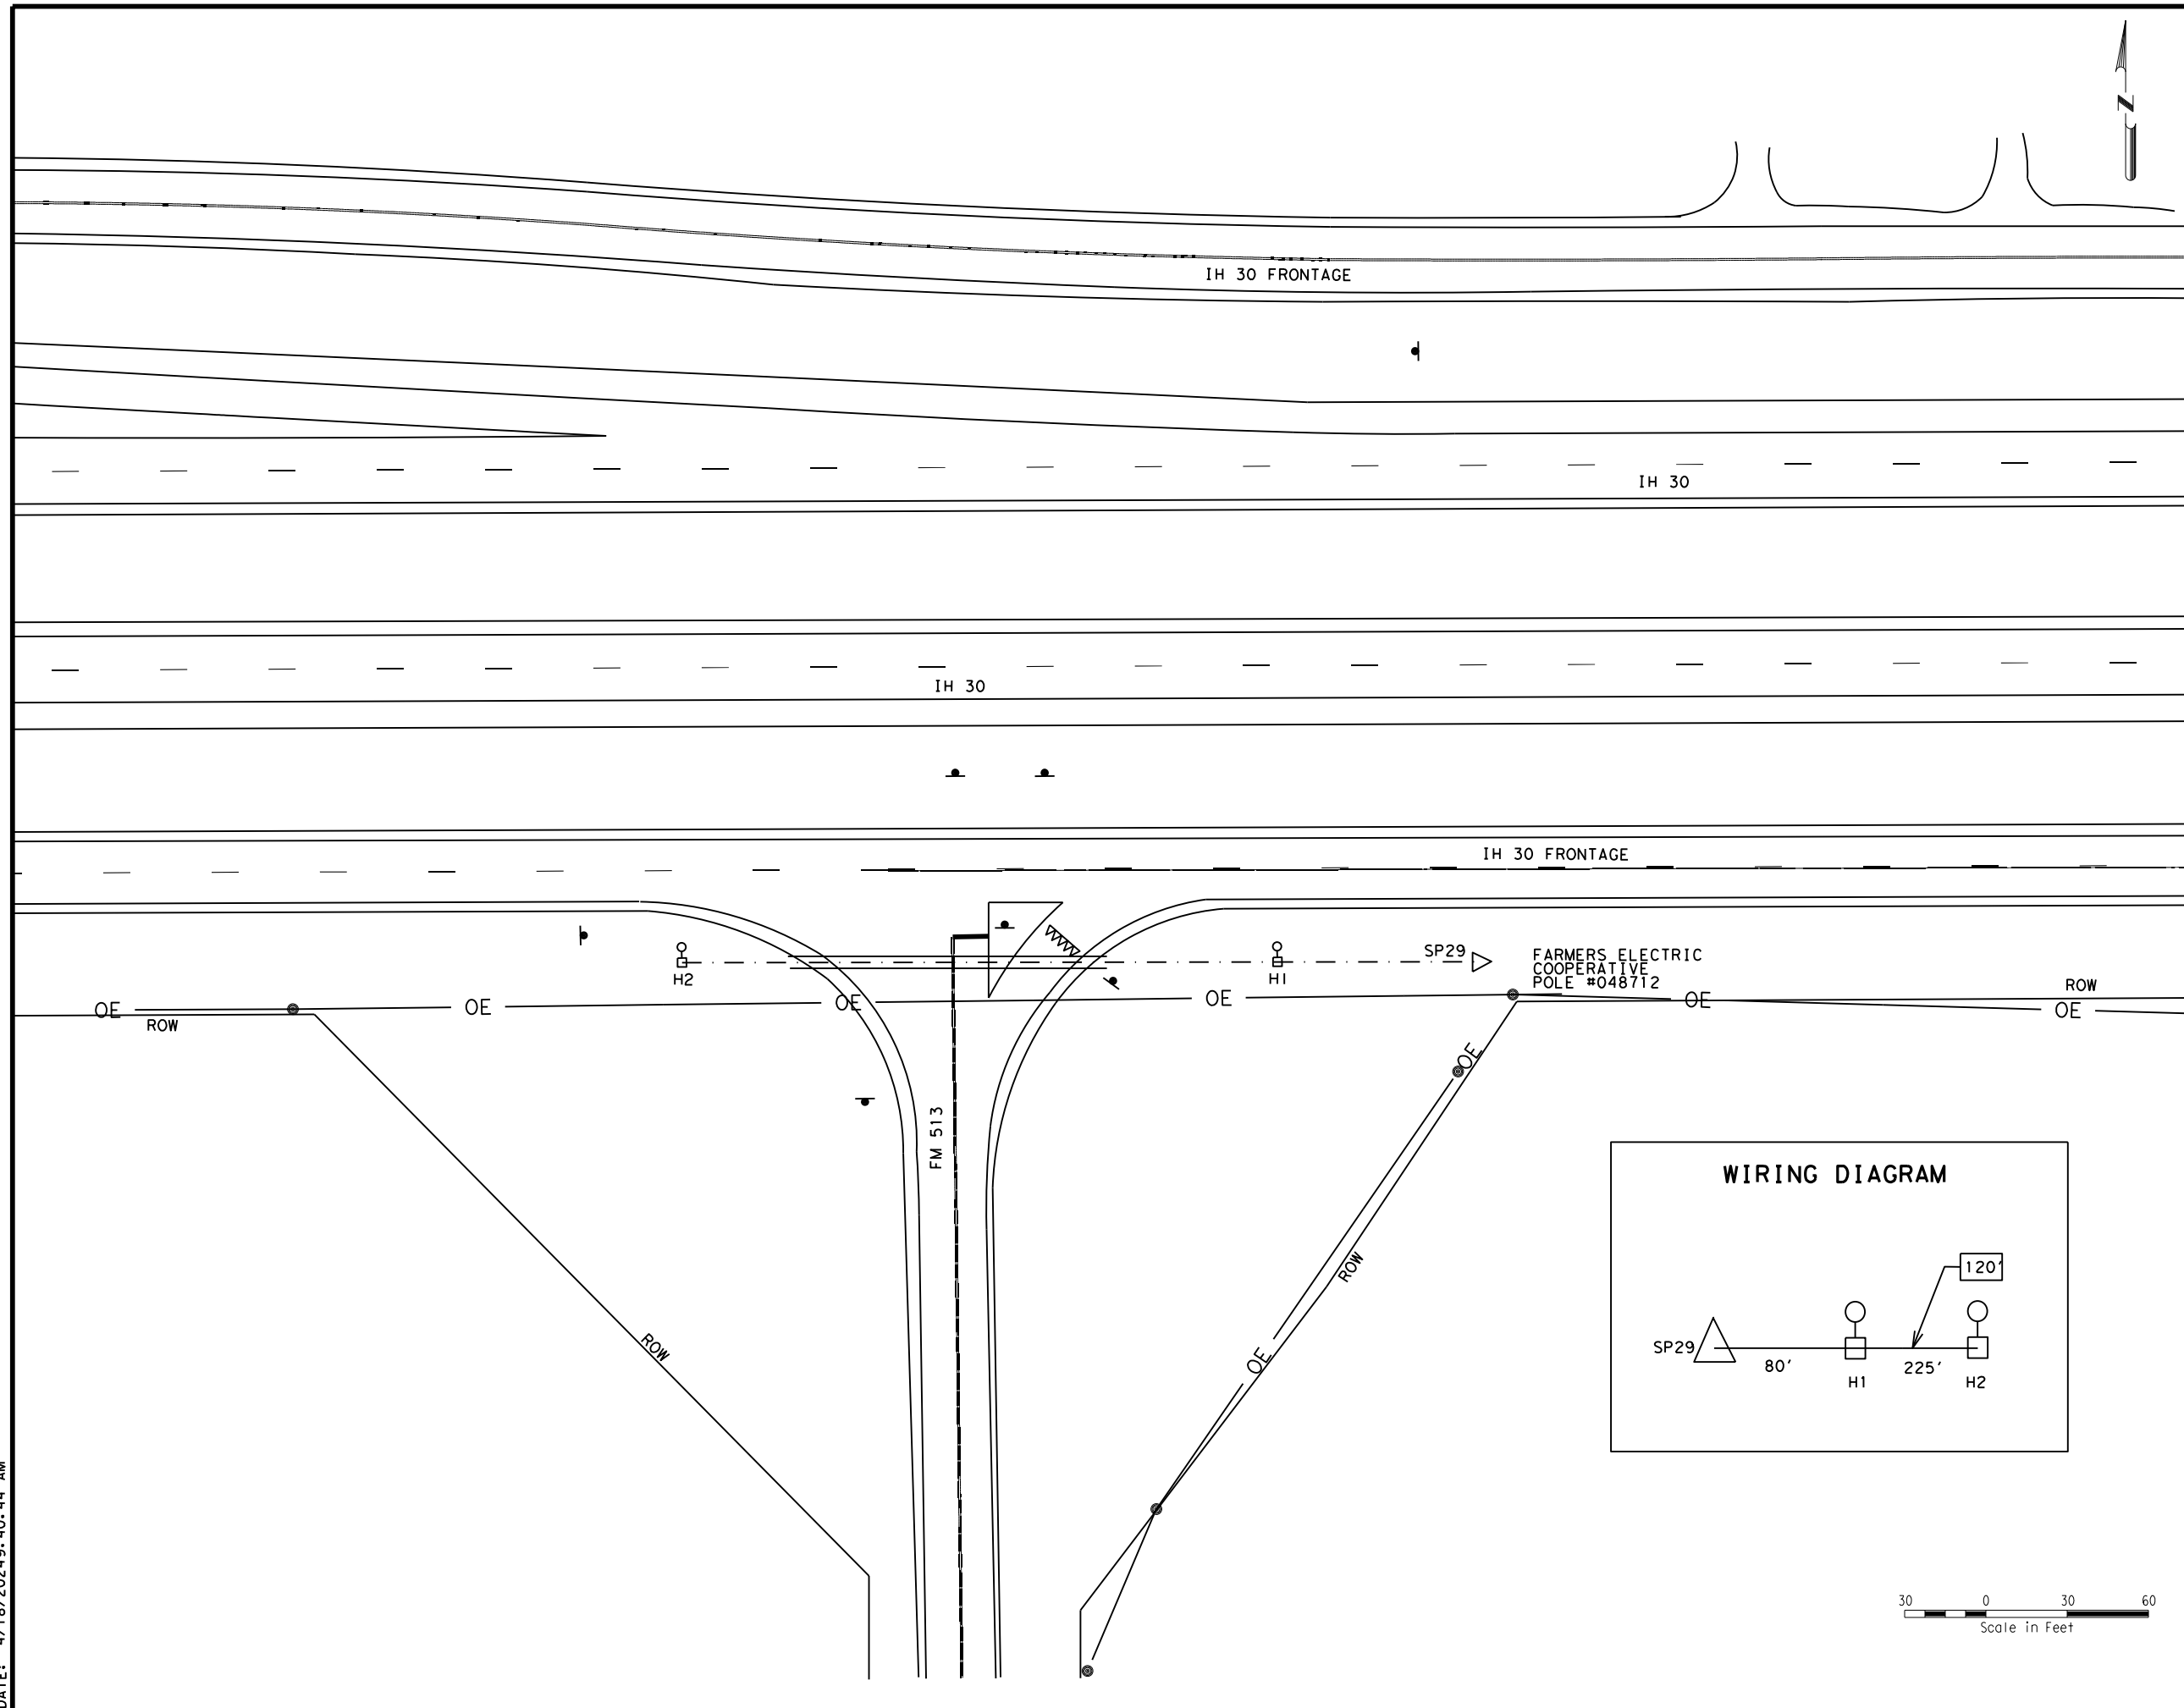

*D. Samuels* P.E. 4/19/2024

**ILLUMINATION LAYOUT**  
 IH 30 AT FM 513  
 CSJ: 0009-13-197



© 2024 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		10

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP29	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	H	2P/15	1.42	0.3


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
H1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	10
H2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	10

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	16	LF
432	6001	RIPRAP (CONC) (4 IN)	0.70	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	2	EA
618	6075	CONDT (RM) (3") (BORE)	120	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	305	LF
6185	6002	TMA (STATIONARY)	7	DAY

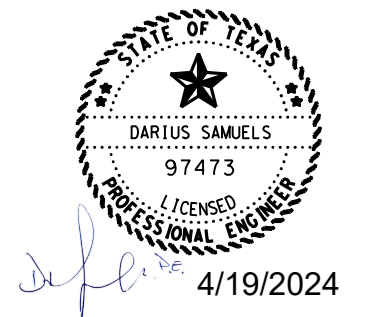




**QUANTITY SUMMARY**  
IH 30 AT FM 513  
CSJ: 0009-13-197

© 2024 <sup>®</sup>			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		11

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting\let#8-24\DESIGN PLANS\Hunt\FM 512 AT FM 2874.dgn  
 DATE: 4/18/2024 9:40:49 AM



**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ▭ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- ROW

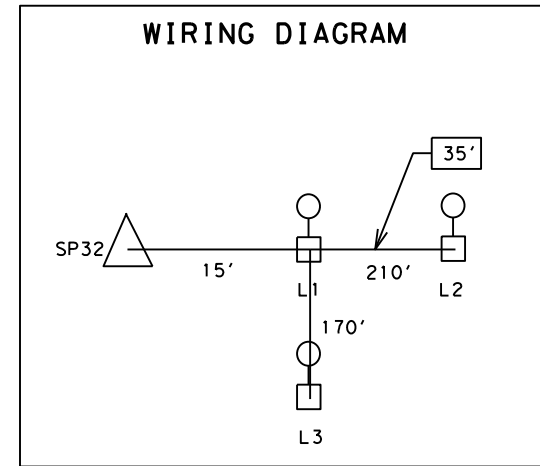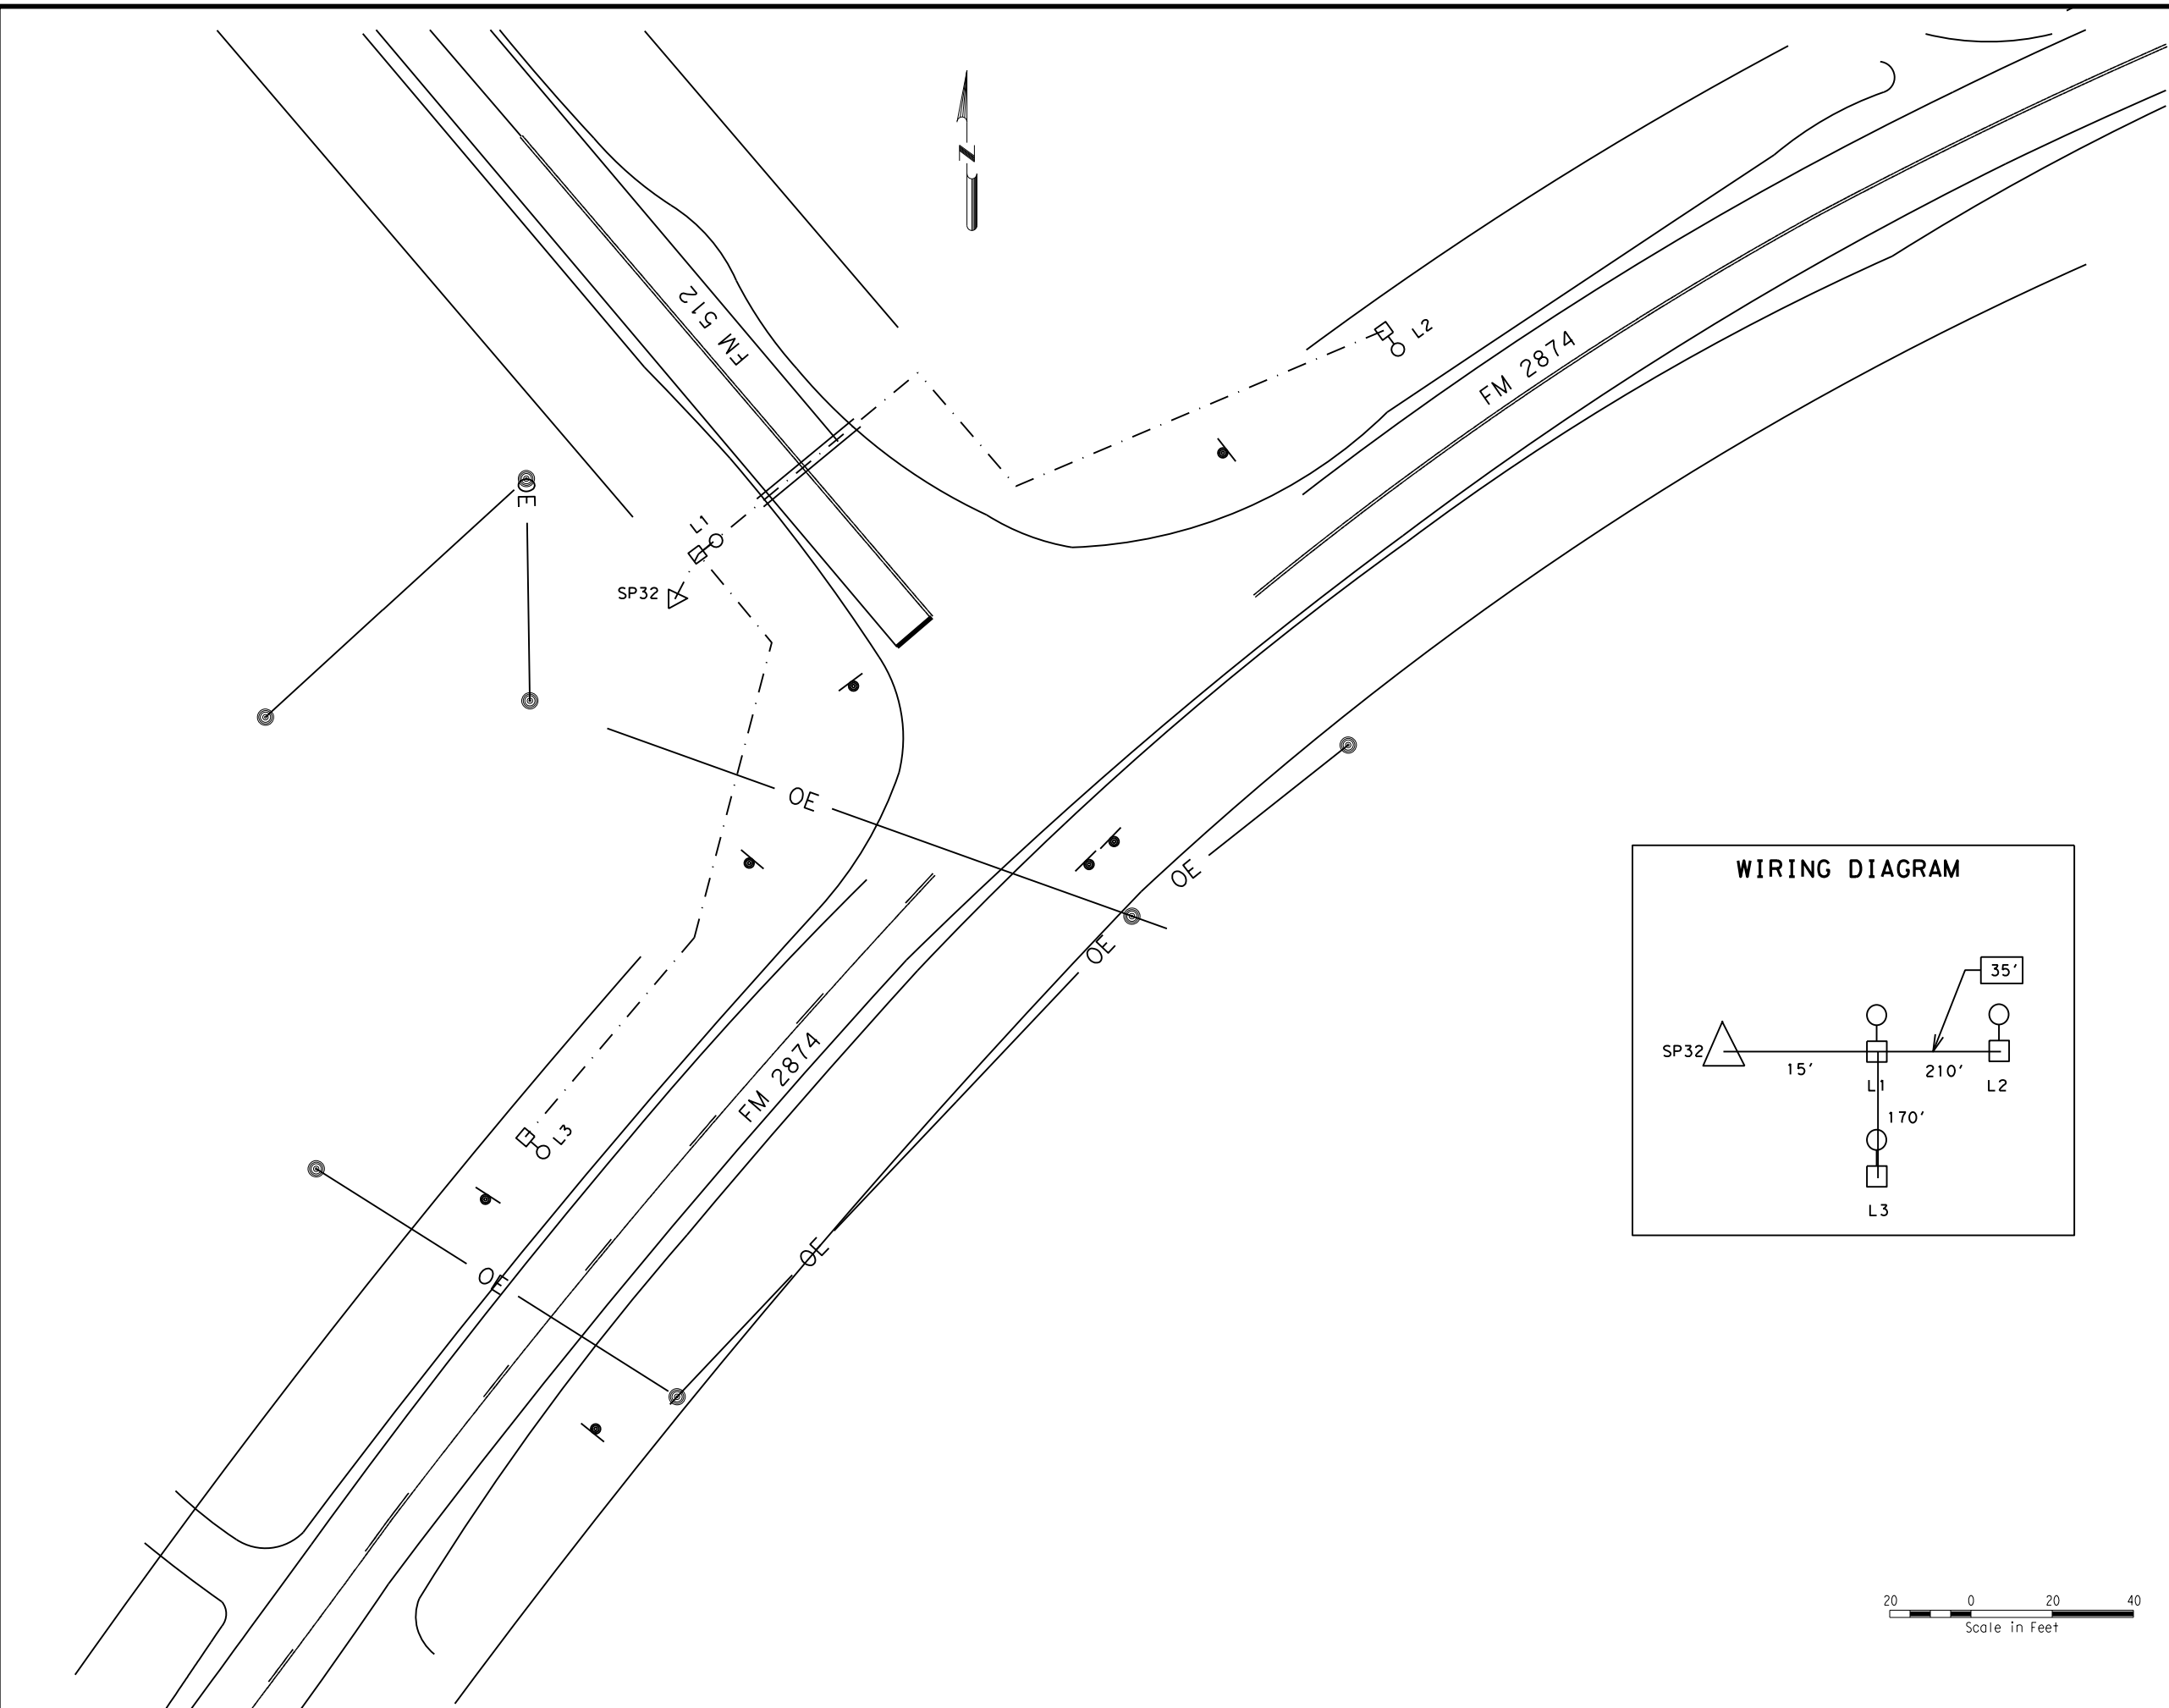

*D. Samuels* 4/19/2024

**ILLUMINATION LAYOUT**  
**FM 512 AT FM 2874**  
**CSJ: 0579-02-015**

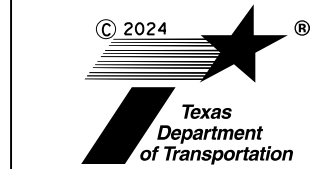

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		12

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hunt\FM 512 AT FM 2874.dgn  
 DATE: 4/18/2024 9:40:52 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP32	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	L	2P/15	2.13	0.5


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
L1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	12
L2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	12
L3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	12


\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY


ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	24	LF
432	6001	RIPRAP (CONC) (4 IN)	1.05	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	3	EA
618	6075	CONDT (RM) (3") (BORE)	35	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	395	LF
6185	6002	TMA (STATIONARY)	7	DAY

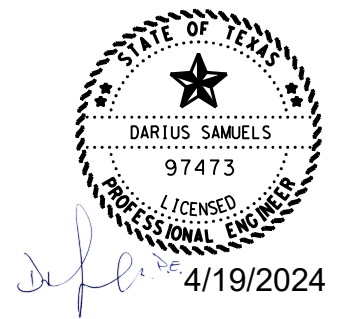

**QUANTITY SUMMARY**  
 FM 512 AT FM 2874  
 CSJ: 0579-02-015


© 2024 			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		13

FILE: t:\partof\ashley\projects\safety lighting let#8-24\design plans\Hunt\SH 276 AT CR 3611.dgn  
 DATE: 4/18/2024 9:40:55 AM

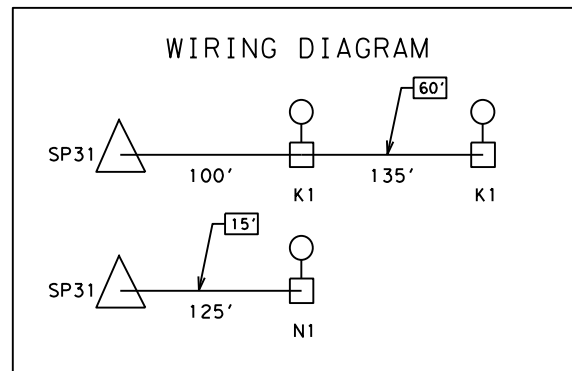


**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- DUCT CABLE
- === 3" BORED RMC
- ⊥ SIGN
- POWER POLE
- ⌋ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- FIRE HYDRANT
- FIBER OPTIC LINE

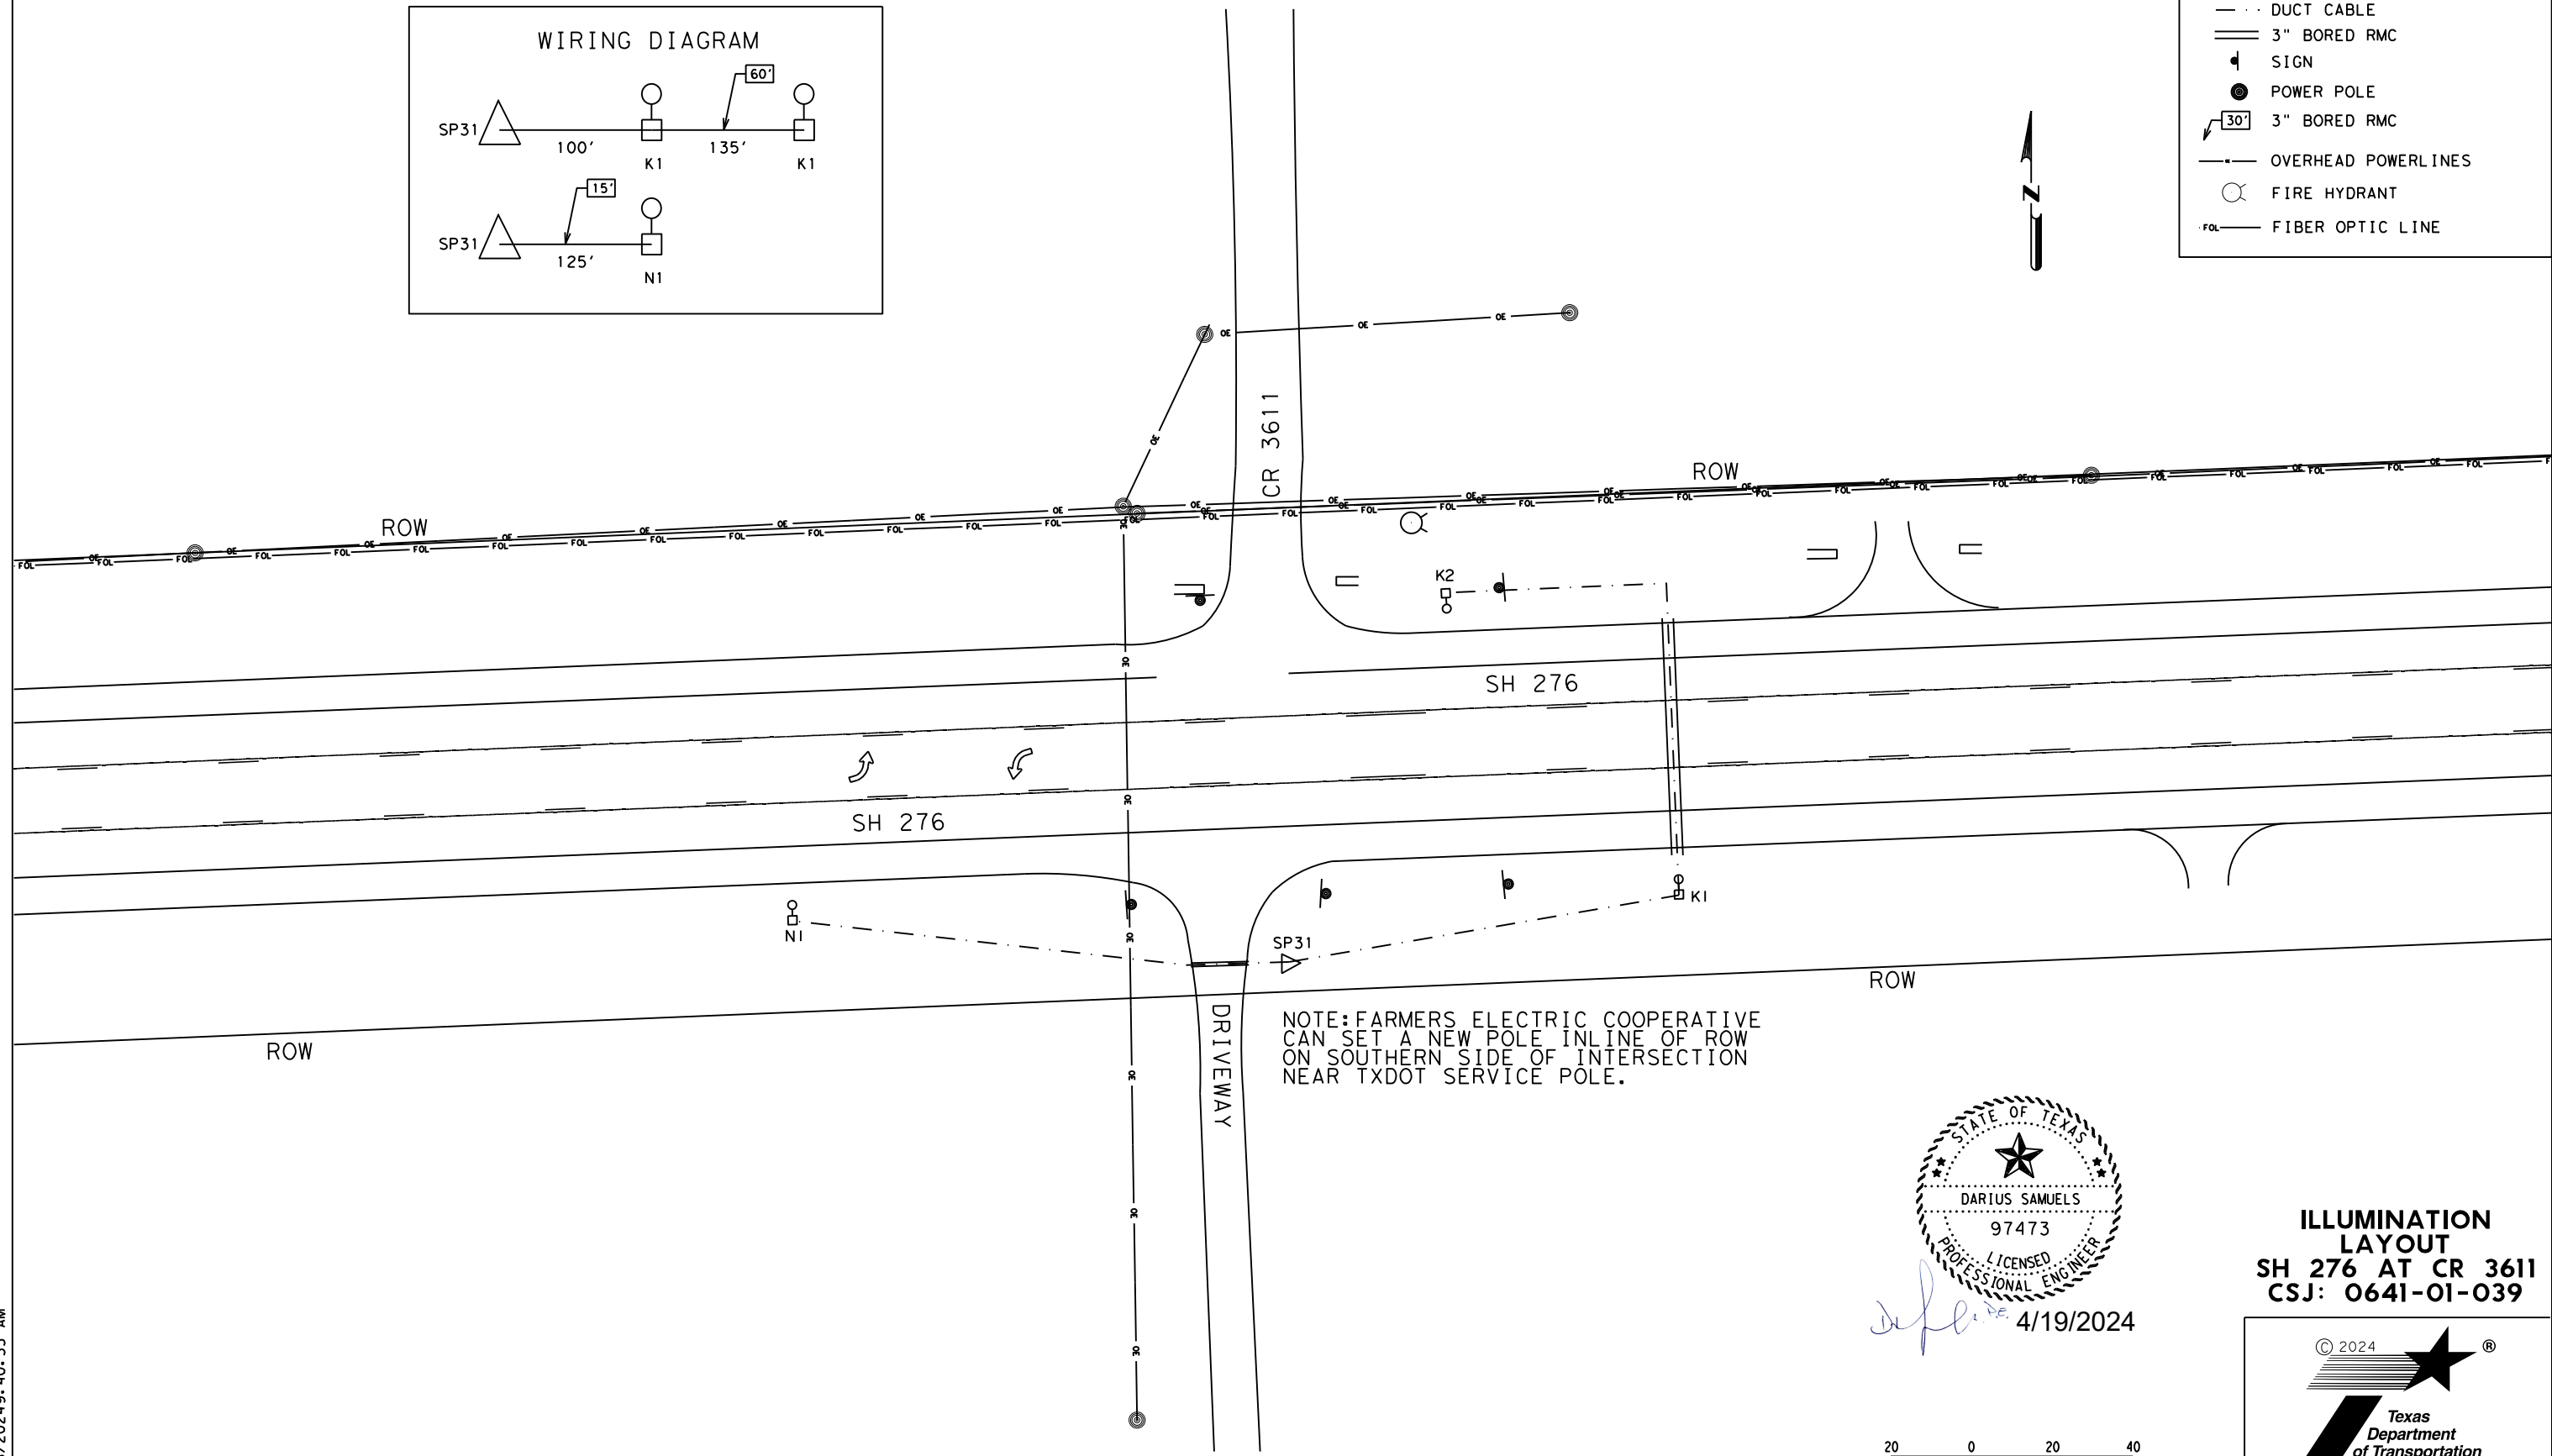

NOTE: FARMERS ELECTRIC COOPERATIVE CAN SET A NEW POLE INLINE OF ROW ON SOUTHERN SIDE OF INTERSECTION NEAR TXDOT SERVICE POLE.

*Darius Samuels* 4/19/2024



**ILLUMINATION LAYOUT**  
**SH 276 AT CR 3611**  
**CSJ: 0641-01-039**

© 2024			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		14



FILE: t:\part\raf\ashley\projects\safety lighting let#8-24\design plans\Hunt\SH 276 AT CR 3611.dgn  
 DATE: 4/18/2024 9:40:57 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP31	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	K N	2P/15	2.13 0.71	0.5


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
K1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	14
K2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	14
N1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	14


\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	24	LF
432	6001	RIPRAP (CONC) (4 IN)	1.05	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	3	EA
618	6075	CONDT (RM) (3") (BORE)	75	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	360	LF
6185	6002	TMA (STATIONARY)	7	DAY

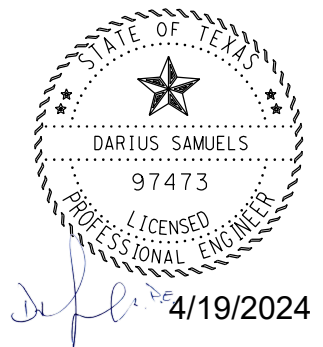



**QUANTITY SUMMARY**  
 SH 276 AT CR 3611  
 CSJ: 0641-01-039

			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		15


FILE: \\FS-PARHQ.dot.state.tx.us\Data1\Data\PAR\Groups\PARTRAF\Ashley\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\Hunt\SH 24 AT FM 2736.dgn  
 DATE: 4/19/2024 3:06:17 PM

**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- - - DUCT CABLE
- ══ 3" BORED RMC
- ⊥ SIGN
- POWER POLE
- ⊥ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- ROW

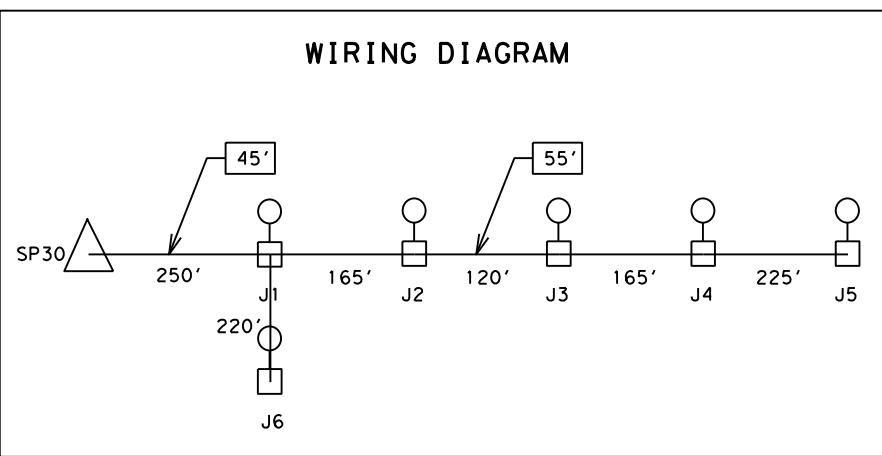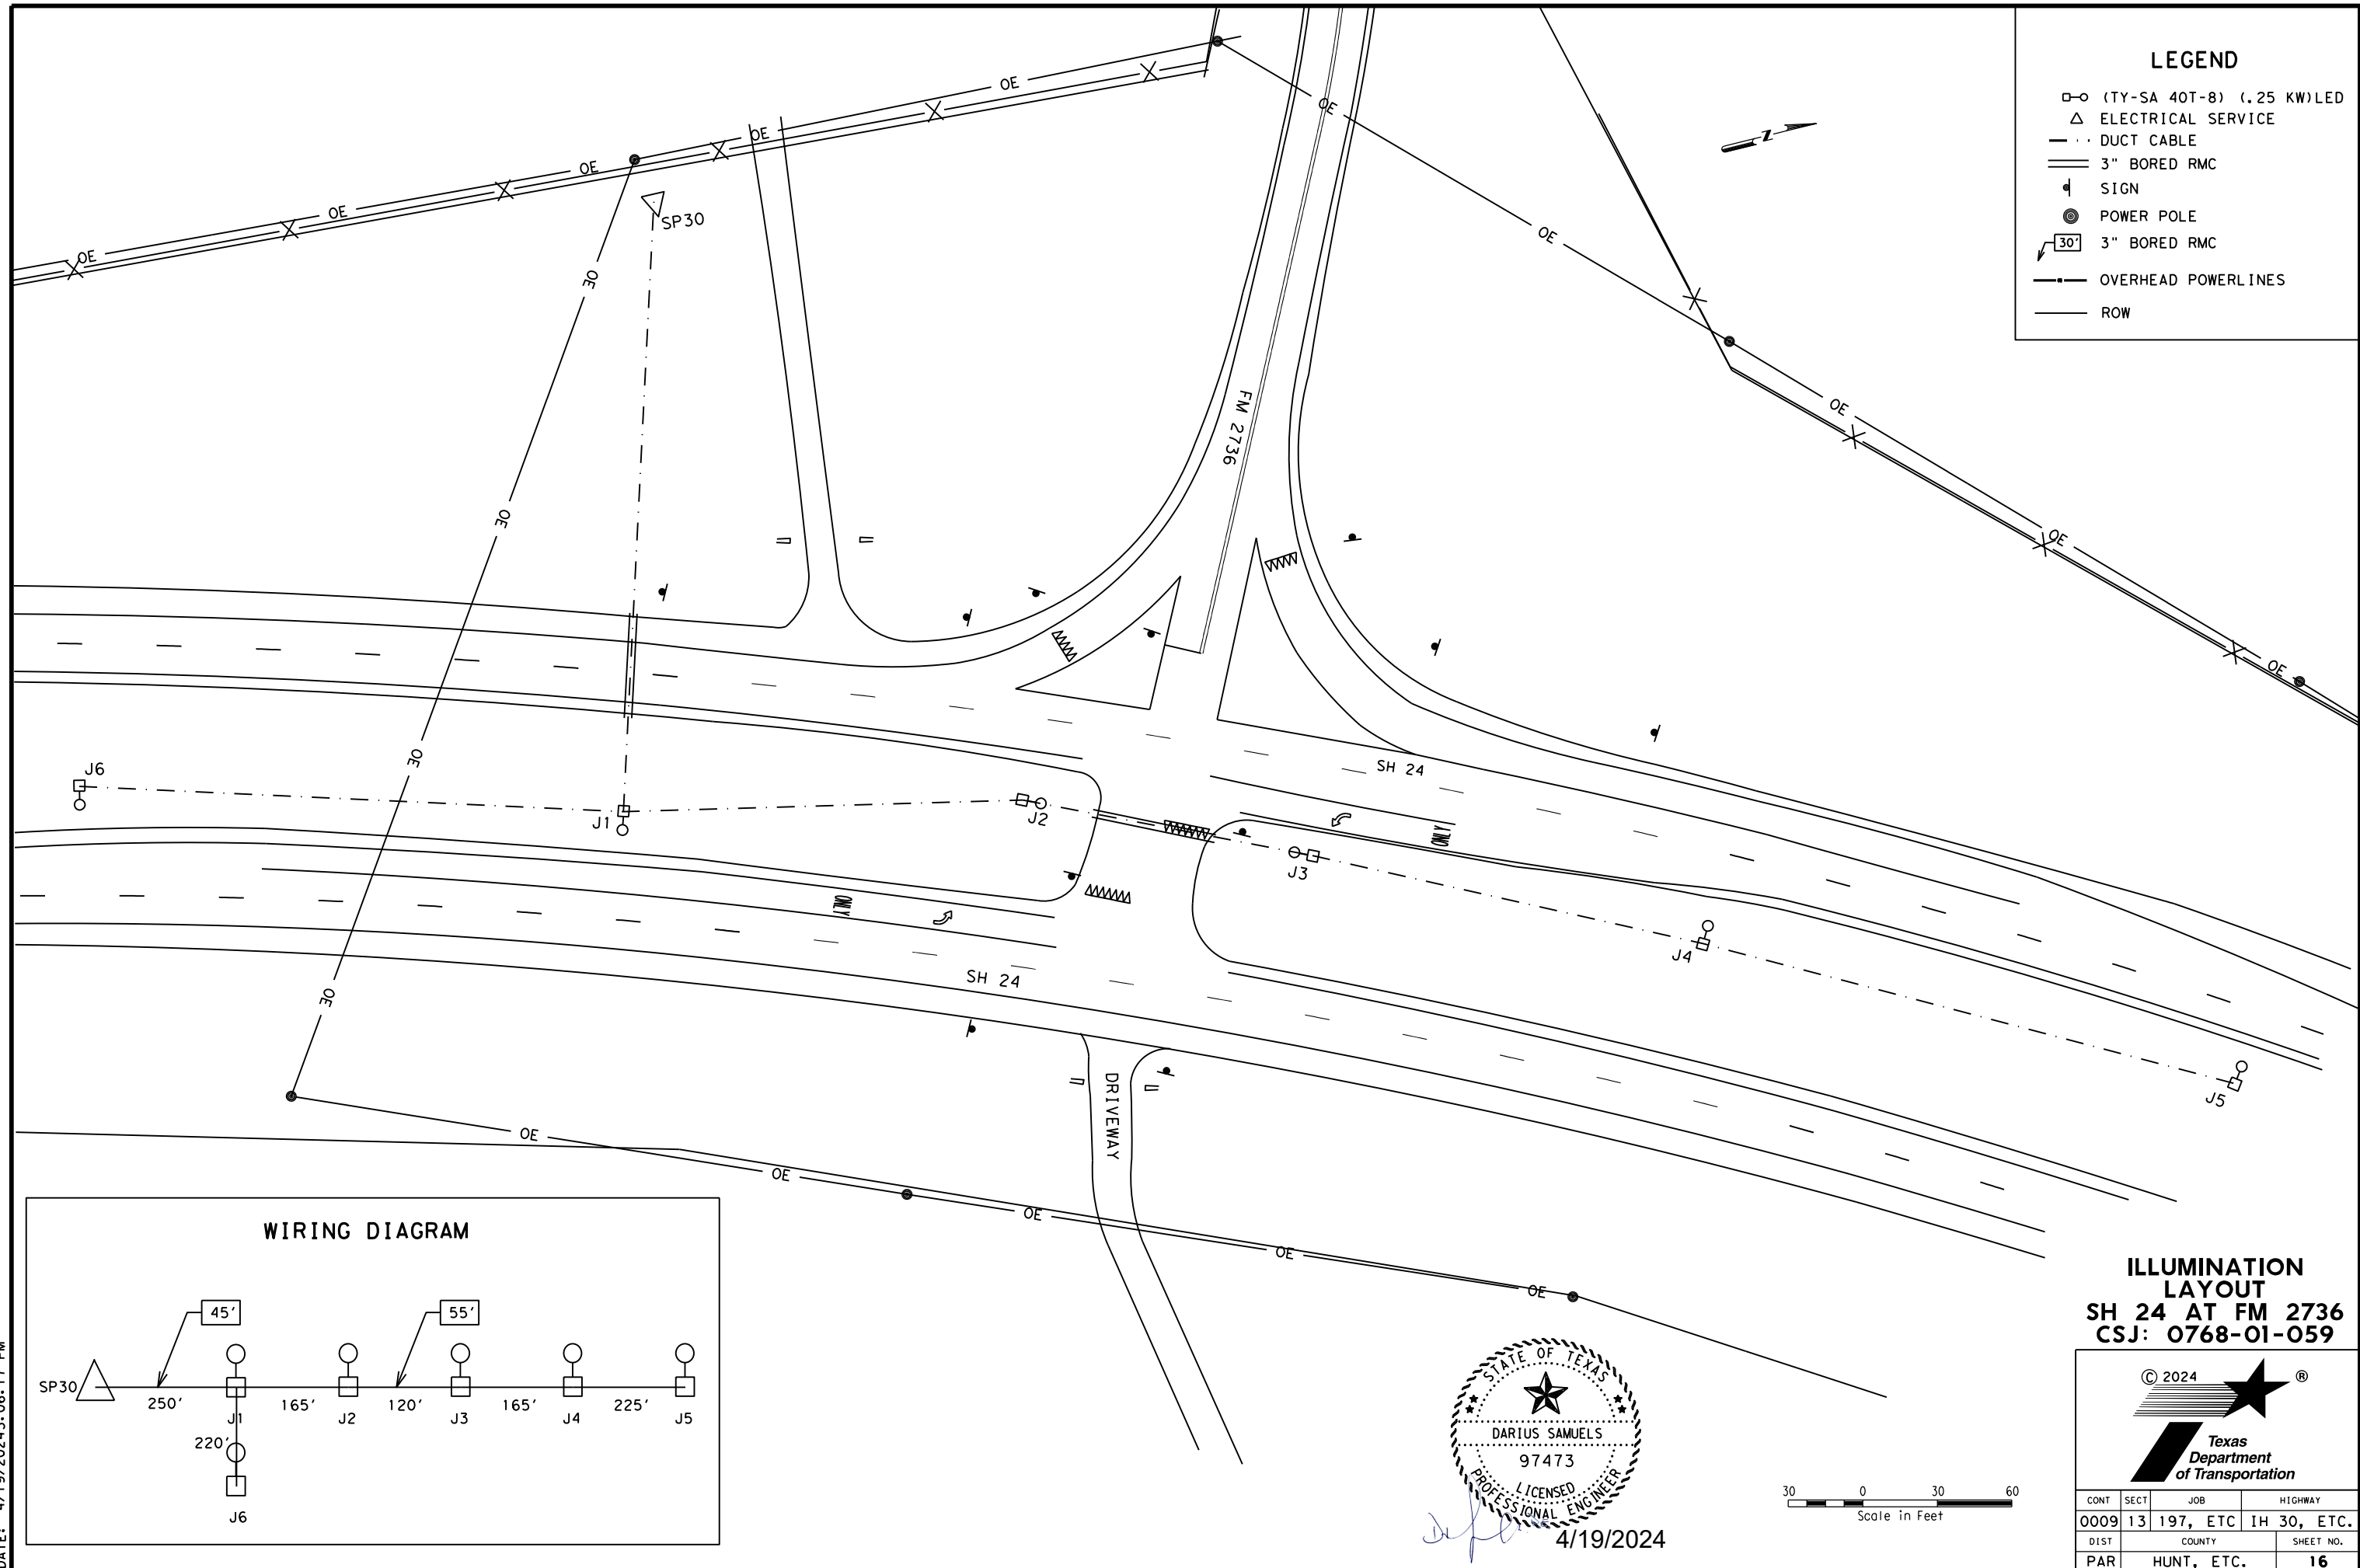

STATE OF TEXAS  
 DARIUS SAMUELS  
 97473  
 LICENSED PROFESSIONAL ENGINEER  
 4/19/2024



**ILLUMINATION LAYOUT**  
 SH 24 AT FM 2736  
 CSJ: 0768-01-059

© 2024

Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		16

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hunt\SH 24 AT FM 2736.dgn  
 DATE: 4/18/2024 9:41:03 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP30	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	J	2P/15	4.26	1.0


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
J1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	16
J2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	16
J3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	16
J4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	16
J5	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	16
J6	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	16

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	48	LF
432	6001	RIPRAP (CONC) (4 IN)	2.10	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	6	EA
618	6075	CONDT (RM) (3") (BORE)	100	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	1145	LF
6185	6002	TMA (STATIONARY)	7	DAY




*Darius Samuels*  
 4/19/2024

**QUANTITY SUMMARY**  
 SH 24 AT FM 2736  
 CSJ: 0768-01-059



© 2024			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		17

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hunt\SH 276 AT BU276.dgn  
 DATE: 4/18/2024 9:41:12 AM

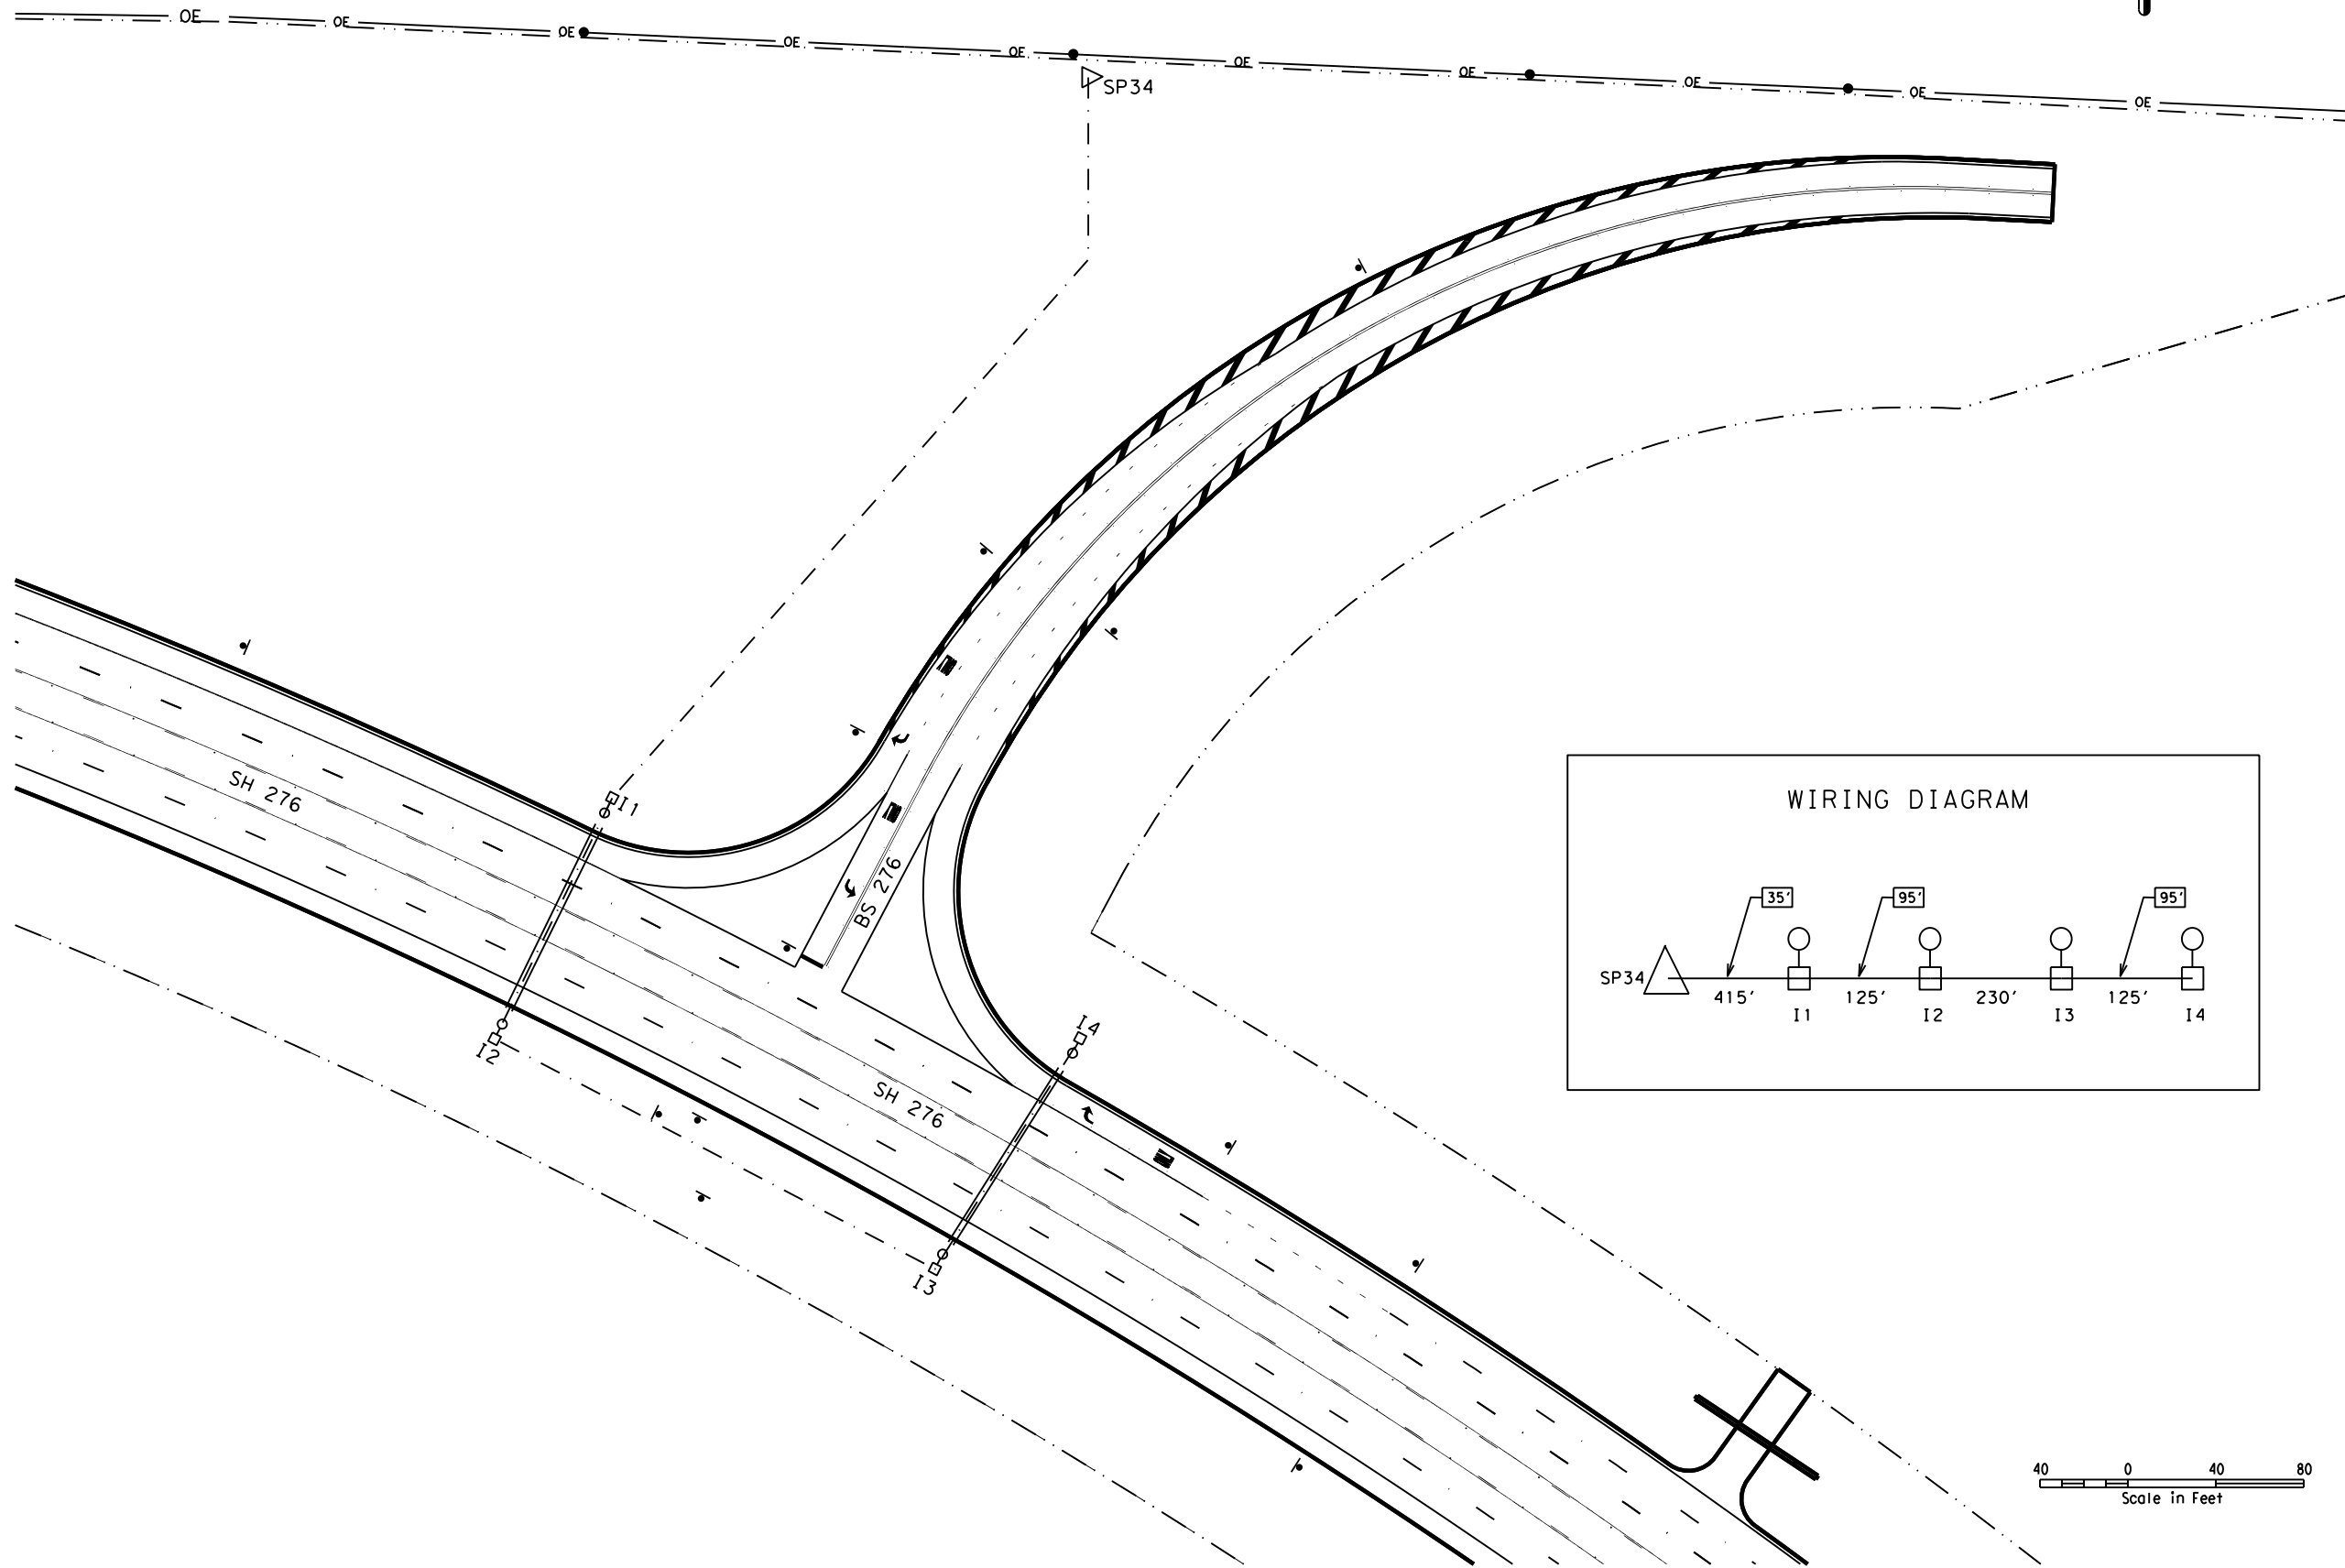


**LEGEND**


- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- DUCT CABLE
- === 3" BORED RMC
- ⊥ SIGN
- POWER POLE
- 30' 3" BORED RMC
- OVERHEAD POWERLINES
- FIRE HYDRANT
- FOL FIBER OPTIC LINE
- ROW

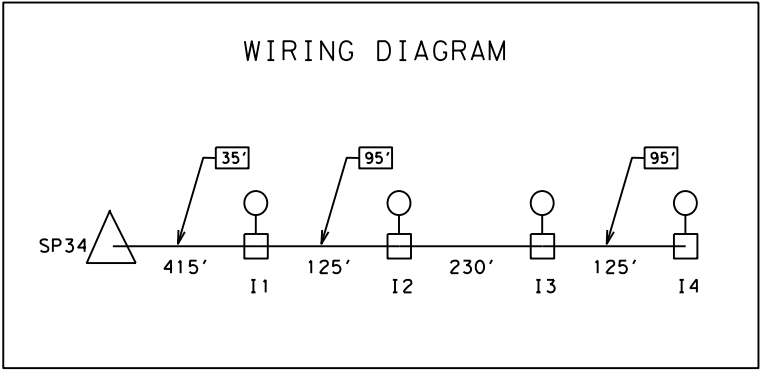

*Darius Samuels* 4/19/2024

**ILLUMINATION LAYOUT  
 SH 276 AT BS 276  
 CSJ: 1290-09-002**



© 2024 

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		18

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting\let#8-24\DESIGN PLANS\Hunt\SH 276\SH 276 AT BS276.dgn  
 DATE: 4/18/2024 9:41:15 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP34	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	I	2P/15	2.84	0.7


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
I1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	18
I2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	18
I3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	18
I4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	18


\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	32	LF
432	6001	RIPRAP (CONC) (4 IN)	1.40	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	4	EA
618	6075	CONDT (RM) (3") (BORE)	225	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	895	LF
6185	6002	TMA (STATIONARY)	7	DAY

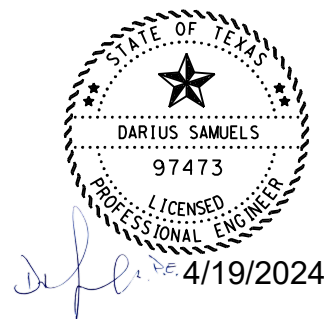


**QUANTITY SUMMARY**  
 SH 276 AT BS 276  
 CSJ: 1290-09-002



© 2024


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST		COUNTY	SHEET NO.
PAR		HUNT, ETC.	19

FILE: \\FS-PARHQ.dot.state.tx.us\Data1\Data\PAR\Groups\PARTRAF\Ashley\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\Lamar\US 82 AT FM 38.dgn  
 DATE: 4/19/2024 3:21:13 PM

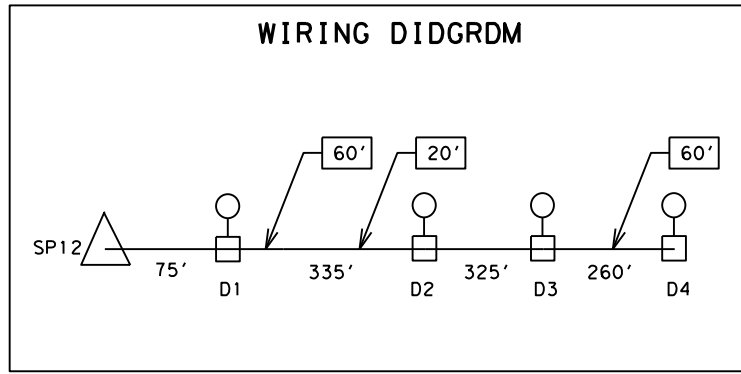


**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- DUCT CABLE
- === 3" BORED RMC
- ⊥ SIGN
- POWER POLE
- ⌊ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- WATER LINE



*Darius Samuels*  
 4/19/2024

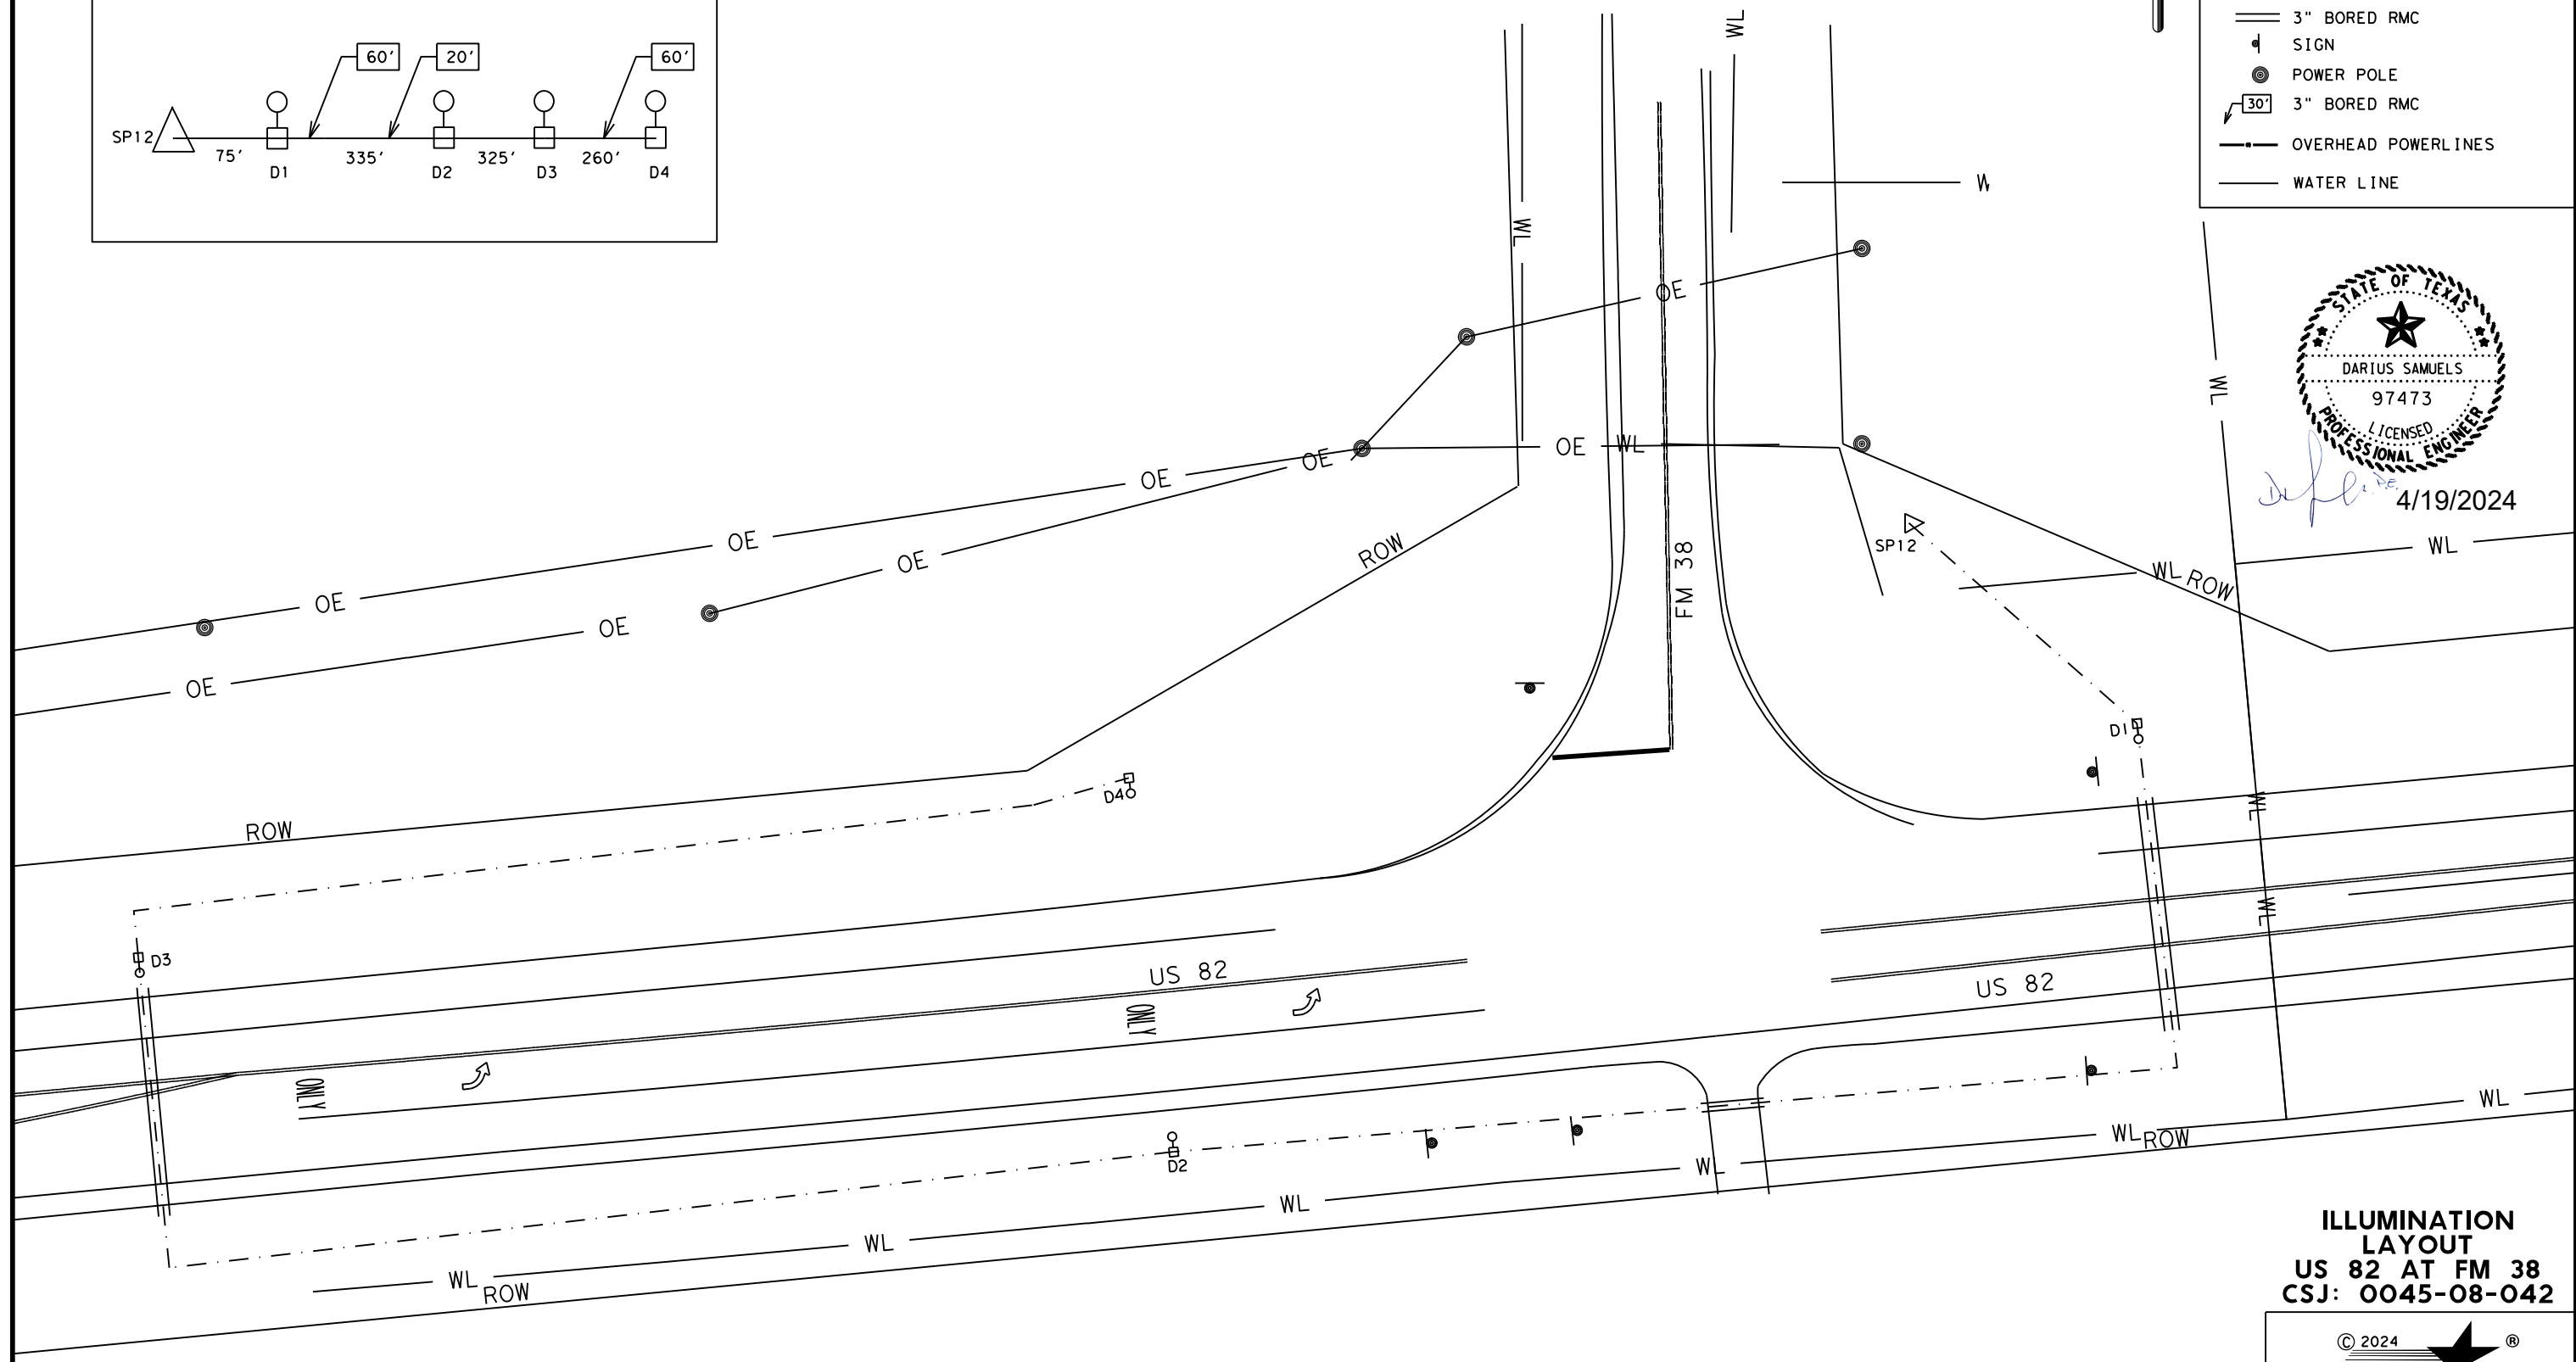

**ILLUMINATION LAYOUT**  
 US 82 AT FM 38  
 CSJ: 0045-08-042

© 2024

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		20

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\US 82 AT FM 38.dgn  
 DATE: 4/18/2024 9:41:20 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP12	ELC SRV TY A (120/240)060(NS)SS(E)SP(O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	D	2P/15	2.84	0.7


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
D1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	20
D2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	20
D3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	20
D4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	20

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	32	LF
432	6001	RIPRAP (CONC) (4 IN)	1.40	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	4	EA
618	6075	CONDT (RM) (3") (BORE)	140	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	995	LF
6185	6002	TMA (STATIONARY)	7	DAY

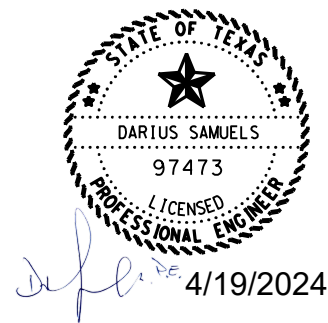




**QUANTITY SUMMARY**  
 US 82 AT FM 38  
 CSJ: 0045-08-042

© 2024 <sup>®</sup>			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		21


FILE: \\FS-PARHQ.dot.state.tx.us\Data1\Data\PAR\Groups\PARTRAF\Ashley\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\Lamar\US 271 AT FM 1499.dgn  
 DATE: 4/19/2024 3:15:42 PM

**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- DUCT CABLE
- ==== 3" BORED RMC
- ⊕ SIGN
- ⊙ POWER POLE
- ▭ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- ROW
- TREE
- WATER LINE
- FIBER OPTIC LINE

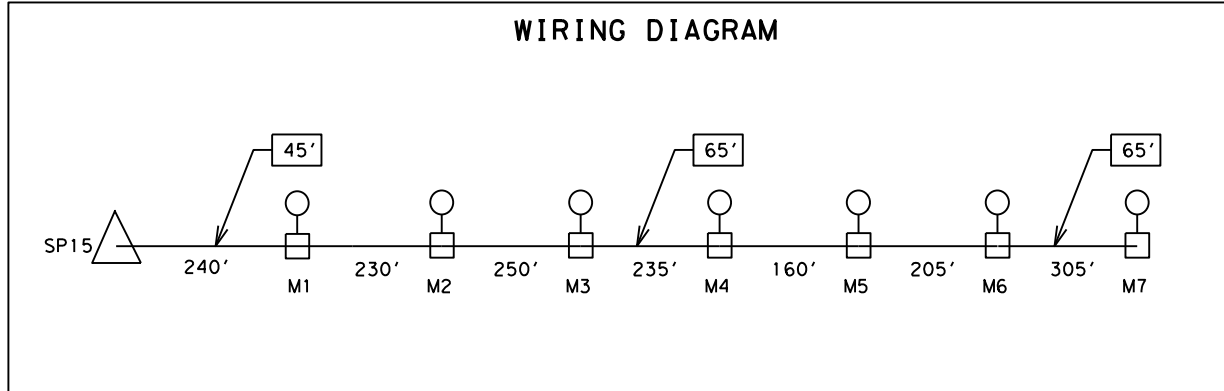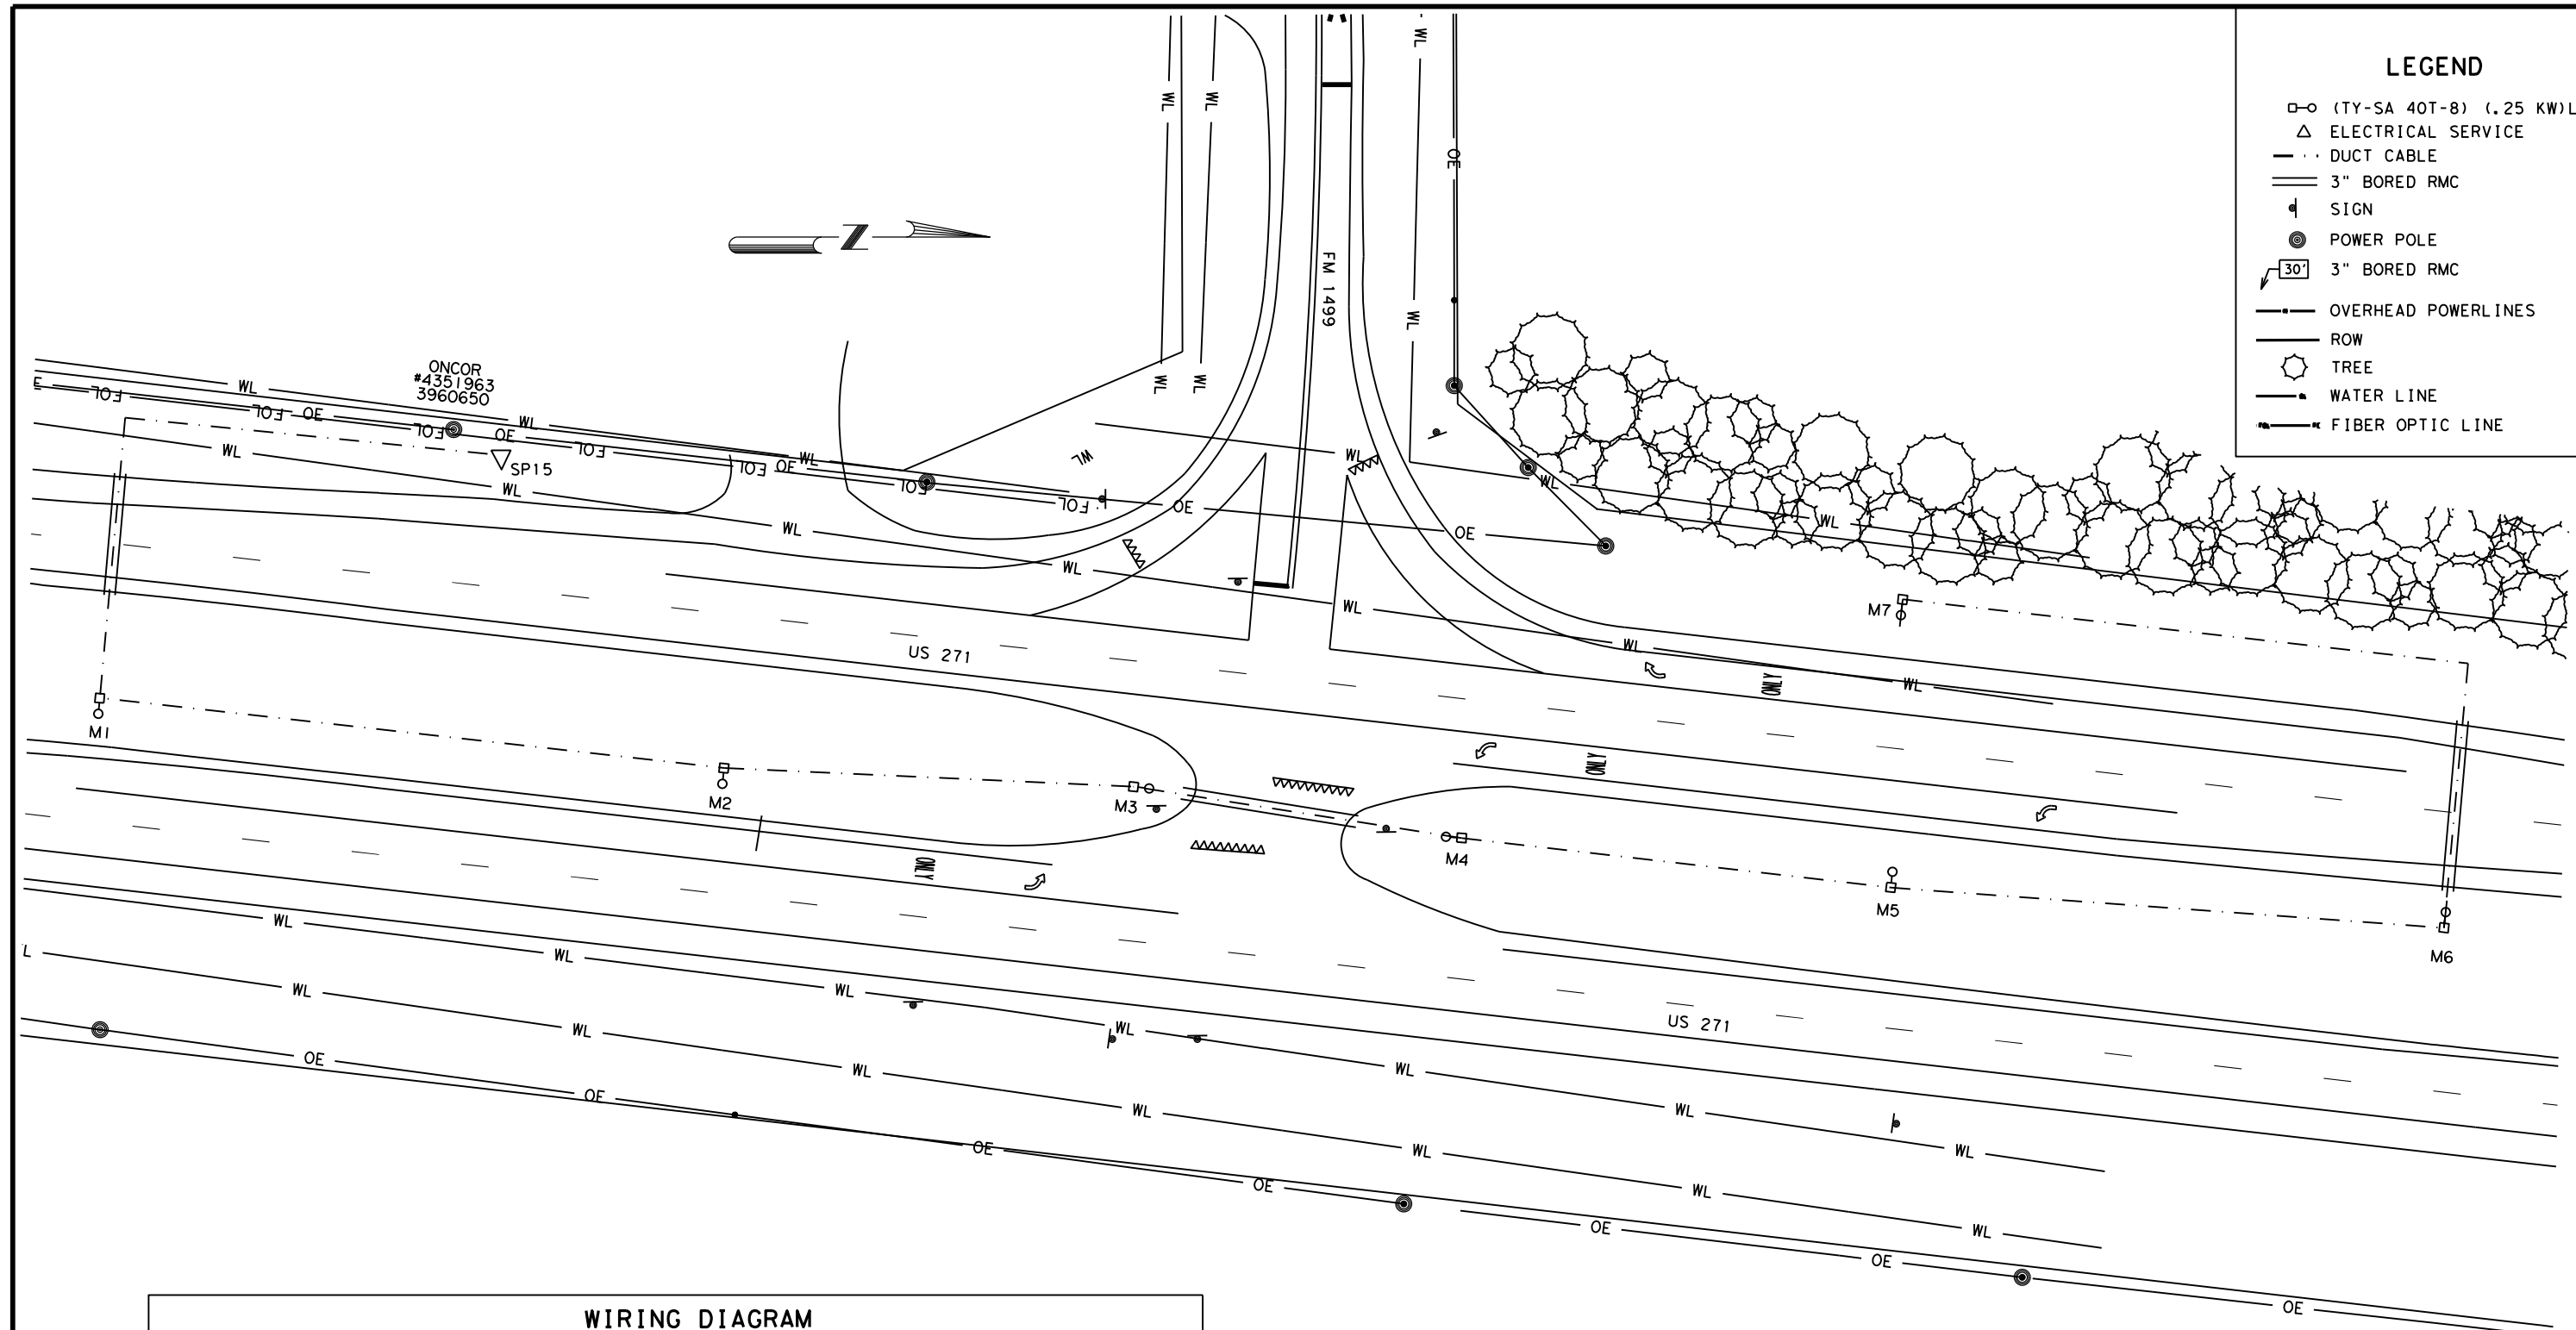

*Darius Samuels*  
 4/19/2024



**ILLUMINATION LAYOUT**  
**US 271 AT FM 1499**  
**CSJ: 0136-07-054**

© 2024  
 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		22



FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\US 271 AT FM 1499.dgn  
 DATE: 4/18/2024 9:41:27 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP15	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	M	2P/15	4.97	1.2


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
M1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22
M2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22
M3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22
M4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22
M5	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22
M6	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22
M7	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	22

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	56	LF
432	6001	RIPRAP (CONC) (4 IN)	2.45	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	7	EA
618	6075	CONDT (RM) (3") (BORE)	175	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	1625	LF
6185	6002	TMA (STATIONARY)	7	DAY

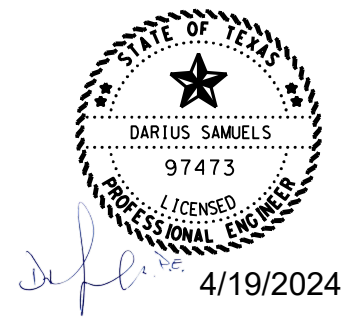




**QUANTITY SUMMARY**  
 US 271 AT FM 1499  
 CSJ: 0136-07-054

© 2024 <sup>®</sup>			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		23


FILE: T:\PART\AF\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\US 271 AT TIMBERLAKE.dgn  
 DATE: \$DATE\$ 9:41:30 AM

**LEGEND**

- (TY-SA 40T-8) (.25 KW) LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- === 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ⊥ 30' 3" BORED RMC
- — — OVERHEAD POWERLINES
- ▬▬▬ RAILROAD
- · — WATER LINE

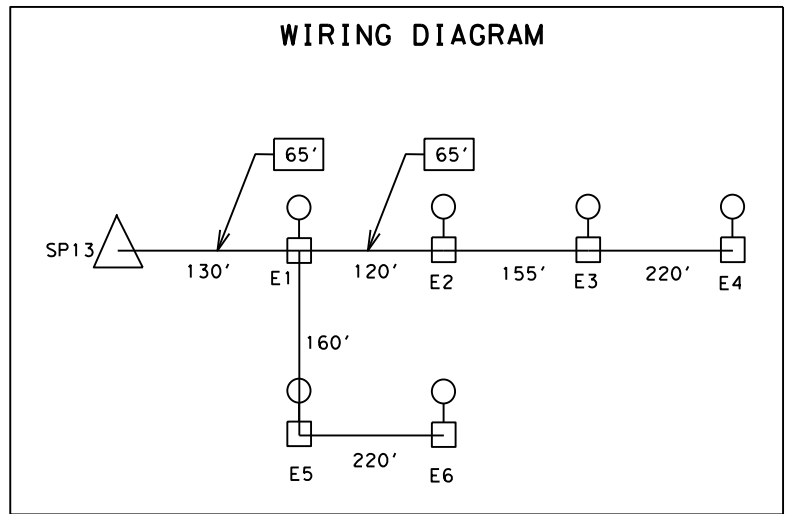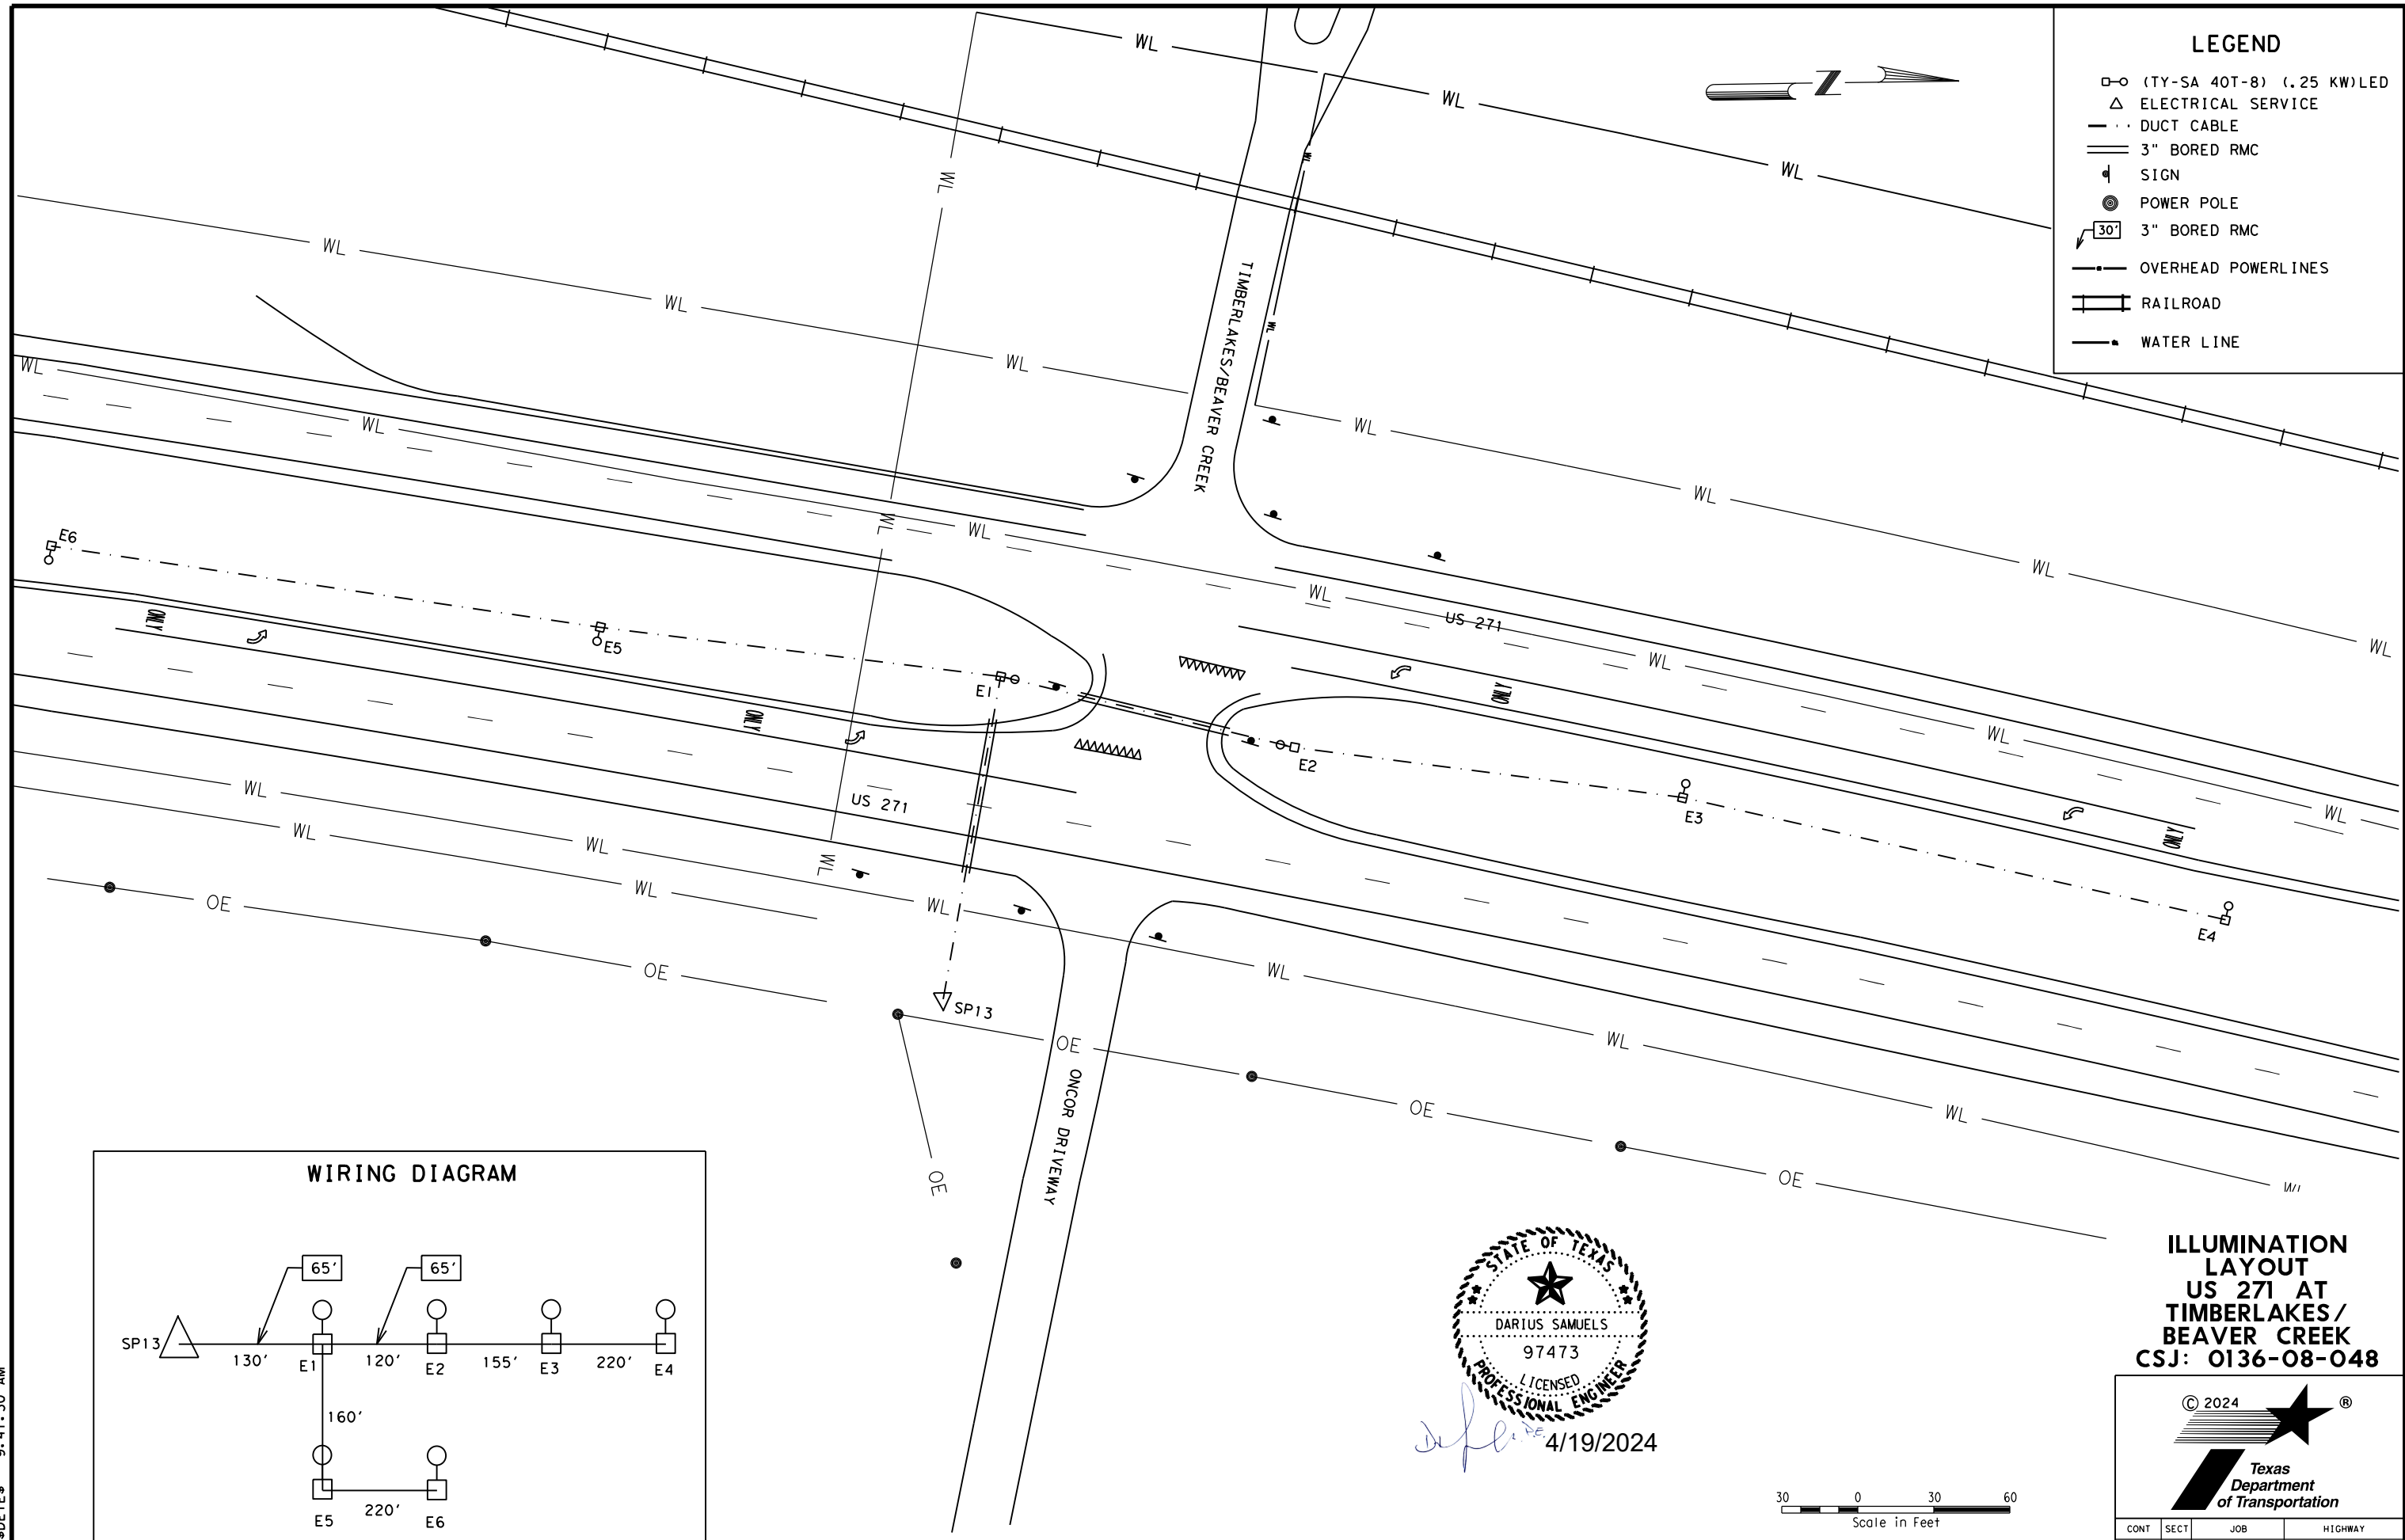

*Darius Samuels*  
 4/19/2024



**ILLUMINATION LAYOUT  
 US 271 AT  
 TIMBERLAKES/  
 BEAVER CREEK  
 CSJ: 0136-08-048**



CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		24

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\US 271 AT TIMBERLAKE.dgn  
 DATE: 4/18/2024 9:41:32 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP13	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	E	2P/15	4.26	1.0


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
E1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	24
E2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	24
E3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	24
E4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	24
E5	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	24
E6	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	24

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	48	LF
432	6001	RIPRAP (CONC) (4 IN)	2.1	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	6	EA
618	6075	CONDT (RM) (3") (BORE)	130	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	1005	LF
6185	6002	TMA (STATIONARY)	7	DAY



*Darius Samuels*  
 4/19/2024

**QUANTITY SUMMARY  
 US 271 AT  
 TIMBERLAKES/  
 BEAVER CREEK  
 CSJ: 0136-08-048**



© 2024 <sup>®</sup>  
 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		25


FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\US 271 AT GATE II RD.dgn  
 DATE: 4/18/2024 9:41:35 AM

**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- - - DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ▭ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- RAILROAD
- WATER LINE

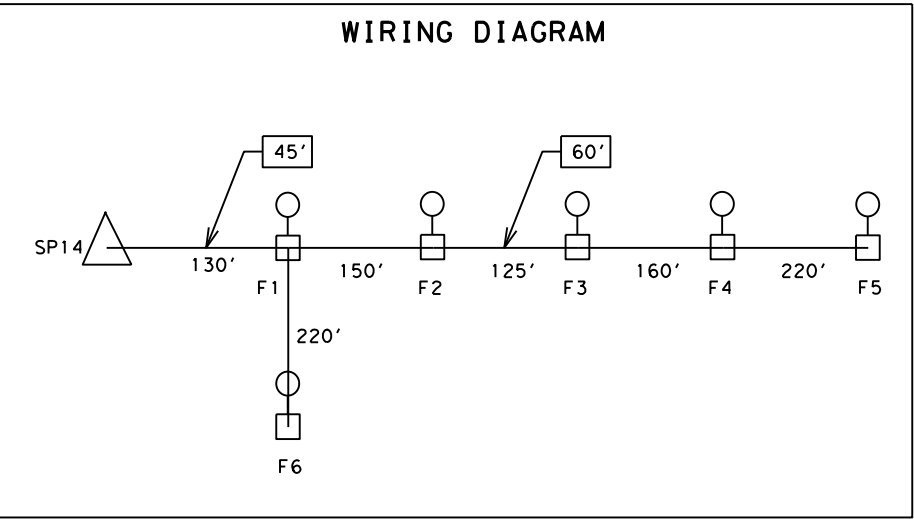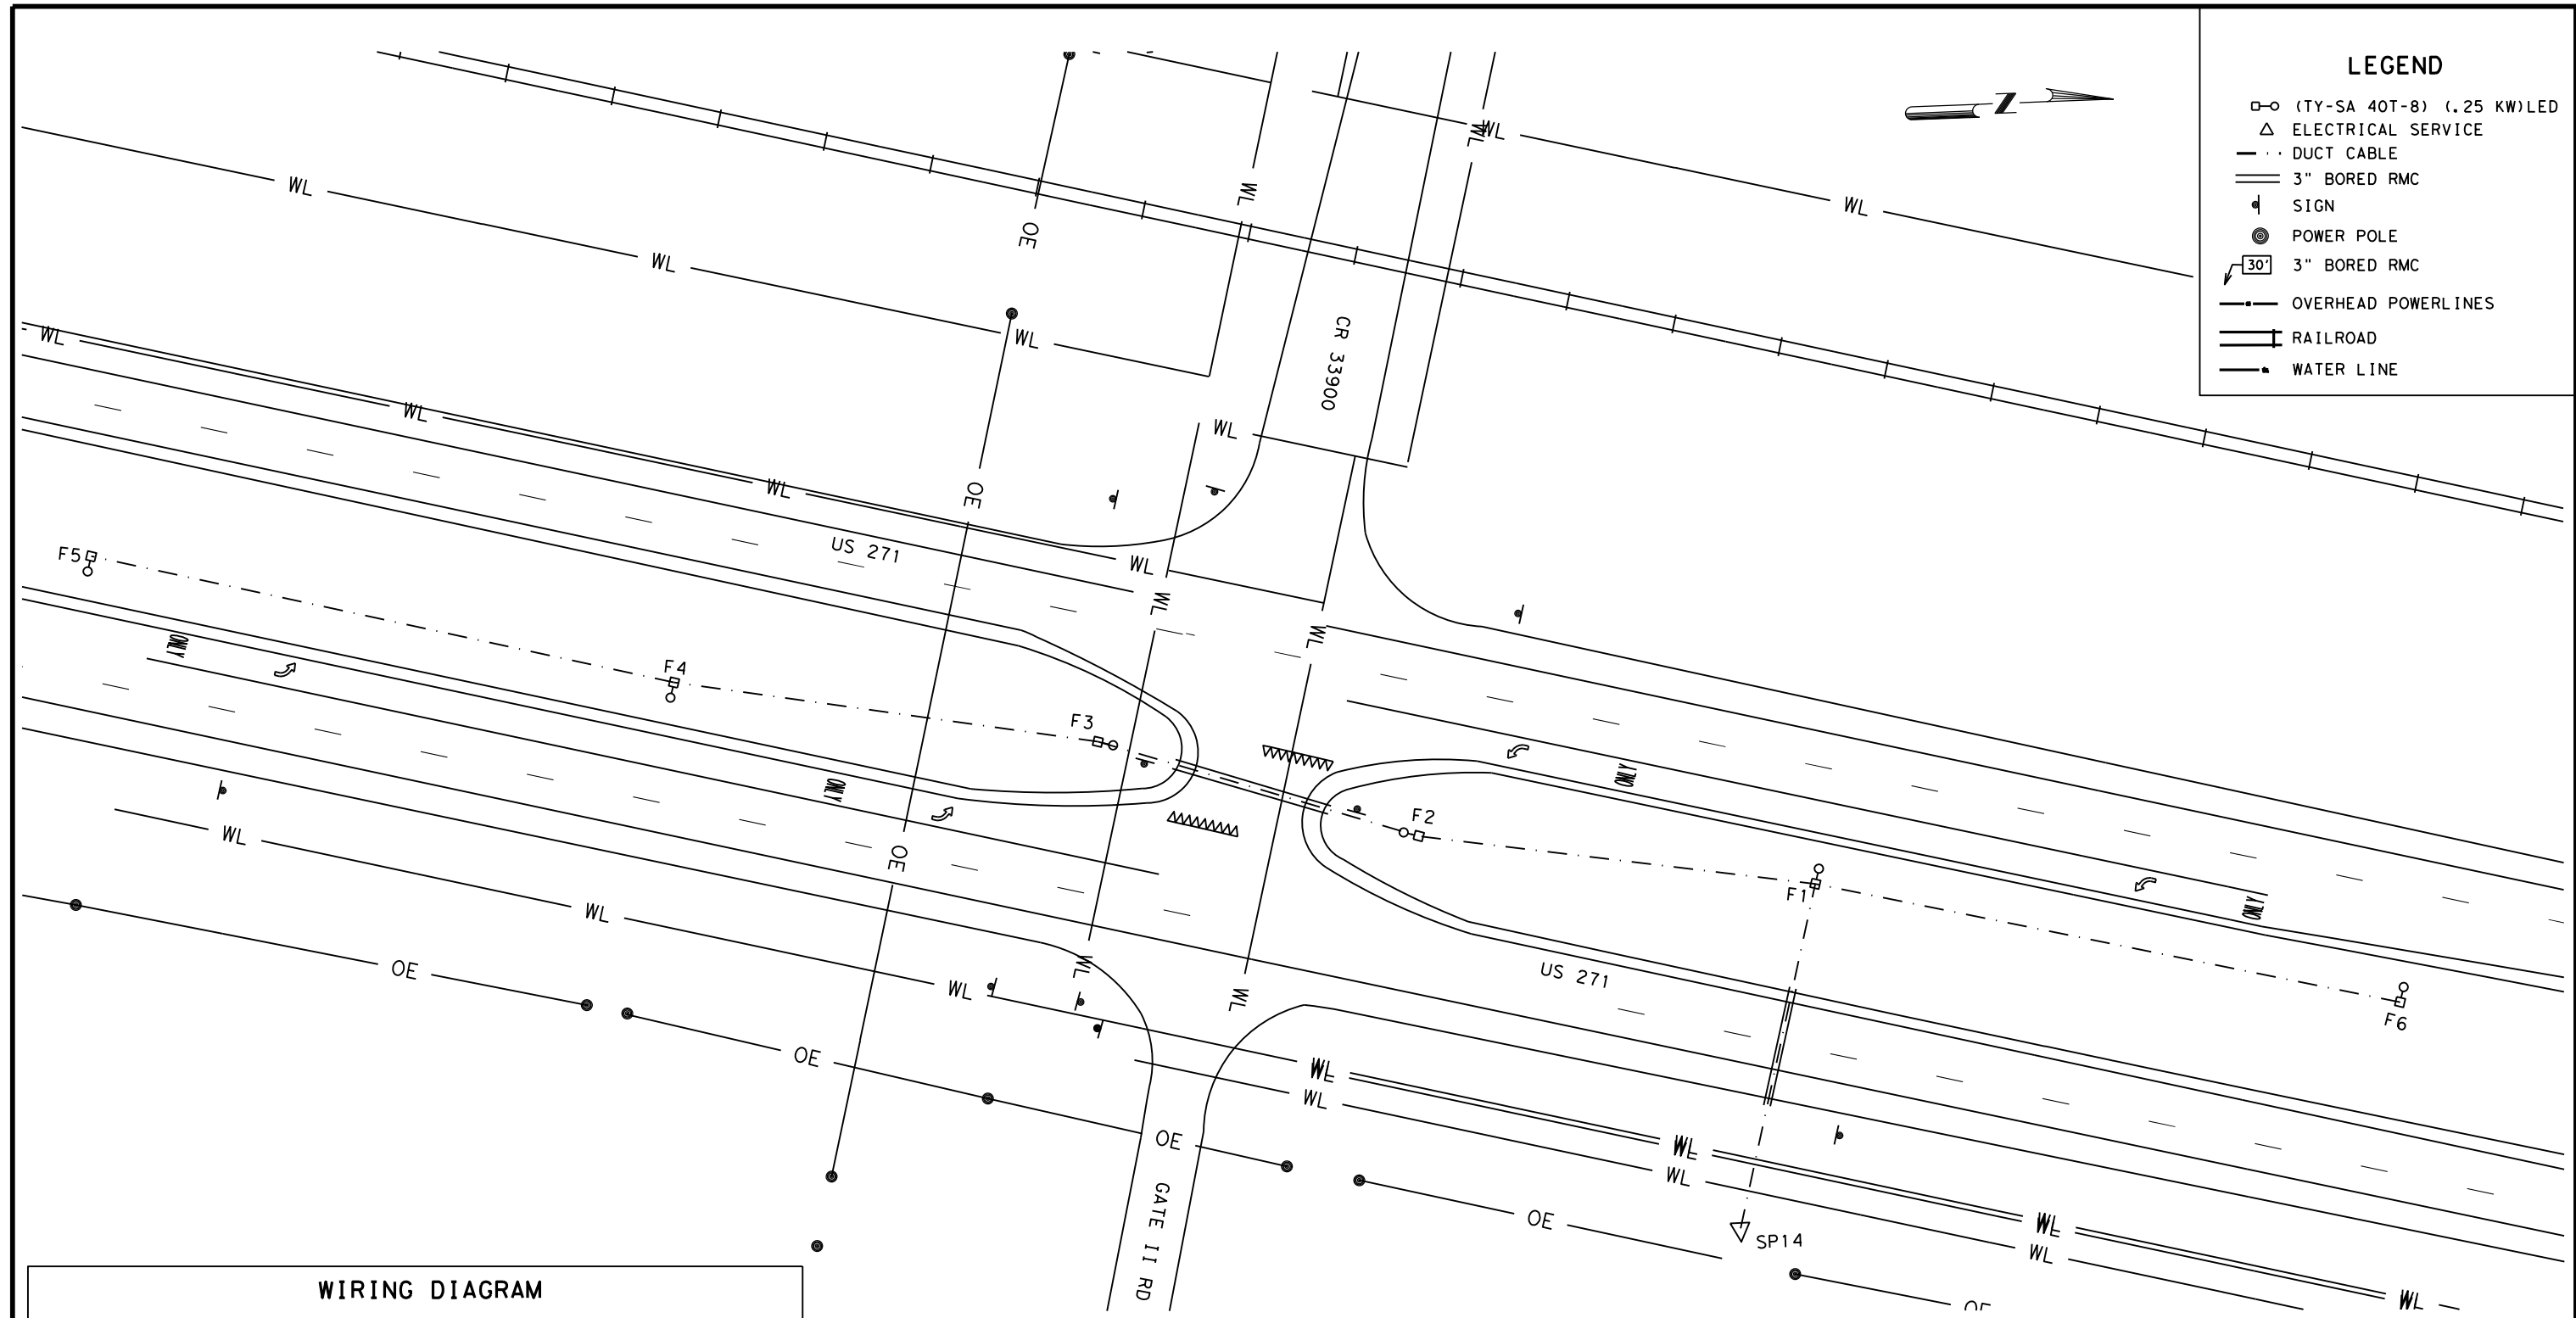

STATE OF TEXAS  
 DARIUS SAMUELS  
 97473  
 LICENSED PROFESSIONAL ENGINEER  
 4/19/2024



**ILLUMINATION LAYOUT**  
 US 271 AT GATE II RD  
 CSJ: 0136-08-049

© 2024  
 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		26

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\US 271 AT GATE II RD.dgn  
 DATE: 4/18/2024 9:41:38 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP14	ELC SRV TY A (120/240)060(NS)SS(E)SP(O) 628 6009(1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	F	2P/15	4.26	1.0


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
F1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	26
F2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	26
F3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	26
F4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	26
F5	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	26
F6	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	26

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	48	LF
432	6001	RIPRAP (CONC) (4 IN)	2.1	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	6	EA
618	6075	CONDT (RM) (3") (BORE)	105	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	1005	LF
6185	6002	TMA (STATIONARY)	7	DAY

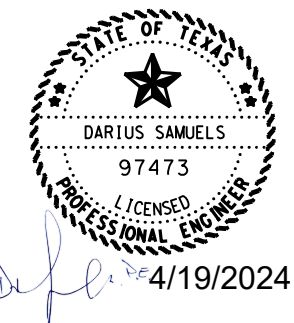

**QUANTITY SUMMARY**  
 US 271 AT  
 GATE II RD  
 CSJ: 0136-08-049



© 2024			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		27

FILE: T:\PARTRAF\ASHLEY\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\Lamar\FM 195 AT FM 196.dgn  
 DATE: 4/18/2024 9:41:41 AM



**LEGEND**


- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ==== 3" BORED RMC
- ⊣ SIGN
- POWER POLE
- ⌒ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- WATER LINE
- UTV - CABLE

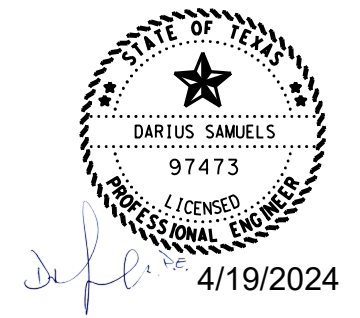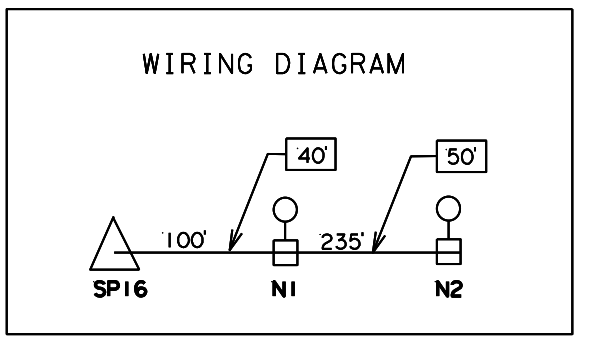

**ILLUMINATION LAYOUT**  
**FM 195 AT FM 196**  
**CSJ: 0730-02-061**

© 2024 **Texas Department of Transportation**

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		<b>28</b>

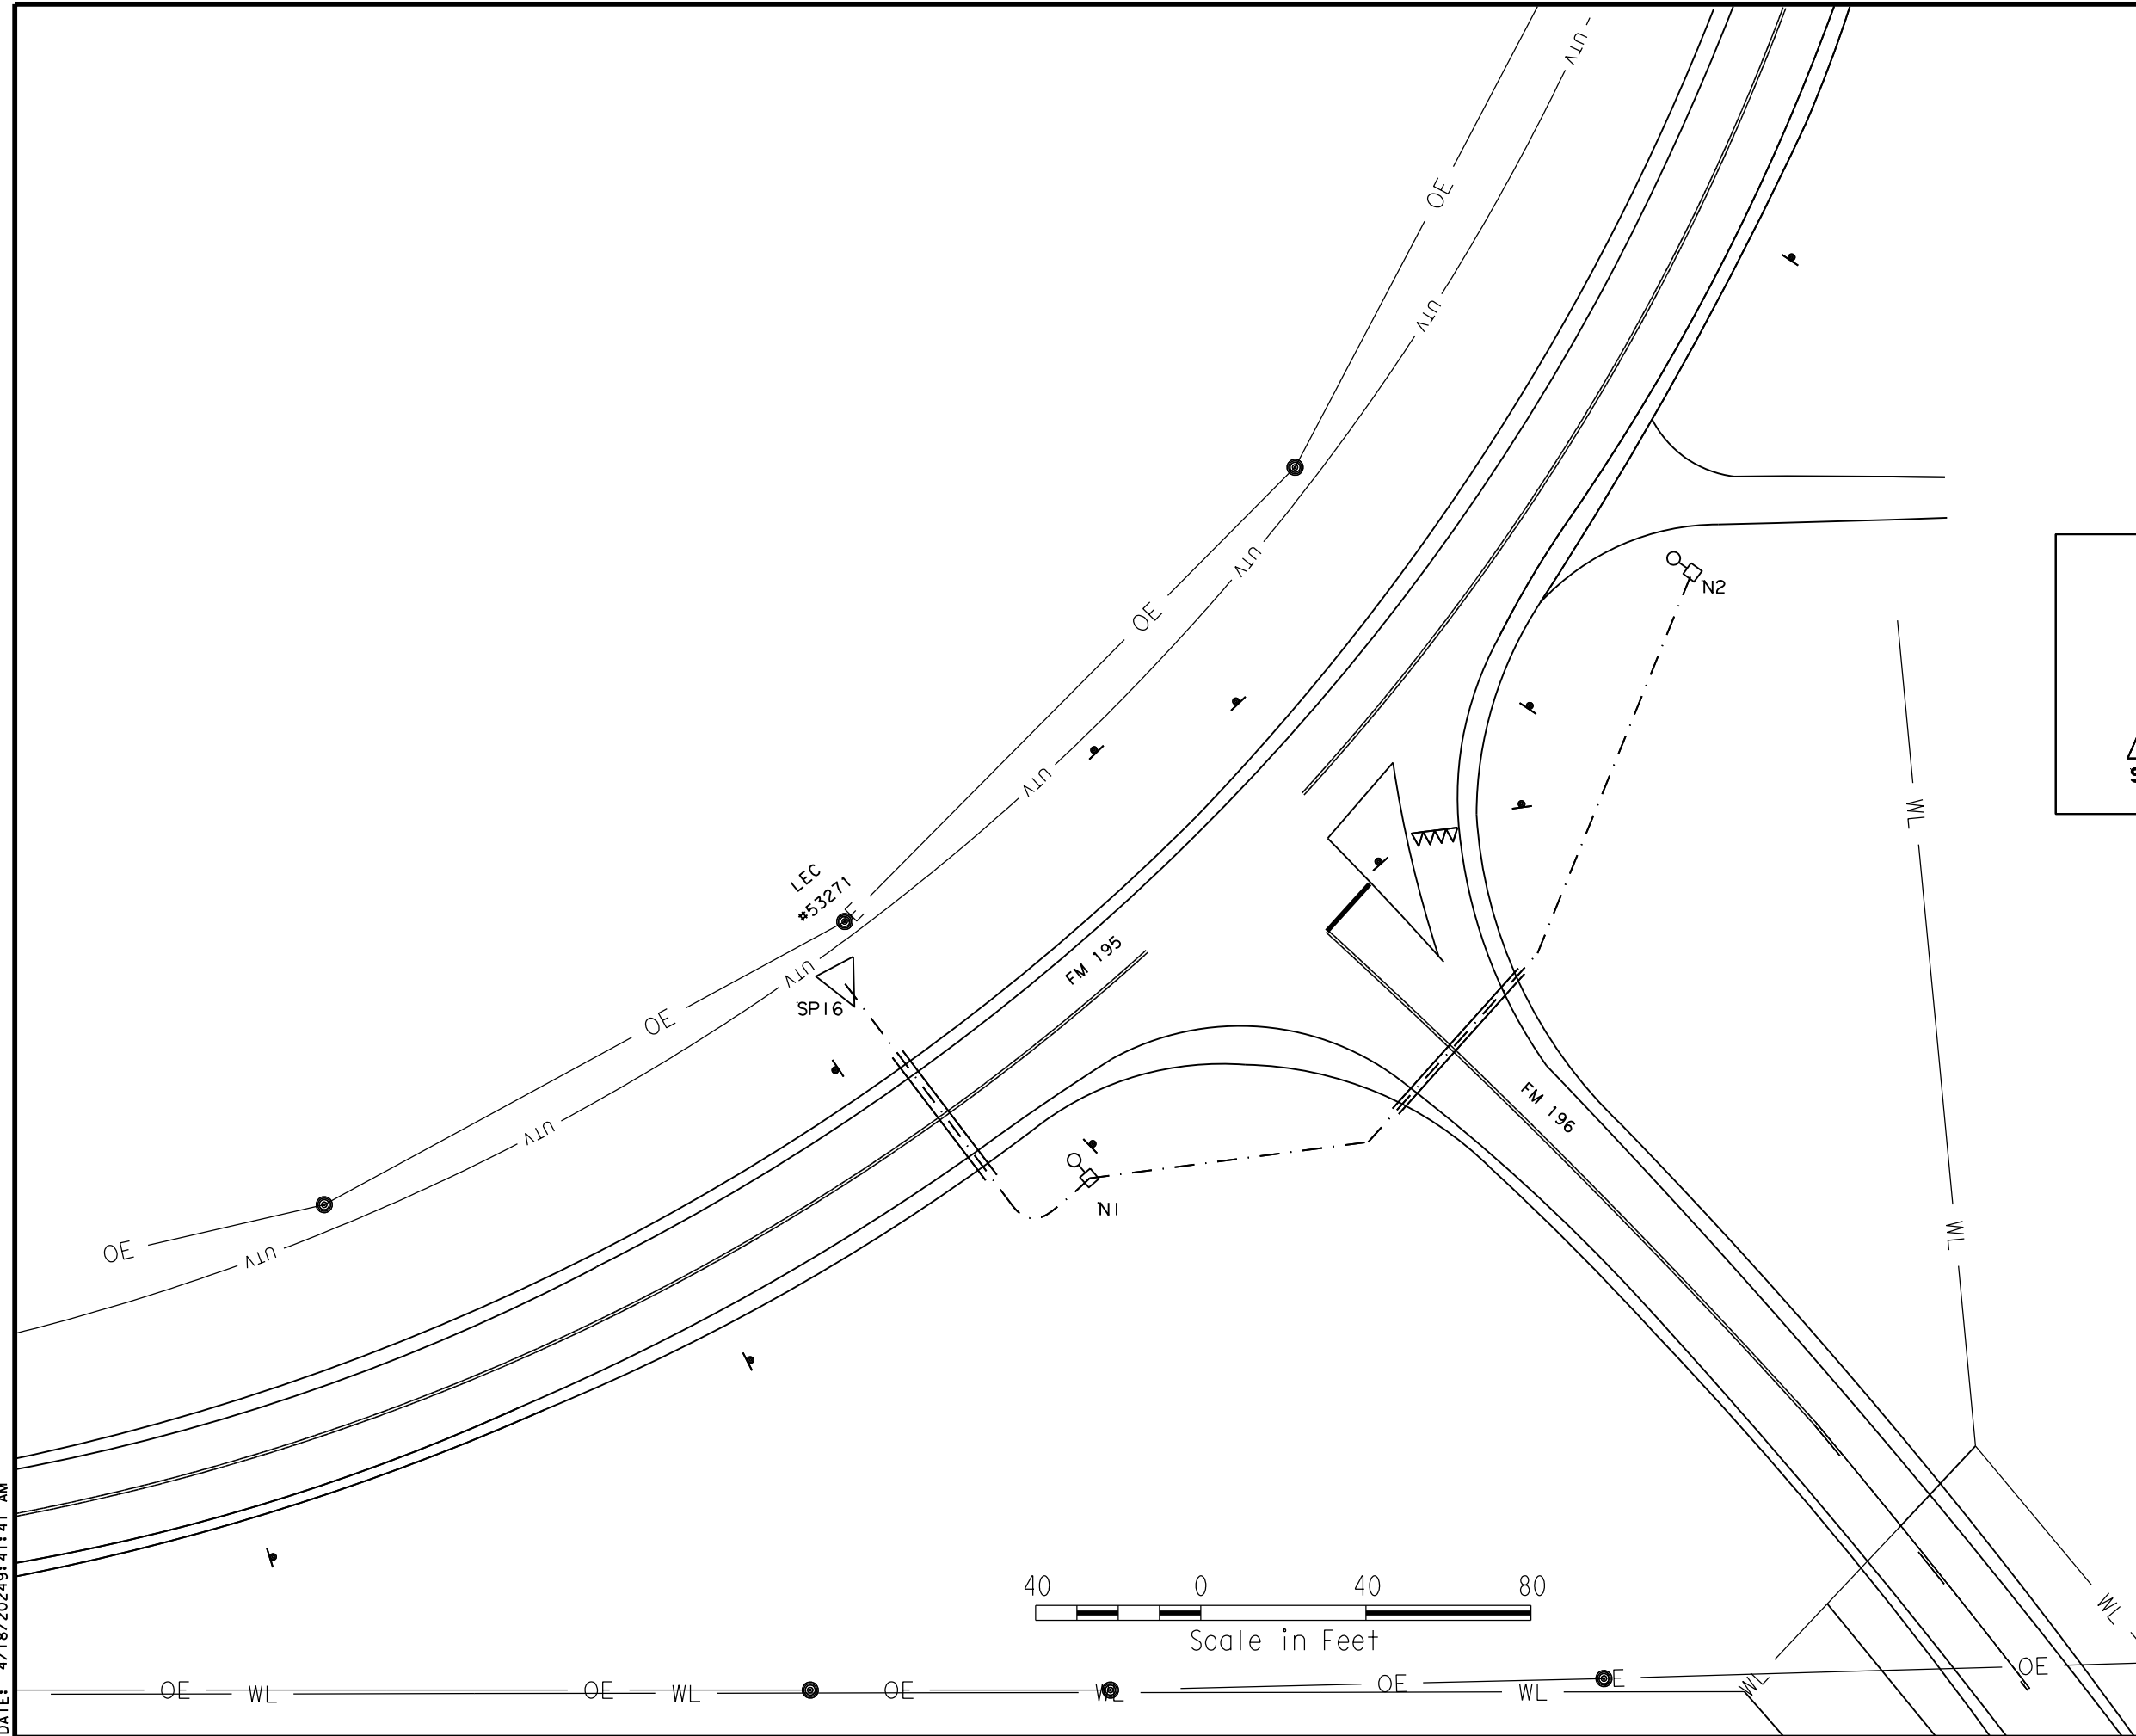

**ELECTRICAL SERVICES DATA SHEET**

ELEC. SERVICE ID	ELECTRICAL SERVICE DESCRIPTION	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. POLE/AMPS	LIGHTING CONTACTOR AMPS	PANELBD/LOADCENTER AMP RATING	BRANCH CIRCUIT ID	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP16	ELC SRV TY A 120/240 060 (INSISSEISPIO) 0628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	N	1P/15	1.42	0.3


**LUMINAIRE LAYOUT SUMMARY**

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
N1	RD IL AM (TY SA) 40T - 8 (25 KW) LED	8'	•	28
N2	RD IL AM (TY SA) 40T - 8 (25 KW) LED	8'	•	28


\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

**MISCELLANEOUS QUANTITY SUMMARY**


ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	16	LF
432	6001	RIPRAP (CONC) (4 IN)	0.7	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	2	EA
618	6075	CONDT (RM) (3") (BORE)	90	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	335	LF
6185	6002	TMA (STATIONARY)	7	DAY

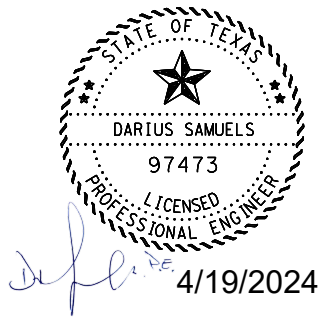

**QUANTITY SUMMARY**  
**FM 195 AT FM 196**  
**CSJ: 0730-02-061**



© 2024 			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		29

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\SL 286 AT FM 1507.dgn  
 DATE: 4/18/2024 9:41:46 AM

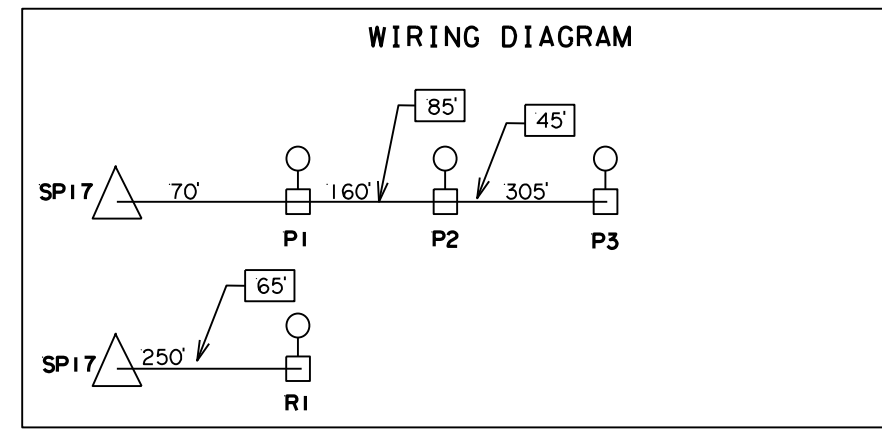

**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- DUCT CABLE
- === 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ⌒ 30' 3" BORED RMC
- OVERHEAD POWERLINES

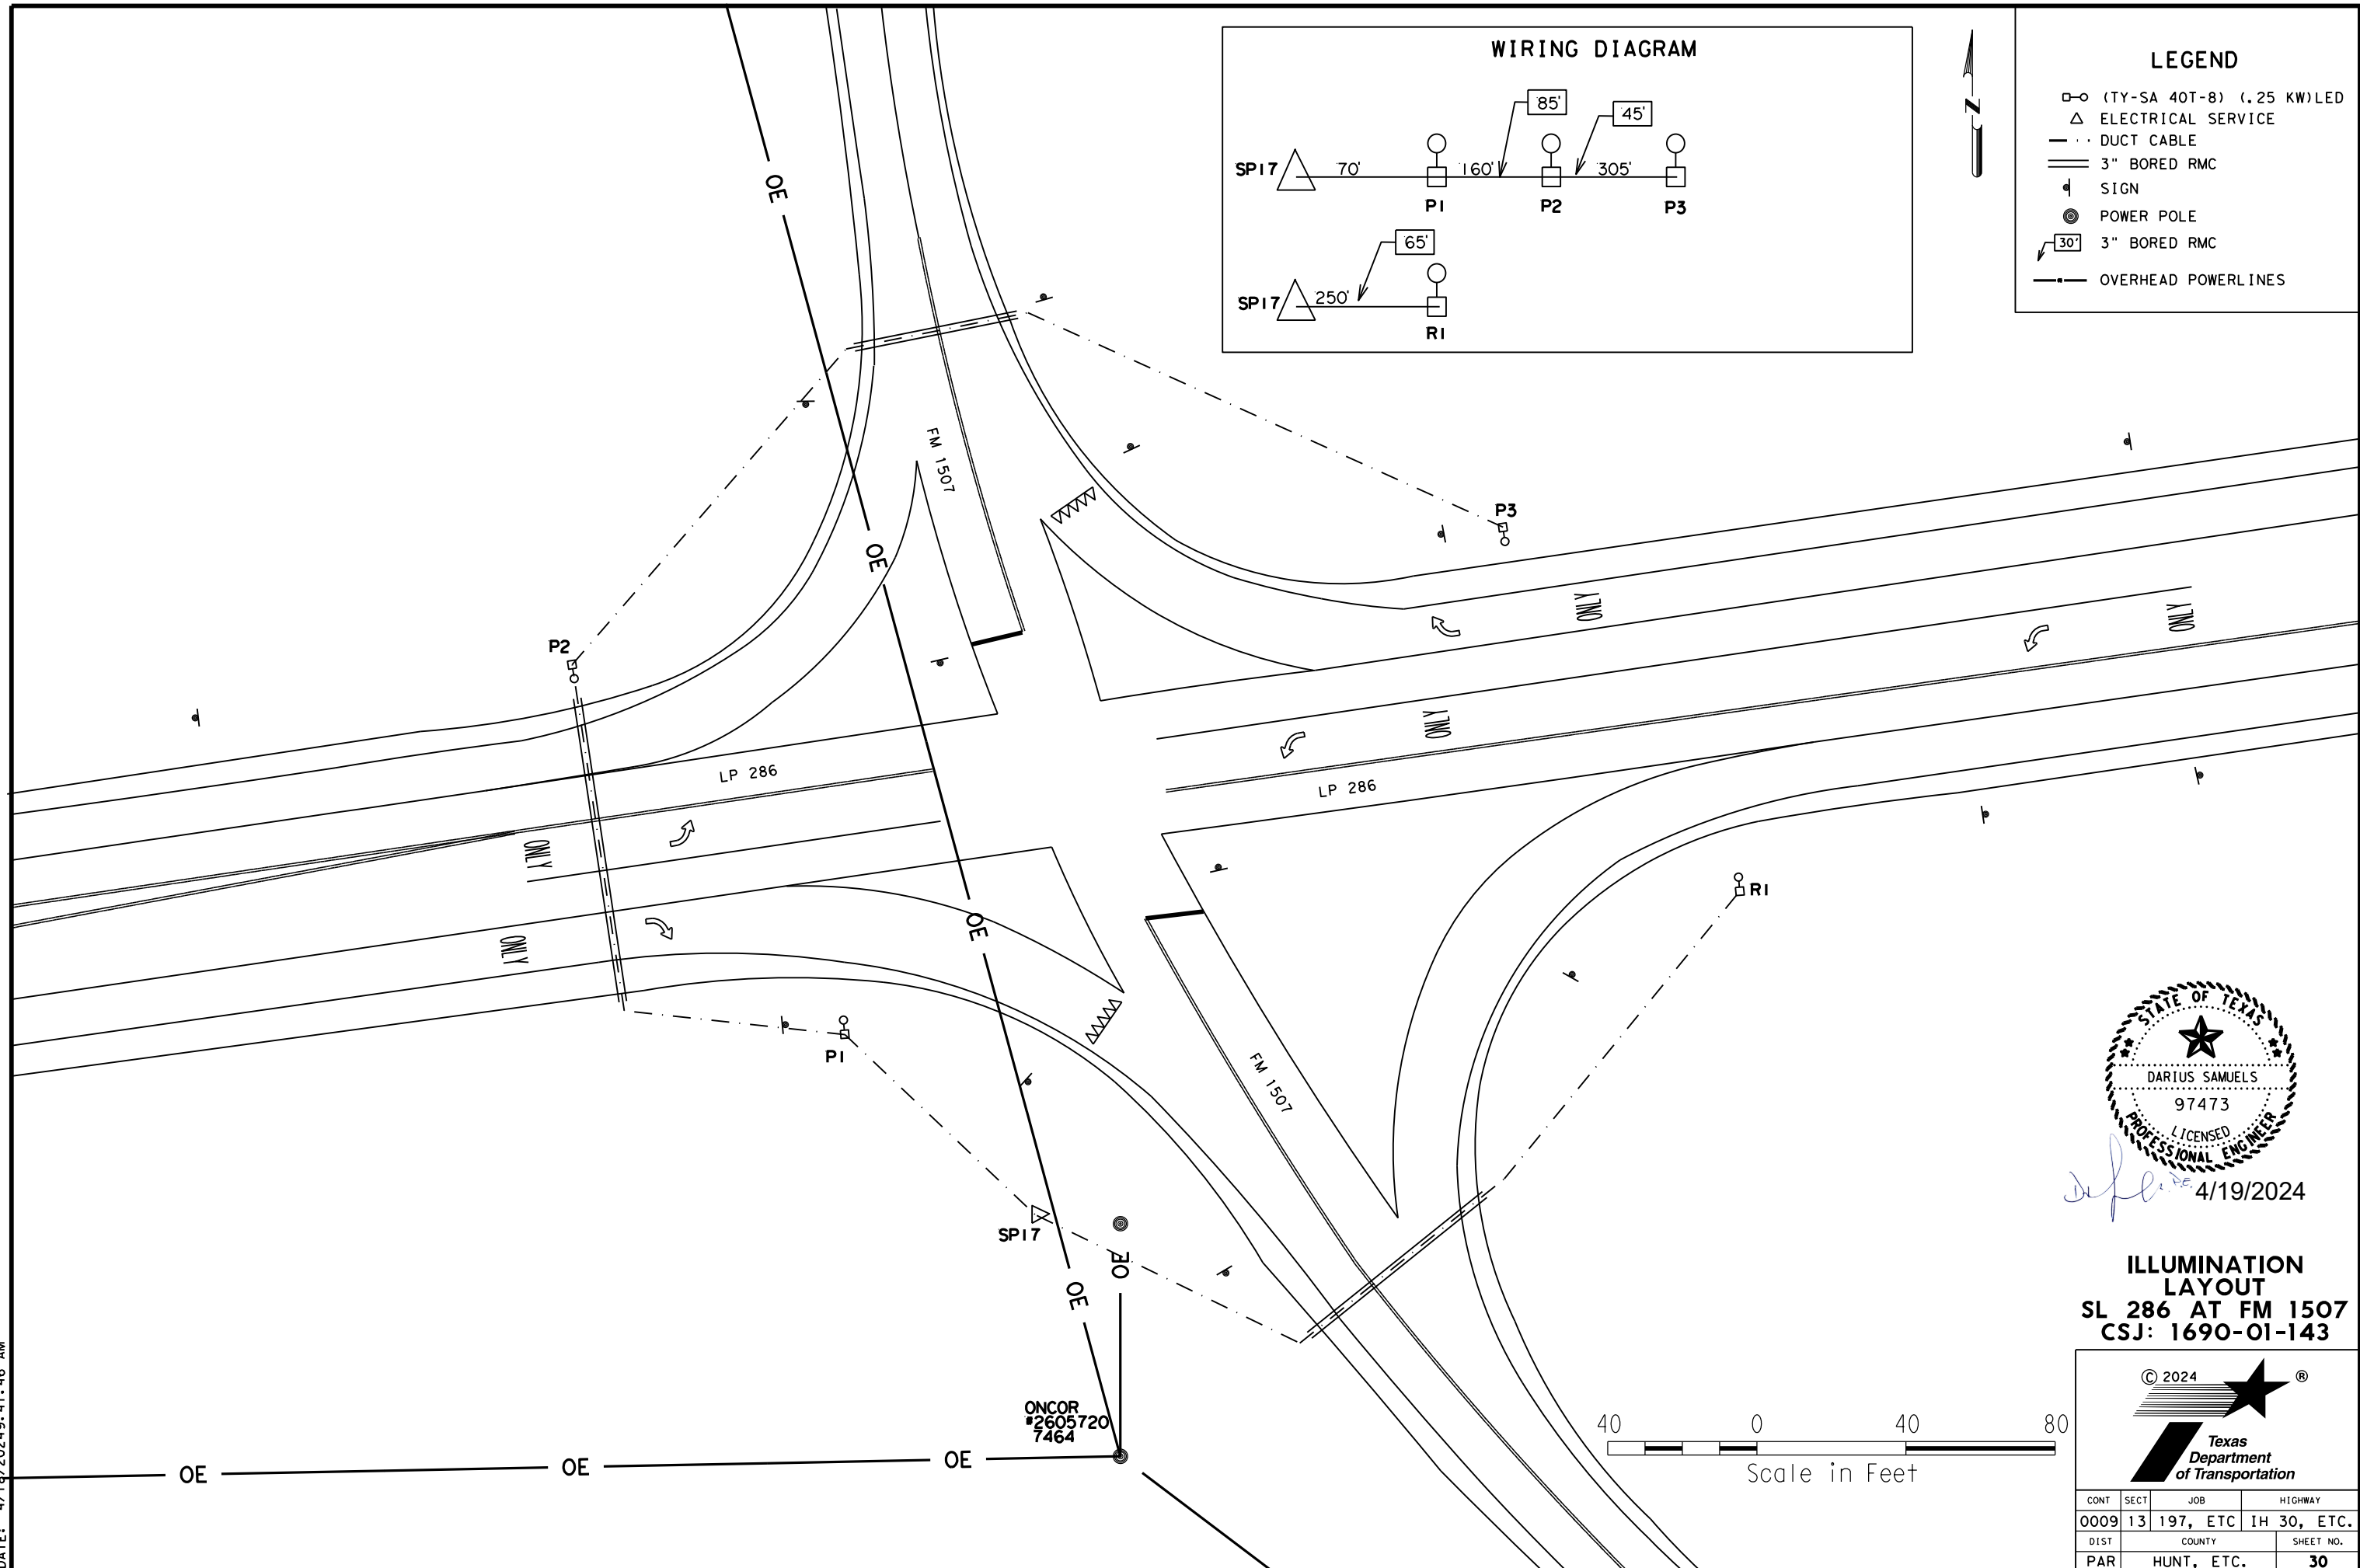

*[Signature]* 4/19/2024

**ILLUMINATION LAYOUT**  
 SL 286 AT FM 1507  
 CSJ: 1690-01-143



© 2024

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		30

ONCOR  
 #2605720  
 7464




FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Lamar\SL 286 AT FM 1507.dgn  
 DATE: 4/18/2024 9:41:48 AM

ELECTRICAL SERVICES DATA SHEET											
ELEC. SERVICE ID	ELECTRICAL SERVICE DESCRIPTION	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. POLE/AMPS	LIGHTING CONTACTOR AMPS	PANELBD/LOADCENTER AMP RATING	BRANCH CIRCUIT ID	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP17	ELC SRV TY A 120/240 060 (NS)SS(E)SP(O) 0628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	2P/ 60	N/A	P R	2P/15	2.13 0.71	0.7

LUMINAIRE LAYOUT SUMMARY				
POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
P1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	30
P2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	30
P3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	30
R1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	30

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

MISCELLANEOUS QUANTITY SUMMARY				
ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	32	LF
432	6001	RIPRAP (CONC) (4 IN)	1.4	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	4	EA
618	6075	CONDT (RM) (3") (BORE)	195	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	785	LF
6185	6002	TMA (STATIONARY)	7	DAY

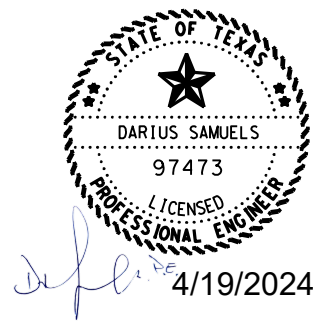


**QUANTITY SUMMARY**  
 SL 286 AT FM 1507  
 CSJ: 1690-01-143

© 2024					
CONT	SECT	JOB	HIGHWAY		
0009	13	197, ETC	IH 30, ETC.		
DIST		COUNTY	SHEET NO.		
PAR		HUNT, ETC.	31		



I:\PARTRA\Ashley\PROJECTS\Safety Lighting Let+8-24\DESIGN PLANS\Del\to\SH 24 AT FM 1528copy.dgn

LEGEND	
	(TY-SA 40T-8) (.25 KW) LED
	ELECTRICAL SERVICE
	DUCT CABLE
	3" BORED RMC
	SIGN
	POWER POLE
	3" BORED RMC
	OVERHEAD POWERLINES
	FENCE
	ROW

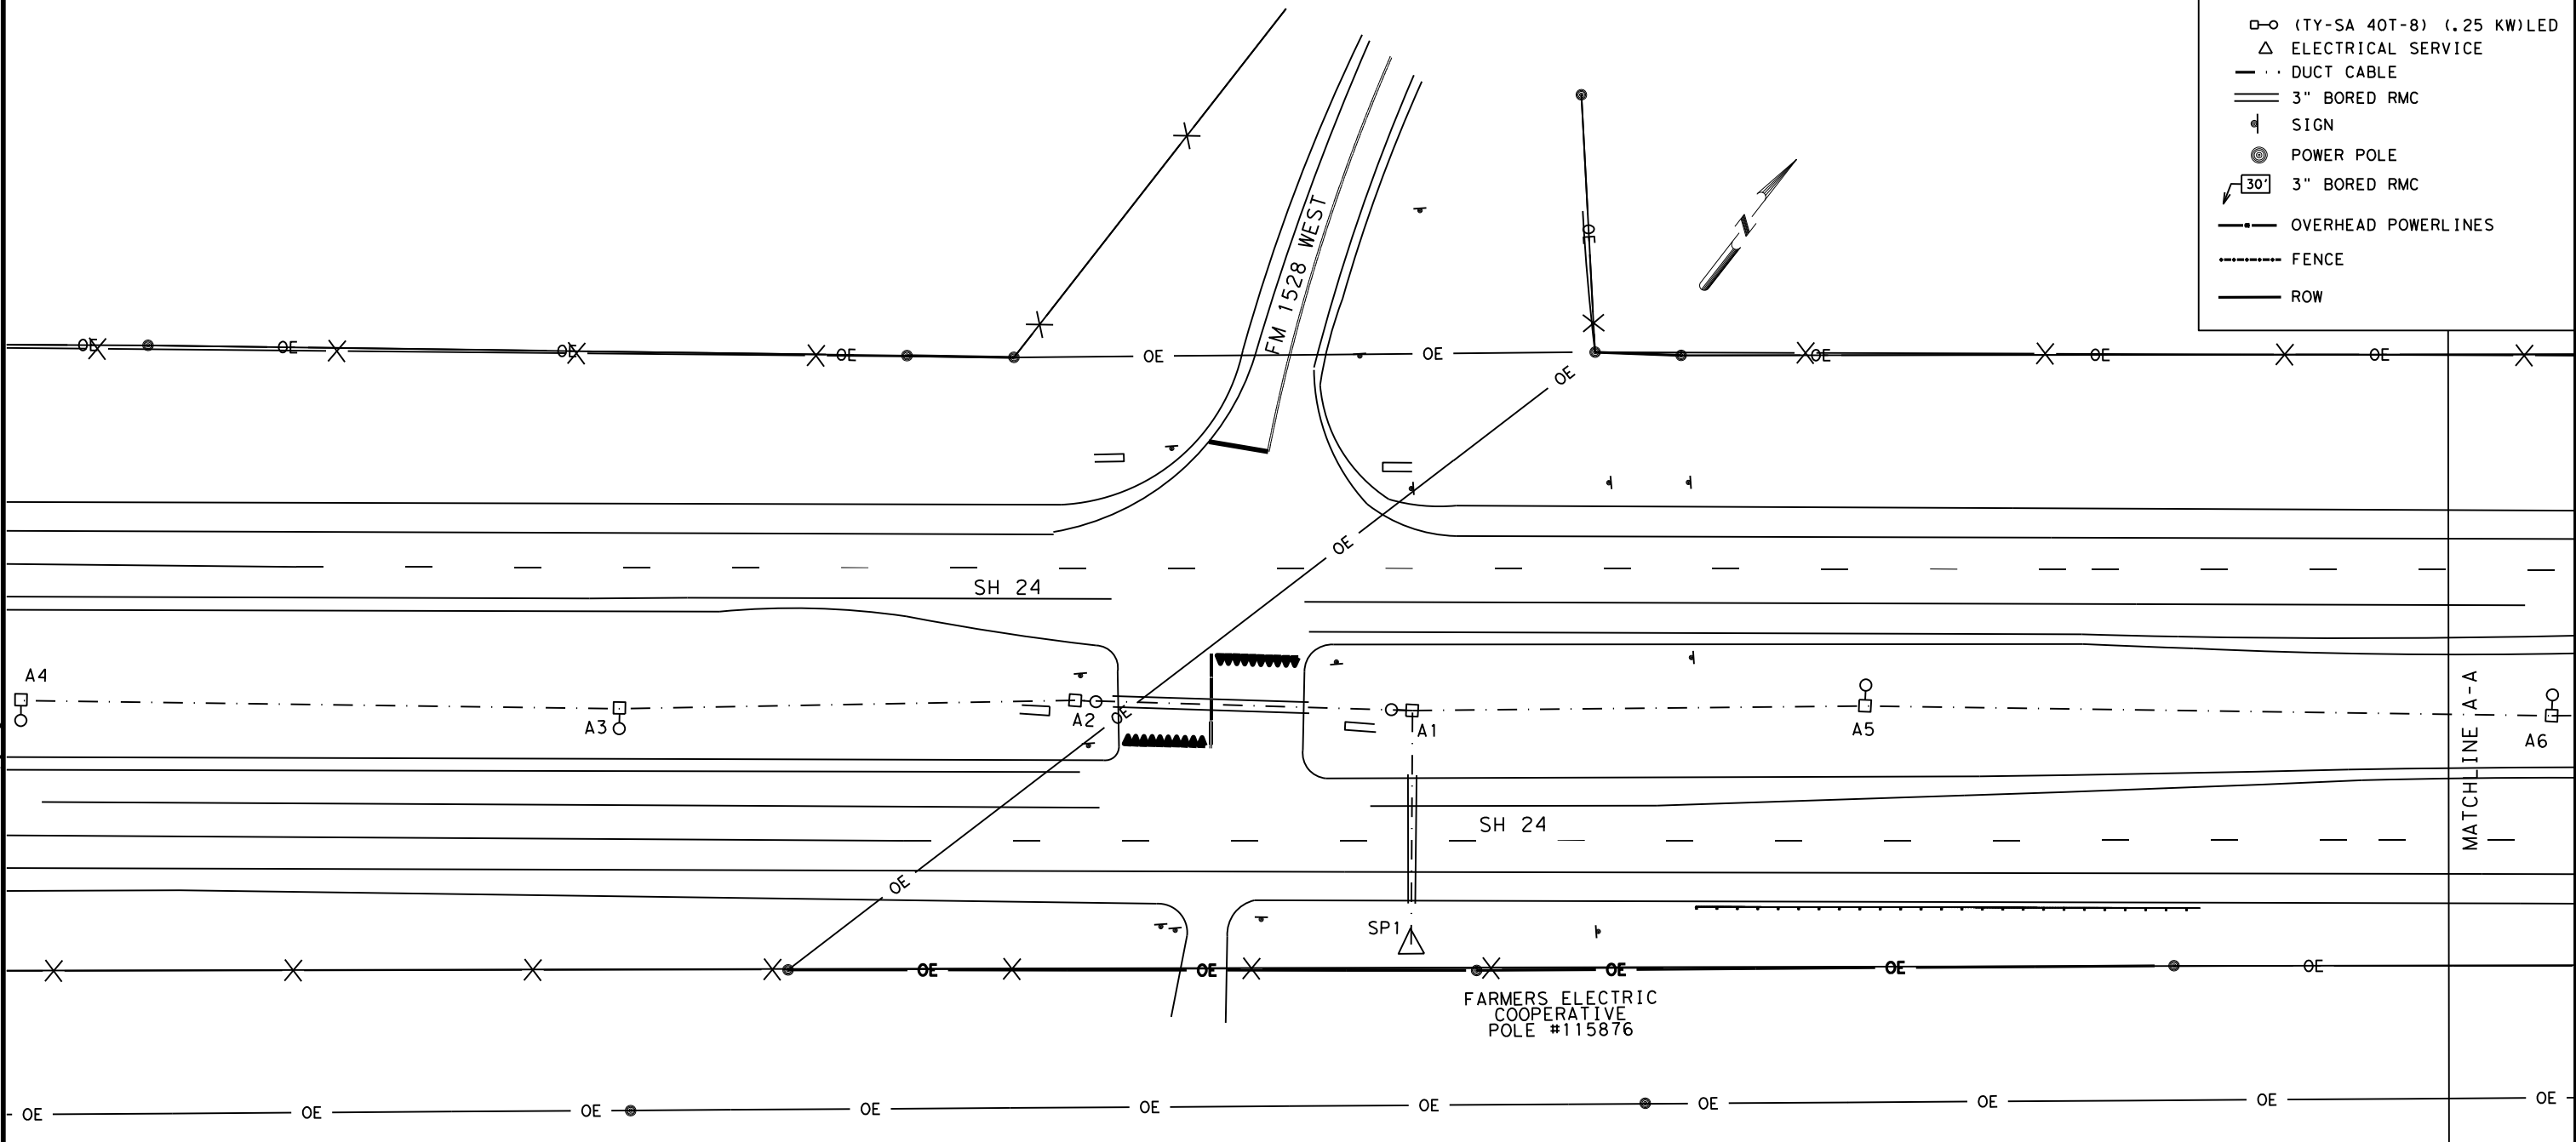


FARMERS ELECTRIC  
COOPERATIVE  
POLE #115876


**WIRING DIAGRAM**

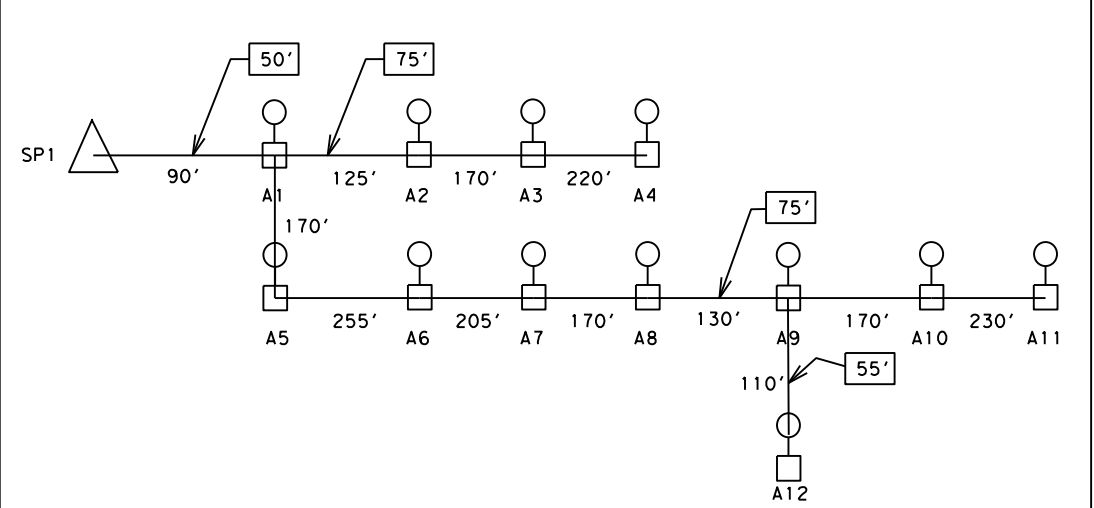

*D. Samuels* 4/19/2024



**ILLUMINATION LAYOUT**  
SH 24 AT FM 1528  
CSJ: 0136-03-068  
1 of 2

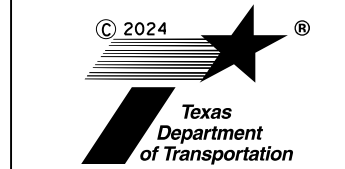


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		32



I:\PARTRA\Ashley\PROJECTS\Safety Lighting Let+8-24\DESIGN PLANS\Delto\SH 24 AT FM 1528copy.dgn

**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ▭ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- FENCE
- ROW

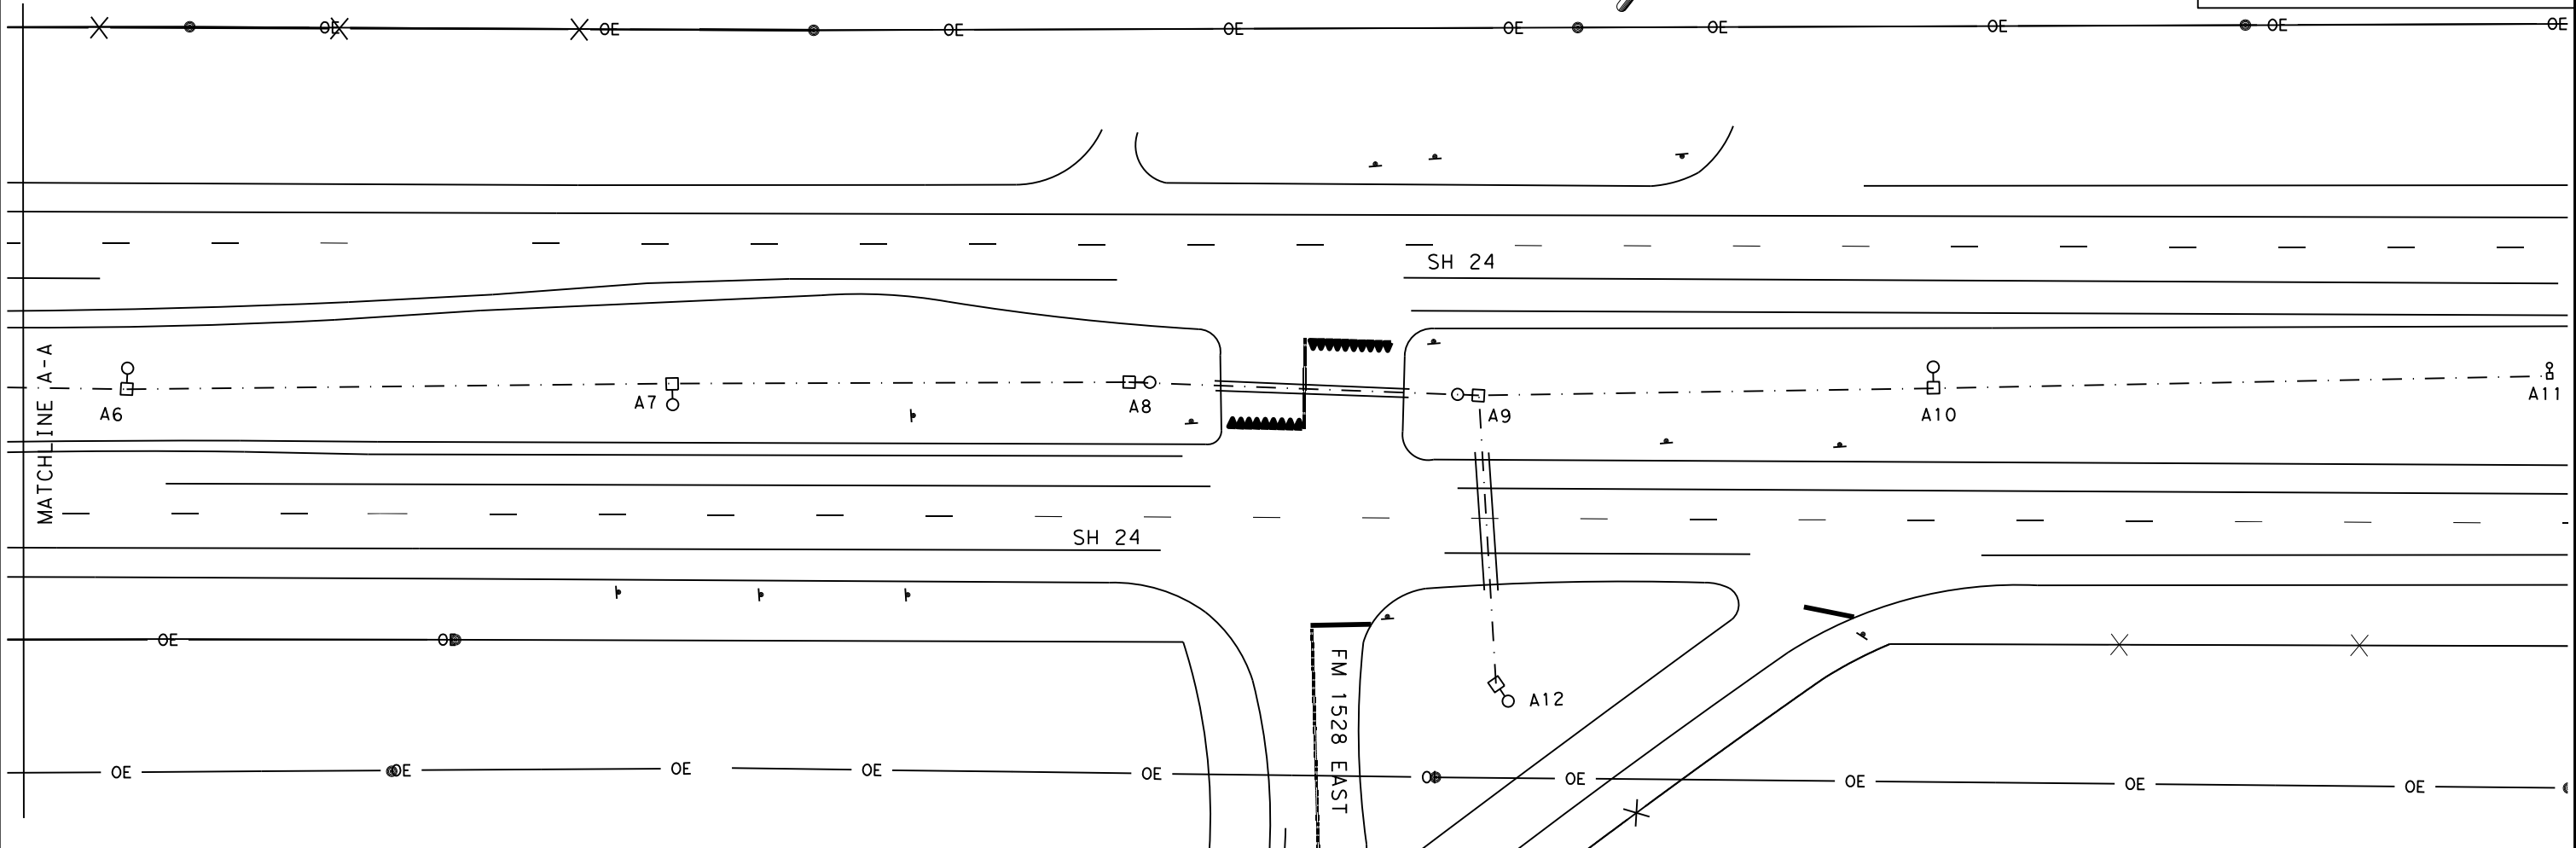


**WIRING DIAGRAM**

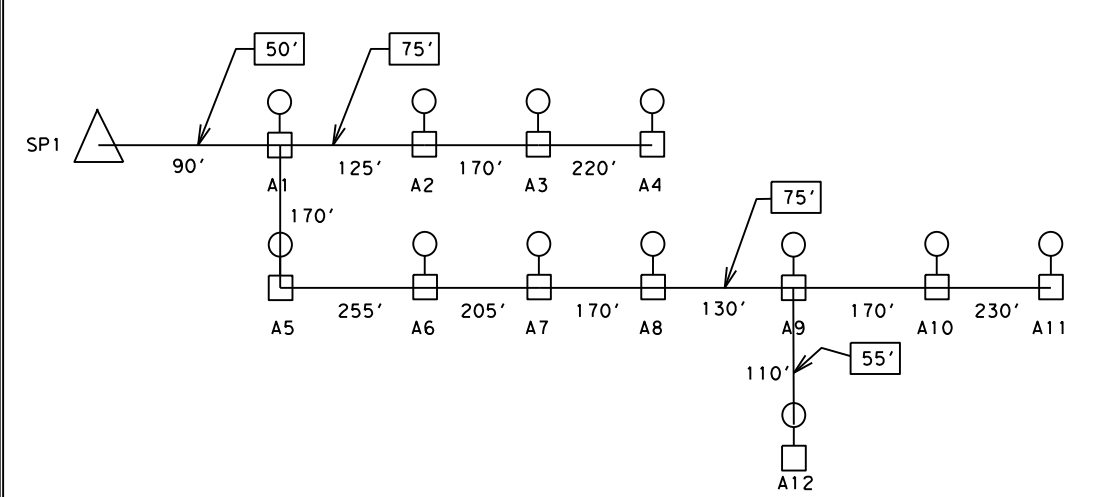

*D. Samuels* 4/19/2024

**ILLUMINATION LAYOUT**  
**SH 24 AT FM 1528**  
**CSJ: 0136-03-068**  
**2 of 2**



© 2024			
CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		33

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\Delet\SH 24 AT FM 1528copy.dgn  
 DATE: 4/18/2024 9:41:57 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP1	ELC SRV TY A (120/240)060(NS)SS(E)SP(O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	A	2P/15	8.52	2.0


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
A1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	32
A2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	32
A3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	32
A4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	32
A5	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	32
A6	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33
A7	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33
A8	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33
A9	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33
A10	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33
A11	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33
A12	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	33

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	96	LF
432	6001	RIPRAP (CONC) (4 IN)	4.2	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	12	EA
618	6075	CONDT (RM) (3") (BORE)	255	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	2045	LF
6185	6002	TMA (STATIONARY)	7	DAY

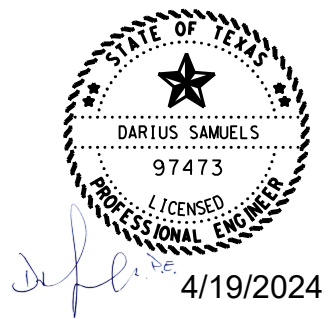

**QUANTITY SUMMARY**  
 SH 24 AT FM 1528  
 CSJ: 0136-03-068


© 2024 <sup>®</sup>

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		34


FILE: \\fs-paring.dot.state.tx.us\data1\data\par\groups\par\traf\ashley\projects\safety\lighting\let\*8-24\design\plans\Delta\SH 24 AT BU 24D (North).dgn  
 DATE: 4/18/2024 9:42:01 AM

**LEGEND**



- (TY-SA 40T-8) (.25 KW) LED
- △ ELECTRICAL SERVICE
- - - DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ⊥ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- ROW

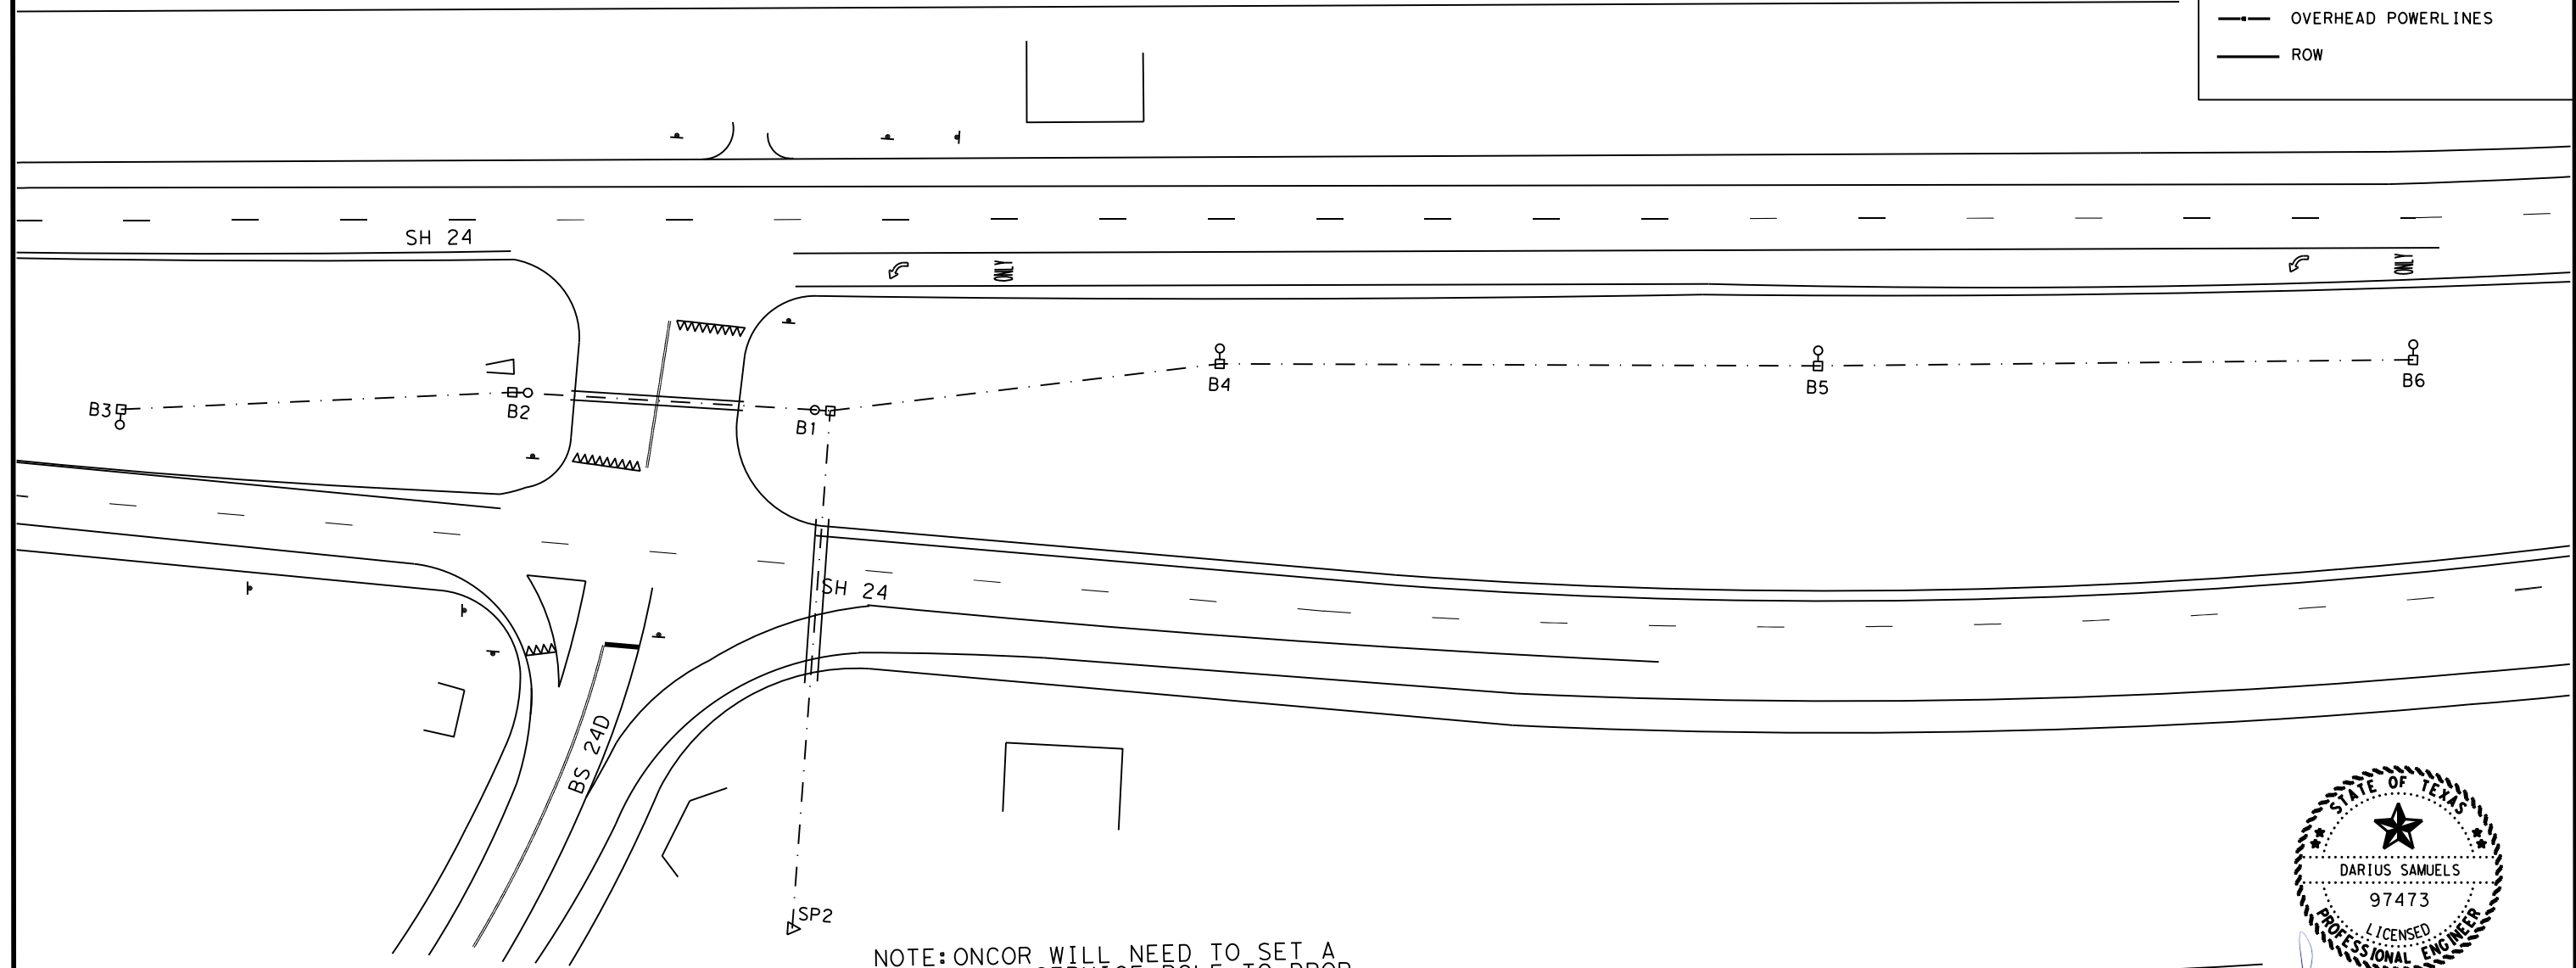

NOTE: ONCOR WILL NEED TO SET A SECONDARY SERVICE POLE TO DROP SERVICE TO TXDOT




**WIRING DIAGRAM**

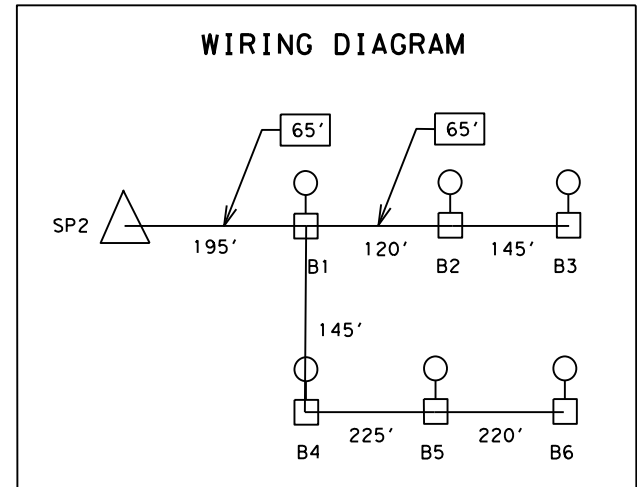

*D. Samuels* 4/19/2024

**ILLUMINATION LAYOUT  
 SH 24 AT BS 24D  
 (NW 1ST STREET)  
 CSJ: 0136-03-069**



CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		35

FILE: \\fs-parha.dot.state.tx.us\data\1\data\par\groups\par\traf\ashley\projects\safety\lighting\let\*8-24\design\plans\Delta\SH 24 AT BU 24D (North).dgn  
 DATE: 4/18/2024 9:42:04 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP2	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	B	2P/15	4.26	1.0


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
B1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	35
B2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	35
B3	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	35
B4	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	35
B5	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	35
B6	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	35

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	48	LF
432	6001	RIPRAP (CONC) (4 IN)	2.1	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	6	EA
618	6075	CONDT (RM) (3") (BORE)	130	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	1050	LF
6185	6002	TMA (STATIONARY)	7	DAY




*Darius Samuels* 4/19/2024

**QUANTITY SUMMARY**  
 SH 24 AT BS 24D  
 (NW 1ST STREET)  
 CSJ: 0136-03-069




CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		36

FILE: T:\PARTRAF\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Deit\SH 24 AT FM 198.dgn  
 DATE: 4/18/2024 9:42:07 AM

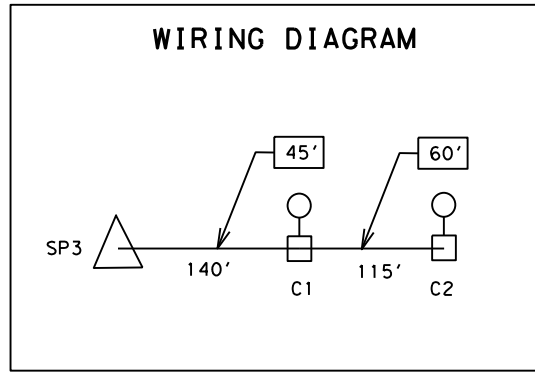


### LEGEND

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- - - DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ⌒ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- ROW
- ×-×- FENCE LINE

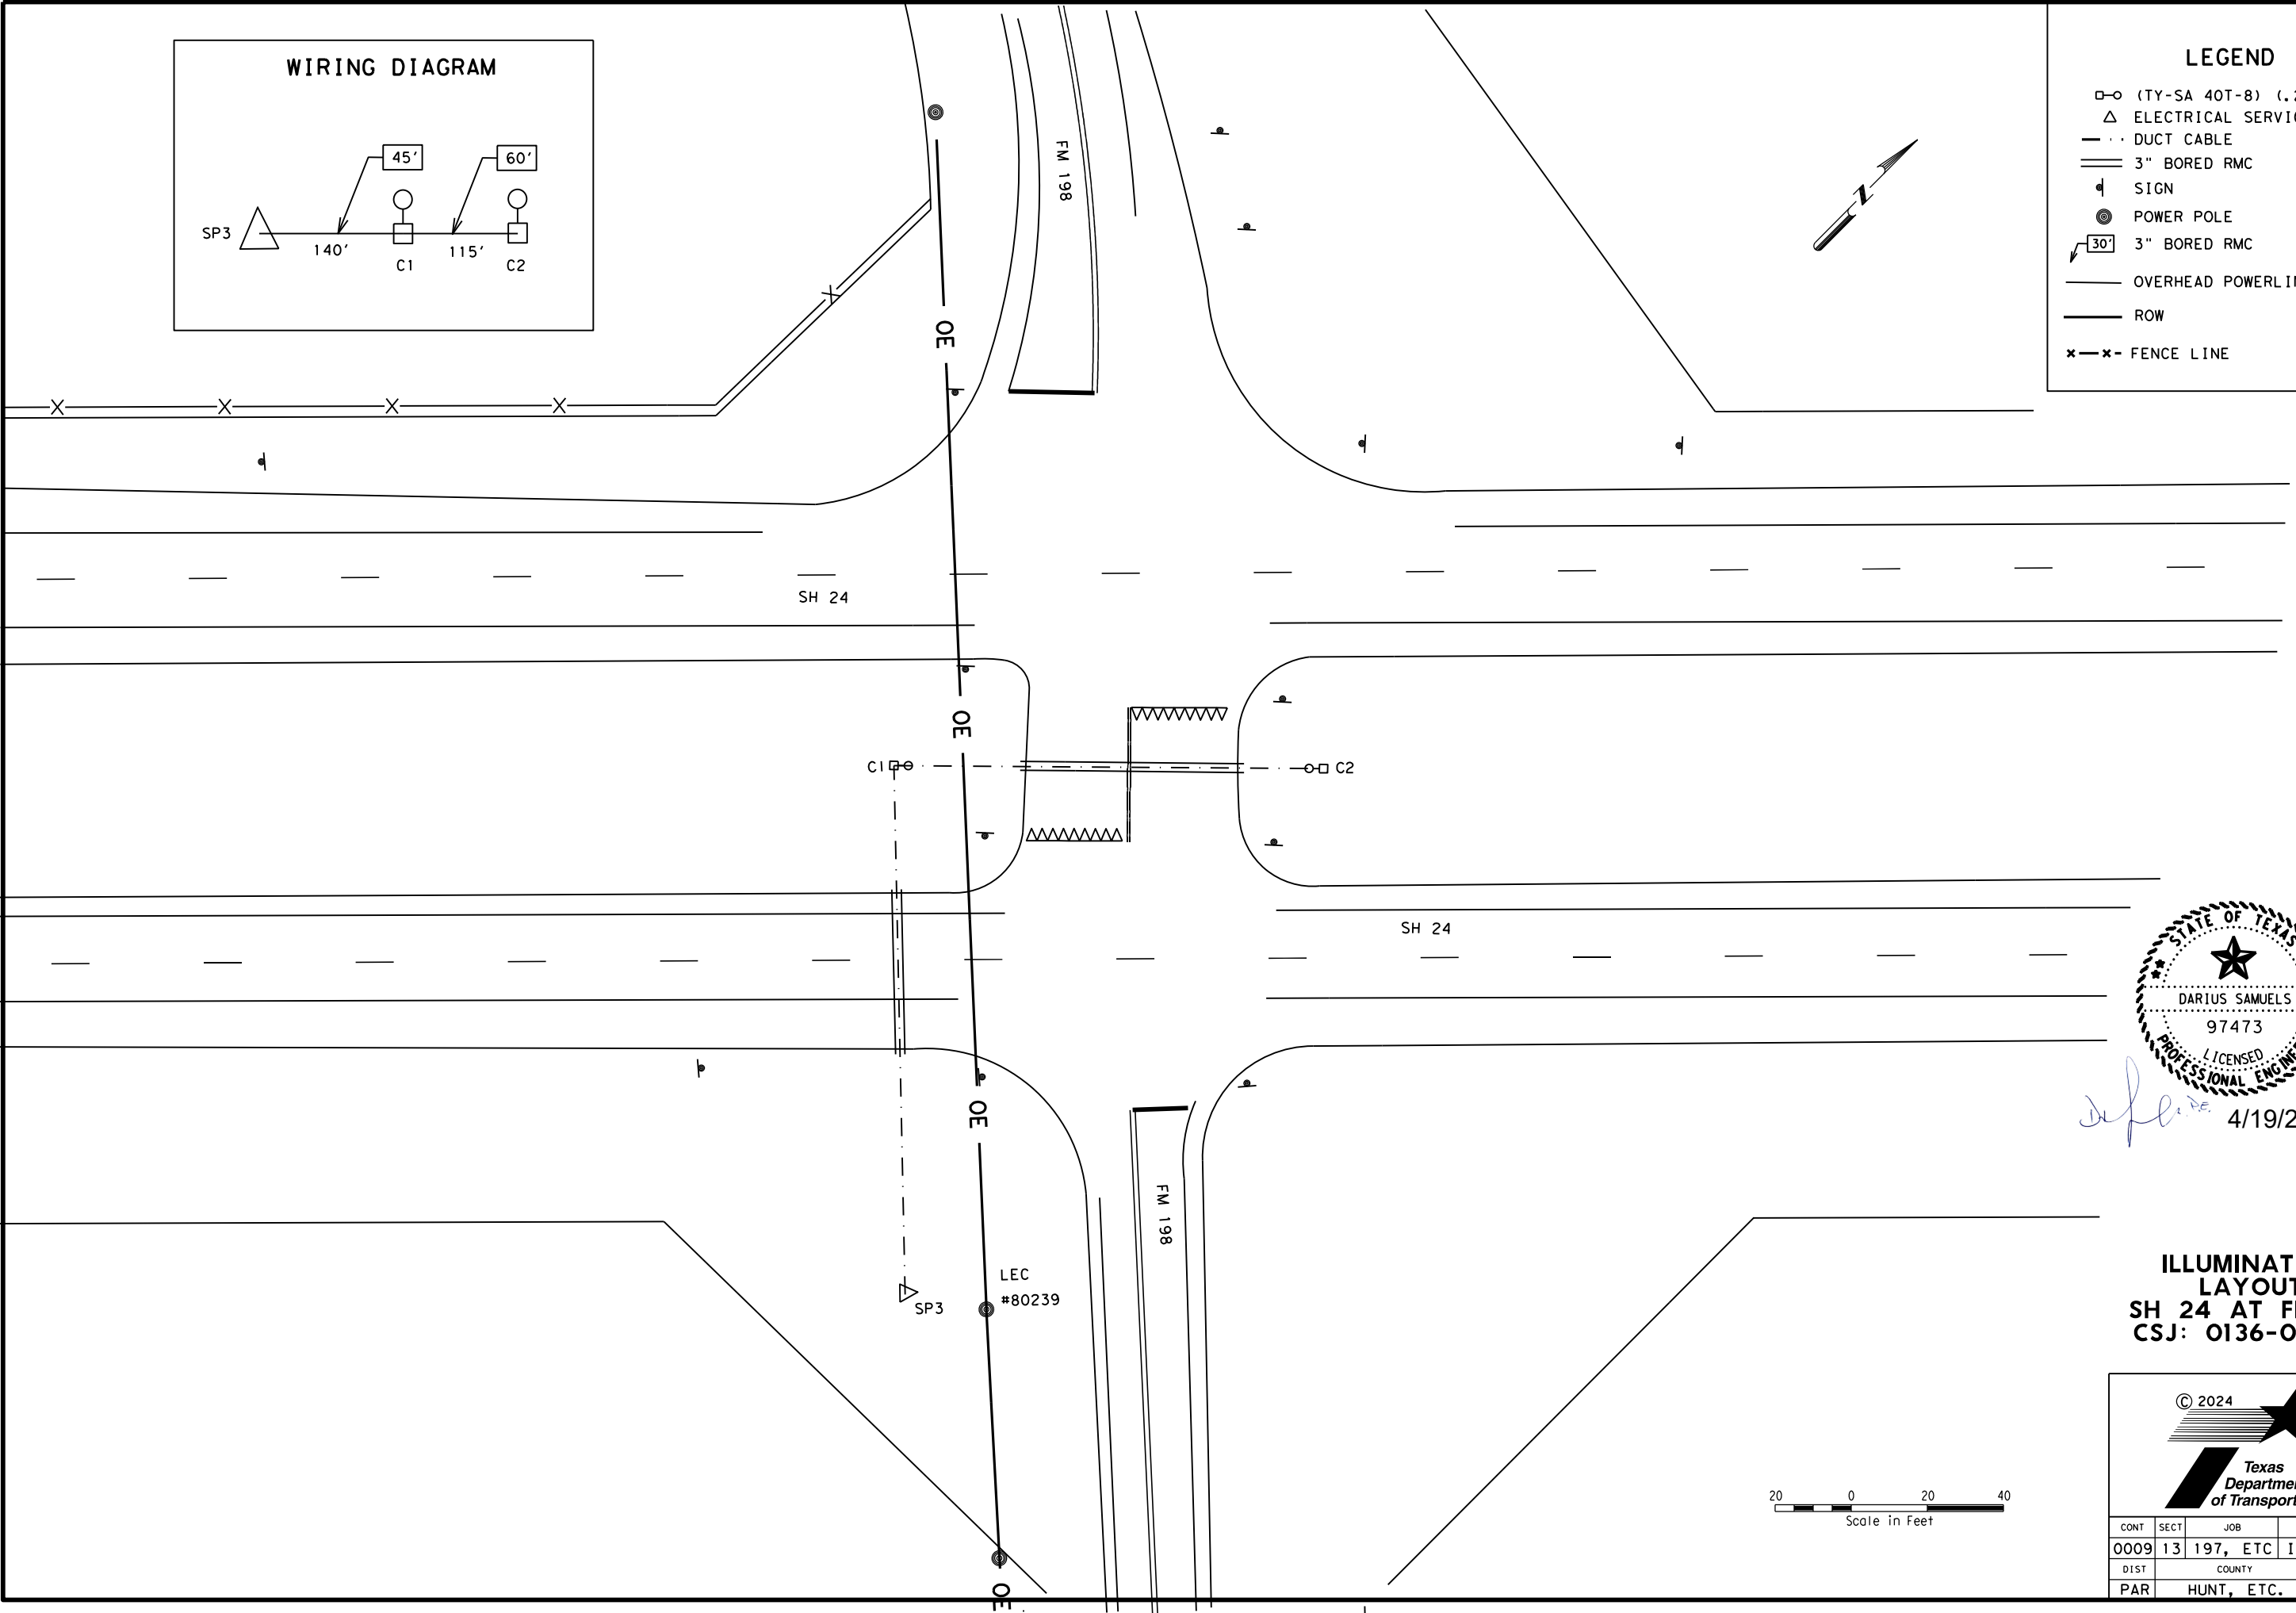

DARIUS SAMUELS  
 97473  
 LICENSED PROFESSIONAL ENGINEER  
*D. Samuels* 4/19/2024

**ILLUMINATION LAYOUT**  
**SH 24 AT FM 198**  
**CSJ: 0136-04-051**



© 2024

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		37

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\DeIta\SH 24 AT FM 198.dgn  
 DATE: 4/18/2024 9:42:10 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP3	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	C	2P/15	1.42	0.3


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
C1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	37
C2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	37

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	16	LF
432	6001	RIPRAP (CONC) (4 IN)	0.70	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	2	EA
618	6075	CONDT (RM) (3") (BORE)	105	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	255	LF
6185	6002	TMA (STATIONARY)	7	DAY

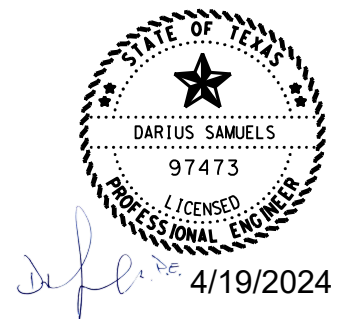

**QUANTITY SUMMARY**  
 SH 24 AT FM 198  
 CSJ: 0136-04-051

© 2024 Texas Department of Transportation


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		38





FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hopkins\SH 19 AT FM 1536.dgn  
 DATE: 4/18/2024 9:42:13 AM

**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ▭ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- ROW


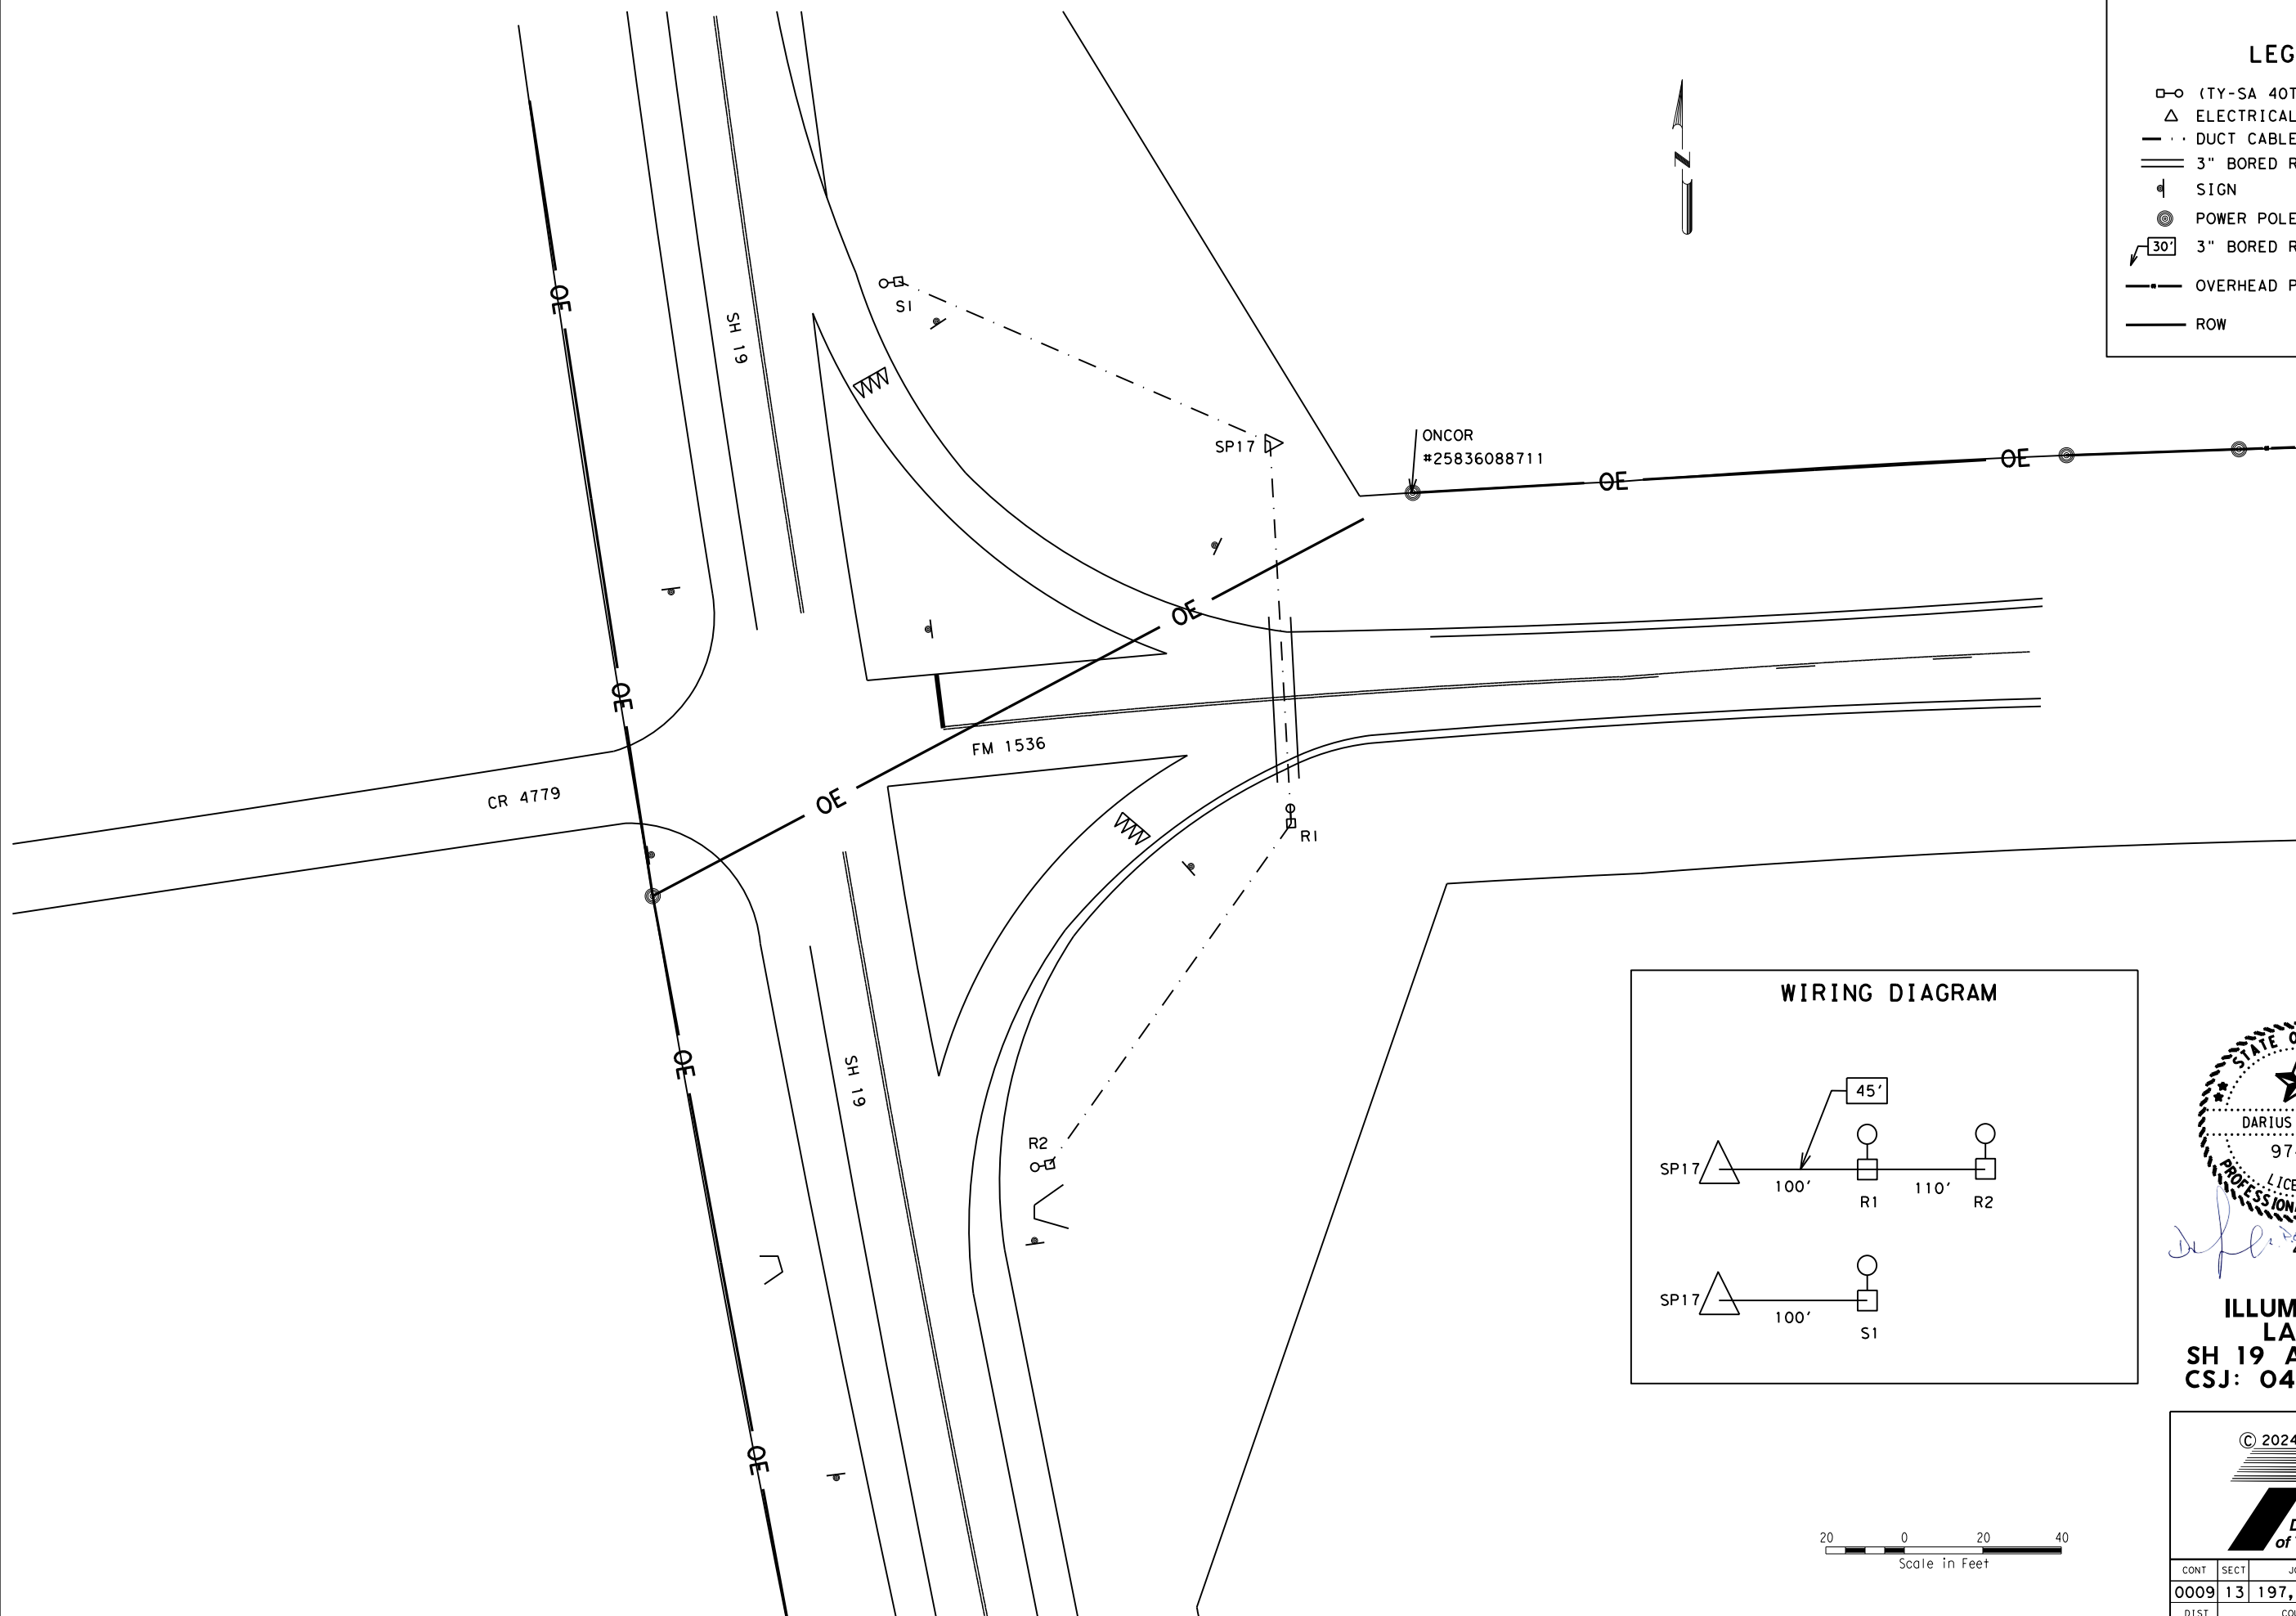


**WIRING DIAGRAM**

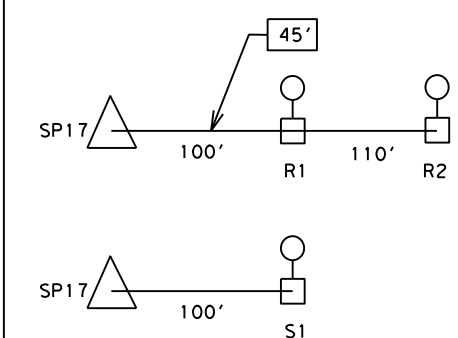

*D. Samuels* 4/19/2024

**ILLUMINATION LAYOUT**  
**SH 19 AT FM 1536**  
**CSJ: 0400-02-059**

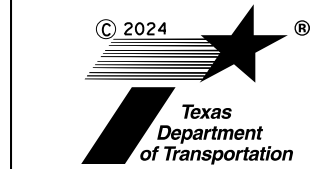

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		39

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hopkins\SH 19 AT FM 1536.dgn  
 DATE: 4/18/2024 9:42:15 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP17	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	R S	2P/15 2P/15	1.42 0.71	0.3 0.2


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
R1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	39
R2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	39
S1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	39


\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	24	LF
432	6001	RIPRAP (CONC) (4 IN)	1.05	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	3	EA
618	6075	CONDT (RM) (3") (BORE)	45	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	310	LF
6185	6002	TMA (STATIONARY)	7	DAY

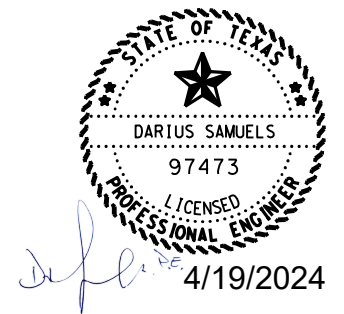


**QUANTITY SUMMARY**  
 SH 19 AT FM 1536  
 CSJ: 0400-02-059

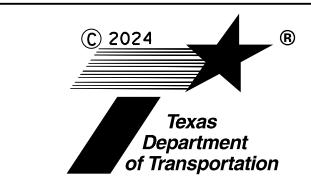


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		40

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hopkins\FM 1567 AT FM 2297.dgn  
 DATE: 4/18/2024 9:42:18 AM

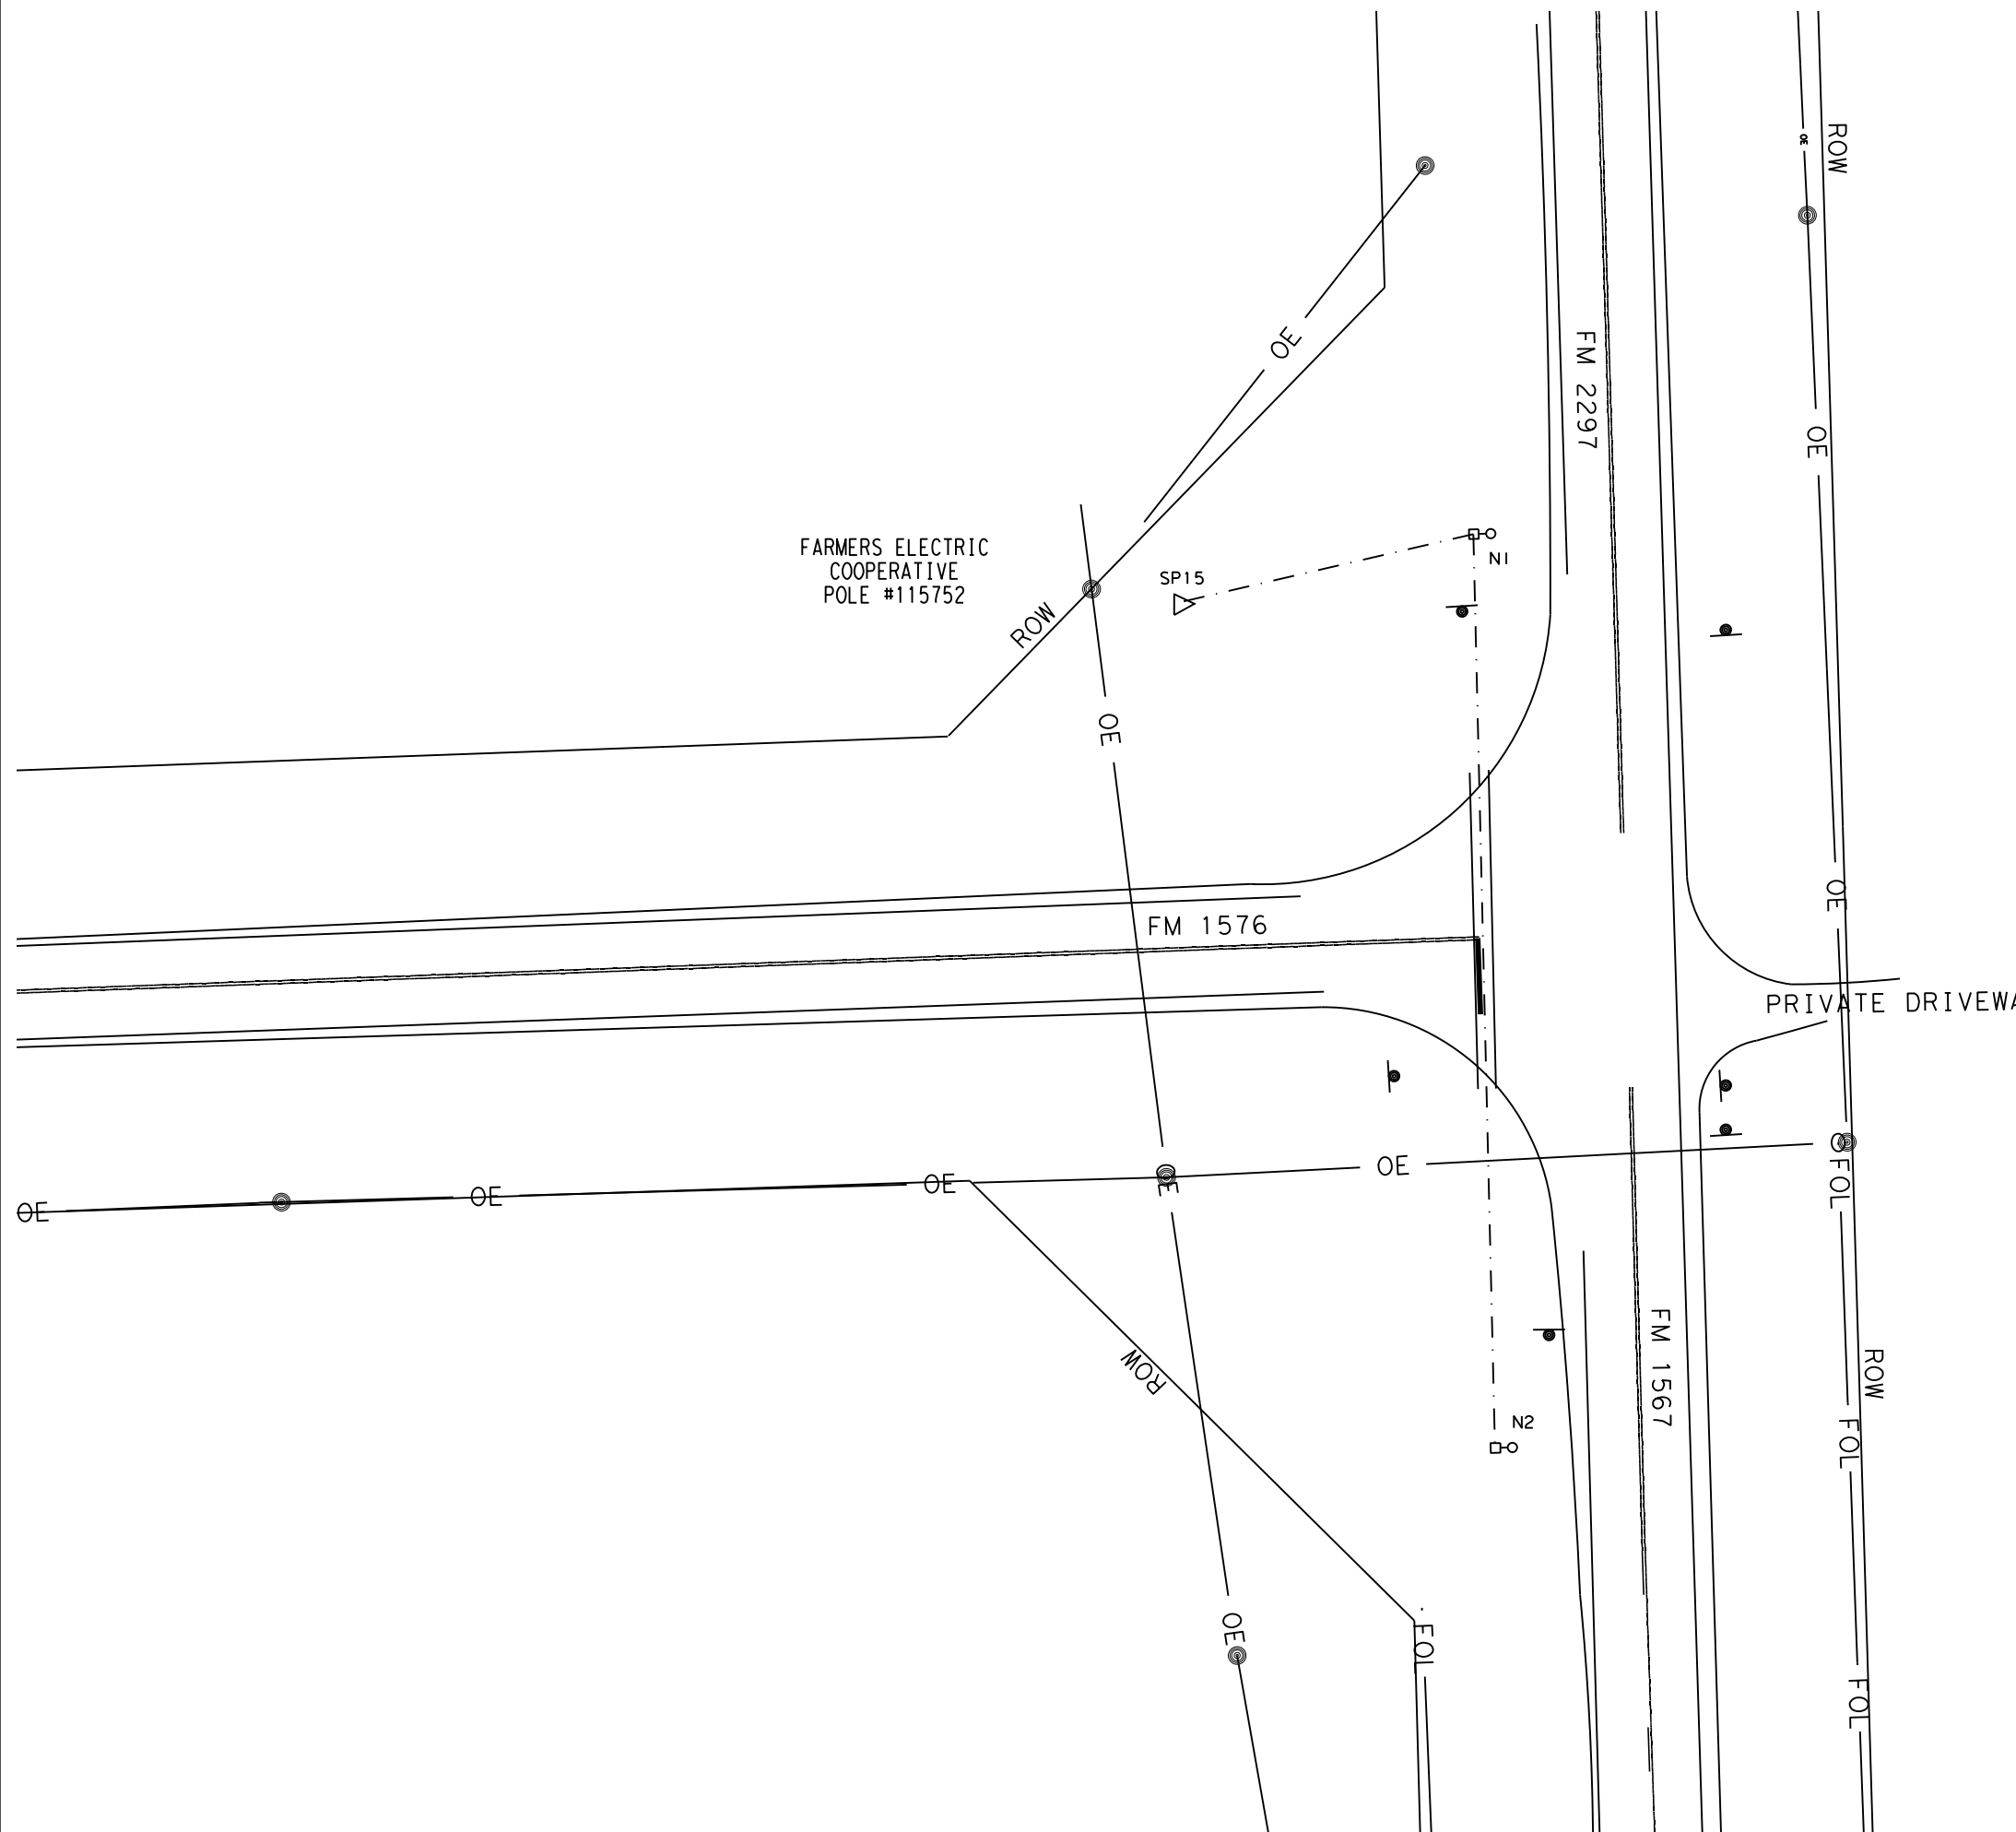

FARMERS ELECTRIC  
 COOPERATIVE  
 POLE #115752

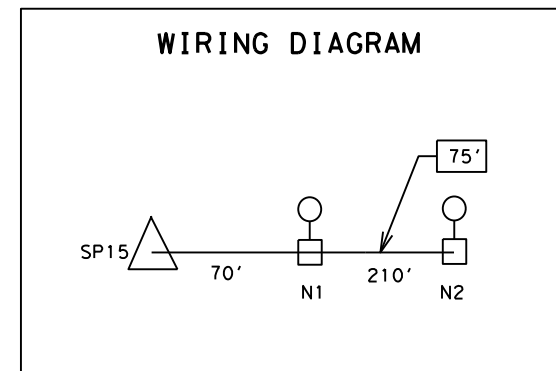



**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ▭ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- FIBER



STATE OF TEXAS  
 ★  
 DARIUS SAMUELS  
 97473  
 LICENSED PROFESSIONAL ENGINEER  
*Darius Samuels* 4/19/2024

**ILLUMINATION LAYOUT**  
**FM 1567 AT FM 2297**  
**CSJ: 0641-04-021**

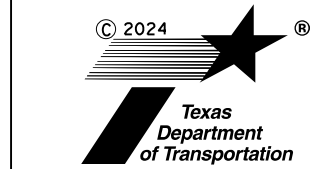

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		41

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hopkins\FM 1567 AT FM 2297.dgn  
 DATE: 4/18/2024 9:42:21 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP15	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	N	2P/15	1.42	0.3


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
N1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	41
N2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	41

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	16	LF
432	6001	RIPRAP (CONC) (4 IN)	0.70	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	2	EA
618	6075	CONDT (RM) (3") (BORE)	75	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	280	LF
6185	6002	TMA (STATIONARY)	7	DAY

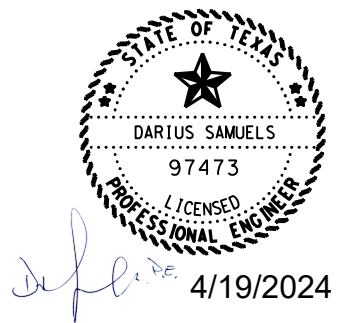


**QUANTITY SUMMARY**  
 FM 1567 AT FM 2297  
 CSJ: 0641-04-021

© 2024 <sup>®</sup>

Texas Department of Transportation


CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		<b>42</b>

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hopkins\SH 154 AT CR 2174.dgn  
 DATE: 4/18/2024 9:42:24 AM

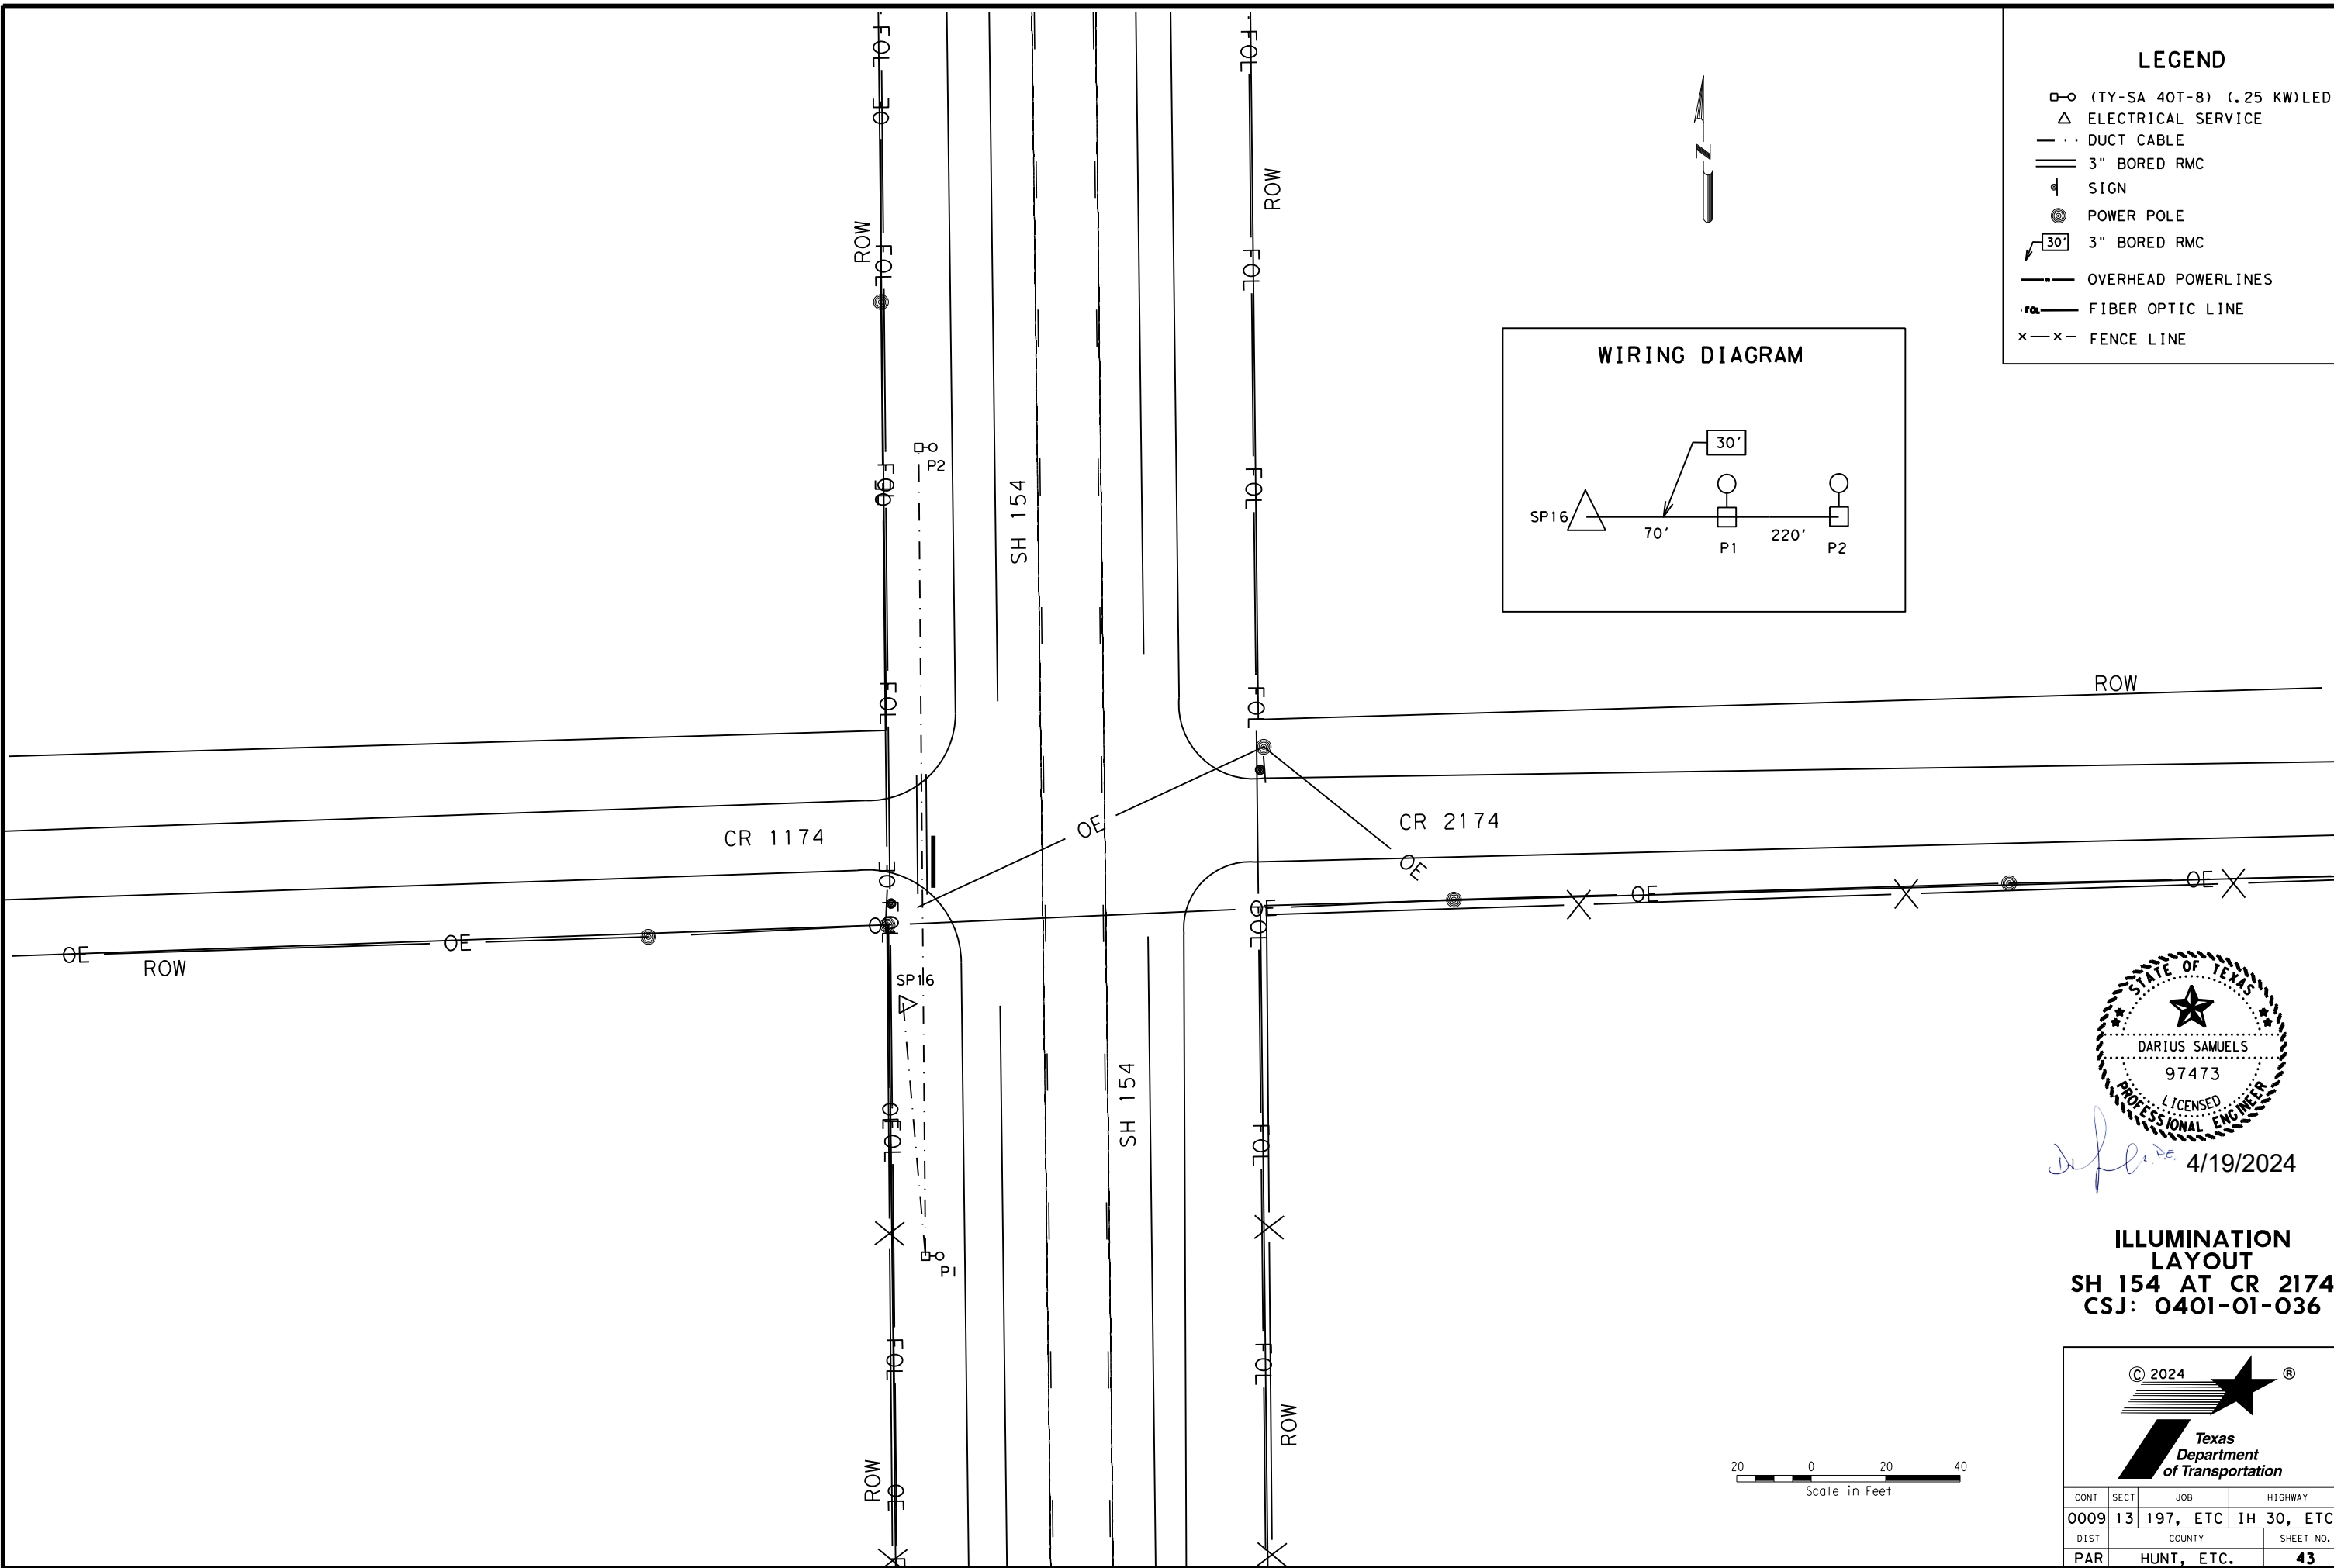


**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- · - · DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- ⊙ POWER POLE
- ⌈ 30' ⌋ 3" BORED RMC
- OVERHEAD POWERLINES
- FIBER OPTIC LINE
- x-x FENCE LINE

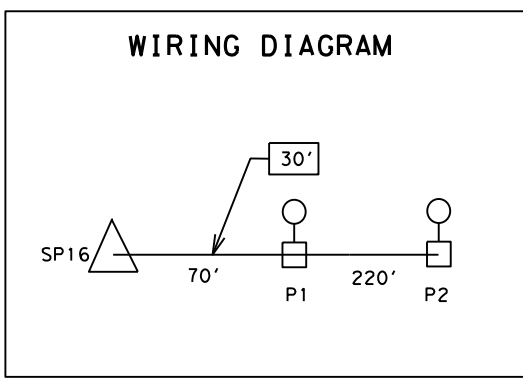

STATE OF TEXAS  
 DARIUS SAMUELS  
 97473  
 LICENSED PROFESSIONAL ENGINEER  
*Darius Samuels* 4/19/2024

**ILLUMINATION LAYOUT**  
 SH 154 AT CR 2174  
 CSJ: 0401-01-036



© 2024  
 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC IH 30, ETC.	
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		43

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\Hopkins\SH 154 AT CR 2174.dgn  
 DATE: 4/18/2024 9:42:27 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP16	ELC SRV TY A (120/240) 060 (NS) SS (E) SP (O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	P	2P/15	1.42	0.3


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
P1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	43
P2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	43

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	16	LF
432	6001	RIPRAP (CONC) (4 IN)	0.70	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	2	EA
618	6075	CONDT (RM) (3") (BORE)	30	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	290	LF
6185	6002	TMA (STATIONARY)	7	DAY




*Darius Samuels*  
 4/19/2024

**QUANTITY SUMMARY**  
 SH 154 AT CR 2174  
 CSJ: 0401-01-036

© 2024 <sup>®</sup>  
 Texas Department of Transportation



CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		44

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let#8-24\DESIGN PLANS\SH 276 AT FM 2737.dgn  
 DATE: 4/18/2024 9:42:30 AM

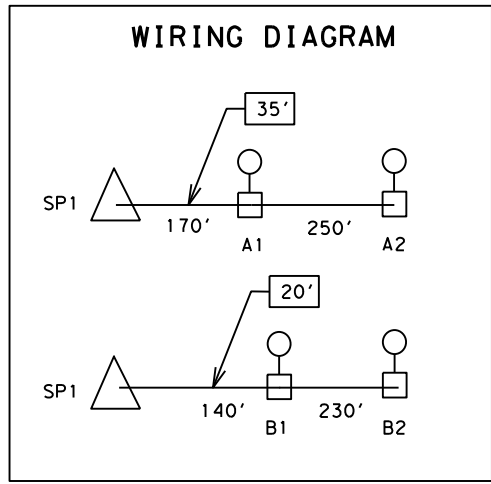


**LEGEND**

- (TY-SA 40T-8) (.25 KW)LED
- △ ELECTRICAL SERVICE
- - - DUCT CABLE
- ==== 3" BORED RMC
- ⊥ SIGN
- POWER POLE
- ⊥ 30' 3" BORED RMC
- OVERHEAD POWERLINES
- x-x FENCE LINE
- FIBER OPTIC LINE

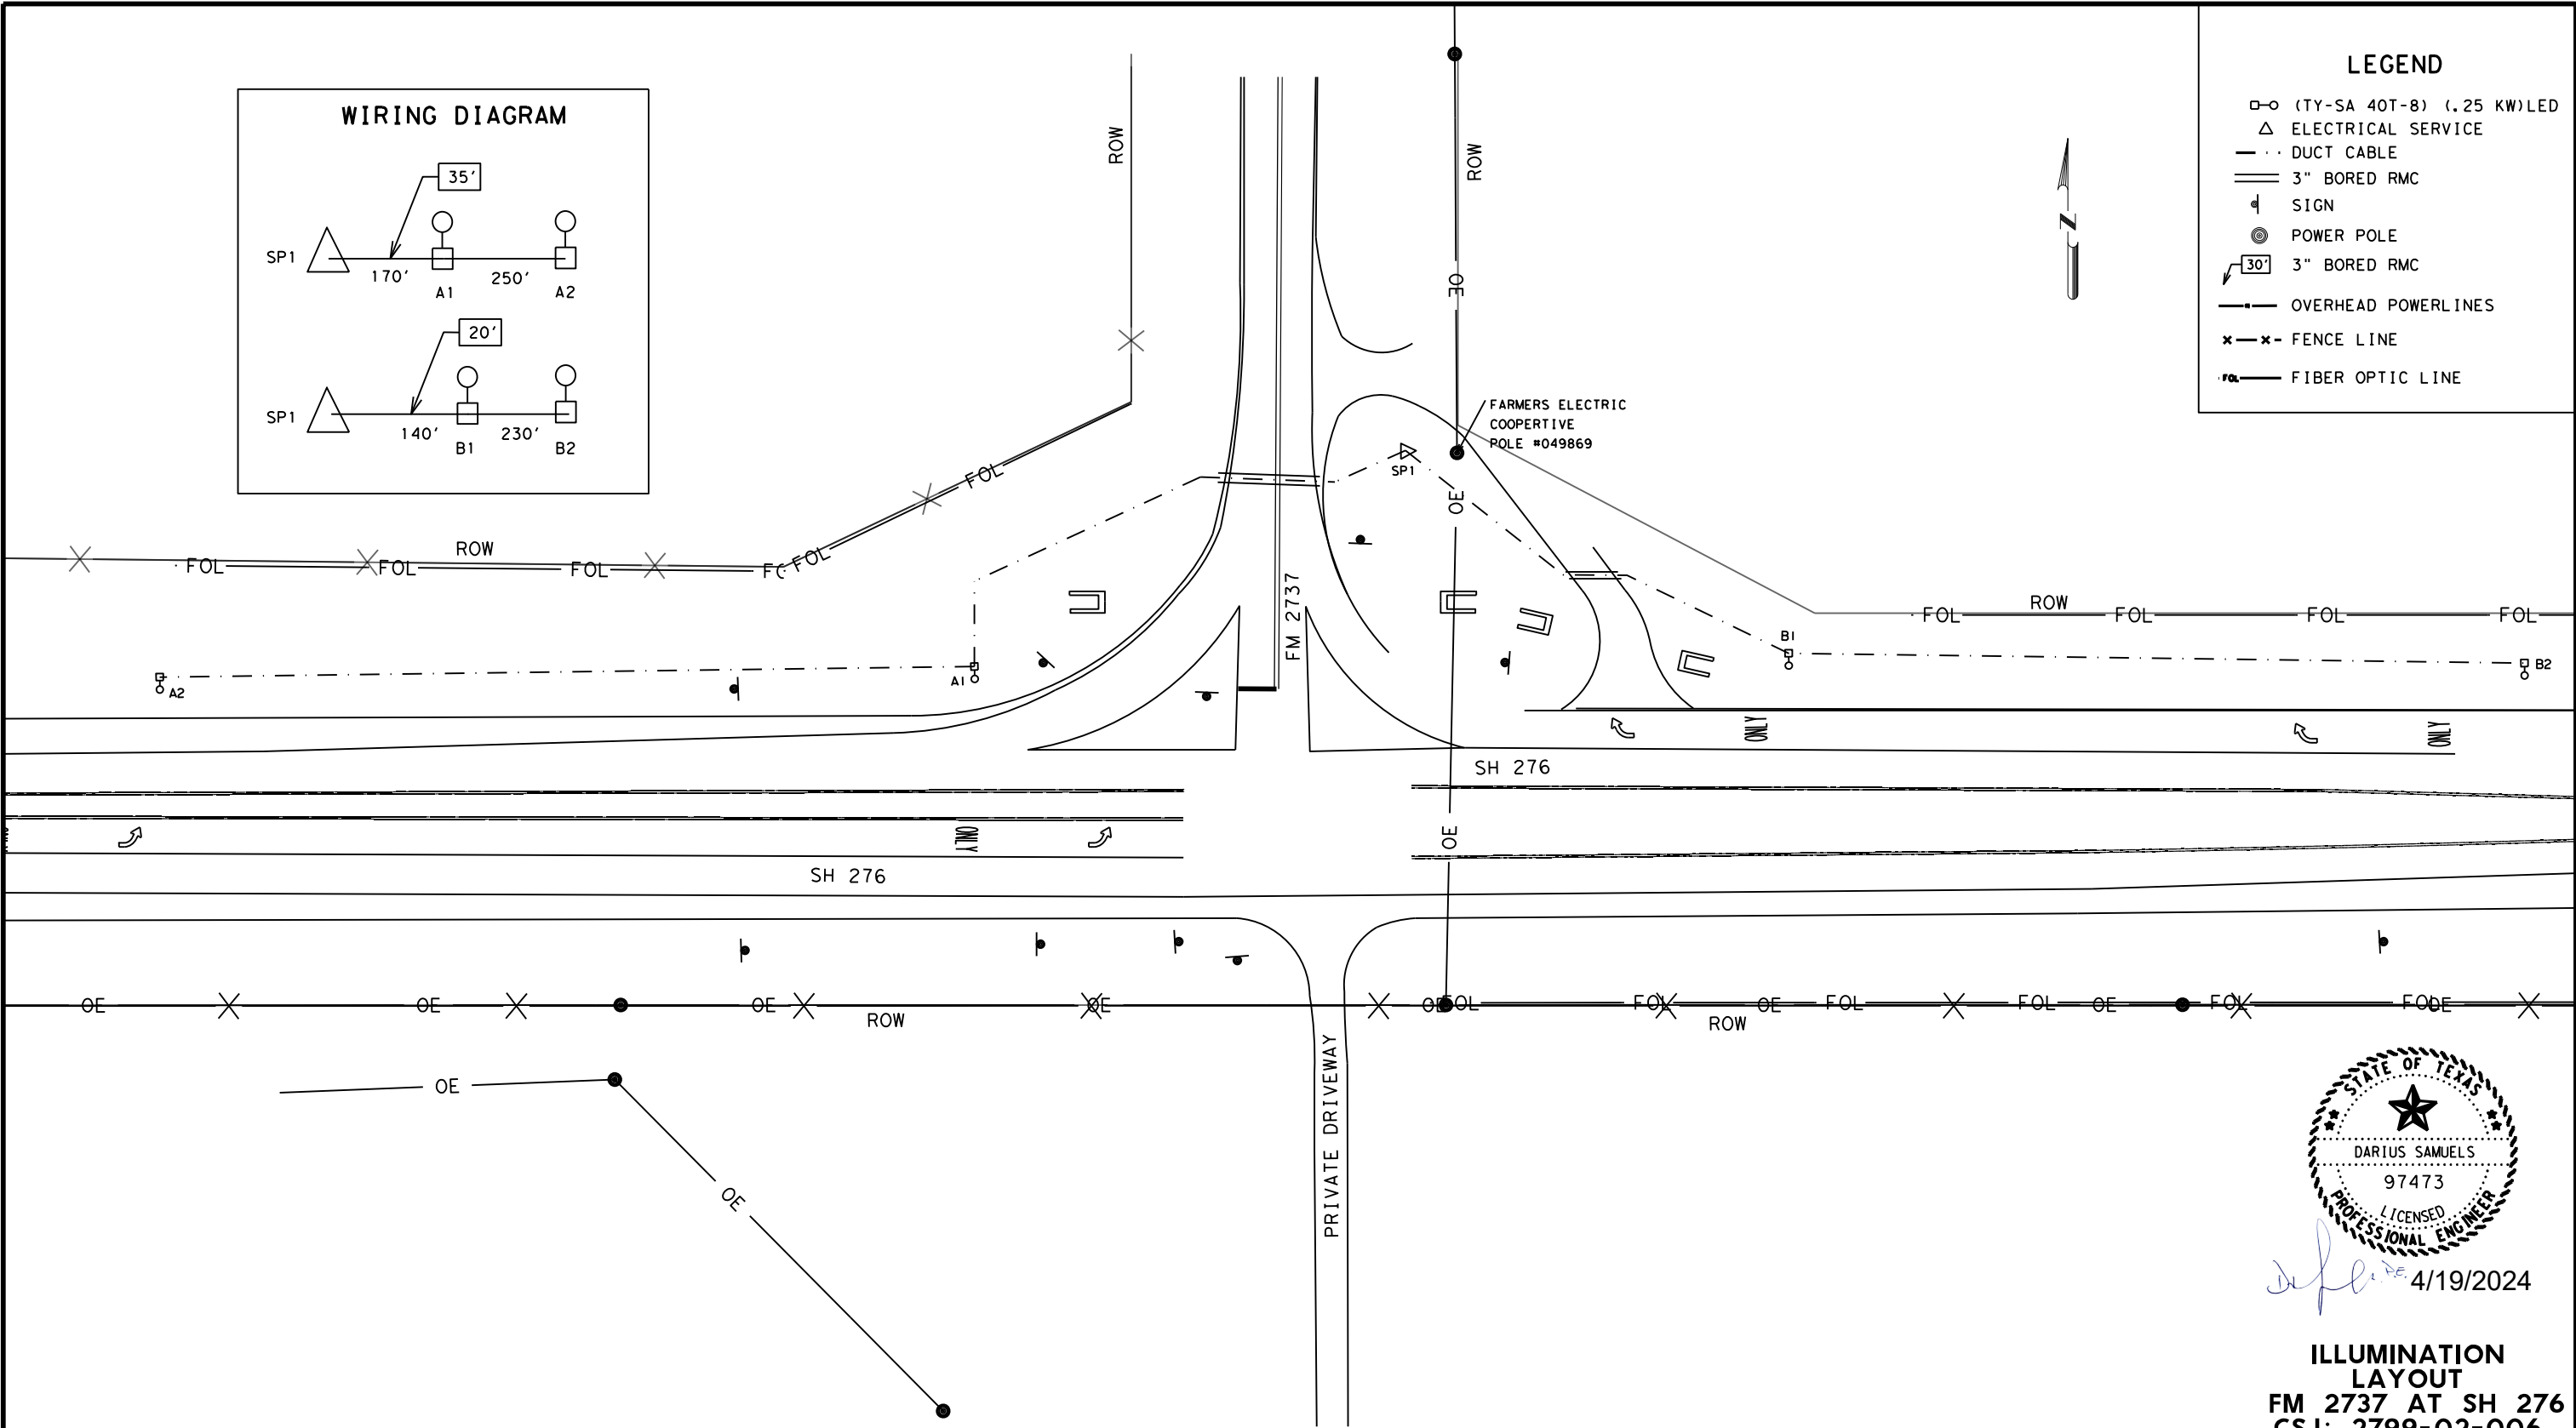

*ds* 4/19/2024

**ILLUMINATION LAYOUT**  
**FM 2737 AT SH 276**  
**CSJ: 2799-02-006**



© 2024 Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		45

FILE: T:\PARTIAL\ASHLEY\PROJECTS\Safety Lighting let\*8-24\DESIGN PLANS\Roins\SH 276 AT FM 2737.dgn  
 DATE: 4/18/2024 9:42:33 AM

### ELECTRICAL SERVICES DATA SHEET

ELEC. SERVICE NO.	ELECTRICAL SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BKR. AMPS	TWO-POLE CONTACTOR POLE/AMP	PANELBD/LOADCENTER AMP RATING	CIRCUIT NO.	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
SP1	ELC SRV TY A (120/240)060(NS)SS(E)SP(O) 628 6009 (1 EA)	1 1/4"	3/#6	N/A	2P/60	60	N/A	A B	2P/15	1.42 1.42	0.7


### LUMINAIRE LAYOUT SUMMARY

POLE NO.	ASSEMBLY	FOUNDATION LENGTH	OFFSET	SHEET NUMBER
A1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	45
A2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	45
B1	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	45
B2	RD IL AM (TY SA) 40T - 8 (.25 KW) LED	8'	*	45

\*INSTALL ROADWAY ILLUMINATION POLES OFFSET 15' FROM THE TRAVEL LANE BEING ILLUMINATED.

### MISCELLANEOUS QUANTITY SUMMARY

ITEM NO.	DESC CODE	DESCRIPTION	QUANTITY	UNITS
416	6029	DRILL SHAFT (RDWY ILL POLE) (30 IN)	32	LF
432	6001	RIPRAP (CONC) (4 IN)	1.4	CY
506	6038	TEMP SEDMT CONT FENCE (INSTALL)	50	LF
506	6039	TEMP SEDMT CONT FENCE (REMOVE)	50	LF
610	6214	IN RD IL (TY SA) 40T - 8 (250W EQ) LED	4	EA
618	6075	CONDT (RM) (3") (BORE)	55	LF
622	6002	DUCT CBL (3 NO. 8) (2 INSULATED 1 BARE)	790	LF
6185	6002	TMA (STATIONARY)	7	DAY



*D. Samuels* 4/19/2024

**QUANTITY SUMMARY**  
 FM 2737 AT SH 276  
 CSJ: 2799-02-006

© 2024 <sup>®</sup>

Texas Department of Transportation

CONT	SECT	JOB	HIGHWAY
0009	13	197, ETC	IH 30, ETC.
DIST	COUNTY		SHEET NO.
PAR	HUNT, ETC.		46



DATE: 5/21/2024 9:43:07 AM  
 FILE: t:\part\raf\ashley\projects\safety\lighting\let\_8-24\STANDARDS\bc-21.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:**

1. The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
2. The development and design of the Traffic Control Plan (TCP) is the responsibility of the Engineer.
3. The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
4. The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
5. Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.
6. When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
7. The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
9. The temporary traffic control devices shown in the illustrations of the BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.
10. Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
11. Traffic control devices should be in place only while work is actually in progress or a definite need exists.
12. The Engineer has the final decision on the location of all traffic control devices.
13. Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

**WORKER SAFETY NOTES:**

1. Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
2. Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.

**COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES**

1. Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources.
2. Work zone traffic control devices shall be compliant with the Manual for Assessing safety Hardware (MASH).

<b>THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT</b> <a href="http://www.txdot.gov">http://www.txdot.gov</a>
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS

SHEET 1 OF 12




**BARRICADE AND CONSTRUCTION  
GENERAL NOTES  
AND REQUIREMENTS**

**BC (1) - 21**

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CR:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0009	13	197, ETC		IH 30, ETC.			
4-03	7-13	DIST	COUNTY		SHEET NO.				
9-07	8-14	PAR	HUNT, ETC.		47				
5-10	5-21								


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**TYPICAL LOCATION OF CROSSROAD SIGNS**

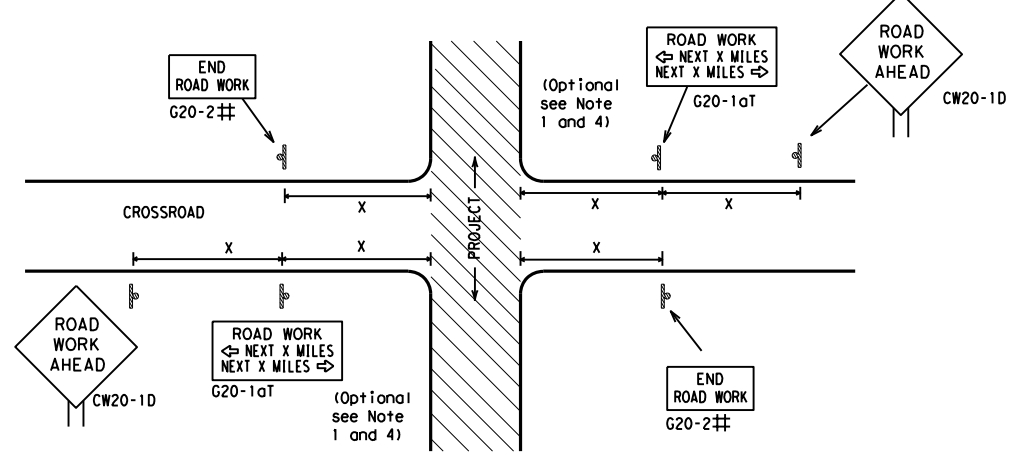

- ## May be mounted on back of "ROAD WORK AHEAD" (CW20-1D) sign with approval of Engineer. (See note 2 below)
- The typical minimum signing on a crossroad approach should be a "ROAD WORK AHEAD" (CW20-1D) sign and a (G20-2) "END ROAD WORK" sign, unless noted otherwise in plans.
  - The Engineer may use the reduced size 36" x 36" ROAD WORK AHEAD (CW20-1D) sign mounted back to back with the reduced size 36" x 18" "END ROAD WORK" (G20-2) sign on low volume crossroads (see Note 4 under "Typical Construction Warning Sign Size and Spacing"). See the "Standard Highway Sign Designs for Texas" manual for sign details. The Engineer may omit the advance warning signs on low volume crossroads. The Engineer will determine whether a road is low volume as per TMUTCD Part 5. This information shall be shown in the plans.
  - Based on existing field conditions, the Engineer/Inspector may require additional signs such as FLAGGER AHEAD, LOOSE GRAVEL, or other appropriate signs. When additional signs are required, these signs will be considered part of the minimum requirements. The Engineer/Inspector will determine the proper location and spacing of any sign not shown on the BC sheets, Traffic Control Plan sheets or the Work Zone Standard Sheets.
  - The "ROAD WORK NEXT X MILES" (G20-1aT) sign shall be required at high volume crossroads to advise motorists of the length of construction in either direction from the intersection. The Engineer will determine whether a roadway is considered high volume.
  - Additional traffic control devices may be shown elsewhere in the plans for higher volume crossroads.
  - When work occurs in the intersection area, appropriate traffic control devices, as shown elsewhere in the plans or as determined by the Engineer/Inspector, shall be in place.

**T-INTERSECTION**

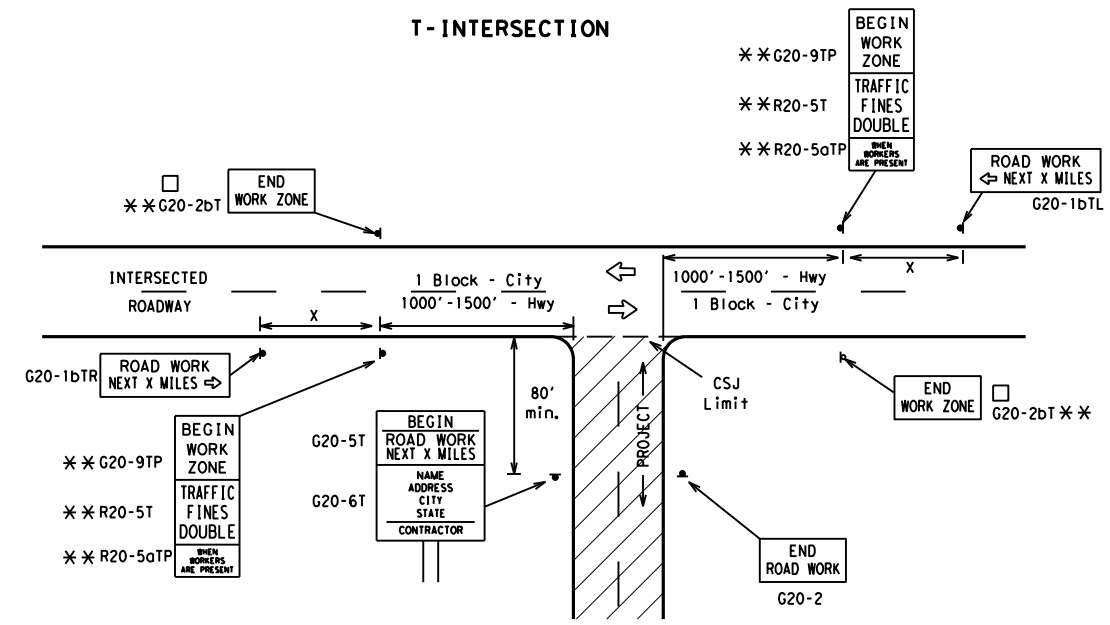

**CSJ LIMITS AT T-INTERSECTION**

- The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
- If construction closes the road at a T-intersection, the Contractor shall place the "CONTRACTOR NAME" (G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(10) also). The "ROAD WORK NEXT X MILES" left arrow (G20-1bTL) and "ROAD WORK NEXT X MILES" right arrow (G20-1bTR) signs shall be replaced by the detour signing called for in the plans.

**TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING<sup>1,5,6</sup>**

Sign Number or Series	SIZE		SPACING	
	Conventional Road	Expressway/Freeway	Posted Speed MPH	Sign Δ Spacing "x" Feet (Apprx.)
CW20 <sup>4</sup>	48" x 48"	48" x 48"	30	120
CW21			35	160
CW22			40	240
CW23			45	320
CW25			50	400
CW1, CW2, CW7, CW8, CW9, CW11, CW14	36" x 36"	48" x 48"	55	500 <sup>2</sup>
CW3, CW4, CW5, CW6, CW8-3, CW10, CW12	48" x 48"	48" x 48"	60	600 <sup>2</sup>
			65	700 <sup>2</sup>
			70	800 <sup>2</sup>
			75	900 <sup>2</sup>
			80	1000 <sup>2</sup>
			*	* <sup>3</sup>


\* For typical sign spacings on divided highways, expressways and freeways, see Part 6 of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) typical application diagrams or TCP Standard Sheets.

Δ Minimum distance from work area to first Advance Warning sign nearest the work area and/or distance between each additional sign.

**GENERAL NOTES**


- Special or larger size signs may be used as necessary.
- Distance between signs should be increased as required to have 1500 feet advance warning.
- Distance between signs should be increased as required to have 1/2 mile or more advance warning.
- 36" x 36" "ROAD WORK AHEAD" (CW20-1D) signs may be used on low volume crossroads at the discretion of the Engineer as per TMUTCD Part 5. See Note 2 under "Typical Location of Crossroad Signs".
- Only diamond shaped warning sign sizes are indicated.
- See sign size listing in "TMUTCD", Sign Appendix or the "Standard Highway Sign Designs for Texas" manual for complete list of available sign design sizes.

**WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS**

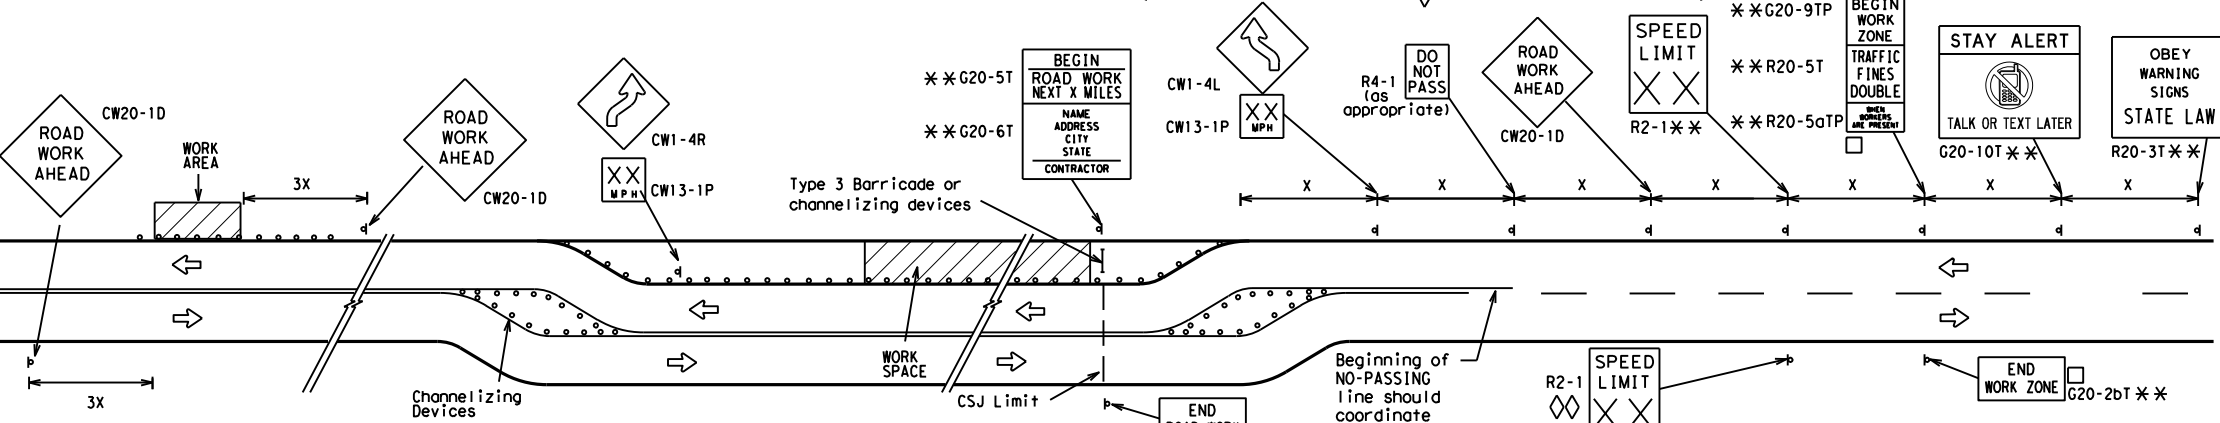


When extended distances occur between minimal work spaces, the Engineer/Inspector should ensure additional "ROAD WORK AHEAD" (CW20-1D) signs are placed in advance of these work areas to remind drivers they are still within the project limits. See the applicable TCP sheets for exact location and spacing of signs and channelizing devices.

**SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS**

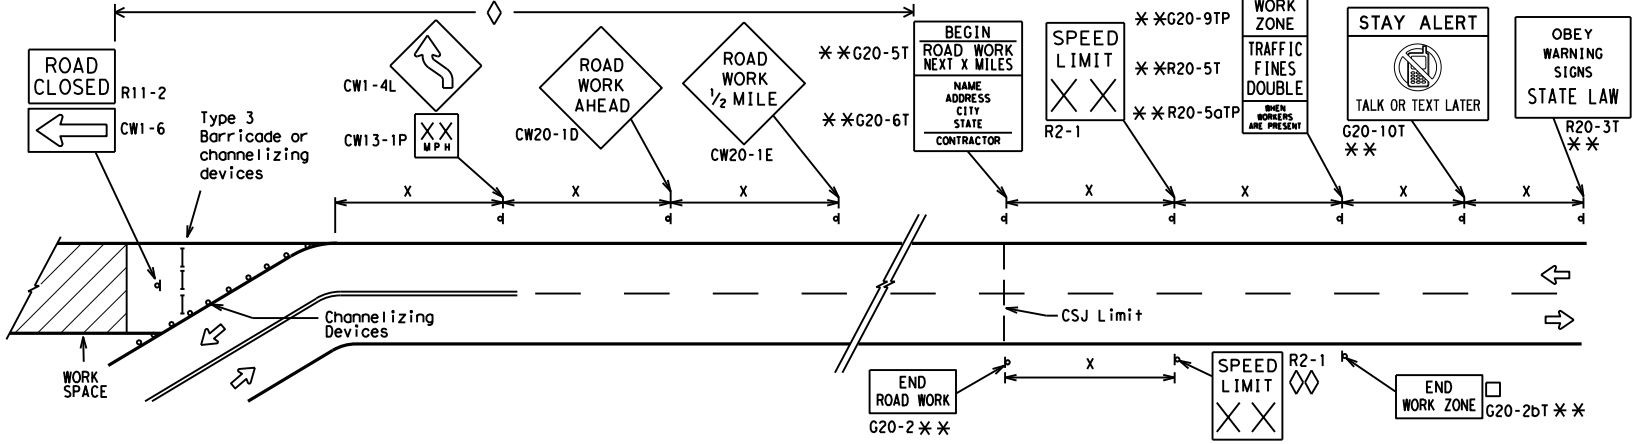

**SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING AT THE CSJ LIMITS**

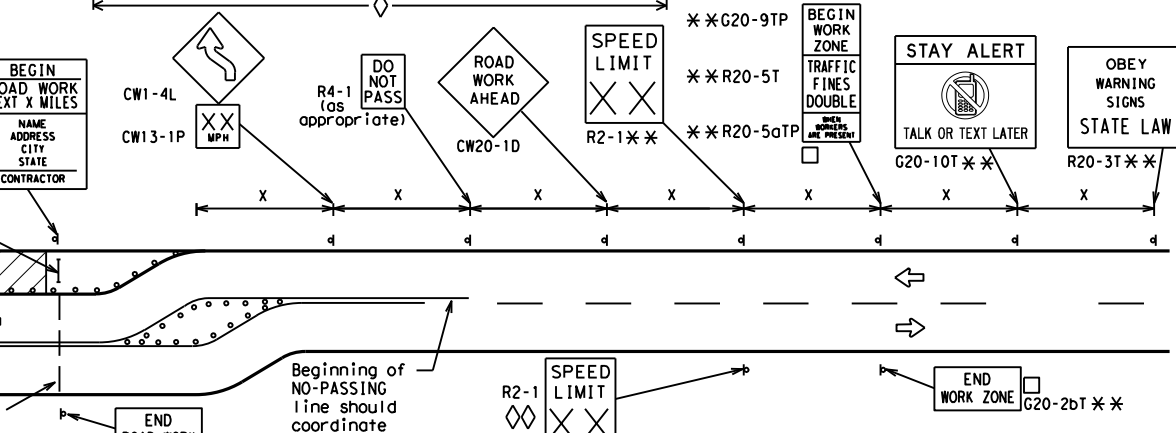

**NOTES**

- The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and "BEGIN ROAD WORK NEXT X MILES" (G20-5T) sign for each specific project. This distance shall replace the "x" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- The "BEGIN WORK ZONE" (G20-9TP) and "END WORK ZONE" (G20-2bT) shall be used as shown on the sample layout when advance signs are required outside the CSJ Limits. They inform the motorist of entering or leaving a part of the work zone lying outside the CSJ Limits where traffic fines may double if workers are present.
  - CSJ limit signing is required for highway construction and maintenance work, with the exception of mobile operations.
  - Area for placement of "ROAD WORK AHEAD" (CW20-1D) sign and other signs or devices as called for on the Traffic Control Plan.
  - Contractor will install a regulatory speed limit sign at the end of the work zone.

**LEGEND**

—	Type 3 Barricade
○ ○ ○	Channelizing Devices
■	Sign
X	See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.

SHEET 2 OF 12



**BARRICADE AND CONSTRUCTION PROJECT LIMIT**

**BC (2) - 21**

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	PAR	HUNT, ETC.	48	

# TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within Incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project. Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.



## GUIDANCE FOR USE:

### LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including:

- rough road or damaged pavement surface
- substantial alteration of roadway geometrics (diversions)
- construction detours
- grade
- width
- other conditions readily apparent to the driver

As long as any of these conditions exist, the work zone speed limit signs should remain in place.

### SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the traveled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered. (See Removing or Covering on BC(4)).

## GENERAL NOTES

- Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
- Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
- Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
- Frequency of work zone speed limit signs should be:
 

40 mph and greater	0.2 to 2 miles
35 mph and less	0.2 to 1 mile
- Regulatory speed limit signs shall have black legend and border on a white reflective background (See "Reflective Sheeting" on BC(4)).
- Fabrication, erection and maintenance of the "ADVANCE SPEED LIMIT" (CW3-5) sign, "WORK ZONE" (G20-5aP) plaque and the "SPEED LIMIT" (R2-1) signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
- Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
- Techniques that may help reduce traffic speeds include but are not limited to:
  - Law enforcement.
  - Flagger stationed next to sign.
  - Portable changeable message sign (PCMS).
  - Low-power (drone) radar transmitter.
  - Speed monitor trailers or signs.
- Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
- For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form #1204 in the TxDOT e-form system.


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.  
 DATE: 5/21/2024 9:43:10 AM  
 FILE: t:\parr\ashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn

SHEET 3 OF 12

		Traffic Safety Division Standard	
<h2>BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT</h2>			
<h3>BC (3) - 21</h3>			
FILE:	bc-21.dgn	DW:	TxDOT
© TxDOT	November 2002	CONT	SECT
REVISIONS		JOB	HIGHWAY
9-07	8-14	0009 13	197, ETC IH 30, ETC.
7-13	5-21	DIST	COUNTY
PAR	HUNT, ETC.	SHEET NO. 49	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


**TYPICAL MINIMUM CLEARANCES FOR LONG TERM AND INTERMEDIATE TERM SIGNS**

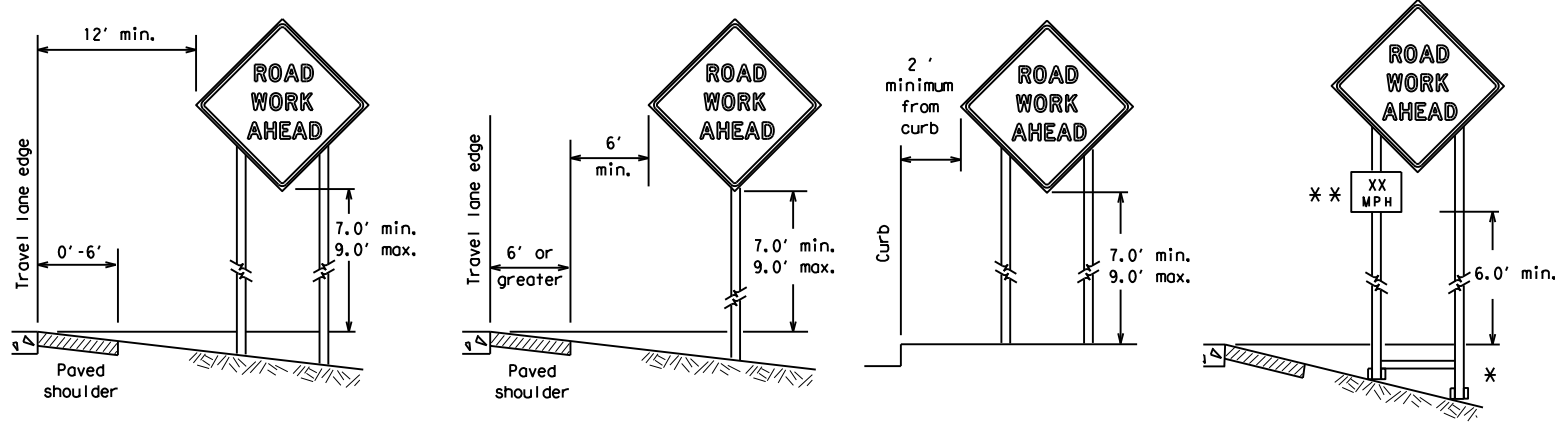

\* When placing skid supports on unlevel ground, the leg post lengths must be adjusted so the sign appears straight and plumb. Objects shall NOT be placed under skids as a means of leveling.

\*\* When plaques are placed on dual-leg supports, they should be attached to the upright nearest the travel lane. Supplemental plaques (advisory or distance) should not cover the surface of the parent sign.

**ATTACHMENT FOR SIGN SUPPORTS**

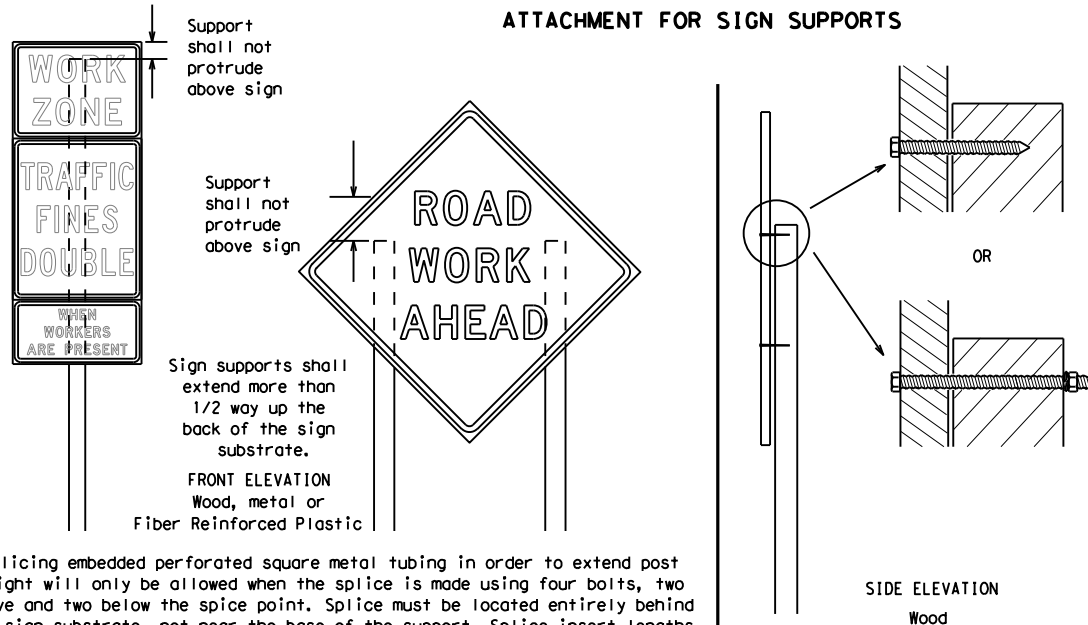


Attachment to wooden supports will be by bolts and nuts or screws. Use TxDOT's or manufacturer's recommended procedures for attaching sign substrates to other types of sign supports

**Nails shall NOT be allowed.**  
 Each sign shall be attached directly to the sign support. Multiple signs shall not be joined or spliced by any means. Wood supports shall not be extended or repaired by splicing or other means.

Splicing embedded perforated square metal tubing in order to extend post height will only be allowed when the splice is made using four bolts, two above and two below the splice point. Splice must be located entirely behind the sign substrate, not near the base of the support. Splice insert lengths should be at least 5 times nominal post size, centered on the splice and of at least the same gauge material.

**STOP/SLOW PADDLES**

1. STOP/SLOW paddles are the primary method to control traffic by flaggers. The STOP/SLOW paddle size should be 24" x 24".
2. STOP/SLOW paddles shall be retroreflectORIZED when used at night.
3. STOP/SLOW paddles may be attached to a staff with a minimum length of 6' to the bottom of the sign.
4. Any lights incorporated into the STOP or SLOW paddle faces shall only be as specifically described in Section 6E.03 Hand Signaling Devices in the TMUTCD.

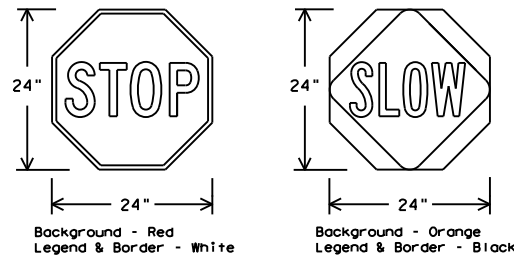

SHEETING REQUIREMENTS (WHEN USED AT NIGHT)		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	ORANGE	TYPE B <sub>FL</sub> OR C <sub>FL</sub> SHEETING
LEGEND & BORDER	WHITE	TYPE B OR C SHEETING
LEGEND & BORDER	BLACK	ACRYLIC NON-REFLECTIVE FILM

**CONTRACTOR REQUIREMENTS FOR MAINTAINING PERMANENT SIGNS WITHIN THE PROJECT LIMITS**

1. Permanent signs are used to give notice of traffic laws or regulations, call attention to conditions that are potentially hazardous to traffic operations, show route designations, destinations, directions, distances, services, points of interest, and other geographical, recreational, specific service (LOGO), or cultural information. Drivers proceeding through a work zone need the same, if not better route guidance as normally installed on a roadway without construction.
2. When permanent regulatory or warning signs conflict with work zone conditions, remove or cover the permanent signs until the permanent sign message matches the roadway condition. For details for covering large guide signs see the TS-CD standard.
3. When existing permanent signs are moved and relocated due to construction purposes, they shall be visible to motorists at all times.
4. If existing signs are to be relocated on their original supports, they shall be installed on crashworthy bases as shown on the SMD Standard sheets. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards. This work should be paid for under the appropriate pay item for relocating existing signs.
5. If permanent signs are to be removed and relocated using temporary supports, the Contractor shall use crashworthy supports as shown on the BC standard sheets, TLRs standard sheets or the CWZTCD list. The signs shall meet the required mounting heights shown on the BC, or the SMD standard sheets during construction. This work should be paid for under the appropriate pay item for relocating existing signs.
6. Any sign or traffic control device that is struck or damaged by the Contractor or his/her construction equipment shall be replaced as soon as possible by the Contractor to ensure proper guidance for the motorists. This will be subsidiary to Item 502.

**GENERAL NOTES FOR WORK ZONE SIGNS**

1. Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer.
2. Wooden sign posts shall be painted white.
3. Barricades shall NOT be used as sign supports.
4. All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and guide the traveling public safely through the work zone.
5. The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
6. The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD) for small roadside signs. Supports for temporary large roadside signs shall meet the requirements detailed on the Temporary Large Roadside Signs (TLRS) standard sheets. The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so the Engineer can verify the correct procedures are being followed.
7. The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or damaged or marred reflective sheeting as directed by the Engineer/Inspector.
8. Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1 inch.
9. The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

**DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)**

1. The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in regard to crashworthiness and duration of work requirements.
  - a. Long-term stationary - work that occupies a location more than 3 days.
  - b. Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting more than one hour.
  - c. Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period.
  - d. Short, duration - work that occupies a location up to 1 hour.
  - e. Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

**SIGN MOUNTING HEIGHT**

1. The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except as shown for supplemental plaques mounted below other signs.
2. The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above the ground.
3. Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
4. Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to appropriate Long-term/Intermediate sign height.
5. Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

**SIZE OF SIGNS**

1. The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

**SIGN SUBSTRATES**

1. The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports.
2. "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave.
3. All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6" centers. The Engineer may approve other methods of splicing the sign face.

**REFLECTIVE SHEETING**

1. All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1).
2. White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background.
3. Orange sheeting, meeting the requirements of DMS-8300 Type B<sub>FL</sub> or Type C<sub>FL</sub>, shall be used for rigid signs with orange backgrounds.

**SIGN LETTERS**

1. All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of first class workmanship in accordance with Department Standards and Specifications.

**REMOVING OR COVERING**

1. When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
2. Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any intersections where the sign may be seen from approaching traffic.
3. Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely covered when not required.
4. When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.
5. Burlap shall NOT be used to cover signs.
6. Duct tape or other adhesive material shall NOT be affixed to a sign face.
7. Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

**SIGN SUPPORT WEIGHTS**

1. Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used.
2. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
3. Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights.
4. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
5. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall NOT be used.
6. Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
7. Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
8. Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

**FLAGS ON SIGNS**

1. Flags may be used to draw attention to warning signs. When used, the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.

SHEET 4 OF 12




**BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES**

**BC (4) - 21**

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	OW:	TxDOT	CR:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0009	13	197, ETC	IH 30, ETC.				
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	PAR	HUNT, ETC.	50					



DATE: 5/21/2024 9:43:11 AM  
 FILE: t:\par\traf\ashley\projects\safety\lighting\let\_8-24\STANDARDS\bc-21.dgn

DATE: 5/21/2024 9:43:13 AM  
 FILE: t:\parr\ashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

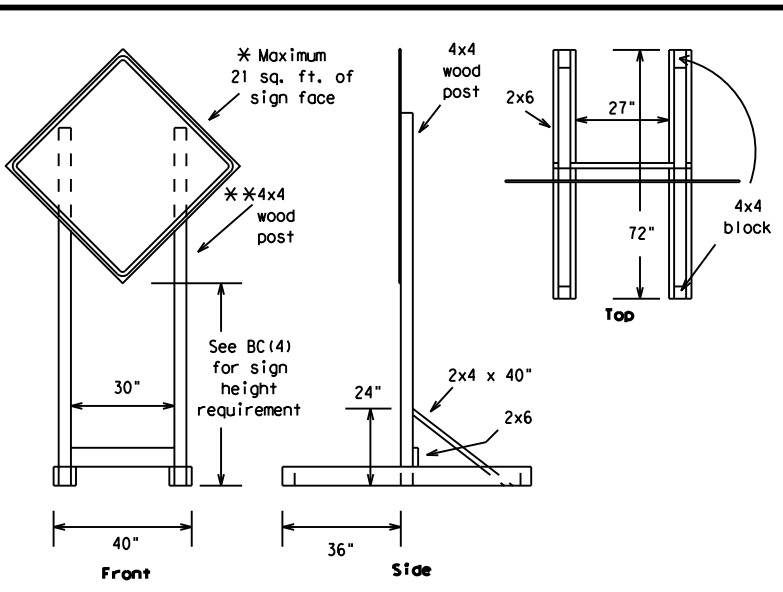


**SKID MOUNTED WOOD SIGN SUPPORTS**

\* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

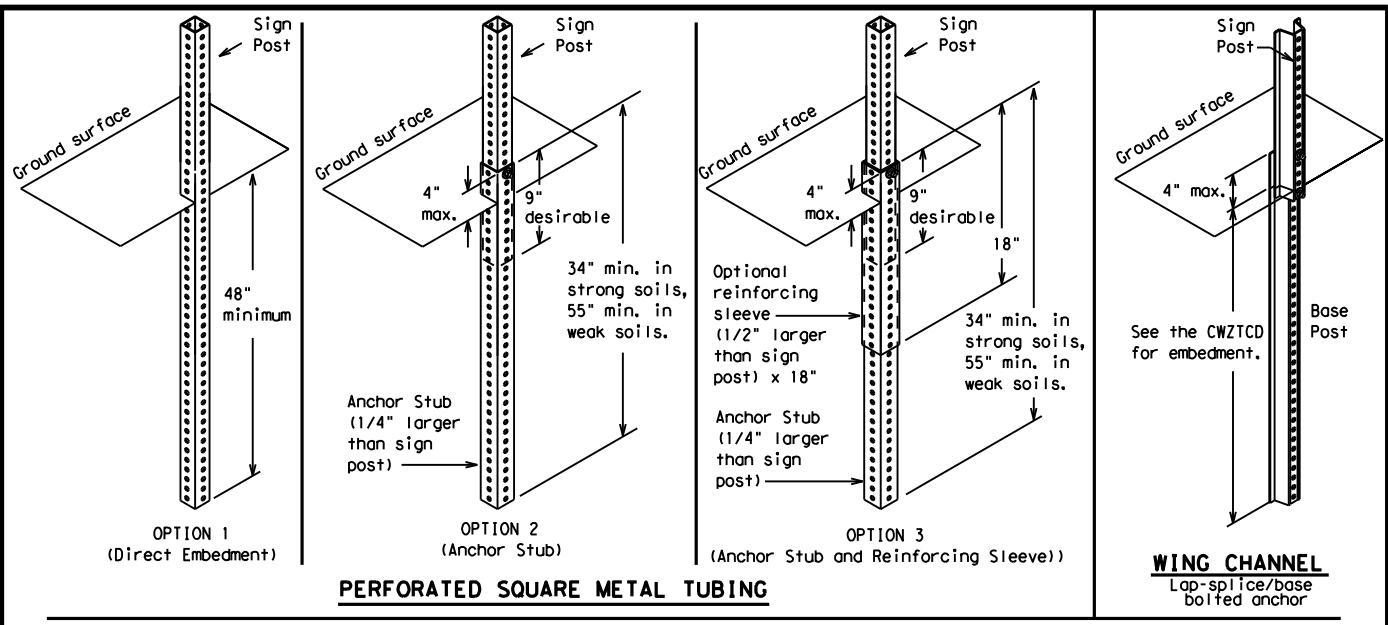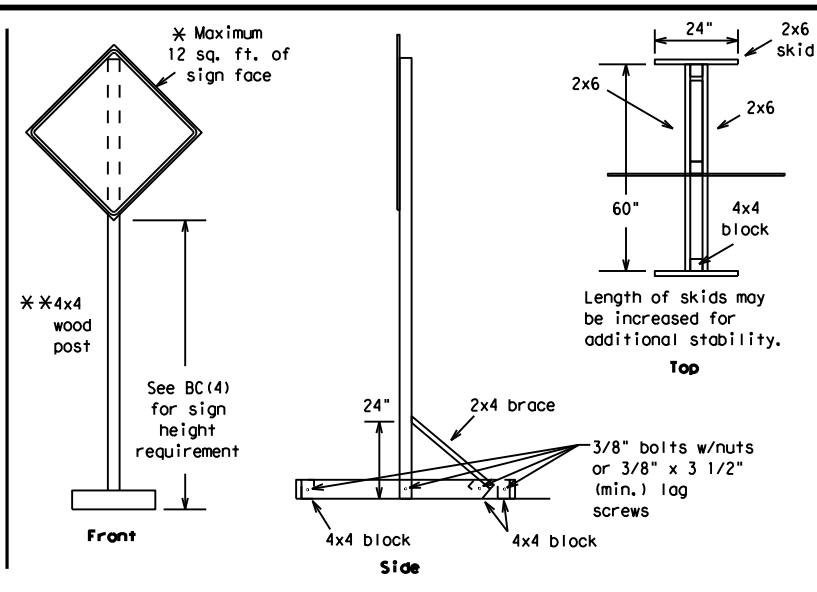



**GROUND MOUNTED SIGN SUPPORTS**

Refer to the CWZTCD and the manufacturer's installation procedure for each type sign support. The maximum sign square footage shall adhere to the manufacturer's recommendation. Two post installations can be used for larger signs.

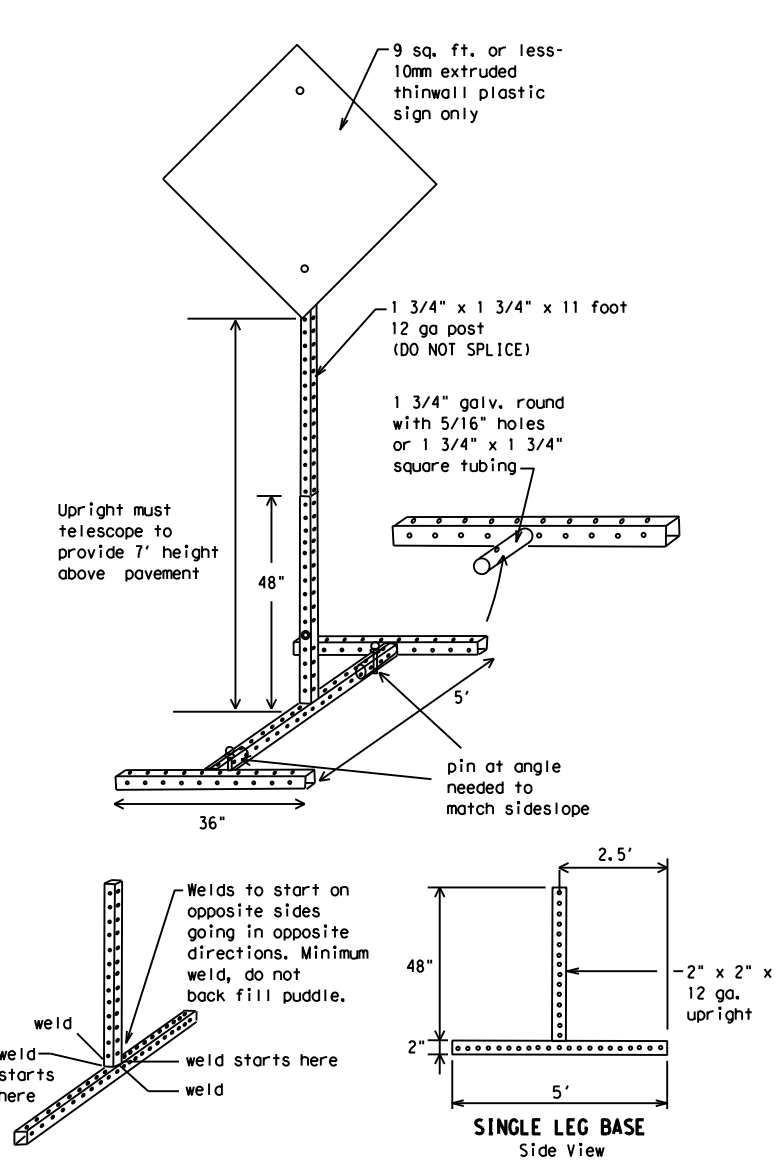

**SKID MOUNTED PERFORATED SQUARE STEEL TUBING SIGN SUPPORTS**

\* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

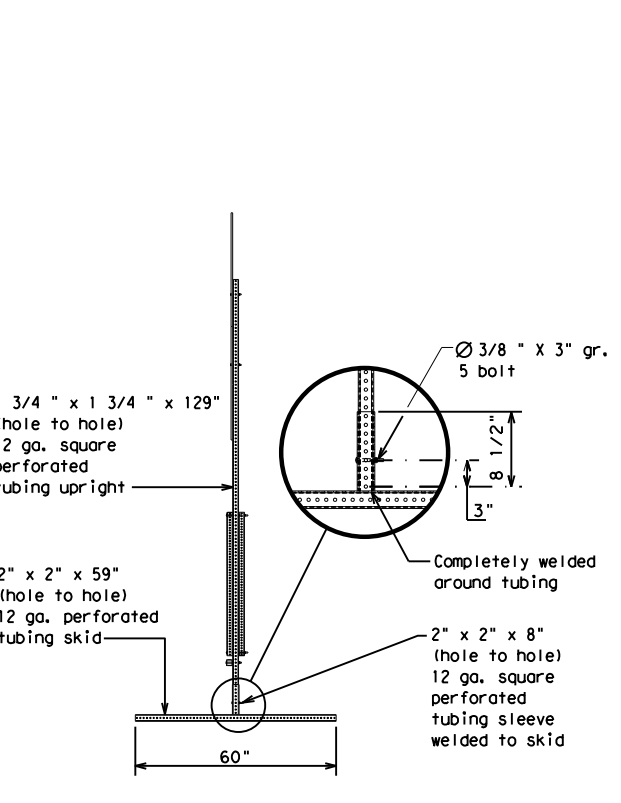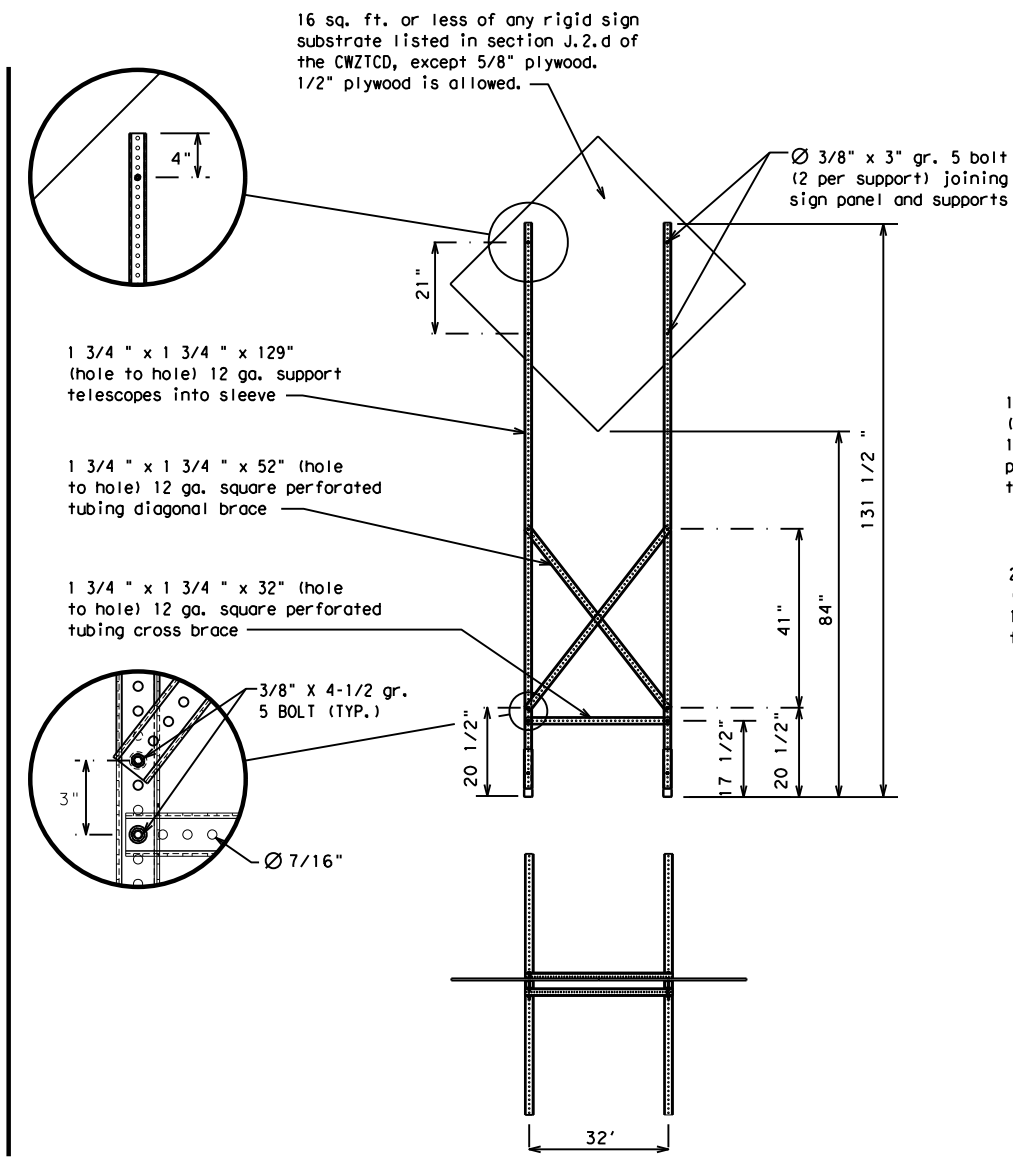

**WEDGE ANCHORS**

Both steel and plastic Wedge Anchor Systems as shown on the SMD Standard Sheets may be used as temporary sign supports for signs up to 10 square feet of sign face. They may be set in concrete or in sturdy soils if approved by the Engineer. (See web address for "Traffic Engineering Standard Sheets" on BC(1)).

**OTHER DESIGNS**

MORE DETAILS OF APPROVED LONG/INTERMEDIATE AND SHORT TERM SUPPORTS CAN BE FOUND ON THE CWZTCD LIST. SEE BC(1) FOR WEBSITE LOCATION.

**GENERAL NOTES**

- Nails may be used in the assembly of wooden sign supports, but 3/8" bolts with nuts or 3/8" x 3 1/2" lag screws must be used on every joint for final connection.
  - No more than 2 sign posts shall be placed within a 7 ft. circle, except for specific materials noted on the CWZTCD List.
  - When project is completed, all sign supports and foundations shall be removed from the project site. This will be considered subsidiary to Item 502.
- \* See BC(4) for definition of "Work Duration."
  - \*\* Wood sign posts MUST be one piece. Splicing will NOT be allowed. Posts shall be painted white.
  - ☐ See the CWZTCD for the type of sign substrate that can be used for each approved sign support.

SHEET 5 OF 12



**BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT**

**BC(5) - 21**

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CR:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS	0009 13	197, ETC IH 30, ETC.							
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	PAR	HUNT, ETC.	51					

WHEN NOT IN USE, REMOVE THE PCMS FROM THE RIGHT-OF-WAY OR PLACE THE PCMS BEHIND BARRIER OR GUARDRAIL WITH SIGN PANEL TURNED PARALLEL TO TRAFFIC

# RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES

(The Engineer may approve other messages not specifically covered here.)

## PORTABLE CHANGEABLE MESSAGE SIGNS

- The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
- Messages on PCMS should contain no more than 8 words (about four to eight characters per word), not including simple words such as "TO," "FOR," "AT," etc.
- Messages should consist of a single phase, or two phases that alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
- Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
- Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
- When in use, the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
- The message term "WEEKEND" should be used only if the work is to start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
- The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
- Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
- Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
- Do not use the word "Danger" in message.
- Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
- Do not display messages that scroll horizontally or vertically across the face of the sign.
- The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
- PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
- Each line of text should be centered on the message board rather than left or right justified.
- If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

## Phase 1: Condition Lists

### Road/Lane/Ramp Closure List

FREEWAY CLOSED X MILE	FRONTAGE ROAD CLOSED
ROAD CLOSED AT SH XXX	SHOULDER CLOSED XXX FT
ROAD CLSD AT FM XXXX	RIGHT LN CLOSED XXX FT
RIGHT X LANES CLOSED	RIGHT X LANES OPEN
CENTER LANE CLOSED	DAYTIME LANE CLOSURES
NIGHT LANE CLOSURES	I-XX SOUTH EXIT CLOSED
VARIOUS LANES CLOSED	EXIT XXX CLOSED X MILE
EXIT CLOSED	RIGHT LN TO BE CLOSED
MALL DRIVEWAY CLOSED	X LANES CLOSED TUE - FRI
XXXXXXXX BLVD CLOSED	

### Other Condition List

ROADWORK XXX FT	ROAD REPAIRS XXXX FT
FLAGGER XXXX FT	LANE NARROWS XXXX FT
RIGHT LN NARROWS XXXX FT	TWO-WAY TRAFFIC XX MILE
MERGING TRAFFIC XXXX FT	CONST TRAFFIC XXX FT
LOOSE GRAVEL XXXX FT	UNEVEN LANES XXXX FT
DETOUR X MILE	ROUGH ROAD XXXX FT
ROADWORK PAST SH XXXX	ROADWORK NEXT FRI-SUN
BUMP XXXX FT	US XXX EXIT X MILES
TRAFFIC SIGNAL XXXX FT	LANES SHIFT *

\* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

## Phase 2: Possible Component Lists

### Action to Take/Effect on Travel List

MERGE RIGHT	FORM X LINES RIGHT
DETOUR NEXT X EXITS	USE XXXXX RD EXIT
USE EXIT XXX	USE EXIT I-XX NORTH
STAY ON US XXX SOUTH	USE I-XX E TO I-XX N
TRUCKS USE US XXX N	WATCH FOR TRUCKS
WATCH FOR TRUCKS	EXPECT DELAYS
EXPECT DELAYS	PREPARE TO STOP
REDUCE SPEED XXX FT	END SHOULDER USE
USE OTHER ROUTES	WATCH FOR WORKERS
STAY IN LANE *	

### Location List

AT FM XXXX
BEFORE RAILROAD CROSSING
NEXT X MILES
PAST US XXX EXIT
XXXXXXXX TO XXXXXX
US XXX TO FM XXXX

### Warning List

SPEED LIMIT XX MPH
MAXIMUM SPEED XX MPH
MINIMUM SPEED XX MPH
ADVISORY SPEED XX MPH
RIGHT LANE EXIT
USE CAUTION
DRIVE SAFELY
DRIVE WITH CARE

### \*\* Advance Notice List

TUE-FRI XX AM-X PM
APR XX-XX X PM-X AM
BEGINS MONDAY
BEGINS MAY XX
MAY X-X XX PM - XX AM
NEXT FRI-SUN
XX AM TO XX PM
NEXT TUE AUG XX
TONIGHT XX PM-XX AM

\*\* See Application Guidelines Note 6.

## APPLICATION GUIDELINES

- Only 1 or 2 phases are to be used on a PCMS.
- The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
- A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
- A Location Phase is necessary only if a distance or location is not included in the first phase selected.
- If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS shall be limited to two phases, and should be understandable by themselves.
- For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

## WORDING ALTERNATIVES

- The words RIGHT, LEFT and ALL can be interchanged as appropriate.
- Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
- EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
- Highway names and numbers replaced as appropriate.
- ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
- AHEAD may be used instead of distances if necessary.
- FT and MI, MILE and MILES interchanged as appropriate.
- AT, BEFORE and PAST interchanged as needed.
- Distances or AHEAD can be eliminated from the message if a location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC, THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

## FULL MATRIX PCMS SIGNS

- When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
- When symbol signs, such as the "Flagger Symbol" (CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
- When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute for, or replace that sign.
- A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

WORD OR PHRASE	ABBREVIATION	WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD	Major	MAJ
Alternate	ALT	Miles	MI
Avenue	AVE	Miles Per Hour	MPH
Best Route	BEST RTE	Minor	MNR
Boulevard	BLVD	Monday	MON
Bridge	BRDG	Normal	NORM
Cannot	CANT	North	N
Center	CTR	Northbound	(route) N
Construction Ahead	CONST AHD	Parking	PKING
CROSSING	XING	Road	RD
Detour Route	DETOUR RTE	Right Lane	RT LN
Do Not	DONT	Saturday	SAT
East	E	Service Road	SERV RD
Eastbound	(route) E	Shoulder	SHLDR
Emergency	EMER	Slippery	SLIP
Emergency Vehicle	EMER VEH	South	S
Entrance, Enter	ENT	Southbound	(route) S
Express Lane	EXP LN	Speed	SPD
Expressway	EXPWY	Street	ST
XXXX Feet	XXXX FT	Sunday	SUN
Fog Ahead	FOG AHD	Telephone	PHONE
Freeway	FRWY, FWY	Temporary	TEMP
Freeway Blocked	FWY BLKD	Thursday	THURS
Friday	FRI	To Downtown	TO DWNTN
Hazardous Driving	HAZ DRIVING	Traffic	TRAF
Hazardous Material	HAZMAT	Travelers	TRVLR
High-Occupancy Vehicle	HOV	Tuesday	TUES
Highway	HWY	Time Minutes	TIME MIN
Hour(s)	HR, HRS	Upper Level	UPR LEVEL
Information	INFO	Vehicles (s)	VEH, VEHS
It Is	ITS	Warning	WARN
Junction	JCT	Wednesday	WED
Left	LFT	Weight Limit	WT LIMIT
Left Lane	LFT LN	West	W
Lane Closed	LN CLOSED	Westbound	(route) W
Lower Level	LWR LEVEL	Wet Pavement	WET PVMT
Maintenance	MAINT	Will Not	WONT


Roadway designation # IH-number, US-number, SH-number, FM-number

<h3>BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS)</h3>			
<h2>BC (6) - 21</h2>			
FILE:	bc-21.dgn	DN:	TxDOT
© TxDOT	November 2002	CONT:	SECT:
REVISIONS	0009 13	JOB:	197, ETC IH 30, ETC.
9-07	8-14	DIST:	COUNTY:
7-13	5-21	PAR:	HUNT, ETC.
		SHEET NO.:	52

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 5/21/2024 9:43:17 AM  
 FILE: t:\paratraf\ashley\projects\safety\lighting\let\_8-24\STANDARDS\bc-21.dgn

- Barrier Reflectors shall be pre-qualified, and conform to the color and reflectivity requirements of DMS-8600. A list of prequalified Barrier Reflectors can be found at the Material Producer List web address shown on BC(1).
- Color of Barrier Reflectors shall be as specified in the TMUTCD. The cost of the reflectors shall be considered subsidiary to Item 512.

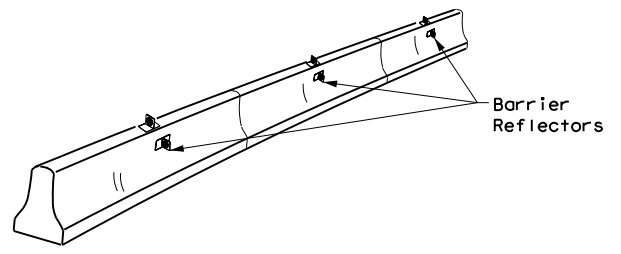


**CONCRETE TRAFFIC BARRIER (CTB)**

- Where traffic is on one side of the CTB, two (2) Barrier Reflectors shall be mounted in approximately the midsection of each section of CTB. An alternate mounting location is uniformly spaced at one end of each CTB. This will allow for attachment of a barrier grapple without damaging the reflector. The Barrier Reflector mounted on the side of the CTB shall be located directly below the reflector mounted on top of the barrier, as shown in the detail above.
- Where CTB separates two-way traffic, three barrier reflectors shall be mounted on each section of CTB. The reflector unit on top shall have two yellow reflective faces (Bi-Directional) while the reflectors on each side of the barrier shall have one yellow reflective face, as shown in the detail above.
- When CTB separates traffic traveling in the same direction, no barrier reflectors will be required on top of the CTB.
- Barrier Reflector units shall be yellow or white in color to match the edgeline being supplemented.
- Maximum spacing of Barrier Reflectors is forty (40) feet.
- Pavement markers or temporary flexible-reflective roadway marker tabs shall NOT be used as CTB delineation.
- Attachment of Barrier Reflectors to CTB shall be per manufacturer's recommendations.
- Missing or damaged Barrier Reflectors shall be replaced as directed by the Engineer.
- Single slope barriers shall be delineated as shown on the above detail.

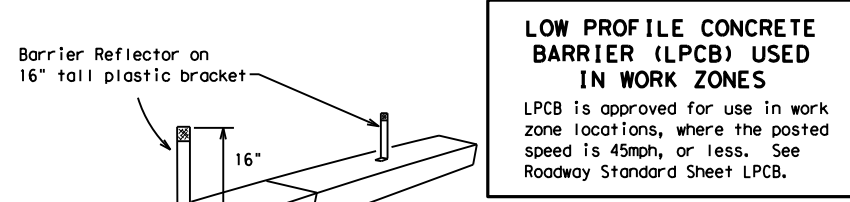

**LOW PROFILE CONCRETE BARRIER (LPCB) USED IN WORK ZONES**  
 LPCB is approved for use in work zone locations, where the posted speed is 45mph, or less. See Roadway Standard Sheet LPCB.

**LOW PROFILE CONCRETE BARRIER (LPCB)**

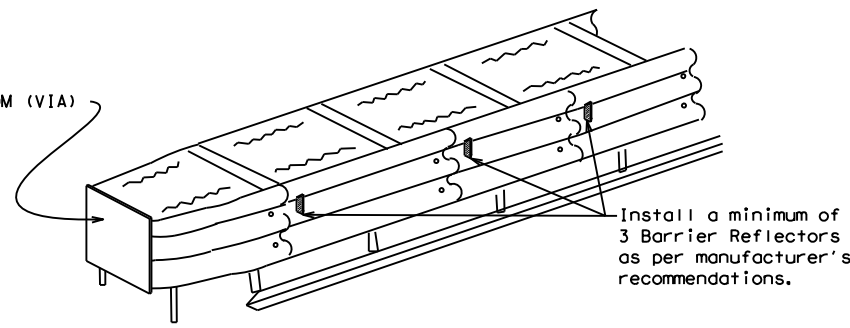

**DELINEATION OF END TREATMENTS**

**END TREATMENTS FOR CTB'S USED IN WORK ZONES**  
 End treatments used on CTB's in work zones shall meet the appropriate crashworthy standards as defined in the Manual for Assessing Safety Hardware (MASH). Refer to the CWZTCD List for approved end treatments and manufacturers.

**BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS**

**WARNING LIGHTS**


- Warning lights shall meet the requirements of the TMUTCD.
- Warning lights shall NOT be installed on barricades.
- Type A-Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall not be used with signs manufactured with Type B<sub>FL</sub> or C<sub>FL</sub> Sheeting meeting the requirements of Departmental Material Specification DMS-8300.
- Type-C and Type D 360 degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".
- The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.
- When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights.
- When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.
- The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

**WARNING LIGHTS MOUNTED ON PLASTIC DRUMS**


- Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.
- Type A random flashing warning lights are not intended for delineation and shall not be used in a series.
- A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used, the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.
- Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane changes, on lane closures, and on other similar conditions.
- Type A, Type C and Type D warning lights shall be installed at locations as detailed on other sheets in the plans.
- Warning lights shall not be installed on a drum that has a sign, chevron or vertical panel.
- The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

**WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS**

- A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the discretion of the Contractor unless otherwise noted in the plans.
- The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed on the CWZTCD.
- The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches.
- Round reflectors shall be fully reflectorized, including the area where attached to the drum.
- Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it attaches to the drum.
- The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for DMS 8300-Type B or Type C.
- When used near two-way traffic, both sides of the warning reflector shall be reflectorized.
- The warning reflector should be mounted on the side of the handle nearest approaching traffic.
- The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

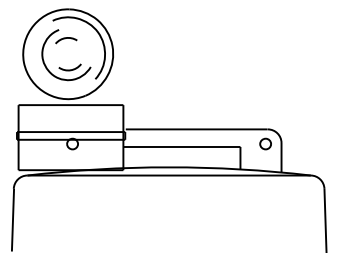


Type C Warning Light or approved substitute mounted on a drum adjacent to the travel way.

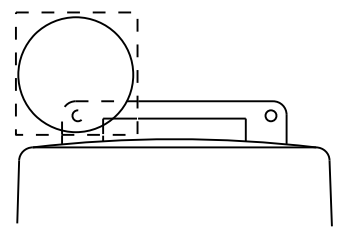

Warning reflector may be round or square. Must have a yellow reflective surface area of at least 30 square inches

Arrow Boards may be located behind channelizing devices in place for a shoulder taper or merging taper, otherwise they shall be delineated with four (4) channelizing devices placed perpendicular to traffic on the upstream side of traffic.

- The Flashing Arrow Board should be used for all lane closures on multi-lane roadways, or slow moving maintenance or construction activities on the travel lanes.
- Flashing Arrow Boards should not be used on two-lane, two-way roadways, detours, diversions or work on shoulders unless the "CAUTION" display (see detail below) is used.
- The Engineer/Inspector shall choose all appropriate signs, barricades and/or other traffic control devices that should be used in conjunction with the Flashing Arrow Board.
- The Flashing Arrow Board should be able to display the following symbols:

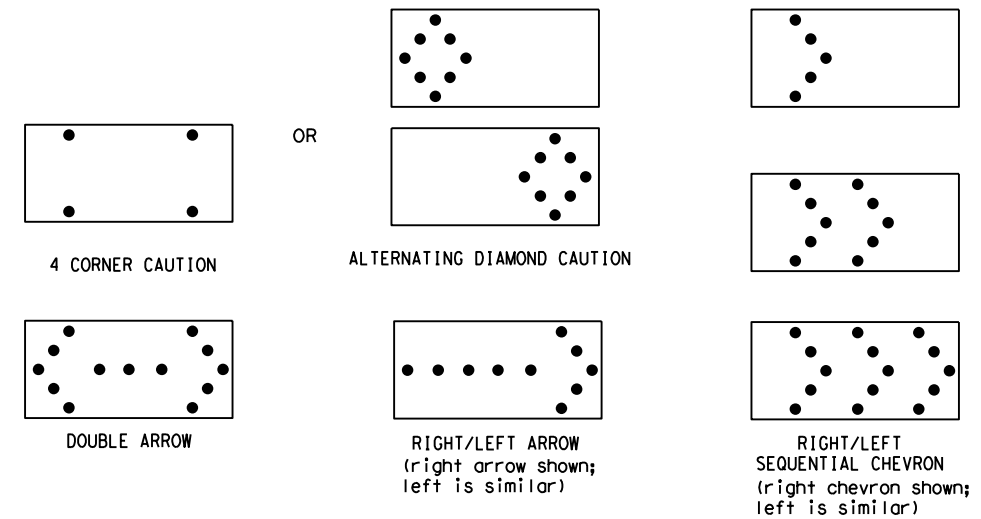

- The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
- The straight line caution display is NOT ALLOWED.
- The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.
- Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.
- The sequential arrow display is NOT ALLOWED.
- The flashing arrow display is the TxDOT standard; however, the sequential chevron display may be used during daylight operations.
- The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.
- A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.
- A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.
- Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway to bottom of panel.

REQUIREMENTS			
TYPE	MINIMUM SIZE	MINIMUM NUMBER OF PANEL LAMPS	MINIMUM VISIBILITY DISTANCE
B	30 x 60	13	3/4 mile
C	48 x 96	15	1 mile

**ATTENTION**  
 Flashing Arrow Boards shall be equipped with automatic dimming devices.

WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE ARROW BOARD BEHIND CONCRETE TRAFFIC BARRIER OR GUARDRAIL.

**FLASHING ARROW BOARDS**

SHEET 7 OF 12

**TRUCK-MOUNTED ATTENUATORS**

- Truck-mounted attenuators (TMA) used on TxDOT facilities must meet the requirements outlined in the Manual for Assessing Safety Hardware (MASH).
- Refer to the CWZTCD for the requirements of Level 2 or Level 3 TMAs.
- Refer to the CWZTCD for a list of approved TMAs.
- TMAs are required on freeways unless otherwise noted in the plans.
- A TMA should be used anytime that it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.
- The only reason a TMA should not be required is when a work area is spread down the roadway and the work crew is an extended distance from the TMA.



**BARRICADE AND CONSTRUCTION ARROW PANEL, REFLECTORS, WARNING LIGHTS & ATTENUATOR**

**BC (7) -21**

FILE:	bc-21.dgn	DN:	TxDOT	CR:	TxDOT	OW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0009	13	197, ETC	IH	30, ETC.			
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	PAR	HUNT, ETC.	53					

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.  
 DATE: 5/21/2024 9:43:19 AM  
 FILE: t:\parr\trav\ashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn

**GENERAL NOTES**

- For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
- For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections, one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
- For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
- Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
- The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

**GENERAL DESIGN REQUIREMENTS**

Pre-qualified plastic drums shall meet the following requirements:




- Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
- The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
- Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
- Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
- The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
- The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectORIZED space between any two adjacent stripes shall not exceed 2 inches in width.
- Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
- Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
- Drum body shall have a maximum unballasted weight of 11 lbs.
- Drum and base shall be marked with manufacturer's name and model number.

**RETROREFLECTIVE SHEETING**

- The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials." Type A or Type B reflective sheeting shall be supplied unless otherwise specified in the plans.
- The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.


**BALLAST**

- Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
- Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
- Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
- The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
- When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
- Ballast shall not be placed on top of drums.
- Adhesives may be used to secure base of drums to pavement.

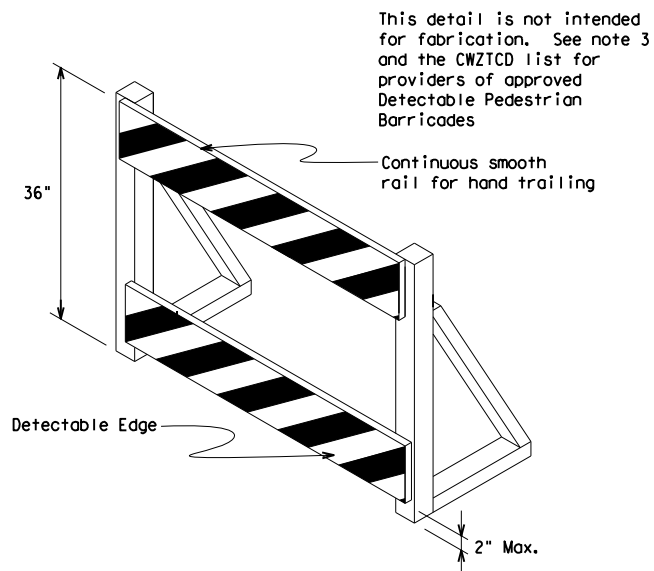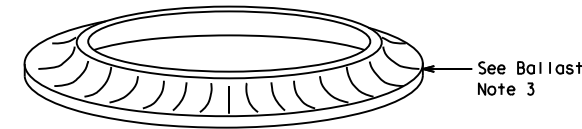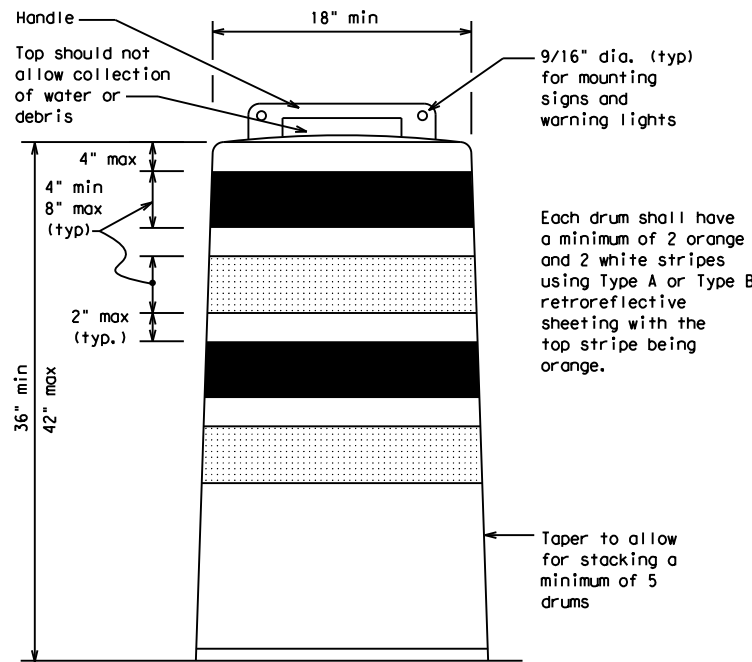


**DETECTABLE PEDESTRIAN BARRICADES**

- When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility. Refer to WZ(BTS-2) for Pedestrian Control requirements for Sidewalk Diversions, Sidewalk Detours and Crosswalk Closures.
- Where pedestrians with visual disabilities normally use the closed sidewalk, a Detectable Pedestrian Barricade shall be placed across the full width of the closed sidewalk instead of a Type 3 Barricade.
- Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
- Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines (ADAAG)" and should not be used as a control for pedestrian movements.
- Warning lights shall not be attached to detectable pedestrian barricades.
- Detectable pedestrian barricades should use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.



18" x 24" Sign  
(Maximum Sign Dimension)  
Chevron CW1-8, Opposing Traffic Lane  
Divider, Driveway sign D70a, Keep Right  
R4 series or other signs as approved  
by Engineer



12" x 24"  
Vertical Panel  
mount with diagonals  
sloping down towards  
travel way

Plywood, Aluminum or Metal sign  
substrates shall NOT be used on  
plastic drums

**SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS**

- Signs used on plastic drums shall be manufactured using substrates listed on the CWZTCD.
- Chevrons and other work zone signs with an orange background shall be manufactured with Type B<sub>FL</sub> or Type C<sub>FL</sub> Orange sheeting meeting the color and retroreflectivity requirements of DMS-8300, "Sign Face Material," unless otherwise specified in the plans.
- Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A or Type B. Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane.
- Other sign messages (text or symbolic) may be used as approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below.
- Signs shall be installed using a 1/2 inch bolt (nominal) and nut, two washers, and one locking washer for each connection.
- Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2 inch beyond nuts.
- Chevrons may be placed on drums on the outside of curves, on merging tapers or on shifting tapers. When used in these locations, they may be placed on every drum or spaced not more than on every third drum. A minimum of three (3) should be used at each location called for in the plans.
- R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.

SHEET 8 OF 12



**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**


**BC (8) - 21**

FILE:	bc-21.dgn	DN:	TxDOT	CR:	TxDOT	OW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0009	13	197, ETC	IH	30, ETC.			
4-03	8-14	DIST	COUNTY	SHEET NO.					
9-07	5-21	PAR	HUNT, ETC.	54					
7-13									



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 5/21/2024 9:43:20 AM  
 FILE: t:\paratraf\ashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn

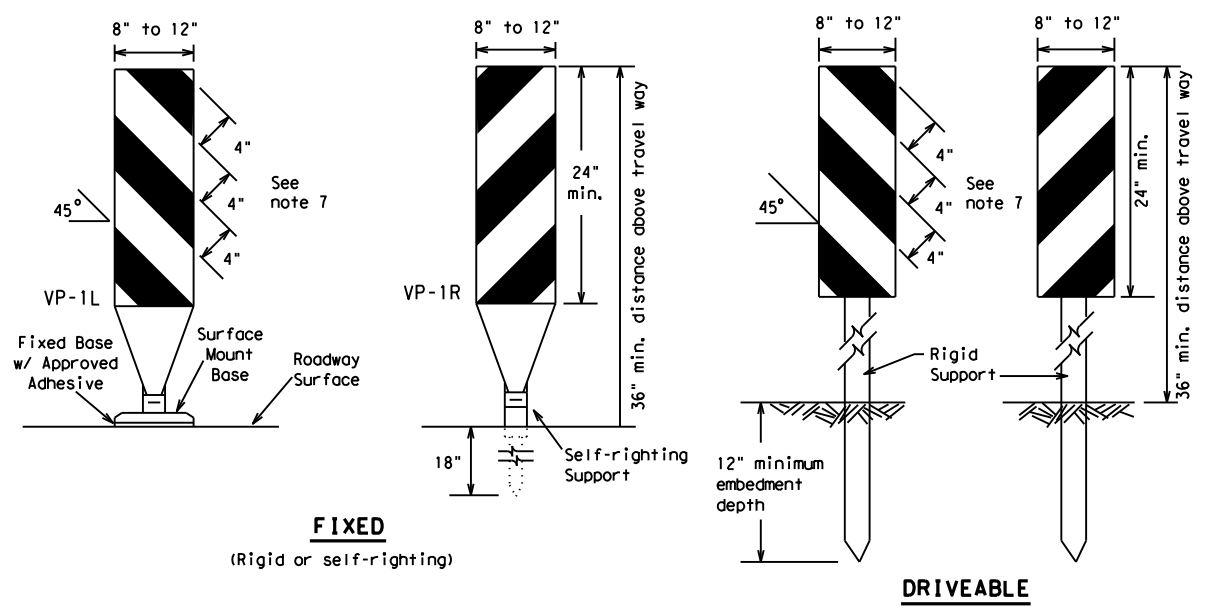

**FIXED**  
(Rigid or self-righting)

**DRIVEABLE**




(Rigid or self-righting)

**PORTABLE**


**VERTICAL PANELS (VPs)**

- Vertical Panels (VP's) are normally used to channelize traffic or divide opposing lanes of traffic.
- VP's may be used in daytime or nighttime situations. They may be used at the edge of shoulder drop-offs and other areas such as lane transitions where positive daytime and nighttime delineation is required. The Engineer/Inspector shall refer to the Roadway Design Manual for additional requirements on the use VP's for drop-offs.
- VP's should be mounted back to back if used at the edge of cuts adjacent to two-way two lane roadways. Stripes are to be reflective orange and reflective white and should always slope downward toward the travel lane.
- VP's used on expressways and freeways or other high speed roadways, may have more than 270 square inches of retroreflective area facing traffic.
- Self-righting supports are available with portable base. See "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Sheeting for the VP's shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300, unless noted otherwise.
- Where the height of reflective material on the vertical panel is 36 inches or greater, a panel stripe of 6 inches shall be used.

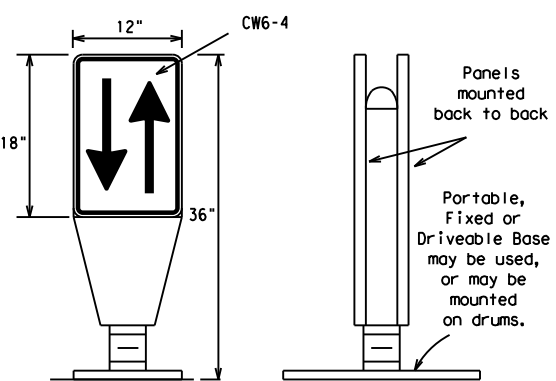


**OPPOSING TRAFFIC LANE DIVIDERS (OTLD)**

- Opposing Traffic Lane Dividers (OTLD) are delineation devices designed to convert a normal one-way roadway section to two-way operation. OTLD's are used on temporary centerlines. The upward and downward arrows on the sign's face indicate the direction of traffic on either side of the divider. The base is secured to the pavement with an adhesive or rubber weight to minimize movement caused by a vehicle impact or wind gust.
- The OTLD may be used in combination with 42" cones or VPs.
- Spacing between the OTLD shall not exceed 500 feet. 42" cones or VPs placed between the OTLD's should not exceed 100 foot spacing.
- The OTLD shall be orange with a black non-reflective legend. Sheeting for the OTLD shall be retroreflective Type B<sub>FL</sub> or Type C<sub>FL</sub> conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.

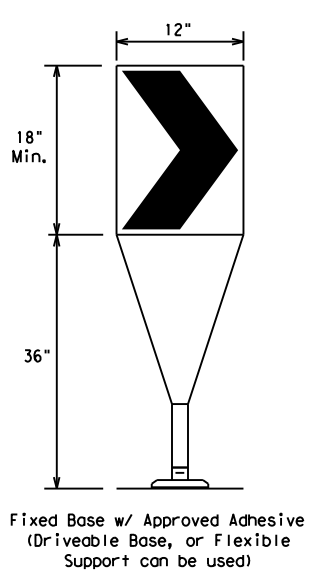

- The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
- Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
- Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
- To be effective, the chevron should be visible for at least 500 feet.
- Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type B<sub>FL</sub> or Type C<sub>FL</sub> conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
- For Long Term Stationary use on tapers or transitions on freeways and divided highways, self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

**CHEVRONS**

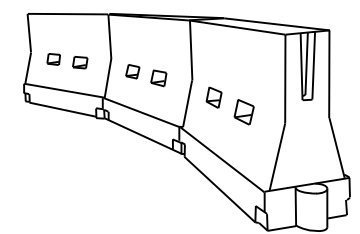

**LONGITUDINAL CHANNELIZING DEVICES (LCD)**

- LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
- LCDs may be used instead of a line of cones or drums.
- LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
- LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
- LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10). Place reflective sheeting near the top of the LCD along the full length of the device.

**WATER BALLASTED SYSTEMS USED AS BARRIERS**

- Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate Manual for Assessing Safety Hardware (MASH) crashworthiness requirements based on roadway speed and barrier application.
- Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
- Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
- When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long canes and the top of the unit shall not be less than 32 inches in height.

**HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS**

**GENERAL NOTES**

- Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
- Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
- Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
- Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
- The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.

Posted Speed	Formula	Minimum Desirable Taper Lengths * *			Suggested Maximum Spacing of Channelizing Devices	
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent
30	L = WS <sup>2</sup> / 60	150'	165'	180'	30'	60'
35		205'	225'	245'	35'	70'
40		265'	295'	320'	40'	80'
45	L = WS	450'	495'	540'	45'	90'
50		500'	550'	600'	50'	100'
55		550'	605'	660'	55'	110'
60		600'	660'	720'	60'	120'
65		650'	715'	780'	65'	130'
70		700'	770'	840'	70'	140'
75		750'	825'	900'	75'	150'
80		800'	880'	960'	80'	160'

\* \* \* Taper lengths have been rounded off.  
 L=Length of Taper (FT.) W=Width of Offset (FT.)  
 S=Posted Speed (MPH)

**SUGGESTED MAXIMUM SPACING OF CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS**

SHEET 9 OF 12



**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (9) - 21**

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	PAR	HUNT, ETC.	55	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 5/21/2024 9:43:22 AM  
 FILE: t:\partofashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn

**TYPE 3 BARRICADES**

1. Refer to the Compliant Work Zone Traffic Control Devices List (CWZTCD) for details of the Type 3 Barricades and a list of all materials used in the construction of Type 3 Barricades.
2. Type 3 Barricades shall be used at each end of construction projects closed to all traffic.
3. Barricades extending across a roadway should have stripes that slope downward in the direction toward which traffic must turn in detouring. When both right and left turns are provided, the chevron striping may slope downward in both directions from the center of the barricade. Where no turns are provided at a closed road, striping should slope downward in both directions toward the center of roadway.
4. Striping of rails, for the right side of the roadway, should slope downward to the left. For the left side of the roadway, striping should slope downward to the right.
5. Identification markings may be shown only on the back of the barricade rails. The maximum height of letters and/or company logos used for identification shall be 1".
6. Barricades shall not be placed parallel to traffic unless an adequate clear zone is provided.
7. Warning lights shall NOT be installed on barricades.
8. Where barricades require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand is recommended. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight. Sand bags shall not be stacked in a manner that covers any portion of a barricade rails reflective sheeting. Rock, concrete, iron, steel or other solid objects will NOT be permitted. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall not be used for sandbags. Sandbags shall only be placed along or upon the base supports of the device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners.
9. Sheeting for barricades shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300 unless otherwise noted.

Barricades shall NOT be used as a sign support.




**TYPICAL STRIPING DETAIL FOR BARRICADE RAIL**




Stiffener may be inside or outside of support, but no more than 2 stiffeners shall be allowed on one barricade.

**TYPICAL PANEL DETAIL FOR SKID OR POST TYPE BARRICADES**

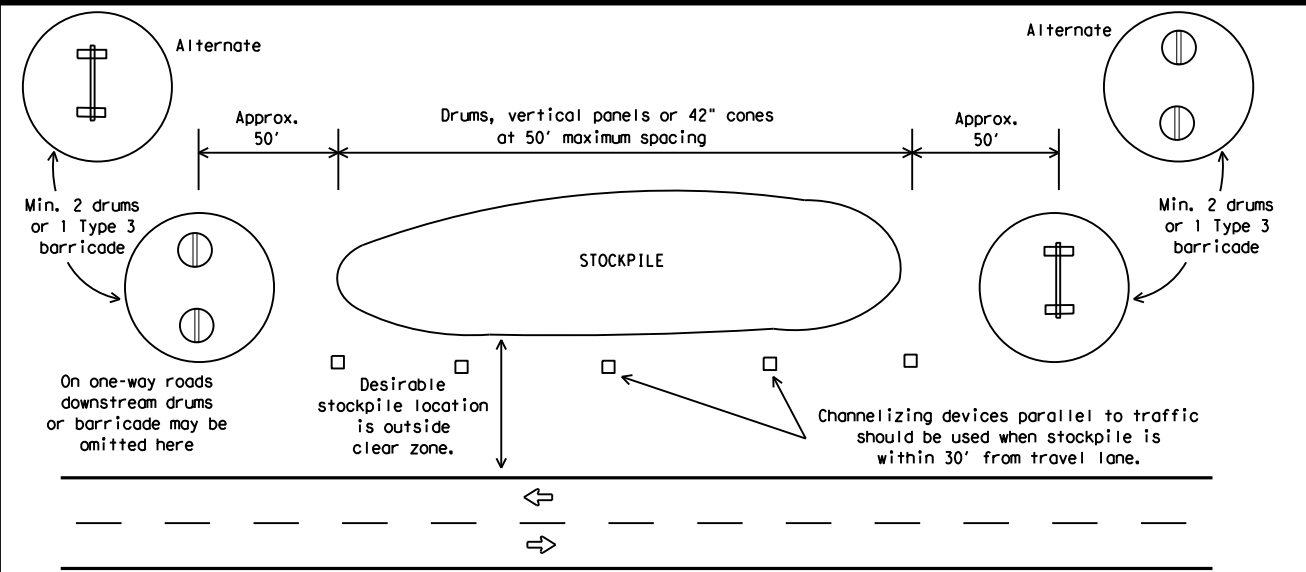


**TRAFFIC CONTROL FOR MATERIAL STOCKPILES**

Each roadway of a divided highway shall be barricaded in the same manner.

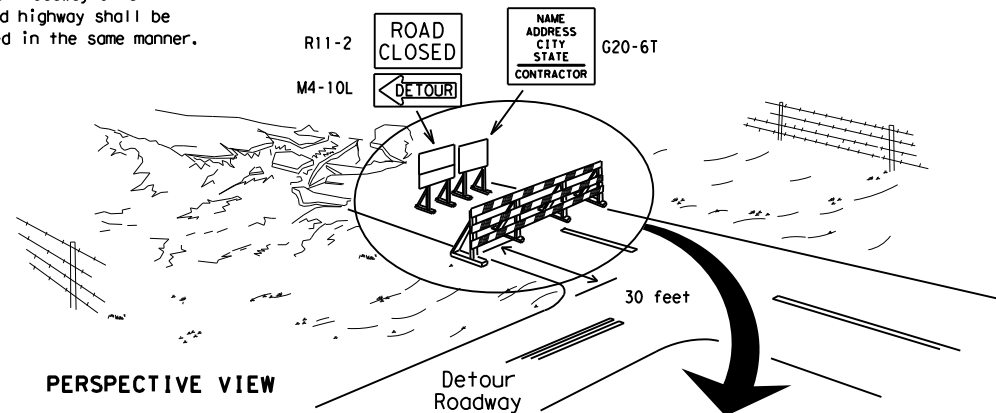

PERSPECTIVE VIEW


The three rails on Type 3 barricades shall be reflectorized orange and reflective white stripes on one side facing one-way traffic and both sides for two-way traffic. Barricade striping should slant downward in the direction of detour.

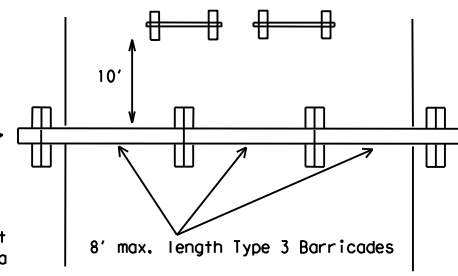


PLAN VIEW

1. Signs should be mounted on independent supports at a 7 foot mounting height in center of roadway. The signs should be a minimum of 10 feet behind Type 3 Barricades.
2. Advance signing shall be as specified elsewhere in the plans.

**TYPE 3 BARRICADE (POST AND SKID) TYPICAL APPLICATION**

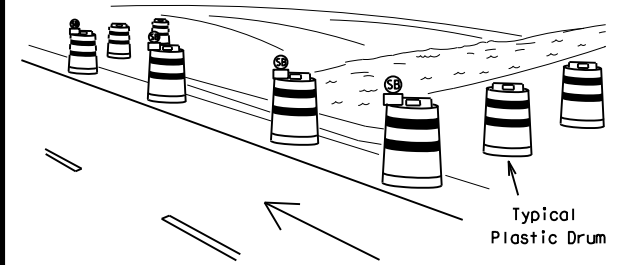

PERSPECTIVE VIEW

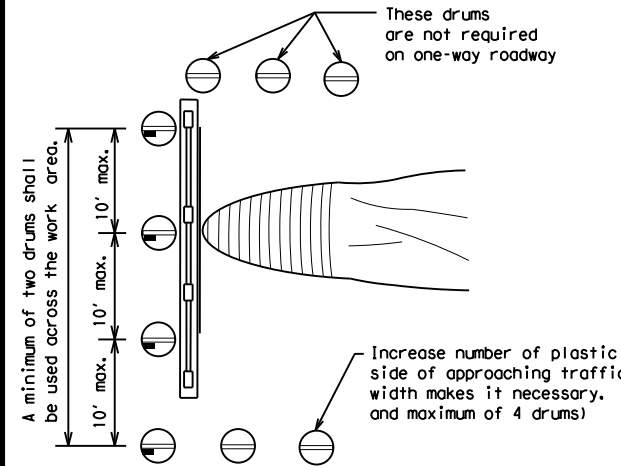


PLAN VIEW

**CULVERT WIDENING OR OTHER ISOLATED WORK WITHIN THE PROJECT LIMITS**

1. Where positive redirection capability is provided, drums may be omitted.
2. Plastic construction fencing may be used with drums for safety as required in the plans.
3. Vertical Panels on flexible support may be substituted for drums when the shoulder width is less than 4 feet.
4. When the shoulder width is greater than 12 feet, steady-burn lights may be omitted if drums are used.
5. Drums must extend the length of the culvert widening.

LEGEND	
	Plastic drum
	Plastic drum with steady burn light or yellow warning reflector
	Steady burn warning light or yellow warning reflector

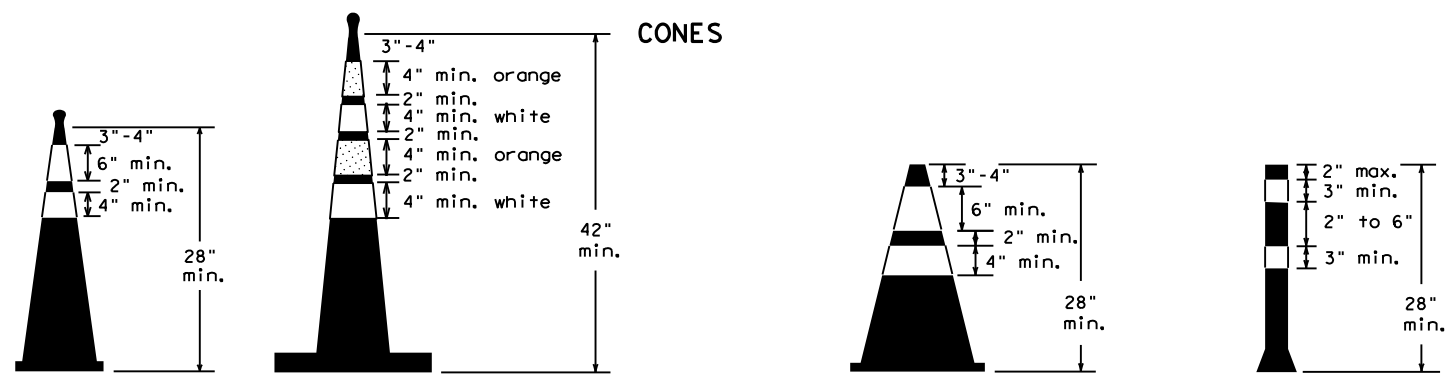

Two-Piece cones

One-Piece cones

Tubular Marker

28" Cones shall have a minimum weight of 9 1/2 lbs.  
 42" 2-piece cones shall have a minimum weight of 30 lbs. including base.

1. Traffic cones and tubular markers shall be predominantly orange, and meet the height and weight requirements shown above.
2. One-piece cones have the body and base of the cone molded in one consolidated unit. Two-piece cones have a cone shaped body and a separate rubber base, or ballast, that is added to keep the device upright and in place.
3. Two-piece cones may have a handle or loop extending up to 8" above the minimum height shown, in order to aid in retrieving the device.
4. Cones or tubular markers shall have white or white and orange reflective bands as shown above. The reflective bands shall have a smooth, sealed outer surface and meet the requirements of Departmental Material Specification DMS-8300 Type A or Type B.
5. 28" cones and tubular markers are generally suitable for short duration and short-term stationary work as defined on BC(4). These should not be used for intermediate-term or long-term stationary work unless personnel is on-site to maintain them in their proper upright position.
6. 42" two-piece cones, vertical panels or drums are suitable for all work zone durations.
7. Cones or tubular markers used on each project should be of the same size and shape.

**BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES**

**BC (10) -21**

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	OW:	TxDOT	CR:	TxDOT
©TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0009	13	197, ETC	IH 30, ETC.				
9-07	8-14	DIST	COUNTY	SHEET NO.					
7-13	5-21	PAR	HUNT, ETC.	56					

## WORK ZONE PAVEMENT MARKINGS

### GENERAL

- The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
- Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Additional supplemental pavement marking details may be found in the plans or specifications.
- Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
- When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
- When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
- All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

### RAISED PAVEMENT MARKERS

- Raised pavement markers are to be placed according to the patterns on BC(12).
- All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

### PREFABRICATED PAVEMENT MARKINGS

- Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
- Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


### MAINTAINING WORK ZONE PAVEMENT MARKINGS

- The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
- Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
- The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
- Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

### REMOVAL OF PAVEMENT MARKINGS

- Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
- The above shall not apply to detours in place for less than three days, where flaggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
- Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
- The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
- Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
- Blast cleaning may be used but will not be required unless specifically shown in the plans.
- Over-painting of the markings SHALL NOT BE permitted.
- Removal of raised pavement markers shall be as directed by the Engineer.
- Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
- Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

## Temporary Flexible-Reflective Roadway Marker Tabs

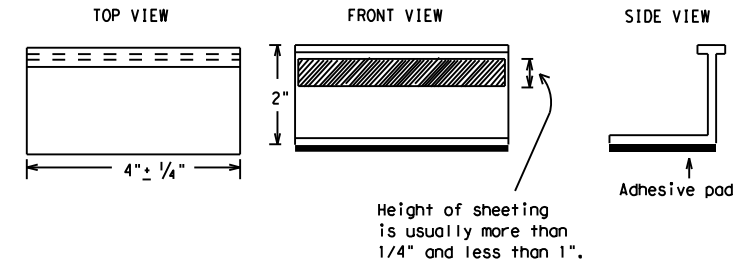

**STAPLES OR NAILS SHALL NOT BE USED TO SECURE  
TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARKER  
TABS TO THE PAVEMENT SURFACE**

- Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242.
- Tabs detailed on this sheet are to be inspected and accepted by the Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" or "B" below may be imposed to assure quality before placement on the roadway.
  - Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance.
  - Select five (5) tabs and perform the following test. Affix five (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed of 35 to 40 miles per hour, four (4) times in each direction. No more than one (1) out of the five (5) reflective surfaces shall be lost or displaced as a result of this test.
- Small design variances may be noted between tab manufacturers.
- See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work.

### RAISED PAVEMENT MARKERS USED AS GUIDEMARKS

- Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200.
- All temporary construction raised pavement markers provided on a project shall be of the same manufacturer.
- Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete surfaces.

Guidemarks shall be designated as:  
 YELLOW - (two amber reflective surfaces with yellow body).  
 WHITE - (one silver reflective surface with white body).

DEPARTMENTAL MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
TRAFFIC BUTTONS	DMS-4300
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8241
TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242

A list of prequalified reflective raised pavement markers, non-reflective traffic buttons, roadway marker tabs and other pavement markings can be found at the Material Producer List web address shown on BC(1).

SHEET 11 OF 12



## BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS

**BC(11)-21**

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CR: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS		0009	13	197, ETC IH 30, ETC.
2-98	9-07	5-21		
1-02	7-13			
11-02	8-14			
	DIST	COUNTY		SHEET NO.
	PAR	HUNT, ETC.		<b>57</b>

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.  
 DATE: 5/21/2024 9:43:24 AM  
 FILE: t:\part\raf\ashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn

## PAVEMENT MARKING PATTERNS




REFLECTORIZED PAVEMENT MARKINGS - PATTERN A




REFLECTORIZED PAVEMENT MARKINGS - PATTERN B

Pattern A is the TXDOT Standard, however Pattern B may be used if approved by the Engineer. Prefabricated markings may be substituted for reflectORIZED pavement markings.



RAISED PAVEMENT MARKERS - PATTERN A

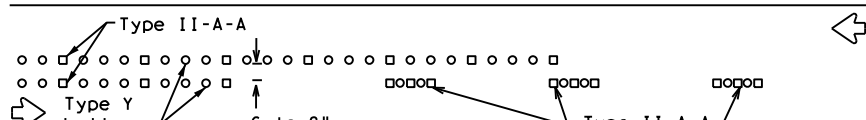

RAISED PAVEMENT MARKERS - PATTERN B

## CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO-LANE, TWO-WAY HIGHWAYS



REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.




RAISED PAVEMENT MARKERS

## EDGE & LANE LINES FOR DIVIDED HIGHWAY



REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

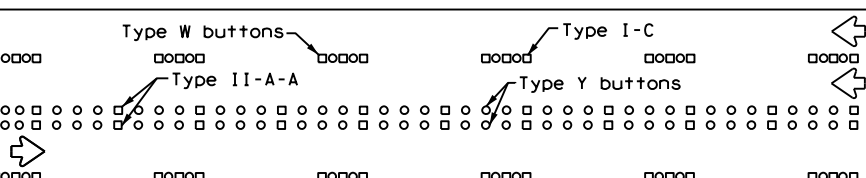

RAISED PAVEMENT MARKERS

## LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS



REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.






RAISED PAVEMENT MARKERS

## TWO-WAY LEFT TURN LANE


## STANDARD WORK ZONE PAVEMENT MARKINGS DETAILS



### SOLID LINES

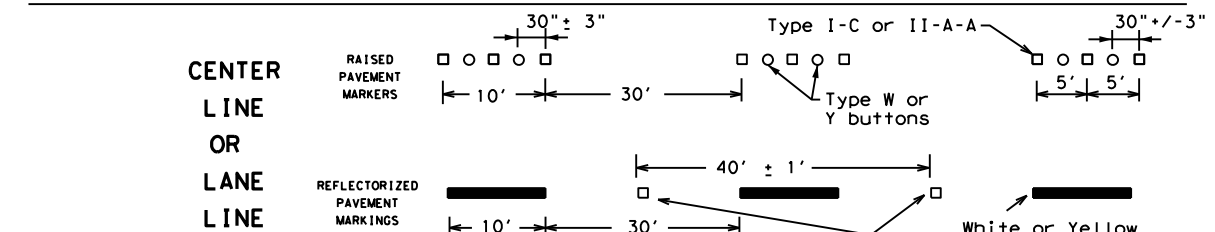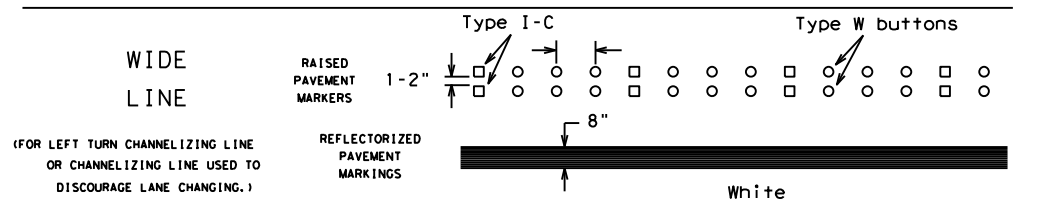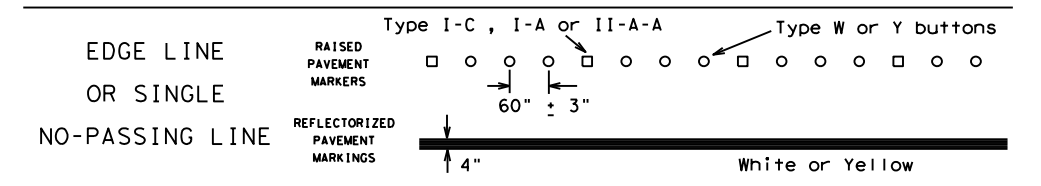


### BROKEN LINES

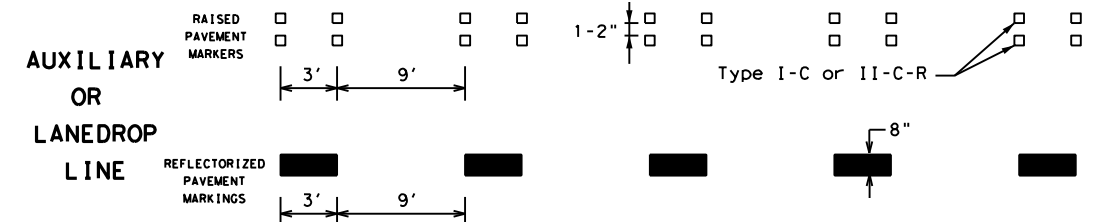

### REMOVABLE MARKINGS WITH RAISED PAVEMENT MARKERS

If raised pavement markers are used to supplement REMOVABLE markings, the markers shall be applied to the top of the tape at the approximate mid length of tape used for broken lines or at 20 foot spacing for solid lines. This allows an easier removal of raised pavement markers and tape.

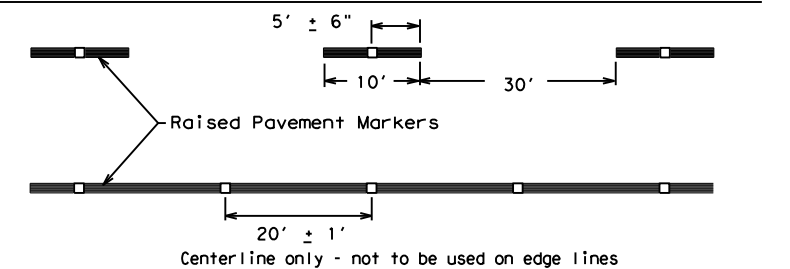

SHEET 12 OF 12



## BARRICADE AND CONSTRUCTION PAVEMENT MARKING PATTERNS

BC(12)-21

Raised pavement markers used as standard pavement markings shall be from the approved products list and meet the requirements of Item 672 "RAISED PAVEMENT MARKERS."


FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	OW: TxDOT	CR: TxDOT
©TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
1-97 9-07 5-21	DIST	COUNTY	SHEET NO.	
2-98 7-13	PAR	HUNT, ETC.	58	
11-02 8-14				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 5/21/2024 9:43:26 AM  
FILE: t:\parrif\ashley\projects\safety lighting let\_8-24\STANDARDS\bc-21.dgn


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 5/21/2024 9:43:28 AM  
 FILE: t:\paratraf\ashley\projects\safety\lighting\let\_8-24\STANDARDS\tcp2-1-18.dgn

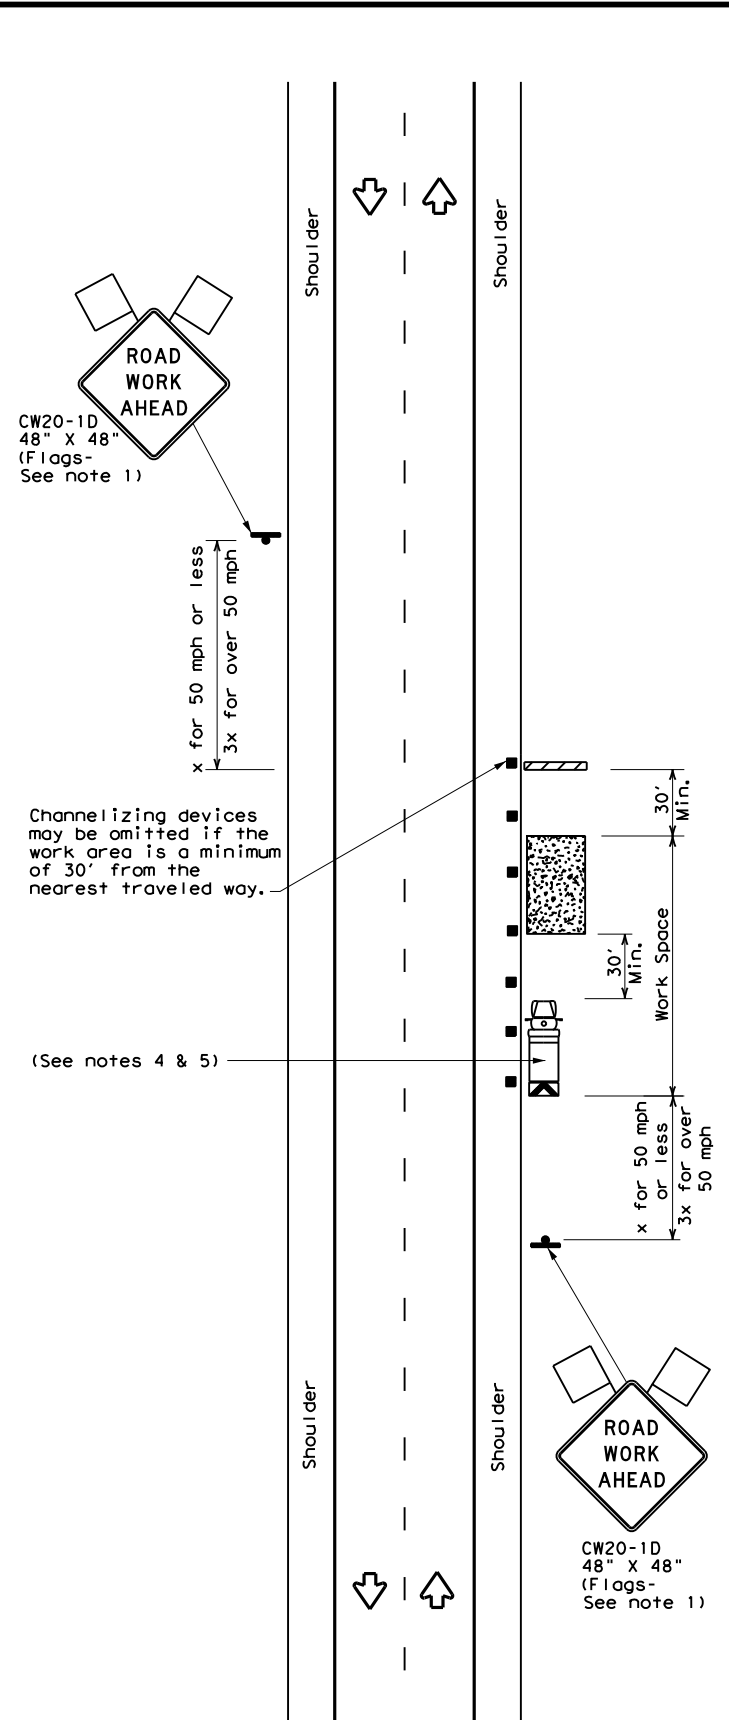


TCP (2-1a)

**WORK SPACE NEAR SHOULDER**  
 Conventional Roads

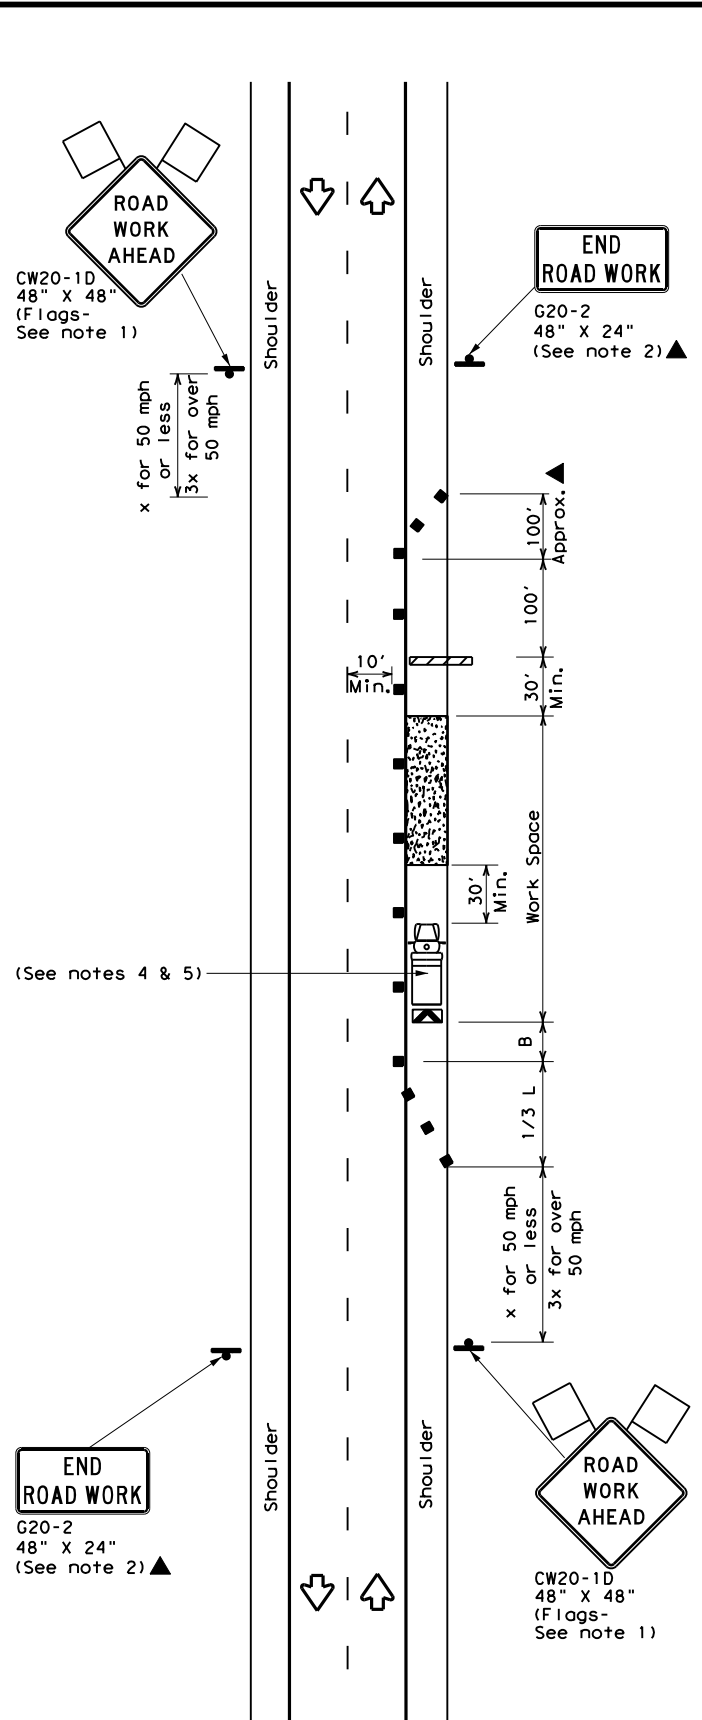

TCP (2-1b)

**WORK SPACE ON SHOULDER**  
 Conventional Roads

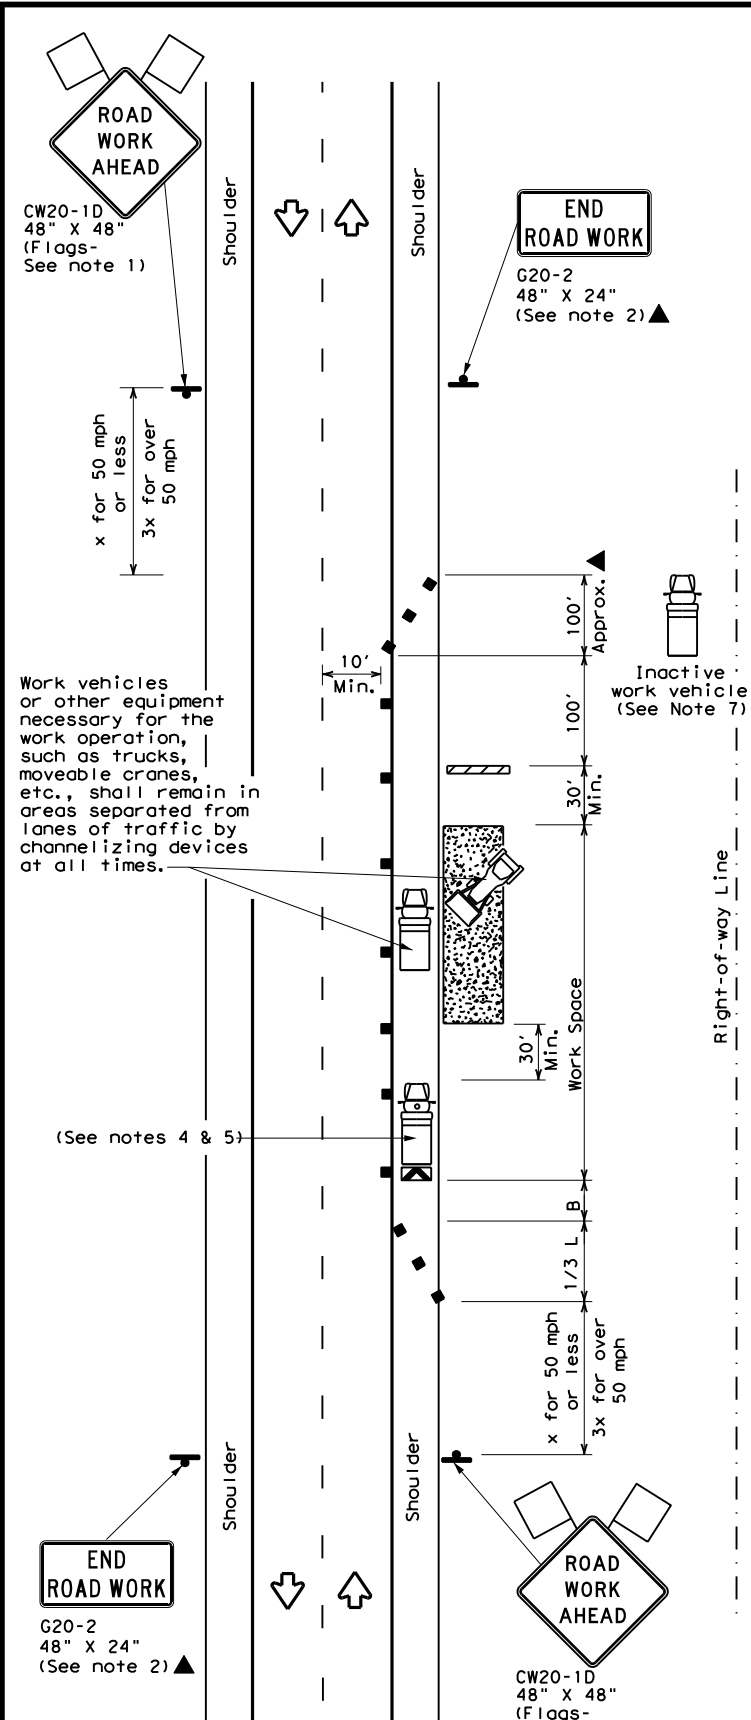

TCP (2-1c)

**WORK VEHICLES ON SHOULDER**  
 Conventional Roads

LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "X" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

\* Conventional Roads Only  
 \*\* Taper lengths have been rounded off.  
 L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

TYPICAL USAGE				
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
	✓	✓	✓	✓

**GENERAL NOTES**

- Flags attached to signs where shown, are REQUIRED.
- All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated in the plans, or for routine maintenance work, when approved by the Engineer.
- Stockpiled material should be placed a minimum of 30 feet from nearest traveled way.
- Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
- Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
- See TCP(5-1) for shoulder work on divided highways, expressways and freeways.
- Additional work vehicles or other equipment should be parked near the right-of-way line and not parked on the paved shoulder.
- CW21-5 "SHOULDER WORK" signs may be used in place of CW20-1D "ROAD WORK AHEAD" signs for shoulder work on conventional roadways.




**TRAFFIC CONTROL PLAN**  
**CONVENTIONAL ROAD**  
**SHOULDER WORK**

**TCP (2-1) - 18**


FILE: tcp2-1-18.dgn	DN:	CK:	DW:	CK:
© TxDOT December 1985	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
2-94 4-98	DIST	COUNTY	SHEET NO.	
8-95 2-12	PAR	HUNT, ETC.	59	
1-97 2-18				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of any kind to other formats or for incorrect results or damages resulting from its use.

DATE: 4/18/2024 9:43:06 AM  
 FILE: t:\par\tr\ashley\projects\safety\lighting\let\_8-24\STANDARDS\tcp2-2.dwg

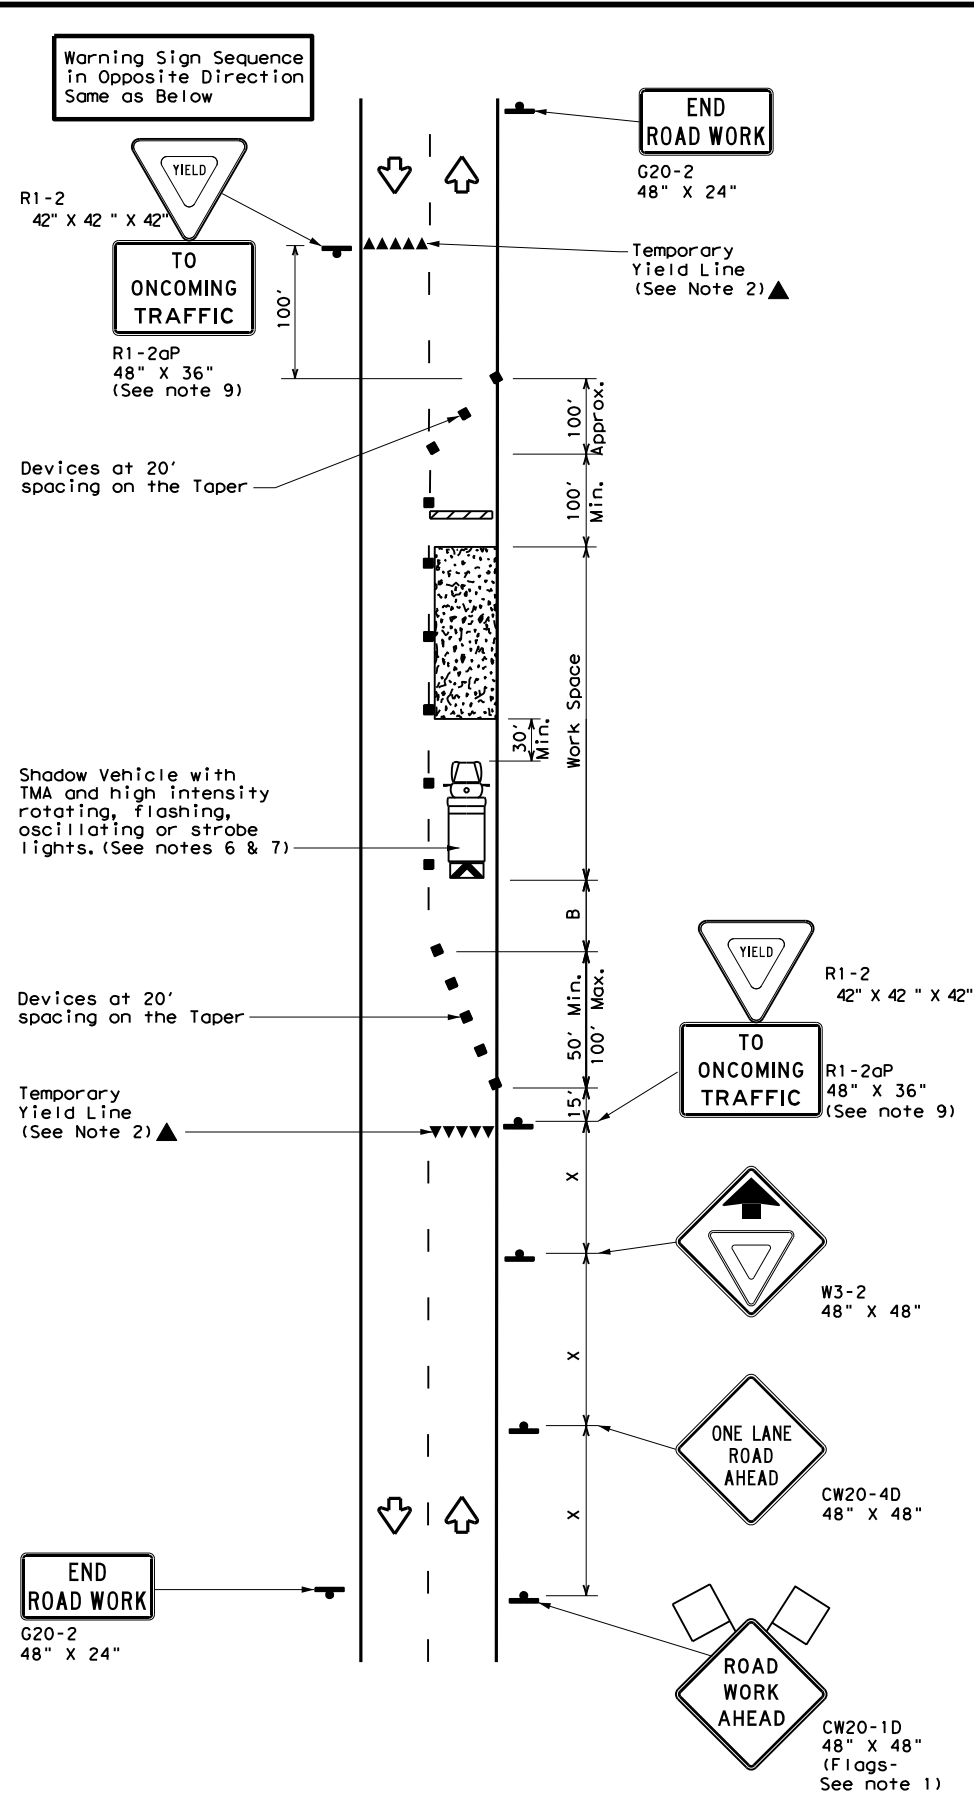

TCP (2-2a)  
 2-LANE ROADWAY WITHOUT PAVED SHOULDERS  
 ONE LANE TWO-WAY  
 CONTROL WITH YIELD SIGNS  
 (Less than 2000 ADT - See Note 9)

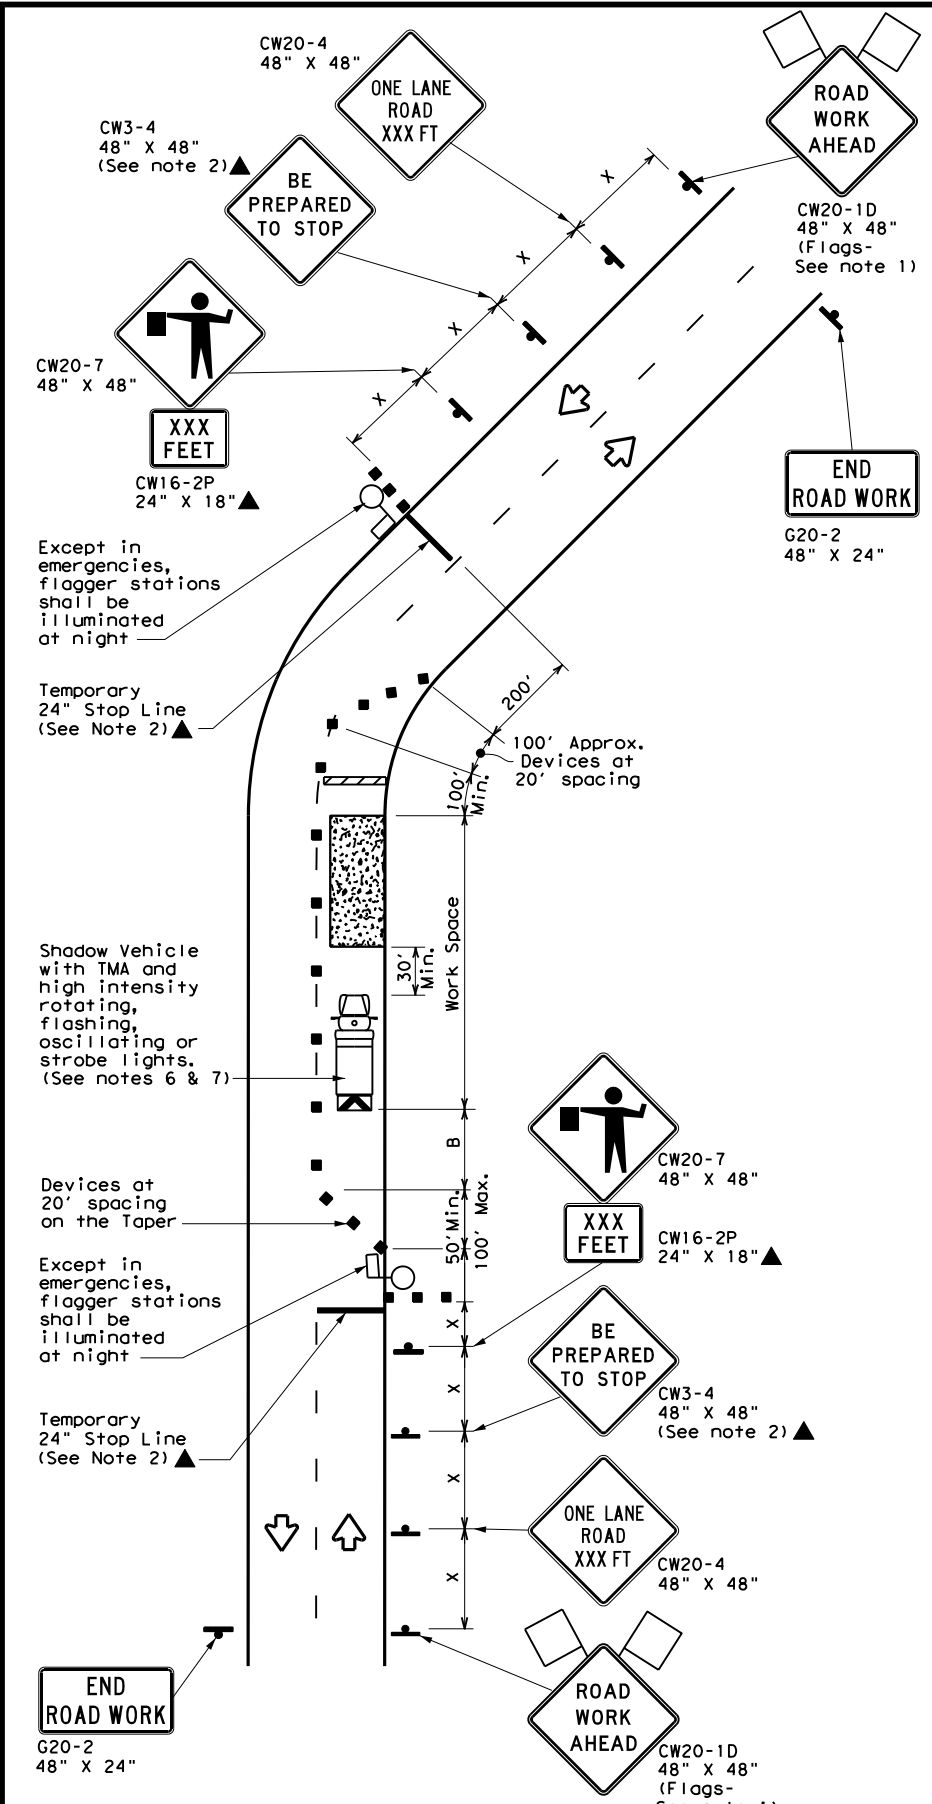

TCP (2-2b)  
 2-LANE ROADWAY WITHOUT PAVED SHOULDERS  
 ONE LANE TWO-WAY  
 CONTROL WITH FLAGGERS

**LEGEND**

	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed *	Formula	Minimum Desirable Taper Lengths **			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "x" Distance	Suggested Longitudinal Buffer Space "B"	Stopping Sight Distance
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent			
30	L = WS <sup>2</sup> / 60	150'	165'	180'	30'	60'	120'	90'	200'
35		205'	225'	245'	35'	70'	160'	120'	250'
40		265'	295'	320'	40'	80'	240'	155'	305'
45	L = WS	450'	495'	540'	45'	90'	320'	195'	360'
50		500'	550'	600'	50'	100'	400'	240'	425'
55		550'	605'	660'	55'	110'	500'	295'	495'
60		600'	660'	720'	60'	120'	600'	350'	570'
65		650'	715'	780'	65'	130'	700'	410'	645'
70		700'	770'	840'	70'	140'	800'	475'	730'
75		750'	825'	900'	75'	150'	900'	540'	820'

\* Conventional Roads Only  
 \*\* Taper lengths have been rounded off.  
 L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)

**TYPICAL USAGE**

	MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY
		✓	✓	✓	

- GENERAL NOTES**
- Flags attached to signs where shown, are REQUIRED.
  - All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
  - The CW3-4 "BE PREPARED TO STOP" sign may be installed after the CW20-4 "ONE LANE ROAD XXX FT" sign, but proper sign spacing shall be maintained.
  - Flaggers should use two-way radios or other methods of communication to control traffic.
  - Length of work space should be based on the ability of flaggers to communicate.
  - A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
  - Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space.
- TCP (2-2a)**
- The R1-2 "YIELD" sign traffic control may be used on projects with approaches that have adequate sight distance. For projects in urban areas, work space should be no longer than one half city block. In rural areas, roadways with less than 2000 ADT, work space should be no longer than 400 feet.
  - The R1-2aP "YIELD TO ONCOMING TRAFFIC" sign shall be placed on a support at a 7 foot minimum mounting height.
- TCP (2-2b)**
- Channelizing devices on the center line may be omitted when a pilot car is leading traffic and approved by the Engineer.
  - If the work space is located near a horizontal or vertical curve, the buffer distances should be increased in order to maintain stopping sight distance to the flagger and a queue of stopped vehicles. (See table above).
  - Flaggers should use 24" STOP/SLOW paddles to control traffic. Flags should be limited to emergency situations.

Texas Department of Transportation  
 Traffic Operations Division Standard

**TRAFFIC CONTROL PLAN  
 ONE-LANE TWO-WAY  
 TRAFFIC CONTROL**

**TCP (2-2) - 18**

FILE: tcp2-2-18.dgn	DN:	CK:	DW:	CK:
© TxDOT	REVISIONS	CON	SECT	JOB
8-95 3-03	0009	13	197, ETC	IH 30, ETC.
1-97 2-12	DIST	COUNTY	SHEET NO.	
4-98 2-18	PAR	HUNT, ETC.	60	

DATE: 4/18/2024 9:43:08 AM  
 FILE: t:\parr\trav\ashley\projects\safety lighting let\_8-24\STANDARDS\ed1-14.dwg  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**GENERAL NOTES FOR ALL ELECTRICAL WORK**

- The location of all conduits, junction boxes, ground boxes, and electrical services is diagrammatic and may be shifted to accommodate field conditions.
- Provide new and unused materials. Ensure that all materials and installations comply with the applicable articles of the National Electrical Code (NEC), TxDOT standards and specifications, National Electrical Manufacturers Association (NEMA), and are listed by Underwriters Laboratories (UL) or a Nationally Recognized Testing Lab (NRTL). NRTLs such as Canadian Standard Association (CSA), Intertek Testing Services NA Inc., or FM Approvals LLC can be considered equivalent to UL. Where reference is made to NEMA listed devices, International Electrotechnical Commission (IEC) listed devices will not be considered an acceptable equal to a NEMA listed device. Acceptable devices may have both a NEMA and IEC listing. Faulty fabrication or poor workmanship in any material, equipment, or installation is justification for rejection. Replace or reinstall rejected material or equipment at no additional cost to the Department.
- Miscellaneous nuts, bolts and hardware, except for high strength bolts, may be stainless steel when plans specify galvanized, provided the bolt size is 1/2 in. or less in diameter.
- Provide the following test equipment as required by the Engineer to confirm compliance with the contract and the NEC: voltmeter, ammeter, megohm meter (1000 volt DC), ground resistance tester, torque wrenches, and torque screwdrivers. Ensure all equipment has been properly calibrated within the last year. Provide calibration certification to the Engineer upon request. Operate test equipment during inspection as requested by the Engineer.
- Install grounding as shown on the plans and in accordance with the NEC. Ensure all metallic conduits; metal poles; luminaires; and metal enclosures are bonded to the equipment grounding conductor. Provide stranded bare copper or green insulated grounding conductors. Ground rods, connectors, and bonding jumpers are subsidiary to the various bid items.
- When required by the Engineer, notify the Department in writing of materials from the Material Producers List (MPL) intended for use on each project. Prequalified materials are listed on the MPL on TxDOT's website under "Roadway Illumination and Electrical Supplies." No substitutions will be allowed for materials on this list.

**CONDUIT**

**A. MATERIALS**

- Provide conduit, junction boxes, fittings, and hardware as per TxDOT Departmental Material Specification (DMS) 11030 "Conduit" and Item 618 "Conduit" of TxDOT's "Standard Specifications For Construction And Maintenance Of Highways, Streets, And Bridges," latest edition. Provide conduits listed under Item 618 on the MPL under "Roadway Illumination and Electrical Supplies." Provide conduit types according to the descriptive code or as shown on the plans. Do not substitute other types of conduits for those shown. Provide liquidtight flexible metal conduit (LFMC) when flexible conduit is called for on galvanized steel rigid metallic conduit (RMC) systems. Provide liquidtight flexible nonmetallic conduit (LFNC) when flexible conduit is called for on polyvinyl chloride (PVC) systems.
- Provide galvanized steel RMC for all exposed conduits, unless otherwise shown on the plans. Properly bond all metal conduits.
- Unless otherwise shown on the plans, provide junction boxes with a minimum size as shown in the following table, which applies to the greatest number of conductors entering the box through one conduit with no more than four conduits per box. When a mixture of conductor sizes is present, count the conductors as if all are of the larger size. For situations not applicable to the table, size junction boxes in accordance with NEC.


AWG	3 CONDUCTORS	5 CONDUCTORS	7 CONDUCTORS
#1	10" x 10" x 4"	12" x 12" x 4"	16" x 16" x 4"
#2	8" x 8" x 4"	10" x 10" x 4"	12" x 12" x 4"
#4	8" x 8" x 4"	10" x 10" x 4"	10" x 10" x 4"
#6	8" x 8" x 4"	8" x 8" x 4"	10" x 10" x 4"
#8	8" x 8" x 4"	8" x 8" x 4"	8" x 8" x 4"

- Junction boxes with an internal volume of less than 100 cu. in. and supported by entering raceways must have threaded entries or hubs identified for the intended purpose and supported by connection of two or more rigid metal conduits. Secure conduit within 3 ft. of the enclosure or within 18 in. of the enclosure if all conduit entries are on the same side. Mechanically secure all junction boxes with an internal volume greater than 100 cu. inches.
- Provide hot dipped galvanized cast iron or sand cast aluminum outlet boxes for junction boxes containing only 10 AWG or 12 AWG conductors. Do not use die cast aluminum boxes. Size outlet boxes according to the NEC.
- Do not use intermediate metal conduit (IMC) or electrical metallic tubing (EMT) unless specifically required by the plan sheets. When EMT is called for, provide junction boxes made from galvanized steel sheeting, listed and approved for outdoor use, unless otherwise noted on the plans. Size all galvanized steel junction boxes in accordance with the NEC. Provide junction boxes for IMC conduit systems that meet the same requirements for junction boxes used with RMC systems.
- Provide PVC junction boxes intended for outdoor use on PVC conduit systems, unless otherwise noted on the plans.

- Provide PVC elbows in PVC conduit systems, unless otherwise shown on the plans. Use only a flat, high tensile strength polyester fiber pull tape for pulling conductors through the PVC conduit system. When galvanized steel RMC elbows are specifically called for in the plans and any portion of the RMC elbow is buried less than 18 in., ground the RMC elbow by means of a grounding bushing on a rigid metal extension. Grounding of the rigid metal elbow is not required if the entire RMC elbow is encased in a minimum of 2 in. of concrete. PVC extensions are allowed on these concrete encased rigid metal elbows. RMC or PVC elbows are subsidiary to various bid items.
- When required, provide High-Density Polyethylene (HDPE) conduit with factory installed internal conductors according to Item 622 "Duct Cable." At the Contractor's request and with approval by the Engineer, substitute HDPE conduit with no conductors for bored schedule 40 or schedule 80 PVC conduit bid under Item 618. Ensure bored HDPE substituted for PVC is schedule 40 and of the same size PVC called for in the plans. Ensure the substituted HDPE meets the requirements of Item 622, except that the conduit is supplied without factory-installed conductors. Make the transition of the HDPE conduit to PVC (or RMC elbow when required) at the bore pit. Provide conduit of the size and schedule as shown on the plans. Do not extend substituted conduit into ground boxes or foundations. Provide PVC or galvanized steel RMC elbows as called for at all ground boxes and foundations.
- Use two-hole straps when supporting 2 in. and larger conduits. On electrical service poles, properly sized stainless steel or hot dipped galvanized one-hole standoff straps are allowed on the service riser conduit.

**B. CONSTRUCTION METHODS**

- Provide and install expansion joint conduit fittings on all structure-mounted conduits at the structure's expansion joints to allow for movement of the conduit. In addition, provide and install expansion joint fittings on all continuous runs of galvanized steel RMC conduit externally exposed on structures such as bridges at maximum intervals of 150 ft. When requested by the project Engineer, supply manufacturer's specification sheet for expansion joint conduit fittings. Repair or replace expansion joint fittings that do not allow for movement at no additional cost to the Department. Provide the method of determining the amount of expansion to the Engineer upon request. Do not use LFMC or LFNC as a substitute for the required expansion conduit fittings.
- Space all conduit supports at maximum intervals of 5 ft. Install conduit spacers when attaching metal conduit to surface of concrete structures. See "Conduit Mounting Options" on ED(2). Install conduit support within 3 ft. of all enclosures and conduit terminations.
- Do not attach conduit supports directly to pre-stressed concrete beams except as shown specifically in the plans or as approved by the Engineer.
- Unless otherwise shown on the plans, jack or bore conduit placed beneath existing roadways, driveways, sidewalks, or after the base or surfacing operation has begun. Backfill and compact the bore pits below the conduit per Item 476 "Jacking, Boring, or Tunneling Pipe or Box" prior to installing conduit or duct cable to prevent bending of the connections.
- When placing conduit in the sub-grade of new roadways, backfill all trenches with excavated material unless otherwise noted on the plans. When placing conduit in the sub-base of new roadways, backfill all trenches with cement-stabilized base as per requirements of Items 110 "Excavation", 400 "Excavation and Backfill for Structures", 401 "Flowable Backfill", 402 "Trench Excavation Protection", and 403 "Temporary Special Shoring."
- Provide and place warning tape approximately 10 in. above all trenched conduit as per Item 618.
- During construction, temporarily cap or plug open ends of all conduit and raceways immediately after installation to prevent entry of dirt, debris and animals. Temporary caps constructed of durable duct tape are allowed. Tightly fix the tape to the conduit opening. Clean out the conduit and prove it clear in accordance with Item 618 prior to installing any conductors.
- Ensure conduit entry into the top of any enclosure is waterproof by installing conduit sealing hubs or using boxes with threaded bosses. This includes surface mounted safety switches, meter cans, service enclosures, auxiliary enclosures and junction boxes. Grounding bushings on water tight sealing hubs are not required.
- Fit the ends of all PVC conduit terminations with bushings or bell end fittings. Provide and install a grounding type bushing on all metal conduit terminations.
- Install a bonding jumper from each grounding bushing to the nearest ground rod, grounding lug, or equipment grounding conductor. Ensure all bonding jumpers are the same size as the equipment grounding conductor. Bonding of conduit used as a casing under roadways for duct cable is not required, if the duct extends the full length through the casing.
- At all electrical services, install a 6 AWG solid copper grounding electrode conductor.
- Place conduits entering ground boxes so that the conduit openings are between 3 in. and 6 in. from the bottom of the box. See the ground box detail on sheet ED(4).
- Seal ends of all conduits with duct seal, expandable foam, or by other methods approved by the Engineer. Seal conduit immediately after completion of conductor installation and pull tests. Do not use duct tape as a permanent conduit sealant. Do not use silicone caulk as a conduit sealant.
- File smooth the cut ends of all mounting strut and conduit. Before installing, paint the field cut ends of all mounting strut and RMC (threaded or non-threaded) with zinc rich paint (94% or more zinc content) to alleviate overspray. Use zinc rich paint to touch up galvanized material as allowed under Item 445 "Galvanizing." Do not paint non-galvanized material with a zinc rich paint as an alternative for materials required to be galvanized.

				<b>Traffic Operations Division Standard</b>	
<h1>ELECTRICAL DETAILS CONDUITS &amp; NOTES</h1>					
<h2>ED(1) - 14</h2>					
FILE:	ed1-14.dgn	DWG:	CK:	DW:	CK:
© TxDOT	October 2014	CONT	SECT	JOB	HIGHWAY
REVISIONS		0009	13	197, ETC	IH 30, ETC.
		DIST	COUNTY		SHEET NO.
		PAR	HUNT, ETC.		61

**ELECTRICAL SERVICES NOTES**

- Provide new materials. Ensure installation and materials comply with the applicable provisions of the National Electrical Code (NEC) and National Electrical Manufacturers Association (NEMA) standards. Ensure material is Underwriters Laboratories (UL) listed. Provide and install electrical service conduits, conductors, disconnects, contactors, circuit breaker panels, and branch circuit breakers as shown on the Electrical Service Data chart in the plans. Faulty fabrication or poor workmanship in material, equipment, or installation is justification for rejection. Where manufacturers provide warranties and guarantees as a customary trade practice, furnish these to the State.
- Provide electrical services in accordance with Electrical Details standard sheets, Departmental Material Specification (DMS) 11080 "Electrical Services," DMS 11081 "Electrical Services-Type A," DMS 11082 "Electrical Services-Type C," DMS 11083 "Electrical Services-Type D," DMS 11084 "Electrical Services-Type T," DMS 11085 "Electrical Services-Pedestal (PS)", and Item 628 "Electrical Services" of the Standard Specifications. Provide electrical service types A, C, and D, as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies," Item 628. Provide other service types as detailed on the plans.
- Provide all work, materials, services, and any incidentals needed to install a complete electrical service as specified in the plans.
- Coordinate with the Engineer and the utility provider for metering and compliance with utility requirements. Primary line extensions, connection charges, meter charges, and other charges by the utility company to provide power to the location are paid for in accordance with Item 628. Get approval for the costs associated with these charges prior to engaging the utility company to do the work. Consult with the utility provider to determine costs and requirements, and coordinate the work as approved.
- The enclosure manufacturer will provide Master Lock Type 2 with brass tumblers keyed #2195 for all custom electrical enclosures. Installing Contractor is to provide Master Lock #2195 Type 2 with brass tumblers for "off the shelf" enclosures. Master Lock #2195 keys and locks become property of the State. Unless otherwise approved, do not energize electrical service equipment until locks are installed.
- Enclosures with external disconnects that de-energize all equipment inside the enclosure do not need a dead front trim. Protect incoming line terminations from incidental contact as required by the NEC.
- When galvanized is specified for nuts, screws, bolts or miscellaneous hardware, stainless steel may be used.
- Provide wiring and electrical components rated for 75°C. Provide red, black, and white colored XHHW service entrance conductors of minimum size 6 American Wire Gauge (AWG). Identify size 6 AWG conductors by continuous color jacket. Identify electrical conductors sized 4 AWG and larger by continuous color jacket or by colored tape. Mark at least 6 inches of the conductor's insulation with half laps of colored tape, when identifying conductors. Ensure each service entrance conductor exits through a separately bushed non-metallic opening in the weatherhead. The lengths of the conductors outside the weatherhead are to be 12 inches minimum, 18 inches maximum, or as required by utility.
- All electrical service conduit and conductors attached to the electrical service including the riser or the elbow below ground are subsidiary to the electrical service. For an underground utility feed, all service conduit and conductors after the elbow, including service conduit and conductors for the utility pole riser when furnished by the Contractor, will be paid for separately.
- Provide rigid metal conduit (RMC) for all conduits on service, except for the 1/2 in. PVC conduit containing the electrical service grounding electrode conductor. Size the service entrance conduit as shown in the plans. Ensure conduit for branch circuit entry to enclosure is the same size as that shown on the layout sheets for branch circuit conduit. Extend all rigid metal conduits a minimum of 6 inches underground and then couple to the type and schedule of the conduit shown on the layout for that particular branch circuit. Install a grounding bushing on the RMC where it terminates in the service enclosure.
- Use of liquidtight flexible metal conduit (LFMC) is allowed between the meter and service enclosure when they are mounted 90 to 180 degrees to each other. Size the LFMC the same size as service entrance conduit. LFMC must not exceed 3 feet in length. Strap LFMC within 1 foot of each end. LFMC less than 12 inches in length need not be strapped. Each end of LFMC must have a grounding bushing or be terminated with a grounding fitting. The LFMC must contain a grounded (neutral) conductor. Ensure any bend in LFMC never exceeds 180 degrees. A pull test is required on all installed conductors, with at least six inches of free conductor movement demonstrated to the satisfaction of the Engineer.
- Ensure all mounting hardware and installation details of services conform to utility company specifications.
- For all electrical service enclosures listed under Item 628 on the MPL, the UL 508 enclosure manufacturers will prepare and submit a schematic drawing unique to each service. Before shipment to the job site, place the applicable laminated schematic drawings and the laminated plan sheet showing the electrical service data chart used to build the enclosure in the enclosure's data pocket. The installing contractor will copy and laminate the actual project plan sheets detailing all equipment and branch circuits supplied by that service. The laminated plan sheets are to be placed in the service enclosure's document pocket. Reduce 11 in. x 17 in. plan sheets to 8 1/2 in. x 11 in. before laminating. If the installation differs from the plan sheets, the installing contractor is to redline plan sheets before laminating.
- When providing an "Off The Shelf" Type D or Type T service, provide laminated plan sheets detailing equipment and branch circuits supplied by that service. Reduce 11 in. x 17 in. plan sheets to 8 1/2 in. x 11 in. before laminating. Deliver these drawings before completion of the work to the Engineer, instead of placing in enclosure that has no door pocket.
- Do not install conduit in the back wall of a service enclosure where it would penetrate the equipment mounting panel inside the enclosure. Provide grounding bushings on all metal conduits, and terminate bonding jumpers to grounding bus. Grounding bushings are not required when the end of the metal conduit is fitted with a conduit sealing hub or threaded boss, such as a meter base hub.

**SERVICE ASSEMBLY ENCLOSURE**

- Provide threaded hub for all conduit entries into the top of enclosure.
- Type galvanized steel (GS) enclosures may be used for Type C panelboards and for Type D and T services that do not use an enclosure mounted photoceII or lighting contactor. Provide GS enclosures in accordance with DMS 11080, 11082, 11083, and 11084.
- Provide aluminum (AL) and stainless steel (SS) enclosures for Types A, C, and D in accordance with DMS 11080, 11081, 11082, 11083, and 11084. Do not paint stainless steel.
- Provide pedestal service (PS) enclosures in accordance with ED(9) and DMS 11080 and 11085. Do not provide GS pedestal services. If GS is shown in the PS descriptive code, provide an AL enclosure.

**MAIN DISCONNECT & BRANCH CIRCUIT BREAKERS**

- Field drill flange-mounted remote operator handle if needed, to ensure handle is lockable in both the "On" and "Off" positions.
- When the utility company provides a transformer larger than 50 KVA, verify that the available fault current is less than the circuit breaker's ampere interrupting capacity (AIC) rating and provide documentation from the electric utility provider to the Engineer.



**PHOTOELECTRIC CONTROL**

- Provide photocell as listed on the MPL. Move, adjust, or shield the photocell from stray or ambient night time light to ensure proper operation. Mount photocell facing north when practical. Mount top of pole photocells as shown on Top Mounted Photocell Detail.

* ELECTRICAL SERVICE DATA												
Elec. Service ID	Plan Sheet Number	Electrical Service Description	Service Conduit *xSize	Service Conductors No./Size	Safety Switch Amps	Main Ckt. Bkr. Pole/Amps	Two-Pole Contractor Amps	Panelbd/ Loadcenter Amp Rating	Branch Circuit ID	Branch Ckt. Bkr. Pole/Amps	Branch Circuit Amps	KVA Load
SB 183	289	ELC SRV TY A 240/480 100(SS)AL(E)SF(U)	2"	3/#2	100	2P/100	100	N/A	Lighting NB	2P/40	26	28.1
									Lighting SB	2P/40	25	
									Underpass	1P/20	15	
NB Access	30	ELC SRV TY D 120/240 060(NS)SS(E)TS(O)	1 1/4"	3/#6	N/A	2P/60		100	Sig. Controller	1P/30	23	5.3
							30		Luminaires	2P/20	9	
									CCTV	1P/20	3	
2nd & Main	58	ELC SRV TY T 120/240 000(NS)GS(N)SP(O)	1 1/4"	3/#6	N/A	N/A	N/A	70	Flashing Beacon 1	1P/20	4	1.0
									Flashing Beacon 2	1P/20	4	

\* Example only, not for construction. All new electrical services must have electrical service data chart specific to that service as shown in the plans.  
 \*\* Verify service conduit size with utility. Size may change due to utility meter requirements. Ensure conduit size meets the National Electrical Code.

**EXPLANATION OF ELECTRICAL SERVICE DESCRIPTIVE CODE**

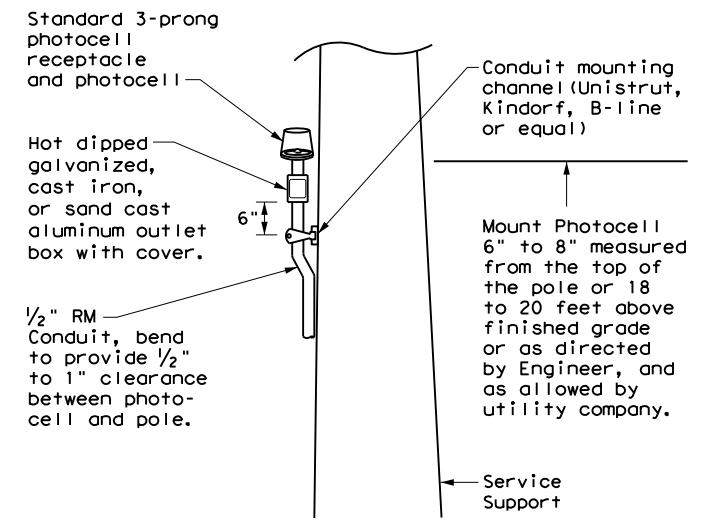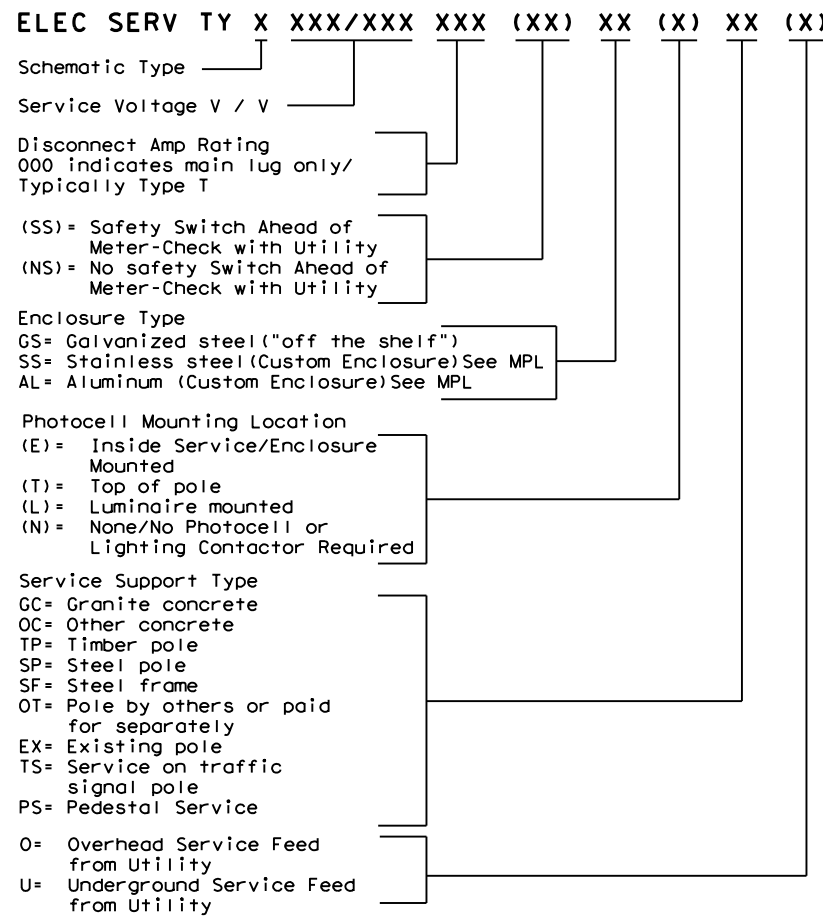

**TOP MOUNTED PHOTOCELL**

Install conduit strap maximum 3 feet from box. 5 foot maximum spacing between straps supporting conduit.

Texas Department of Transportation Traffic Operations Division Standard

**ELECTRICAL DETAILS SERVICE NOTES & DATA**

**ED(5) - 14**


FILE: ed5-14.dgn	DWG: TxDOT	CHK: TxDOT	DWG: TxDOT	CHK: TxDOT	
© TxDOT October 2014		CONT	SECT	JOB	HIGHWAY
REVISIONS		0009 13	197, ETC IH 30, ETC.		
DIST	COUNTY	SHEET NO.			
PAR	HUNT, ETC.	62			

DATE: 4/18/2024 9:43:11 AM  
 FILE: t:\par\traf\ashley\projects\safety lighting let\_8-24\STANDARDS\eds-14.dgn  
 The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.




DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/18/2024 9:43:13 AM  
 FILE: t:\parr\ashley\projects\safety lighting let\_8-24\STANDARDS\ed6-14.dgn

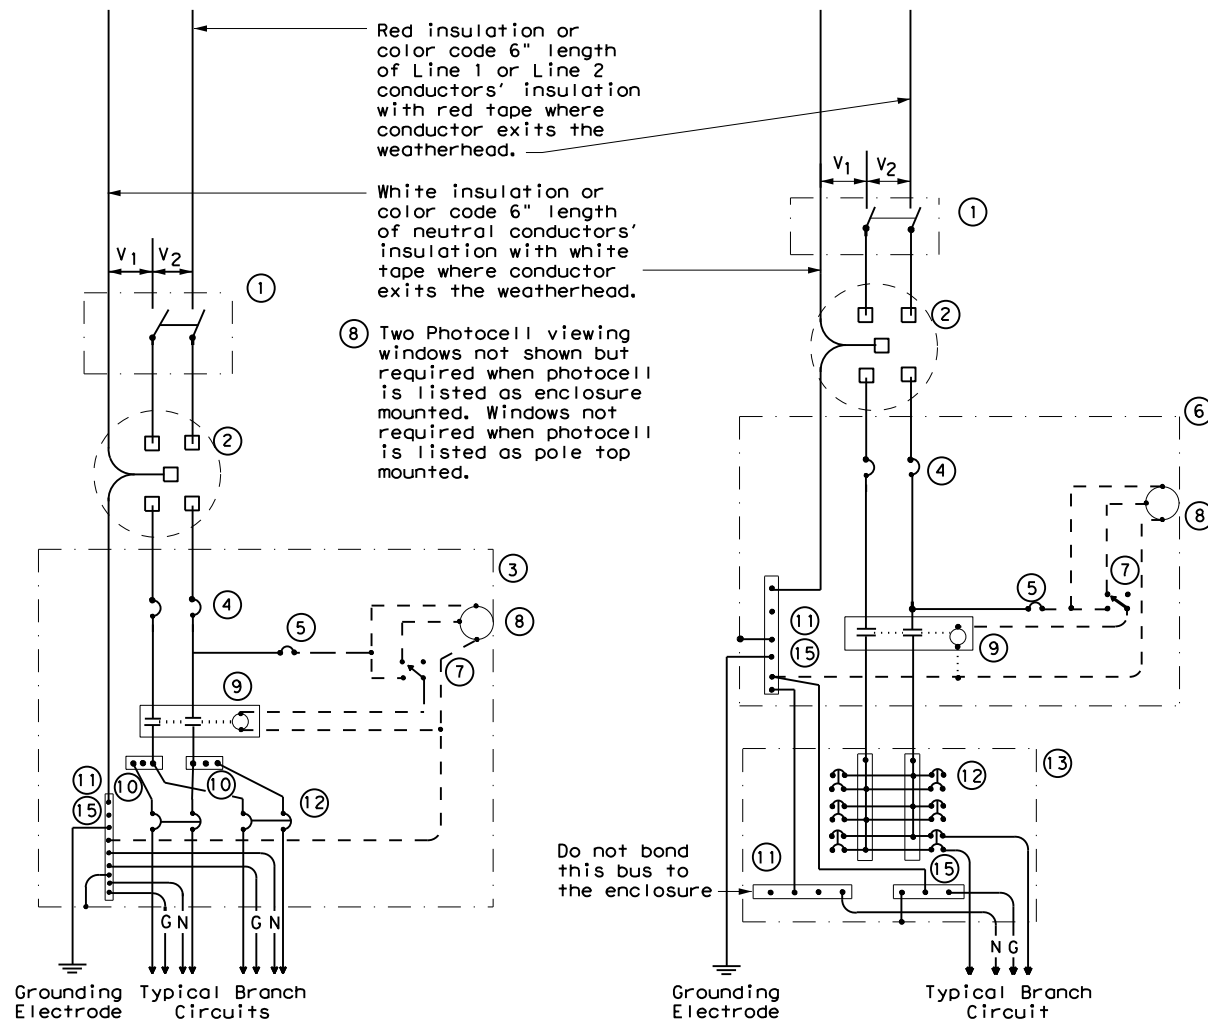

**SCHEMATIC TYPE A  
THREE WIRE**

**SCHEMATIC TYPE C  
THREE WIRE**

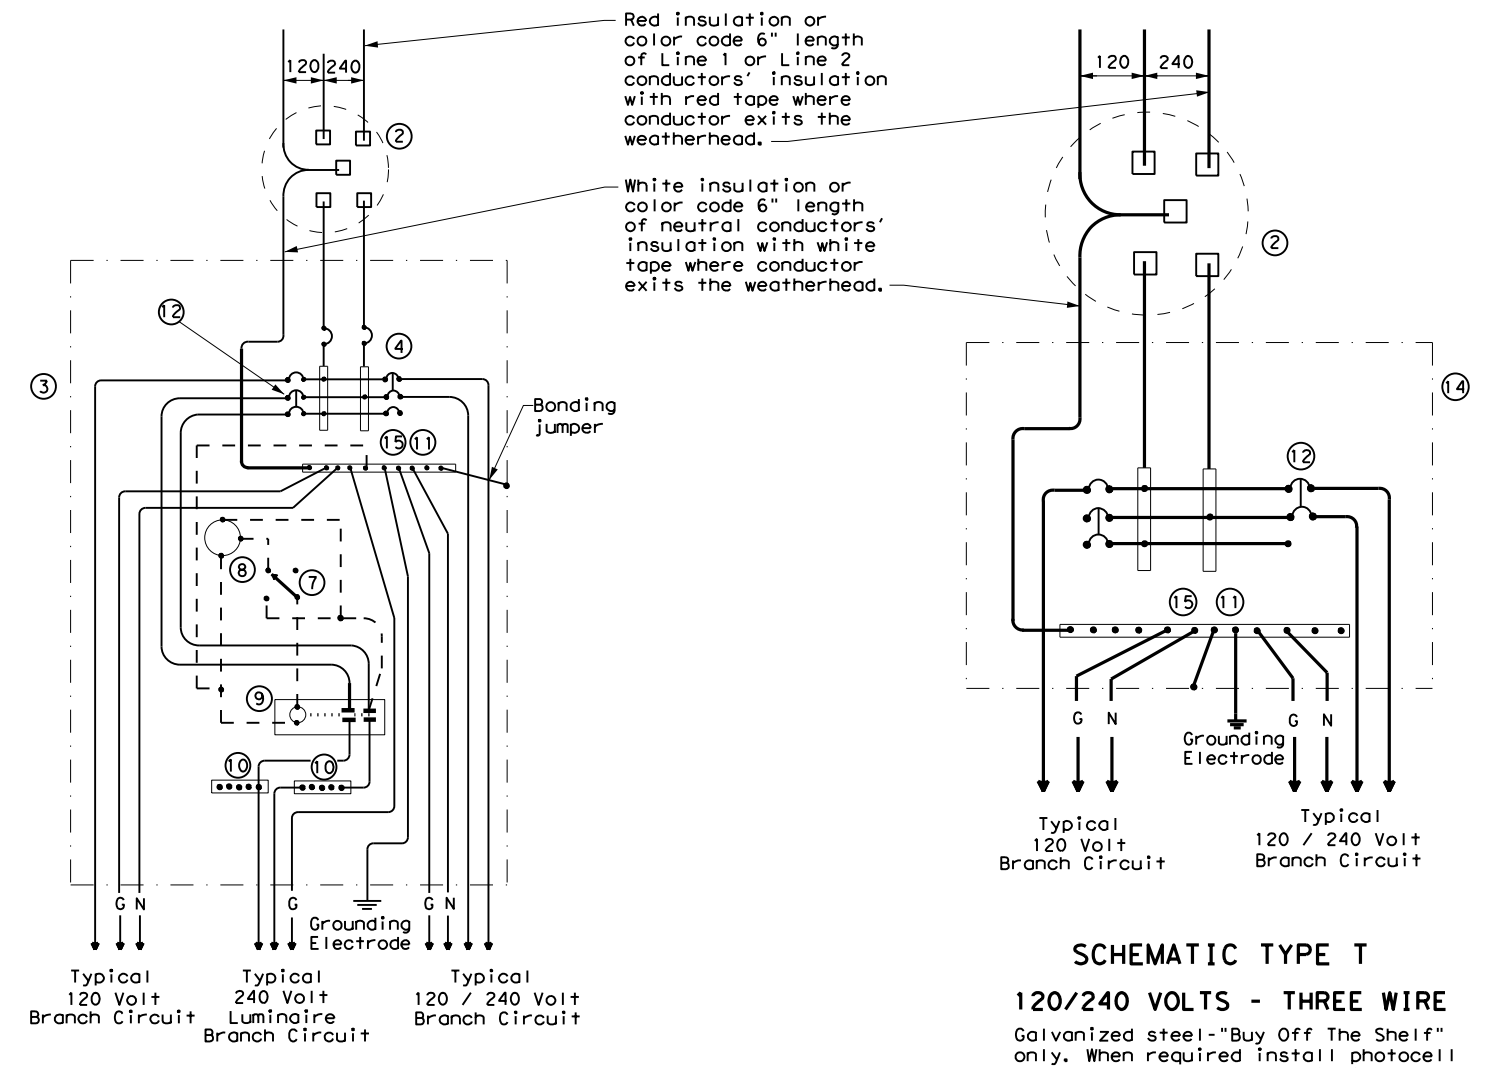

**SCHEMATIC TYPE D - CUSTOM  
120/240 VOLTS - THREE WIRE**

**SCHEMATIC TYPE T  
120/240 VOLTS - THREE WIRE**  
 Galvanized steel-"Buy Off The Shelf" only. When required install photocell top of the pole or on luminaire only, no lighting contractor will be installed.

WIRING LEGEND	
—	Power Wiring
- - -	Control Wiring
—N—	Neutral Conductor
—G—	Equipment grounding conductor-always required

SCHEMATIC LEGEND	
1	Safety Switch (when required)
2	Meter (when required-verify with electric utility provider)
3	Service Assembly Enclosure
4	Main Disconnect Breaker (See Electrical Service Data)
5	Circuit Breaker, 15 Amp (Control Circuit)
6	Auxiliary Enclosure
7	Control Station ("H-O-A" Switch)
8	Photo Electric Control (enclosure-mounted shown)
9	Lighting Contactor
10	Power Distribution Terminal Blocks
11	Neutral Bus
12	Branch Circuit Breaker (See Electrical Service Data)
13	Separate Circuit Breaker Panelboard
14	Load Center
15	Ground Bus

		Traffic Operations Division Standard	
<b>ELECTRICAL DETAILS SERVICE ENCLOSURE AND NOTES</b>			
<b>ED(6) - 14</b>			
FILE: ed6-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT
© TxDOT October 2014	CONT	SECT	JOB
REVISIONS	0009 13	197, ETC	IH 30, ETC.
DIST	COUNTY	SHEET NO.	
PAR	HUNT, ETC.	63	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/18/2024 9:43:15 AM  
 FILE: t:\par\tr\ashley\projects\safety\lighting\let\_8-24\STANDARDS\ed7-14.dgn

**SUPPORT TYPE STEEL POLE (SP) AND STEEL FRAME (SF)**

1. Provide steel pole and steel frame supports as per TxDOT Departmental Material Specification (DMS)11080 "Electrical Services." Mount all equipment and conduit on 12 gauge galvanized steel or stainless steel channel strut, 1 1/2 in. or 1 3/8 in. wide by 1 in. up to 3 3/4 in. deep Unistrut, Kindorf, B-line or equal. Bolt or weld all channel and hardware to vertical members as approved. Do not stack channel. File smooth and paint field cut ends of all channel with zinc-rich paint before installing.
2. Provide poles for overhead service with an eyebolt or similar fitting for attachment of the service drop to the pole in conformance with the electric utility provider's specifications.
3. Provide and install galvanized 3/4 in. x 18 in. x 4 in. (dia. x length x hook length) anchor bolts for underground service supports. Provide and install galvanized 3/4 in. x 56 in. x 4 in. anchor bolts for overhead service supports. Ensure anchor bolts have 3 in. of thread, with 3 1/4 in. to 3 1/2 in. of the exposed anchor bolt projecting above finished foundation. Provide and install leveling nuts for all anchor bolts.
4. Bond one of the anchor bolts to the rebar cage with 6 AWG bare stranded copper conductor. Use listed mechanical connectors rated for embedment in concrete. See Inset B.
5. Furnish and install rigid metallic ellis in all steel pole and steel frame foundations for all conduits entering the service from underground.
6. Use class C concrete for foundations. Ensure reinforcing steel is Grade 60 with 3" of unobstructed concrete cover.
7. Drill and tap steel poles and frames for 1/2 in. X 13 UNC tank ground fitting. For steel pole service supports, provide and install tank ground fitting 4 in. to 6 in. below electrical service enclosure. Provide properly sized hole through the bottom of the enclosure for the service grounding electrode conductor. Ensure electrical service grounding electrode conductor is as short and straight as possible from the enclosure to the tank ground fitting. For steel frame service supports, provide and install tank ground fitting on steel frame post. Install service grounding electrode conductor in a non-metallic conduit or tubing from the enclosure to the steel frame post. Connect electrical service grounding electrode conductor to the tank ground fitting. See steel frame and steel pole details and Inset A for more information. Size service entrance conduit and branch circuit conduit as shown in the plans. For underground conduit runs from the electrical service, extend RMC from the service enclosure to an RMC elbow, and then connect the schedule type and size of conduit shown in the plans. Provide and install grounding bushings where RMC terminates in the enclosure. Grounding bushings are not required when RMC is fitted into a sealing hub or threaded boss.
8. If Steel pole or frame is painted, bond each separate painted piece with a bonding jumper attached to a tapped hole.
9. Provide 1/4" - 20 machine screws for bonding. Do not use sheet metal screws. Remove all non-conductive material at contact points. Terminate bonding jumpers with listed devices. Install minimum size 6 AWG stranded copper bonding jumpers. Make up all threaded bonding connections wrench tight.
10. Avoid contact of the service drop and service entrance conductors with the metal pole to prevent abrasion of the insulated conductors.
11. Shop drawings are not required for service support structure unless specifically stated elsewhere or directed by the Engineer.

White insulation or color code 6" of neutral conductor's insulation with white tape where conductor exits weatherhead.

Red insulation or color code 6" length of Line 1 or Line 2 conductor's insulation with red tape where conductor exits the weatherhead. Conductor slack length, 12" min., 18" max.

2" to 6" 4" (typ.)

RMC

Service Enclosure

Inset A

Channel bracket or other arrangement approved by the Engineer. (Kindorf, Unistrut, B-line or equal.)

Inset A

Inset B

60" TYP.

2"

18" Min.

Class "C" concrete



RMC

PVC

24 Dia. x 60" depth foundation 4-#5 reinforcing bars and #2 spiral (typ.) at 6" pitch

WITH SAFETY SWITCH  
WITHOUT SAFETY SWITCH  
**SERVICE SUPPORT TYPE SP (O) - OVERHEAD SERVICE**

Drill, tap, and thread 1/2" X 13 UNC. Install tank ground fitting, connect electrical service grounding electrode conductor. See Note 7.

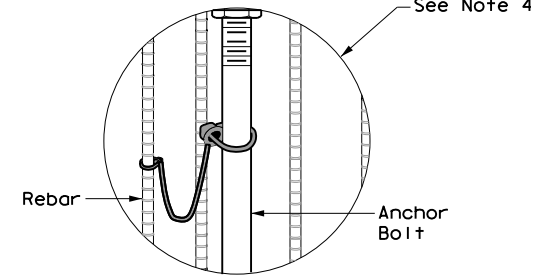

Safety switch (when required)

3' max.

2"

60" (typ.)

18" Min.

RMC to utility


24" dia. x 36" depth foundation 4-#5 reinforcing bars and #2 spiral (typ.) at 6" pitch

RMC



PVC

WITH SAFETY SWITCH


**SERVICE SUPPORT TYPE SP(U) - UNDERGROUND SERVICE**

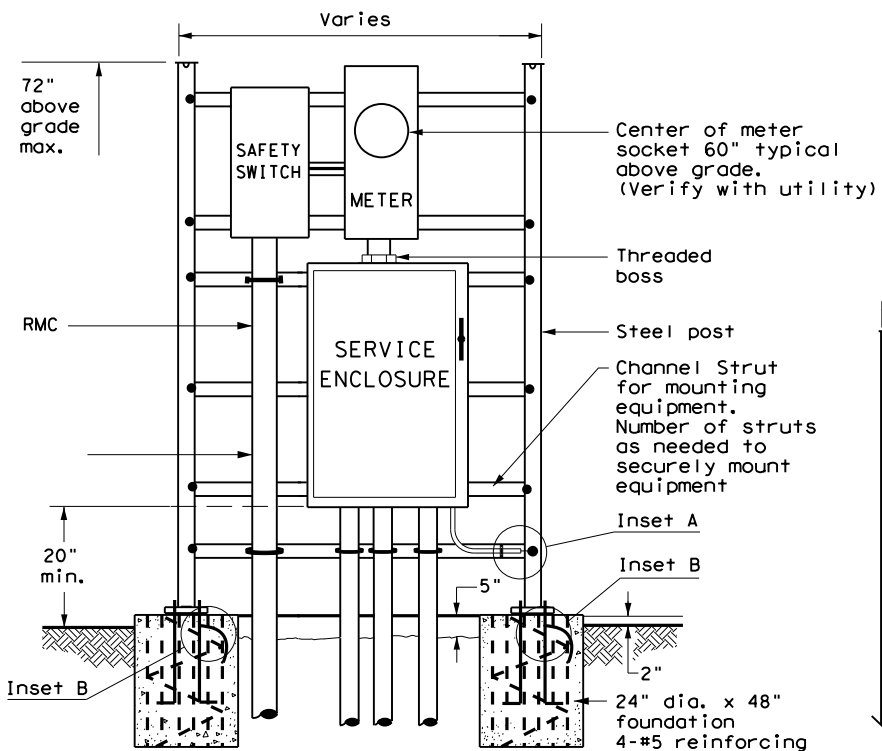


WITH SAFETY SWITCH  
WITHOUT SAFETY SWITCH  
**SERVICE SUPPORT TYPE SF (U) - UNDERGROUND SERVICE**

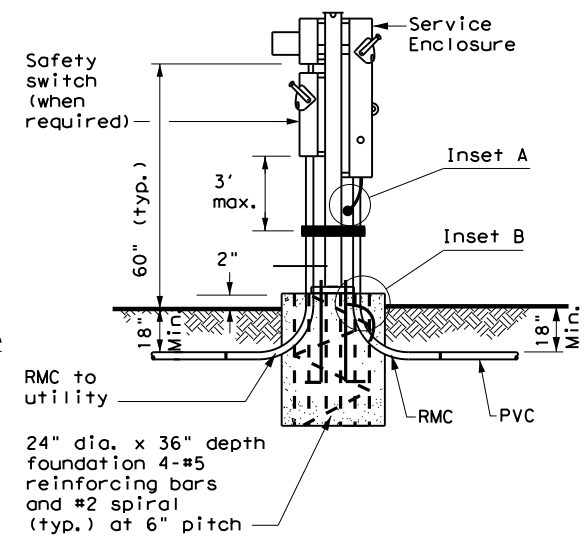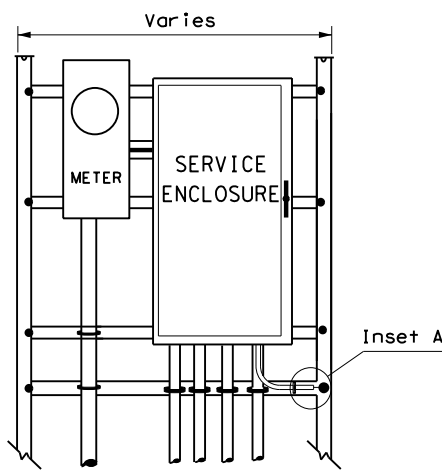


**HOOKED ANCHOR DETAIL**

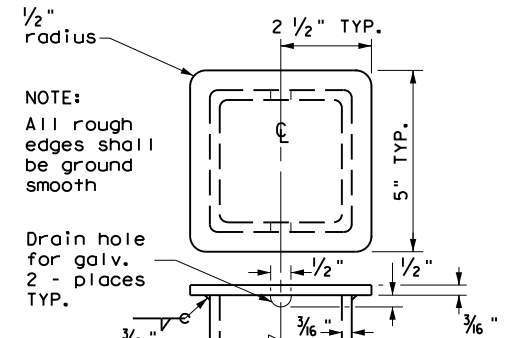

**POLE TOP PLATE**

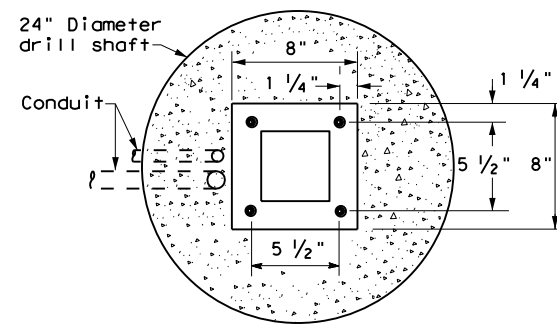


**BASE PLATE DETAIL**

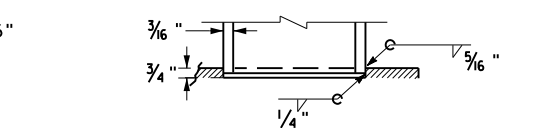

**BOTTOM OF POLE**

**SERVICE SUPPORT TYPE SF & SP**

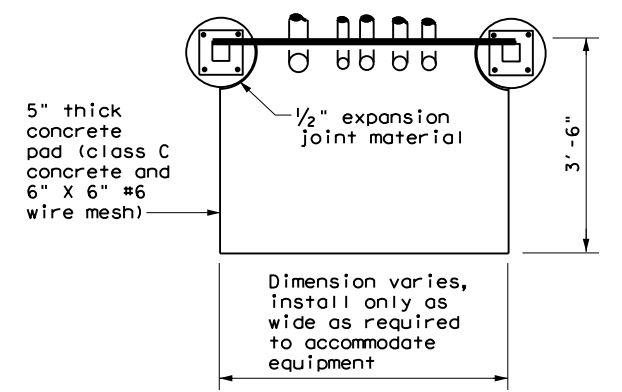

**TOP VIEW  
SERVICE SUPPORT TY SF (O) & SF (U)**

		<b>Traffic Operations Division Standard</b>	
<b>ELECTRICAL DETAILS SERVICE SUPPORT TYPES SF &amp; SP ED(7)-14</b>			
FILE: ed7-14.dgn	DWG: TxDOT	CHK: TxDOT	DWG: TxDOT
©TxDOT October 2014	CON: 13	SECT: 197	HIGHWAY: ETC.
REVISIONS	0009	JOB: IHC	IH 30, ETC.
DIST: PAR	COUNTY: HUNT, ETC.	SHEET NO. 64	

# ROADWAY ILLUMINATION ASSEMBLY NOTES

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

1. Details apply to roadway lighting installations bid or referenced under Item 610, "Roadway Illumination Assemblies." Provide, furnish, and install all other materials not shown on the plans which may be necessary for complete and proper construction. Where manufacturers provide warranties or guarantees as a customary trade practice, furnish to the State such warranties or guarantees.
2. The locations of poles and fixtures may be shifted by the Engineer to accommodate local conditions. Install or remove poles and luminaires located near overhead electrical lines using established industry and utility safety practices and in accordance with laws governing such work. Consult with the appropriate utility company prior to beginning such work.
3. Provide new and unused materials. Ensure that all materials and installations comply with the applicable articles of the National Electrical Code (NEC), TxDOT standards and specifications, National Electrical Manufacturers Association (NEMA), and are listed by Underwriters Laboratories (UL) or a Nationally Recognized Testing Lab (NRTL). NRTLs such as Canadian Standard Association, Intertek Testing Services NA Inc., or FM Approvals LLC can be considered equivalent to UL. Faulty fabrication or poor workmanship in any material, equipment, or installation is justification for rejection.
4. Provide Roadway Illumination Light Fixtures as per TxDOT Departmental Material Specification (DMS) 11010, Item 610, and as shown on the Material Producers List (MPL) for Roadway Illumination and Electrical Supplies.
5. Fabricate steel roadway illumination poles in accordance with Roadway Illumination Poles (RIP) standards and Item 610. Poles fabricated according to RIP standards do not require shop drawing submittals.
  - a. Alternate designs to RIP standards or the use of aluminum to fabricate poles will require the submission of shop drawings electronically. For instructions on submitting shop drawings electronically see "Guide to Electronic Shop Drawing Submittal" on the TxDOT web site.
  - b. Limitations on use of the RIP standard: The RIP standard details were developed for installations in locations where the 3-second gust basic maximum wind speed is 110 mph, and where the elevation of the base of the pole is less than (i.e. not more than) 25' above the elevation of the surrounding terrain, in accordance with the "AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals," 6th Edition (2013) of the AASHTO Design Specifications. For poles to be installed in regions where the maximum basic wind speed exceeds 110 mph or to be mounted more than 25' above the surrounding terrain, provide poles meeting the following requirements:
    - i. Submittals. Following the electronic shop drawing submittal process (see Guide to Electronic Shop Drawing Submittal on the TxDOT web site), submit to the Engineer for approval fabrication drawings and calculations for the poles, sealed by a Texas licensed professional engineer (P.E.).
    - ii. Luminaire Structural Support Requirements. Provide light poles, arms, and anchor bolt assemblies with a 25 year design life to safely resist dead loads, ice loads and the required basic wind speeds at the location of installation in accordance with the 6th edition (2013) of the AASHTO Design Specifications. For transformer base poles, include transformer base and connecting hardware in calculations and shop drawing submittals. Structurally test all transformer bases to resist the theoretical plastic moment capacity of the pole. Submit certification of the plastic moment load test and FHWA breakaway requirement test of the model of base being furnished with the shop drawings. Show breakaway base model number, manufacturer's name, and logo on shop drawings. Include on manufacturer's shop drawings the ASTM designations for all materials to be used.
6. For both transformer and shoe-base type illumination poles, provide and install double-pole breakaway fuse holders as specified by DMS-11040. Breakaway fuse holders are listed on the MPL for Roadway Illumination and Electrical Supplies under Items 610 & 620. Provide 10 amp time delay fuses for breakaway connectors in light poles, or inside the light fixture for underpass luminaires. In each pole, connect luminaires to the breakaway connector with continuous stranded 12 AWG copper conductors as listed on the MPL. Bond all equipment grounding conductors together and to the ground lug in the transformer base or hand hole.
7. Tighten anchor bolts for shoe base, concrete traffic barrier base, and bridge mount roadway illumination poles, in accordance with Item 449.
8. Install T-Base with following procedure:
  - a. Anchor Bolt Tightening.
    - i. Coat the threads of the anchor bolts with electrically conductive lubricant.
    - ii. Place the T-base over the anchor bolts. Foundation must be level and flat. The maximum permissible gap under any one corner of the t-base is 1/8" before nuts are tightened.
    - iii. Coat the bearing surfaces of the nuts and washers with electrically conductive lubricant. Install (1) 1/2" hold down washer, (1) lock washer, and (1) nut on each anchor bolt. Turn the nuts onto the bolts so that each is hand-tight against the washer.
    - iv. Using a torque wrench, tighten each nut to 150 ft-lb. Uniform contact is required between the foundation and the T-base in the corner regions of the T-base, and all corner gaps must be closed after applying torque. If a gap still exists after torquing to 150 ft-lbs, continue torquing each bolt incrementally until gap is closed or maximum allowable torque of 250 ft. pound is reached, whichever comes first. If 250 ft-lbs is not enough to close the gap the foundation must be leveled. Gaps along the straight sides of the T-bases and the foundation are permissible. Ensure that no high point of contact occurs between the straight sides of the T-base and the foundation.
    - v. Check top of T-base for level. If not level then foundation must be leveled.
  - b. Top Bolt Procedure
    - i. Erect pole over T-base with crane. Coat bolts, nuts, washers, and lock washers with electrically conductive lubricant.


- ii. Install bolts and 1/2" connecting washers from the inside of the T-base, thread up through the pole base. Install flat washers, lock washers and nuts snug tight according to Item 447, "Structural Bolting."
  - iii. Tighten each nut to 150 ft-lb. using a torque wrench.
- c. Level and Plumb
- i. Ensure pole is plumb and mast arm is perpendicular to the roadway according to plans to within 5 degrees.
9. Construct luminaire pole foundations in accordance with Item 416, "Drilled Shaft Foundations," and TxDOT standard sheet RID(2).
  10. Provide and install underpass luminaires in accordance with Item 610, DMS-11010, and TxDOT standard sheet RID(3). Typical luminaire size for underpass luminaires is 150W HPS or 150W EQ LED.
  11. Mount luminaires on arms level as shown by the luminaire level indicator.
  12. Orient luminaires perpendicular to the roadway intended to be lit unless otherwise shown on the plans.

## Wiring Diagram Notes:

- ① Use 1/2 in. -13 UNC threaded, copper or tin-plated copper, pole bonding connector, sized appropriately for conductors, bonded to T-base, or use ground lug in handhole as available.
- ② Use pre-qualified two-pole breakaway connectors for all luminaire pole installations. For luminaires fed by a circuit with a neutral conductor, use double pole breakaway connectors with the neutral side unfused and marked white.
- ③ Split Bolt or other connector.


## Decorative LED Lighting Notes:

1. LED Drivers in Remote Outdoor enclosures (for drivers that do not include an enclosure as part of a factory assembly):
  - a. Provide NEMA 3R outdoor enclosure or as approved.
  - b. Install enclosure at least 12" above ground or other horizontal surface. Mount vertically or on ceiling, and avoid direct sun where possible.
  - c. Install drivers with at least 2 inches of space from enclosure walls.
  - d. For multiple drivers in an enclosure, provide at least 4 inches side to side and 1 inch end to end from other drivers or electronic equipment
  - e. For drivers mounted on back wall of enclosure, mount enclosure on 1 5/8" strut or other standoff to dissipate heat, or mount driver to side of the enclosure or to the metal cover.
  - f. Provide remote drivers with a maximum of 100 watts
  - g. Provide drivers with documentation of 100,000 hr lifetime at Tcase of 65C or higher.

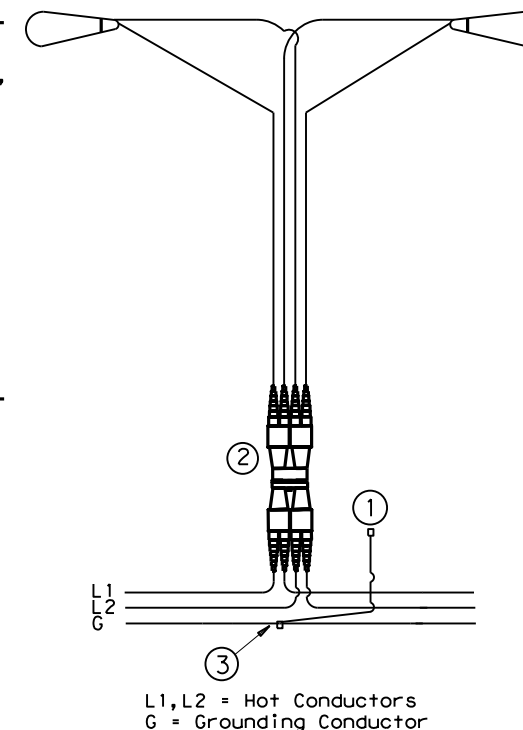

## TYPICAL WIRING DIAGRAM

LUMINAIRES SERVED AT 480V ON 240/480 VOLT SERVICE OR LUMINAIRES SERVED AT 240V FOR 120/240 VOLT SERVICE.

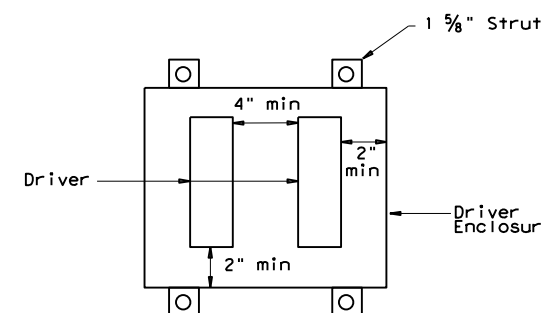


Driver Spacing In Remote Enclosure


		Traffic Safety Division Standard	
<h1>ROADWAY ILLUMINATION DETAILS</h1> <h2>RID(1)-20</h2>			
FILE:	rid1-20.dgn	DN:	CK:
© TxDOT	January 2007	CONT	SECT
REVISIONS		0009	13
		197, ETC	IH 30, ETC.
7-17		DIST	COUNTY
12-20		PAR	HUNT, ETC.
			SHEET NO.
			65

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/18/2024 9:43:20 AM  
 FILE: t:\paratraf\ashley\projects\safety lighting let\_8-24\STANDARDS\RID-20.dgn

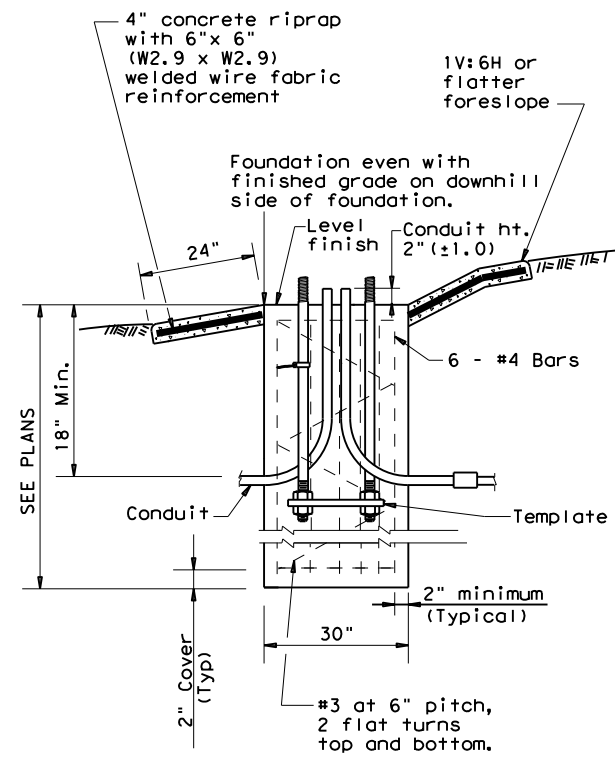

**SECTION A-A**  
SHOWING SLOPED GRADE

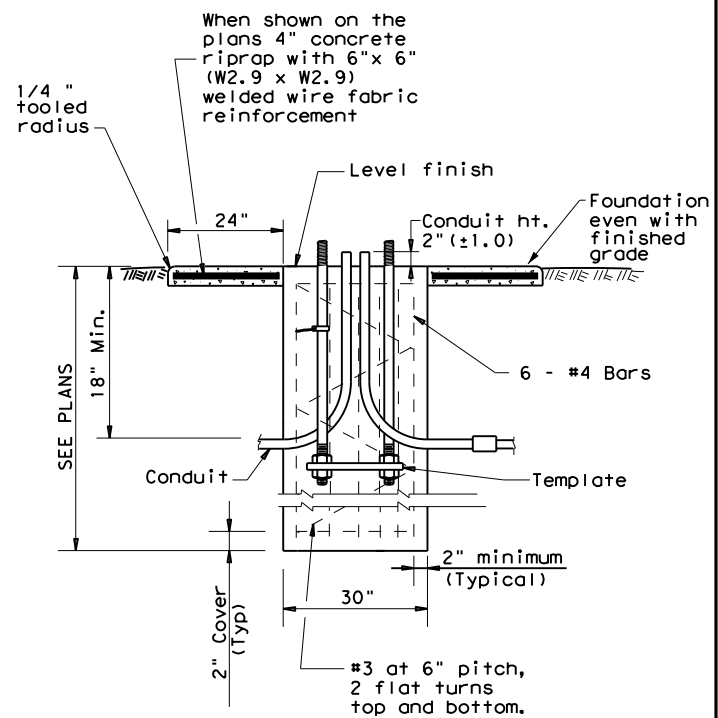

**SECTION A-A**  
SHOWING CONSTANT GRADE

**TABLE 1**

**ANCHOR BOLTS**

POLE MOUNTING HEIGHT	BOLT CIRCLE		ANCHOR BOLT SIZE
	Shoe Base	T-Base	
<40 ft.	13 in.	14 in.	1 in. x 30 in.
40-50 ft.	15 in.	17 1/4 in.	1 1/4 in. x 30 in.

**TABLE 2**

**RECOMMENDED FOUNDATION LENGTHS**  
(See note 1)

MOUNTING HEIGHT	TEXAS CONE PENETROMETER N Blows/ft		
	10	15	40
<20 ft.	6'	6'	6'
>20 ft. to 30 ft.	8'	6'	6'
>30 ft. to 40 ft.	8'	8'	6'
>40 ft. to 50 ft.	10'	8'	6'


**TABLE 3**

**PAY QUANTITY OF RIPRAP PER FOUNDATION**  
(Install only when shown on the plans)


Foundation Diameter	RIPRAP DIAMETER	RIPRAP (CONC) (CL B)
30 in.	78 in.	0.35 CY

**GENERAL NOTES:**

1. "Recommended Foundation Lengths" table is for information purposes only. Foundation lengths shall be as shown on the plans, or as directed by the Engineer. Foundations will be paid for under Item 416, "Drilled Shaft Foundations," unless otherwise shown on the plans.
2. Erect roadway illumination assembly poles plumb and true. Form and level the top 6" of the foundation so the pole will be plumb. Use leveling nuts to plumb shoe base poles. Do not use shims or leveling nuts under transformer bases. Do not grout between baseplate and the foundation.
3. Ensure Class 2A and 2B fit for anchor bolts and nuts. Tap and chase nuts after galvanizing. Anchor bolt body with rolled threads need not be full size.
4. Use appropriate class of concrete as specified in Items 416 and 432. Concrete for riprap may be upgraded to Class C at no extra cost to the Department.
5. Place riprap around the foundation when called for elsewhere in the plans. Riprap will be paid for under Item 432.
6. Locate breakaway roadway illumination assemblies as shown in the placement table, unless otherwise dimensioned on the plans. Protect non-breakaway illumination assemblies from vehicular impact (i.e. 2.5 ft. behind guard rail or mounted on traffic barrier), or located outside the clear zone, except that 2.5 ft. from curb face is minimum desired for light poles on city streets, 45 mph or less. See Roadway Design Manual for further information.
7. Use 4 hold down and 4 connecting washers on transformer base poles as recommended by the manufacturer and supplied with base.
8. Install a minimum of 2 conduits in each foundation. See lighting layout sheets for locations of foundations with more than 2 conduits. Cap unused conduits in foundations on both ends.
9. Conduit location in foundations is critical for breakaway devices. Place conduits 2 in. apart on centerline as shown.
10. Bond anchor bolt to rebar cage with #6 bare stranded copper conductor. Use listed mechanical connectors rated for embedment in concrete. The bonded steel in the foundation creates a concrete encased grounding electrode which replaces the ground rod.
11. Grade earthwork around T-base foundations even with the finished grade as shown in Section A-A to ensure proper function of the breakaway device. Use riprap on T-base foundations that are located on sloped grades, and as shown on the plans for level grades.

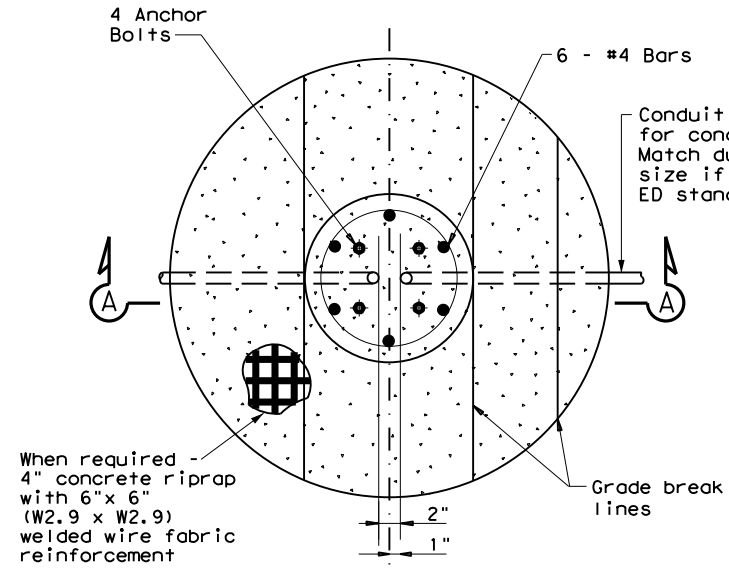

**FOUNDATION DETAIL**

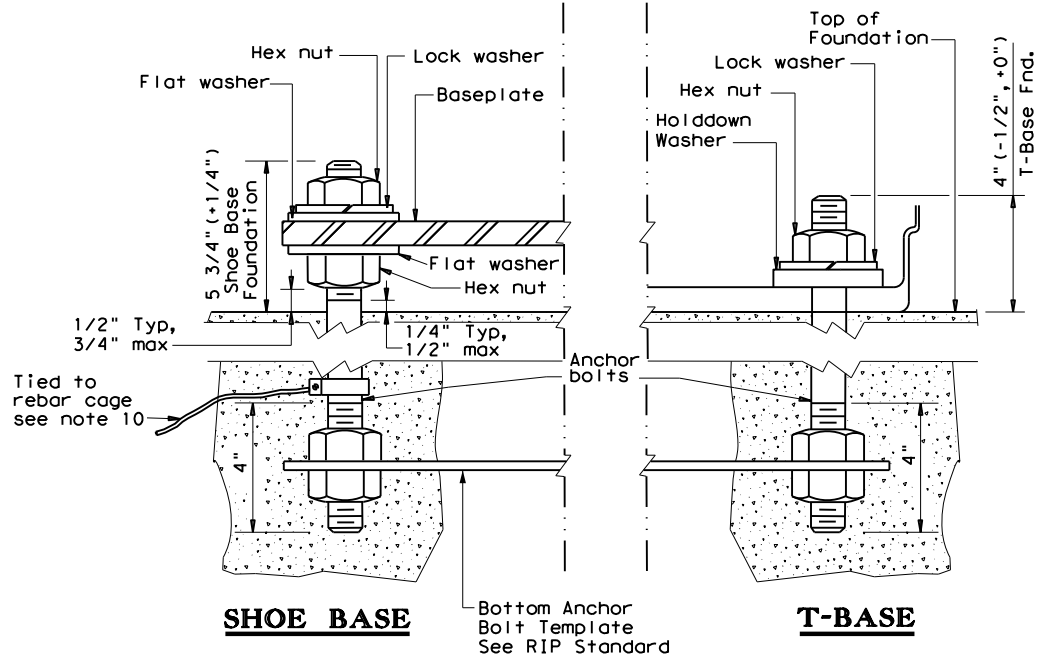

**ANCHOR BOLT DETAIL**

**TABLE 4**

**BREAKAWAY POLE PLACEMENT (See note 6)**

ROADWAY FUNCTIONAL CLASSIFICATION	** POLE OFFSET (DISTANCE TO FACE OF TRANSFORMER BASE)
Freeway Mainlanes (roadway with full control of access)	15 ft. (minimum and typical) from lane edge
All curbed, 45 mph or less design speed	2.5 ft. minimum (15 ft. desirable) from curb face
All others	10 ft. minimum*(15 ft. desirable) from lane edge

\* or as close to ROW line as is practical

\*\* provide 2/5 of the luminaire mounting height behind the pole for "falling area" to prevent encroachment on the other travel lanes. See design guidelines.

Texas Department of Transportation  
 Traffic Safety Division Standard

**ROADWAY ILLUMINATION DETAILS**  
 (RDWY ILLUM FOUNDATIONS)  
 RID(2)-20

FILE: rid2-20.dgn	DN:	CK:	DW:	CK:
© TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
1-11	DIST	COUNTY	SHEET NO.	
7-17	PAR	HUNT, ETC.	66	
12-20				

## SHIPPING PARTS LIST - POLES AND LUMINAIRE ARMS


Nominal Mounting Ht. (ft)	Shoe Base					T-Base					CSB/SSCB Mounted				
	Designation				Quantity	Designation				Quantity	Designation				Quantity
	Pole	A1	A2	Luminaire		Pole	A1	A2	Luminaire		Pole	A1	A2	Luminaire	
20	(Type SA 20 S - 4)			(150W EQ) LED		(Type SA 20 T - 4)			(150W EQ) LED						
	(Type SA 20 S - 4 - 4)			(150W EQ) LED		(Type SA 20 T - 4 - 4)			(150W EQ) LED						
30	(Type SA 30 S - 4)			(250W EQ) LED		(Type SA 30 T - 4)			(250W EQ) LED		(Type SP 28 S - 4)		(250W EQ) LED		
	(Type SA 30 S - 4 - 4)			(250W EQ) LED		(Type SA 30 T - 4 - 4)			(250W EQ) LED		(Type SP 28 S - 4 - 4)		(250W EQ) LED		
40	(Type SA 30 S - 8)			(250W EQ) LED		(Type SA 30 T - 8)			(250W EQ) LED		(Type SP 28 S - 8)		(250W EQ) LED		
	(Type SA 30 S - 8 - 8)			(250W EQ) LED		(Type SA 30 T - 8 - 8)			(250W EQ) LED		(Type SP 28 S - 8 - 8)		(250W EQ) LED		
	(Type SA 40 S - 4)			(250W EQ) LED		(Type SA 40 T - 4)			(250W EQ) LED		(Type SP 38 S - 4)		(250W EQ) LED		
	(Type SA 40 S - 4 - 4)			(250W EQ) LED		(Type SA 40 T - 4 - 4)			(250W EQ) LED		(Type SP 38 S - 4 - 4)		(250W EQ) LED		
	(Type SA 40 S - 8)			(250W EQ) LED		(Type SA 40 T - 8)			(250W EQ) LED		(Type SP 38 S - 8)		(250W EQ) LED		
	(Type SA 40 S - 8 - 8)			(250W EQ) LED		(Type SA 40 T - 8 - 8)			(250W EQ) LED		(Type SP 38 S - 8 - 8)		(250W EQ) LED		
	(Type SA 40 S - 10)			(250W EQ) LED		(Type SA 40 T - 10)			(250W EQ) LED		(Type SP 38 S - 10)		(250W EQ) LED		
	(Type SA 40 S - 10 - 10)			(250W EQ) LED		(Type SA 40 T - 10 - 10)			(250W EQ) LED		(Type SP 38 S - 10 - 10)		(250W EQ) LED		
50	(Type SA 40 S - 12)			(250W EQ) LED		(Type SA 40 T - 12)			(250W EQ) LED		(Type SP 38 S - 12)		(250W EQ) LED		
	(Type SA 40 S - 12 - 12)			(250W EQ) LED		(Type SA 40 T - 12 - 12)			(250W EQ) LED		(Type SP 38 S - 12 - 12)		(250W EQ) LED		
	(Type SA 50 S - 4)			(400W EQ) LED		(Type SA 50 T - 4)			(400W EQ) LED		(Type SP 48 S - 4)		(400W EQ) LED		
	(Type SA 50 S - 4 - 4)			(400W EQ) LED		(Type SA 50 T - 4 - 4)			(400W EQ) LED		(Type SP 48 S - 4 - 4)		(400W EQ) LED		
	(Type SA 50 S - 8)			(400W EQ) LED		(Type SA 50 T - 8)			(400W EQ) LED		(Type SP 48 S - 8)		(400W EQ) LED		
	(Type SA 50 S - 8 - 8)			(400W EQ) LED		(Type SA 50 T - 8 - 8)			(400W EQ) LED		(Type SP 48 S - 8 - 8)		(400W EQ) LED		
	(Type SA 50 S - 10)			(400W EQ) LED		(Type SA 50 T - 10)			(400W EQ) LED		(Type SP 48 S - 10)		(400W EQ) LED		
	(Type SA 50 S - 10 - 10)			(400W EQ) LED		(Type SA 50 T - 10 - 10)			(400W EQ) LED		(Type SP 48 S - 10 - 10)		(400W EQ) LED		

OTHER				
Designation				Quantity
Pole	A1	A2	Luminaire	

### GENERAL NOTES:

- All work, materials and services not shown on the plans which may be necessary for complete and proper construction shall be performed, furnished and installed by the Contractor. Faulty fabrication or poor workmanship in any material, equipment or installation will be considered justification for rejection. Where manufacturers provide warranties or guarantees as a customary trade practice, furnish to the Department such warranties or guarantees.
- The location of poles and fixtures are diagrammatic only and may be shifted by the Engineer to accommodate local conditions. Install or remove poles and luminaires located near overhead electrical lines using established industry and utility safety practices and in accordance with laws governing such work. Consult with the appropriate utility company prior to beginning such work.
- Standard Steel Pole Designs. Steel poles fabricated in accordance with the details and dimensions shown herein, shall be considered standard designs. Submission of shop drawings and design calculations for standard designs is not required.
- Optional Steel Pole Designs. Multi-sided steel poles may be allowed as optional designs, if steel poles are permitted or required, pending approval by the Department as outlined below.
  - Shop Drawings. Optional designs require submission of shop drawings and design calculations bearing the seal of an engineer licensed in the State of Texas, in accordance with Item 441, "Steel Structures." The Department may elect to pre-approve some shop drawings for optionally designed poles. Submission of shop drawings and design calculations is not required for structures fabricated in accordance with the details of shop drawings on the pre-approved list maintained by the TxDOT Traffic Operations Division. Any deviation from the pre-approved shop drawings will require submission of shop drawings of the complete assembly and design calculations as described above.
  - Structural Support Design for Luminaires. Lighting support structures shall be designed for a 25 year design life in accordance with the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto. All poles shall be designed for 110 mph 3-second gust wind speeds. The Gust Factor, G, and Wind Importance Factor, I<sub>r</sub>, shall be applied as per the AASHTO Specifications assuming a 25-year design life. The design wind pressure for hurricane wind velocities greater than 100 mph shall not be less than the design wind pressure using 100 mph with the non-hurricane Wind Importance Factor, I<sub>r</sub>, value. For transformer base poles, fabricator shall include transformer base and connecting hardware in design calculations and shop drawing submittals. All transformer bases shall have been structurally tested to resist the theoretical plastic moment capacity of the pole. Certification of the plastic moment load test and FHWA breakaway requirement test of the model of base being furnished shall be submitted with the shop drawings. Shop drawings shall show breakaway base model number, and manufacturer's name and logo. Manufacturer's shop drawings shall include the ASTM designations for all materials to be used.
  - Mast Arm Attachments. All poles and attachments shall be structurally designed to support two 12-foot mast arms and luminaires. Poles shall be supplied with mast arm combinations as shown in the plans. All mast arms shall be designed for a 60-pound luminaire having an effective projected area of 1.6 square feet.
  - Anchor Bolt Assembly. Anchor bolt assemblies for optionally designed poles shall be the same as those shown herein.
- Aluminum Pole Designs. Aluminum pole designs may be allowed, if aluminum poles are permitted or required, pending approval by the Department as outlined below.
  - Meet all of the requirements stated above for optional steel pole designs and the following:
    - Aluminum poles shall be fabricated in accordance with "Structural Welding Code-Aluminum" AWS D1.2.
    - Aluminum pole designs shall use the same anchor bolt assembly and be subject to the same geometric restraints and other requirements for steel poles specified herein.
    - Aluminum poles shall be equipped with vibration mitigation devices, as approved by the engineer.
    - Pole components shall be constructed using the following material:
      - Shaft: ASTM B221 or B241 Alloy 6063-T6, ASTM B209 Alloy 5086-H34, ASTM B221 Alloy 6005-T5.
      - Base Flange: ASTM B26 Alloy 356.0-T6 or ASTM B108 Alloy 356.0-T6 (Yield strength test required).
      - Mast Arm Fitting: ASTM B209 Alloy 6061-T6 or ASTM B221 Alloy 6005-T5.
      - Mast Arms: ASTM B241 Alloy 6061-T6 or Alloy 6063-T6.
      - Pole Cap: ASTM B209 Alloy 5086-H32 or ASTM B108 or B26 Alloy 356.0-T6.
      - Bolts: Stainless Steel AISI 300 series. Bolts threading into aluminum threads shall be treated with anti-seize compound, Never-Seez Compound, Permatex 133K or equal.
- Special Designs. Poles with architectural treatments shall meet the requirements shown elsewhere in the plans.
- Luminaire Mounting Height. Actual luminaire mounting height shall be the nominal mounting height given on RIP(2) for all pole-arm combinations except for poles with 4 ft. luminaire arms, which shall be 3'-0" lower than the nominal height, unless otherwise shown or directed.

### EXPLANATION OF ROADWAY ILLUMINATION ASSEMBLY DESIGNATIONS

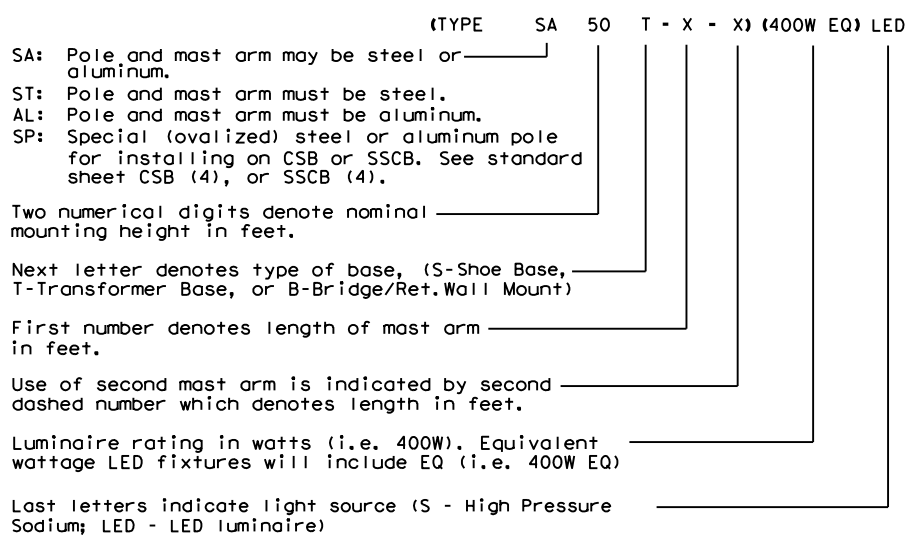


<span style="font-size: small;">Texas Department of Transportation</span>		Traffic Safety Division Standard
ROADWAY ILLUMINATION POLES		
RIP(1) - 19		
FILE: r1p-19.dgn	DN:	CK: DW: CK:
© TxDOT January 2007	CONT SECT	JOB HIGHWAY
REVISIONS	0009 13	197, ETC IH 30, ETC.
7-17	DIST	COUNTY SHEET NO.
12-19	PAR	HUNT, ETC. 67

DATE: 4/18/2024 9:43:22 AM  
 FILE: t:\partofashley\projects\safety Lighting let\_8-24\STANDARD\ip(1)-4p-19.dgn  
 The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of standard to other formats or for incorrect results or damages resulting from its use.


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 4/18/2024 9:43:24 AM  
 FILE: t:\parr\ashley\projects\safety lighting let.8-24\STANDARD\SRIP(1)-19-19.dgn

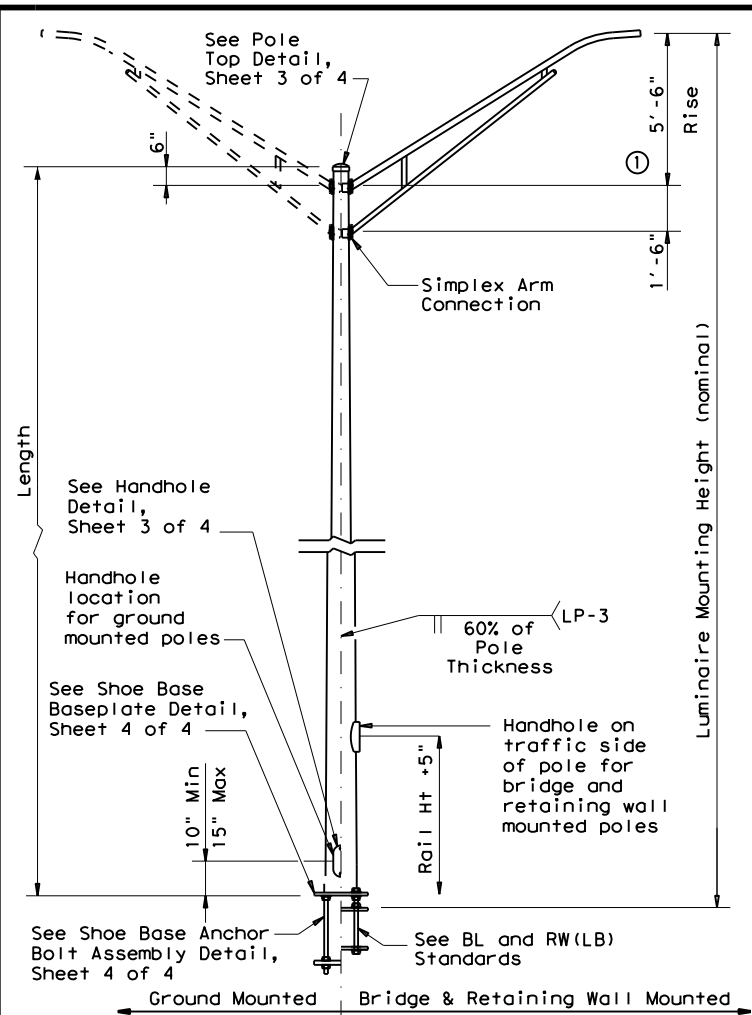


**SHOE BASE POLE**

SHOE BASE POLE					
Luminaire Mounting Height (Nominal) (ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)
20.00	7.00	4.90	15.00	0.1196	7.1
30.00	7.50	4.00	25.00	0.1196	13.2
31.00-39.00	8.00	4.36-3.24	26.00-34.00	0.1196	20.7
40.00	8.50	3.60	35.00	0.1196	20.7
50.00	10.50	4.20	45.00	0.1196	30.3

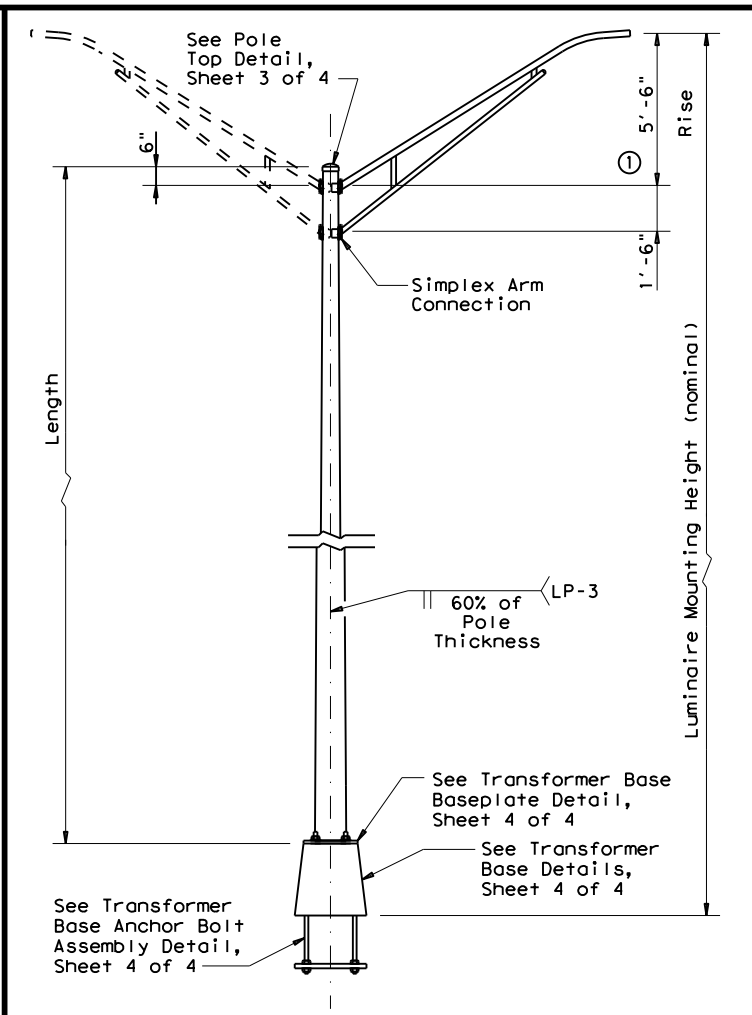

**TRANSFORMER BASE POLE**

TRANSFORMER BASE POLE					
Luminaire Mounting Height (Nominal) (ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)
20.00	7.00	5.11	13.50	0.1196	7.1
30.00	7.50	4.21	23.50	0.1196	13.2
31.00-39.00	8.00	4.57-3.45	24.50-32.50	0.1196	20.7
40.00	8.50	3.81	33.50	0.1196	20.7
50.00	10.00	3.91	43.50	0.1196	30.3

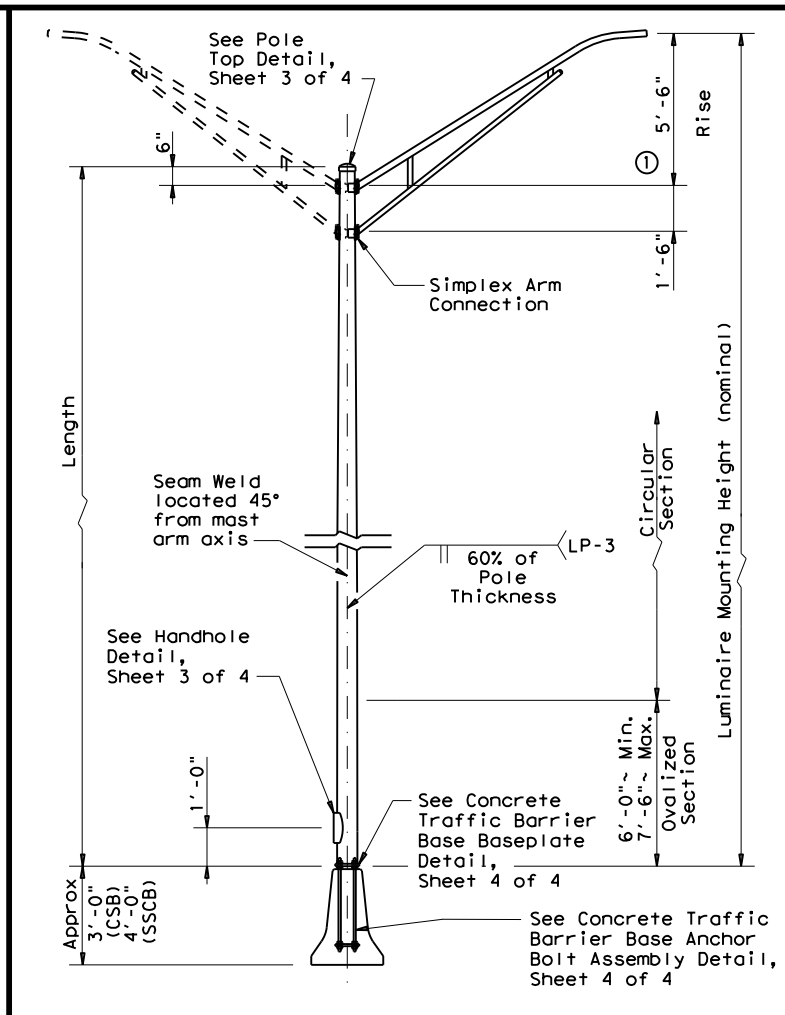

**CONCRETE TRAFFIC BARRIER BASE POLE**

CONCRETE TRAFFIC BARRIER BASE POLE (CSB/SSCB)						
Luminaire Mounting Height (Nominal) (ft)	Base Diameter (in)	Top Diameter (in)	Length (ft)	Pole Thickness (in)	Design Moment (K-ft)	
					About C of Rail	Perp. to Rail
28.00	9.00	5.78	23.00	0.1196	10.3	13.2
38.00	9.00	4.38	33.00	0.1196	16.6	20.8
48.00	10.50	4.48	43.00	0.1345	25.1	30.5

**GENERAL NOTES:**

- Designs conform to AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto. Design 3-Second Gust Wind Speed equals 110 mph with a 1.14 gust factor. A wind importance factor of 0.80 is applied to adjust the wind speed to a 25 year recurrence interval. Design moments listed in tables assume base of pole is 25' above natural ground level.
- Structures are designed to support two 12' luminaire mast arms and luminaires. Mast arms are designed to support a 60-pound luminaire having an effective projected area of 1.6 square feet.
- Fabrication shall be in accordance with the Specifications and with the details, dimensions, and weld procedures shown herein. Do not submit shop drawings for roadway illumination pole assemblies fabricated in accordance with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. Materials, fabrication tolerances, and shipping practices shall meet the requirements of these sheets and the Specifications. In the absence of specified fabrication tolerances, dimensions shall be within the tolerances generally obtainable in normal fabrication practice.
- For mounting heights between values shown in the tables, use base diameter and thickness values for the larger height.
- Unless otherwise noted, all steel parts shall be galvanized in accordance with Item 445, "Galvanizing."
- Steel poles shall be fabricated in accordance with Item 441, "Steel Structures." Longitudinal seam welds for pole sections shall have 60% minimum penetration. All welding shall be in accordance with AWS D1.1, Structural Welding Code-Steel.
- Two-section poles joined by circumferential welds will not be permitted, unless otherwise shown on the plans. Poles may be fabricated in two sections and field-assembled by the lap-joint method. The two sections shall telescope together with a lap length of not less than 1-1/2 times the shaft diameter at the lap joint.
- Alternate material equal to or better than material specified may be substituted with the approval of the Engineer.
- Lubricate and tighten anchor bolts, when erecting shoe base poles and concrete traffic barrier base poles, in accordance with Item 449, "Anchor Bolts."
- All poles, except Transformer Base Poles, shall have hand holes with reinforcing frames and covers. For ground mounted shoe base poles, hand holes shall be placed 90 degrees to mast arm unless otherwise noted on the plans. For poles mounted on a concrete traffic barrier with one luminaire arm, hand holes shall be located 180 degrees from luminaire arm. For poles mounted on a concrete traffic barrier with two luminaire arms, all hand holes shall be on the same side of the barrier. For poles mounted on a bridge lighting bracket or a retaining wall lighting bracket, hand hole shall be on traffic side of the pole, at a height that will clear the barrier.
- The finished pole shall have a smooth, uniform finish free of pits, blisters, or other defects. Scratched, chipped, and other damaged galvanized areas on poles and mast arms shall be repaired in accordance with Item 445, "Galvanizing."
- Pole length is based on a 5'-6" luminaire arm rise. 4 ft. luminaire arms have a 2'-6" rise. A pole with 4 ft. luminaire arms will have an actual mounting height 3'-0" less than the nominal mounting height. Increasing the pole length to meet the nominal mounting height is allowed, but unnecessary unless otherwise directed by the engineer.
- Erect transformer base poles in accordance with sheet RID(1).

**MATERIAL DATA**

COMPONENT	ASTM DESIGNATION	MIN. YIELD (ksi)
Pole Shaft (0.14"/ft. Taper)	A572 Gr 50, A595 Gr A, A1011 HSLAS Gr 50 Cl 2 (3), or A1008 HSLAS Gr 50 Cl 2	50
Base Plate and Handhole Frame	A572 Gr.50, or A36	36
T-Base Connecting Bolts	F3125 Gr A325	92
Anchor Bolts	F1554 Gr 55, A193-B7 or A321	55 105
Anchor Bolt Templates	A36	36
Heavy Hex (H.H.) Nuts	A194 Gr 2H, or A563 Gr DH	
Flat Washers	F436	

**NOTES:**

- 2'-6" rise for 4 ft. luminaire arms.
- Before ovalized as shown on Concrete Traffic Barrier Base Baseplate details, Sheet 4 of 4.
- A1011 SS Gr 50 may be used instead of HSLAS, provided the material meets the elongation requirements for HSLAS.

**POLE ASSEMBLY FABRICATION TOLERANCES TABLE**

DIMENSION	TOLERANCE
Shaft length	+1"
I.D. of outside piece of slip fitting pieces	+1/8", -1/16"
O.D. of inside piece of slip fitting pieces	+1/32", -1/8"
Shaft diameter: other	+3/16"
Out of "round"	1/4"
Straightness of shaft	±1/4" in 10 ft
Twist in multi-sided shaft	4° in 50 ft
Perpendicular to baseplate	1/8" in 24"
Pole centered on baseplate	±1/4"
Location of Attachments	±1/4"
Bolt hole spacing	±1/16"

SHEET 2 OF 4


Traffic Safety Division Standard

## ROADWAY ILLUMINATION POLES

### RIP(2) - 19

FILE: rip-19.dgn	DN:	CK:	DW:	CK:
© TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
7-17	DIST	COUNTY	SHEET NO.	
12-19	PAR	HUNT, ETC.	68	


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

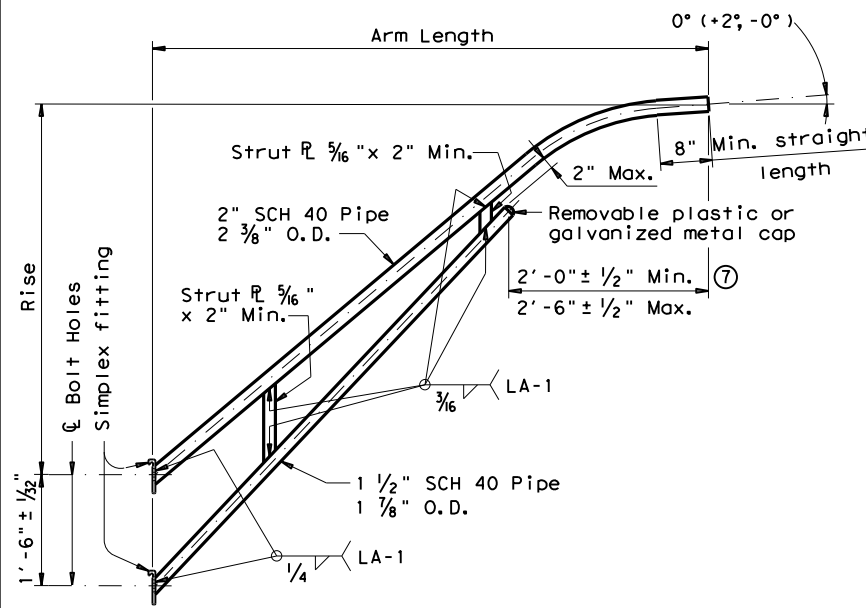


**LUMINAIRE ARM**

LUMINAIRE ARM DIMENSIONS		
Nominal Arm Length	Arm Length	Rise
4'-0"	3'-6"	2'-6"
6'-0"	5'-6"	5'-6"
8'-0"	7'-6"	5'-6"
10'-0"	9'-6"	5'-6"
12'-0"	11'-6"	5'-6"


ARM ASSEMBLY FABRICATION TOLERANCES TABLE	
DIMENSION	TOLERANCE
Arm Length	±1"
Arm Rise	±1"
Deviation from flat	1/8" in 12"
Spacing between holes	±1/32"

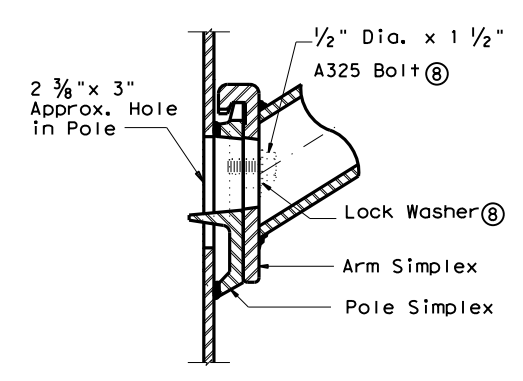


**UPPER SIMPLEX FITTING**  
(Gusset not shown for clarity)

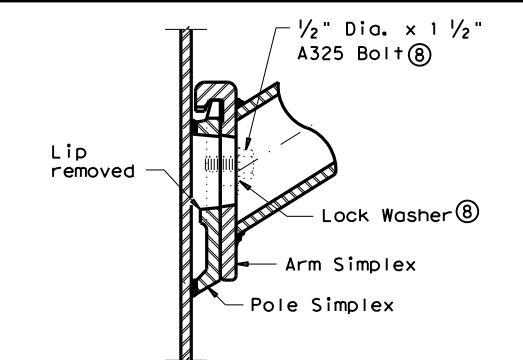


**LOWER SIMPLEX FITTING**  
(Gusset not shown for clarity)

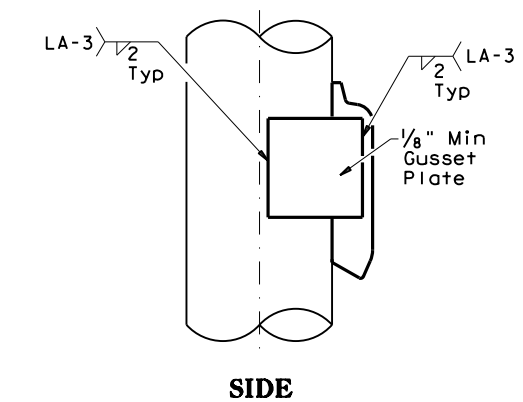

**SIDE**

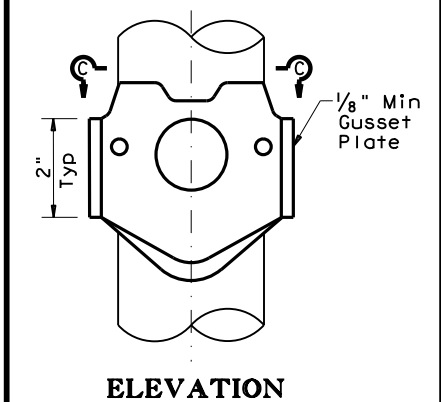


**ELEVATION**

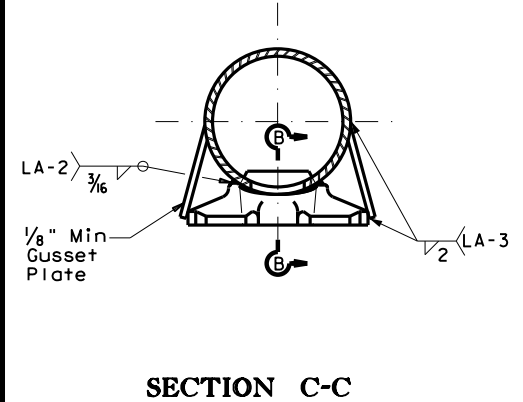


**SECTION C-C**


**SIMPLEX ATTACHMENT DETAIL**

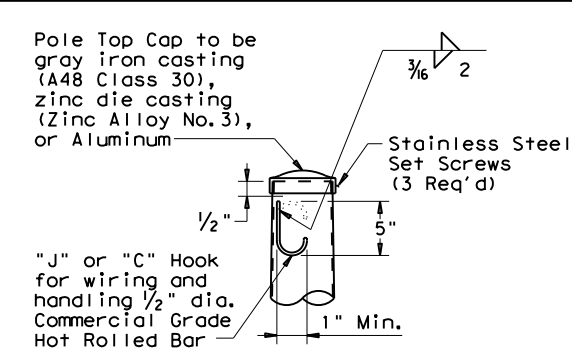

**POLE TOP**

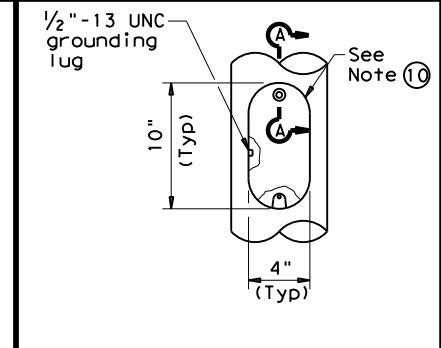


**ELEVATION**

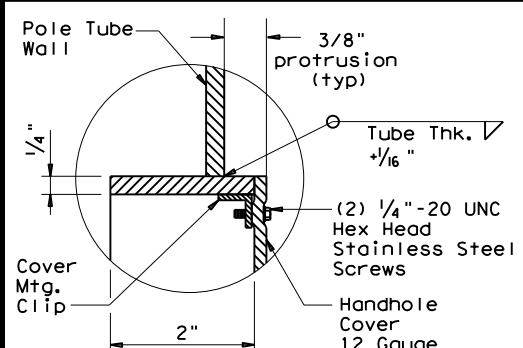


**SECTION A-A**

**HANDHOLE**

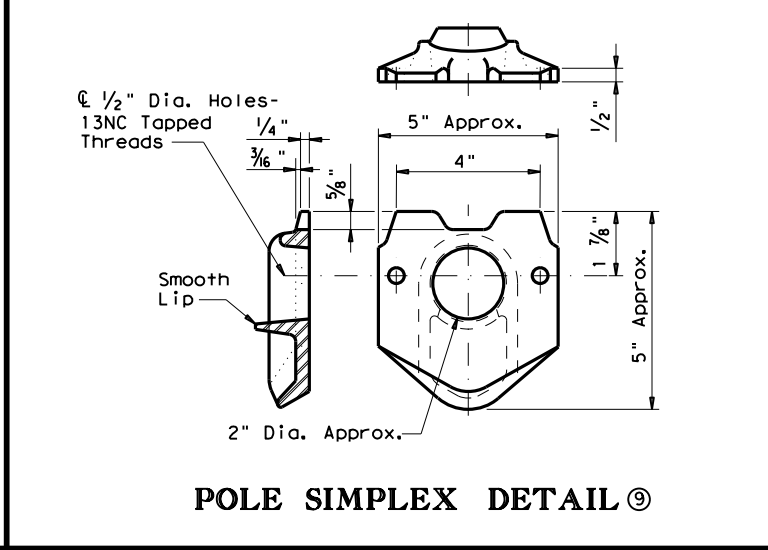

**POLE SIMPLEX DETAIL ③**

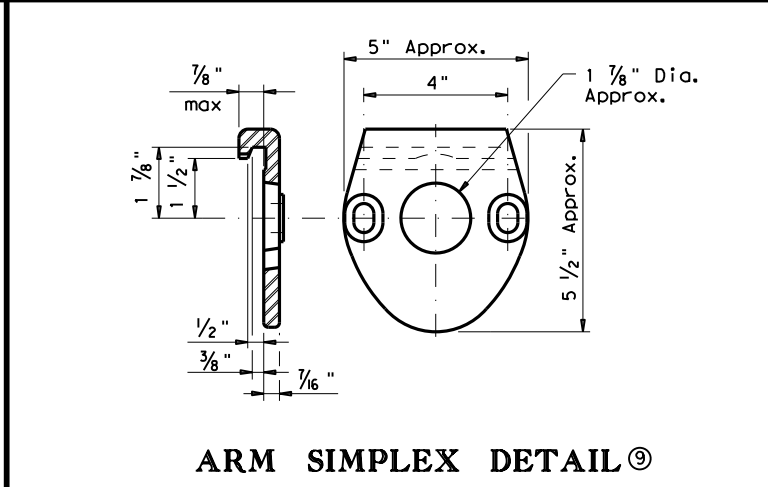

**ARM SIMPLEX DETAIL ③**

**NOTES:**

- ④ Any of the materials listed for plates may be used where the drawings do not specify a particular ASTM designation.
- ⑤ A576 must be suitable for forging and also meet minimum tensile strength of 65 ksi, minimum yield of 35 ksi, and elongation in 2 inches of 22 percent.
- ⑥ A572, A1008 HSLAS-F, and A1011 HSLAS-F materials may have higher yield strengths but shall not have less elongation than the grade indicated.
- ⑦ Dimensional limits are given to show acceptable variation in design. All of a Fabricator's production of a particular arm length shall have the same dimensions within specified tolerances.
- ⑧ Each pole simplex fitting shall be supplied with 2 bolts and 2 lock washers of the size specified. The bolts and lock washers shall be secured to the pole with the other hardware items called for in the plans.
- ⑨ Proposed deviations in arm simplex dimensions or materials must be submitted to the Department for approval.
- ⑩ A welded handhole frame is permissible. Maximum of two (2) CJP weld splices is allowed.

MATERIALS	
Pole or Arm Simplex	ASTM A27 Gr 65-35 or Gr 70-36, A148 Gr 80-50, A576 Gr 1021 ⑤, or A36 (Arm only)
Arm Pipes	ASTM A53 Gr A or B, A500 Gr B, A501, A 1008 HSLAS-F Gr 50 ⑥, or A1011 HSLAS-F Gr 50 ⑥
Arm Struts and Gusset Plates ④	ASTM A36, A572 Gr 50 ⑥, or A588
Misc.	ASTM designations as noted


SHEET 3 OF 4



**ROADWAY ILLUMINATION POLES**  
**RIP(3) - 19**


FILE: rip-19.dgn	DN:	CK:	DW:	CK:
© TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
7-17	DIST	COUNTY	SHEET NO.	
12-19	PAR	HUNT, ETC.	69	

DATE: 4/18/2024 9:43:28 AM  
 FILE: t:\par\tr\ashley\projects\safety lighting let\_8-24\STANDARDS\ip(1-4)-19.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

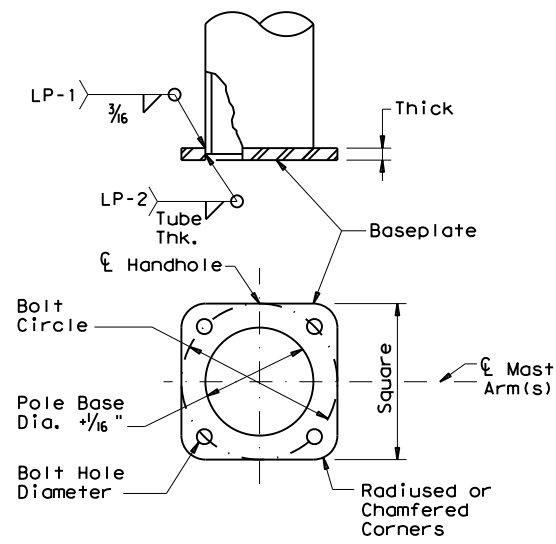


**SHOE BASE BASEPLATE**

SHOE BASE BASEPLATE TABLE				
MOUNTING HEIGHTS (nominal)	BOLT CIRCLE	SQUARE	THICK	BOLT HOLE DIAMETER
20' - 39'	13"	13"	1 1/4"	1 1/4"
40'	15"	15"	1 1/4"	1 1/2"
50'	15"	15"	1 1/2"	1 1/2"

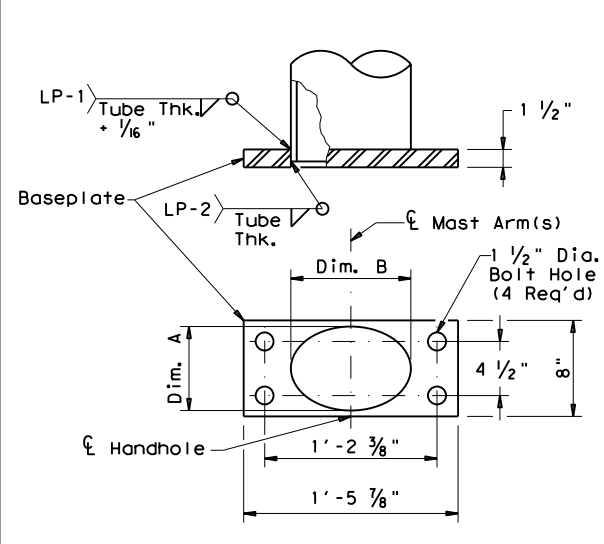

**CONCRETE TRAFFIC BARRIER BASE BASEPLATE**






CONCRETE TRAFFIC BARRIER BASE BASEPLATE TABLE			
MOUNTING HEIGHTS (nominal)	POLE DIA. (12)	DIM. A	DIM. B
28' - 38'	9"	7" ± 1/4"	10" ± 1/4"
48'	10 1/2"	7" ± 1/4"	13" ± 1/4"

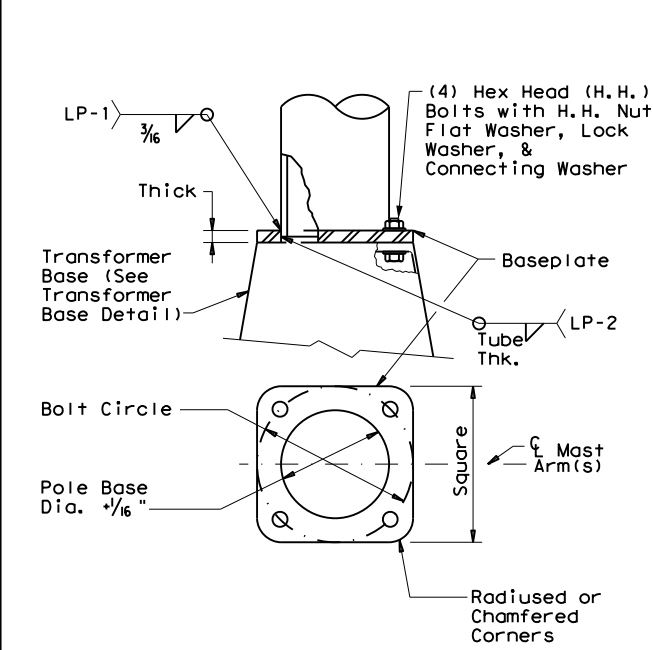


**TRANSFORMER BASE BASEPLATE**

TRANSFORMER BASE BASEPLATE TABLE						
MOUNTING HEIGHTS (nominal)	BOLT CIRCLE	SQUARE	THICK	CONNECTING BOLT DIA.	BOLT HOLE DIAMETER	TRANSFORMER BASE TYPE
20' - 39'	13"	13"	1 1/4"	1"	1 1/4"	A
40'	15"	15"	1 1/4"	1 1/4"	1 1/2"	B
50'	15"	15"	1 1/2"	1 1/4"	1 1/2"	B

TRANSFORMER BASE TABLE		
TYPE	TOP B.C.	BTM. B.C.
A	13"	14"
B	15"	17 1/4"

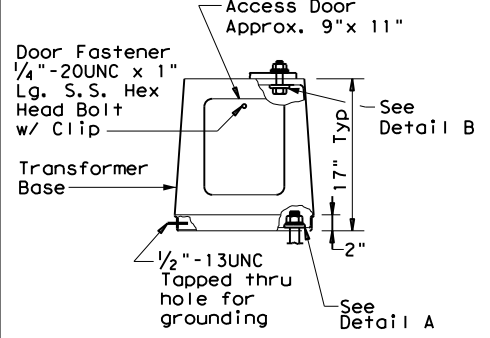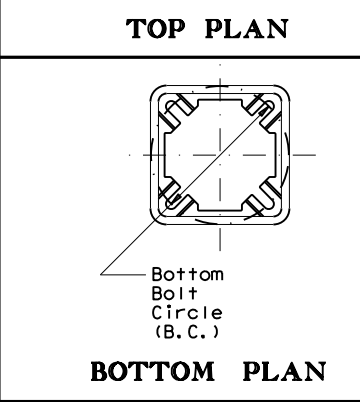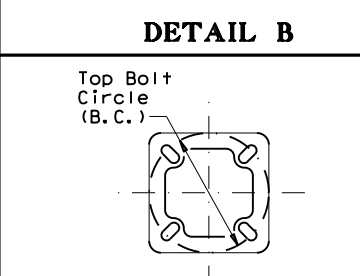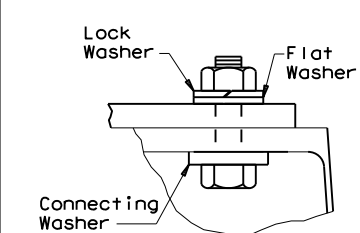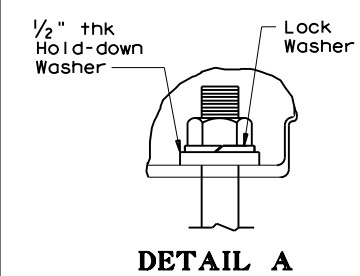


**TRANSFORMER BASE DETAILS**

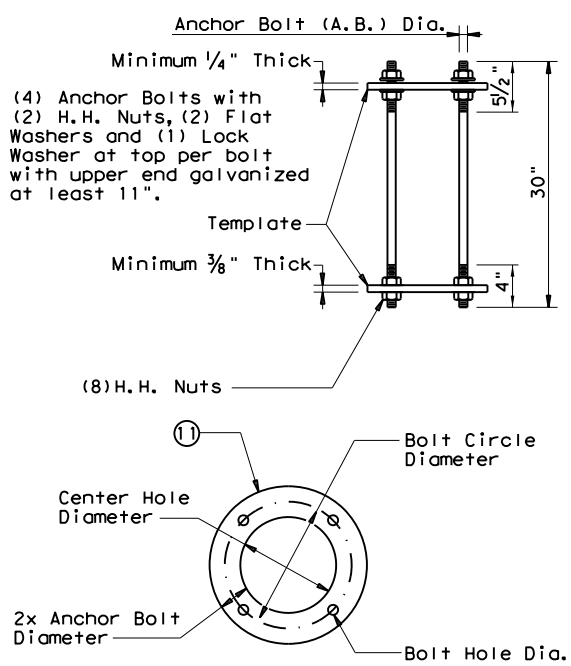


**SHOE BASE ANCHOR BOLT ASSEMBLY**

SHOE BASE ANCHOR BOLT ASSEMBLY TABLE				
MOUNTING HEIGHTS (nominal)	A.B. Dia.	BOLT CIRCLE DIAMETER	CTR. HOLE DIAMETER	BOLT HOLE DIAMETER
20' - 39'	1"	13"	11"	1 1/16"
40' - 50'	1 1/4"	15"	12 1/2"	1 5/16"

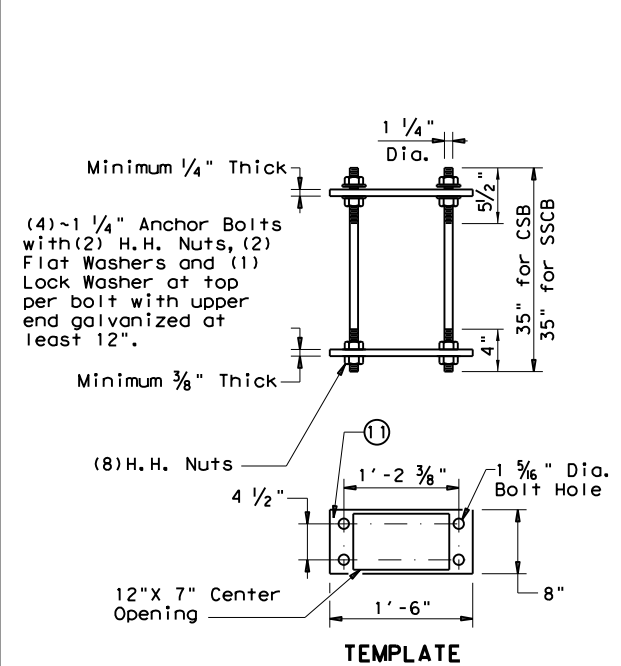

**CONCRETE TRAFFIC BARRIER BASE ANCHOR BOLT ASSEMBLY**

CONCRETE TRAFFIC BARRIER BASE ANCHOR BOLT ASSEMBLY TABLE				
MOUNTING HEIGHTS (nominal)	A.B. Dia.	BOLT CIRCLE DIAMETER	CTR. HOLE DIAMETER	BOLT HOLE DIAMETER
20' - 39'	1"	14"	12"	1 1/16"
40' - 50'	1 1/4"	17 1/4"	14 3/4"	1 5/16"

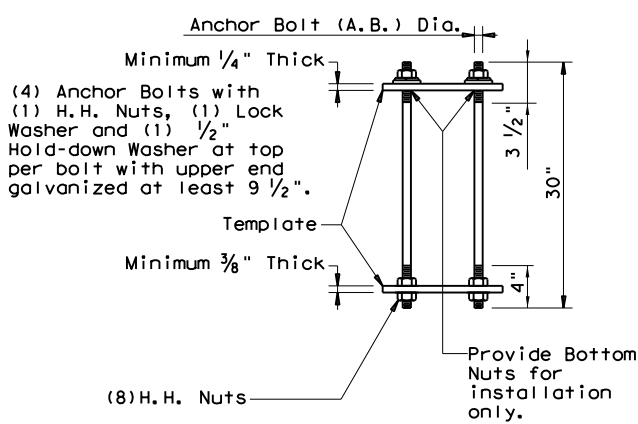

**TRANSFORMER BASE ANCHOR BOLT ASSEMBLY**

**GENERAL NOTES:**

- For mounting heights between those shown in the table, use the values in the table for the larger mounting height.
- All breakaway bases shall meet the breakaway requirements of the AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals, 6th Edition (2013) and Interim Revisions thereto, and shall have been tested by FHWA-approved methods. All bases shall have been structurally tested to resist 150% of the design moment.
- Transformer bases shall be cast from aluminum, ASTM B108 or B26 Alloy 356.0-T6, or other material approved by the Engineer. Four Hex Head (H.H.) bolts with four H.H. nuts, four lock washers, four flat washers, and connecting and hold-down washers as recommended by the manufacturer, galvanized to ASTM A153 Class C or D, or B695 Class 50, shall be provided with each transformer base for connecting the pole. Bolts shall be ASTM A325 or approved equal. Nuts shall be ASTM A563 grade DH galvanized.
- Bases shall be stamped, incised or by other approved permanent means, marked to show fabricator's name or logo, and model number. Such information shall be placed in a readily seen location, inside or outside the base, but shall not be placed on the door.
- Doors for transformer bases shall be made of plastic, fiberglass or other non-metallic material approved by the Engineer and shall be attached with stainless steel screws or bolts. Transformer bases shall be cleaned by grit blast cleaning after heat treatment. Certification by the manufacturer of heat treatment shall be furnished with transformer bases. The certification shall show the metal alloy and temper and that the base meets those requirements, chemical and physical. The certification shall also show the material ASTM specification. Transformer bases shall be cast with a removable tab bar for material testing. Some bars may have been removed by the manufacturer for testing.

**NOTES:**

- Anchor Bolt Templates do not need to be galvanized.
- Pole diameter before ovalized.


ANCHOR BOLT FABRICATION TOLERANCES TABLE	
DIMENSION	TOLERANCE
Length	± 1/2"
Threaded length	± 1/2"
Galvanized length (if required)	- 1/4"

**ROADWAY ILLUMINATION POLES  
RIP(4)-19**

FILE: rip-19.dgn	DN:	CK:	DW:	CK:
©TxDOT January 2007	CONT	SECT	JOB	HIGHWAY
REVISIONS	0009	13	197, ETC	IH 30, ETC.
7-17	DIST	COUNTY	SHEET NO.	
12-19	PAR	HUNT, ETC.		70




40A822024  
 +F1b8r-traf\ashley\projects\safety\_lighting let\_8-24\STANDARDS\ec116.dgn  
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

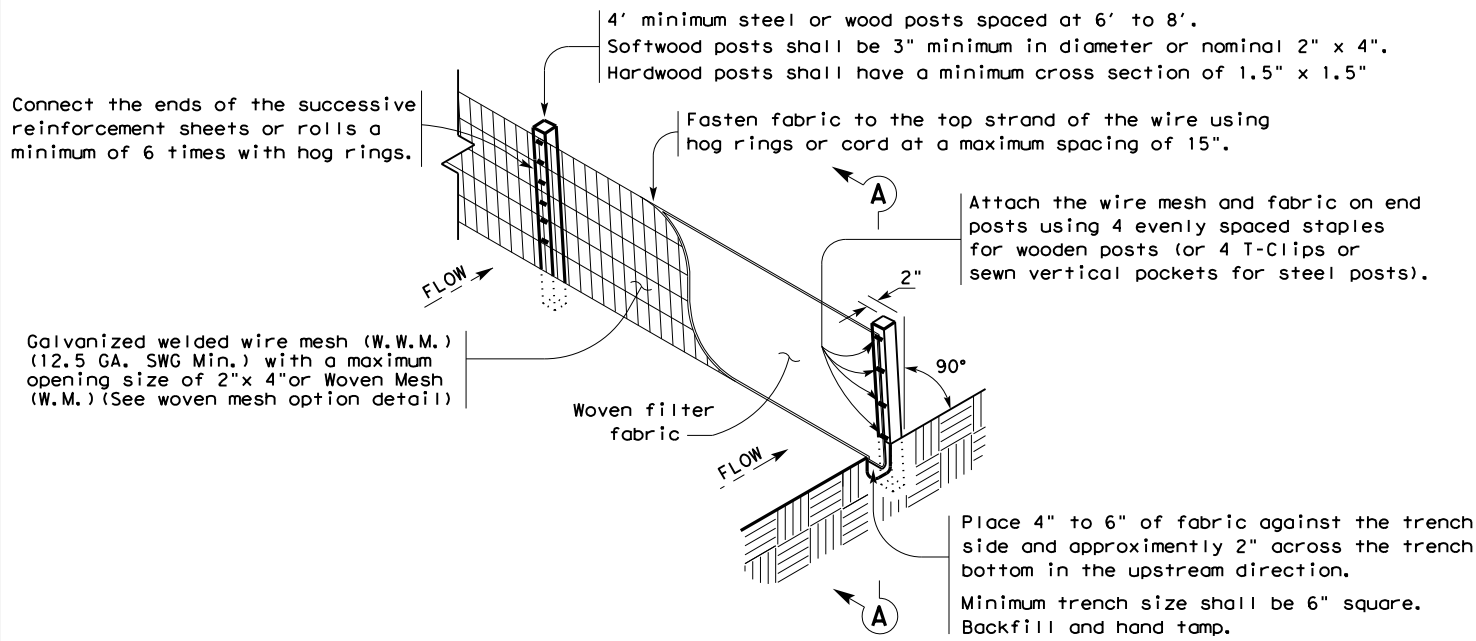

**TEMPORARY SEDIMENT CONTROL FENCE**

SCF

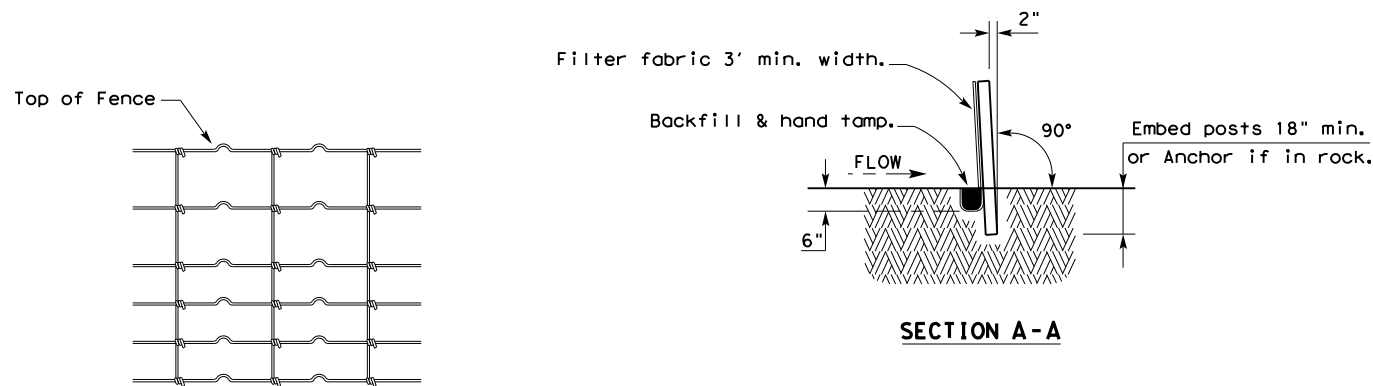

**HINGE JOINT KNOT WOVEN MESH (OPTION) DETAIL**

Galvanized hinge joint knot woven mesh (12.5 GA. SWG Min.) requires a minimum of five horizontal wires spaced at a maximum of 12 inches apart and all vertical wires spaced at a maximum of 12 inches apart.

**SEDIMENT CONTROL FENCE USAGE GUIDELINES**

A sediment control fence may be constructed near the downstream perimeter of a disturbed area along a contour to intercept sediment from overland runoff. A 2 year storm frequency may be used to calculate the flow rate to be filtered.

Sediment control fence should be sized to filter a maximum flow through rate of 100 GPM/FT<sup>2</sup>. Sediment control fence is not recommended to control erosion from a drainage area larger than 2 acres.


**LEGEND**

Sediment Control Fence

SCF

**GENERAL NOTES**

1. Vertical tracking is required on projects where soil distributing activities have occurred unless otherwise approved.
2. Perform vertical tracking on slopes to temporarily stabilize soil.
3. Provide equipment with a track undercarriage capable of producing linear soil impressions measuring a minimum of 12" in length by 2" to 4" in width by 1/2" to 2" in depth.
4. Do not exceed 12" between track impressions.
5. Install continuous linear track impressions where the minimum 12" length impressions are perpendicular to the slope or direction of water flow.

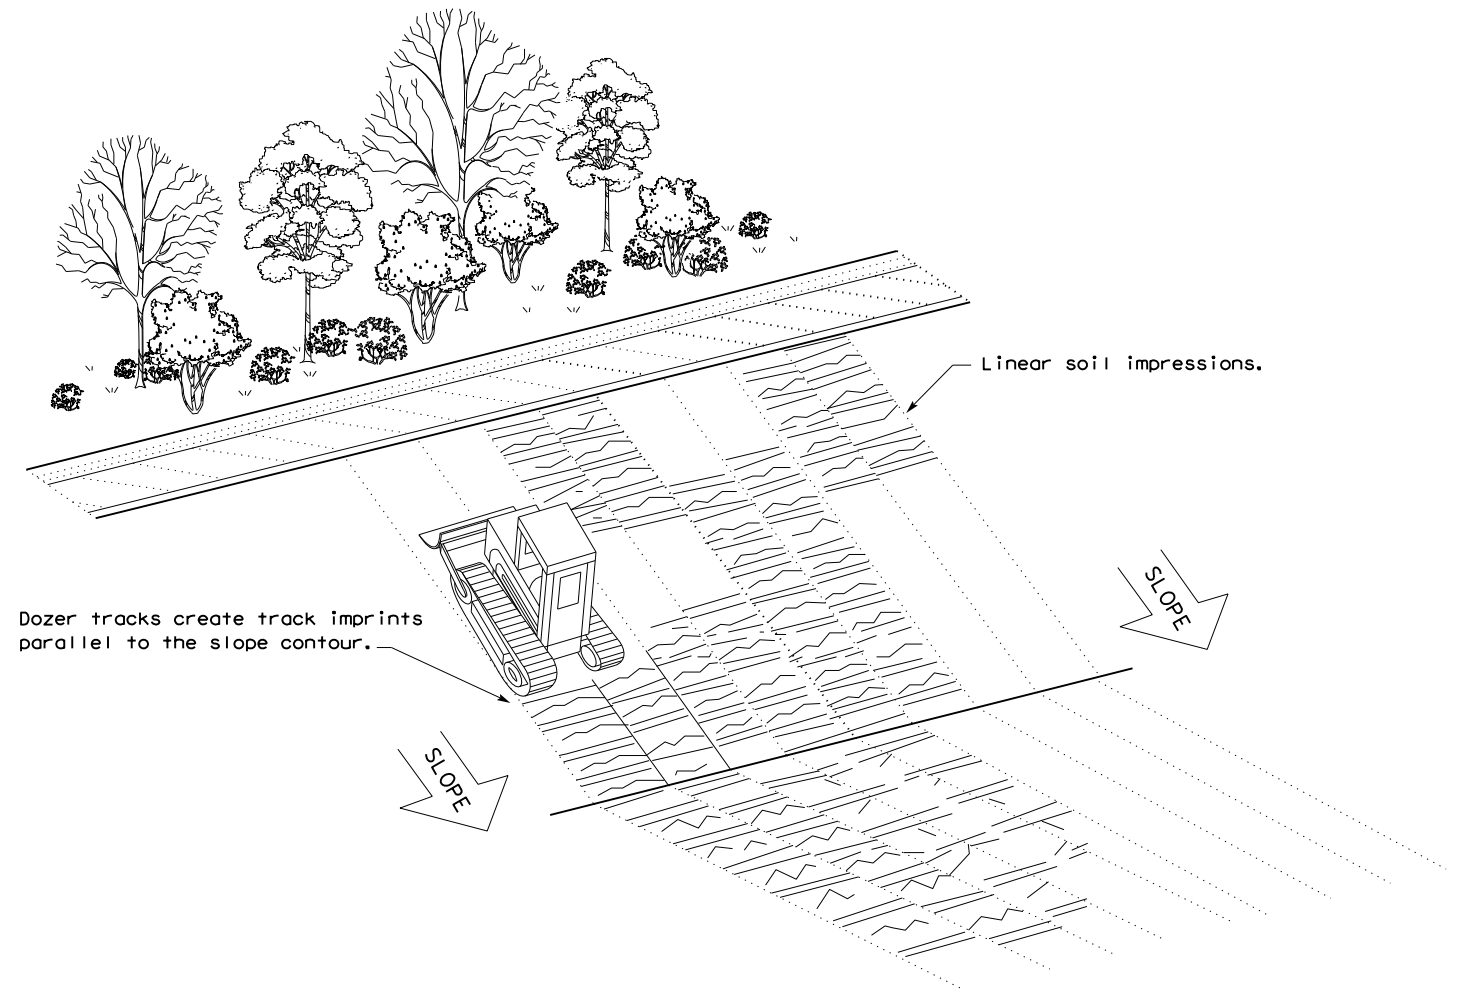

**VERTICAL TRACKING**

				Design Division Standard	
<b>TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES FENCE &amp; VERTICAL TRACKING</b> <b>EC(1)-16</b>					
FILE: ec116	DN: TxDOT	CK: KM	DW: VP	DN/CK: LS	
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY	
REVISIONS		0009 13	197, ETC	IH 30, ETC.	
DIST	COUNTY		SHEET NO.		
PAR	HUNT, ETC.		71		

**STORMWATER POLLUTION PREVENTION PLAN (SWP3):**

This SWP3 has been developed in accordance with TxDOT policy for projects disturbing less than 1 acre of soil, and not part of a larger common plan of development.

For projects with less than one acre of soil disturbing activity and that have Environmental, Permits, Issues, and Commitments (EPICs) dependent on stormwater controls and water quality measures TxDOT will maintain a SWP3 with all pertinent records, correspondence, environmental documents, etc. at the project field office, Area Office, or electronically.

This SWP3 is consistent with requirements specified in applicable stormwater plans, and the project's environmental permits, issues, and commitments (EPICs).

**1.0 SITE/PROJECT DESCRIPTION**

**1.1 PROJECT CONTROL SECTION JOB (CSJ):**

See Sheet 3 of 3

**1.2 PROJECT LIMITS:**

From: See Sheet 3 of 3

To: See Sheet 3 of 3

**1.3 PROJECT COORDINATES:**

BEGIN: (Lat) See Sheet 3 of 3, (Long) See Sheet 3 of 3

END: (Lat) See Sheet 3 of 3, (Long) See Sheet 3 of 3

**1.4 TOTAL PROJECT AREA (Acres):** 7.6305

**1.5 TOTAL AREA TO BE DISTURBED (Acres):** 0.3355

**1.6 NATURE OF CONSTRUCTION ACTIVITY:**

See Sheet 3 of 3

**1.7 MAJOR SOIL TYPES:**

Soil Type	Description
See Sheet 3 of 3	

**1.8 PROJECT SPECIFIC LOCATIONS (PSLs):**

PSLs must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. PSLs may be identified during preconstruction meetings or during the construction process. Please choose from the options below:

- PSLs determined during preconstruction meeting
- PSLs determined during construction
- No PSLs planned for construction

Type	Sheet #s
N/A	

All off-ROW PSLs required by the Contractor are the Contractor's responsibility. The Contractor shall secure all permits required by local, state, federal laws for off-ROW PSLs. The contractor shall provide diagrams, areas of disturbance, acreage, and BMPs for all off-ROW PSLs within one mile of the project.

**1.9 CONSTRUCTION ACTIVITIES:**

(Use the following list as a starting point when developing the Construction Activity Schedule and Ceasing Record in Attachment 2.3.)

- Mobilization
- Install sediment and erosion controls
- Blade existing topsoil into windrows, prep ROW, clear and grub
- Remove existing pavement
- Grading operations, excavation, and embankment
- Excavate and prepare subgrade for proposed pavement widening
- Remove existing culverts, safety end treatments (SETs)
- Remove existing metal beam guard fence (MBGF), bridge rail
- Install proposed pavement per plans
- Install culverts, culvert extensions, SETs
- Install mow strip, MBGF, bridge rail
- Place flex base
- Rework slopes, grade ditches
- Blade windrowed material back across slopes
- Revegetation of unpaved areas
- Achieve site stabilization and remove sediment and erosion control measures

Other: \_\_\_\_\_  
 Other: \_\_\_\_\_  
 Other: \_\_\_\_\_

**1.10 POTENTIAL POLLUTANTS AND SOURCES:**

- Sediment laden stormwater from stormwater conveyance over disturbed area
- Fuels, oils, and lubricants from construction vehicles, equipment, and storage
- Solvents, paints, adhesives, etc. from various construction activities
- Transported soils from offsite vehicle tracking
- Construction debris and waste from various construction activities
- Contaminated water from excavation or dewatering pump-out water
- Sanitary waste from onsite restroom facilities
- Trash from various construction activities/receptacles
- Long-term stockpiles of material and waste
- Discharges from concrete washout activities, runoff from concrete cutting activities, and other concrete related activities
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**1.11 RECEIVING WATERS:**

Receiving waters must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. Include Segment # for receiving waters.

Tributaries	Classified Waterbody
See Sheet 3 of 3	


\* Add (\*) for impaired waterbodies with pollutant in ( ).

**1.12 ROLES AND RESPONSIBILITIES: TxDOT**

- Development of plans and specifications
- Perform SWP3 inspections
- Maintain SWP3 records and update to reflect daily operations
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**1.13 ROLES AND RESPONSIBILITIES: CONTRACTOR**

- Day To Day Operational Control
- Maintain schedule of major construction activities
- Install, maintain and modify BMPs
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_



*Darius Smalls* 4/19/2024

**STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre)**

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.
				72
STATE	STATE DIST.	COUNTY		
TEXAS	PAR	HUNT, ETC.		
CONT.	SECT.	JOB	HIGHWAY NO.	
0009	13	197, ETC	IH 30, ETC.	

**STORMWATER POLLUTION PREVENTION PLAN (SWP3):**

**2.0 BEST MANAGEMENT PRACTICES (BMPs) AND CONTROLS, INSPECTION, AND MAINTENANCE**

The Contractor shall be the responsible party for implementing the BMPs described herein and for complying with the SWP3 for control of erosion and sedimentation during day-to-day operations. The Contractor shall implement changes to this SWP3 approved by TxDOT within the times specified in this SWP3 or the CGP.

**2.1 EROSION CONTROL AND SOIL STABILIZATION BMPs:**

**T / P**

- Protection of Existing Vegetation
- Vegetated Buffer Zones
- Soil Retention Blankets
- Geotextiles
- Mulching/ Hydromulching
- Soil Surface Treatments
- Temporary Seeding
- Permanent Planting, Sodding or Seeding
- Biodegradable Erosion Control Logs
- Rock Filter Dams/ Rock Check Dams
- Vertical Tracking
- Interceptor Swale
- Riprap
- Diversion Dike
- Temporary Pipe Slope Drain
- Embankment for Erosion Control
- Paved Flumes
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**2.2 SEDIMENT CONTROL BMPs:**

**T / P**

- Biodegradable Erosion Control Logs
- Dewatering Controls
- Inlet Protection
- Rock Filter Dams/ Rock Check Dams
- Sandbag Berms
- Sediment Control Fence
- Stabilized Construction Exit
- Floating Turbidity Barrier
- Vegetated Buffer Zones
- Vegetated Filter Strips
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

**2.3 PERMANENT CONTROLS:**

(Coordinate post-construction BMPs with appropriate TxDOT maintenance sections.)

BMPs To Be Left In Place Post Construction:

Type	Stationing	
	From	To
N/A		

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

**2.4 OFFSITE VEHICLE TRACKING CONTROLS:**

- Excess dirt/mud on road removed daily
- Haul roads dampened for dust control
- Loaded haul trucks to be covered with tarpaulin
- Stabilized construction exit
- Daily street sweeping
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**2.5 POLLUTION PREVENTION MEASURES:**

- Chemical Management
- Concrete and Materials Waste Management
- Debris and Trash Management
- Dust Control
- Sanitary Facilities
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_
- Other: \_\_\_\_\_

**2.6 VEGETATED BUFFER ZONES:**

Natural vegetated buffers shall be maintained as feasible to protect adjacent surface waters. If vegetated natural buffer zones are not feasible due to site geometry, the appropriate additional sediment control measures have been incorporated into this SWP3.

Type	Stationing	
	From	To
N/A		

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

**2.7 ALLOWABLE NON-STORMWATER DISCHARGES:**

- Fire hydrant flushings
- Irrigation drainage
- Pavement washwater (where spills or leaks have not occurred, and detergents are not used)
- Potable water sources
- Springs
- Uncontaminated groundwater
- Water used to wash vehicles or control dust
- Other allowable non-stormwater discharges as allowed by TPDES GP TXR150000.

**2.8 DEWATERING:**


Dewatering discharges of accumulated stormwater, groundwater, and surface water including discharges from dewatering of trenches, excavations, foundations, vaults, and other points of accumulation are prohibited unless managed by appropriate controls to prevent and minimize the offsite discharge of sediment and other pollutants.

**2.9 INSPECTIONS:**

All disturbed areas and erosion and sediment control devices shall be inspected at least once every seven (7) days. Inspections shall be performed by TxDOT as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.3 of this SWP3 .

**2.10 MAINTENANCE:**

Control measures shall be properly installed according to specifications. If it is determined that a BMP or control measure is not operating effectively, maintenance must be accomplished as soon as possible and before the next anticipated rain event, but in no case later than 7 calendar days after being able to access the site. Maintenance shall be performed by the Contractor as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.3 of this SWP3.



4/19/2024 © 2024 July 2023 Sheet 2 of 3


**STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre)**

Texas Department of Transportation

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.
				73
STATE	STATE DIST.	COUNTY		
TEXAS	PAR	HUNT, ETC.		
CONT.	SECT.	JOB	HIGHWAY NO.	
0009	13	197, ETC.	H 30, ETC.	

**SW3P INFORMATION TABLE**

PROJECT LIMITS	COUNTY	CSJ	NATURE OF WORK Construction	Lat Begin	Long Begin	Lat End	Long End	Project Area (AC)	Area Disturb ed(AC)	Soil Type	Soil Type Descrip	Tributaries	Classified Waterbody
IH 30 AT FM 513	Hunt	0009-13-197	Safety Lighting	33.132036	-95.9473522	33.1320356	-95.9473522	0.2	0.01	Crockett loam, 2 to 5 percent slopes	100% Crockett, moderately well drained, very high rate of run off, very high erosion potential	West Caney Creek; Caney Creek	Cowleech Fork Sabine River(0507A); not Impaired
FM 512 AT FM 2874	Hunt	0579-02-015	Safety Lighting	33.247745	-95.9612025	33.2477448	-95.9612025	0.1	0.01	Leson clay, 1 to 3 percent slopes	100% Leson, moderately well drained, very high rate of run off, very low erosion potential	Rays Creek	*Upper South Sulphur River(0306); Impaired for bacteria
SH 276 AT CR 3611	Hunt	0641-01-039	Safety Lighting	32.903514	-96.0561661	32.903514	-96.0561661	0.2	0.01	Crockett loam, 1 to 3 percent slopes	85% Crockett, moderately well drained, very high rate of run off, very low erosion potential	N/A	Lake Tawakoni (0507), not impaired
SH 24 AT FM 2736	Hunt	0768-01-059	Safety Lighting	33.177514	-95.9371168	33.1775135	-95.9371168	0.6	0.03	Axtell loam, 1 to 5 percent slopes; Crockett loam, 1 to 3 percent slopes	91.1% Axtell, moderately well drained, very high rate of run off, low erosion potential; 8.8% Crockett, moderately well drained, very high rate of run off, very low erosion potential	N/A	*Upper South Sulphur River(0306); Impaired for bacteria
SH 276 AT BU 276	Hunt	1290-09-002	Safety Lighting	32.909469	-96.1576127	32.909469	-96.1576127	0.4	0.02	Leson clay, 1 to 3 percent slopes	100% Leson, moderately well drained, very high rate of run off, very low erosion potential	Jones Creek	Lake Tawakoni (0507), not impaired
US 82 AT FM 38	Lamar	0045-08-042	Safety Lighting	33.60249	-95.8246574	33.6024901	-95.8246574	0.5	0.02	Houston Black clay, 1 to 3 percent slopes	80% Houston Black, moderately well drained, very high rate of run off, very low erosion potential	West Fork Bergrer Creek	Rowdy Creek (0305A), not impaired
US 271 AT FM 1499	Lamar	0136-07-054	Safety Lighting	33.737968	-95.5468107	33.7379678	-95.5468107	0.6	0.02	Ambia clay loam, 0 to 1 percent slopes, frequently flooded; Freestone-Hicota complex, 0 to 3 percent slopes	95% Ambia, poorly drained, very high rate of run off, very low erosion potential; 87% Freestone-Hicota, moderately well drained, medium rate of run off, very low erosion potential	Crooked Creek; Pine Creek	Pine Creek (0202D), not impaired
US 271 AT TIMBELAKES RD	Lamar	0136-08-048	Safety Lighting	33.751288	-95.5444528	33.7512884	-95.5444528	0.5	0.02	Annona loam, 1 to 4 percent slopes; Freestone-Hicota complex, 0 to 3 percent slopes	90% Annona, moderately well drained, very high rate of run off, low erosion potential; 87% Freestone-Hicota, moderately well drained, medium rate of run off, very low erosion potential	'Crooked Creek	Pine Creek (0202D), not impaired
US 271 AT GATE II RD	Lamar	0136-08-049	Safety Lighting	33.76015	-95.5414662	33.7601499	-95.5414662	0.6	0.02	Annona loam, 1 to 4 percent slopes; Freestone-Hicota complex, 0 to 3 percent slopes; Woodtell loam, 5 to 12 percent slopes	90% Annona, moderately well drained, very high rate of run off, low erosion potential; 87% Freestone-Hicota, moderately well drained, medium rate of run off, very low erosion potential; 85% Woodtell, well drained, very high rate of run off, high erosion potential;	Pine Creek	*Hicks Creek (0202N), Impaired for bacteria
FM 195 AT FM 196	Lamar	0730-02-061	Safety Lighting	33.73753	-95.4210361	33.7375300	-95.4210361	0.1	0.01	Annona loam, 1 to 4 percent slopes	90% Annona, moderately well drained, very high rate of run off, low erosion	Ninemile Creek	Pine Creek (0202D), not impaired
SL 286 AT FM 1507	Lamar	1690-01-143	Safety Lighting	33.632341	-95.509853	33.6323413	-95.5098530	0.4	0.02	Normangee clay loam, 1 to 3 percent slopes	85% Normangee, moderately well drained, high rate of run off, very low erosion potential	Echols Creek	Big Sandy Creek (0305D), not impaired
SH 24 AT FM 1528	Delta	0136-03-068	Safety Lighting	33.337341	-95.7635991	33.3373409	-95.7635991	1.6	0.05	Crockett loam, 1 to 3 percent slopes; Wilson silt loam, 0 to 2 percent slopes	85% Crockett, moderately well drained, very high rate of run off, very low erosion potential; 95% Wilson, moderately well drained, very high rate of run off, very low erosion potential	Honey Creek	Jim L. Chapman Lake (formerly Cooper Lake) (0307), not impaired
SH 24 AT BS 24D (North)	Delta	0136-03-069	Safety Lighting	33.383618	-95.687759	33.3836178	-95.6877590	0.8	0.03	Houston Black clay, 1 to 3 percent slopes; Tinn clay, 0 to 1 percent slopes, occasionally flooded	80% Crockett, moderately well drained, very high rate of run off, very low erosion potential; 85% Tinn, moderately well drained, high rate of run off, very low erosion potential	Big Creek	Big Creek (0303A), not impaired
SH 24 AT FM 198	Delta	0136-04-051	Safety Lighting	33.451313	-95.5965466	33.4513128	-95.5965466	0.32	0.01	Leson clay, 1 to 3 percent slopes	95% Leson, moderately well drained, very high rate of run off, very low erosion potential	Lake Creek	Sulphur/South Sulphur River (0303), not impaired; North Sulphur River (0305), not impaired
SH 19 AT FM 1536	Hopkins	0400-02-059	Safety Lighting	33.323857	-95.5896586	33.3238570	-95.5896586	0.16	0.01	Crockett loam, 1 to 3 percent slopes; Crockett loam, 2 to 5 percent slopes, eroded	85% Crockett, moderately well drained, very high rate of run off, very low erosion potential; 100% Crockett, moderately well drained, very high rate of run off, moderate erosion potential	Vaden Creek	'Sulphur/South Sulphur River (0303), not impaired
FM 1567 AT FM 2297	Hopkins	0641-04-021	Safety Lighting	33.016408	-95.6477729	33.0164083	-95.6477729	0.09	0.01	Wolfpen loamy fine sand, 2 to 5 percent slopes	90% Wolfpen, well drained, very low rate of run off, very low erosion potential	Brushy Creek; Birch Creek	Lake Fork Reservoir (0512), not impaired
SH 154 AT CR 2174	Hopkins	0401-01-036	Safety Lighting	33.065304	-95.5993283	33.0653043	-95.5993283	0.12	0.01	Freestone fine sandy loam, 1 to 3 percent slopes	85% Freestone, moderately well drained, medium rate of run off, very low erosion potential	Kennedy Creek	Rock Creek (0303D), not impaired
FM 2737 AT SH 276	Rains	2799-02-006	Safety Lighting	32.896452	-95.9191476	32.8964520	-95.9191476	0.24	0.02	Crockett loam, 1 to 3 percent slopes	85% Crockett, moderately well drained, very high rate of run off, very low erosion potential	Schoolhouse Branch	Lake Tawakoni (0507), not impaired

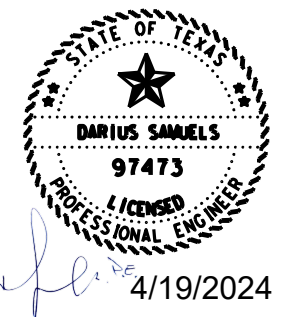

**STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre) Sheet 3 of 3**



FED. RD. DIV. NO.				SHEET NO.
				<b>74</b>
STATE	STATE DIST.	COUNTY		
TEXAS	PAR	HUNT, ETC.		
CONT.	SECT.	JOB	HIGHWAY NO.	
0009	13	197, ETC	IH 30, ETC.	

DATE: 4/18/2024 9:51:15 AM  
 FILE: t:\partraf\ashley\projects\safety lighting let\_8-24\STANDARDS\epic.dgn  
 The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

**I. STORMWATER POLLUTION PREVENTION-CLEAN WATER ACT SECTION 402**

TPDES TXR 150000: Stormwater Discharge Permit or Construction General Permit required for projects with 1 or more acres disturbed soil. Projects with any disturbed soil must protect for erosion and sedimentation in accordance with Item 506.

List MS4 Operator(s) that may receive discharges from this project. They may need to be notified prior to construction activities.

1.  
2.
- No Action Required     Required Action

- Action No.
1. Prevent stormwater pollution by controlling erosion and sedimentation in accordance with TPDES Permit TXR 150000
  2. Comply with the SW3P and revise when necessary to control pollution or required by the Engineer.
  3. Post Construction Site Notice (CSN) with SW3P information on or near the site, accessible to the public and TCEQ, EPA or other inspectors.
  4. When Contractor project specific locations (PSL's) increase disturbed soil area to 5 acres or more, submit NOI to TCEQ and the Engineer.

**II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS CLEAN WATER ACT SECTIONS 401 AND 404**

USACE Permit required for filling, dredging, excavating or other work in any water bodies, rivers, creeks, streams, wetlands or wet areas. The Contractor must adhere to all of the terms and conditions associated with the following permit(s):

- No Permit Required
- Nationwide Permit 14 - PCN not Required (less than 1/10th acre waters or wetlands affected)
- Nationwide Permit 14 - PCN Required (1/10 to <1/2 acre, 1/3 in tidal waters)
- Individual 404 Permit Required
- Other Nationwide Permit Required: NWP# \_\_\_\_\_

Required Actions: List waters of the US permit applies to, location in project and check Best Management Practices planned to control erosion, sedimentation and post-project TSS.

1.  
2.  
3.  
4.

The elevation of the ordinary high water marks of any areas requiring work to be performed in the waters of the US requiring the use of a nationwide permit can be found on the Bridge Layouts.

**Best Management Practices:**

<b>Erosion</b>	<b>Sedimentation</b>	<b>Post-Construction TSS</b>
<input type="checkbox"/> Temporary Vegetation	<input checked="" type="checkbox"/> Silt Fence	<input type="checkbox"/> Vegetative Filter Strips
<input type="checkbox"/> Blankets/Matting	<input type="checkbox"/> Rock Berm	<input type="checkbox"/> Retention/Irrigation Systems
<input type="checkbox"/> Mulch	<input type="checkbox"/> Triangular Filter Dike	<input type="checkbox"/> Extended Detention Basin
<input type="checkbox"/> Sodding	<input type="checkbox"/> Sand Bag Berm	<input type="checkbox"/> Constructed Wetlands
<input type="checkbox"/> Interceptor Swale	<input type="checkbox"/> Straw Bale Dike	<input type="checkbox"/> Wet Basin
<input type="checkbox"/> Diversion Dike	<input type="checkbox"/> Brush Berms	<input type="checkbox"/> Erosion Control Compost
<input type="checkbox"/> Erosion Control Compost	<input type="checkbox"/> Erosion Control Compost	<input type="checkbox"/> Mulch Filter Berm and Socks
<input type="checkbox"/> Mulch Filter Berm and Socks	<input type="checkbox"/> Mulch Filter Berm and Socks	<input type="checkbox"/> Compost Filter Berm and Socks
<input type="checkbox"/> Compost Filter Berm and Socks	<input type="checkbox"/> Compost Filter Berm and Socks	<input type="checkbox"/> Vegetation Lined Ditches
	<input type="checkbox"/> Stone Outlet Sediment Traps	<input type="checkbox"/> Sand Filter Systems
	<input type="checkbox"/> Sediment Basins	<input type="checkbox"/> Grassy Swales

**III. CULTURAL RESOURCES**

Refer to TxDOT Standard Specifications in the event historical issues or archeological artifacts are found during construction. Upon discovery of archeological artifacts (bones, burnt rock, flint, pottery, etc.) cease work in the immediate area and contact the Engineer immediately.

- No Action Required     Required Action

Action No.

1.  
2.  
3.  
4.

**IV. VEGETATION RESOURCES**

Preserve native vegetation to the extent practical. Contractor must adhere to Construction Specification Requirements Specs 162, 164, 192, 193, 506, 730, 751, 752 in order to comply with requirements for invasive species, beneficial landscaping, and tree/brush removal commitments.

- No Action Required     Required Action

Action No.

1.  
2.  
3.  
4.

**V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRDS.**

- No Action Required     Required Action

Action No.

1.  
2.  
3.  
4.

If any of the listed species are observed, cease work in the immediate area, do not disturb species or habitat and contact the Engineer immediately. The work may not remove active nests from bridges and other structures during nesting season of the birds associated with the nests. If caves or sinkholes are discovered, cease work in the immediate area, and contact the Engineer immediately.

**LIST OF ABBREVIATIONS**

BMP: Best Management Practice	SPCC: Spill Prevention Control and Countermeasure
CGP: Construction General Permit	SW3P: Storm Water Pollution Prevention Plan
DSHS: Texas Department of State Health Services	PCN: Pre-Construction Notification
FHWA: Federal Highway Administration	PSL: Project Specific Location
MOA: Memorandum of Agreement	TCEQ: Texas Commission on Environmental Quality
MOU: Memorandum of Understanding	TPDES: Texas Pollutant Discharge Elimination System
MS4: Municipal Separate Stormwater Sewer System	TPWD: Texas Parks and Wildlife Department
MBTA: Migratory Bird Treaty Act	TxDOT: Texas Department of Transportation
NOT: Notice of Termination	T&E: Threatened and Endangered Species
NWP: Nationwide Permit	USACE: U.S. Army Corps of Engineers
NOI: Notice of Intent	USFWS: U.S. Fish and Wildlife Service

**VI. HAZARDOUS MATERIALS OR CONTAMINATION ISSUES**

General (applies to all projects):

Comply with the Hazard Communication Act (the Act) for personnel who will be working with hazardous materials by conducting safety meetings prior to beginning construction and making workers aware of potential hazards in the workplace. Ensure that all workers are provided with personal protective equipment appropriate for any hazardous materials used. Obtain and keep on-site Material Safety Data Sheets (MSDS) for all hazardous products used on the project, which may include, but are not limited to the following categories: Paints, acids, solvents, asphalt products, chemical additives, fuels and concrete curing compounds or additives. Provide protected storage, off bare ground and covered, for products which may be hazardous. Maintain product labelling as required by the Act. Maintain an adequate supply of on-site spill response materials, as indicated in the MSDS. In the event of a spill, take actions to mitigate the spill as indicated in the MSDS, in accordance with safe work practices, and contact the District Spill Coordinator immediately. The Contractor shall be responsible for the proper containment and cleanup of all product spills.

Contact the Engineer if any of the following are detected:

- \* Dead or distressed vegetation (not identified as normal)
- \* Trash piles, drums, canister, barrels, etc.
- \* Undesirable smells or odors
- \* Evidence of leaching or seepage of substances

Does the project involve any bridge class structure rehabilitation or replacements (bridge class structures not including box culverts)?

- Yes     No

If "No", then no further action is required. If "Yes", then TxDOT is responsible for completing asbestos assessment/inspection.

Are the results of the asbestos inspection positive (is asbestos present)?

- Yes     No

If "Yes", then TxDOT must retain a DSHS licensed asbestos consultant to assist with the notification, develop abatement/mitigation procedures, and perform management activities as necessary. The notification form to DSHS must be postmarked at least 15 working days prior to scheduled demolition.

If "No", then TxDOT is still required to notify DSHS 15 working days prior to any scheduled demolition.

In either case, the Contractor is responsible for providing the date(s) for abatement activities and/or demolition with careful coordination between the Engineer and asbestos consultant in order to minimize construction delays and subsequent claims.

Any other evidence indicating possible hazardous materials or contamination discovered on site. Hazardous Materials or Contamination Issues Specific to this Project:

- No Action Required     Required Action

Action No.

1.  
2.  
3.


**VII. OTHER ENVIRONMENTAL ISSUES**

(includes regional issues such as Edwards Aquifer District, etc.)

- No Action Required     Required Action

Action No.

1.  
2.  
3.

 Texas Department of Transportation		<i>Design Division Standard</i>	
<b>ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS</b>			
<b>EPIC</b>			
FILE: epic.dgn	DN: TxDOT	CK: RG	DW: VP
©TxDOT: February 2015	CONT	SECT	JOB
12-12-2011 (DS) REVISIONS	0009	13	197, ETC
05-07-14 ADDED NOTE SECTION IV.	DIST	COUNTY	IH 30, ETC.
01-23-2015 SECTION I (CHANGED ITEM 1122 TO ITEM 506, ADDED GRASSY SWALES.	PAR	HUNT, ETC.	SHEET NO. 75