INDEX OF SHEETS SEE SHEET 2

- BEGIN PROJECT

STATE OF TEXAS DEPARTMENT OF TRANSPORTATION

PLANS OF PROPOSED

STATE HIGHWAY IMPROVEMENT

PROJECT NO. STP2B24(357)HES

CSJ: 1986-01-072


MONTGOMERY FM 1314

BEGIN PROJECT LOCATION

> END PROJECT LOCATION


LIMITS FROM: OLD HOUSTON ROAD TO: LOOP 494

NET LENGTH OF PROJECT = 36,649.12 FT = 7.51 MI INSTALLATION OF FIBER OPTIC CABLE FOR TRAFFIC SIGNAL INTERCONNECT

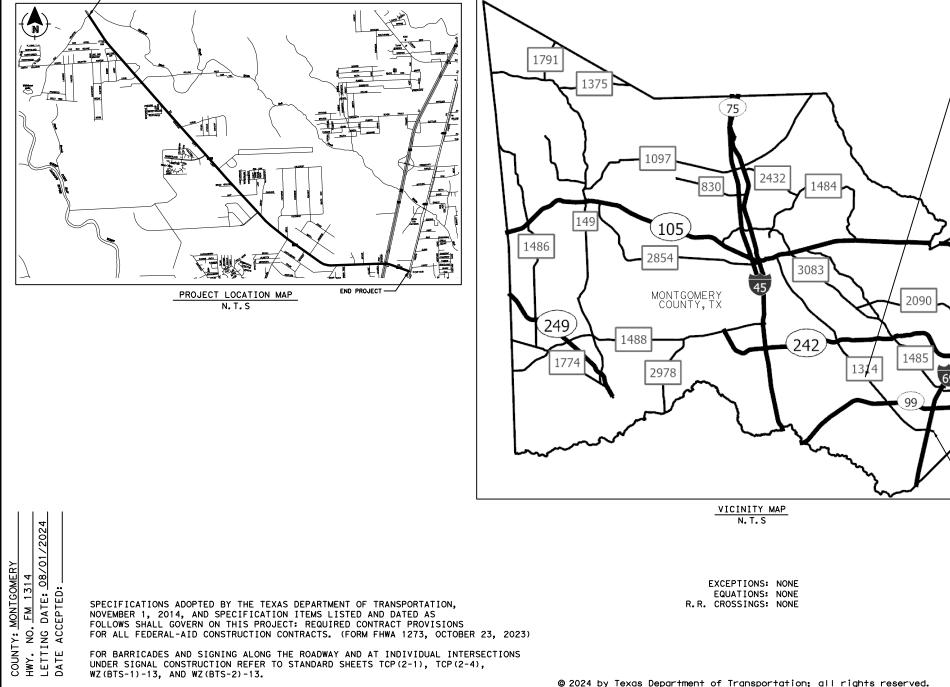

FED.RD. DIV.NO.		PROJECT NO.			
6		STP2B24 (357) HES			
STATE		STATE DIST.			
TEXA	S	HOU	MONTGOMERY		
CONT.		SECT.	JOB	AY	
198	6	01	072	314	
LETTING DATE: 08/01/2024				024	

- POSTED SPEED = 55 MPH (OLD HOUSTON RD RIVERWALK DR) = 50 MPH (RIVERWALK DR VALLEY RANCH PKWY) = 40 MPH (VALLEY RANCH PKWY SL 494)
 - AADT 2024 = 36,322 (170H121) = 25,692 (170H120)
- FUNCTIONAL CLASSIFICATION = MINOR ARTERIAL



©2024	
Texas Department of	Transportation®
SUBMITTED FOR LETTING	05/24/2024
APPROVED FOR DELTING by:	5/24/2024
For DISTRICT ENGINEE8C2D7C24E543D	, P.E.

INDEX OF SHEETS

1	TITLE SHEET
2	INDEX OF SHEETS
3,3A-3G	GENERAL NOTES
4	ESTIMATE AND QUANTITY SHEET
5	SUMMARY OF QUANTITIES
6-39	FIBER OPTIC CABLE LAYOUTS
40-43	FIBER CABLE TERMINATION ASSIGNMENTS S/M
44	WZ (BTS-1)-13
45	WZ (BTS-2)-13
46	ED (1)-14
47	ED (2)-14
48	ED (3)-14
49	ED (4)-14
50	ITS (27)-16
51	ITS (28)-16
52	ITS (31)-16
53	ITS (35)-16
54	ITS (37) -22
55	ITS (38) -17
56	ITS (42) -16
57	ITS (43) -16
58	BC (1) -21
59	BC (2) -21
60	BC (3) -21
61	BC (4) -21
62	BC (5) -21
63	BC (6) -21
64	BC (7) -21
65	BC (8) -21
66	BC (9) -21
67	BC (10) -21
68	BC (11) -21
69	BC (12) -21
70	TCP (1-1) -18
71	TCP (1-4) -18
72	TCP (2-1) -18
73	TCP (2-4) -18
74	EC (1) -16
75	EPIC - ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS
76-77	STORMWATER POLLUTION PREVENTION PLAN (SWP3)

ROMA G. STEVENS 100354	
Roma Stavens Roma G. Stevens, P.E.	5/23/2024 DATE
©2024	PRINT DATE REVISION DATE 5/23/2024 5/23/2024
	Transportation ECHNICAL SINEERING FIRM F-13097 PHONE: (713) 828-4742
FM 131 FROM OLD HO RD TO LOOI	4 DUSTON > 494
INDEX OF S	HEETS
BID: NO: PROJECT NO 6 SEE TITLE SH STATE DIST TEXAS HOU CONT SECT	IEET 2 COUNTY ITGOMERY
CONT SECT JUB	HIGHWAY

Highway: FM 1314

General Notes:

General:

Area Engineer contact information for this project follows:

Montgomery County Abraham Guzman, P.E. (936) 538-3300

Submit any questions about this project via the Letting Pre-Bid Q&A web page, located at:

https://tableau.txdot.gov/views/ProjectInformationDashboard/NoticetoContractors

The Letting Pre-Bid Q&A web page for each project can be accessed by scrolling or filtering the dashboard using the controls on the left side to navigate to the project. Hover over the blue hyperlink of the project to view the Q&A and click on the link in the window that pops up.

Large files with relevant project documentation, such as Geotech reports, As-Built plans, and cross-sections will continue to be provided on the following FTP site:

Index of /pub/txdot-info/Pre-Letting Responses/Houston District (state.tx.us) or https://ftp.dot.state.tx.us/pub/txdot-info/Pre-Letting%20Responses/Houston%20District/

References to manufacturer's trade name or catalog numbers are for the purpose of identification only. Similar materials from other manufacturers are permitted if they are of equal quality, comply with the specifications for this project, and are approved, except for roadway illumination, electrical, and traffic signal items.

The cost for materials, labor, and incidentals to provide for traffic across the roadway and for ingress and egress to private property in accordance with Section 7.2.4 of the standard specifications is subsidiary to the various bid items. Restore access roadways to their original condition upon completing construction.

Procure permits and licenses, which are to be issued by the City, County, or Municipal Utility District.

General: Roadway Illumination and Electrical

For roadway illumination and electrical items, use materials from pre-qualified producers as shown on the Construction Division (CST) of the Department's material producers list. Check the latest link on the Department's website for this list. The category/item is "Roadway Illumination and Electrical Supplies." No substitutions will be allowed for materials found on this list. Perform electrical work in conformance with the National Electrical Code (NEC) and the Department's standard sheets.

General: Traffic Signals

For traffic signal items, use materials from the Pre-Qualified Producers List (located at <u>http://www.dot.state.tx.us/GSD/purchasing/supps.htm</u>) and the materials pre-qualified for illumination and electrical items (located at <u>https://ftp.dot.state.tx.us/pub/txdot-info/cmd/mpl/archive/</u>) as shown on the Department's Material Producers List and the Roadway Illumination and Electrical Supplies List. Check the latest links on the Department's website for these lists. No substitutions will be allowed for materials found on these lists.

General: Site Management

Mow the grass and weeds within the project limits a maximum of 3 times a year as directed. This work is subsidiary to the various bid items.

Mark stations every 100 ft. and maintain the markings for the project duration. Remove the station markings at the completion of the project. This work is subsidiary to the various bid items.

Do not mix or store materials, or store or repair equipment, on top of concrete pavement or bridge decks unless authorized by the Engineer. Permission will be granted to store materials on surfaces if no damage or discoloration will result.

Personal vehicles of employees are not permitted to park within the right of way, including sections closed to public traffic. Employees may park on the right of way at the Contractor's office, equipment, and materials storage yard sites.

Assume ownership of debris and dispose of at an approved location. Do not dispose of debris on private property unless approved in writing by the District Engineer.

General: Traffic Control and Construction

When design details are not shown on the plans, provide signs and arrows conforming to the latest "Standard Highway Sign Designs for Texas" manual.

General: Utilities

Consider the locations of underground utilities depicted in the plans as approximate and employ responsible care to avoid damaging utility facilities. Depending upon scope and magnitude of planned construction activities, advanced field confirmation by the utility owner or operator may be prudent. Where possible, protect and preserve permanent signs, markers, and designations of underground facilities.

Control: 1986-01-072

Sheet: 3

Highway: FM 1314

If the Contractor damages or causes damage (breaks, leaks, nicks, dents, gouges, etc.) to the utility, contact the utility facility owner or operator immediately.

At least 72 hours before starting work, make arrangements for locating existing Departmentowned above ground and underground fiber optic, communications, power, illumination, and traffic signal cabling and conduit. Do this by calling the Department's Houston District Traffic Signal Operations Office at 713-802-5662, or by e-mailing the Department's Houston District Traffic Signal Operations Office at: HOU-LocateRequest@txdot.gov, to schedule marking of underground lines on the ground. Use caution if working in these areas to avoid damaging or interfering with existing facilities.

Notify the Engineer at least 48 hours before constructing junction boxes at storm drain and utility intersections.

Install or remove poles and luminaires located near overhead or underground electrical lines using established industry and utility safety practices. Consult the appropriate utility company before beginning such work.

If overhead or underground power lines need to be de-energized, contact the electrical service provider to perform this work. Costs associated with de-energizing the power lines or other protective measures required are at no expense to the Department.

If working near power lines, comply with the appropriate sections of Texas State Law and Federal Regulations relating to the type of work involved.

Perform electrical work in conformance with the National Electrical Code (NEC) and Department's standard sheets.

Locate all underground utilities within the limits of the project. Provide all equipment necessary for locating the utilities, locate and mark the utilities prior to doing any earthwork in the area. Consider this work incidental to the various bid items.

The locations of existing underground conduits as shown in the plans are approximate. Caution should be taken prior to excavation where underground utilities, conduits and water sprinkler system may exist and run in conflict with the proposed route of the new conduits. It is the contractor's responsibility to locate all of them before excavation. In the event that any part of the existing underground utilities, conduits and water sprinkler systems are damaged during construction, the contractor will repair or replace the damaged equipment immediately at no cost to the department. Consider the cost for locating existing underground utilities, conduits and water sprinkler system subsidiary to various bid items.

Interconnect the new equipment to the computerized transportation management system in a manner which does not interfere with the operation of remaining system components.

Item 5: Control of Work

Submit shop drawings electronically for the fabrication of items as documented in Table 1 or Table 2 below. Information and requirements for electronic submittals can be viewed in the "Guide to Electronic Shop Drawing Submittal" which can be accessed through the following web link, https://ftp.txdot.gov/pub/txdot-info/library/pubs/bus/bridge/e submit guide.pdf References to 11 in. x 17 in. sheets in individual specifications for structural items imply electronic CAD sheets.

2014 Construction Specification Required Shop/Working Drawing Submittals - Consultant Generated Plans							
Spec Item No.'s	Product	Submittal Required	Approval Required (Y/N)	Contractor/ Fabricator P.E. Seal Required	Reviewing Party	Shop or Working Drawing (Note 1)	
7.16.1&.2	Construction Load Analyses	Y	Y	Y	D	WD	
400	Excavation and Backfill for Structures (cofferdams)	Y	Ν	Y	D	WD	
403	Temporary Special Shoring	Y	N	Y	D	WD	
420	Formwork/Falsework	Y	N	Y	D	WD	
423	Retaining Walls, (calcs req'd.)	Y	Y	Y	D	SD	
425	Optional Design Calculations (Prstrs Bms)	Y	Y	Y	D	SD	
425	Prestr Concr Sheet Piling	Y	Y	Ν	D	SD	
425	Prestr Concr Beams	Y	Y	N	D	SD	
425	Prestr Concr Bent	Y	Y	Ν	D	SD	
426	Post Tension Details	Y	Y	Ν	D	SD	
434	Elastomeric Bearing Pads (All)	Y	Y	N	D	SD	
441	Bridge Protective Assembly	Y	Y	N	D	SD	
441	Misc Steel (various steel assemblies)	Y	Y	N	D	SD	
441	Steel Pedestals (bridge raising)	Y	Y	N	D	SD	
441	Steel Bearings	Y	Y	N	D	SD	
441	Steel Bent	Y	Y	N	D	SD	
441	Steel Diaphragms	Y	Y	N	D	SD	
441	Steel Finger Joint	Y	Y	N	D	SD	
441	Steel Plate Girder	Y	Y	N	D	SD	
441	Steel Tub-Girders	Y	Y	N	D	SD	
441	Erection Plans, including Falsework	Y	Ν	Y	D	WD	
449	Sign Structure Anchor Bolts	Y	Y	N	D	SD	
450	Railing	Y	Y	N	D	SD	
462	Concrete Box Culvert	Y	Y	N	D	SD	
462	Concrete Box Culvert (Alternate Designs Only,calcs reqd.)	Y	Y	Y	D	SD	
464	Reinforced Concrete Pipe (Jack and Bore only; ONLY when requested)	Y	Y	Y	D	SD	
465	Pre-cast Junction Boxes, Grates, and Inlets	Y	Y	Ν	D	SD	
465	Pre-cast Junction Boxes, Grates, and Inlets (Alternate Designs Only, calcs req'd.)	Y	Y	Y	D	SD	
466	Pre-cast Headwalls and Wingwalls	Y	Y	N	D	SD	

Control: 1986-01-072

Sheet: 3A

Highway: FM 1314

467	Pre-cast Safety End Treatments	Y	Y	N	D	SD
495	Raising Existing Structure (calcs reqd.)	Y	Y	Y	D	SD
610	Roadway Illumination Supports (Non-Standard only, calcs reqd.)	Y	Y	Y	D	SD
613	High Mast Illumination Poles (Non- standard only, calcs reqd.)	Y	Y	Y	D	SD
627	Treated Timber Poles	Y	Y	N	D	SD
644	Special Non-Standard Supports (Bridge Mounts, Barrier Mounts, Etc.)	Y	Y	Y	D	SD
647	Large Roadside Sign Supports	Y	Y	Y	D	SD
650	Cantilever Sign Structure Supports - Alternate Design Calcs.	Y	Y	Y	D	SD
650	Sign Structures	Y	Y	N	D	SD
680	Installation of Highway Traffic Signals	Y	Y	N	D	SD
682	Vehicle and Pedestrian Signal Heads	Y	Y	N	D	SD
684	Traffic Signal Cables	Y	Y	N	D	SD
685	Roadside Flashing Beacon Assemblies	Y	Y	N	D	SD
686	Traffic Signal Pole Assemblies (Steel) (Non-Standard only)	Y	Y	Y	D	SD
687	Pedestal Pole Assemblies	Y	Y	N	D	SD
688	Detectors	Y	Y	N	D	SD
784	Repairing Steel Bridge Members	Y	Y	Y	D	WD
SS	Prestr Concr Crown Span	Y	Y	N	D	SD
SS	Sound Barrier Walls	Y	Y	Y	D	SD
SS	Camera Poles	Y	Y	Y	TMS	SD
SS	Pedestrian Bridge (Calcs req'd.)	Y	Y	Y	D	SD
SS	Screw-In Type Anchor Foundations	Y	Y	N	D	SD
SS	Fiber Optic/Communication Cable	Y	Y	N	TMS	SD
SS	Spread Spectrum Radios for Signals	Y	Y	Ν	D	SD
SS	VIVDS System for Signals	Y	Y	N	D	SD
SS	CTMS Equipment	Y	Y	Ν	TMS	SD

Notes:

1. Document flow for Working Drawings differs from Shop Drawings in that Working Drawings must be submitted to the Engineer rather than the Engineer of Record and they are for the information of the Engineer only; an approval stamp and distribution to all project offices is not required.

Key to Reviewing Party

D – Consultant: Submit to Engineer of Record at email@host.xxx					
TMS – Traffic Management System					
	1				
Computerized Traffic Management					
Systems (CTMS) <u>HOU-CTMSShpDrwgs@txdot.gov</u>					

Item 6: Control of Materials

To comply with the latest provisions of the Build America, Buy America Act (BABA Act) of the Bipartisan Infrastructure Law, the Contractor must submit a notarized original of the TxDOT Construction Material Buy America Certification Form for items classified as construction materials. This form is not required for materials classified as a manufactured product.

Refer to the Buy America Material Classification Sheet for clarification on material categorization.

The Buy America Material Classification Sheet is located at the below link. https://www.txdot.gov/business/resources/materials/buy-america-material-classificationsheet.html for clarification on material categorization.

Item 7: Legal Relations and Responsibilities

Do not initiate activities in a Project Specific Location (PSL), associated with a U.S. Army Corps of Engineers (USACE) permit area, that have not been previously evaluated by the USACE as part of the permit review of this project. Such activities include those pertaining to, but are not limited to, haul roads, equipment staging areas, borrow and disposal sites. Associated defined here means materials are delivered to or from the PSL. The permit area includes the waters of the U.S. or associated wetlands affected by activities associated with this project. Special restrictions may be required for such work. Assume responsibility for consultations with the USACE regarding activities, including PSLs that have not been previously evaluated by the USACE. Provide the Department with a copy of consultations or approvals from the USACE before initiating activities.

No significant traffic generator events have been identified.

Item 8: Prosecution and Progress

Working days will be computed and charged based on a *standard* workweek in accordance with Section 8.3.1.4.

The maximum number of days the time charges on this contract may be suspended due to contractor mobilization, and material fabrication/accumulation or processing delays is <u>90</u> days. The Engineer and the Contractor may mutually agree, in writing, to decrease this maximum number of days.

Item 502: Barricades, Signs, and Traffic Handling

Use a traffic control plan for handling traffic through the various phases of construction. Follow the phasing sequence unless otherwise agreed upon by the Area Engineer and the Project Manager. Ensure this plan conforms to the latest "Texas Manual on Uniform Traffic Control Devices" and the latest Barricade and Construction (BC) Standard Sheets. The latest versions of

Control: 1986-01-072

Sheet: 3B

Highway: FM 1314

Work Zone Standard Sheets WZ (BTS-1) and WZ (BTS-2) are the traffic control plan for the signal installations.

Submit changes to the traffic control plan to the Area Engineer. Provide a layout showing the construction phasing, signs, striping, and signalizations for changes to the original traffic control plan.

Furnish and maintain the barricades and warning signs, including the necessary temporary and portable traffic control devices, during the various phases of construction. Place and construct these barricades and warning signs in accordance with the latest "Texas Manual on Uniform Traffic Control Devices" for typical construction layouts.

Cover work zone signs when work related to the signs is not in progress, or when any hazard related to the signs no longer exists.

Keep the delineation devices, signs, and pavement markings clean. This work is subsidiary to the Item, "Barricades, Signs, and Traffic Handling."

If a section is not complete before the end of the workday, pull back the base material to the existing pavement edge on a 6H: 1V slope. Edge drop-offs during the hours of darkness are not permitted.

Before detouring traffic onto the mainlane shoulders, remove dirt, debris, vegetation, and other deleterious material from the surface of the shoulders. Appropriately sign the detour in an approved manner. This work is subsidiary to the various bid items.

Do not mount signs on drums or barricades, except those listed in the latest Barricades and Construction standard sheets.

Use traffic cones for daytime work only. Replace the cones with plastic drums during nighttime hours.

Place positive barriers to protect drop-off conditions greater than 2 ft. within the clear zone that remain overnight.

Do not reduce the existing number of lanes open to traffic except as shown on the following time schedule:

Day	Daytime Closure	Nighttime Closure	Restricted Hours Subject
	Hours	Hours	to Lane Assessment Fee
Monday	9:00 AM - 3:00 PM	N/A	5:00 AM - 9:00 AM 3:00 PM - 7:00 PM
Tuesday	9:00 AM - 3:00 PM	N/A	5:00 AM - 9:00 AM 3:00 PM - 7:00 PM

Day	Daytime Closure Hours	Nighttime Closure Hours	Restricted Hours Subject to Lane Assessment Fee
Wednesday	9:00 AM - 3:00 PM	N/A	5:00 AM - 9:00 AM 3:00 PM - 7:00 PM
Thursday	9:00 AM - 3:00 PM	N/A	5:00 AM - 9:00 AM 3:00 PM - 7:00 PM
Friday	9:00 AM - 3:00 PM	N/A	5:00 AM - 9:00 AM 3:00 PM - 7:00 PM
Saturday	9:00 AM - 3:00 PM	N/A	5:00 AM - 9:00 AM 3:00 PM - 7:00 PM
Sunday	N/A	N/A	N/A

The above times are approved for the traffic control conditions listed. The Area Engineer may approve other closure times if traffic counts warrant. The Area Engineer may reduce the above times for special events.

No street closures should be necessary for this work. During the construction, if street closure becomes necessary, it should be done on non-working days. The closure period for each intersection occurs only during the phase when constructing that street, unless otherwise directed. Reopen the street within the number of working days allowed; otherwise, the engineer may cease construction activities not affiliated with reopening the closed street, until it fully reopens to the traveling public. Time charges will not be suspended nor increased to compensate for this occurrence.

During the various phases of construction, maintain and relocate Logo signs/Specific Service signs located within the project limits. Maintenance and relocation of these signs are subsidiary to the Item, "Barricades, Signs, and Traffic Handling." These signs are Department-owned and administered by LoneStar Logos, a Department signage contractor.

Relocate a logo sign to avoid interference with construction phases as necessary. Assure that relocated signs meet clearance requirements. If clearance requirements cannot be met using the existing sign, contact the logo sign contractor to manufacture and deliver to the jobsite a smaller logo sign within 3 weeks. If there is absolutely no room to display the relocated logo sign, 2 weeks before relocating, contact the logo sign contractor to remove the sign and place it in storage. The telephone number for LoneStar Logos is (512) 462-1310 and the e-mail address for the regional manager, Tyler Starr, is tstarr@lonestarlogos.com.

When relocating a logo sign, provide wooden skid mounted sign supports for the sign that are crashworthy and in accordance with the latest edition of the "Texas Manual on Uniform Traffic Control Devices." Specific information on crash worthy skid mounted signs can be found at: http://d2dtl5nnlpfr0r.cloudfront.net/tti.tamu.edu/documents/0-6782-2.pdf

Control: 1986-01-072

Sheet: 3C

Highway: FM 1314

The Contractor Force Account "Safety Contingency" that has been established for this project is intended to be utilized for work zone enhancements, to improve the effectiveness of the Traffic Control Plan, that could not be foreseen in the project planning and design stage. These enhancements will be mutually agreed upon by the Engineer and the Contractor's Responsible Person based on weekly or more frequent traffic management reviews on the project. The Engineer may choose to use existing bid items if it does not slow the implementation of enhancement.

Item 506: Temporary Erosion, Sedimentation and Environmental Controls

The use of hay bales is not permitted as Storm Water Pollution Prevention Plan (SWP3) measures.

The Storm Water Pollution Prevention Plan (SWP3) consists of temporary erosion control measures needed and provided for under this Item. The disturbed area is less than one acre and use of erosion control measures is not anticipated. If physical conditions encountered at the job site require necessary controls, BMP installation, maintenance, and removal will be paid as extra work on a force account basis per Articles 4.4 and 9.7. Since the disturbed area is less than 5 acres, a "Notice of Intent" (NOI) is not required.

Use appropriate measures to prevent, minimize, and control the spill of hazardous materials in the construction staging area. Remove and dispose of materials in compliance with State and Federal laws.

Before starting construction, review with the Engineer the SWP3 used for temporary erosion control as outlined on the plans. Before construction, place the temporary erosion and sedimentation control features as shown on the SWP3.

Schedule the seeding or sodding work as soon as possible. The project schedule provides for a vegetation management plan.

After completing earthwork operations, restore and reseed the disturbed areas in accordance with the Department's specifications for permanent or temporary erosion control.

Implement temporary and permanent erosion control measures to comply with the National Pollution Discharge Elimination System (NPDES) general permit under the Clean Water Act.

Before starting grading operations and during the project duration, place the temporary or permanent erosion control measures to prevent sediment from leaving the right of way.

Item 618: Conduit **Item 620: Electrical Conductors**

If the specifications for electrical items require UL-listed products, this means UL-listed or CSAlisted.

Item 618: Conduit

When backfilling bore pits, ensure that the conduit is not damaged during installation or due to settling backfill material. Compact select backfill in 3 equal lifts to the bottom of the conduit; or if using sand, place it 2 in. above the conduit. Ensure backfill density is equal to that of the existing soil. Prevent material from entering the conduit.

Construct bore pits a minimum of 5 ft. from the edge of the base or pavement. Close the bore pit holes overnight.

Unless otherwise shown on the plans, install underground conduit a minimum of 24 in. deep. Install the conduit in accordance with the latest National Electrical Code (NEC) and applicable Department standard sheets. Place conduit under driveways or roadways a minimum of 24 in. below the pavement surface.

If using casing to place bored conduit, the casing is subsidiary to the conduit.

If placing the conduit under existing pavement to reach the service poles, bore the conduit in place and extend it a minimum distance of 5 ft. beyond the edge of shoulder or the back of curb.

Where PVC, duct cable, and HDPE conduit 1 in. and larger is allowed and installed per Department standards, provide a PVC elbow in place of the galvanized rigid metal elbow required by the Electrical Details standards. Ensure the PVC elbow is of the same schedule rating as the conduit to which it is connected. Use only a flat, high tensile strength polyester fiber pull tape to pull conductors through the PVC conduit system.

Remove conductor and conduit to be abandoned to 1 ft. below the ground level. This work is subsidiary to the various bid items.

Do not use cast iron junction boxes in concrete traffic barriers and single slope traffic barriers. Use polymer concrete junction boxes as shown on standard sheet ED(4)-14. Mount the junction boxes flush (+0 in., -1/2 in.) with the concrete surface of the concrete barrier.

Locate the underground utilities within the project limits. Provide the equipment necessary for locating these utilities, locate, and mark them before starting any excavation work in the area. This work is subsidiary to the various bid items. If the Contractor damages or cause damage to any existing underground utilities, repair such damage at no cost to the Department.

Ensure the interconnection of new equipment to the existing system does not interfere with the operation of the remaining system components. Ensure the system remains completely operational between the hours of 6:00 a.m. Monday and 12:00 a.m. (midnight) Saturday.

Do not interrupt system operation without coordinating with the Department's operations personnel at Houston Transtar at (713) 881-3285.

Perform work to be done on cables during weekends only.

Control: 1986-01-072

Sheet: 3D

General Notes

Highway: FM 1314

Provide Liquid-Tight Flexible Metal (LTFM) conduit if the plans refer to flexible metal conduit. Do not use flexible metal conduit.

Unless otherwise shown on the plans, place conduit runs behind curbs at locations where curbs exist.

Use schedule 80 PVC conduit to house conductor runs under paved riprap, roadway, or driveways, unless otherwise shown on the plans.

Use Rigid Metal Conduit (RMC) for exposed conduit.

Before backfilling conduit trenches, place a detectable underground metalized mylar marking tape above the conduit and concrete encasement. Imprint the marking tape with, "TxDOT CONDUIT AND FIBER OPTIC CABLE SYSTEM. CALL (713) 802-5909 BEFORE PROCEEDING" every 18 in. Supplying and installing the marking tapes is subsidiary to the various bid items.

Conduit elbows and rigid metal extensions required when installing PVC conduit systems are subsidiary to the various bid items.

Install a continuous bare or green insulated copper wire No. 8 AWG or larger in every conduit throughout the electrical system in accordance with the Electrical Detail Standard Sheets, and the latest edition of the NEC.

Provide a single 1/C #14 insulated wire in conduit runs which have been identified in the plans to carry fiber optic cable. Provide UL-listed solid copper wire with orange color low density polyethylene insulation, suitable for conduit installation, rated for a temperature range of -20 C to +60 C and a voltage rating of 600V. This wire will serve as a tracer, or locate, wire for locating underground conduit containing fiber optic cabling and will be paid for under Item 620, "Electrical Conductors."

Item 620: Electrical Conductors

Test each wire of each cable or conductor after installation. Incomplete circuits or damage to the wire or the cable are cause for immediate rejection of the entire cable being tested. Remove and replace the entire cable at no expense to the Department. Also test the replacement cable after installation.

When pulling cables or conductors through the conduit, do not exceed the manufacturer's recommended pulling tensions. Lubricate the cables or conductors with a lubricant recommended by the cable manufacturer.

For both transformer and shoe-base type illumination poles, provide double-pole breakaway fuse holders as shown on the Department's Construction Division (CST) material producers list. Check the latest link on the Department's website for this list. The category is "Roadway

Illumination and Electrical Supplies." The fuse holder is shown on the list under Items 610 and 620. Provide 10 Amp time delay fuses.

Ensure that circuits test clear of faults, grounds, and open circuits.

Split bolt connectors are allowed only for splices on the grounding conductors.

For Roadside Flashing Beacon Assemblies (Item 685) and Pedestal Pole Assemblies (Item 687) within the project, provide single-pole breakaway disconnects as shown on the Construction Division (CST) material producers list. Check the latest link on the Department's website for this list. The category is "Roadway Illumination and Electrical Supplies." The fuse holder is shown on the list under Item 685. For underground (hot) conductors, install a breakaway connector with a dummy fuse (slug). Provide dummy fuse (slug). For grounded (neutral) conductors, install a breakaway connector with a white colored marking and a permanently installed dummy fuse (slug).

For electrical licensing and electrical certification requirements for this project, see Item 7 of the Standard Specifications and any applicable special provisions to Item 7.

Item 624: Ground Boxes

The ground box locations are approximate. Alternate ground box locations may be used as directed, to avoid placing in sidewalks or driveways.

Ground metal ground box covers. Bond the ground box cover and ground conductors to a ground rod located in the ground box and to the system ground.

Ground the existing metal ground box covers as shown on the latest standard sheet ED (4)-14.

During construction and until project completion, provide personnel and equipment necessary to remove ground box lids for inspection. Provide this assistance within 24 hours of notification.

Construct concrete aprons in accordance with the latest standard sheet ED (4)-14. Make the depth of the concrete apron the same as the depth of the ground box, except for Type 1 and Type 2 ground boxes. For Type 1 or Type 2 ground boxes, construct the concrete apron in accordance with details shown on the "Ground Box Details Installations" standard.

Item 6007: Intelligent Transportation System (ITS) Fiber Optic Cable

Seal each end of the communications cable that is exposed to elements during storage or after installing with a waterproof sealant, or as per manufacturer recommendations.

Ensure each communication cable run is continuous without splices from controller to controller.

Control: 1986-01-072

Sheet: 3E

Highway: FM 1314

Assume responsibility for the signal carrying capability and performance of the cable. Install each wire with a lightning protection device unless otherwise noted. Ground the cable in accordance with the manufacturer's recommendation.

Locations of underground installations are approximate. It is the contractor's responsibility to verify all utility locations prior to any construction.

The contractor shall contact public and private utilities for location of underground facilities at least 72 hours prior to any drilling, boring, trenching or excavating.

The contractor shall be fully responsible for any damages caused by contractor's failure to locate and preserve these utilities whether underground, above ground or overhead.

All work must be performed within TxDOT right of way.

Data communication switch (ethernet) to be supplied by TxDOT.

Use type 1 ground box, installed near controller, exclusively for fiber optic cable with conduit only.

Do not install other electrical cable or conduit in the type 1 ground box. Ground metal ground box cover. Bond the ground box cover and ground conductors to the ground rod located in the ground box and the system ground.

All existing controllers should be compatible with its system.

During construction and until project completion, provide personnel and equipment necessary to remove ground box lids for inspection. Provide this assistance within 24 hours of notification.

For each ground box on this project in which cable is added or removed, affix a tag to the cabling remaining in the box clearly stating that the box contains cabling which is supplied by more than one source. Ensure the tag is laminated and has minimum dimensions of 4 inches by 6 inches. The ground box locations are approximate. Alternate ground box locations may be used as directed, to avoid placing in sidewalks or driveways.

For type 1 ground box construct the concrete apron in accordance with details shown on the "ground box details its (37)-16" standard.

Fully test the proposed fiber optic cable in accordance with the testing requirements of the specifications.

Fiber optic cables coiled in ground boxes with waterproof splice enclosures shall not exceed fifteen feet per cable unless otherwise shown in the plans or as directed by engineer in the field. If using casing to place bored conduit, consider the casing incidental to the conduit.

If working near power lines, comply with the appropriate sections of Texas state law and federal regulations relating to the type of work involved.

Provide a single 1#14 insulated wire in conduit runs which have been identified in the plans to carry fiber optic cable. Provide UL listed solid copper wire with orange color type XHHW polyethylene insulation. This wire will serve as a tracer or locate wire for locating underground conduit containing fiber optic cabling and will be paid for under item 620, "electrical conductors".

Furnish all equipment, material and labor necessary for identification and protection of the utilized fiber.

Construct bore pits a minimum of five feet from the edge of the base, or pavement, close the bore pit holes overnight. Consider payment for bored conduit as the width of the roadway plus five feet on each side of roadway.

Repair or replace pavement and sidewalks damaged by the contractor's forces during construction at no cost to the department.

Each fiber optic cable run in underground conduits shall have an extra length of fifteen feet coiled and left in each ground box unless otherwise shown in the plans or as directed by the engineer in the field.

Ground all existing metal ground box covers as outlined on latest standard sheet ed(4)-14. Replacements for these ground boxes must be made of polymer concrete as detailed on the latest standard sheet ed(4)-14. The materials and labor associated with this work is subsidiary to various bid items in project.

Limits of pay for bored conduits shall not extend more than five feet in front of and beyond the roadway or driveway that is being bored under. When multiple driveways exist, the contractor may be allowed to bore under the entire group of driveways provided the driveways do not exceed forty foot spacing as approved by the engineer in the field. No increase for bored conduits will be incurred for this work. Conduit bored between multiple driveways to be paid for as trenched conduit.

Construct concrete apron, if necessary, in accordance with the latest standard sheet ed(4)-14. For tyl ground box construct apron in accordance with details shown on the "ground box details its(37)-16" standard.

Install a fiber optic patch panel on the fiber drop cable in each controller cabinet. The fiber optic

Control: 1986-01-072

Sheet: 3F

General Notes

Highway: FM 1314

patch panel (12 position) shall be considered incidental to the pertinent bid items in this project.

Furnish and install all fiber optic cables and accessories for a complete and operational system.

Use schedule 80 PVC conduit to house all conductor runs under paved riprap, roadway, or driveways unless otherwise shown in the plans.

Unless otherwise noted on the plans, place conduit runs behind curbs at all locations where curb exists.

Refer to TxDOT's website for prequalified products list regarding conduits, conductors, ground boxes and electrical service. Check website periodically for current updates.

Use rigid metal conduit (RMC) for exposed conduit.

Junction boxes used to attach to bridge structures shall be incidental to item 618,"condt (rm)".

When pulling cables or conductors through the conduit, do not exceed the manufacturer's recommended pulling tension. Lubricate the cables or conductors with lubricant recommended by the cable manufacturer.

Provide the fiber optic cable system complete with incidental work. Material and services not expressly called for in the specifications, or not shown on the plans, but which may be necessary for a complete and properly functioning system. Consider this as part of this bid item.

Item 6185: Truck Mounted Attenuator (TMA) and Trailer Attenuator (TA)

A shadow vehicle with Truck Mounted Attenuators (TMAs) or Trailer Attenuators (TAs) is required as shown on the appropriate Traffic Control Plan (TCP) sheets. TMAs/TAs must meet the requirements of the Compliant Work Zone Traffic Control Device List.

Level 3 Compliant TMAs/TAs are required for this project.

A total of one (1) shadow vehicle with a TMA/TA is required for the work with the exception of Pavement Marking Operations. The Contractor is responsible for determining if one or more of these operations will be ongoing at the same time to determine the total number of TMAs/TAs needed on the project.

A total of three (3) shadow vehicles with a TMA/TA are required for Pavement Marking Operations. The Contractor is responsible for determining if one or more of these operations will be ongoing at the same time to determine the total number of TMAs/TAs needed on the project. Control: 1986-01-072

Sheet: 3G



CONTROLLING PROJECT ID 1986-01-072

DISTRICT Houston **HIGHWAY** FM 1314 **COUNTY** Montgomery

Estimate & Quantity Sheet


		CONTROL SECTIO	ON JOB	1986-0	1-072		
		PROJI	ECT ID	A0019	3458		
		c	COUNTY		omery	TOTAL EST.	TOTAL FINAL
		HIGHWAY FM 1314		314			
ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL		
	500-6001	MOBILIZATION	LS	1.000		1.000	
	502-6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	MO	18.000		18.000	
	618-6053	CONDT (PVC) (SCH 80) (3")	LF	28,775.000		28,775.000	
	618-6054	CONDT (PVC) (SCH 80) (3") (BORE)	LF	12,555.000		12,555.000	
	618-6074	CONDT (RM) (3")	LF	455.000		455.000	
	620-6002	ELEC CONDR (NO.14) INSULATED	LF	41,355.000		41,355.000	
	6007-6011	FIBER OPTIC CBL (SNGLE-MODE)(12 FIBER)	LF	615.000		615.000	
	6007-6013	FIBER OPTIC CBL (SNGLE-MODE)(36 FIBER)	LF	43,240.000		43,240.000	
	6007-6089	FO SPLICE ENCLOSURE (TYPE 2)	EA	12.000		12.000	
	6007-6094	FIBER OPTIC FUSION SPLICE	EA	144.000		144.000	
	6007-6096	FIBER OPTIC PATCH PANEL (12 POSITION)	EA	12.000		12.000	
	6027-6004	JUNCTION BOX (INSTALL)	EA	4.000		4.000	
	6186-6002	ITS GND BOX(PCAST) TY 1 (243636)W/APRN	EA	79.000		79.000	
	18	LAW ENFORCEMENT: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS	1.000		1.000	
		EROSION CONTROL MAINTENANCE: CONTRACTOR FORCE ACCOUNT WORK (PART)	LS	1.000		1.000	
		SAFETY CONTINGENCY: CONTRACTOR FORCE ACCOUNT WORK (PARTICIPATING)	LS	1.000		1.000	




DISTRICT	COUNTY	CCSJ	SHEET
Houston	Montgomery	1986-01-072	4

	SUMMARY OF QUANTITIES					
ITEM	DESC CODE	DESCRIPTION	UNIT	QUANTITY		
500	6001	MOBILIZATION	LS	1		
502	6001	BARRICADES, SIGNS AND TRAFFIC HANDLING	МО	18		
618	6053	CONDT (PVC) (SCHD 80) (3")	LF	28,775		
618	6054	CONDT (PVC) (SCHD 80) (3") (BORE)	LF	12,555		
618	6074	CONDT (RM) (SCHD 80) (3")	LF	455		
620	6002	ELEC CONDR (NO.14) INSULATED	LF	41,355		
6007	6011	FIBER OPTIC CBL (SINGLE MODE) (12 FIBER)	LF	615		
6007	6013	FIBER OPTIC CBL (SINGLE MODE) (36 FIBER)	LF	43,240		
6007	6089	FO SPLICE ENCLOSURE (TY 2)	EA	12		
6007	6094	FIBER OPTIC FUSION SPLICE	EA	144		
6007	6096	FIBER OPTIC PATCH PANEL (12 POSITION)	EA	12		
6027	6004	JUNCTION BOX (INSTALL)	EA	4		
6186	6002	ITS GND BOX (PCAST) TY1 (243636) W/ APRON	EA	79		

			PRINT DATE	REVISION DATE								
			5/23/2024	5/23/2024								
Texa	Texas Department of Transportation [®]											
	TEX 813	TEVENS TE (AS REGISTERED ENGINE 17 JACKRABBIT ROAD ston, TX. 77095		F-13097								
F F F	F ROM RD T	FM 1314 OLD HO O LOOP										
	SUMMARY OF Quantities											
FED.RD. DIV.NO.		PROJECT NO.		SHEET NO.								
6	SE	EE TITLE SHE	ET	5								
STATE	DIST	CC	DUNTY									
TEXAS	HOU	MONT	GOMERY									
CONT	SECT	JOB	HIG	HWAY								
1986	01	072	FM	1314								

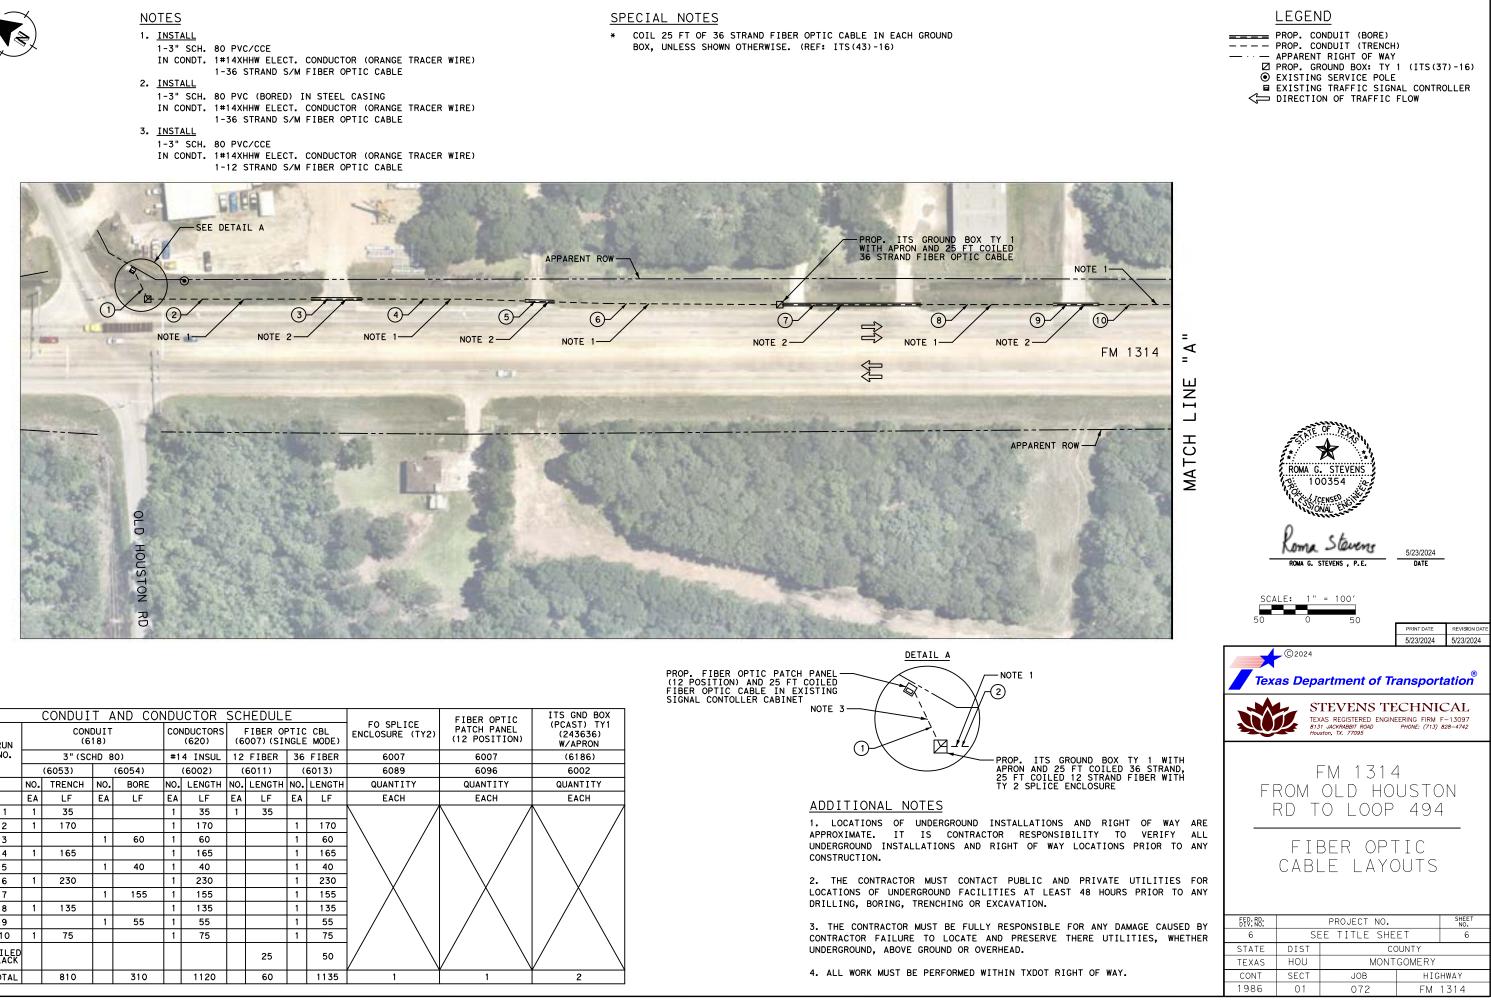

RUN		CONDUI coni (6			1	JCTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SI	PTIC		FO SPLICE ENCLOSURE (TY2)	FIBER OPTIC PATCH PANEL (12 POSITION)	ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH	EACH	EACH
1	1	35			1	35	1	35			\ /	Λ /	Ν /
2	1	170			1	170			1	170			
3			1	60	1	60			1	60			
4	1	165			1	165			1	165			
5			1	40	1	40			1	40	$ \land / $		
6	1	230			1	230			1	230			
7			1	155	1	155			1	155	\wedge	\land	
8	1	135			1	135			1	135			
9			1	55	1	55			1	55			$ / \rangle $
10	1	75			1	75			1	75			
COILED SLACK								25		50	/	/	
TOTAL		810		310		1120		60		1135	1	1	2

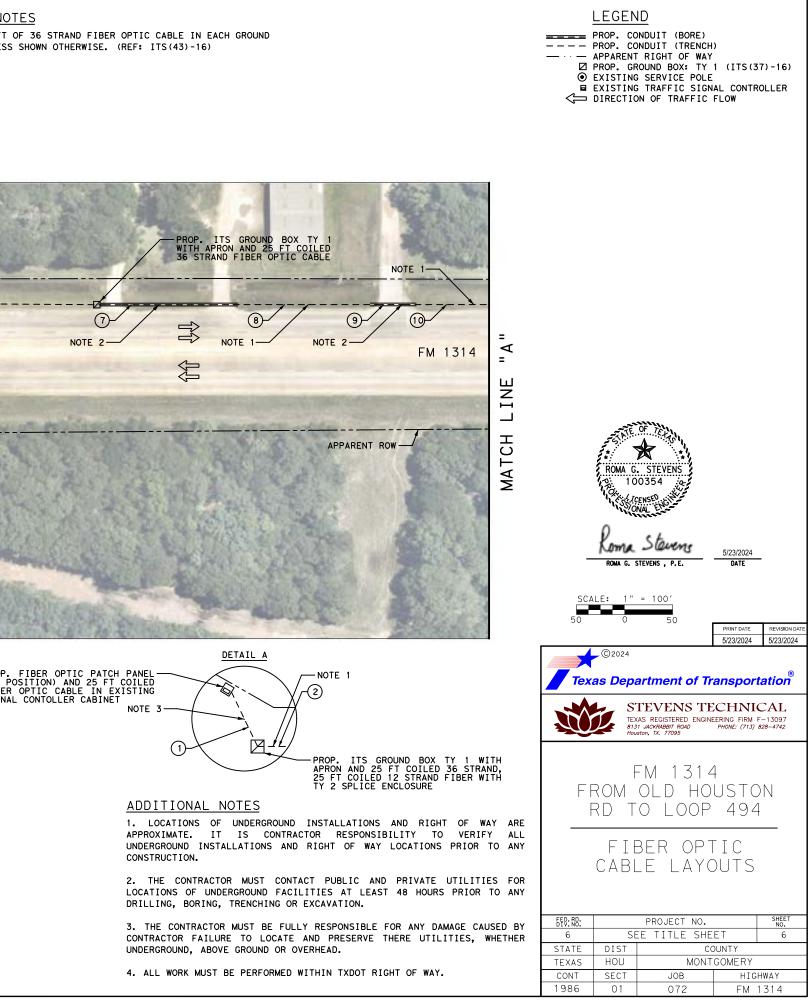



		CONDUI	ΤA	ND CON	1DL	JCTOR	SCł	HEDULI	Ξ		ITS GND BOX
RUN			DUIT 18)		cor	NDUCTORS (620)		FIBER OF 007)(SI			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)	
		(6053)	(6054)		(6002)	(6011)	(6013)	6002	
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH
1	1	75			1	75			1	75	\land /
2			1	105	1	105			1	105	
3	1	315			1	315			1	315	
4			1	45	1	45			1	45	$ \land / $
5	1	405			1	405			1	405	Х
6			1	50	1	50			1	50	
7	1	220			1	220			1	220	
COILED SLACK										50	/
TOTAL		1015		200		1215				1265	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBIL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LO CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND LOCATIONS OF UNDERGROUND FACILITIES AT LEAST DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THE UNDERGROUND, ABOVE GROUND OR OVERHEAD.

		PROP. CO APPARENT PROP. GR EXISTING EXISTING	D NDUIT (BORE) NDUIT (TRENC) RIGHT OF WA OUND BOX: TY SERVICE POL SERVICE POL TRAFFIC SIG N OF TRAFFIC	Y 1 (ITS(3 E NAL CONTRO	
FM 1314	SCA 50	Roma	OF STEVENS 0354 VAL SCOMMON TEVENS, P.E. = 100'	5/23/2024 DATE	REVISION DATE
		©2024		5/23/2024	5/23/2024
		as Depa	Artment of T TEVENS T AS REGISTERED ENGIN 1 JACKRABEIT ROAD ston, TX. 77095	ECHNIC	CAL -13097
AND RIGHT OF WAY ARE LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY		ROM RD T FIE	FM 131 OLD HC O LOOF BER OP)USTO 2 494 TIC	N
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY		UADL	_L LAIV	0013	
DR ANY DAMAGE CAUSED BY ERE UTILITIES, WHETHER	FED:RD: 6 STATE	SE DIST	PROJECT NO. EE TITLE SHI	EET COUNTY	SHEET NO. 7
IT OF WAY.	TEXAS	HOU		TGOMERY	
	CONT 1986	SECT 01	JOB 072	HIGH FM 1	
					- 1 - 4 ·




1. <u>INSTALL</u> 1-3" SCH. 80 PVC/CCE

IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

× COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

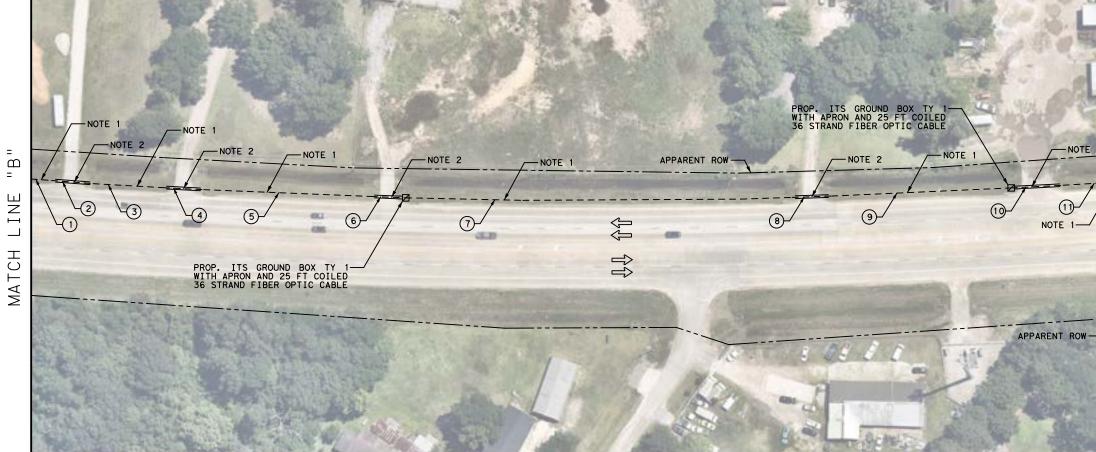

		CONDUI	ΤA	AND CON	NDL	JCTOR	SCI	HEDUL	Ξ		ITS GND BOX
RUN		CONI (6	DUIT 18)		CON	NDUCTORS (620)		FIBER OF 007)(SIN			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	Ċ	6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1	1	25			1	25			1	25	\ /
2			1	45	1	45			1	45	
3	1	75			1	75			1	75	
4			1	45	1	45			1	45	
5	1	175			1	175			1	175	
6			1	40	1	40			1	40	$ \setminus / $
7	1	405			1	405			1	405	Х
8			1	45	1	45			1	45	
9	1	190			1	190			1	190	
10			1	55	1	55			1	55	
11	1	125			1	125			1	125	
COILED SLACK										50	/
TOTAL		995		230		1225				1275	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBIL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LC CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND LOCATIONS OF UNDERGROUND FACILITIES AT LEAST DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THE UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT

=

Ξ

ITTY TO VERIFY ALL FIBER OPTIC LOCATIONS PRIOR TO ANY FIBER OPTIC PRIVATE UTILITIES FOR CABLE LAYOUTS PRIVATE UTILITIES FOR 6 A8 HOURS PRIOR TO ANY 6 SEE TITLE SHEET 8 STATE DIST COUNTY TEXAS TOF WAY. CONT		
AND RIGHT OF WAY ARE LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY FOR ANY DAMAGE CAUSED BY TO F WAY.		PROP. CONDUIT (BORE) — — — PROP. CONDUIT (TRENCH) — — — APPARENT RIGHT OF WAY ☑ PROP. GROUND BOX: TY 1 (ITS(37)-16) ④ EXISTING SERVICE POLE ■ EXISTING TRAFFIC SIGNAL CONTROLLER
AND RIGHT OF WAY ARE LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER HT OF WAY. HOUSTON, TX. 77095 FM 1314 FROM OLD HOUSTON RD TO LOOP 494 FIBER OPTIC CABLE LAYOUTS FROM OLD HOUSTON RD TO LOOP 494 FIBER OPTIC CABLE LAYOUTS FIN. 18: PROJECT NO. SHEET 8 STATE DIST COUNTY TEXAS HOU MONTGOMERY CONT SECT JOB HIGHWAY	FM 1314	I 00354 I 00354 I 00354 I 00354 I 000354 I 000000 I 000000 I 000000 I 000000 I 000000 I 000000 I 0000000 I 000000000 I 00000000000 I 000000000000000000000000000000000000
ITTY TO VERIFY ALL FIBER OPTIC LOCATIONS PRIOR TO ANY FIBER OPTIC PRIVATE UTILITIES FOR CABLE LAYOUTS PRIVATE UTILITIES FOR 6 A8 HOURS PRIOR TO ANY 6 SEE TITLE SHEET 8 STATE DIST COUNTY TEXAS TOF WAY. CONT		FROM OLD HOUSTON
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER 6 SEE TITLE SHEET 8 STATE DIST COUNTY TEXAS HOU MONTGOMERY CONT SECT JOB HIGHWAY	LITY TO VERIFY ALL	
G SEE TITLE SHEET 8 IF OF WAY. 6 SEE TITLE SHEET 8 6 SEE TITLE SHEET 8 17 OF WAY. 6 SEE TITLE SHEET 8		CADEL LATUUIS
T OF WAY. CONT SECT JOB HIGHWAY		6 SEE TITLE SHEET 8 STATE DIST COUNTY
1980 UT U72 FM 1314	IT OF WAY.	

1. INSTALL

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. <u>INSTALL</u>

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

SPECIAL NOTES

* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

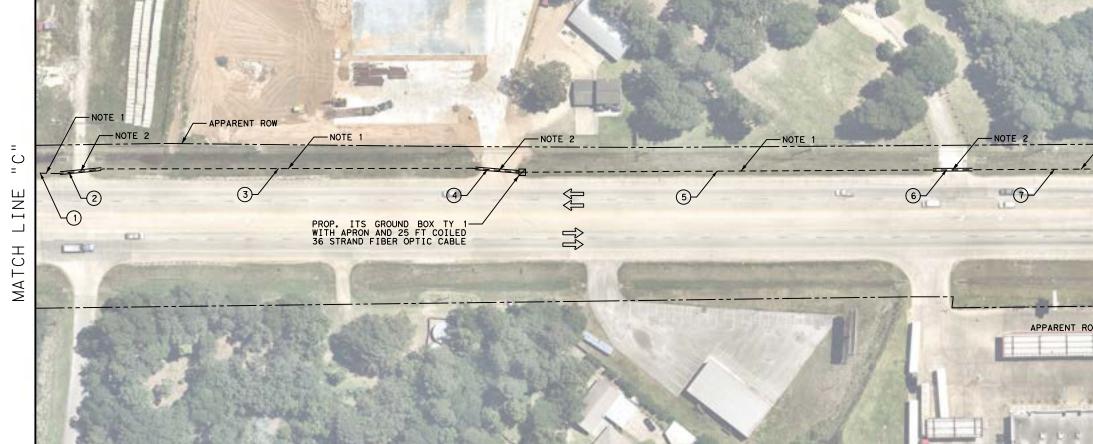

RUN		CONDUI coni (6		ND CON		JCTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SII	TIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)	(6054)		(6002)	(6011)	(6013)	6002	
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH
1	1	25			1	25			1	25	\backslash
2			1	50	1	50			1	50	
3	1	385			1	385			1	385	
4			1	55	1	55			1	55	
5	1	425			1	425			1	425	XI
6			1	50	1	50			1	50	
7	1	225			1	225			1	225	
COILED SLACK										25	
TOTAL		1060		155		1215				1240	1


ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBILI UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOU CONSTRUCTION.


2. THE CONTRACTOR MUST CONTACT PUBLIC AND PF LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THEF UNDERGROUND, ABOVE GROUND OR OVERHEAD.

UEGEND PROP. CONDUIT (BORE) PROP. GONDUIT (TRENCH) APPARENT RIGHT OF WAY PROP. GROUDE POLE ■ EXISTING SERVICE POLE ■ EXISTING SERVICE POLE ■ EXISTING TRAFFIC SIGNAL CONTROLL DIRECTION OF TRAFFIC FLOW	
$\frac{100354}{100354}$ $\frac{100354}{1000000000000000000000000000000000000$	NEVISION DATE
Texas Department of Transportation STEVENS TECHNICA EXAS REGISTERED ENGINEERING FIRM F-13 BIJ JACKRABBIT ROAD PHONE: (713) 828-4	AL 3097
AND RIGHT OF WAY ARE LITY TO VERIFY ALL OCCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY	
ERE UTILITIES, WHETHER 6 SEE TITLE SHEET STATE DIST COUNTY	SHEET NO. 9
TEXAS HOU MONTGOMERY	

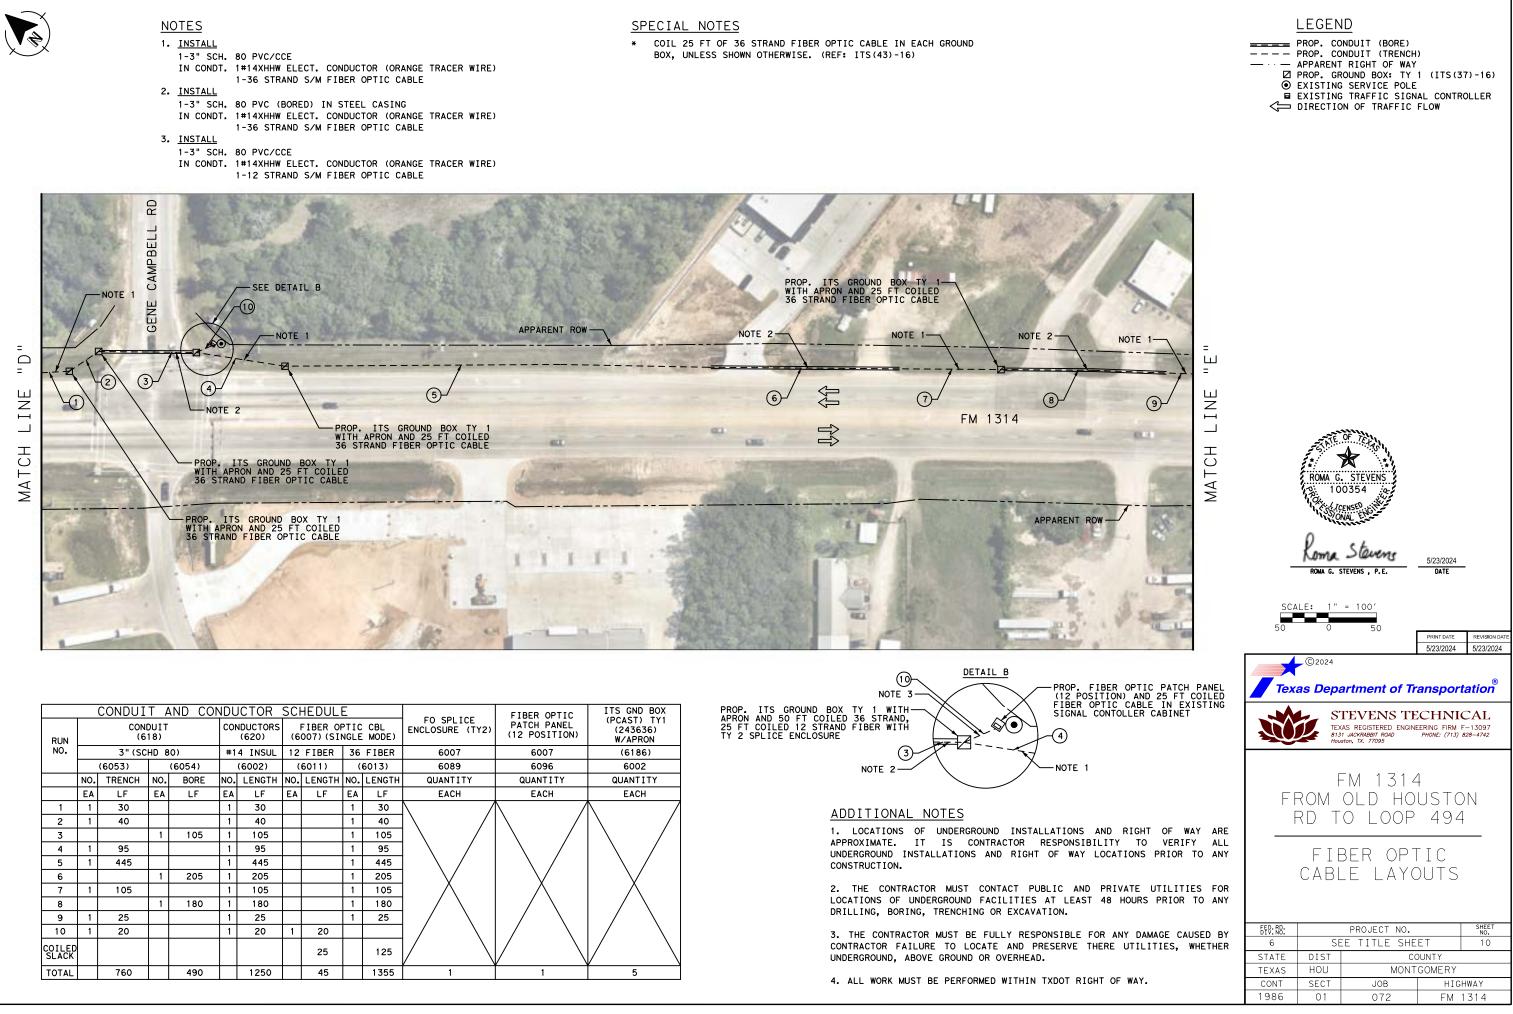

			T				<u> </u>						ITS GND BOX
RUN		CONDUI coni (6			1	JCTOR NDUCTORS (620)		FIBER OF 007) (SII	PTIC		FO SPLICE ENCLOSURE (TY2)	FIBER OPTIC PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	30)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	ΕA	LF	EA	LF	EACH	EACH	EACH
1	1	30			1	30			1	30	Λ /	\land /	\land /
2	1	40			1	40			1	40			\land
3			1	105	1	105			1	105			
4	1	95			1	95			1	95			
5	1	445			1	445			1	445			\setminus /
6			1	205	1	205			1	205			\vee
7	1	105			1	105			1	105		\wedge	\wedge
8			1	180	1	180			1	180			
9	1	25			1	25			1	25			
10	1	20			1	20	1	20					
COILED SLACK								25		125	\backslash	\backslash	/
TOTAL		760		490		1250		45		1355	1	1	5

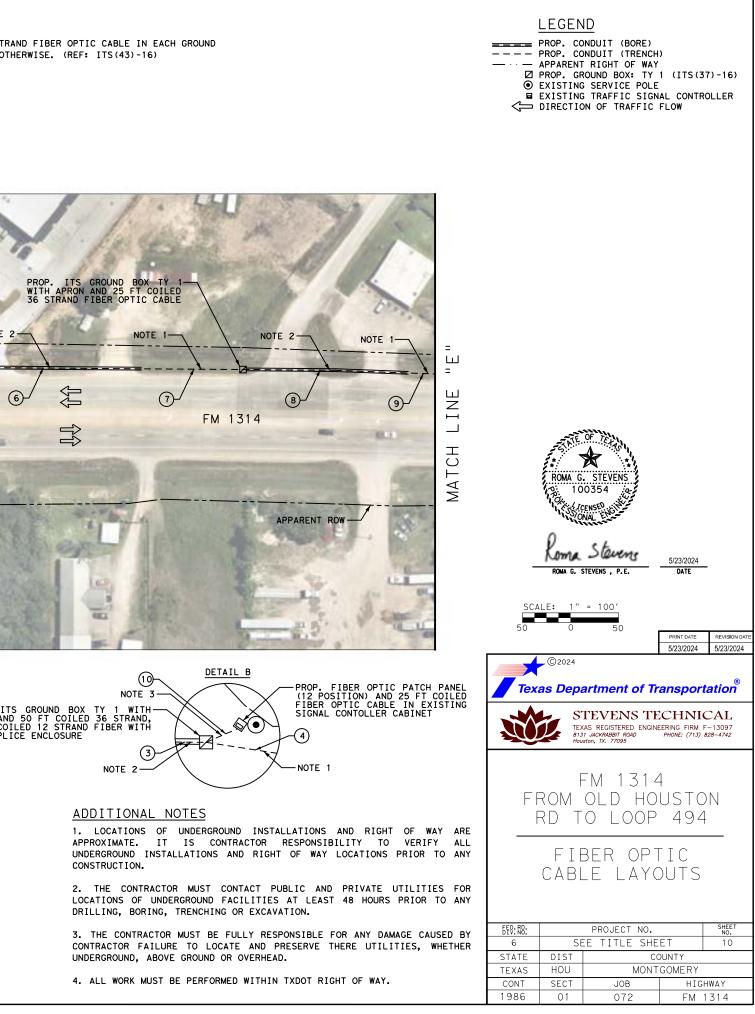



1. INSTALL

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

INSTALL 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

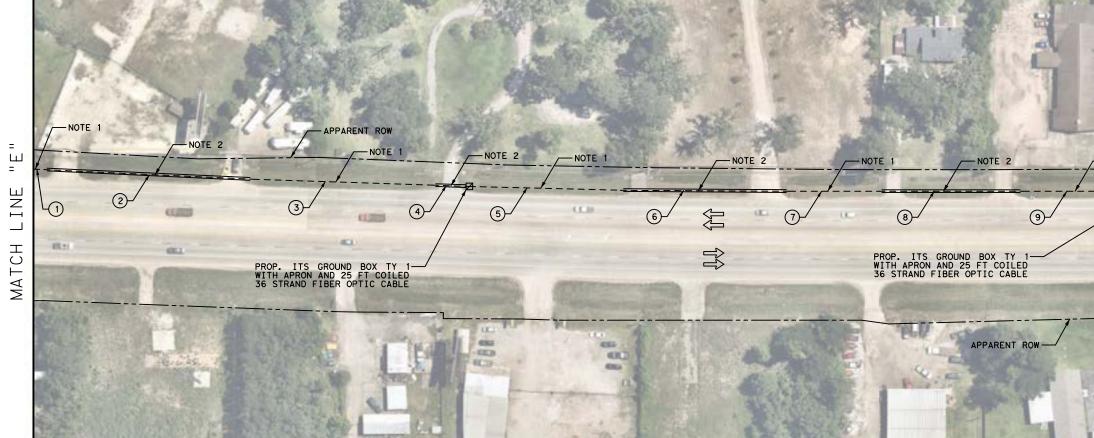

		CONDUI	ΤA	AND CON	IDL	JCTOR	SCI	HEDULI	Ξ		ITS GND BOX
RUN			DUIT 18)		cor	NDUCTORS (620)		FIBER OF 007)(SI			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12 FIBER 30			FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1	1	15			1	15			1	15	Ν /
2			1	220	1	220			1	220	\ /
3	1	190			1	190			1	190	
4			1	40	1	40			1	40	
5	1	160			1	160			1	160	
6			1	180	1	180			1	180	
7	1	95			1	95			1	95	
8			1	155	1	155			1	155	$ / \rangle $
9	1	135			1	135			1	135	$ / \rangle $
10			1	40	1	40			1	40	
COILED SLACK										50	$ $ \backslash
TOTAL		595		635		1230				1280	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBIL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LO CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND LOCATIONS OF UNDERGROUND FACILITIES AT LEAST DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THE UNDERGROUND, ABOVE GROUND OR OVERHEAD.

AND RIGHT OF MAY ARE LITY TO VERIFY ALL AS HOURS PRIOR TO ANY PRIVATE UTILITIES FOR HERE UTILITIES FOR HERE UTILITIES FOR HERE UTILITIES FOR HT OF MAY.		
AND RIGHT OF WAY ARE LITY TO VERIFY ALL COATIONS PRIOR TO ANY PRIVATE UTILITIES, WHETHER AT OF WAY.		 PROP. CONDUIT (BORE) PROP. CONDUIT (TRENCH) APPARENT RIGHT OF WAY PROP. GROUND BOX: TY 1 (ITS(37)-16) ● EXISTING SERVICE POLE ■ EXISTING TRAFFIC SIGNAL CONTROLLER
AND RIGHT OF WAY ARE LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER AT OF WAY. FROM OLD HOUSTON RD TO LOOP 494 FIBER OPTIC CABLE LAYOUTS PROJECT NO. STATE DIST COUNTY TEXAS HOU MONTGOMERY HIGHWAY	MOTE 1 I I I I I I I I I I I I I	$\frac{100354}{1000354}$ $\frac{100354}{1000000000000000000000000000000000000$
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER 6 SEE TITLE SHEET 11 STATE DIST COUNTY TEXAS HOU MONTGOMERY CONT SECT JOB HIGHWAY	LITY TO VERIFY ALL	RD TO LOOP 494 FIBER OPTIC
Image: Constant parameter 6 SEE TITLE SHEET 11 Image: Constant parameter 6 SEE TITLE SHEET 11 STATE DIST COUNTY TEXAS HOU MONTGOMERY IT OF WAY. CONT SECT		
	HERE UTILITIES, WHETHER	6 SEE TITLE SHEET 11 STATE DIST COUNTY
	IT OF WAY.	CONT SECT JOB HIGHWAY


<u>NOTES</u>

1. <u>INSTALL</u> 1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND × BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

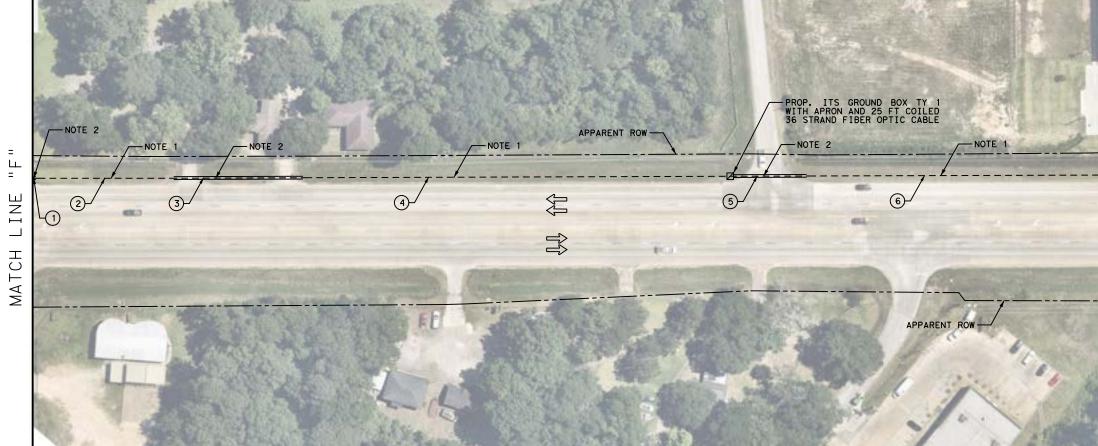

RUN		CON	T / DUIT 18)	ND CON		JCTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SII	PTIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)	(6054)		(6002)		6011)	(6013)	6002	
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	ΕA	LF	ΕA	LF	EACH
1			1	10	1	10			1	10	\land
2	1	140			1	140			1	140	
3			1	145	1	145			1	145	
4	1	445			1	445			1	445	
5			1	85	1	85			1	85	XI
6	1	350			1	350			1	350	
7			1	40	1	40			1	40	
COILED SLACK										25	
TOTAL		935		280		1215				1240	1


ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBIL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LC CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND LOCATIONS OF UNDERGROUND FACILITIES AT LEAST DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THE UNDERGROUND, ABOVE GROUND OR OVERHEAD.

	LEGEND PROP. CONDUIT (BORE) PROP. CONDUIT (TRENCH) APPARENT RIGHT OF WAY Ø PROP. GROUND BOX: TY 1 (ITS(37)-16) € EXISTING SERVICE POLE EXISTING TRAFFIC SIGNAL CONTROLLER DIRECTION OF TRAFFIC FLOW
NOTE 2 T FM 1314 INI HOLEW	i = 100 $i = 100$
AND RIGHT OF WAY ARE LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY	FM 1314 FROM OLD HOUSTON RD TO LOOP 494 FIBER OPTIC CABLE LAYOUTS
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY	
	DIV. NO. NO. NO.
OR ANY DAMAGE CAUSED BY ERE UTILITIES, WHETHER	6 SEE TITLE SHEET 12 STATE DIST COUNTY TEXAS HOU MONTGOMERY

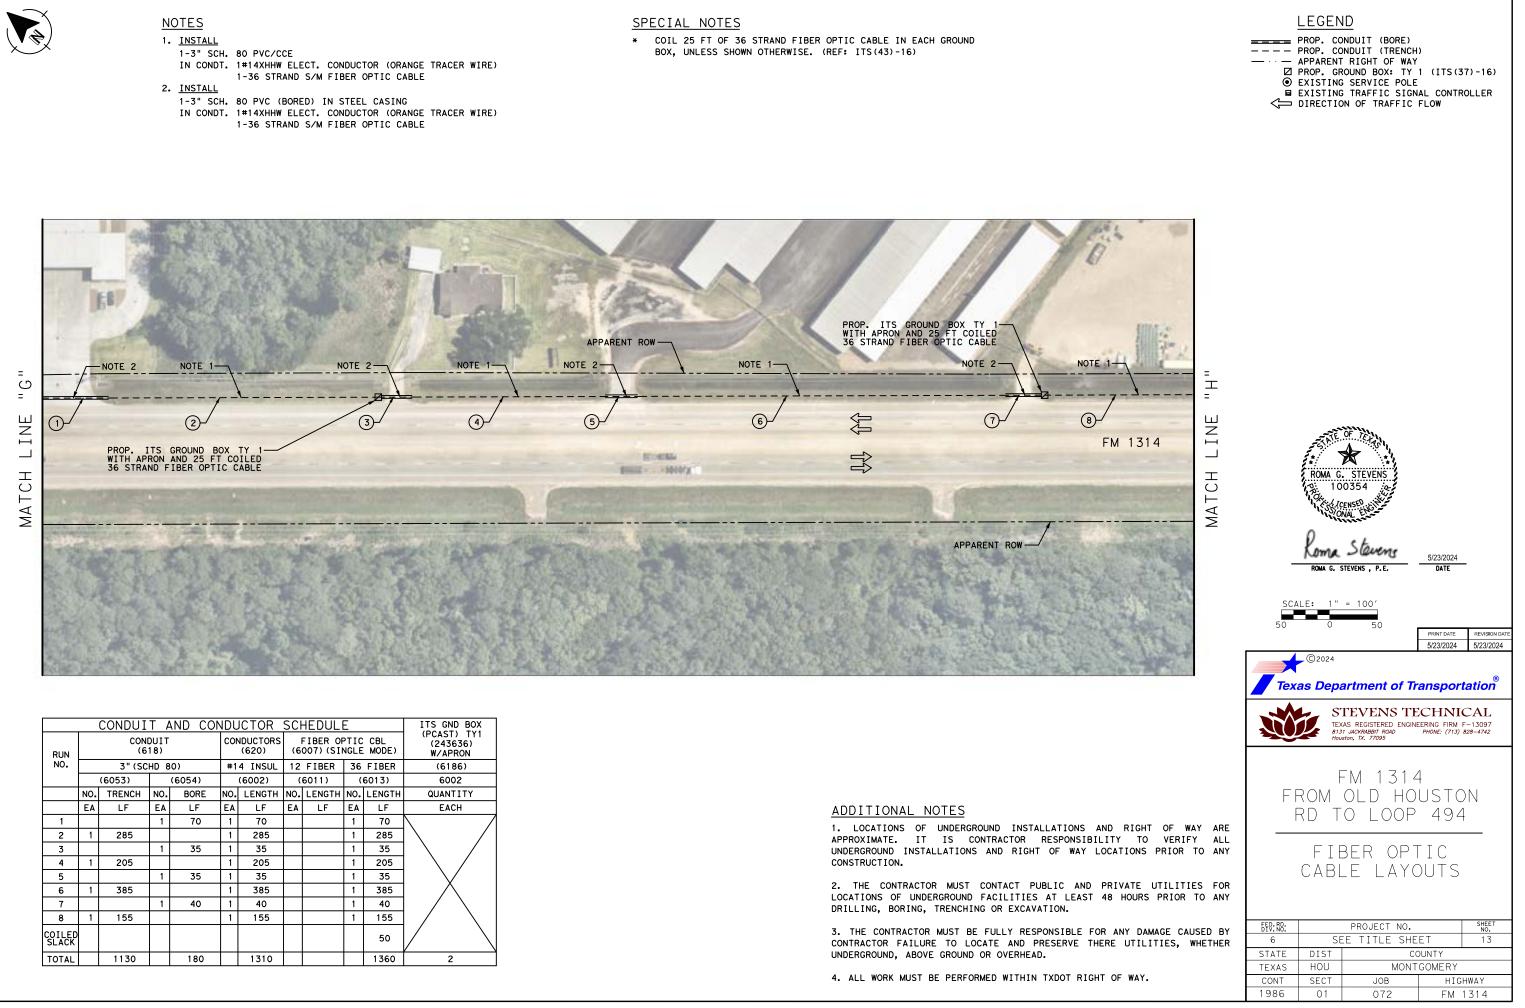

		CONDUI	SCI	HEDULI	Ξ		ITS GND BOX (PCAST) TY1				
RUN			DUIT 18)		COI	NDUCTORS (620)		FIBER OF 007)(SIN			(243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1			1	70	1	70			1	70	Ν /
2	1	285			1	285			1	285	
3			1	35	1	35			1	35	
4	1	205			1	205			1	205	
5			1	35	1	35			1	35	
6	1	385			1	385			1	385	
7			1	40	1	40			1	40	
8	1	155			1	155			1	155	
COILED SLACK										50	\bigvee
TOTAL		1130		180		1310				1360	2

1. <u>INSTALL</u>

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. <u>INSTALL</u>

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

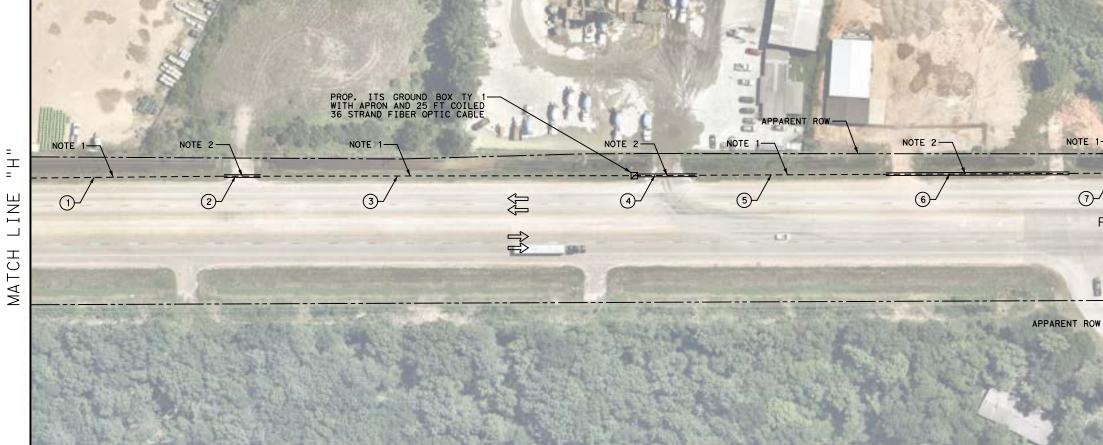


		CONDUI		ITS GND BOX							
RUN			DUIT 18)		COI	NDUCTORS (620)		FIBER OF 007)(SI			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH
1	1	15			1	15			1	15	Λ Λ
2			1	220	1	220			1	220	$ \rangle$ /
3	1	190			1	190			1	190	
4			1	40	1	40			1	40	
5	1	160			1	160			1	160	
6			1	180	1	180			1	180	
7	1	95			1	95			1	95	
8			1	155	1	155			1	155	
9	1	135			1	135			1	135	
10			1	40	1	40			1	40	
COILED SLACK										50	/
TOTAL		595		635		1230				1280	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

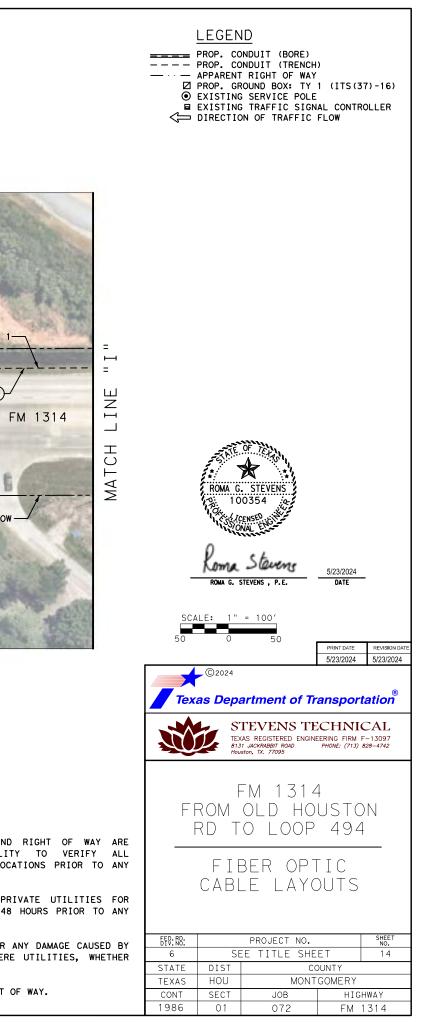

NOTES

- 1. INSTALL
- 1-3" SCH. 80 PVC/CCE
- IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. <u>INSTALL</u>

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)




	-	<u>CONDUI</u>	<u>T A</u>	AND COM	NDUCTOR SCHEDULE						ITS GND BOX
RUN			DUIT 18)		CON	NDUCTORS (620)		FIBER OF 007)(SIN			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1	1 105					105			1	105	\wedge \land
2			1	90	1	90			1	90	
3	1	580			1	580			1	580	
4			1	55	1	55			1	55	X
5	1	385			1	385			1	385	
COILED SLACK										50	
TOTAL		1070		145		1215				1265	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

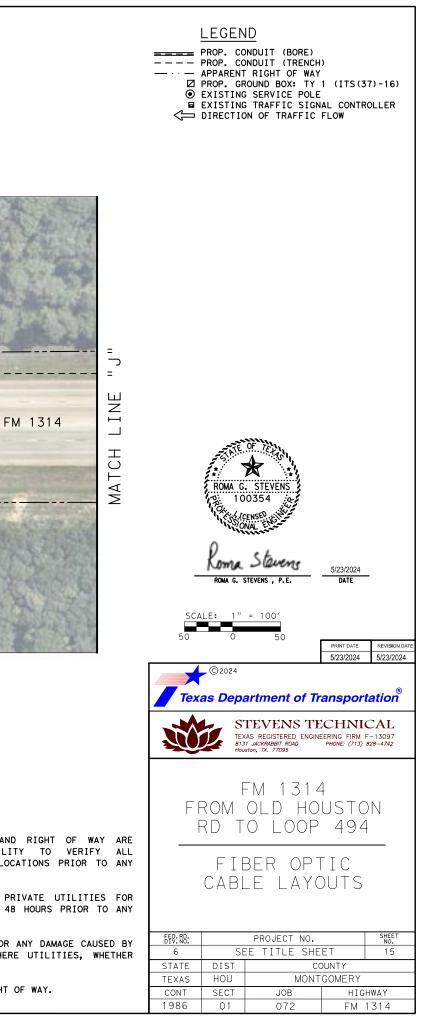



1. <u>INSTALL</u> 1-3" SCH. 80 PVC/CCE IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

SPECIAL NOTES

* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)




RUN		CON		ND CON		UCTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SI	PTIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1	1	355			1	355			1	355	\setminus
2	1	705			1	705			1	705	
3	1	150			1	150			1	150	
COILED SLACK										50	
TOTAL		1210				1210				1210	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

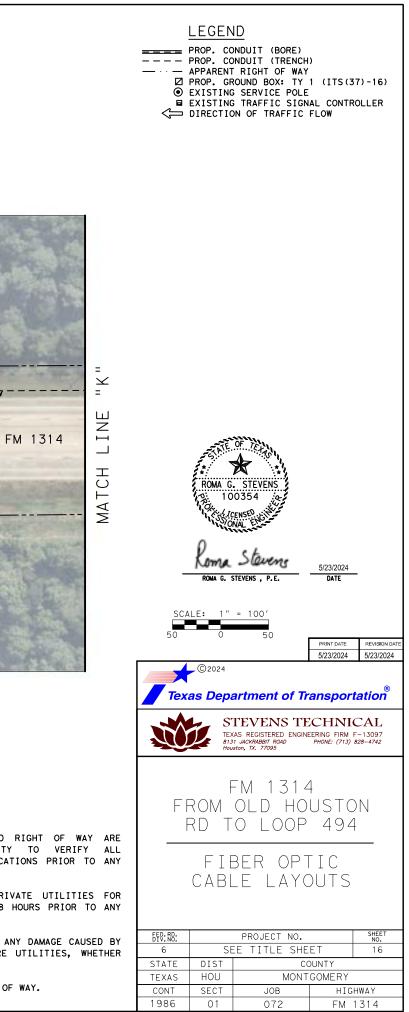



1. <u>INSTALL</u>

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. <u>INSTALL</u>

INSTALL 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

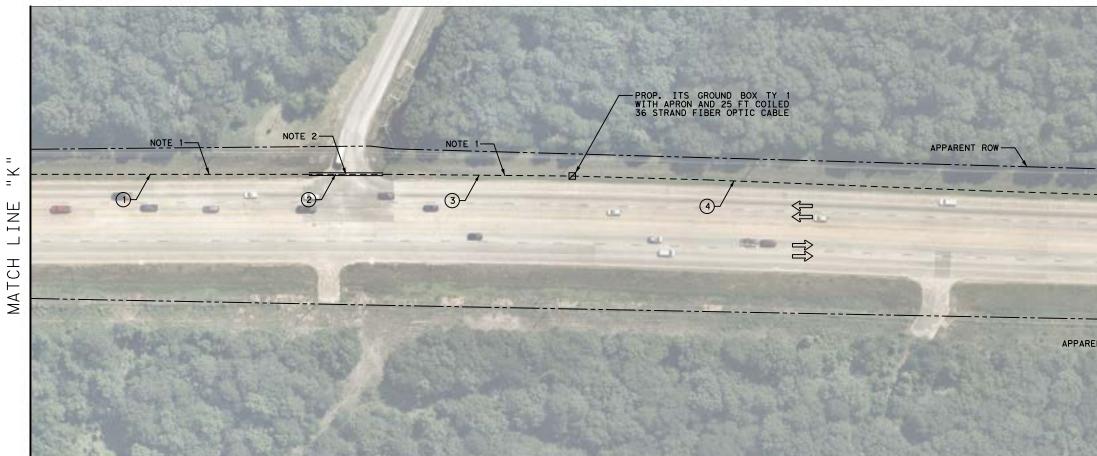

RUN		CON	T / DUIT 18)	ND CON		JCTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SI	PTIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1	1	290			1 290				1	290	\setminus
2			1	85	1	85			1	85	
3	1	195			1	195			1	195	
4	1	640			1	640			1	640	\wedge
COILED SLACK	p									50	
TOTAL	L 1125 85					1210				1260	1


ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.



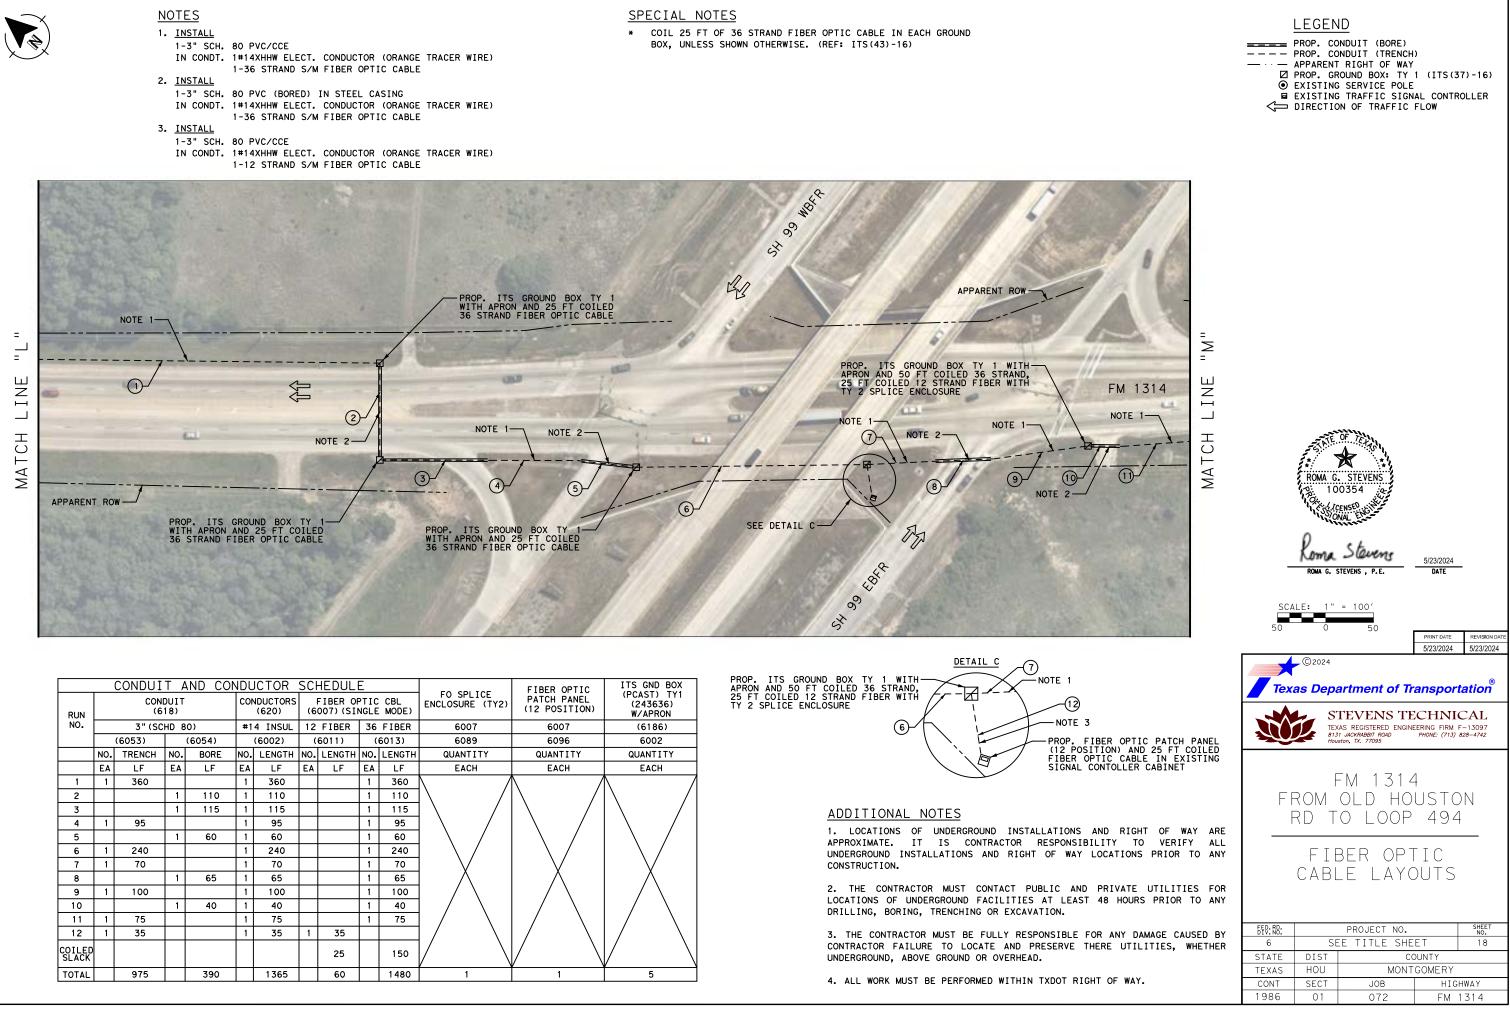


PROP. ITS GROUND BOX TY 1 WITH APRON AND 50 FT COILED 36 STRAND, 25 FT COILED 12 STRAND FIBER WITH TY 2 SPLICE ENCLOSURE	TAIL C NOTE 1 NOTE 3 PROP. FIB (12 POSIT FIBER OPT

			DUIT			DUCTORS		FIBER OF	PTIC		FO SPLICE ENCLOSURE (TY2)	FIBER OPTIC PATCH PANEL (12 POSITION)	ITS GND BOX (PCAST) TY1 (243636)
RUN NO		(6) 3" (SC	18)			(620) 4 INSUL		007)(SIN FIBER		FIBER	6007	6007	W/APRON (6186)
	<u> </u>	(6053)		(6054)	-	(6002)		6011)	<u> </u>	6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH	EACH	EACH
1	1	360			1	360			1	360	Λ /	\ /	N ,
2			1	110	1	110			1	110			\ /
3			1	115	1	115			1	115			
4	1	95			1	95			1	95			
5			1	60	1	60			1	60			
6	1	240			1	240			1	240			
7	1	70			1	70			1	70			
8			1	65	1	65			1	65			
9	1	100			1	100			1	100			
10			1	40	1	40			1	40			
11	1	75			1	75			1	75			
12	1	35			1	35	1	35					
COILED SLACK								25		150	/	$ $ \setminus	/ \
TOTAL		975		390		1365		60		1480	1	1	5

- 1. INSTALL
- 1-3" SCH. 80 PVC/CCE
- IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE
- 2. INSTALL
- 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

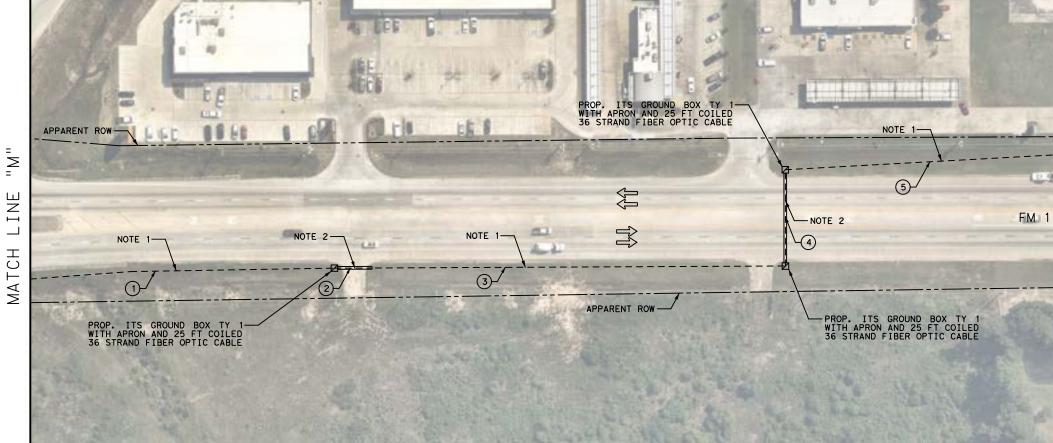

		CONDUI	ΤA	ND CON	İDL	JCTOR	SCł	HEDULI	Ε		ITS GND BOX (PCAST) TY1
RUN			DUIT 18)		COI	NDUCTORS (620)		FIBER OF 007)(SI			(243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH
1	1	320			1	320			1	320	\land /
2			1	45	1	45			1	45	
3	1	430			1	430			1	430	
4			1	110	1	110			1	110	X
5	1	335			1	335			1	335	
COILED SLACK										75	/
TOTAL		1085		155		1240				1315	3

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBIL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LO CONSTRUCTION.


2. THE CONTRACTOR MUST CONTACT PUBLIC AND LOCATIONS OF UNDERGROUND FACILITIES AT LEAST DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THE UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT


AND RIGHT OF WAY ARE LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY FOR ANY DAMAGE CAUSED BY 41 HOURS PRIOR TO ANY 50 TO TO TO TO ANY 50 TO			PROP. CO APPARENT PROP. GF EXISTINO EXISTINO	DNDUIT (BORE) DNDUIT (TRENC RIGHT OF WA ROUND BOX: TY S SERVICE POL S TRAFFIC SIC DN OF TRAFFIC	CH) AY (1 (ITS(3 LE GNAL CONTF	
AND RIGHT OF WAY ARE CLITY TO VERIFY ALL LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER AT OF WAY. TO WAY. CONT SECT JOB HIGHWAY CONT SECT JOB HIGHWAY			Roma G.	Storens stevens, p.e.	DATE PRINT DATE	
AND RIGHT OF WAY ARE LLITY TO VERIFY ALL LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY OR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER HT OF WAY. HT OF WAY.			as Depo	TEVENS T	ECHNI	CAL F-13097
DR ANY DAMAGE CAUSED BY HERE UTILITIES, WHETHER DIV.NO. HOULET NO. 6 SEE TITLE SHEET 19 STATE DIST COUNTY TEXAS HOU MONTGOMERY HT OF WAY. CONT SECT	LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR		ROM RD T FIE	FM 131 FM 131 OLD H(OLD H(OLOOF BER OP	24 2005 24 292 710) N
TEXAS HOU MONTGOMERY Cont Sect Job Highway		6		EE TITLE SH	IEET	NO.
	HT OF WAY.	TEXAS CONT	HOU SECT	MON JOB	ITGOMERY HIG	

LEGEND

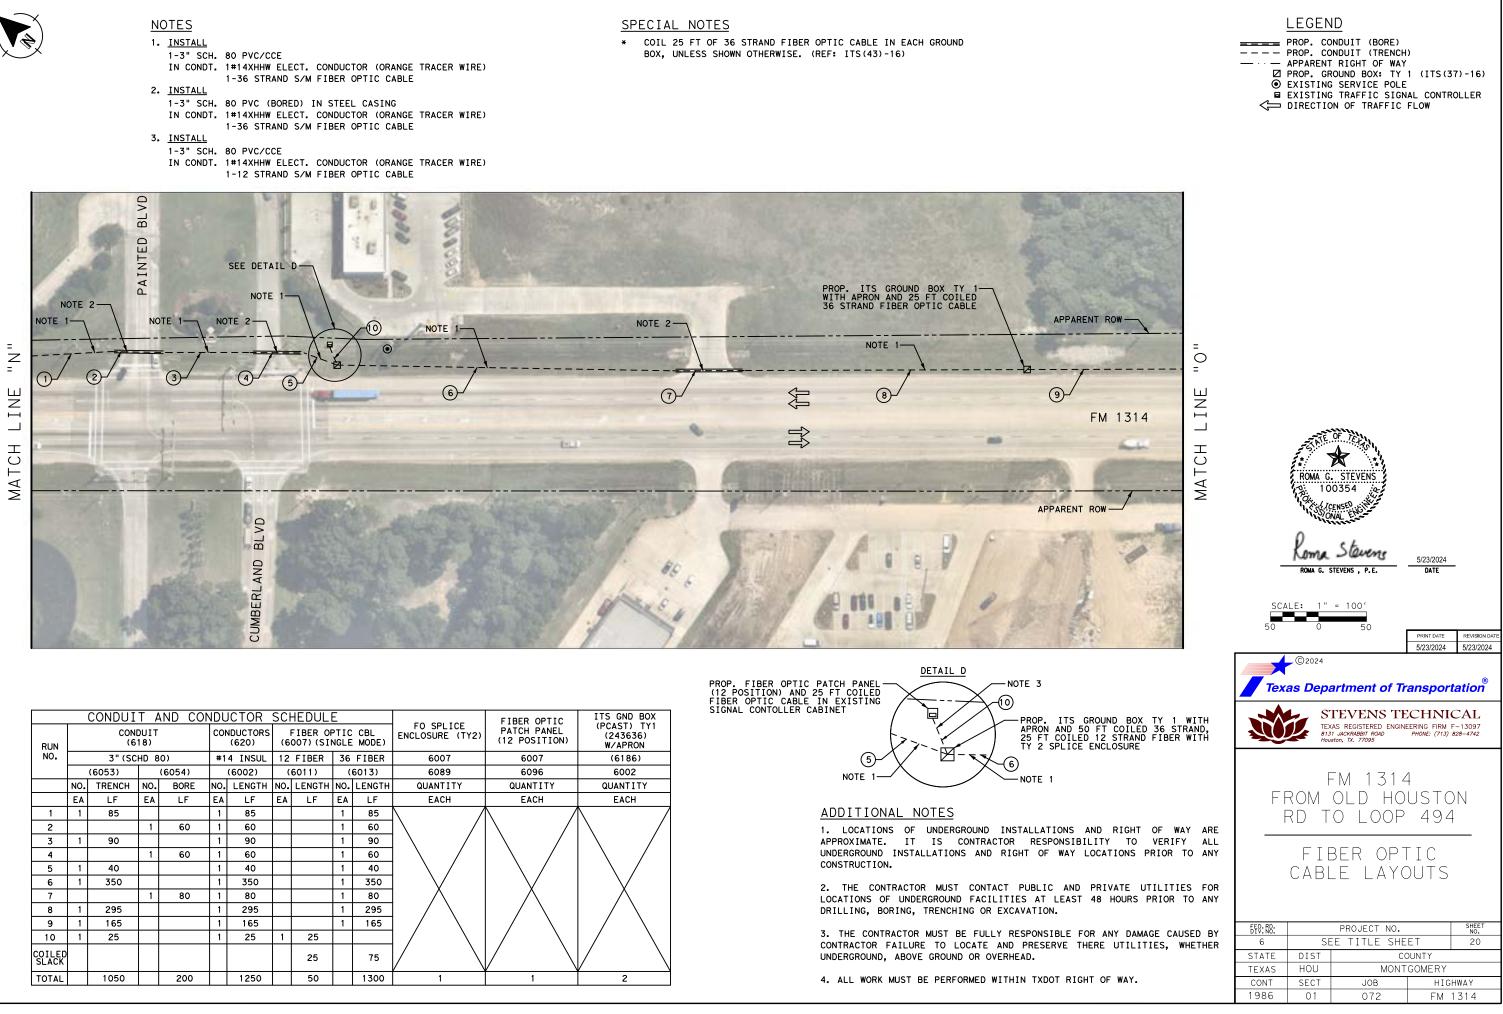


		CONDUI	ΤA	ND COI	NDL	JCTOR	SCI	HEDULI	Ξ			FIBER OPTIC	ITS GND BOX
RUN			DUIT 18)		cor	NDUCTORS (620)		FIBER OF 007)(SIN			FO SPLICE ENCLOSURE (TY2)	PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH	EACH	EACH
1	1	85			1	85			1	85	Ν /	Λ /	\backslash /
2			1	60	1	60			1	60			\land
3	1	90			1	90			1	90			
4			1	60	1	60			1	60			
5	1	40			1	40			1	40		$ \setminus / $	$ \land /$
6	1	350			1	350			1	350			
7			1	80	1	80			1	80			\wedge
8	1	295			1	295			1	295			
9	1	165			1	165			1	165			
10	1	25			1	25	1	25					
COILED SLACK								25		75	$ $ \setminus		/
TOTAL		1050		200		1250		50		1300	1	1	2



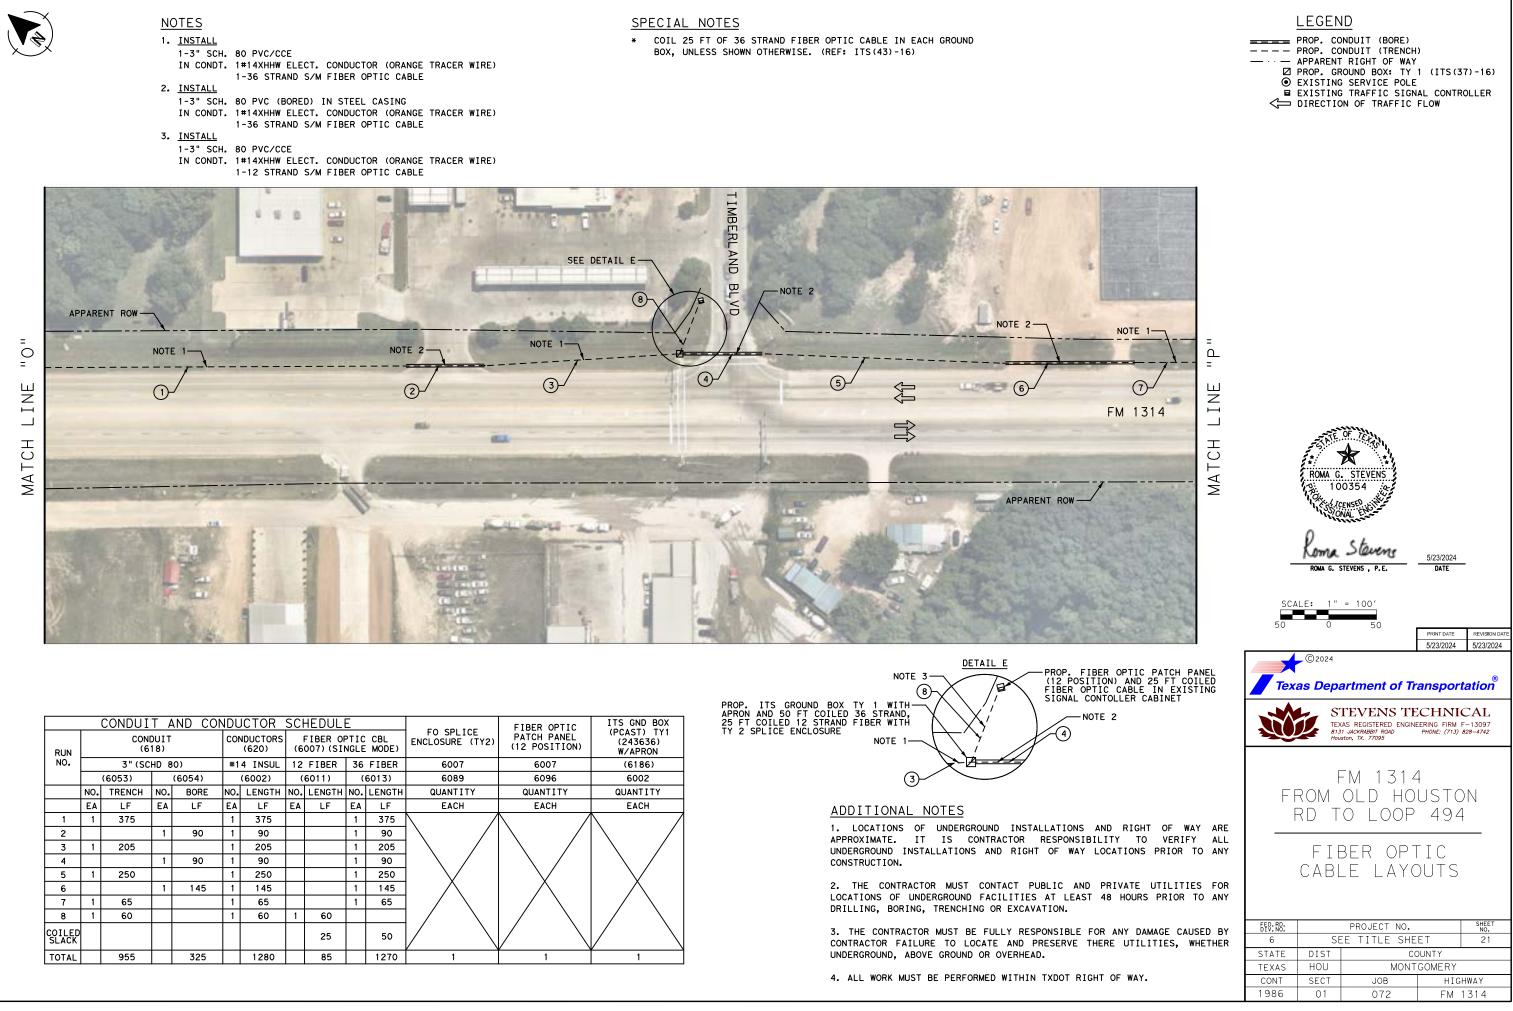

		CONDUI	т /		וחו		501						ITS GND BOX
RUN		CON	1 / DUIT 18)		1	IDUCTORS (620)		FIBER OF 007) (SI	- TIC		FO SPLICE ENCLOSURE (TY2)	FIBER OPTIC PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	ΕA	LF	EA	LF	ΕA	LF	ΕA	LF	ΕA	LF	EACH	EACH	EACH
1	1	375			1	375			1	375	Λ /	\ /	
2			1	90	1	90			1	90			
3	1	205			1	205			1	205			
4			1	90	1	90			1	90			
5	1	250			1	250			1	250			
6			1	145	1	145			1	145		\land	
7	1	65			1	65			1	65			
8	1	60			1	60	1	60					
COILED SLACK								25		50	\backslash	/	
TOTAL		955		325		1280		85		1270	1	1	1

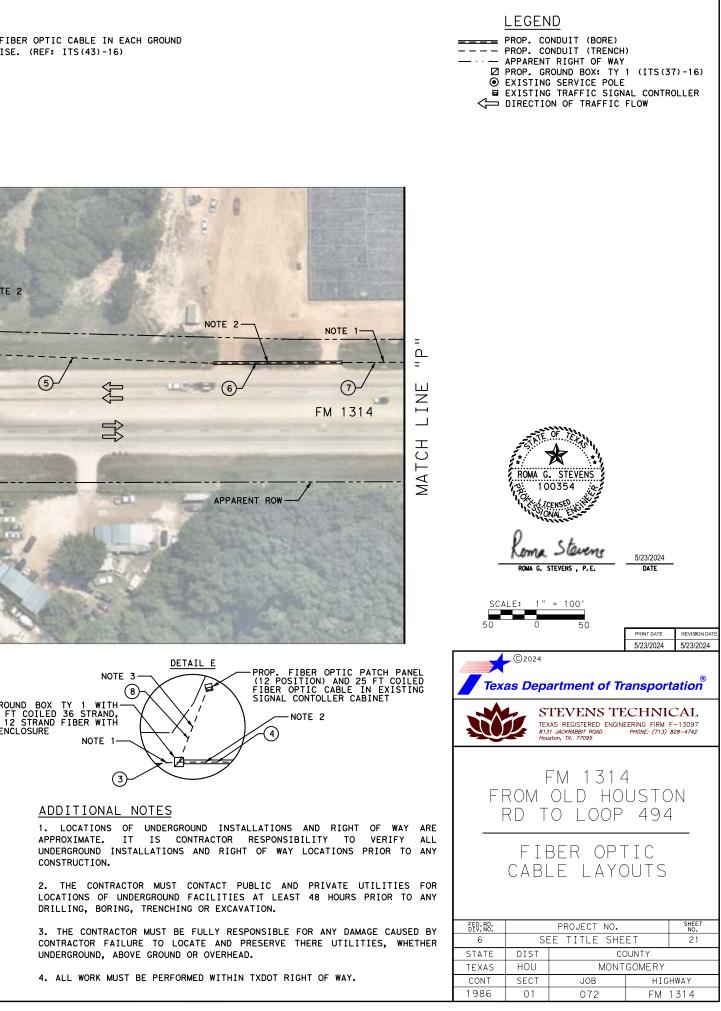


1. INSTALL

1-3" SCH. 80 PVC/CCE

- I-3" SCH. 80 PVC/CCE IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE)
 - 1-36 STRAND S/M FIBER OPTIC CABLE
- 2. <u>INSTALL</u>
- I-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

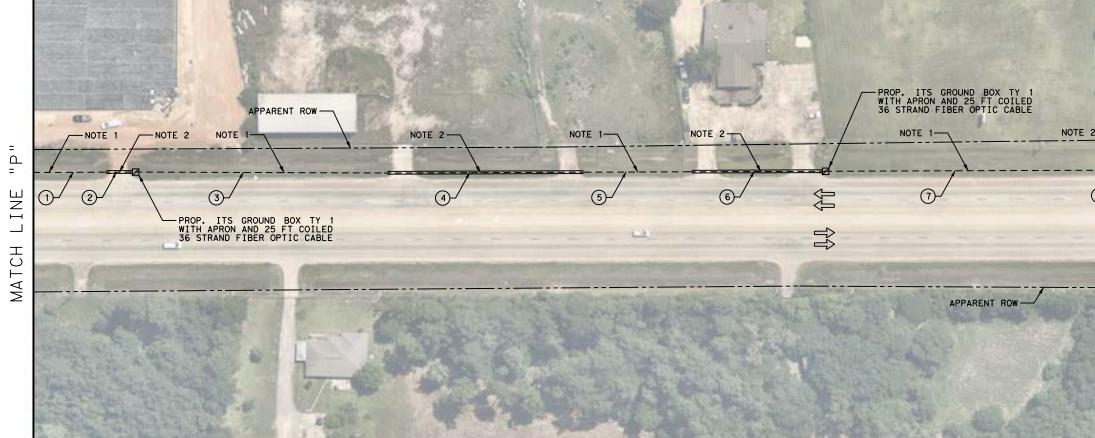

			ITS GND BOX (PCAST) TY1								
RUN			DUIT 18)		00	NDUCTORS (620)		FIBER OF 007)(SII			(243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	ΕA	LF	EACH
1	1	75			1	75			1	75	\land
2			1	35	1	35			1	35	$ \rangle / $
3	1	260			1	260			1	260	
4			1	250	1	250			1	250	
5	1	110			1	110			1	110	
6			1	145	1	145			1	145	XI
7	1	300			1	300			1	300	
8			1	50	1	50			1	50	
9	1	35			1	35			1	35	
COILED SLACK										50	/
TOTAL		780		480		1260				1310	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBIL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LO CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND LOCATIONS OF UNDERGROUND FACILITIES AT LEAST DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THE UNDERGROUND, ABOVE GROUND OR OVERHEAD.


	LEGEND PROP. CONDUIT (BORE) PROP. CONDUIT (TRENCH) APPARENT RIGHT OF WAY PROP. GROUND BOX: TY 1 (ITS(37)-16) EXISTING SERVICE POLE EXISTING TRAFFIC SIGNAL CONTROLLER DIRECTION OF TRAFFIC FLOW
NOTE 1 B. INIT HITH	$i = 100^{\circ}$
AND RIGHT OF WAY ARE LITY TO VERIFY ALL LOCATIONS PRIOR TO ANY	FM 1314 FROM OLD HOUSTON RD TO LOOP 494 FIBER OPTIC CABLE LAYOUTS
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY DR ANY DAMAGE CAUSED BY	FED: RD. DIV: NO: PROJECT NO: SHEET NO:
ERE UTILITIES, WHETHER	6 SEE TITLE SHEET 22 STATE DIST COUNTY TEXAS HOU MONTGOMERY

1. <u>INSTALL</u>

1-3" SCH. 80 PVC/CCE

- IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE
- 2. <u>INSTALL</u>
 - 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

- SPECIAL NOTES
- * COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

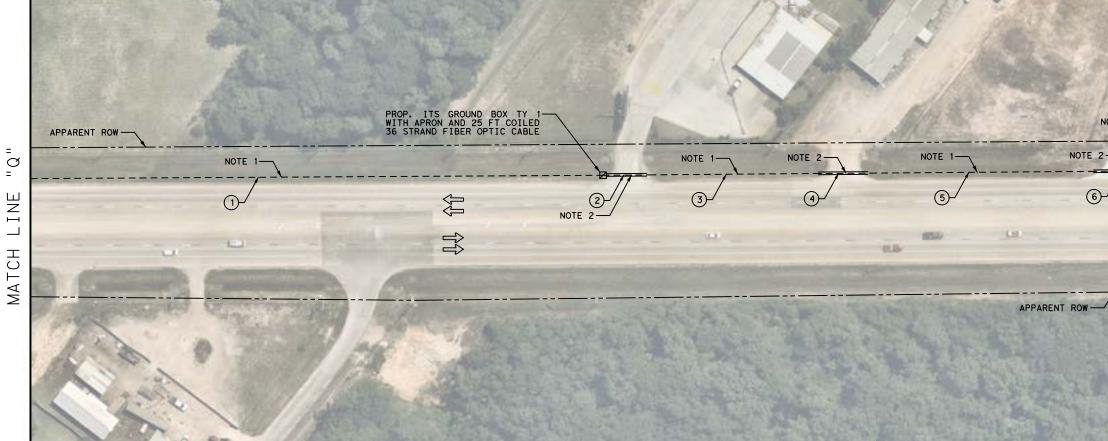


RUN			T / DUIT 18)	ND COM		ICTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SI	PTIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH
1	1	600			1	600			1	600	\land /
2			1	50	1	50			1	50	
3	1	175			1	175			1	175	
4			1	60	1	60			1	60	
5	1	230			1	230			1	230	X
6			1	75	1	75			1	75	
7	1	25			1	25			1	25	
COILED SLACK										25	
TOTAL		1030		185		1215				1240	1

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

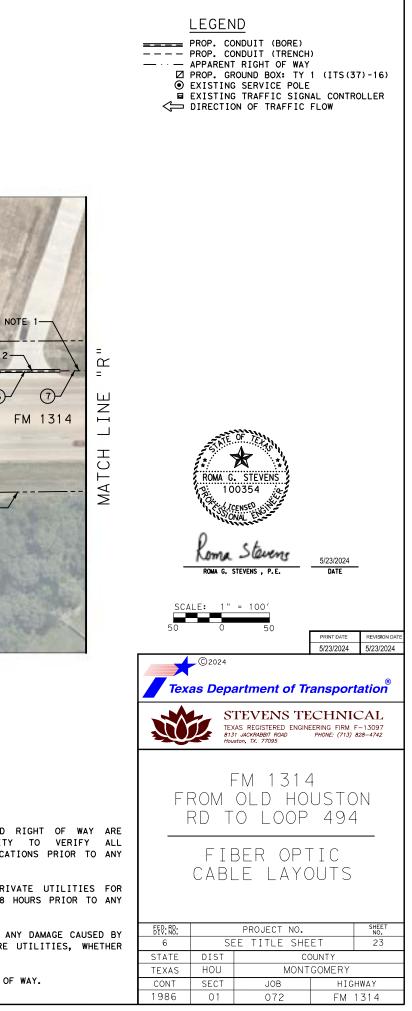

1. <u>INSTALL</u>

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

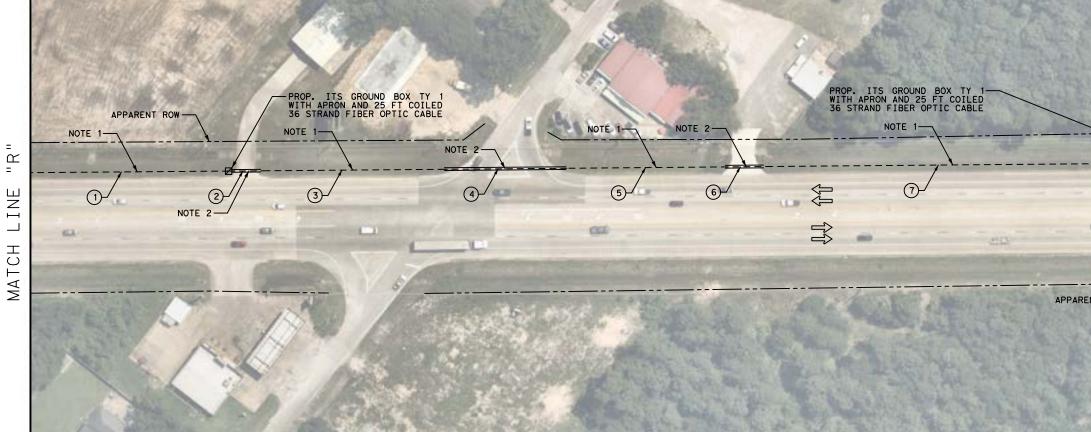


			ITS GND BOX (PCAST) TY1								
RUN			DUIT 18)		cor	NDUCTORS (620)		FIBER OF 007)(SI			(243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH
1	1	210			1	210			1	210	Ν /
2			1	40	1	40			1	40	
3	1	185			1	185			1	185	
4			1	135	1	135			1	135	
5	1	160			1	160			1	160	
6			1	50	1	50			1	50	
7	1	430			1	430			1	430	
8			1	5	1	5			1	5	
COILED SLACK										50	\backslash
TOTAL		985		230		1215				1265	2


ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.


2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

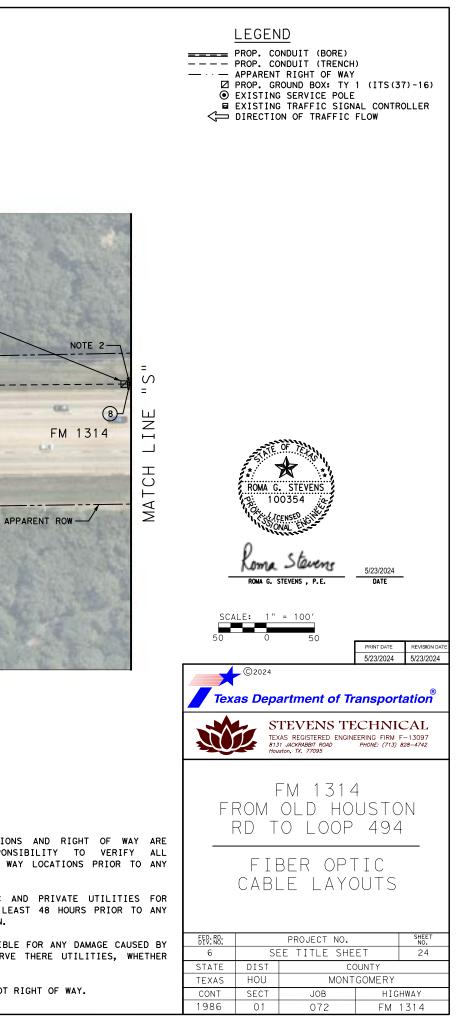


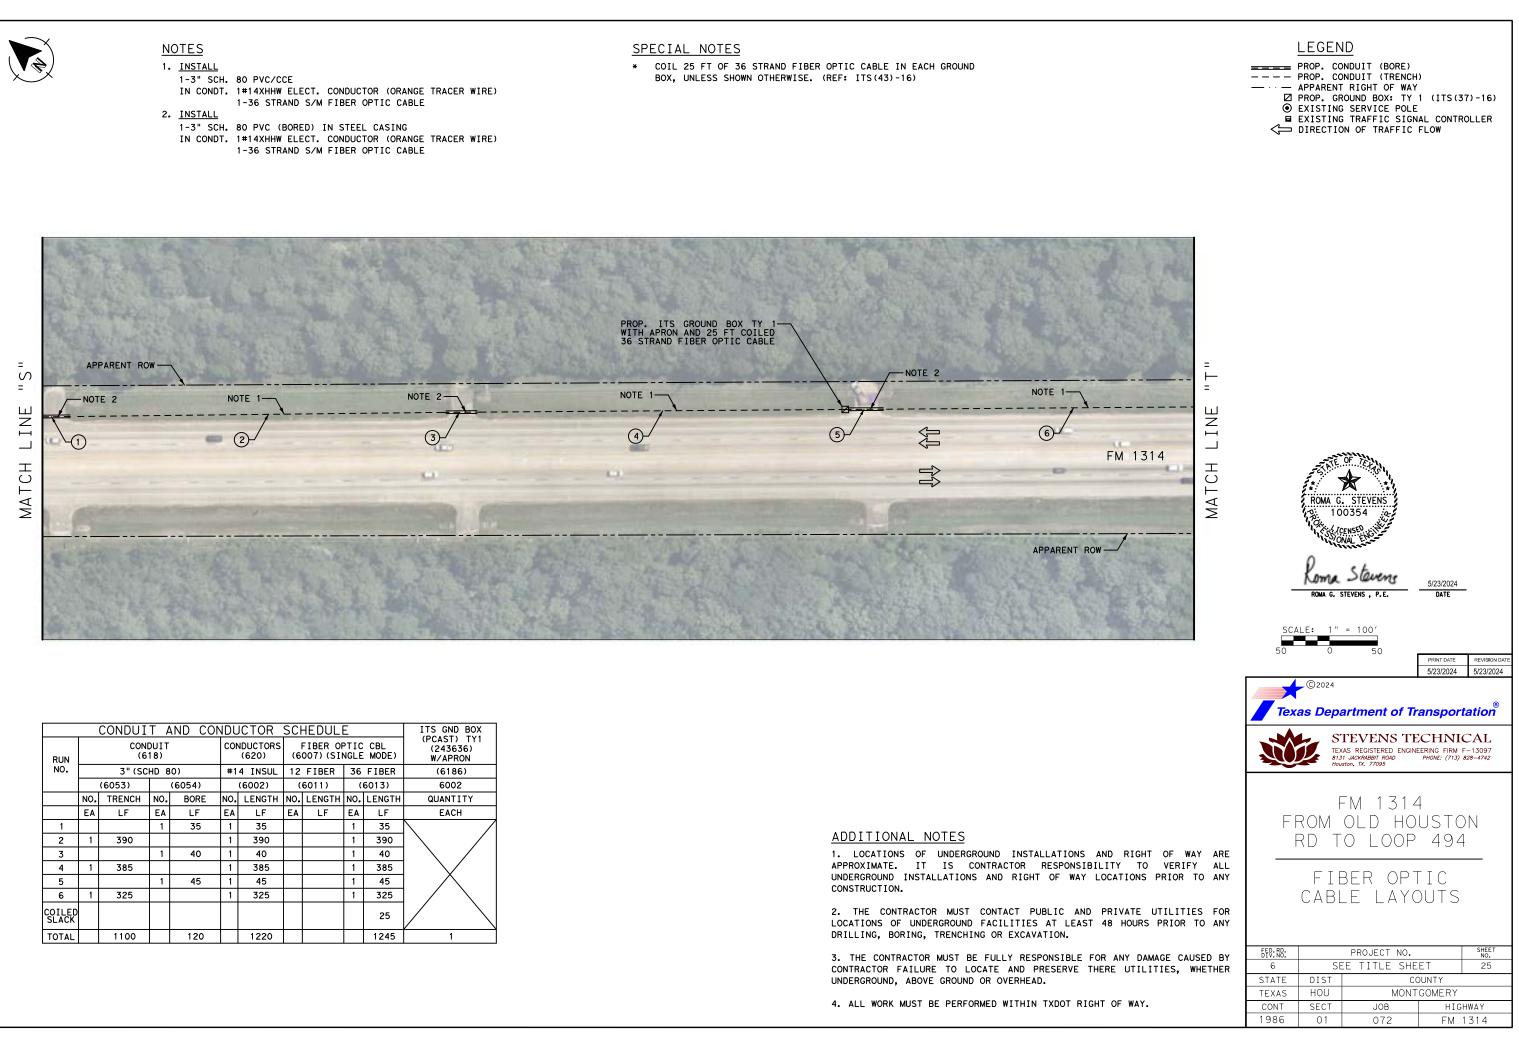

RUN			T / DUIT 18)	ND CON		JCTOR NDUCTORS (620)		HEDUL FIBER OF 007) (SI	PTIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)	(6054)		(6002)	(6011)	(6013)	6002	
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	ΕA	LF	EA	LF	EACH
1			1	35	1	35			1	35	\wedge \land
2	1	390			1	390			1	390	
3			1	40	1	40			1	40	
4	1	385			1	385			1	385	$ \vee $
5			1	45	1	45			1	45	
6	1	325			1	325			1	325	
COILED SLACK										25	
TOTAL		1100		120		1220				1245	1

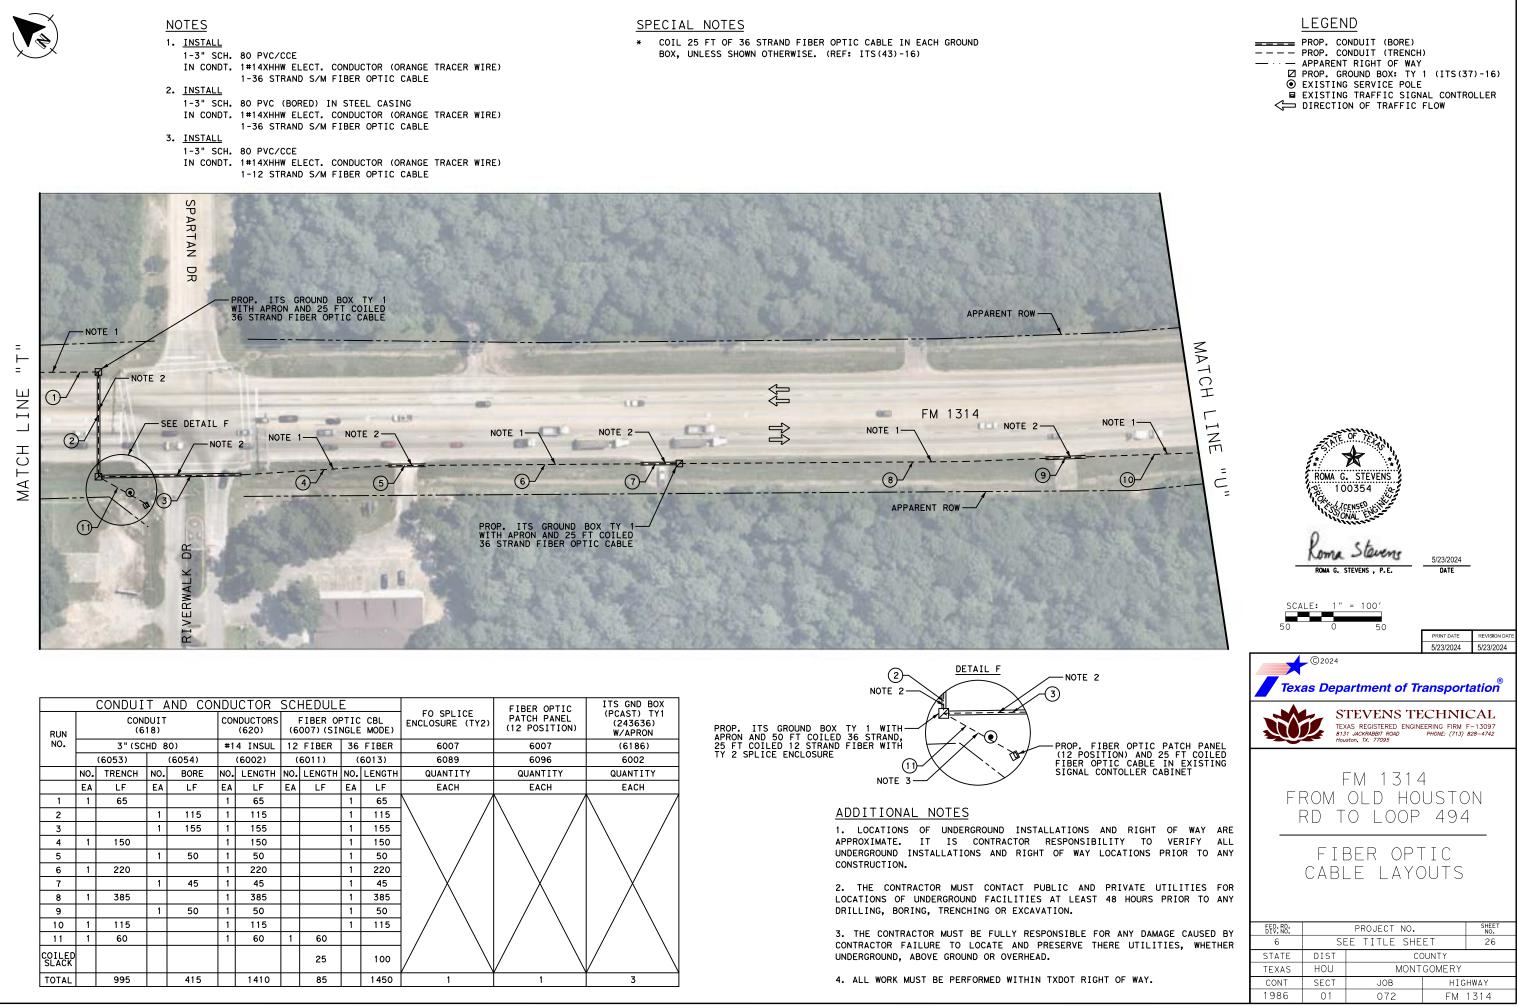

	1	CONDUI		ND COI		ICTOR					FO SPLICE	FIBER OPTIC	ITS GND BOX (PCAST) TY1
RUN			DUIT 18)		COI	NDUCTORS (620)	FIBER OPTIC CBL (6007)(SINGLE MODE)				ENCLOSURE (TY2)	PATCH PANEL (12 POSITION)	(243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH	EACH	EACH
1	1	65			1	65			1	65	Λ /	\backslash /	
2			1	115	1	115			1	115	\ /	\land	$ \rangle /$
3			1	155	1	155			1	155			
4	1	150			1	150			1	150			
5			1	50	1	50			1	50			
6	1	220			1	220			1	220		\setminus	$ \rangle \rangle /$
7			1	45	1	45			1	45	I X I	Х	Х
8	1	385			1	385			1	385			
9			1	50	1	50			1	50			
10	1	115			1	115			1	115			
11	1	60			1	60	1	60					
COILED SLACK								25		100	\backslash	/	/ \
TOTAL		995		415		1410		85		1450	1	1	3

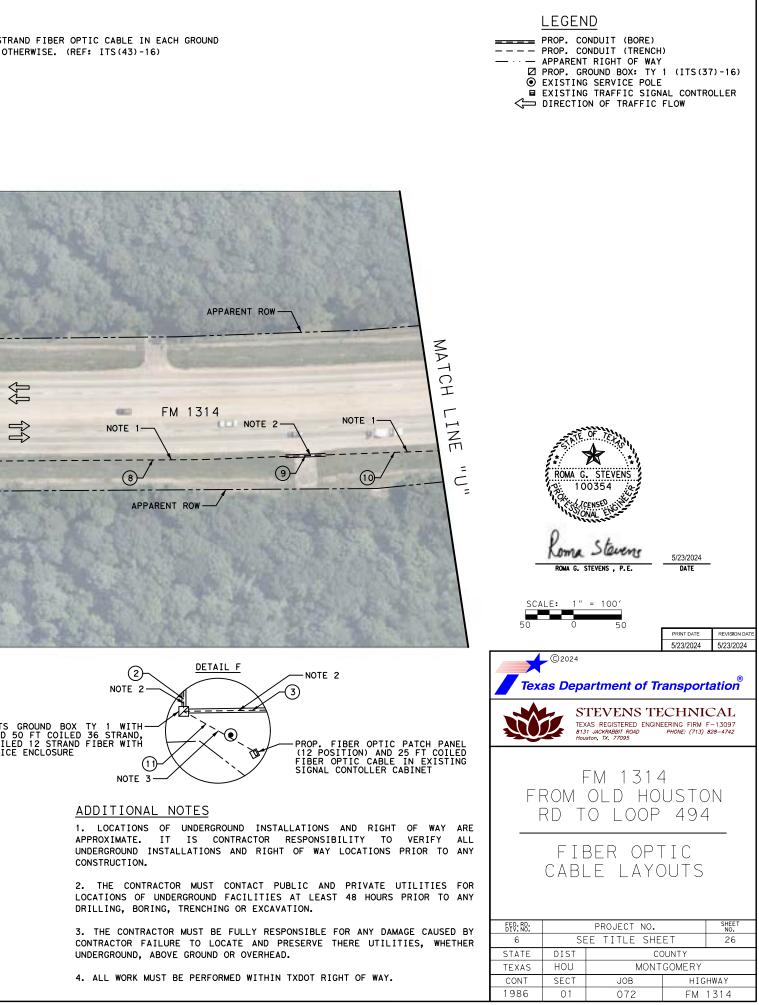




1. <u>INSTALL</u>

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

INSTALL 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

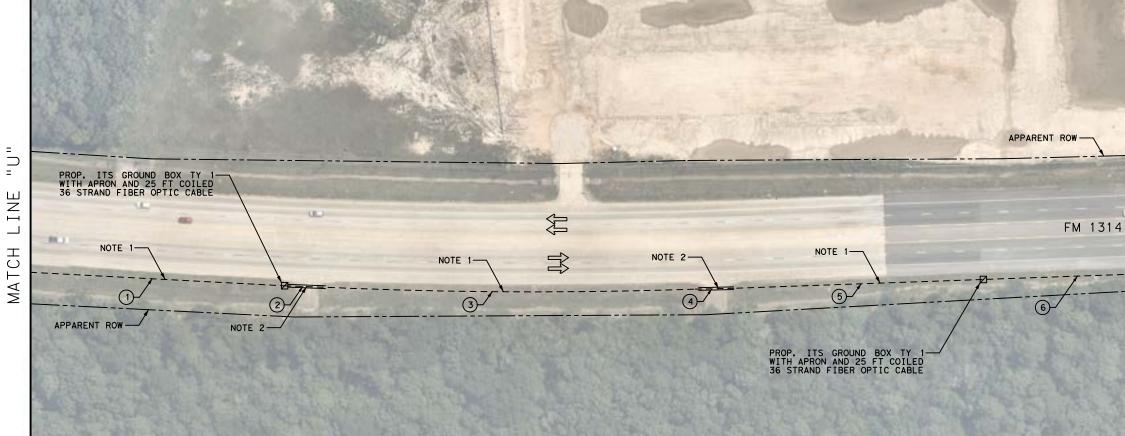


		CONDUI	ΤA	ND CON	IDL	JCTOR	SCI	HEDULI	=		ITS GND BOX
RUN		CONI (6	DUIT 18)		CON	NDUCTORS (620)		FIBER OF 007)(SI			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH
1	1	270			1	270			1	270	\land \land
2			1	50	1	50			1	50	
3	1	385			1	385			1	385	
4			1	45	1	45			1	45	
5	1	260			1	260			1	260	
6	1	210			1	210			1	210	
COILED SLACK										50	
TOTAL		1125		95		1220				1270	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

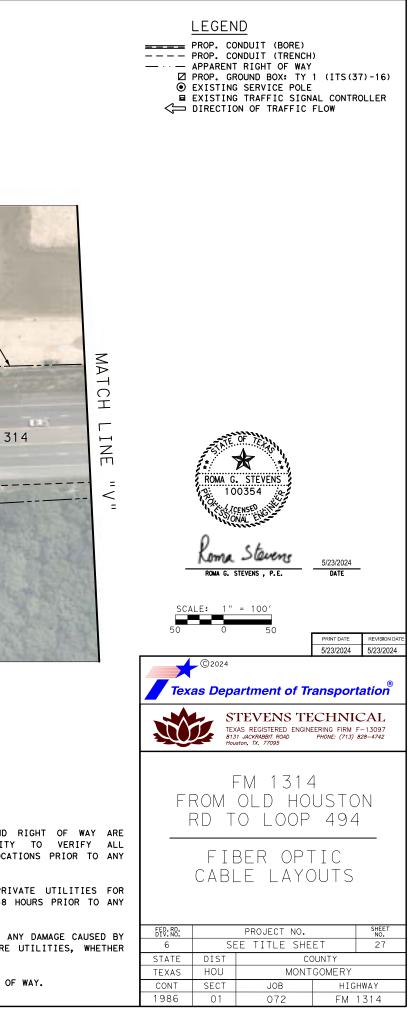

	NOTES 1. INSTALL 1-3" SCH. 80 PVC/CCE IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE 2. INSTALL 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE 3. INSTALL 1-3" SCH. 80 RMC (PARAPET MOUNTED) IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE 4. INSTALL JUNCTION BOX	<pre>SPECIAL NOTES * COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)</pre>
APPARENT ROW RMC TA NOTE 4 NOTE 1 NOTE 2 1 () (2)	NOTE 3 NOTE 1 NOTE NOTE 2 0	FM 1314 FM 1314 NOTE 2 APPARENT ROW PROP. ITS GROUND EXX TY 1 PROP. ITS GROUND EXX TY 1 S6 STRAND FIBER OPTIC CABLE


		CONDUI	ΤA	ND CON	١DU	CTOR S	БCН	EDULE					ITS GND BOX	
RUN			С	ONDUIT (618)			cor	NDUCTORS (620)	FIBER OPTIC CBL (6007) (SINGLE MODE)				(PCAST) TY1 (243636) W/APRON	JUNCTION BOX
NO.			3" ((SCHD 80)	_		#1	4 INSUL	12	FIBER	36	FIBER	(6186)	(6027)
		(6053)		(6054)		(6074)		(6002)	(6011)	(6013)	6002	6004
	NO.	TRENCH	NO.	BORE	NO.	RMC	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH	EACH
1	1	160					1	160			1	160	Λ /	N /
2			1	30			1	30			1	30		\ /
3	1	10					1	10			1	10		
4					1	100	1	100			1	100		
5	1	10					1	10			1	10		
6			1	125			1	125			1	125		
7	1	310					1	310			1	310	I X	I X I
8			1	225			1	225			1	225		
9	1	70					1	70			1	70		$ / \rangle $
10			1	115			1	115			1	115		
11	1	75					1	75			1	75		/
COILED SLACK												75	$ $ \setminus	/
TOTAL		635		495		100		1230				1305	3	2


ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.


2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

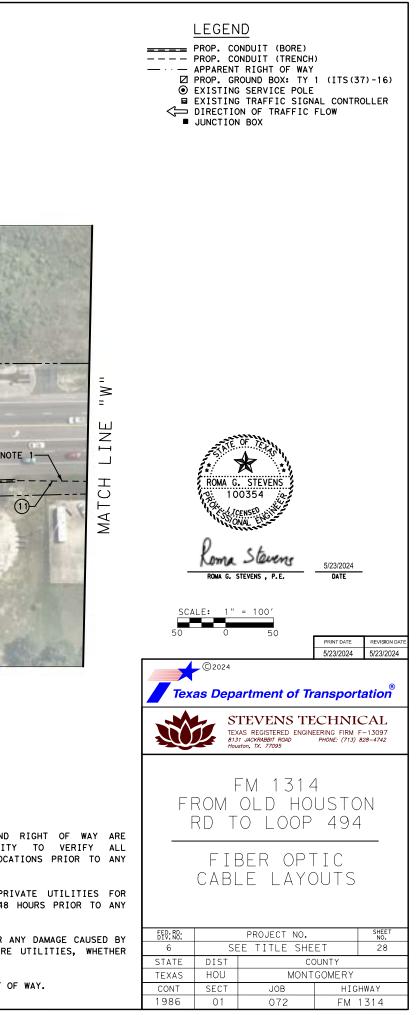

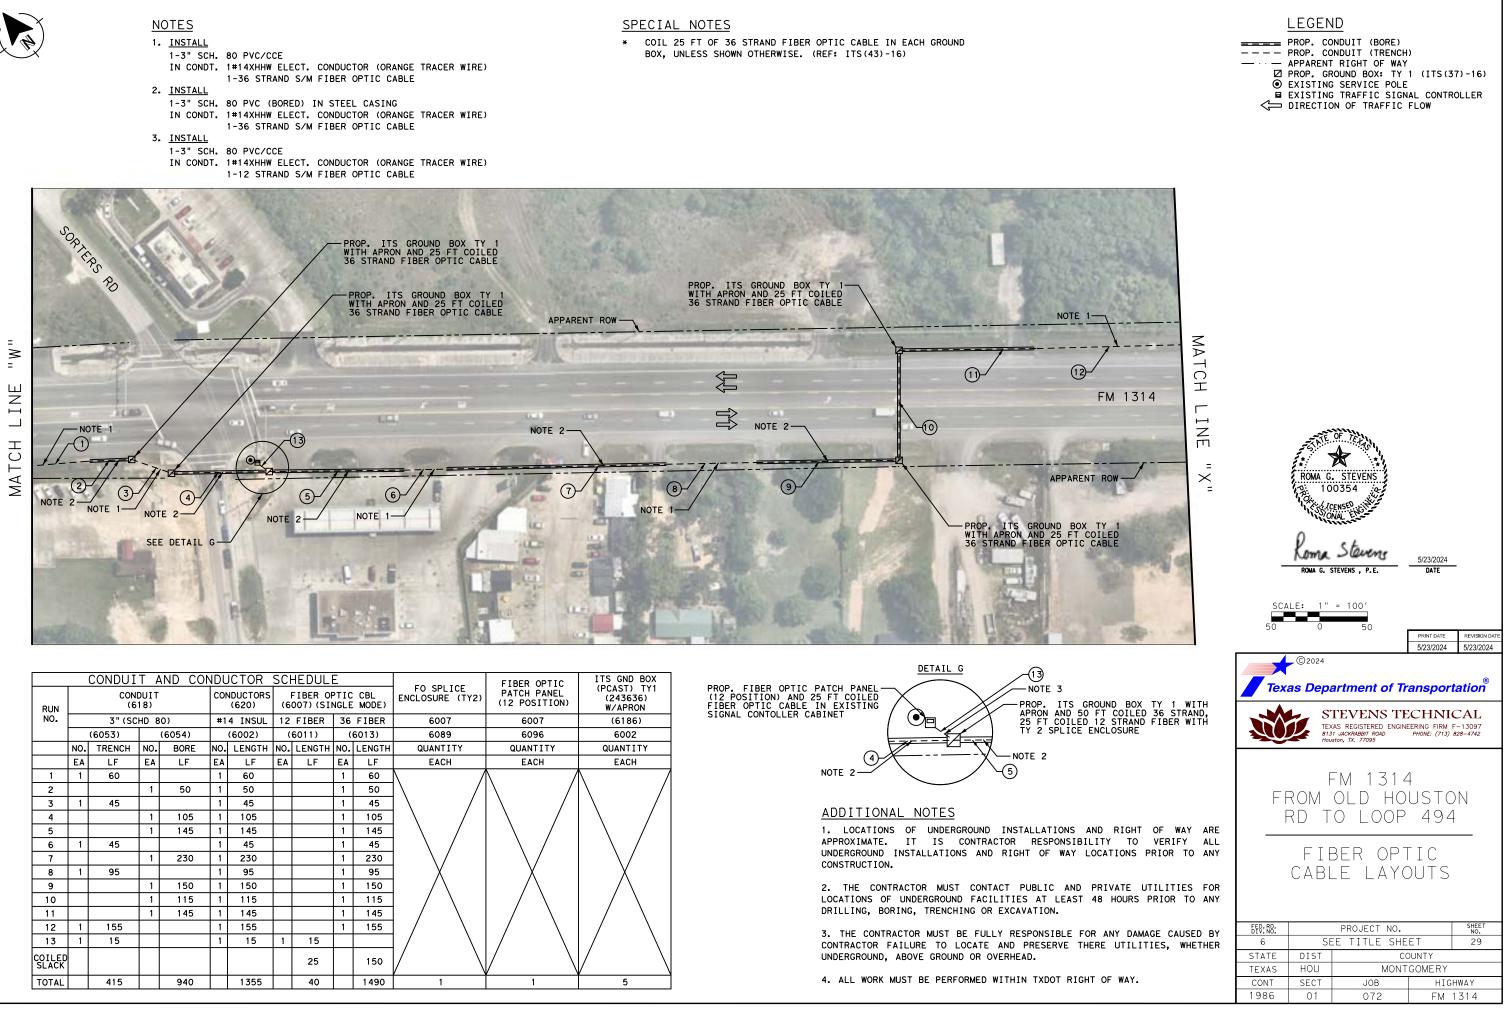

		CONDUI	ΤA	ND CO	ŅDU	ICTOR	SCI	HEDULI	E			FIBER OPTIC	ITS GND BOX
RUN			DUIT 18)			IDUCTORS (620)	FIBER OPTIC CBL (6007) (SINGLE MODE)				FO SPLICE ENCLOSURE (TY2)	PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)	(6054)			(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	ΕA	LF	EA	LF	EACH	EACH	EACH
1	1	60			1	60			1	60	Ν /	\setminus /	Λ /
2			1	50	1	50			1	50]\ /	\backslash /	
3	1	45			1	45			1	45	1 \ /	\backslash /	
4			1	105	1	105			1	105	$ \rangle / $	\setminus /	
5			1	145	1	145			1	145	1 \ /	\setminus /	
6	1	45			1	45			1	45	1 \ /	\setminus /	
7			1	230	1	230			1	230	1 \/	\setminus /	$ \setminus / $
8	1	95			1	95			1	95	1 X	χ	X
9			1	150	1	150			1	150	1 /\		
10			1	115	1	115			1	115	1 / \		
11			1	145	1	145			1	145	1 / \		
12	1	155			1	155			1	155	1 / \		
13	1	15			1	15	1	15			1/ \		
COILED SLACK								25		150	\backslash	/	\backslash
TOTAL		415		940		1355		40		1490	1	1	5

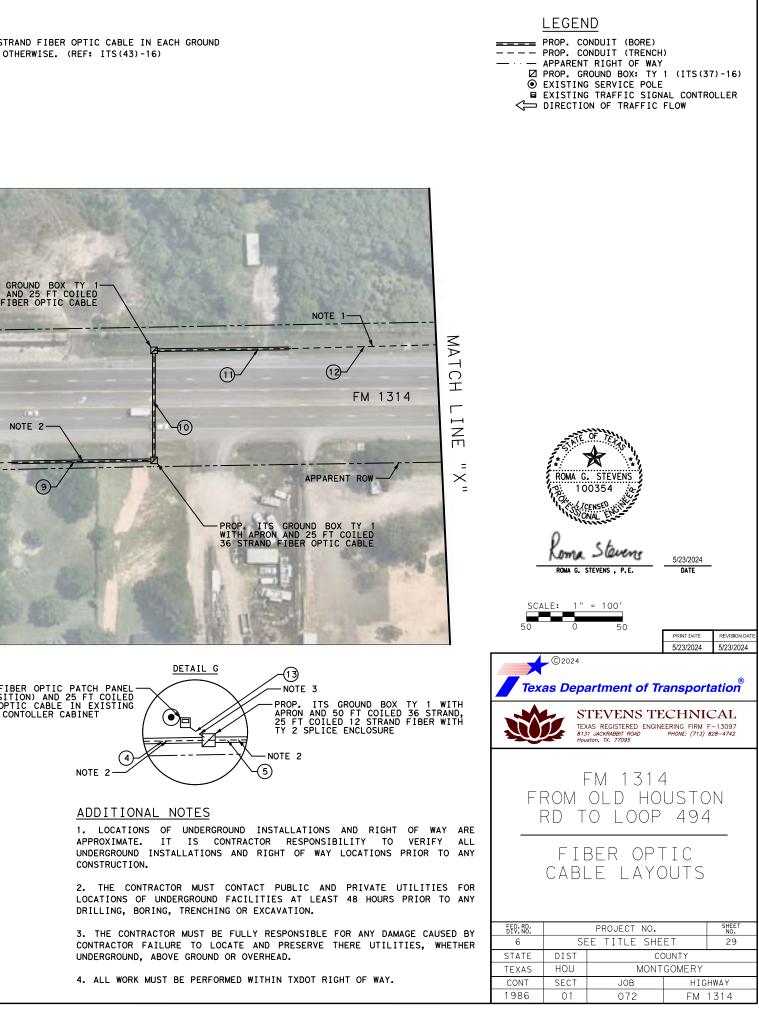

1. INSTALL

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

INSTALL 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

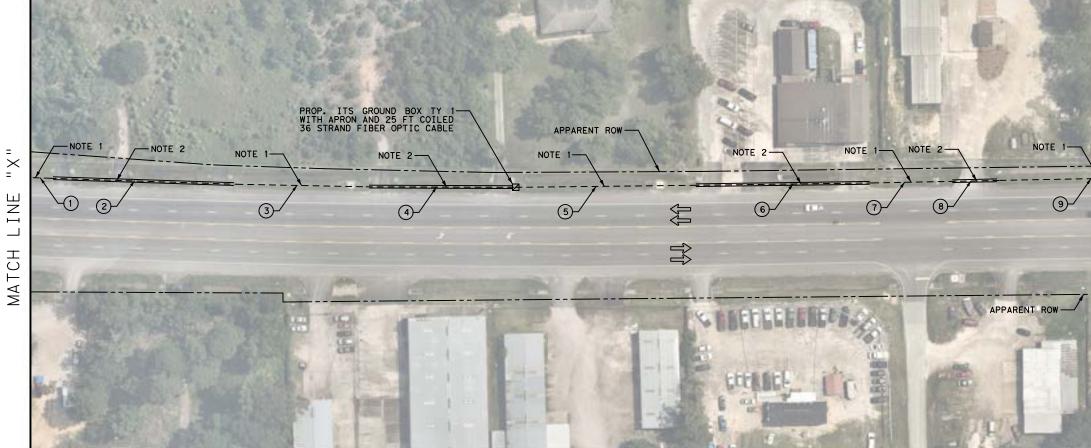

		CONDUI	ΤA	ND CON	IDL	JCTOR	SCI	HEDUL	Ξ		ITS GND BOX
RUN			DUIT 18)		CON	NDUCTORS (620)		FIBER OF 007)(SIN			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	ΕA	LF	ΕA	LF	EACH
1	1	25			1	25			1	25	\wedge /
2			1	195	1	195			1	195	\ /
3	1	135			1	135			1	135	
4			1	160	1	160			1	160	
5	1	185			1	185			1	185	
6			1	190	1	190			1	190	I X I
7	1	80			1	80			1	80	
8			1	55	1	55			1	55	
9	1	190			1	190			1	190	
COILED SLACK										25	$ $ \setminus
TOTAL		615		600		1215				1240	1

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT OF WAY.



1. INSTALL

1-3" SCH. 80 PVC/CCE

IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. <u>INSTALL</u>

I-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)



		CONDUI	ΤA	ND CON	NDL	JCTOR	SCI	HEDULI	Ε		ITS GND BOX
RUN			DUIT 18)		CON	NDUCTORS (620)		FIBER OF 007)(SI			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH
1	1	50			1	50			1	50	N /
2			1	60	1	60			1	60	\ /
3	1	150			1	150			1	150	
4			1	65	1	65			1	65	
5	1	180			1	180			1	180	
6			1	40	1	40			1	40	
7	1	160			1	160			1	160	I X I
8			1	245	1	245			1	245	
9	1	145			1	145			1	145	
10			1	60	1	60			1	60	
11	1	50			1	50			1	50	/
COILED SLACK										50	\backslash
TOTAL		735		470		1205				1255	2

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND APPROXIMATE. IT IS CONTRACTOR RESPONSIBILI UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOC CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT

		PROP. CC APPARENT PROP. GF EXISTING EXISTING	ID NDUIT (BORE) NDUIT (TRENC RIGHT OF WA ROUND BOX: TY SERVICE POL STRAFFIC SIG NO OF TRAFFIC	Y 1 (ITS(3 E NAL CONTR	
MATCH LINE "Z"		ROMA G	OF TOTAL		
	50	NLE: 1" 0	Stevens STEVENS , P.E. = 100' 50	5/23/2024 DATE PRINT DATE 5/23/2024	REVISION DATE 5/23/2024
		S' TEX	Artment of 1 TEVENS T (AS REGISTERED ENG) 4 JACKRABBIT ROAD ston, TX. 77095	ECHNI	CAL -13097
ND RIGHT OF WAY ARE ITY TO VERIFY ALL DCATIONS PRIOR TO ANY		ROM RDT FIE	BER OP)USTC 2 494 	
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY		CABI	_E LAY	0015	
R ANY DAMAGE CAUSED BY RE UTILITIES, WHETHER	FED. RD. DIV. NO. 6		PROJECT NO. EE TITLE SH	EET	sheet No. 31
OF WAY.	STATE TEXAS CONT 1986	DIST HOU SECT 01		COUNTY TGOMERY HIGH FM 1	HWAY
			012	T IVI	TIVIT



1. <u>INSTALL</u> 1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

SPECIAL NOTES

COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND × BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

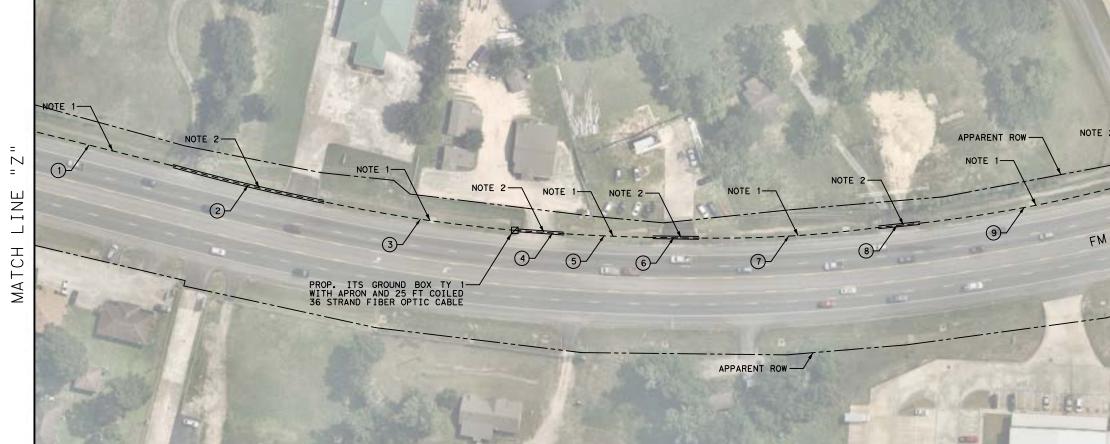

RUN		CONDUI coni (6		ND CON		ICTOR NDUCTORS (620)		HEDULI FIBER OF 007) (SIN	TIC		ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	ΕA	LF	EACH
1	1	150			1	150			1	150	Λ /
2			1	170	1	170			1	170	
3	1	205			1	205			1	205	
4			1	55	1	55			1	55	
5	1	90			1	90			1	90	
6			1	55	1	55			1	55	
7	1	185			1	185			1	185	
8			1	50	1	50			1	50	
9	1	215			1	215			1	215	
10			1	50	1	50			1	50	
COILED SLACK										25	$ $ \setminus
TOTAL		845		380		1225				1250	1

ADDITIONAL NOTES


1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBILI UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOC CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT

		PROP. CC APPARENT PROP. GF EXISTING EXISTING	D NDUIT (BORE) NDUIT (TRENCH RIGHT OF WAY OUND BOX: TY SERVICE POLE TRAFFIC SIGN N OF TRAFFIC	1 (ITS(3 AL CONTR	
2 MATCH LINE #A#	SCA 50	Roma	OF 75 STEVENS 0354 VAL Stevens VAL Stevens TEVENS , P.E. = 100'	5/23/2024 DATE PRINT DATE 5/23/2024	REVISION DATE 5/23/2024
	Tex	S' TED 813	Artment of Tr FEVENS TE AS REGISTERED ENGINI 1 JACKRABBT ROAD	CHNI	CAL F-13097
ND RIGHT OF WAY ARE ITY TO VERIFY ALL DCATIONS PRIOR TO ANY PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY		ROM RD T FIE	500 1314 OLD HO O LOOP BER OPT E LAYC	USTC 494	
ANY DAMAGE CAUSED BY RE UTILITIES, WHETHER	EED.RD. 6 STATE TEXAS	DIST HOU	MONT	DUNTY GOMERY	SHEET NO. 32
·····	CONT 1986	SECT 01	JOB 072		HWAY 1314

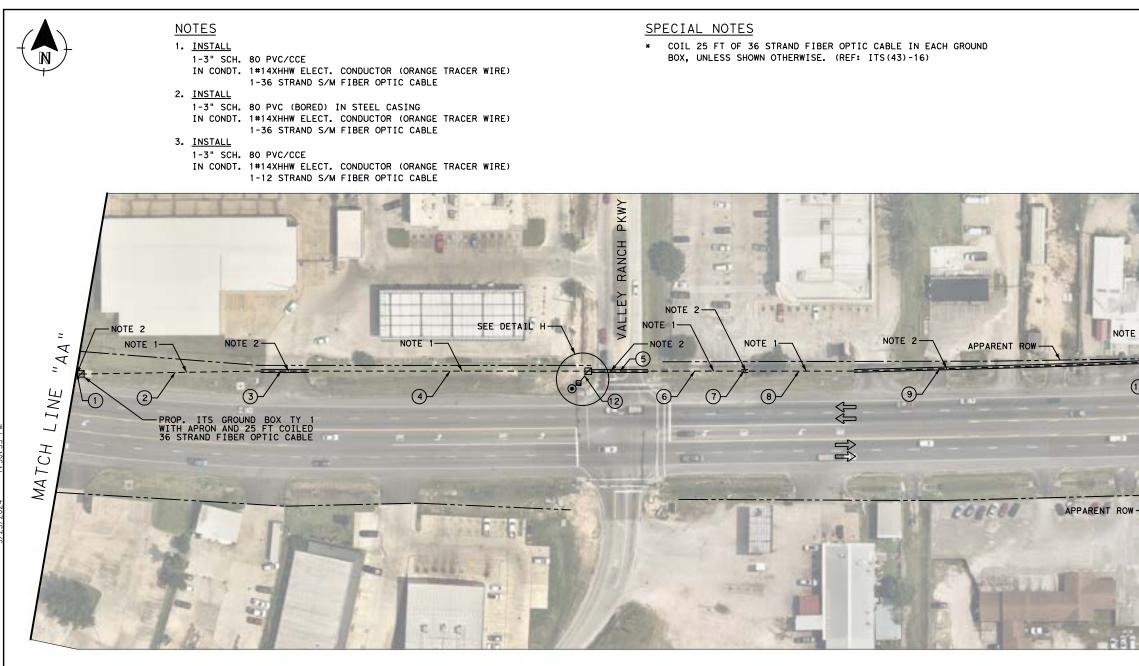

		CONDUI	т л				SCI		-				ITS GND BOX
RUN		CONI	1017 18)			IDUCTORS (620)		FIBER OF 007) (SI	PTIC		FO SPLICE ENCLOSURE (TY2)	FIBER OPTIC PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH	EACH	EACH
1			1	5	1	5			1	5	\land /	\land /	Λ /
2	1	185			1	185			1	185		\land /	\ /
3			1	60	1	60			1	60			
4	1	290			1	290			1	290			
5			1	70	1	70			1	70			
6	1	95			1	95			1	95	$ \setminus / $	\setminus /	
7			1	10	1	10			1	10			
8	1	110			1	110			1	110	\wedge	\wedge	\wedge
9			1	315	1	315			1	315			
10	1	50			1	50			1	50			
11			1	35	1	35			1	35			
12	1	15			1	15	1	15					
COILED SLACK								25		75	/	/	/
TOTAL		745		495		1240		40		1300	1	1	2

DETAIL H PROP. ITS GROUND BOX TY 1 WITH APRON AND 50 FT COILED 36 STRAND, 25 FT COILED 12 STRAND FIBER WITH TY 2 SPLICE ENCLOSURE -NOTE 2 (5) (12) 4 (\bullet) -NOTE 3 NOTE 1-


ADDITIONAL NOTES


1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND RIGHT OF WAY ARE APPROXIMATE. IT IS CONTRACTOR RESPONSIBILITY TO VERIFY ALL UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOCATIONS PRIOR TO ANY CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PRIVATE UTILITIES FOR LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 HOURS PRIOR TO ANY DRILLING, BORING, TRENCHING OR EXCAVATION.


3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR ANY DAMAGE CAUSED BY CONTRACTOR FAILURE TO LOCATE AND PRESERVE THERE UTILITIES, WHETHER UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT OF WAY.

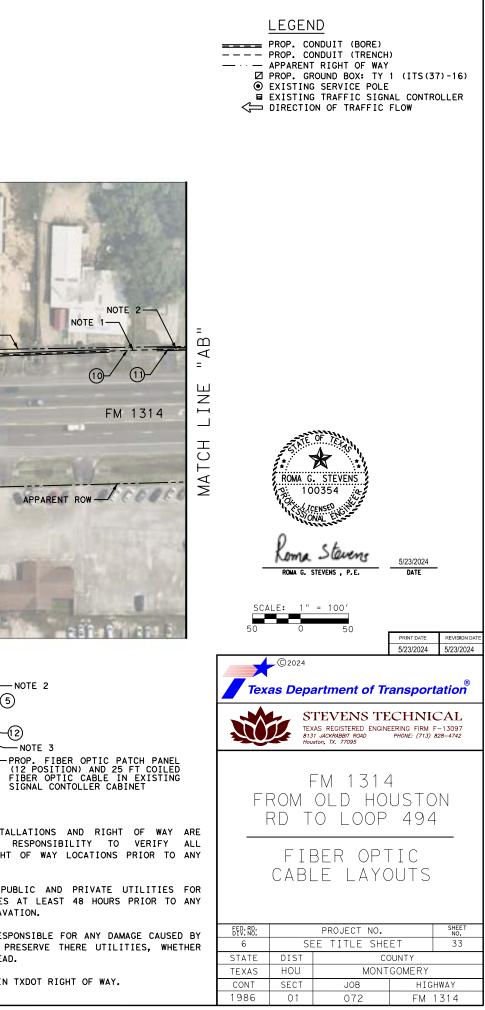

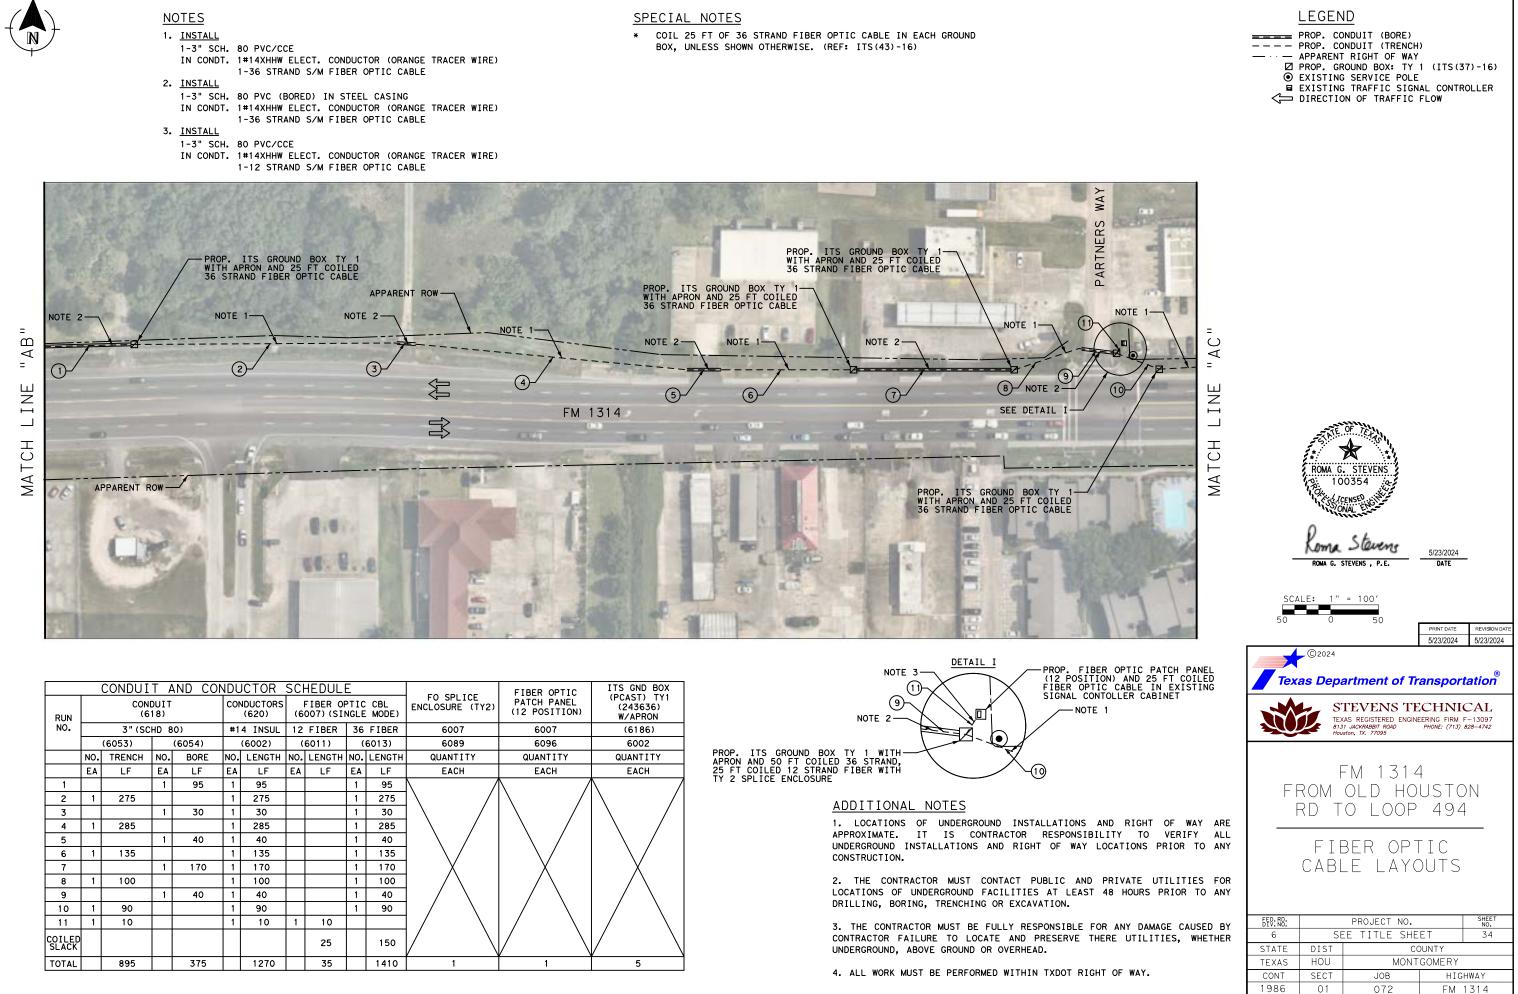

RUN	(CONDUI coni (6		ND CO		ICTOR NDUCTORS (620)	1	HEDULI FIBER OF 007) (SI	PTIC		FO SPLICE ENCLOSURE (TY2)	FIBER OPTIC PATCH PANEL (12 POSITION)	ITS GND BOX (PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
	-	(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	ΕA	LF	ΕA	LF	EACH	EACH	EACH
1			1	95	1	95			1	95	Λ /	\setminus /	\backslash /
2	1	275			1	275			1	275	\ /	\backslash /	\land /
3			1	30	1	30			1	30		\backslash /	
4	1	285			1	285			1	285		\setminus /	
5			1	40	1	40			1	40		\setminus /	
6	1	135			1	135			1	135		\setminus /	\setminus /
7			1	170	1	170			1	170	I X	Х	Х
8	1	100			1	100			1	100			
9			1	40	1	40			1	40			
10	1	90			1	90			1	90			
11	1	10			1	10	1	10					
COILED SLACK								25		150	\backslash	/	$ $ \setminus
TOTAL		895		375		1270		35		1410	1	1	5

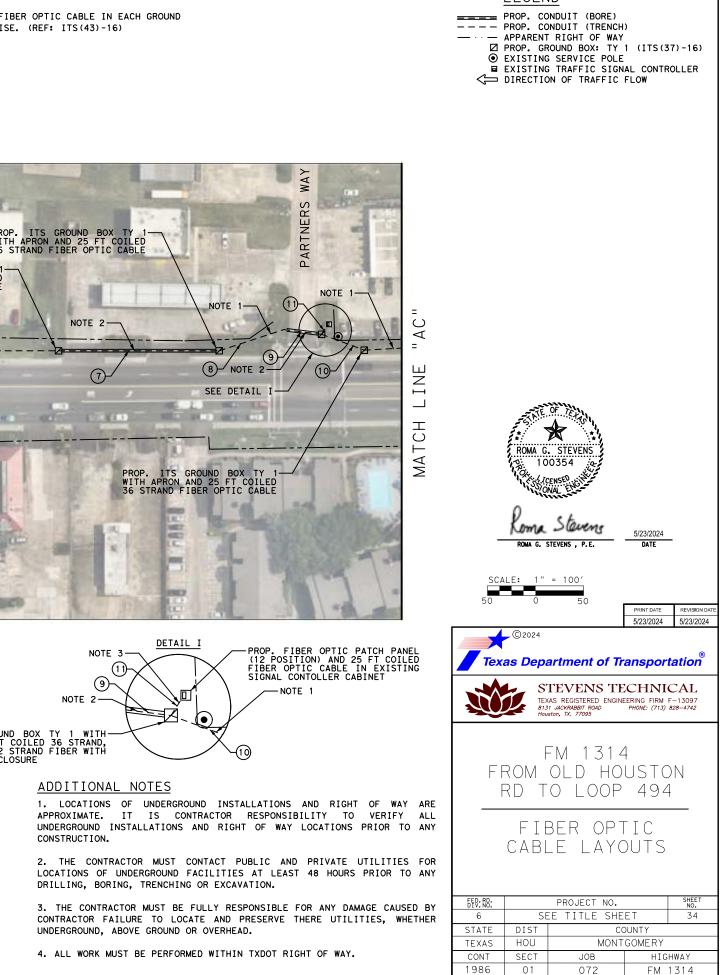



1. INSTALL

1-3" SCH. 80 PVC/CCE


IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE

2. INSTALL

1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE



* COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

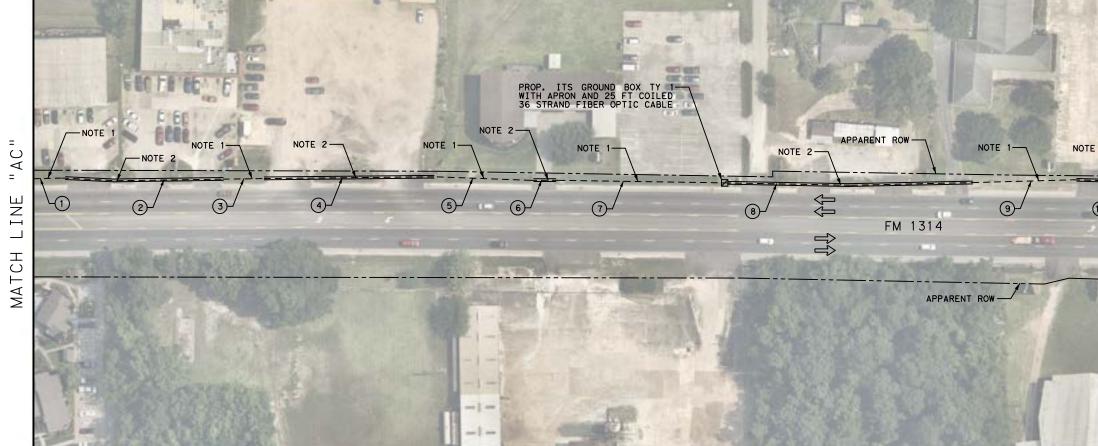

		CONDUI	ΤA	ND CON	IDL	ICTOR	SCI	HEDULI	Ξ		ITS GND BOX
RUN			DUIT 18)		cor	NDUCTORS (620)		FIBER OF 007)(SIN			(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	ΕA	LF	EACH
1	1	35			1	35			1	35	Λ /
2			1	175	1	175			1	175	$ \rangle / $
3	1	45			1	45			1	45	
4			1	180	1	180			1	180	
5	1	100			1	100			1	100	$ \setminus / $
6			1	30	1	30			1	30	
7	1	175			1	175			1	175	
8			1	265	1	265			1	265	
9	1	110			1	110			1	110	$ / \rangle $
10			1	120	1	120			1	120	
COILED SLACK										25	/
TOTAL		465		770		1235				1260	1

ADDITIONAL NOTES

1. LOCATIONS OF UNDERGROUND INSTALLATIONS AND APPROXIMATE. IT IS CONTRACTOR RESPONSIBILI UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOO CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND PF LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 48 DRILLING, BORING, TRENCHING OR EXCAVATION.

3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THEF UNDERGROUND, ABOVE GROUND OR OVERHEAD.

4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT

		PROP. CC APPARENT PROP. GF EXISTING EXISTING	D NDUIT (BOR NDUIT (TRE RUIGHT OF ROUND BOX: S SERVICE F G TRAFFIC S DN OF TRAFF	NCH) WAY TY 1 (ITS OLE GIGNAL CON	
MATCH LINE "AD"	50		OF	TECHN ENGINEERING FIF PHONE: (7	re REVISION DATE 24 5/23/2024 Dortation® NICAL
ND RIGHT OF WAY ARE _ITY TO VERIFY ALL OCATIONS PRIOR TO ANY		ROM RD T FIE	OLD H	HOUST)P 49 PTIC) 4
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY	FED. RD. DIV. NO.		PROJECT N		SHEET NO.
R ANY DAMAGE CAUSED BY ERE UTILITIES, WHETHER	6 STATE TEXAS	SE DIST HOU	E TITLE		35
T OF WAY.	CONT 1986	SECT 01	JOB 072	Н	IGHWAY A 1314

N

<u>NOTES</u>

- 1. INSTALL 1-3" SCH. 80 PVC/CCE
 - IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE


2. <u>INSTALL</u>

- 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE
- 3. <u>INSTALL</u>

- 1-3" SCH. 80 RMC (PARAPET MOUNTED) IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE
- 4. <u>INSTALL</u>
 - JUNCTION BOX



* COIL 25 FT OF 36 STRAND FIBER OPTIC CAB BOX, UNLESS SHOWN OTHERWISE. (REF: ITS)

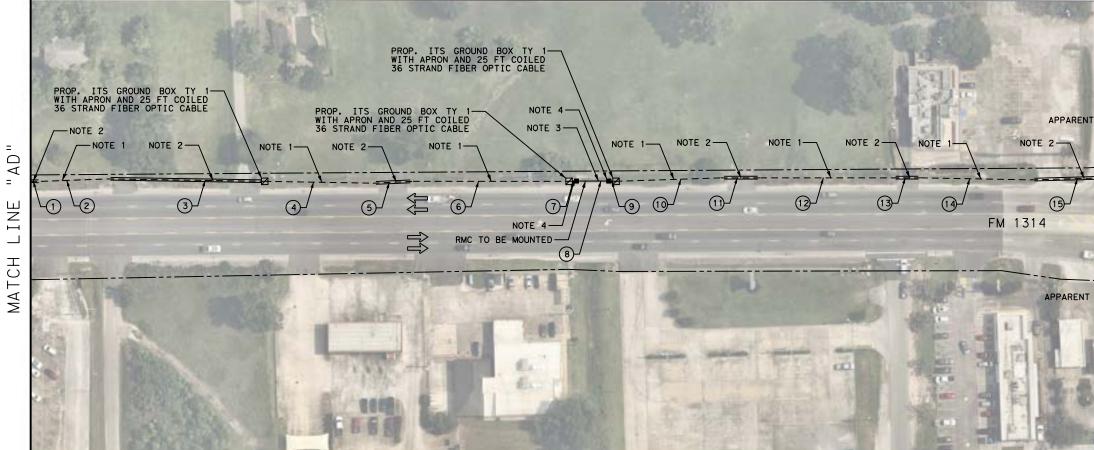

	. (CONDUI	ΤA	ND CO	NDU	CTOR S	СН	EDULE					ITS GND BOX	
RUN				ONDUIT (618)			cor	NDUCTORS (620)		FIBER OF 007)(SI			(PCAST) TY1 (243636) W/APRON	JUNCTION BOX
NO.			3" (SCHD 80)			#1	4 INSUL	12	FIBER	36	FIBER	(6186)	(6027)
		(6053)		(6054)		(6074)		(6002)	(6011)	(6013)	6002	6004
	NO.	TRENCH	NO.	BORE	NO.	RMC	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH	EACH
1			1	10			1	10			1	10	Λ /	Λ /
2	1	70					1	70			1	70		\ /
3			1	165			1	165			1	165		
4	1	115					1	115			1	115		
5			1	45			1	45			1	45		
6	1	165					1	165			1	165		
7	1	10					1	10			1	10		
8					1	35	1	35			1	35		\backslash
9	1	10					1	10			1	10	Х	Х
10	1	110					1	110			1	110		/
11			1	45			1	45			1	45		
12	1	140					1	140			1	140		
13			1	30			1	30			1	30		
14	1	120					1	120			1	120		
15			1	165			1	165			1	165		
COILED SLACK												75	/	$/$ \setminus
TOTAL		740		460		35		1235				1310	3	2

ADDITIONAL NOTES


1. LOCATIONS OF UNDERGROUND INSTALLATIONS AN APPROXIMATE. IT IS CONTRACTOR RESPONSIBILI UNDERGROUND INSTALLATIONS AND RIGHT OF WAY LOW CONSTRUCTION.

2. THE CONTRACTOR MUST CONTACT PUBLIC AND P LOCATIONS OF UNDERGROUND FACILITIES AT LEAST 4 DRILLING, BORING, TRENCHING OR EXCAVATION.


3. THE CONTRACTOR MUST BE FULLY RESPONSIBLE FOR CONTRACTOR FAILURE TO LOCATE AND PRESERVE THEF UNDERGROUND, ABOVE GROUND OR OVERHEAD.


4. ALL WORK MUST BE PERFORMED WITHIN TXDOT RIGHT

BLE IN EACH GROUND (43)-16)	LEGEND PROP. CONDUIT (BORE) PROP. CONDUIT (TRENCH) APPARENT RIGHT OF WAY Ø PROP. GROUND BOX: TY 1 (ITS(37)-16) € EXISTING SERVICE POLE ■ EXISTING TRAFFIC SIGNAL CONTROLLER DIRECTION OF TRAFFIC FLOW JUNCTION BOX
ROM LINE "AE"	$\frac{1}{500000000000000000000000000000000000$
	Texas Department of Transportation [®]
	STEVENS TECHNICAL TEXAS REGISTERED ENGINEERING FIRM F-13097 8131 JACKRABBE ROAD PHONE: (713) 828-4742 Houston, TX. 77095
ND RIGHT OF WAY ARE	FM 1314 FROM OLD HOUSTON RD TO LOOP 494
LITY TO VERIFY ALL OCATIONS PRIOR TO ANY	FIBER OPTIC CABLE LAYOUTS
PRIVATE UTILITIES FOR 48 HOURS PRIOR TO ANY	CADLE LATUUIS
R ANY DAMAGE CAUSED BY ERE UTILITIES, WHETHER	FED: RD: PROJECT NO. SHEET NO. 6 SEE TITLE SHEET 36 STATE DIST COUNTY
T OF WAY.	TEXAS HOU MONTGOMERY CONT SECT JOB HIGHWAY 1986 01 072 FM 1314
	VIZ FWIIJI4

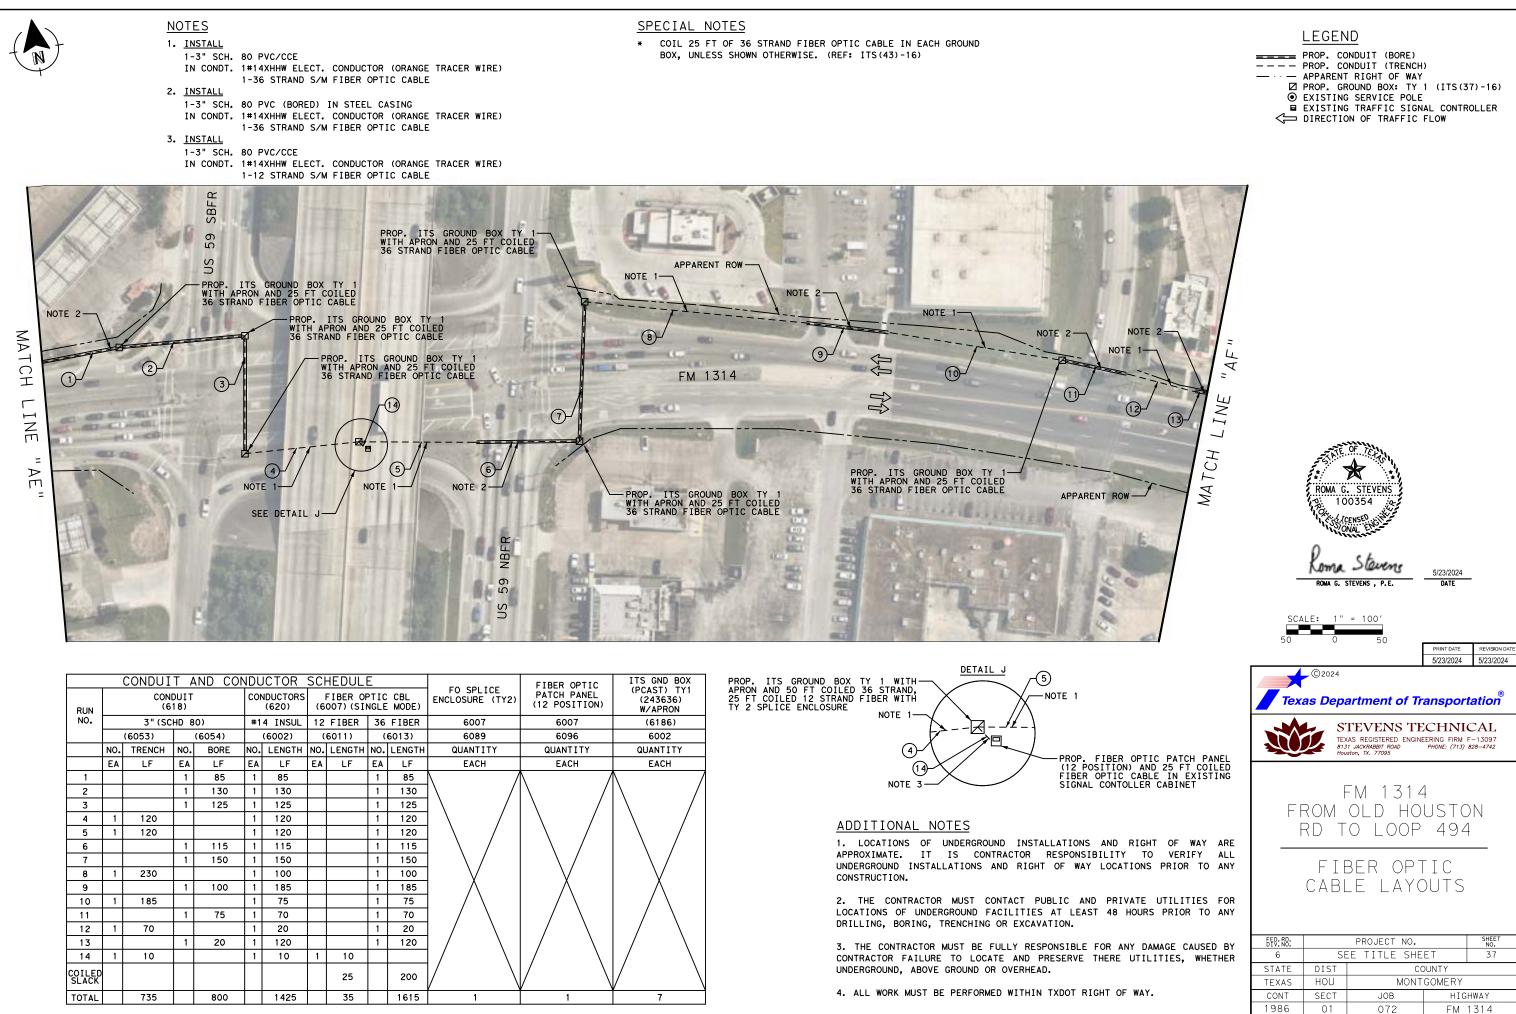

		CONDUI	ΤA	ND COI	NDL	JCTOR	SCI	HEDULI	Ε			FIBER OPTIC	ITS GND BOX
RUN		CONI (6	DUIT 18)		cor	NDUCTORS (620)	S FIBER OPTIC CBL (6007)(SINGLE MODE)				FO SPLICE ENCLOSURE (TY2)	PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EACH	EACH	EACH
1			1	85	1	85			1	85	Λ /	\ /	Λ /
2			1	130	1	130			1	130	\ /	\land	\ /
3			1	125	1	125			1	125			
4	1	120			1	120			1	120			
5	1	120			1	120			1	120			
6			1	115	1	115			1	115			
7			1	150	1	150			1	150			
8	1	230			1	100			1	100			
9			1	100	1	185			1	185		\wedge	
10	1	185			1	75			1	75			
11			1	75	1	70			1	70			$ / \rangle $
12	1	70			1	20			1	20			
13			1	20	1	120			1	120			
14	1	10			1	10	1	10			/		
COILED SLACK								25		200	\backslash	/	
TOTAL		735		800		1425		35		1615	1	1	7

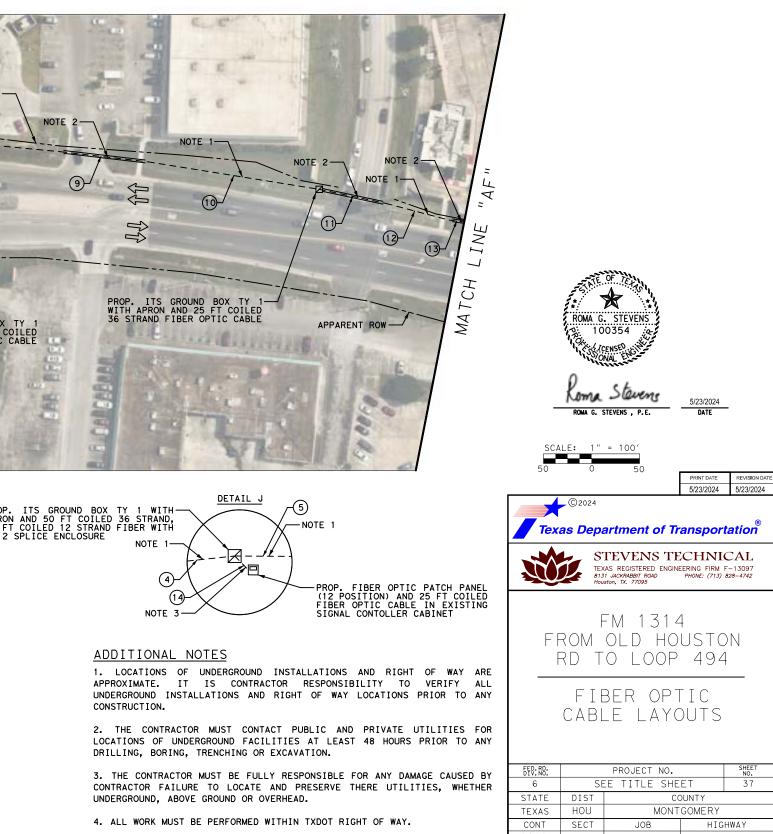






NOTES

1. INSTALL


- 1-3" SCH. 80 PVC/CCE
- IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE
- 2. INSTALL 1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE)
- 1-36 STRAND S/M FIBER OPTIC CABLE 3. INSTALL
- 1-3" SCH. 80 PVC/CCE
- IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-12 STRAND S/M FIBER OPTIC CABLE

SPECIAL NOTES

COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND × BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

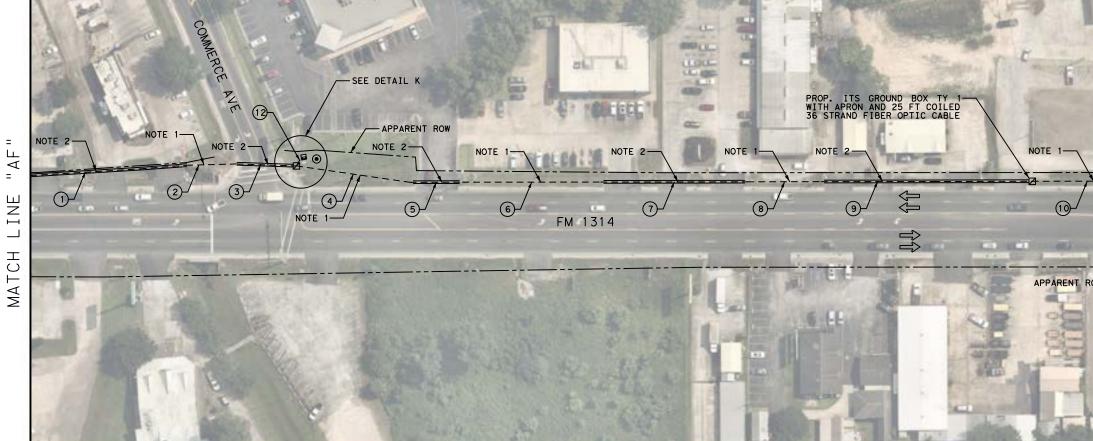

	CONDUIT AND CONDUCTOR SCHEDULE											FIBER OPTIC	ITS GND BOX
RUN	CONDUIT (618)			CONDUCTORS FIBER OPTIC CBL (620) (6007) (SINGLE MODE				FO SPLICE ENCLOSURE (TY2)	PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON			
NO.		3" (SC	HD 8	0)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	EA	LF	ΕA	LF	EA	LF	EACH	EACH	EACH
1			1	165	1	165			1	165	Λ /		
2	1	55			1	55			1	55			\ /
3			1	65	1	65			1	65			
4	1	120			1	120			1	120			
5			1	55	1	55			1	55			
6	1	145			1	145			1	145			
7			1	155	1	155			1	155			
8	1	80			1	80			1	80		\land	\land
9			1	220	1	220			1	220			
10	1	115			1	115			1	115			
11			1	45	1	45			1	45			
12	1	15			1	15	1	15					
COILED SLACK								25		75	/	/	/
TOTAL		530		705		1235		40		1295	1	1	2

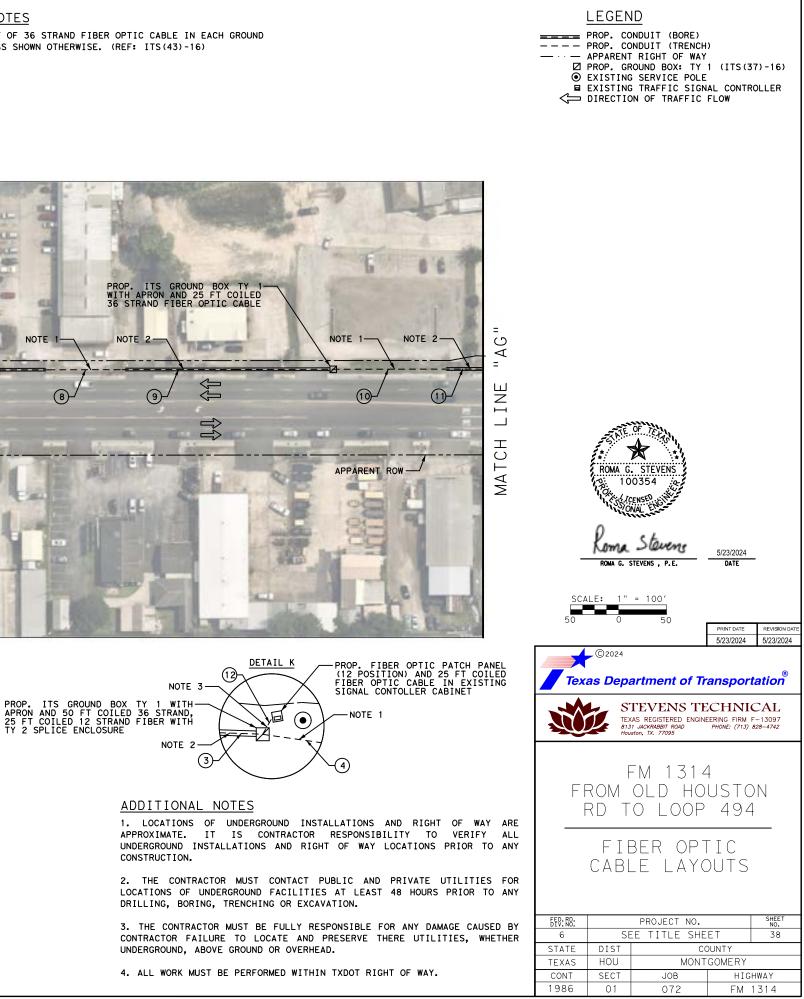

-



NOTES

1. INSTALL


1-3" SCH. 80 PVC (BORED) IN STEEL CASING IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-36 STRAND S/M FIBER OPTIC CABLE


2. INSTALL

1-3" SCH. 80 PVC/CCE IN CONDT. 1#14XHHW ELECT. CONDUCTOR (ORANGE TRACER WIRE) 1-12 STRAND S/M FIBER OPTIC CABLE


SPECIAL NOTES

COIL 25 FT OF 36 STRAND FIBER OPTIC CABLE IN EACH GROUND × BOX, UNLESS SHOWN OTHERWISE. (REF: ITS(43)-16)

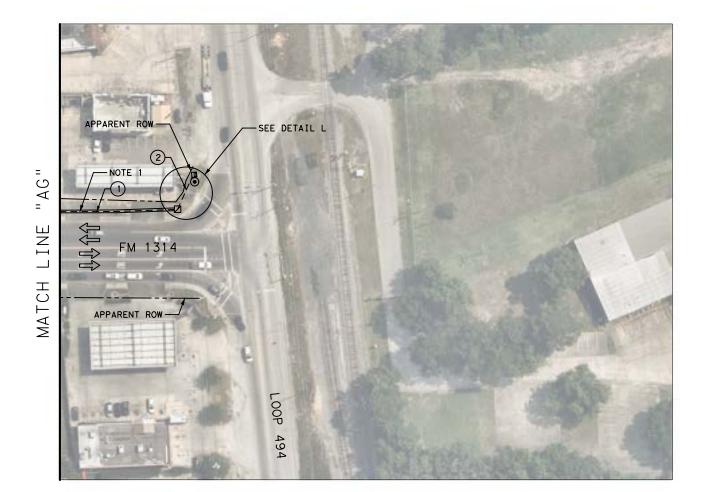

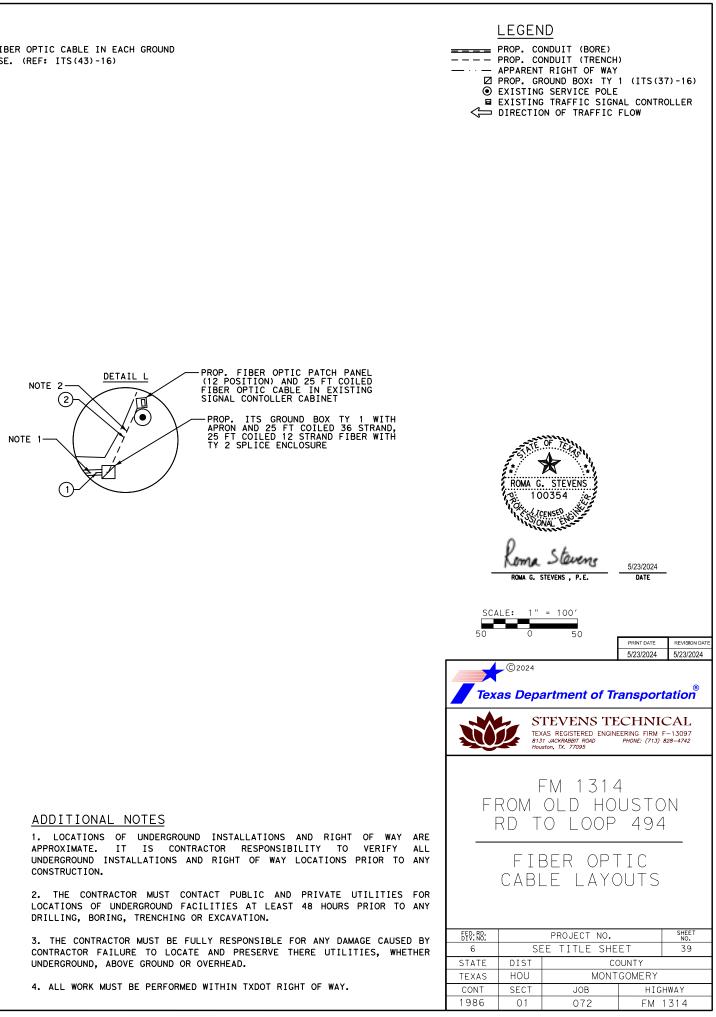

		CONDUI	Τ /	AND COI	NDL	JCTOR	SC	HEDUL	E			FIBER OPTIC	ITS GND BOX
RUN	CONDUIT (618)				со	DUCTORS FIBER OPTIC CBL (620) (6007) (SINGLE MODE)				FO SPLICE ENCLOSURE (TY2)	PATCH PANEL (12 POSITION)	(PCAST) TY1 (243636) W/APRON	
NO.		3" (SC	HD 8	30)	#1	4 INSUL	12	FIBER	36	FIBER	6007	6007	(6186)
		(6053)		(6054)		(6002)	(6011)	(6013)	6089	6096	6002
	NO.	TRENCH	NO.	BORE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	QUANTITY	QUANTITY	QUANTITY
	EA	LF	EA	LF	ΕA	LF	EA	LF	EA	LF	EACH	EACH	EACH
1			1	125	1	125			1	125	\land	\setminus	\land
2	1	40			1	40	1	40					
COILED SLACK								25		25			
TOTAL		40		125		165		65		150	1	1	1

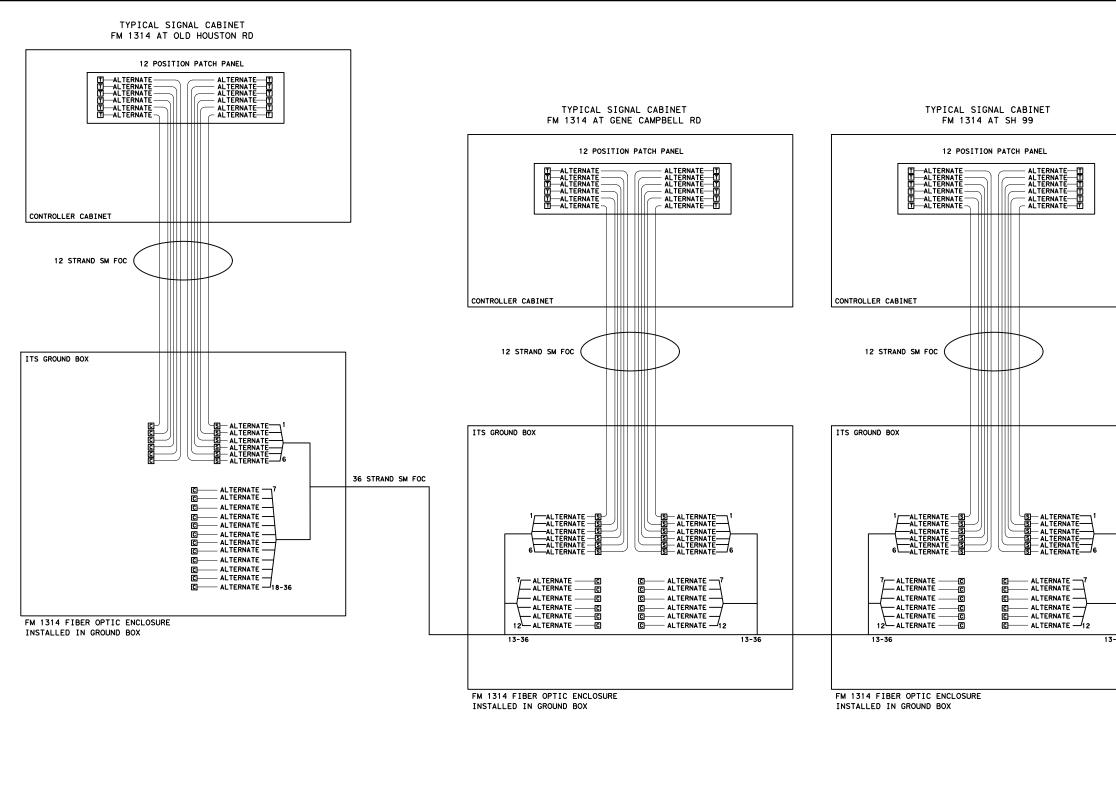


<u>LEGEND</u>

FC CONNECTOR

S FUSION SPLICE


C COIL FIBER FOR FUTURE USE


		ROMA G	OF 75-15 STEVENS 0354 VAL	
	- - A	Roma G. S	Stavens TEVENS, P.E.	5/23/2024 DATE
13-36	A			PRINT DATE REVISION DATE 5/23/2024 5/23/2024
		S' IEX	Artment of Tr. TEVENS TE AS REGISTERED ENGINE 1 JACKRABBIT ROAD 1 JACKRABBIT ROAD	ansportation [®] CHNICAL
		rom rd t	M 1314 OLD HO O LOOP	USTON 494
	A	TEF	BER CAE RMINATI GNMENTS project no.	ON
	6 STATE	SE DIST	E TITLE SHE	
	TEXAS CONT	HOU SECT	MONT JOB	GOMERY HIGHWAY
	1986	01	072	FM 1314

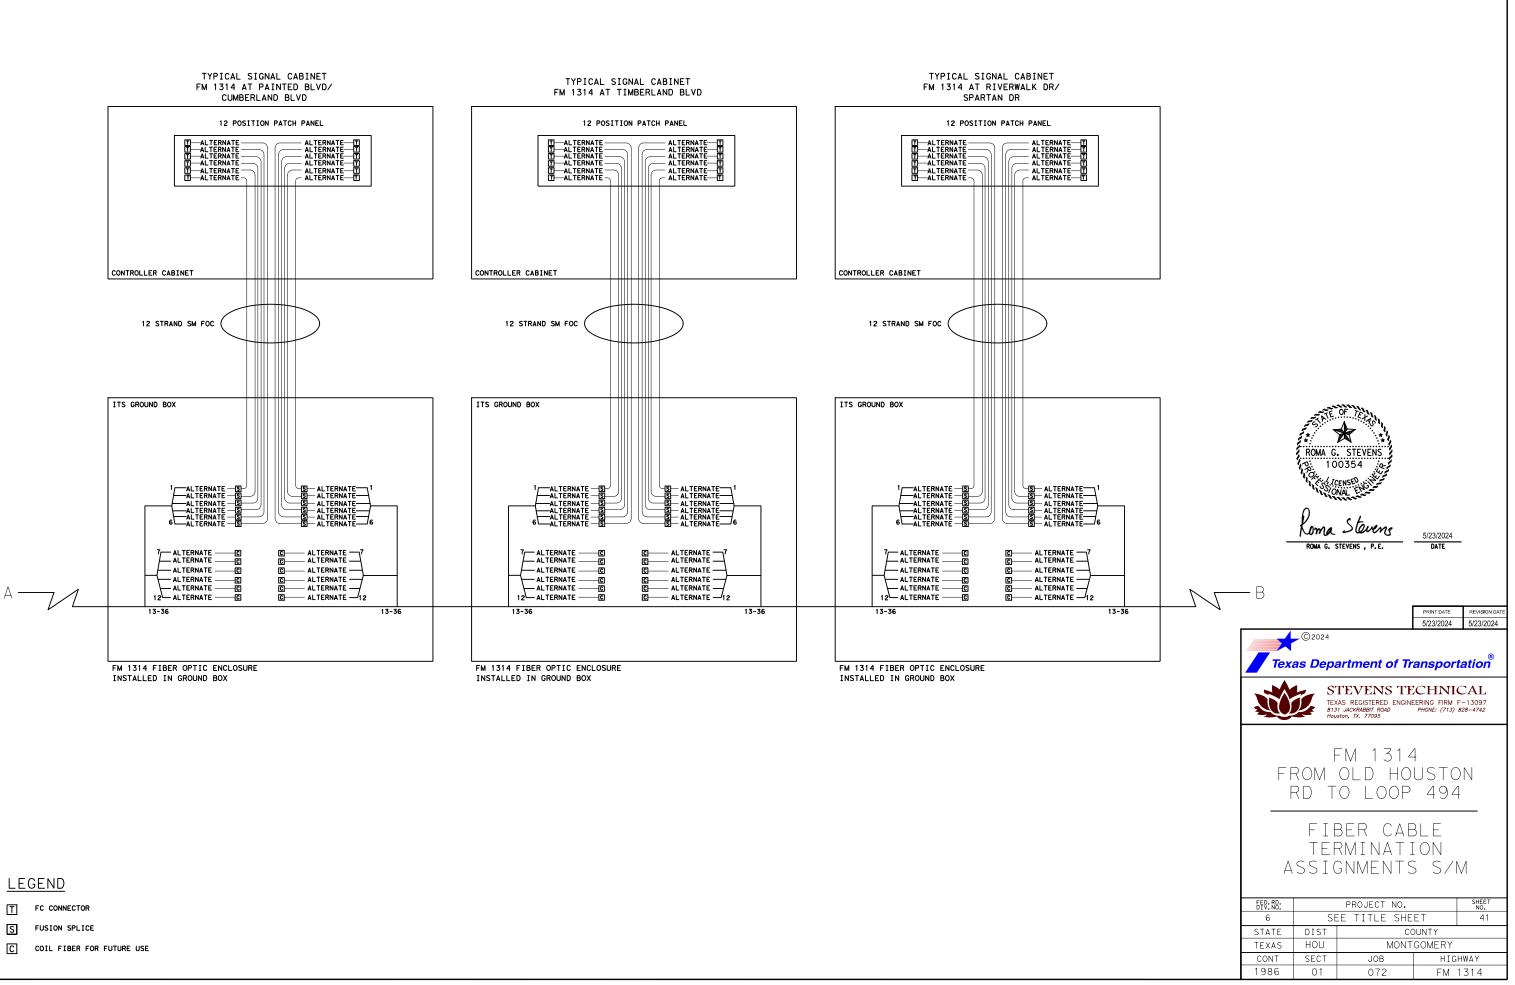

S

С

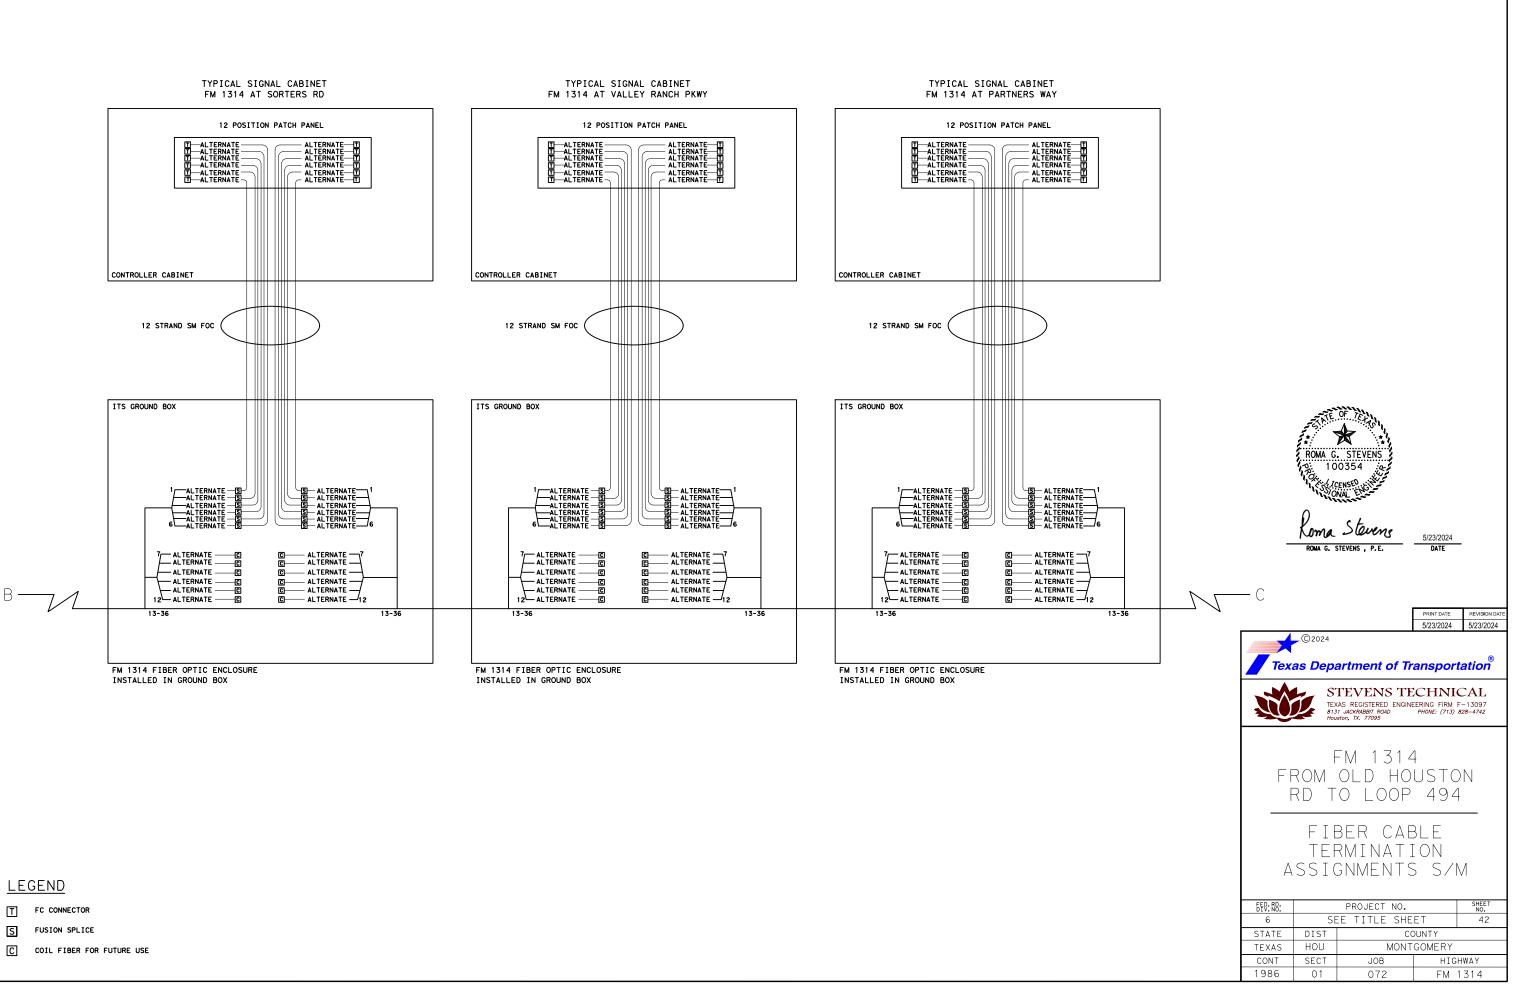


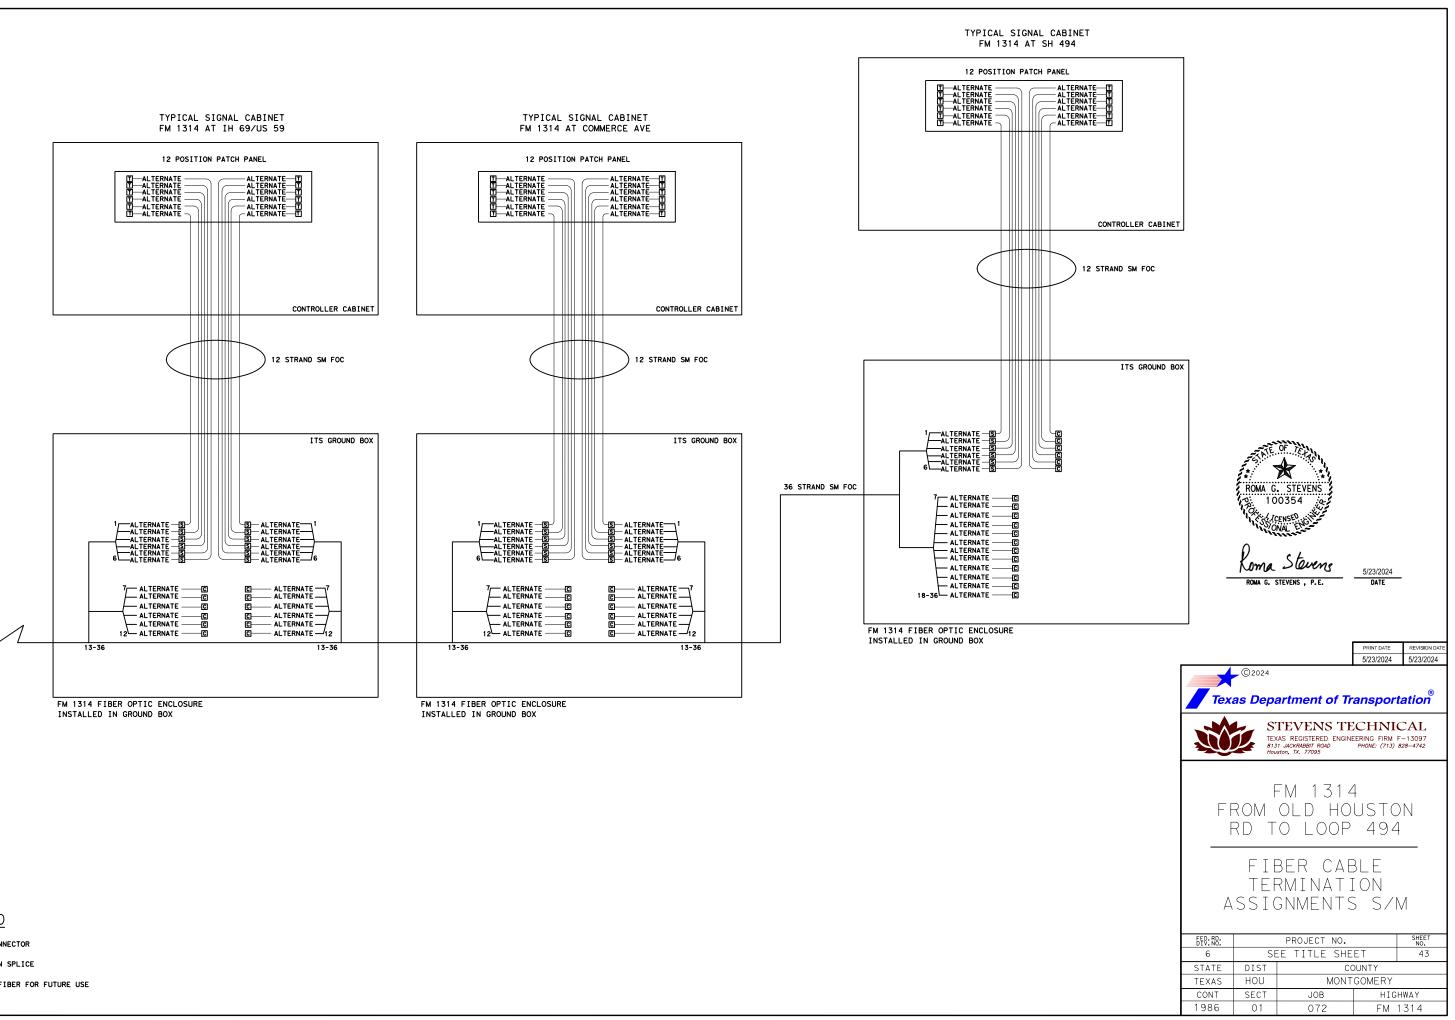

<u>LEGEND</u>

С

- T FC CONNECTOR
- S FUSION SPLICE
- C COIL FIBER FOR FUTURE USE

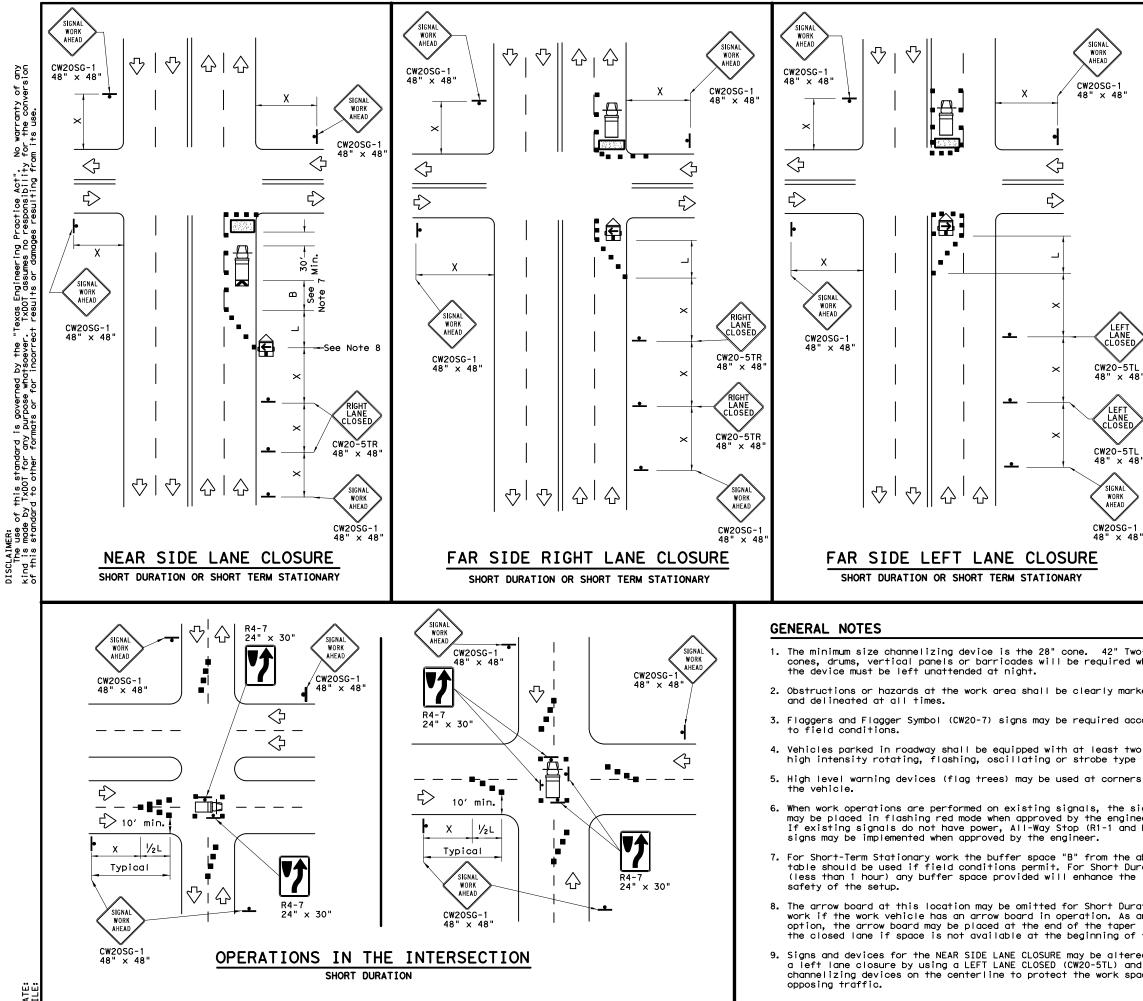

DATE:

	LEGEND										
<u>e 7 7 7 7</u>	Type 3 Barricade		Channelizing Devices								
	Heavy Work Vehicle	X	Truck Mounted Attenuator (TMA)								
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)								
-	Sign	2	Traffic Flow								
\Diamond	Flag	LO	Flagger								

Posted Speed	Formula	**			Spaciı Channe		Minimum Sign Spacing "X"	Suggested Longitudinal Buffer Space	
*		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	Distance	"B"	
30		150′	1651	180′	30'	60′	120′	90′	
35	$L = \frac{WS^2}{60}$	205′	225′	245′	35′	70′	160′	120′	
40	60	265′	2951	320′	40′	80′	240′	155′	
45		450′	495′	540′	45′	90′	320′	195′	
50		500'	550′	600′	50′	100′	400′	240′	
55	L=WS	550′	605′	660′	55′	110′	500′	295′	
60	L-#5	600′	660′	720′	60′	120′	600′	350′	
65		650′	715′	780′	65′	130′	700′	410′	
70		700′	770′	840′	70'	140′	800′	475′	
75		750′	825′	900′	75′	150′	900′	540′	


X Conventional Roads Only

XX Taper lengths have been rounded off.

L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

WORKERS IN BUCKET TRUCKS SHALL NOT WORK ABOVE OPEN LANES OF TRAFFIC.

o-piece when				
ked				
cording				
) lights.				
s of	SHEE	ET 1	OF 2	
ignals eer. R1-3P)	Texas Department	of Tran	sportation	Traffic Operations Division Standard
above ration	TRAFFIC TYPICA			
ation an in the taper.			(S-1)-	
ed for	FILE: wzb†s-13.dgn	DN: TXDO	OT CK:TXDOT DW:	TxDOT CK: TxDOT
d adding ace from	©TxDOT April 1992	CONT SE	ECT JOB	HIGHWAY
	REVISIONS		01 072	FM 1314
	2-98 10-99 7-13 4-98 3-03	DIST HOU	COUNTY	SHEET NO.
	114	000	MONTOOMERT	

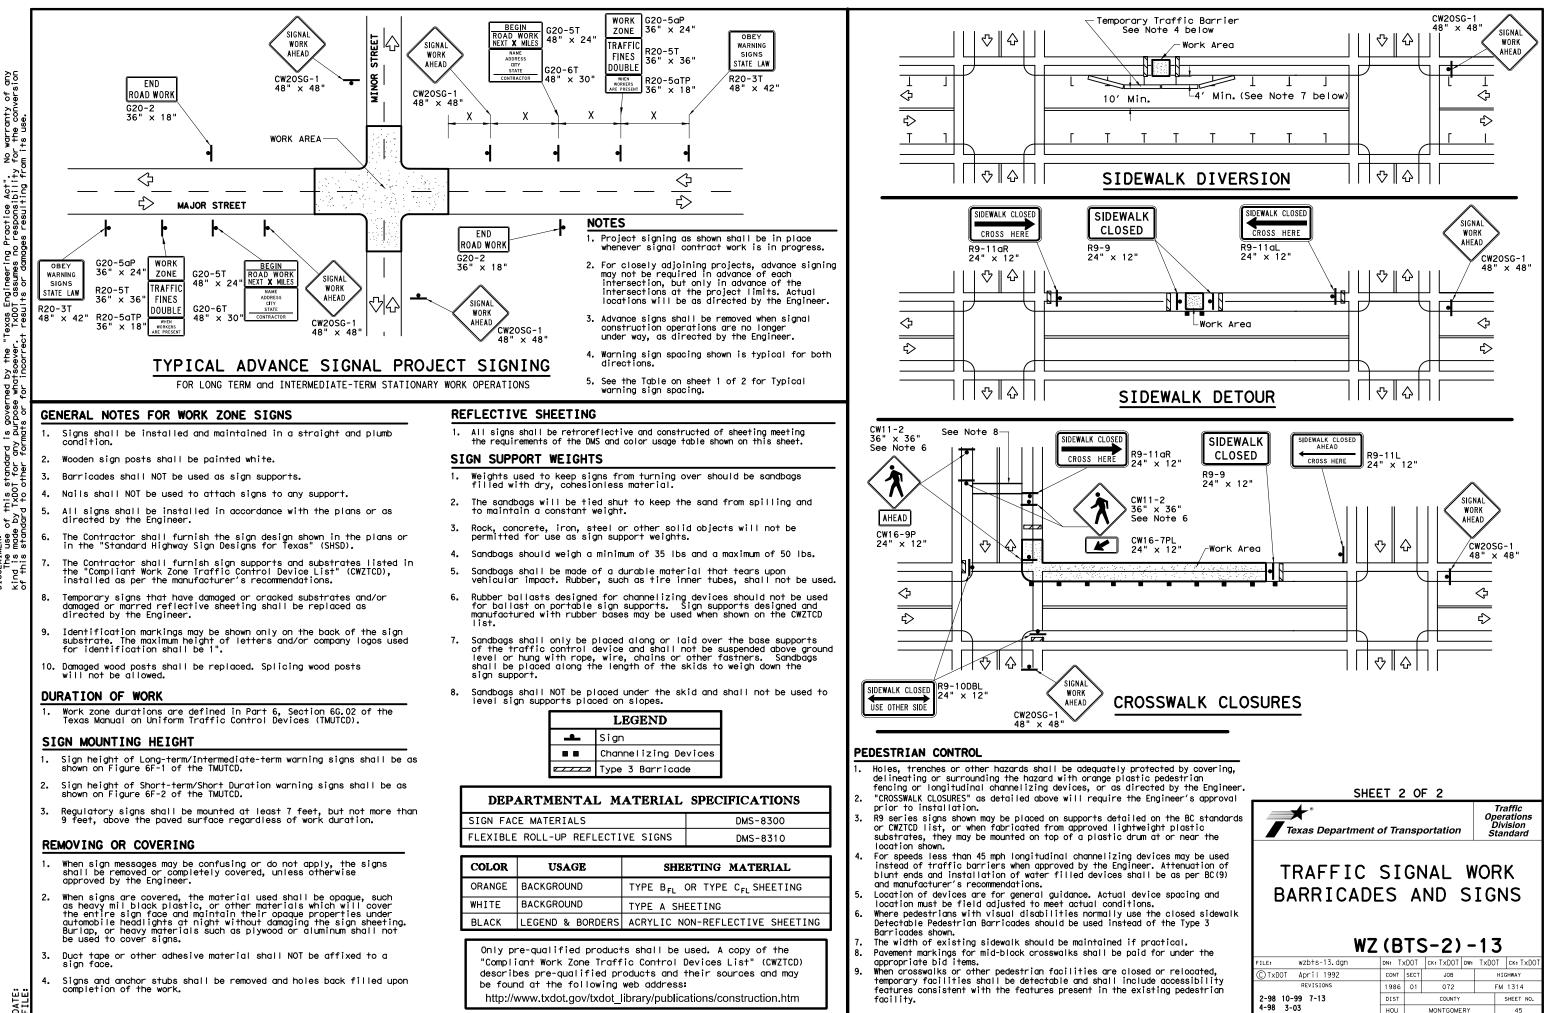

GENERAL NOTES FOR ALL ELECTRICAL WORK

- 1. The location of all conduits, junction boxes, ground boxes, and electrical services is diagrammatic and may be shifted to accommodate field conditions.
- 2. Provide new and unused materials. Ensure that all materials and installations comply with the applicable articles of the National Electrical Code (NEC), TxDOT standards and specifications, National Electrical Manufacturers Association (NEMA), and are listed by Underwriters Laboratories (UL) or a Nationally Recognized Testing Lab (NRTL). NRTLs such as Canadian Standard Association (CSA), Intertek Testing Services NA Inc., or FM Approvals LLC can be considered equivalent to UL. Where reference is made to NEMA listed devices, International Electrotechnical Commission (IEC) listed devices will not be considered an acceptable equal to a NEMA listed device. Acceptable devices may have both a NEMA and IEC listing. Faulty fabrication or poor workmanship in any material, equipment, or installation is justification for rejection. Replace or reinstall rejected material or equipment at no additional cost to the Department.
- 3. Miscellaneous nuts, bolts and hardware, except for high strength bolts, may be stainless steel when plans specify galvanized, provided the bolt size is $\frac{1}{2}$ in. or less in diameter.
- 4. Provide the following test equipment as required by the Engineer to confirm compliance with the contract and the NEC: voltmeter, ammeter, megohm meter (1000 volt DC), ground resistance tester, torque wrenches, and torque screwdrivers. Ensure all equipment has been properly calibrated within the last year. Provide calibration certification to the Engineer upon request. Operate test equipment during inspection as requested by the Engineer.
- 5. Install grounding as shown on the plans and in accordance with the NEC. Ensure all metallic conduits; metal poles; luminaires; and metal enclosures are bonded to the equipment grounding conductor. Provide stranded bare copper or green insulated grounding conductors. Ground rods, connectors, and bonding jumpers are subsidiary to the various bid items.
- 6. When required by the Engineer, notify the Department in writing of materials from the Material Producers List (MPL) intended for use on each project. Prequalified materials are listed on the MPL on TxDOT's website under "Roadway Illumination and Electrical Supplies." No substitutions will be allowed for materials on this list.

CONDUIT

A. MATERIALS

- 1. Provide conduit, junction boxes, fittings, and hardware as per TxDOT Departmental Material Specification (DMS) 11030 "Conduit" and Item 618 "Conduit" of TxDOT's "Standard Specifications For Construction And Maintenance Of Highways, Streets, And Bridges," latest edition. Provide conduits listed under Item 618 on the MPL under "Roadway Illumination and Electrical Supplies." Provide conduit types according to the descriptive code or as shown on the plans. Do not substitute other types of conduit is for those shown. Provide liquidtight flexible metal conduit (LFMC) when flexible conduit is called for on galvanized steel rigid metallic conduit (RMC) systems. Provide liquidtight flexible conduit is called for on polyvinyl chloride (PVC) systems.
- 2. Provide galvanized steel RMC for all exposed conduits, unless otherwise shown on the plans. Properly bond all metal conduits.
- 3. Unless otherwise shown on the plans, provide junction boxes with a minimum size as shown in the following table, which applies to the greatest number of conductors entering the box through one conduit with no more than four conduits per box. When a mixture of conductor sizes is present, count the conductors as if all are of the larger size. For situations not applicable to the table, size junction boxes in accordance with NEC.

AWG	3 CONDUCTORS	5 CONDUCTORS	7 CONDUCTORS
#1	10" × 10" × 4"	12" x 12" x 4"	16" × 16" × 4"
#2	8" × 8" × 4"	10" x 10" x 4"	12" × 12" × 4"
#4	8" × 8" × 4"	10" × 10" × 4"	10" × 10" × 4"
#6	8" × 8" × 4"	8" × 8" × 4"	10" × 10" × 4"
#8	8" × 8" × 4"	8" × 8" × 4"	8" × 8" × 4"

- 4. Junction boxes with an internal volume of less than 100 cu. in. and supported by entering raceways must have threaded entries or hubs identified for the intended purpose and supported by connection of two or more rigid metal conduits. Secure conduit within 3 ft. of the enclosure or within 18 in. of the enclosure if all conduit entries are on the same side. Mechanically secure all junction boxes with an internal volume greater than 100 cu. inches.
- 5. Provide hot dipped galvanized cast iron or sand cast aluminum outlet boxes for junction boxes containing only 10 AWG or 12 AWG conductors. Do not use die cast aluminum boxes. Size outlet boxes according to the NEC.
- 6. Do not use intermediate metal conduit (IMC) or electrical metallic tubing (EMT) unless specifically required by the plan sheets. When EMT is called for, provide junction boxes made from galvanized steel sheeting, listed and approved for outdoor use, unless otherwise noted on the plans. Size all galvanized steel junction boxes in accordance with the NEC. Provide junction boxes for IMC conduit systems that meet the same requirements for junction boxes used with RMC systems.
- 7. Provide PVC junction boxes intended for outdoor use on PVC conduit systems, unless otherwise noted on the plans.


- 8. Provide PVC elbows in PVC conduit systems, unless otherwise shown on the plan a flat, high tensile strength polyester fiber pull tape for pulling conductor the PVC conduit system. When galvanized steel RMC elbows are specifically cal the plans and any portion of the RMC elbow is buried less than 18 in., ground elbow by means of a grounding bushing on a rigid metal extension. Grounding o metal elbow is not required if the entire RMC elbow is encased in a minimum o concrete. PVC extensions are allowed on these concrete encased rigid metal el PVC elbows are subsidiary to various bid items.
- 9. When required, provide High-Density Polyethylene (HDPE) conduit with factory conductors according to Item 622 "Duct Cable." At the Contractor's request an the Engineer, substitute HDPE conduit with no conductors for bored schedule 4 conduit bid under Item 618. Ensure bored HDPE substituted for PVC is schedule size PVC called for in the plans. Ensure the substituted HDPE meets the requirexcept that the conduit is supplied without factory-installed conductors. Mak the HDPE conduit to PVC (or RMC elbow when required) at the bore pit. Provide and schedule as shown on the plans. Do not extend substituted conduit into gr foundations. Provide PVC or galvanized steel RMC elbows as called for at all foundations.
- 10. Use two-hole straps when supporting 2 in. and larger conduits. On electrical properly sized stainless steel or hot dipped galvanized one-hole standoff str the service riser conduit.


B. CONSTRUCTION METHODS

- Provide and install expansion joint conduit fittings on all structure-mounted the structure's expansion joints to allow for movement of the conduit. In add and install expansion joint fittings on all continuous runs of galvanized ste externally exposed on structures such as bridges at maximum intervals of 150 requested by the project Engineer, supply manufacturer's specification sheet joint conduit fittings. Repair or replace expansion joint fittings that do not movement at no additional cost to the Department. Provide the method of deter amount of expansion to the Engineer upon request. Do not use LFMC or LFNC as for the required expansion conduit fittings.
- 2. Space all conduit supports at maximum intervals of 5 ft. Install conduit spac attaching metal conduit to surface of concrete structures. See "Conduit Mount on ED(2). Install conduit support within 3 ft. of all enclosures and conduit
- 3. Do not attach conduit supports directly to pre-stressed concrete beams except specifically in the plans or as approved by the Engineer.
- 4. Unless otherwise shown on the plans, jack or bore conduit placed beneath exis driveways, sidewalks, or after the base or surfacing operation has begun. Bac compact the bore pits below the conduit per Item 476 "Jacking, Boring, or Tun or Box" prior to installing conduit or duct cable to prevent bending of the c
- 5. When placing conduit in the sub-grade of new roadways, backfill all trenches material unless otherwise noted on the plans. When placing conduit in the sub new roadways, backfill all trenches with cement-stabilized base as per requir Items 110 "Excavation", 400 "Excavation and Backfill for Structures", 401 "Fl Backfill", 402 "Trench Excavation Protection", and 403 "Temporary Special Sho
- 6. Provide and place warning tape approximately 10 in. above all trenched condu
- 7. During construction, temporarily cap or plug open ends of all conduit and rac after installation to prevent entry of dirt, debris and animals. Temporary ca durable duct tape are allowed. Tightly fix the tape to the conduit opening. C conduit and prove it clear in accordance with Item 618 prior to installing an
- 8. Ensure conduit entry into the top of any enclosure is waterproof by installing hubs or using boxes with threaded bosses. This includes surface mounted safet cans, service enclosures, auxiliary enclosures and junction boxes. Grounding tight sealing hubs are not required.
- 9. Fit the ends of all PVC conduit terminations with bushings or bell end fittin install a grounding type bushing on all metal conduit terminations.
- 10. Install a bonding jumper from each grounding bushing to the nearest ground ro or equipment grounding conductor. Ensure all bonding jumpers are the same siz grounding conductor. Bonding of conduit used as a casing under roadways for d required, if the duct extends the full length through the casing.
- 11. At all electrical services, install a 6 AWG solid copper grounding electrode
- 12. Place conduits entering ground boxes so that the conduit openings are betwee from the bottom of the box. See the ground box detail on sheet ED(4).
- 13. Seal ends of all conduits with duct seal, expandable foam, or by other method the Engineer. Seal conduit immediately after completion of conductor installo tests. Do not use duct tape as a permanent conduit sealant. Do not use silico conduit sealant.
- 14. File smooth the cut ends of all mounting strut and conduit. Before installing cut ends of all mounting strut and RMC (threaded or non-threaded) with zinc r more zinc content) to alleviate overspray. Use zinc rich paint to touch up go as allowed under Item 445 "Galvanizing." Do not paint non-galvanized material paint as an alternative for materials required to be galvanized.

ans. Use only ors through alled for in nd the RMC of the rigid of 2 in. of elbows. RMC or	
y installed internal and with approval by 40 or schedule 80 PV le 40 and of the same uirements of Item 622 ake the transition of de conduit of the siz ground boxes or I ground boxes and	,
l service poles, traps are allowed on	
ed conduits at ddition, provide teel RMC conduit 0 ft. When t for expansion not allow for ermining the s a substitute	
acers when nting Options" t terminations. pt as shown	
isting roadways, ackfill and unneling Pipe connections.	
s with excavated ub-base of irements of Flowable noring."	
uit as per Item 618.	
aceways immediately caps constructed of Clean out the any conductors.	
ing conduit sealing ety switches, meter g bushings on water	
ings. Provide and	
rod, grounding lug, ize as the equipment duct cable is not	
e conductor. en 3 in. and 6 in.	Texas Depar
ods approved by lation and pull cone caulk as a	ELECT COND
ng, paint the field rich paint (94% or galvanized material al with a zinc rich	FILE: ed1-14.dgn © TxDOT October 2014 REVISIONS
	71A


	Texas Department of Transportation									
E	ELECTR CONDU		8	NO						
ILE:	ed1-14.dgn	DN:		ск:	DW:	CK:				
C TxDOT	October 2014	CONT	SECT	JOB		HIGHWAY				
	REVISIONS	1986	01	072		FM 1314				
		DIST		COUNTY		SHEET NO.				
		HOU		MONTGOME	RY	46				

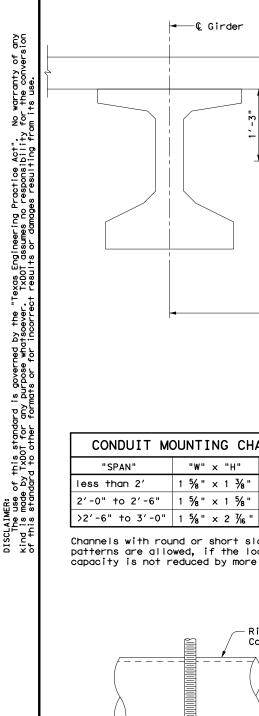

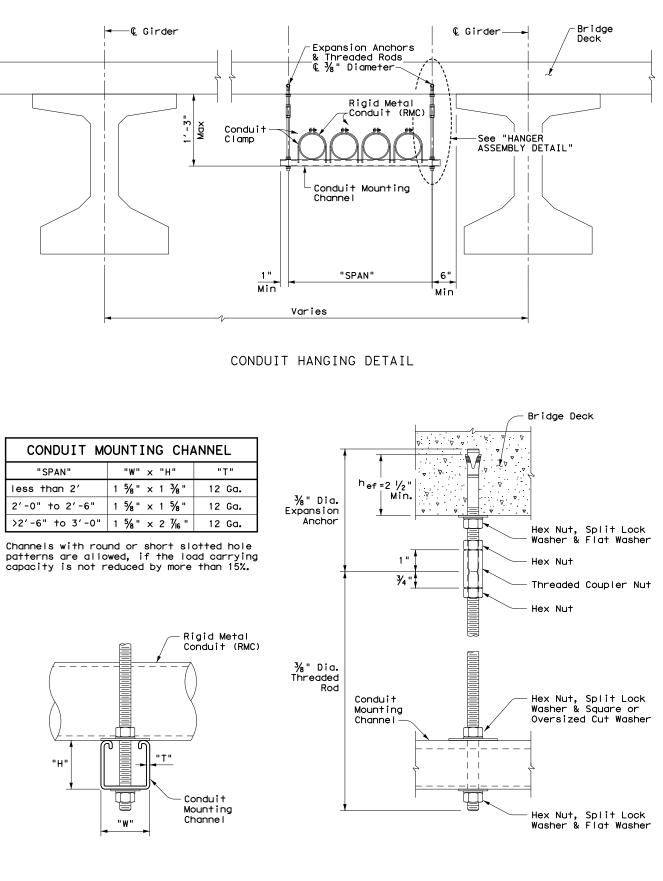

HANGER ASSEMBLY DETAIL

ELECTRIC CONDUIT TO BRIDGE DECK ATTACHMENT

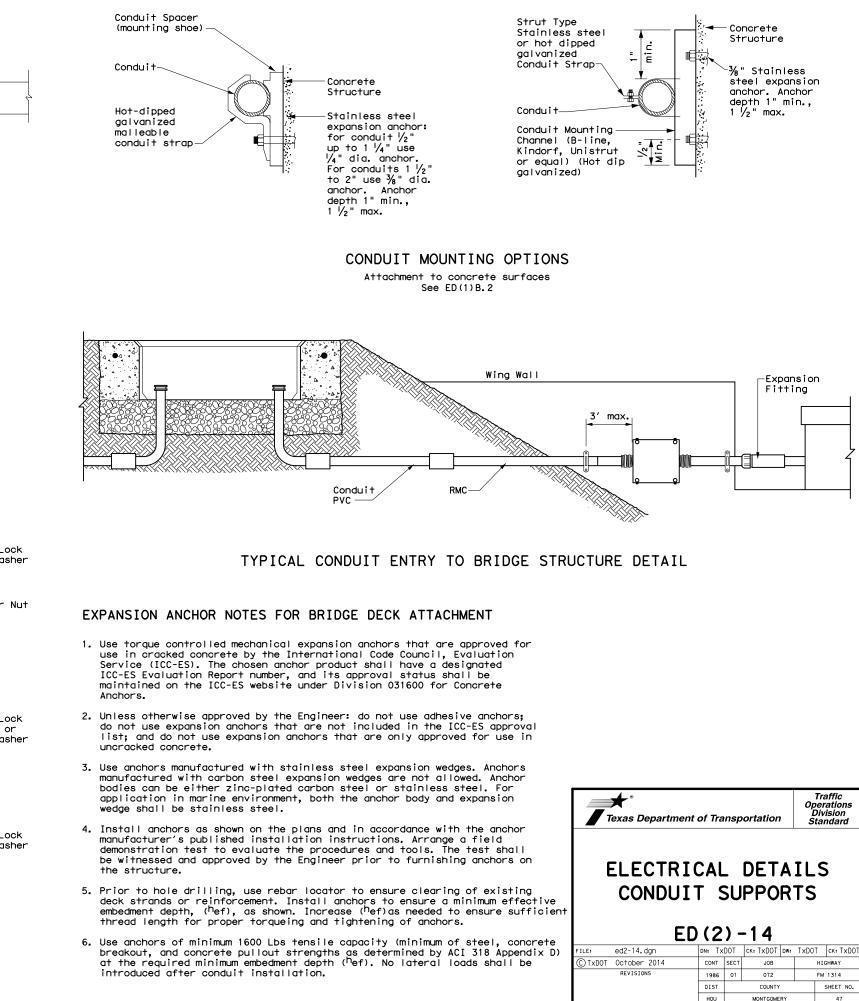

DATE:

ELECTRICAL CONDUCTORS

- A. MATERIAL INFORMATION
- 1. Provide Type XHHW insulated conductors in accordance with Departmental Material Specification (DMS)11040 "Conductors" and Item 620 "Electrical Conductors." Provide conductors as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies" Item 620. Color code insulated conductors in conformance with the NEC. Identify grounded (neutral) conductors with white insulation. Identify grounding conductors (ground wires) with green insulation or bare conductors. Identify ungrounded (hot) conductors with any color insulation except green, white, or gray. Keep color scheme consistent throughout the wiring system. Identify conductors 6 American Wire Gauge (AWG) and smaller by continuous color jacket. Identify electrical conductors 4 AWG and larger by continuous color jacket or by colored tape. When identifying conductors with colored tape, mark at least 6 in. of the conductor's insulation with half laps of tape.
- 2. Provide a solid copper 6 AWG grounding electrode conductor to bond the electrical service equipment to the concrete encased grounding electrode or the ground rod at the service location. Connect the grounding electrode conductor to the ground rod with a UL listed connector in accordance with DMS 11040. Connect the grounding electrode conductor to the concrete encased grounding electrode as shown in the plans.
- 3. Where two or more circuits are present in one conduit or enclosure, permanently identify the conductors of each branch circuit by attaching a non-metallic tag around both circuit conductors at each accessible location. Provide tags with two straps, large enough to indicate circuit number, letter, or other identification as shown in the plans. Print circuit identification on the tag with a permanent marker
- Use listed compression or screw type pressure connectors, terminal blocks, or split bolt connectors for splicing as specified in DMS 11040. Use hot melt adhesive tape to fill the gap and seal the ends of heat shrink tubing. Provide UL listed gel-filled insulating splice covers. Splicing materials, insulating materials, breakaway disconnects, splice covers, and fuse holders are subsidiary to various bid items.

B. CONSTRUCTION METHODS

- Use only a flat, high tensile strength polyester fiber pull tape for pulling conductors through the conduit system. After installing conductors in conduit, perform conductor pull test. If a conductor cannot be freely pulled, make any 1. needed alterations or repairs at no additional cost to the department. Perform insulation resistance tests in accordance with Item 620. Coordinate with the Engineer to witness the tests.
- 2. Leave 2 ft. minimum, 3 ft. maximum length for each conductor up to the splice in ground boxes. Leave 3 ft. minimum, 4 ft. maximum length of conductor in ground boxes when pulled through with no splice. Leave 1 ft. minimum, 1.5 ft. maximum length of conductor at enclosures, weatherheads and pole bases.
- Make splices only in junction boxes, ground boxes, pole bases, or electrical 3. enclosures and use only listed compression or screw type pressure connectors, terminal blocks, or split bolt connectors. Insulate splices with heavy wall heat shrink tubing or gel-filled insulating splice covers to provide a watertight splice. Overlap conductor insulation with heat shrink tubing a minimum of 2 in. past both sides of the splice. Where heat shrink tubing may not shrink sufficiently to provide a watertight seal around the individual conductors, prior to heating the tubing, increase the diameter of the conductor insulation using hot melt adhesive tape to provide a watertight seal between the individual conductors and the heat shrink tubing. Ensure the tape extends past the heat shrink tubing. Use hot melt adhesive tape to fill the gap and seal the ends of heat shrink tubing. Heat shrink tubing that appears to have been burned, or overheated, is considered defective and must be replaced.
- 4. Size and install gel-filled insulating splice covers according to manufacturer's specifications when used in place of heat shrink tubing.
- 5. Wire nuts with factory applied waterproof sealant may be used for 8 AWG or smaller conductors in above ground junction boxes, but not in pole bases or ground boxes. Install wire nuts in an upright position to prevent the accumulation of water.
- 6. Support conductors in illumination poles with a J-hook at the top of the pole.
- 7. When terminating conductors, remove the insulation and jacketing material without nicking the individual strands of the conductor. Conductors with nicked individual conductor strands or removed strands will be considered damaged.
- 8. Replace conductors and cables that are damaged beyond repair or that fail an insulation resistance test at no additional cost to the department.
- 9. Do not repair damaged conductors with duct tape, electrical tape, or wire nuts. Use only approved splicing methods.
- 10. Do not terminate more than one conductor under a single connector, unless the connector is rated for multiple conductors. Do not exceed the pressure connector's listing for maximum number and size of conductors allowed.
- 11. Install breakaway connectors on conductors bid under Item 620 whenever those conductors pass through a breakaway support device. Follow manufacturer's instructions when terminating conductors to breakaway connectors. Properly torque threaded connections. Proper terminations are critical to the safe operation of breakaway devices. Trim waterproofing boots on breakaway connectors to fit snugly around the conductor to ensure waterproof connection. Only one conductor may enter a single opening in a boot. Provide waterproof boots with the correct number of openings. Leave unused openings factory sealed. Use prequalified breakaway connectors as shown on the MPL.

- 12. Provide and install a separate stranded equipment grounding conductor (EGC) in all conduits that contain circuit wiring of 50 volts or more. Unless shown elsewhere, size the EGC to be the same size as the largest current carrying conductor contained in the conduit. Ensure all EGCs are bonded together at every accessible location. For traffic signal installations, provide a minimum size 8 AWG EGC. The EGC is paid for under Item 620.
- C. TEMPORARY WIRING
- 1. Install temporary conductors and electrical equipment in accordance with the NEC article "Temporary Installations" and Department standard sheets.
- 2. Provide a ground fault circuit interrupter (GFCI) for power outlets for portable electrical equipment, power tools, ice machines, ice storage bins and refrigerators located outdoors at grade. GFCI may be any one of following: molded cord and plug set, receptacle, or circuit breaker type.
- 3. Use listed wire nuts with factory applied sealant for temporary wiring where approved.
- 4. Enclose conductor splices within a listed enclosure or ground box, or ensure the splices are more than 10 ft. above grade vertically and more than 5 ft. horizontally from any metal structure. Where installing temporary conductors in areas subject to vehicle traffic or mobile construction equipment, ensure the vertical clearance to ground is at least 18 ft. when measured at the lowest point. Ground messenger wires that support power conductors in conformance with the NEC.
- 5. Protect and when necessary repair any existing electrical conduits uncovered during the construction process in a timely manner and in conformance with the NFC.


GROUND RODS & GROUNDING ELECTRODES


A. MATERIAL INFORMATION


1. Provide and install a grounding electrode at electrical services. Provide around rods according to DMS 11040 and the plans. Larger diameter or longer length rods may be called for in some specific locations, see the individual plans sheets. Concrete encased grounding electrodes may be called for in specific locations including electrical service, see individual plan sheets.

B. CONSTRUCTION METHODS

- 1. Furnish auxiliary ground rods for lightning protection and install in soil, concrete, or both, as called for in the plans. For ground rods installed in concrete, ensure the connection of the conductor to the ground rod is readily accessible for inspection or repairs. For ground rods installed in soil, ensure that the upper end is between 2 to 4 in. below finished grade.
- 2. Do not place around rods in the same drilled hole as a timber pole.
- 3. Install ground rods so the imprinted part number is at the upper end of the rod.
- 4. Remove all non-conductive coatings such as concrete splatter from the rod at the clamp location.
- 5. Route all conductors as short and straight as possible for connection to lightning protection ground rods. When a bend is required, ensure a minimum radius bend of four inches for these conductors.
- 6. Unless otherwise called for in the plans, protect grounding electrode conductors with non-metallic conduit. When protecting grounding electrode conductors with metal conduit, provide and install a grounding type bushing and properly sized bonding jumper on each end of the metal conduit.
- 7. Written authorization is required before installing a ground rod in a horizontal trench for rocky soil or a solid rock bottom.

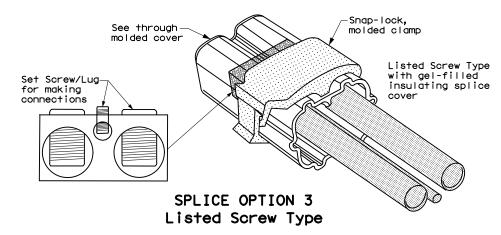

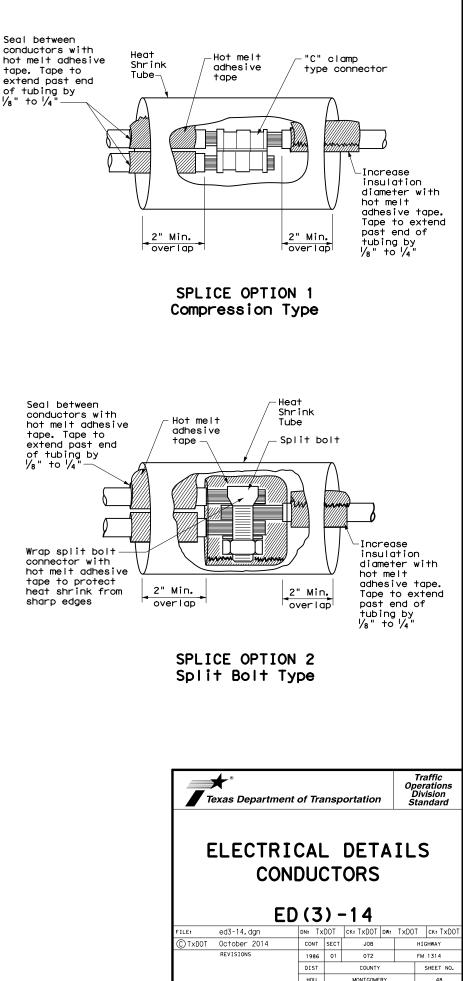


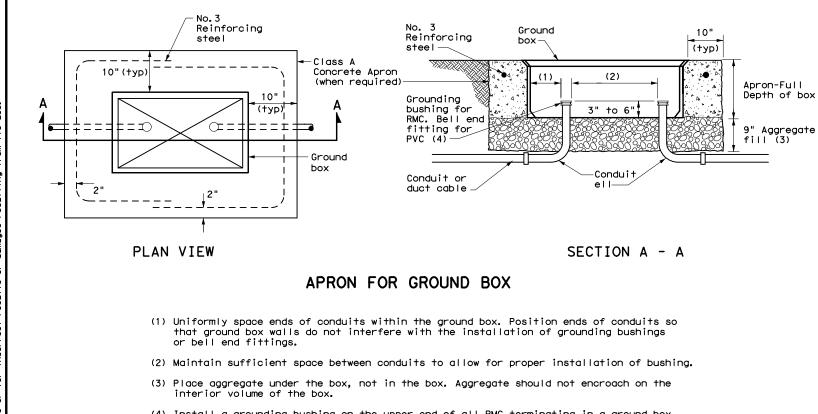

(4) Install a grounding bushing on the upper end of all RMC terminating in a ground box. Ground RMC elbows when any part of the elbow is less than 18 in. below the bottom of the ground box. Install a PVC bushing or bell end fitting on the upper end of all PVC conduits terminating in a ground box.

GROUND BOX DIMENSIONS									
TYPE	OUTSIDE DIMENSIONS (INCHES) (Width x Length X Depth)								
А	12 X 23 X 11								
В	12 X 23 X 22								
С	16 X 29 X 11								
D	16 X 29 X 22								
E	12 X 23 X 17								

		GROL	JND BO	ох со	VER D	IMENS	IONS					
	тург	DIMENSIONS (INCHES)										
	TYPE	Н	Ι	J	K	L	М	N	Ρ			
,	A, B & E	23 1⁄4	23	13 3⁄4	13 1⁄2	9 7/8	5 1⁄8	1 3/8	2			
	C & D	30 ½	30 ¼	17 ½	17 1⁄4	13 1⁄4	6 ¾	1 3/8	2			

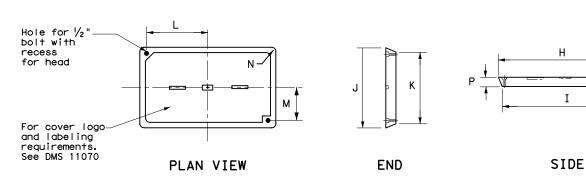

GROUND BOX COVER

GROUND BOXES

A. MATERIALS

- Item 624 "Ground Boxes."
- and Electrical Supplies," Item 624.

- **B. CONSTRUCTION METHODS**
- aggreaate.
- boxes.

- Do not use silicone caulk as a sealant.
- together and to the ground rod with listed connectors.
- below arade.
- fully describing the work required.

1. Provide polymer concrete ground boxes measuring 16x30x24 in. (WxLxD) or smaller in accordance with Departmental Material Specification (DMS) 11070 "Ground Boxes" and

2. Provide Type A, B, C, D, and E ground boxes as shown in the plans, and as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination

3. Ensure ground box cover is correctly labeled in accordance with DMS 11070.

4. Provide larger ground boxes in accordance with Item 624 and as shown in the plans.

Remove all gravel and dirt from conduit. Cap all conduits prior to placing aggregate and setting ground box. Provide Grade 3 or 4 coarse aggregate as shown on Table 2 of Item 302 "Aggregates for Surface Treatments." Ensure aggregate bed is in place and at least 9 inches deep, prior to setting the ground box. Install ground box on top of

2. Cast ground box aprons in place. Reinforcing steel may be field bent. Ensure the depth of concrete for the apron extends from finished grade to the top of the aggregate bed under the box. Ground box aprons, including concrete and reinforcing steel, are subsidiary to ground boxes when called for by descriptive code.

3. Keep bolt holes in the box clear of dirt. Bolt covers down when not working in ground

4. Install all conduits and ells in a neat and workmanlike manner. Uniformly space conduits so grounding bushings and bell end fittings can easily be installed.

5. Temporarily seal all conduits in the ground box until conductors are installed.

6. Permanently seal conduits immediately after the completion of conductor installation and pull tests. Permanently seal the ends of all conduits with duct seal, expandable foam, or other method as approved. Do not use duct tape as a permanent conduit sealant.

7. When a ground rod is present in a ground box, bond all equipment grounding conductors


8. When a type B or D ground box is stacked to meet volume requirements, it is allowable to cut an appropriately sized hole for conduit entry in the side wall at least 18 inches

9. If an existing ground box in the contract has a metal cover, bond the cover to the equipment grounding conductor with a 3 ft. long stranded bonding jumper the same size as the grounding conductor. The bonding jumper is subsidiary to various bid items. Verify existing ground boxes with metal covers are shown on the plans, with notes


10. If other ground boxes with metal covers are within the project limits but are not part of the contract, the Engineer may direct the Contractor to bond the metal covers, identifying the specific boxes in writing. This work will be paid for separately.

11. Bond metal ground box covers to the grounding conductor with a tank ground type lug.


	4	Texas Departm	nent of Ti	ansp	ortation		Oper Div	affic ations ision ndard
_			RICA DUND	B	OXE	•••	LS	5
	FILE:	ed4-14.dgn	DN:	XDOT	ск: TxDOT	DW: Txl	DOT	ск: TxDOT
	(C) Tx	xDOT October 2014	CONT	SECT	JOB		HI	GHWAY
		REVISIONS	1986	01	072		FM	1314
			DIST		COUNTY			SHEET NO.
			HOU		MONTGOME	RY		49
	71D							

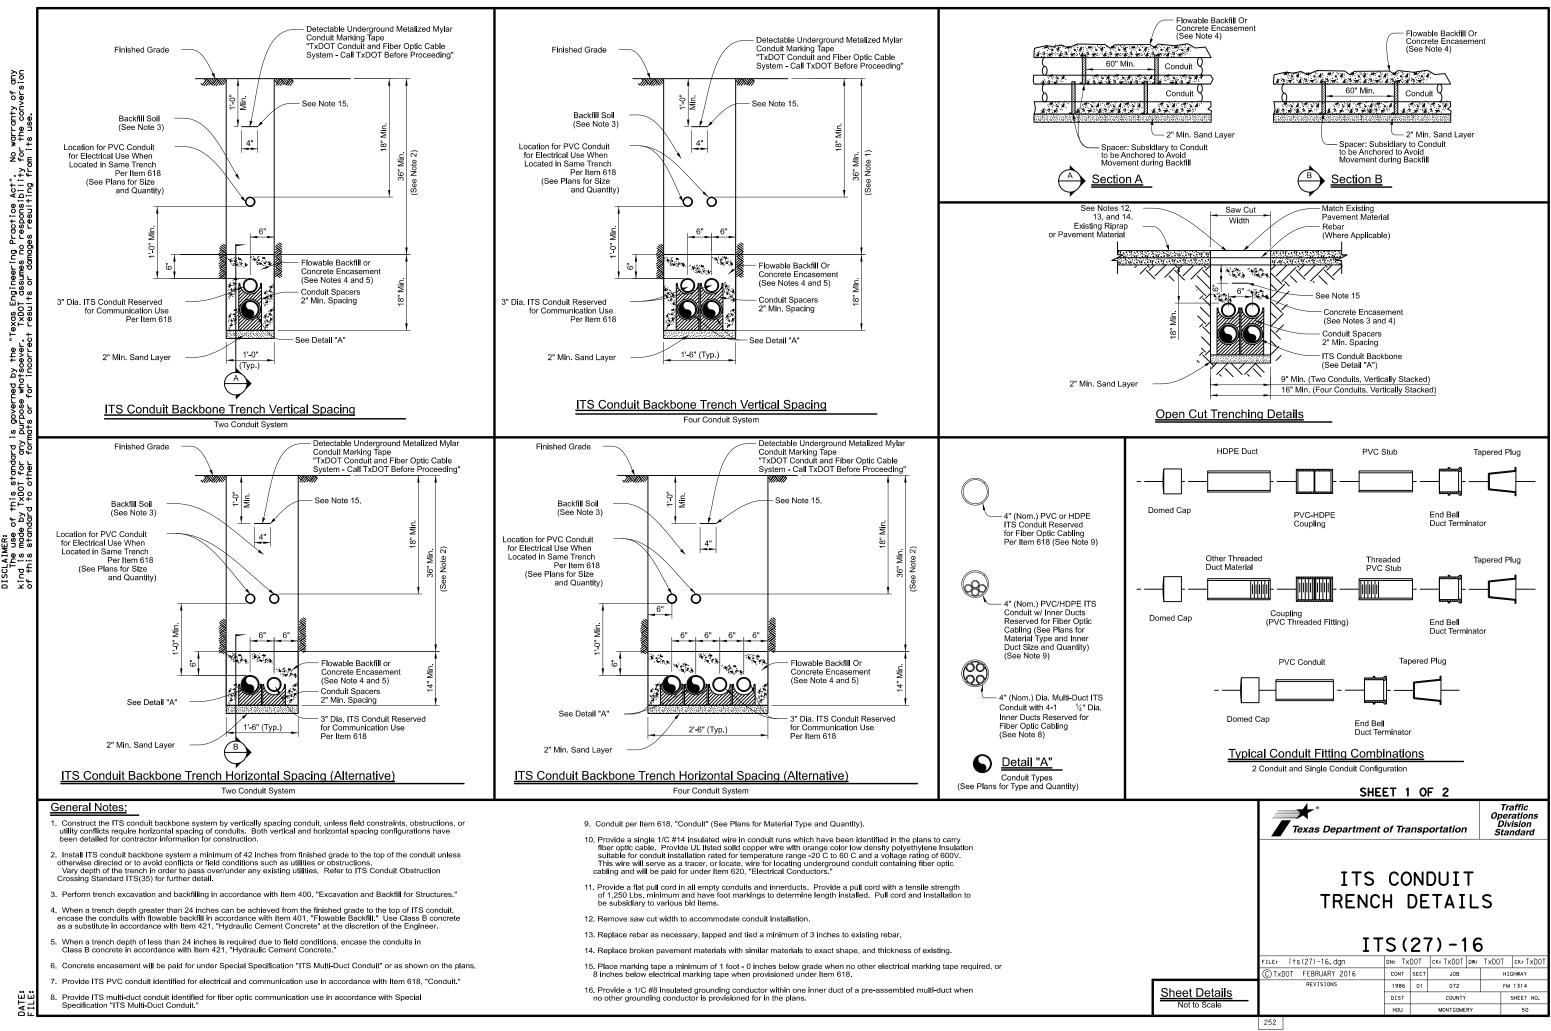


SCL

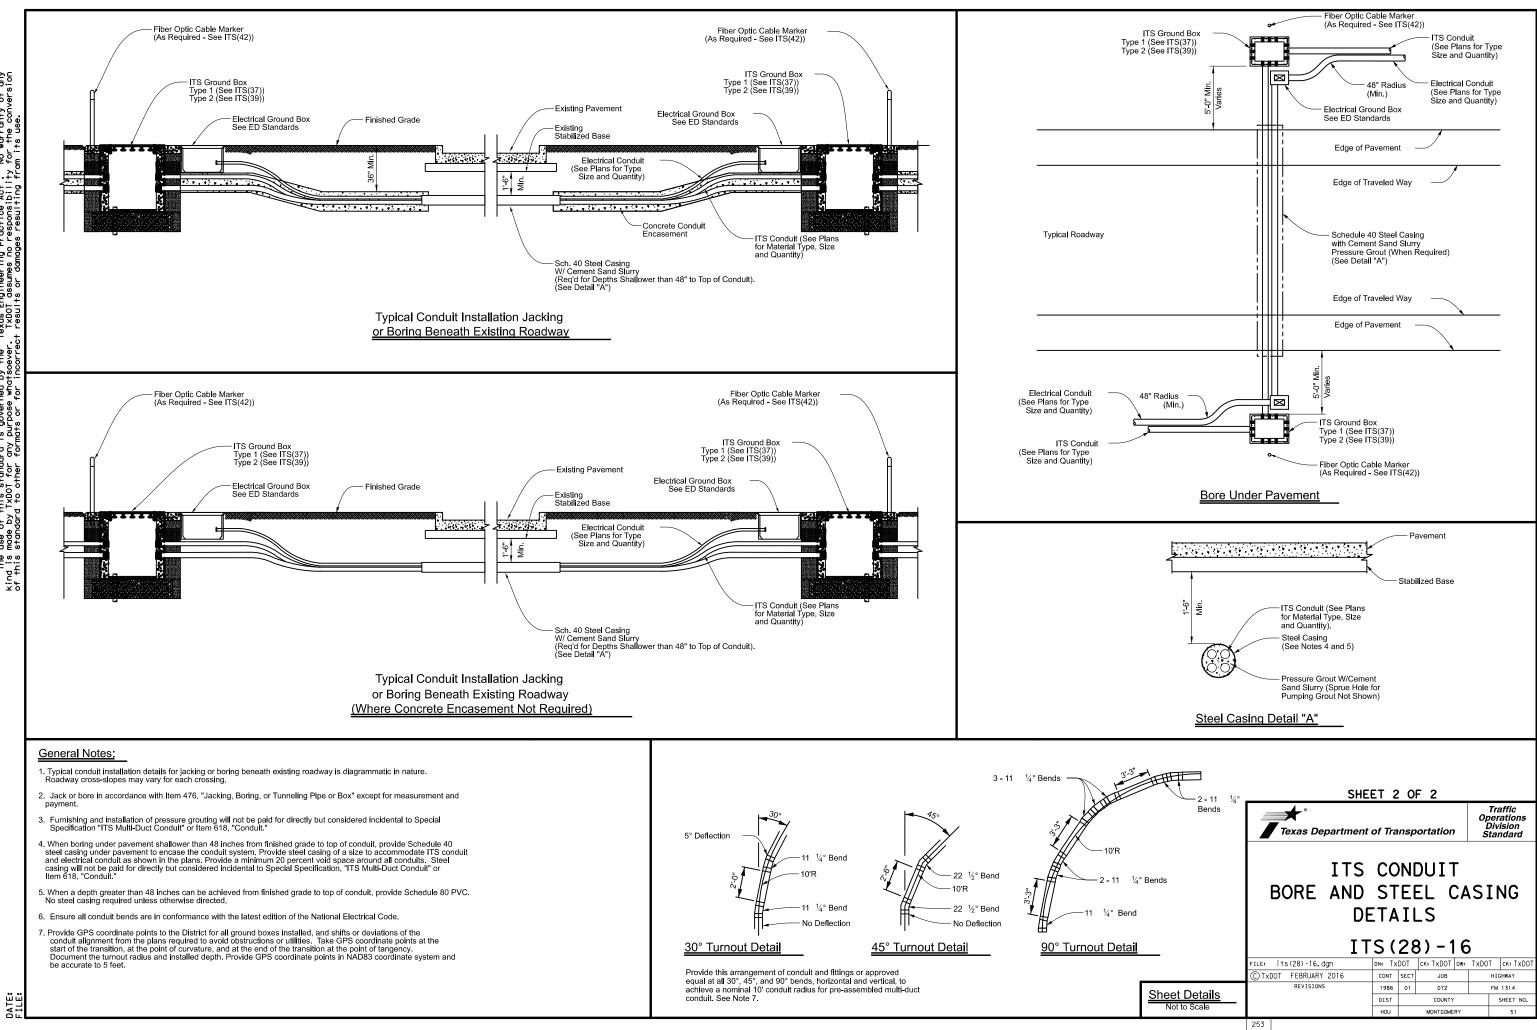

'Texas Engineering Practice Act". No warranty of any TXDOT assumes no responsibility for the conversion of results or damages resulting from its use. AIMER: The use of this standard is governed by the "T. is made by TXDOT for any purpose whatseever. is ethnodard to other formats or for incorrect SCI

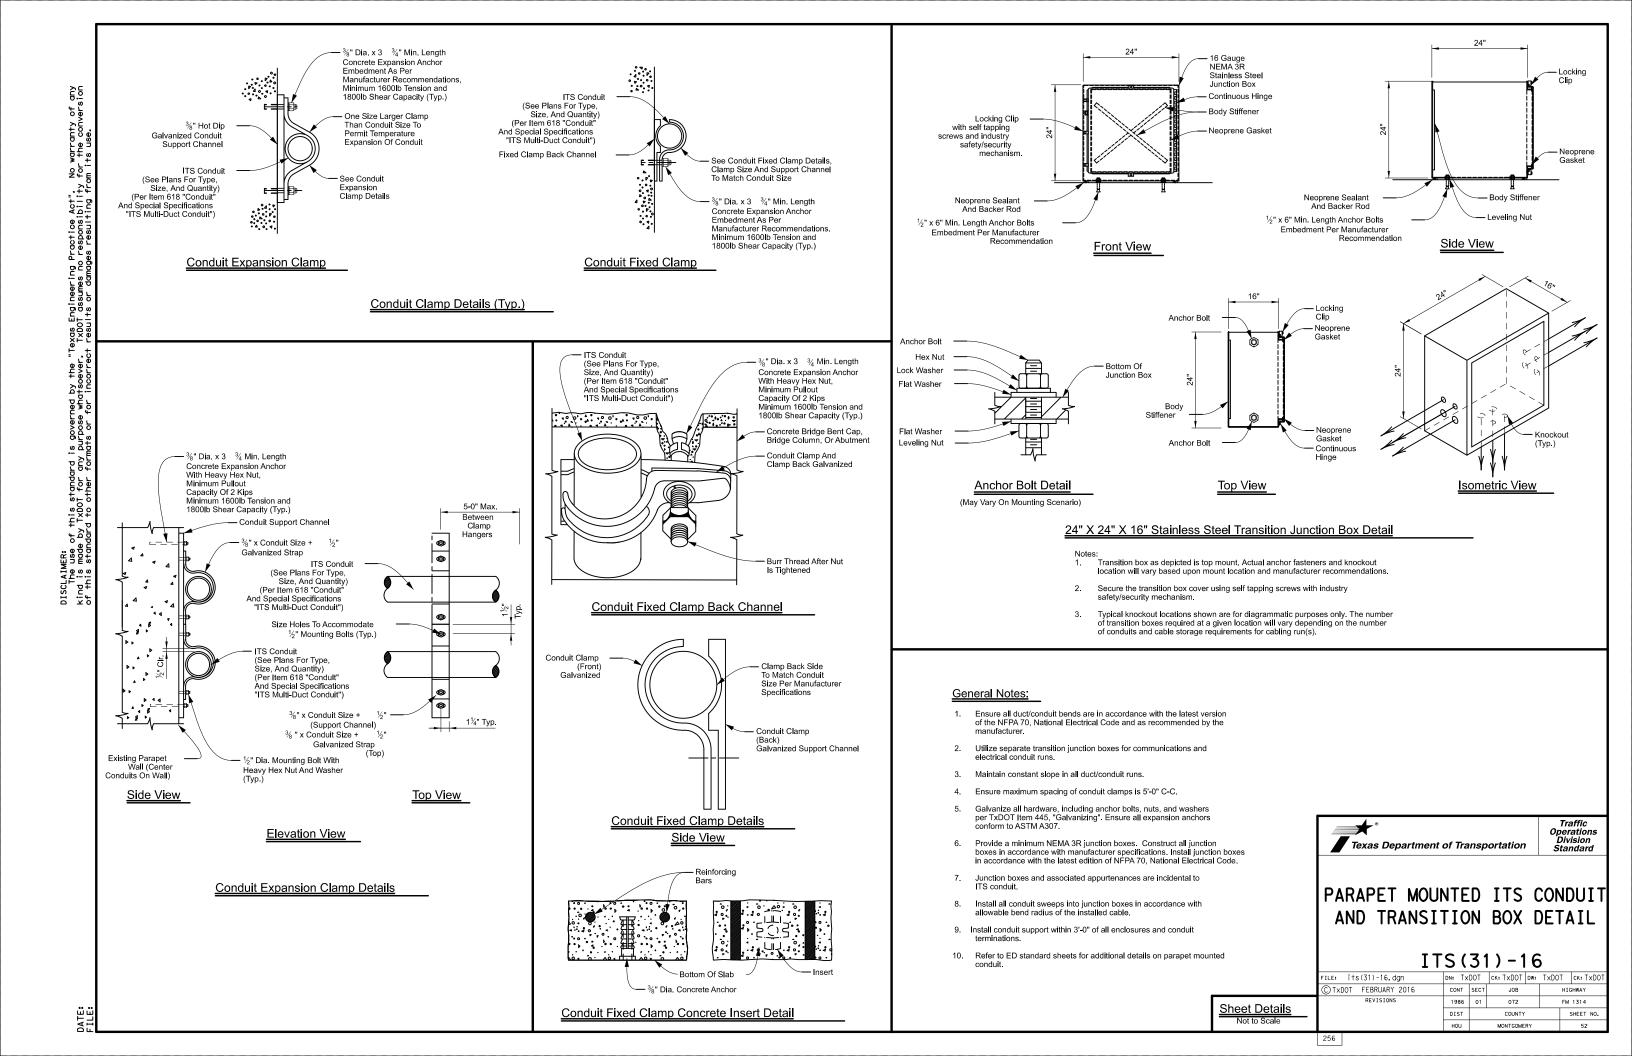

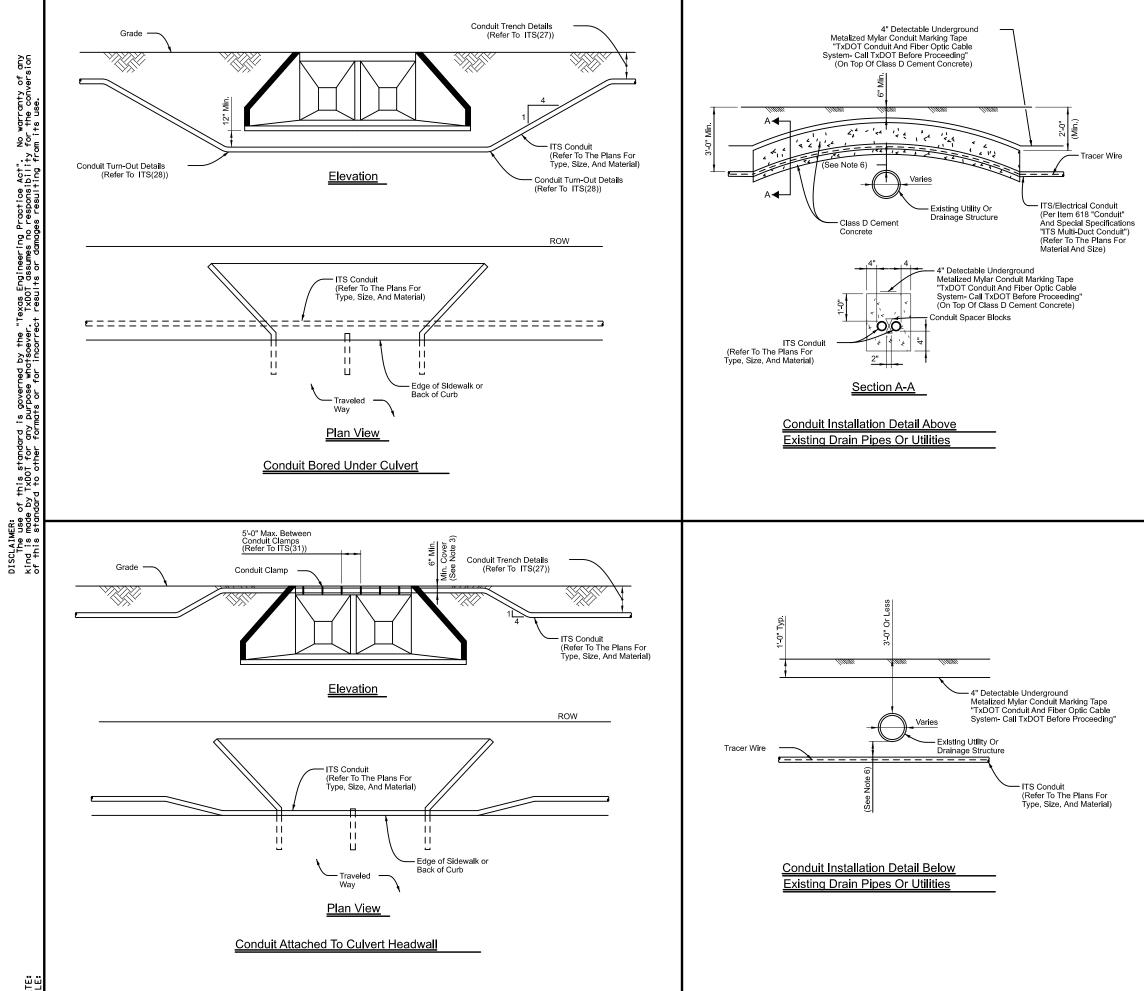


ខ្ល


General Notes:

- With approval from the field engineer adjust the final burial depth of conduit(s) in circumstances requiring traversal of non-movable object conflicts.
- 2. Where conduits are to be installed over existing underground infrastructure (i.e., existing utility or drainage structure) which are less than 3'-0" deep, encase conduit in Class D cement concrete in accordance with Item 421, "Hydraulic Cement Concrete", for the entire length of the conduit that is installed at a depth of less than 3'-0".
- 3. If depth of cover over encasement is less than 6", install the conduit to pass beneath the underground infrastructure.
- Refer to the plans for type, size and configuration of all conduits. Refer to ITS(27) and ITS(28) for further installation details. 4
- It is the responsibility of the contractor to verify all existing 5. underground infrastructure. The contractor is responsible for any damage to any underground infrastructure during construction. Verify all utility locations at least 100' in advance of trenches, plowing or boring, and make changes in conduit placement in the event of conflict.
- If proposed conduit is crossing or in close proximity to an existing underground utility, maintain a minimum clearance of 1'-6" vertical, 1'-6" horizontal or a clearance dictated by municipal code and or utility owner.
- 7. Install underground warning tape directly above all conduits per ITS(27) standard.
- Do not install communications and electric cables in the same conduit. Separate conduits installed within the same trench based on NFPA 70, 8. National Electrical Code. Refer to ITS(27) for additional conduit installation details.
- 9. Ensure all work is in compliance with the latest edition of NFPA 70, National Electrical Code.
- Utilize PVC conduit for all underground applications as required by design. Transition with a conduit coupling to RMC conduit or other as required by design that is approved for above ground applications.
- 11. Do not exceed a rise:run ratio of 1:4 for conduit sloped through increases or decreases in elevation.


		Texas Departme	ent of Tra	nsp	oortation	Ope Div	affic rations /ision ndard				
		ITS CONDUIT OBSTRUCTION CROSSING ITS(35)-16									
	FILE:	its(35)-16.dgn	dn: Tx	DOT	ск: TxDOT dw:	TxDOT	ск: TxDOT				
	(C) T x	DOT FEBRUARY 2016	CONT	SECT	JOB	ні	GHWAY				
Shoot Dataila		1986	01 072		FN	1314					
Sheet Details			DIST		COUNTY		SHEET NO.				
INUL IU SCAIE			HOU		MONTGOMERY		53				
	260										

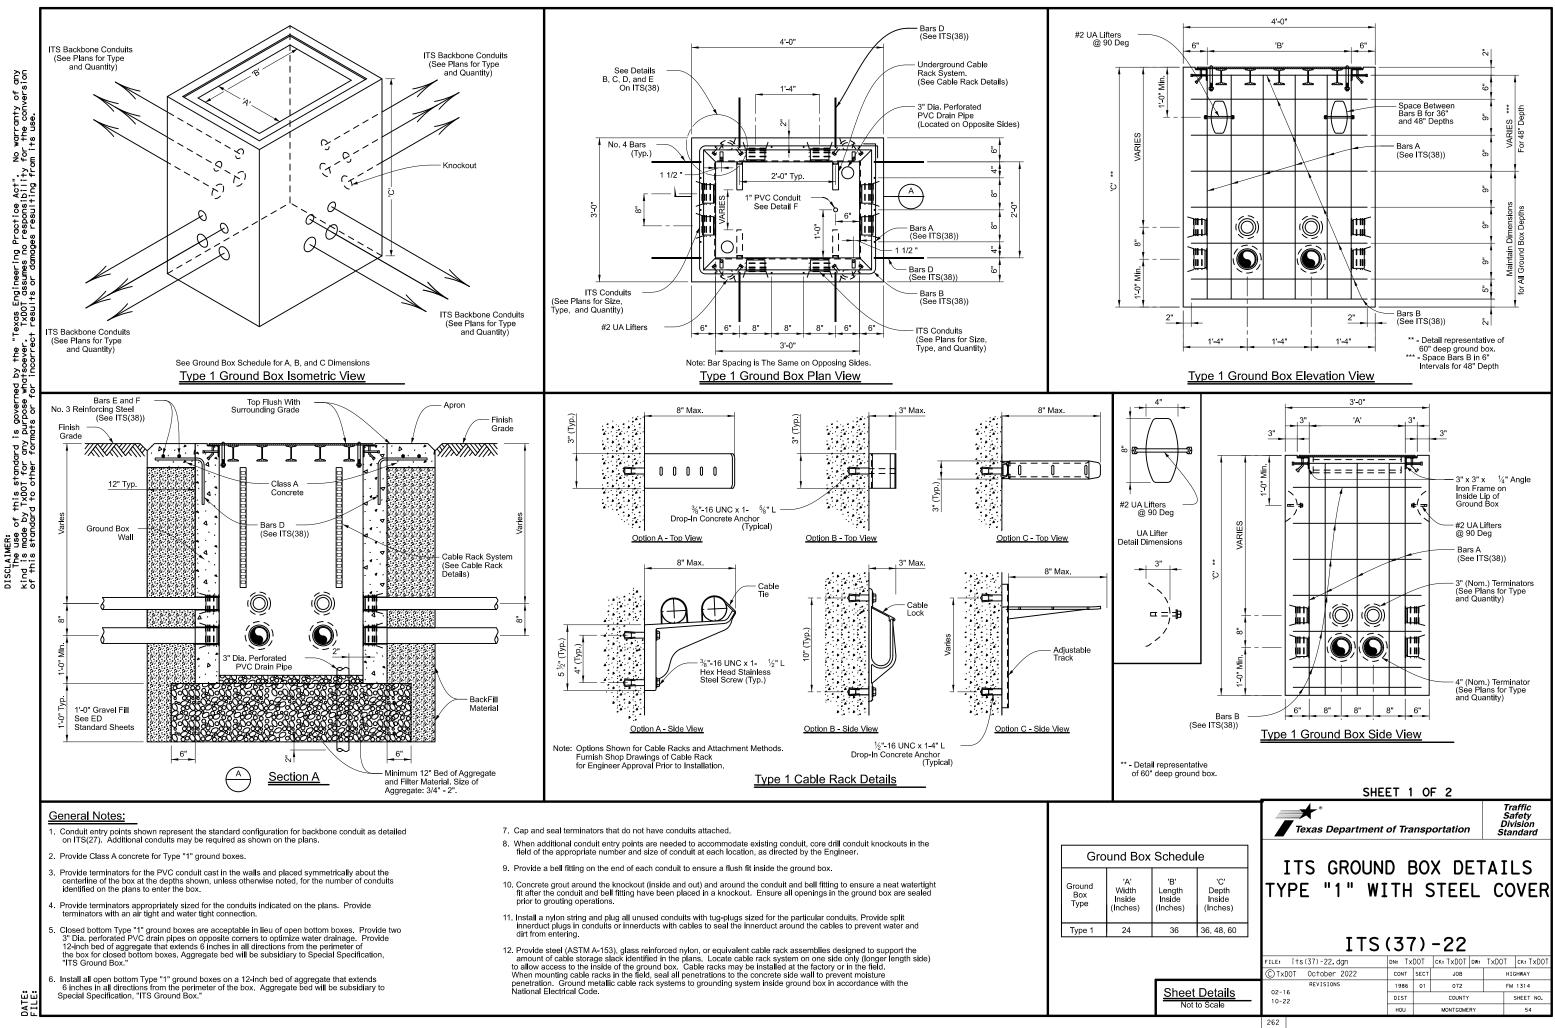


Ы

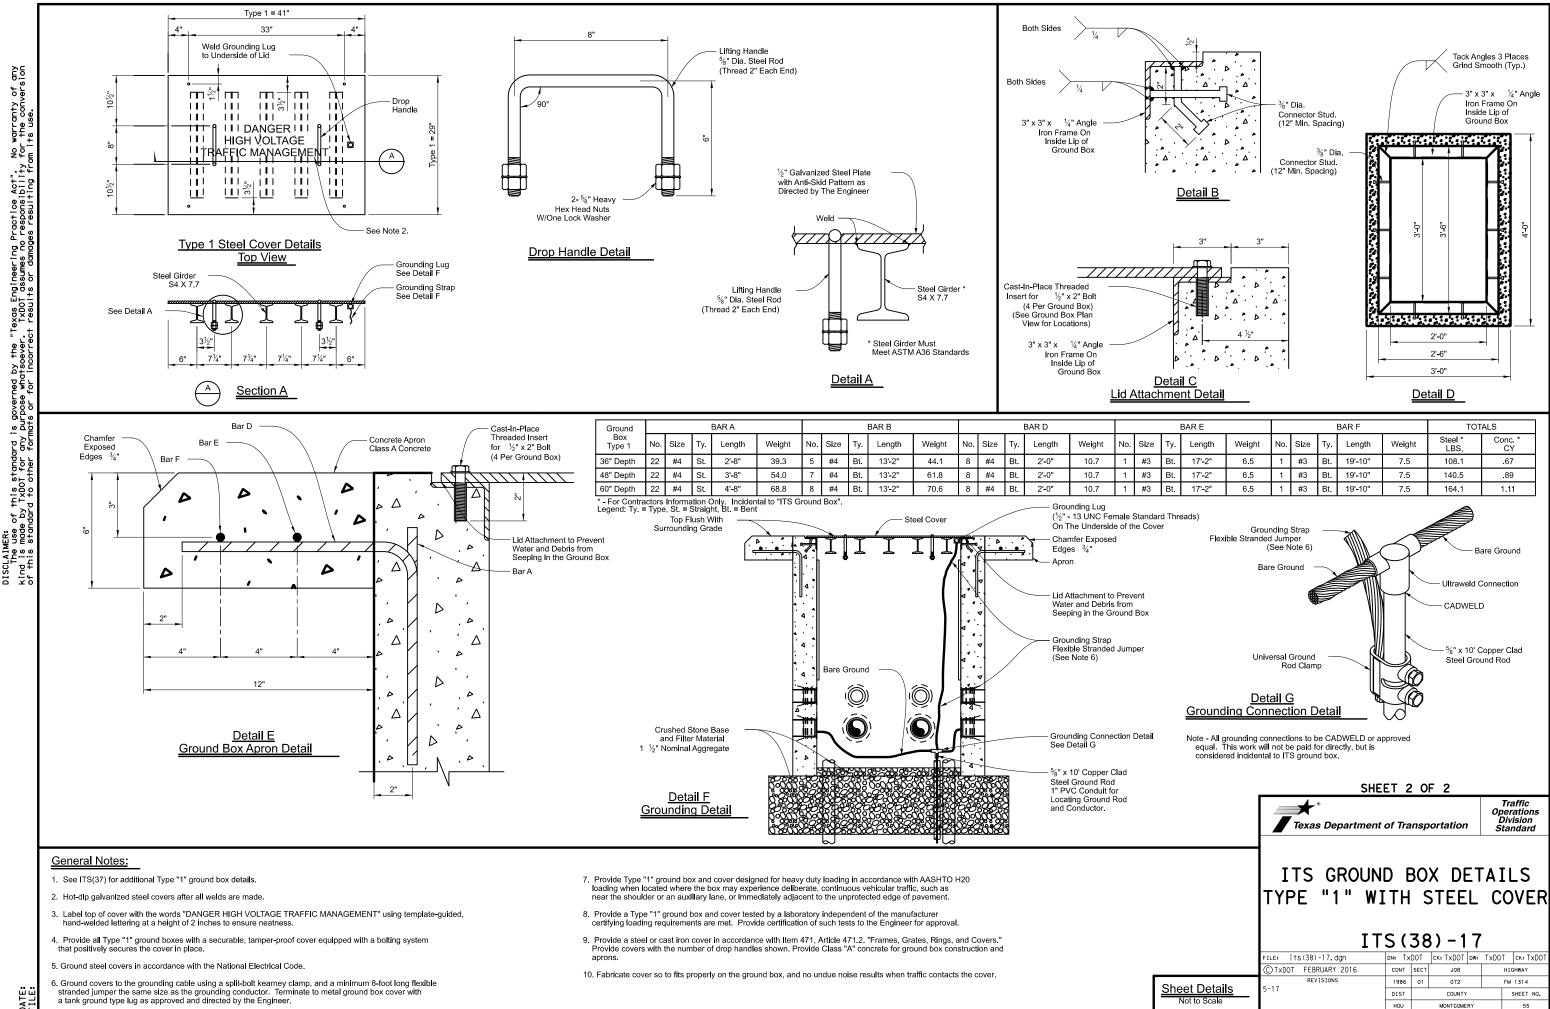

SCI

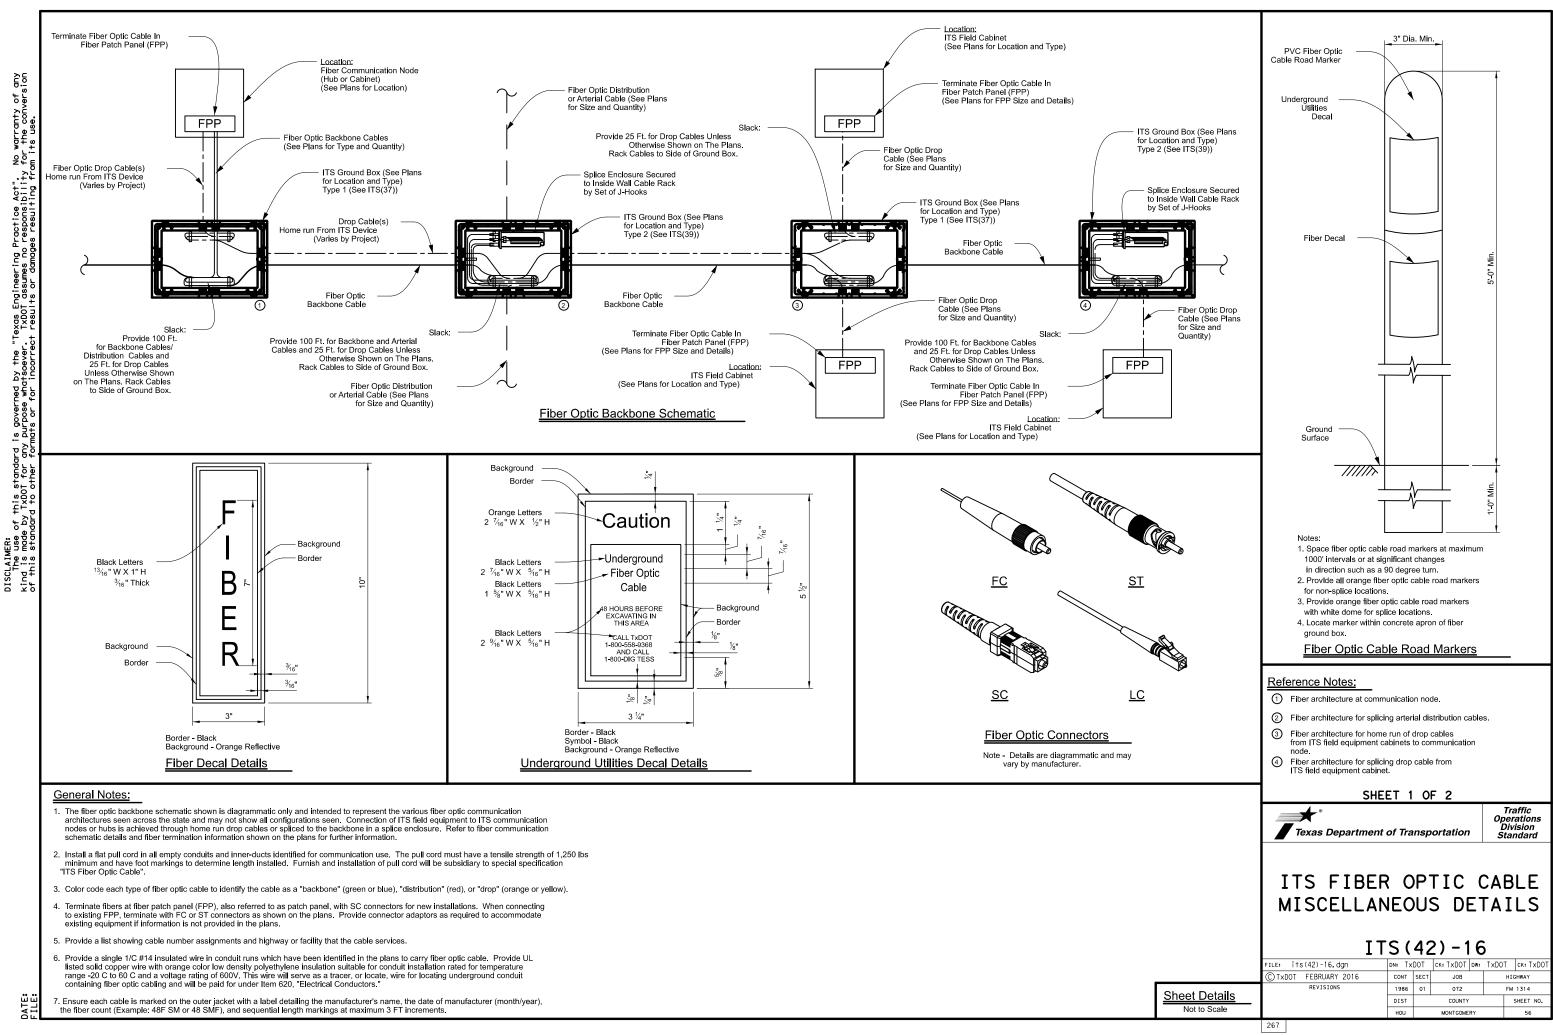

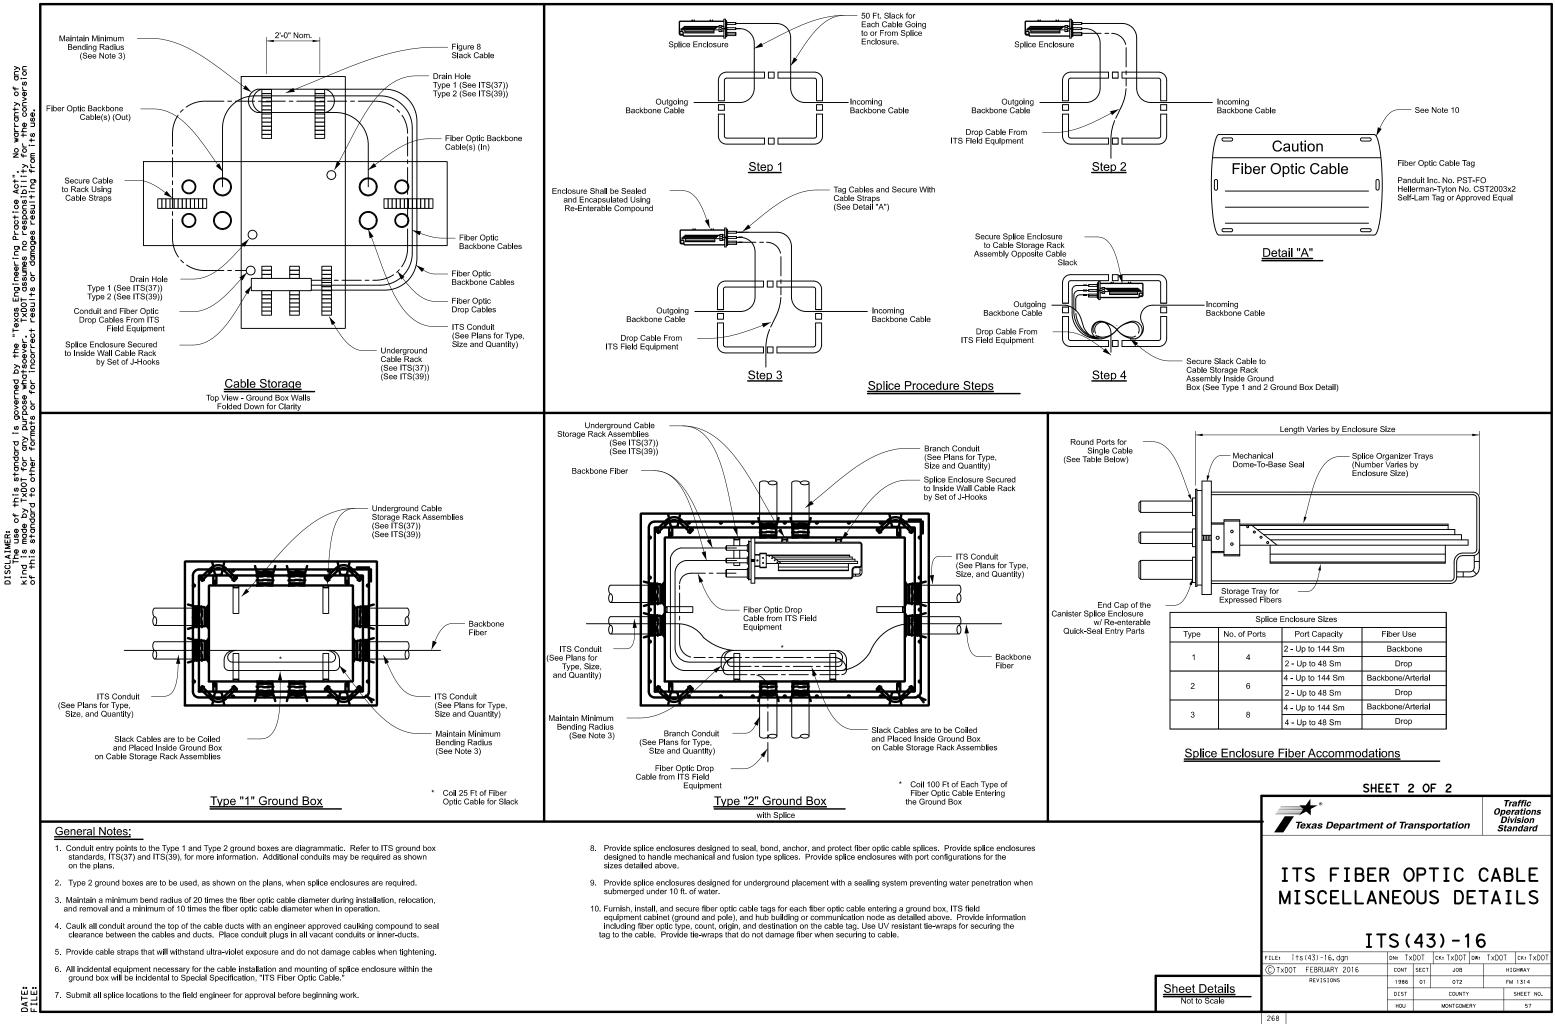

ខ្ល

BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:

- 1. The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- The development and design of the Traffic Control Plan (TCP) is the 2. responsibility of the Engineer.
- The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
- 4. The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
- 5. Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.
- When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
- The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
- 8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
- The temporary traffic control devices shown in the illustrations of the 9. BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.
- 10. Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES. CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
- 11. Traffic control devices should be in place only while work is actually in progress or a definite need exists.
- 12. The Engineer has the final decision on the location of all traffic control devices.
- 13. Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

WORKER SAFETY NOTES:


- 1. Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel." or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
- 2. Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.

COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES

- 1. Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-gualified products and their sources.
- 2. Work zone traffic control devices shall be compliant with the Manual for Assessing safety Hardware (MASH).


THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT http://www.txdot.gov							
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)							
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)							
MATERIAL PRODUCER LIST (MPL)							
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"							
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)							
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)							
TRAFFIC ENGINEERING STANDARD SHEETS							

SHEE	<u>: 1 (</u>	JF 12						
Texas Department	of Trans	sportation	Traffic Safety Division Standard					
BARRICADE AND CONSTRUCTION GENERAL NOTES AND REQUIREMENTS BC(1)-21								
FILE: bc-21.dgn	DN: TXDC		TxDOT CK: TxDO					
© TxDOT November 2002	CONT SE	ст јов	HIGHWAY					
4-03 7-13	1986 C	072	FM 1314					
9-07 8-14	DIST	COUNTY	SHEET NO.					
5-10 5-21	HOU	MONTGOMERY	58					
95								

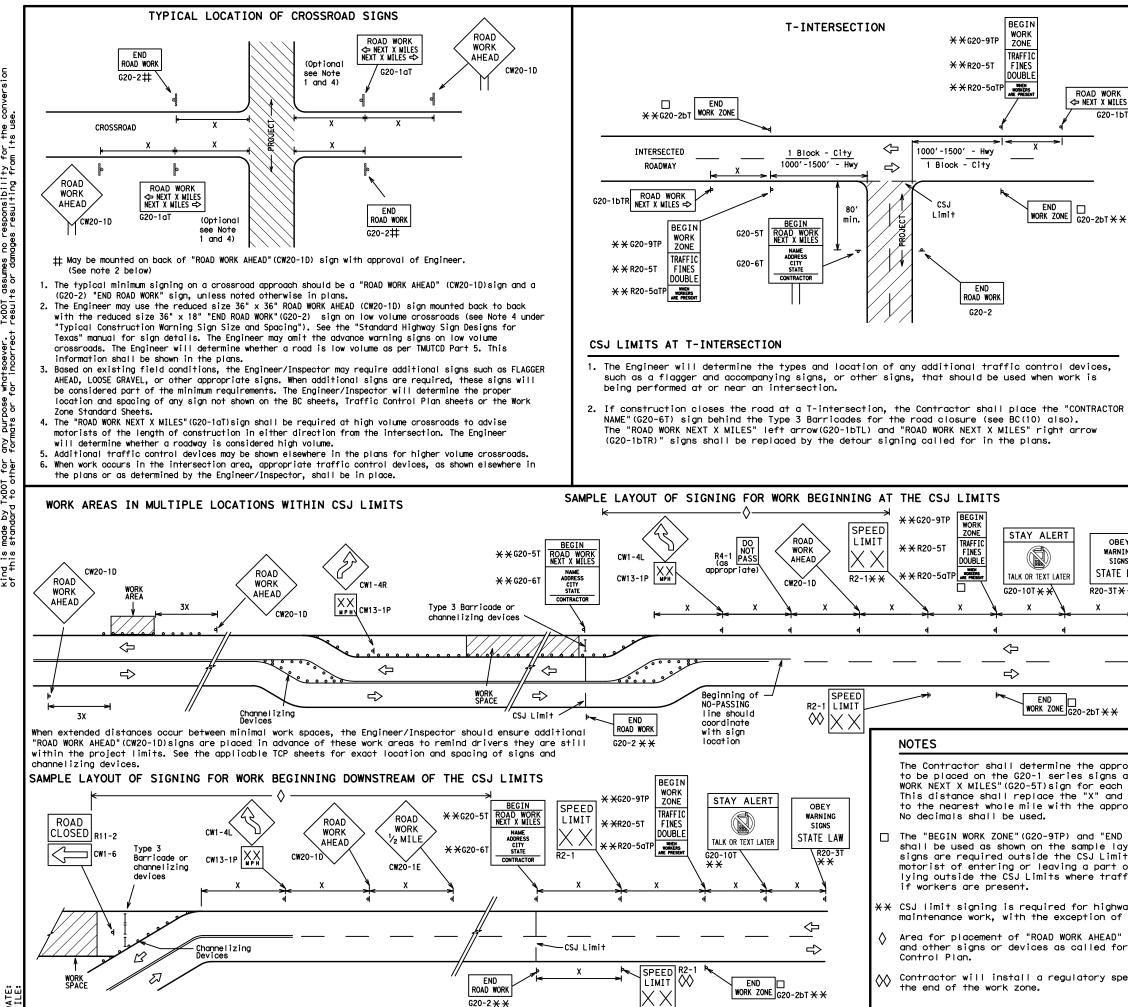

DATE:

	TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING								1G ^{1,5,6}
			SIZ	ZE			SF	PACING	3
WORK X MILES		Sign Number or Series	Convent Roc	tional ad	Express Freew		Posted Speed	Sign Spaci "X"	ng
G20-1bTL		CW20 ⁴ CW21					МРН	Fee (Appr	·x.)
		CW22 CW23	48" ×	< 48"	48" ×	48"	30 35	120	
		CW25					40	240)
		CW1, CW2,					45	320	
26T X X		CW7, CW8, CW9, CW11,	36" ×	< 36"	48" ×	48"	50 55	400 500	
		CW14					60	600	2
		CW3, CW4,					65	700	
		CW5, CW6, CW8-3,	48" ×	< 48"	48" ×	48"	70	800 900	
		CW10, CW12					80	1000	
							*	*	3
es,		For typical sig see Part 6 of t (TMUTCD) typica Minimum distanc	he "Texas I applica e from wo	Manual tion di rk area	on Uniforn agrams or 1 to first /	n Traffic ICP Stanc Advance V	c Control De dard Sheets. Varning sign	vices"	
ACTOR		work area and/o VERAL NOTES		e betwe	en each ado	ditional	sign.		
	1.	Special or larg	er size s	igns ma	y be used o	as necess	sary.		
		Distance betwee advance warning		hould b	e increased	d as requ	uired to hav	e 1500 ·	feet
		Distance betwee or more advance		hould b	e increased	d as requ	uired to hav	e 1/2	mile
OBEY		36" x 36" "ROAD crossroads at t Note 2 under "T	he discre	tion of	the Engine	eer as pe	er TMUTCD Pa		
WARNING SIGNS	5.	Only diamond sh	aped warn	ing sig	n sizes are	e indicat	ted.		
STATE LAW		See sign size Sign Designs fo sizes.							
d				·			_		1
						EGEN			
				H Type 3 Barricade					
				000		nelizin	g Devices		
* *				–	Sign				
appropria	X See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.								
gns and " each spec	BEGIN	N ROAD				T 2 0	F 10		l
and shal	l be	rounded ne Engineer.			SHEE	<u>T 2 0</u>	F 12	Tra	ffic
"END WORK	ZONE	E" (G20-2bT)	Те	xas De	partment o	of Trans	portation	Divi	fety ision idard
le layout when advance Limits. They inform the									
part of the traffic f		rk zone may double	BARF	RICA	DE AI	ND C	ONSTR	UCT	ION
nighway co	nstri	uction and		1	PROJE	CT I	IMIT		
on of mobi									
HEAD" (CW2) ad for on t					BC	(2)	-21		
			FILE: 1 (C) TXDOT N	bo-21.dgr		DN: TXDOT CONT SEC	-		ck: TxDOT hway
y speed I	imi†	sign at		REVISIONS		1986 01	072	FM	1314
				8-14 5-21		DIST HOU	COUNTY	s	HEET NO.
			96						

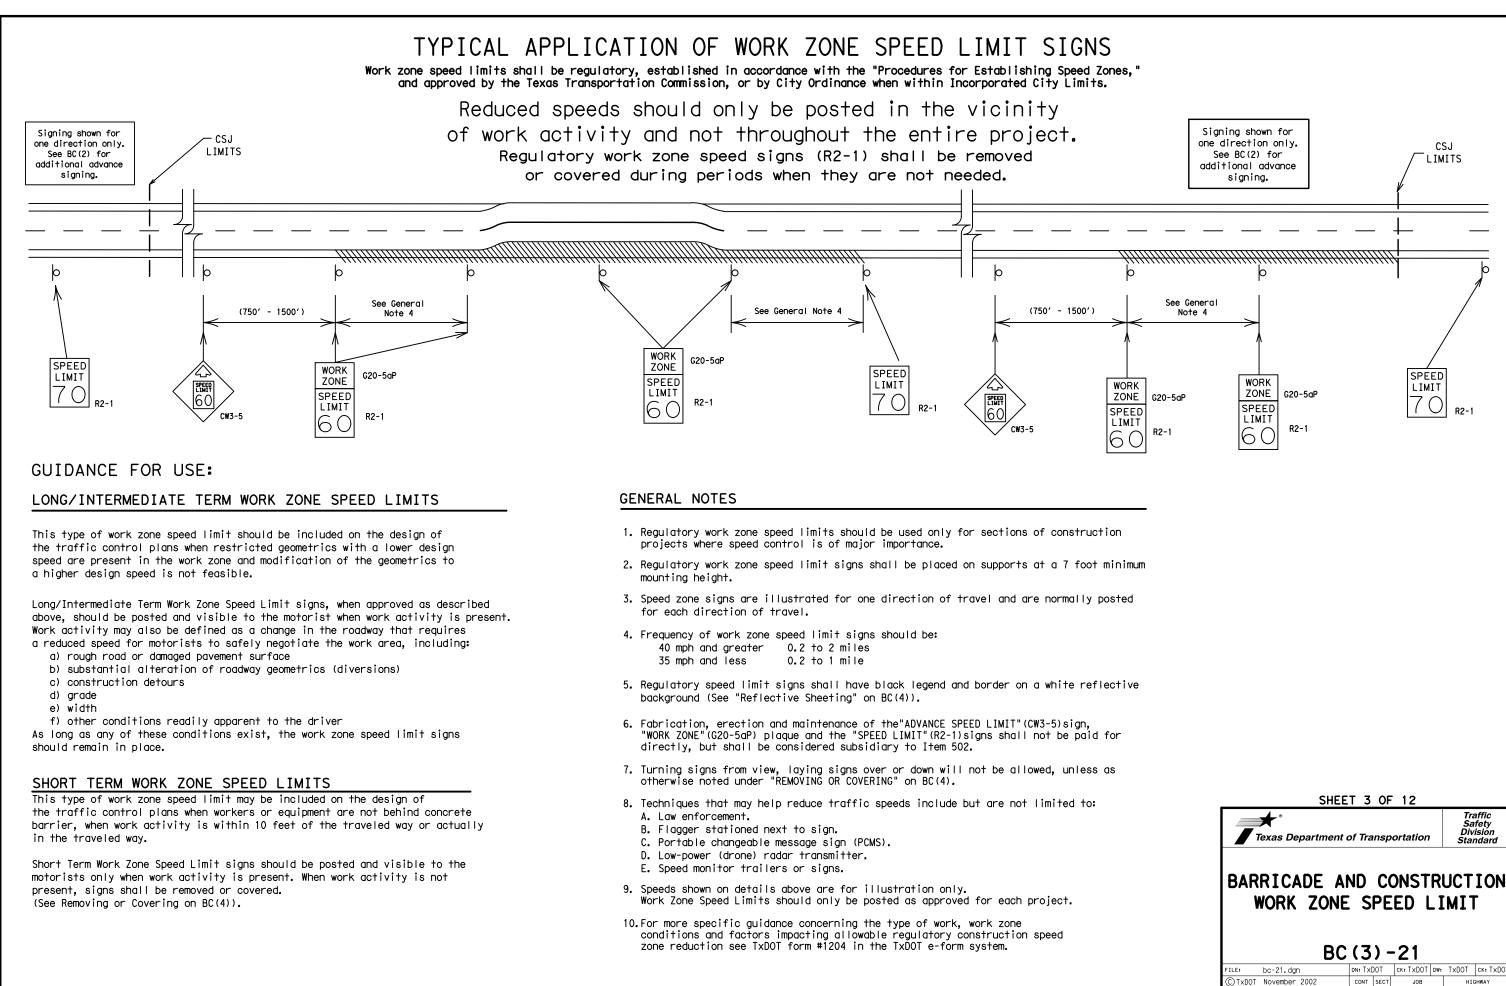

97

9-07 8-14

7-13 5-21

REVISIONS

1986 01

DIST

ноц

072


COUNTY

MONTGOMERY

FM 1314

SHEET NO.

60

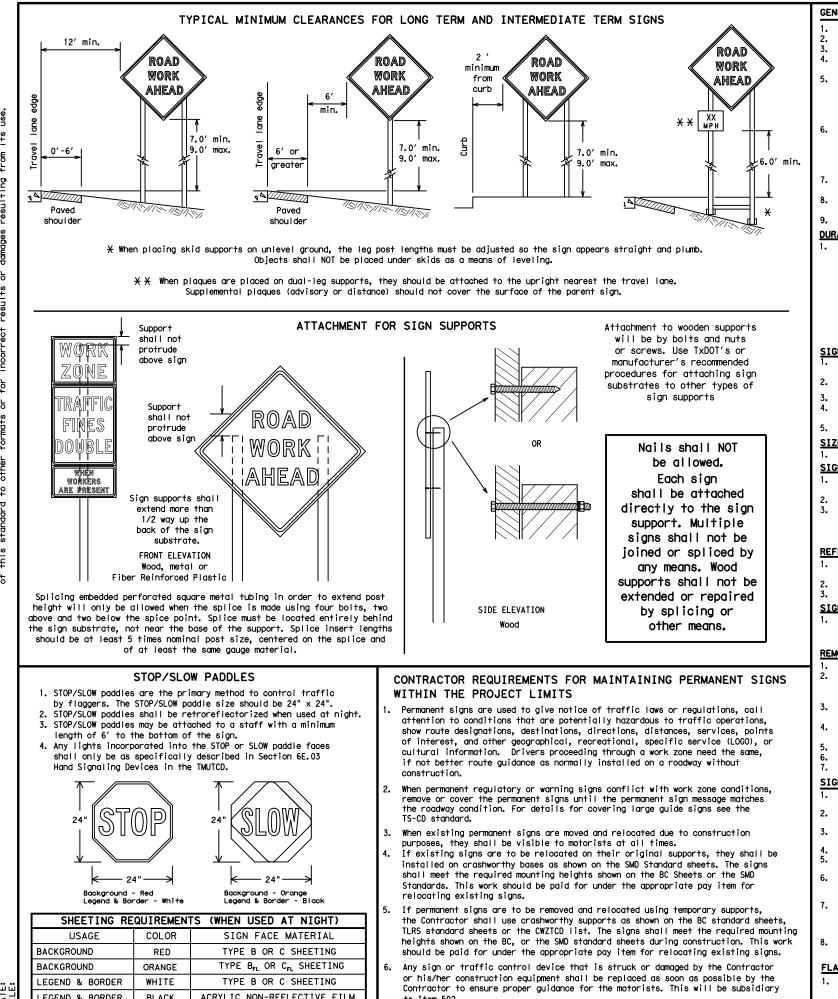

GENERAL NOTES FOR WORK ZONE SIGNS

- Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer. Wooden sign posts shall be painted white.
- Barricades shall NOT be used as sign supports.
- guide the traveling public safely through the work zone.
- the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
- the Engineer can verify the correct procedures are being followed.
- damaged or marred reflective sheeting as directed by the Engineer/Inspector.
- for identification shall be 1 inch.
- The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

<u>DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)</u>

- 1. The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of regard to crashworthiness and duration of work requirements.
- a. Long-term stationary work that occupies a location more than 3 days.
- more than one hour. Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period. c.
- Short, duration work that occupies a location up to 1 hour. d.
- e.

SIGN MOUNTING HEIGHT

- as shown for supplemental plaques mounted below other signs.
- the ground. Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
- Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to
- appropriate Long-term/Intermediate sign height.

SIZE OF SIGNS

1. The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

SIGN SUBSTRATES

- "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave. centers. The Engineer may approve other methods of splicing the sign face.

REFLECTIVE SHEETING

SIGN LETTERS

first class workmanship in accordance with Department Standards and Specifications.

REMOVING OR COVERING

- When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
- intersections where the sign may be seen from approaching traffic. Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely
- covered when not required. When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the
- Burlap shall NOT be used to cover signs.
- Duct tape or other adhesive material shall NOT be affixed to a sign face.
- Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

SIGN SUPPORT WEIGHTS

- 1. Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used. The sandbags will be tied shut to keep the sand from spilling and to maintain a
- constant weight.
- Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
- Sandbags shall be made of a durable material that tears upon vehicular
- impact. Rubber (such as tire inner tubes) shall NOT be used. Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list. Sandbags shall only be placed along or laid over the base supports of the
- traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
- Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

FLAGS ON SIGNS

1. Flags may be used to draw attention to warning signs. When used, the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.

SHEETING RE	QUIREMENT	TS (WHEN USED AT NIGHT)
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	ORANGE	TYPE B _{FL} OR C _{FL} SHEETING
LEGEND & BORDER	WHITE	TYPE B OR C SHEETING
LEGEND & BORDER	BLACK	ACRYLIC NON-REFLECTIVE FILM

to Item 502.

All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and

The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in

The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD) for small roadside signs. Supports for temporary large roadside signs shall meet the requirements detailed on the Temporary Large Roadside Signs (TLRS) standard sheets. The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so

The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or

Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used

work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in

Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting

Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except

The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above

Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports. All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6"

1. All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1). White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background. 3. Orange sheeting, meeting the requirements of DMS-8300 Type B_{FL} or Type C_{FL}, shall be used for rigid signs with orange backgrounds.

1. All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of

Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any

entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.

FILE

<u>C</u>T


98

SHEET 4 OF 12

• • Texas Department of Transportation Traffic Safety Division Standard

BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES

BC(4)-21								
	bc-21.dgn	DN: T	x DOT	ск: TxDOT	DW:	TxDOT	ск: ТхDОТ	
TxDOT	November 2002	CONT	CONT SECT JOB		HIGHWAY			
	REVISIONS	1986	01	072		FM	1314	
9-07	8-14	DIST	DIST COUNTY SHE			SHEET NO.		
'-13	5-21	HOU	HOU MONTGOMERY				61	

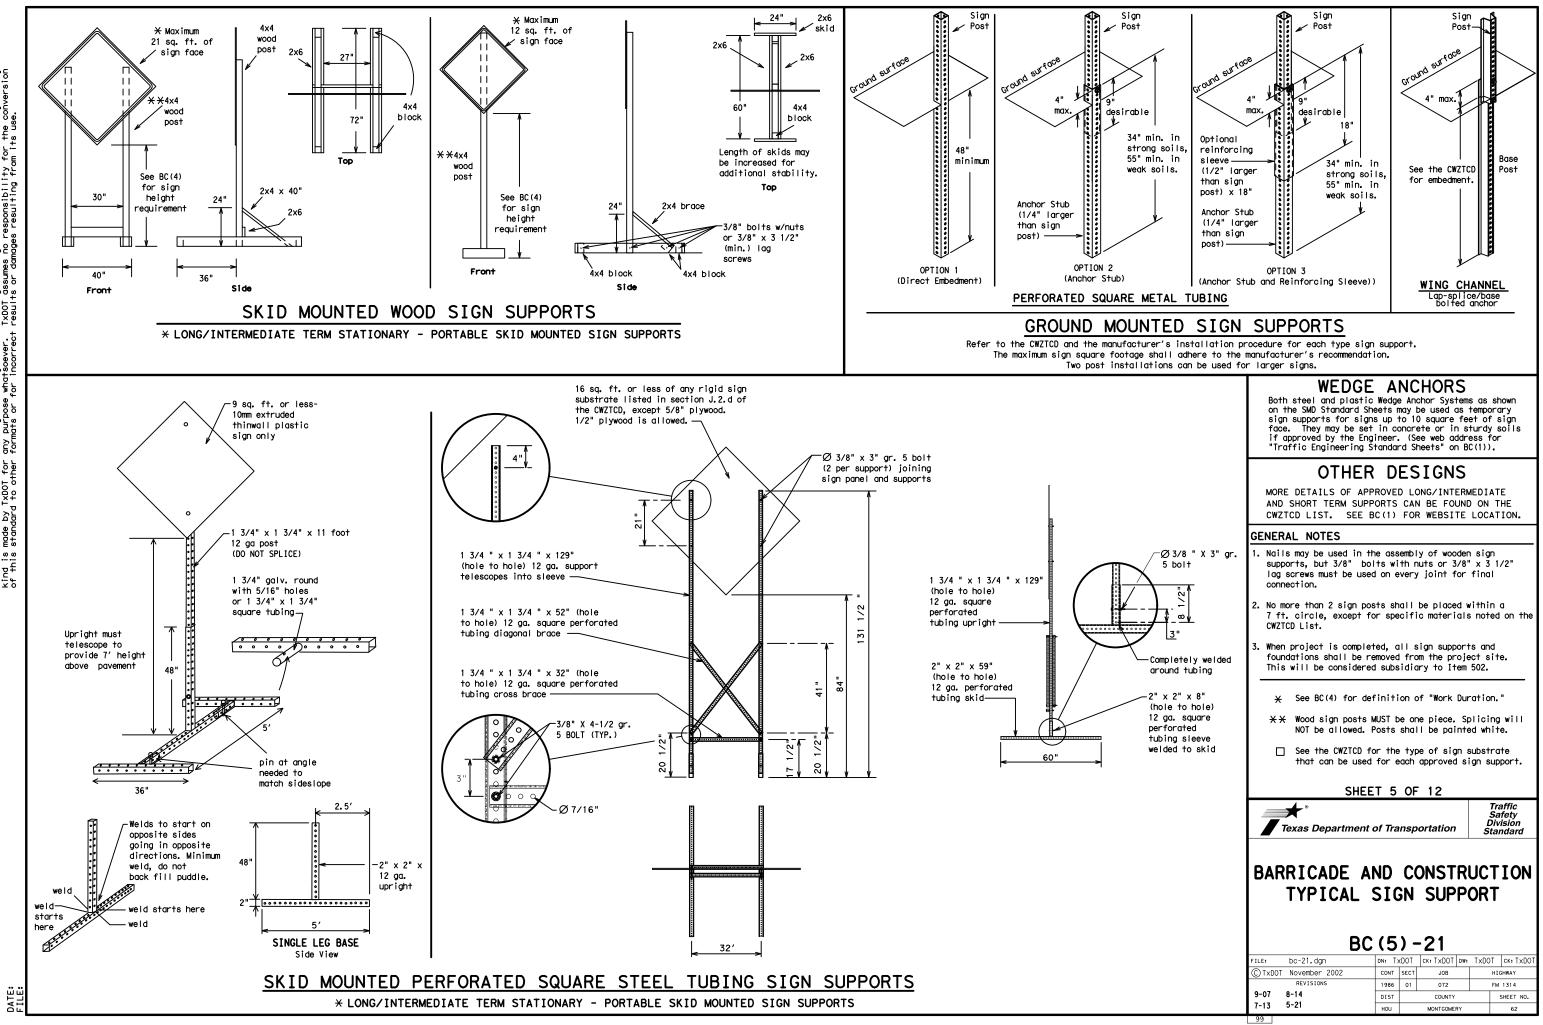

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any Kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

PORTABLE CHANGEABLE MESSAGE SIGNS

- 1. The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
- Messages on PCMS should contain no more than 8 words (about four to 2. eight characters per word), not including simple words such as "TO." "FOR." "AT." etc.
- Messages should consist of a single phase, or two phases that 3. alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
- 4. Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
- Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
- When in use, the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
- The message term "WEEKEND" should be used only if the work is to 7. start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
- The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
- Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
- 10. Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
- Do not use the word "Danger" in message.
 Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
- 13. Do not display messages that scroll horizontally or vertically across the face of the sign.
- 14. The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
- 15. PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
- 16. Each line of text should be centered on the message board rather than left or right justified.
- 17. If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

WORD OR PHRASE	ABBREVIATION	WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD	Major	MAJ
Alternate	ALT	Miles	МІ
Avenue	AVE	Miles Per Hour	MPH
Best Route	BEST RTE	Minor	MNR
Boulevard	BLVD	Monday	MON
Bridge	BRDG	Normal	NORM
Cannot	CANT	North	N
Center	CTR	Northbound	(route) N
Construction Ahead	CONST AHD	Parking	PKING RD
CROSSING	XING	Road	
Detour Route	DETOUR RTE	Right Lane	RT LN
Do Not	DONT	Saturday Saturday	SAT DD
East	E	Service Road	SERV RD
Eastbound	(route) E	Shoulder	SHLDR
Emergency	EMER	Slippery	SL IP S
Emergency Vehicle		South Southbound	(route) S
Entrance, Enter	ENT	Speed	SPD
Express Lane	EXP LN	Street	ST
Expressway	EXPWY	Sunday	SUN
XXXX Feet	XXXX FT	Telephone	PHONE
Fog Ahead	FOG AHD	Temporary	TEMP
Freeway	FRWY, FWY	Thursday	THURS
Freeway Blocked	FWY BLKD	To Downtown	TO DWNTN
Friday	FRI	Traffic	
Hazardous Driving			
Hazardous Material		Travelers	TRVLRS
High-Occupancy	HOV	Tuesday	TUES
Vehicle		Time Minutes	TIME MIN
Highway	HWY	Upper Level	UPR LEVEL
Hour (s)	HR, HRS	Vehicles (s)	VEH, VEHS
Information	INFO	Warning	WARN
It Is	ITS	Wednesday	WED
Junction	JCT	Weight Limit	
Left	LFT	West	-
Left Lane	LFT LN	Westbound Wet Pavement	(route) W WET PVMT
Lane Closed	LN CLOSED	Will Not	WONT
Lower Level	LWR LEVEL	WILL NOT	
Maintenance	MAINT		

RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES

(The Engineer may approve other messages not specifically covered here.)

Phase 1: Condition Lists

Road/Lane/Ramp Closure List

	mΡ			011
FREEWAY CLOSED X MILE		FRONTAGE ROAD CLOSED		ROADW XXX
ROAD CLOSED AT SH XXX		SHOULDER CLOSED XXX FT		FLAG XXXX
ROAD CLSD AT FM XXXX		RIGHT LN CLOSED XXX FT		RIGHT NARRO XXXX
RIGHT X LANES CLOSED		RIGHT X LANES OPEN		MERG TRAF XXXX
CENTER LANE CLOSED		DAYTIME LANE CLOSURES		LOO: GRAV XXXX
NIGHT LANE CLOSURES		I-XX SOUTH EXIT CLOSED		DETC X MI
VARIOUS LANES CLOSED		EXIT XXX CLOSED X MILE		ROADW PAS SH XX
EXIT CLOSED		RIGHT LN TO BE CLOSED		BUM XXXX
MALL DRIVEWAY CLOSED		X LANES CLOSED TUE - FRI		TRAF SIGN XXXX
XXXXXXXX BLVD CLOSED	*	LANES SHIFT in	Phase	1 must be

Other Co	ndition List
ROADWORK XXX FT	ROAD REPAIRS XXXX FT
FLAGGER XXXX FT	LANE NARROWS XXXX FT
RIGHT LN NARROWS XXXX FT	TWO-WAY TRAFFIC XX MILE
MERGING TRAFFIC XXXX FT	CONST TRAFFIC XXX FT
LOOSE GRAVEL XXXX FT	UNEVEN LANES XXXX FT
DETOUR X MILE	ROUGH ROAD XXXX FT
ROADWORK PAST SH XXXX	ROADWORK NEXT FRI-SUN
BUMP XXXX FT	US XXX EXIT X MILES
TRAFFIC SIGNAL XXXX FT	LANES SHIFT

A		e/E [.] Lis	ffect on Travel t	
	MERGE RIGHT		FORM X LINES RIGHT	
	DETOUR NEXT X EXITS		USE XXXXX RD EXIT	
	USE EXIT XXX		USE EXIT I-XX NORTH	
	STAY ON US XXX SOUTH		USE I-XX E TO I-XX N	
	TRUCKS USE US XXX N		WATCH FOR TRUCKS	
	WATCH FOR TRUCKS		EXPECT DELAYS	
	EXPECT DELAYS		PREPARE TO STOP	
	REDUCE SPEED XXX FT		END SHOULDER USE	
	USE OTHER ROUTES		WATCH FOR WORKERS	
	STAY IN LANE	 *		

APPLICATION GUIDELINES

- 1. Only 1 or 2 phases are to be used on a PCMS.
- 2. The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
- 3. A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
- 4. A Location Phase is necessary only if a distance or location is not included in the first phase selected.
- 5. If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS shall be limited to two phases, and should be understandable by themselves.
- 6. For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

WORDING ALTERNATIVES

- 1. The words RIGHT, LEFT and ALL can be interchanged as appropriate.
- 2. Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
- EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
- 4. Highway names and numbers replaced as appropriate.
- 5. ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
- 6. AHEAD may be used instead of distances if necessary.
- 7. FT and MI. MILE and MILES interchanged as appropriate. 8. AT. BEFORE and PAST interchanged as needed.
- 9. Distances or AHEAD can be eliminated from the message if a
- location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC. THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

used with STAY IN LANE in Phase 2.


FULL MATRIX PCMS SIGNS

- 1. When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
- 2. When symbol signs, such as the "Flagger Symbol" (CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
- When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute 3. for. or replace that sign.
- 4. A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.


Ê.

Roadway


Phase 2: Possible Component Lists

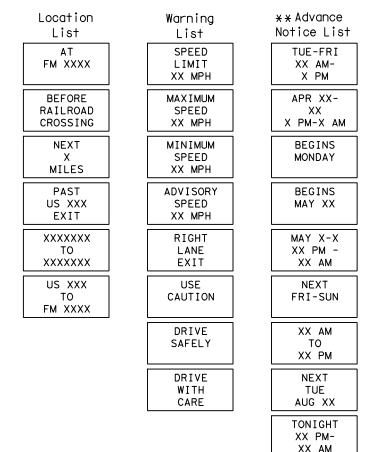


X X See Application Guidelines Note 6.

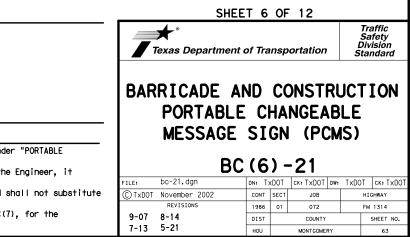



100

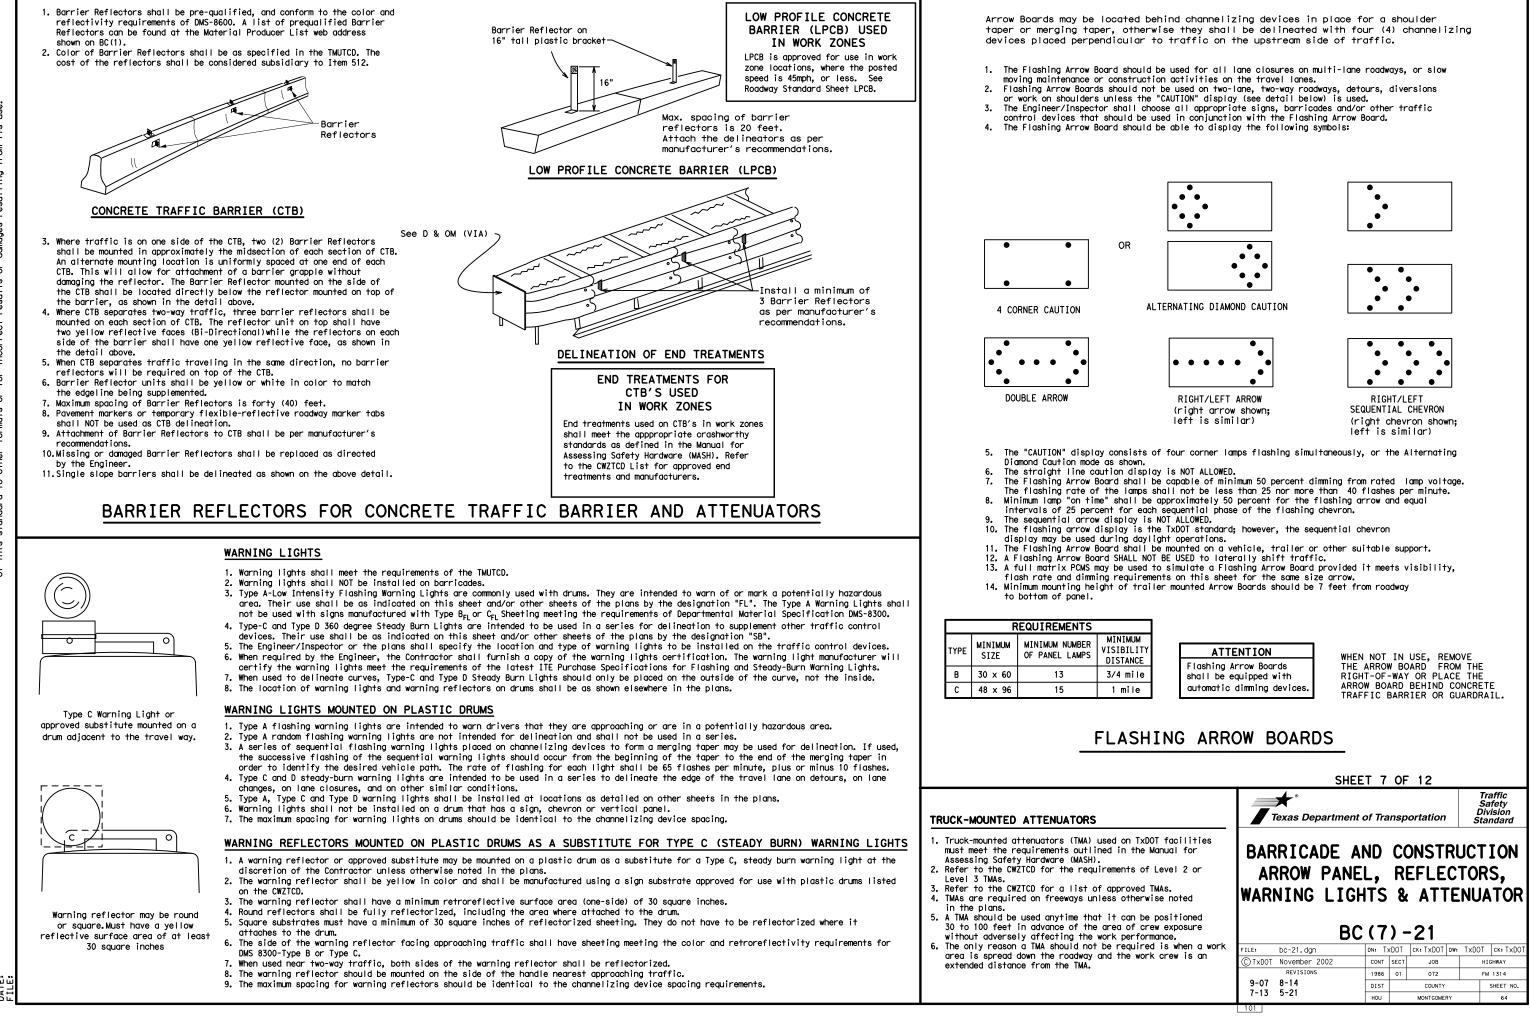



DATE:











GENERAL NOTES

- 1. For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
- 2. For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections, one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
- 3. For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
- 4. Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- 5. Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
- The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

GENERAL DESIGN REQUIREMENTS


- Pre-qualified plastic drums shall meet the following requirements:
- 1. Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
- 2. The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
- Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
- 4. Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
- 5. The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
- 6. The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectorized space between any two adjacent stripes shall not exceed 2 inches in width.
- 7. Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
- Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
- 9. Drum body shall have a maximum unballasted weight of 11 lbs.
- 10. Drum and base shall be marked with manufacturer's name and model number.

RETROREFLECTIVE SHEETING


- The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials." Type A or Type B reflective sheeting shall be supplied unless otherwise specified in the plans.
- 2. The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.

BALLAST

- 1. Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
- Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
- 3. Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
- 4. The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
- 5. When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
- 6. Ballast shall not be placed on top of drums.
- 7. Adhesives may be used to secure base of drums to pavement.

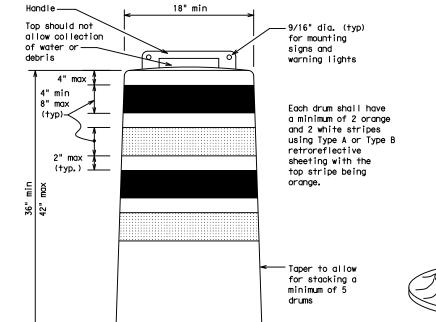




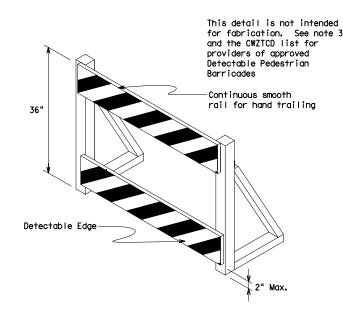


DETECTABLE PEDESTRIAN BARRICADES

- When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility. Refer to WZ(BTS-2) for Pedestrian Control requirements for Sidewalk Diversions, Sidewalk Detours and Crosswalk Closures.
- Where pedestrians with visual disabilities normally use the closed sidewalk, a Detectable Pedestrian Barricade shall be placed across the full width of the closed sidewalk instead of a Type 3 Barricade.
- Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
- 4. Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines (ADAAG)" and should not be used as a control for pedestrian movements.
- 5. Warning lights shall not be attached to detectable pedestrian barricades.
- Detectable pedestrian barricades should use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.


È È

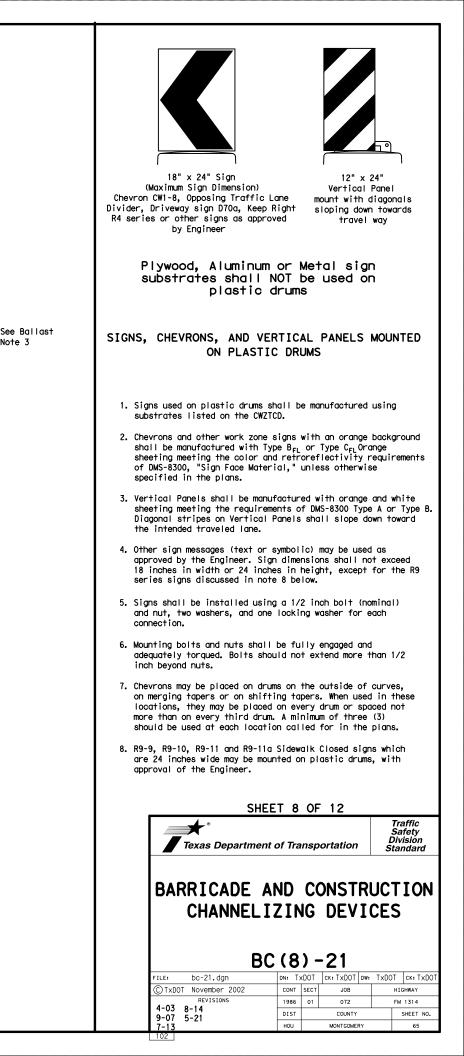

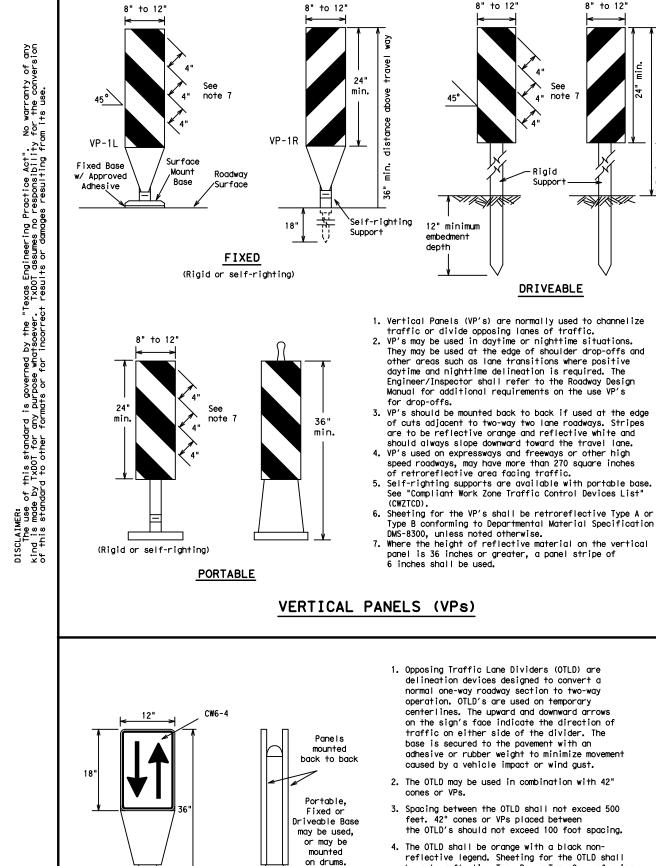

4. The OTLD shall be orange with a black nonreflective legend. Sheeting for the OTLD shall be retroreflective Type $\mathsf{B}_{\mathsf{FL}}\,\mathsf{or}\,\mathsf{Type}\,\mathsf{C}_{\mathsf{FL}}\,\mathsf{conforming}$ to Departmental Material Specification DMS-8300. unless noted otherwise. The legend shall meet the requirements of DMS-8300.

OPPOSING TRAFFIC LANE DIVIDERS (OTLD)

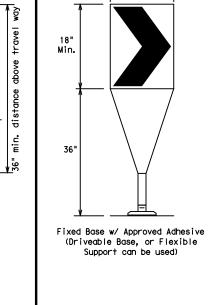

12"

8" to 12

TATION


Rigid

Support

DRIVEABLE

- 1. The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
- 2. Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
- 3. Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
- 4. To be effective, the chevron should be visible for at least 500 feet.
- 5. Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type BFL or Type CFL conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
- 6. For Long Term Stationary use on tapers or transitions on freeways and divided highways, self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

CHEVRONS



LONGITUDINAL CHANNELIZING DEVICES (LCD)

- 1. LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
- 2. LCDs may be used instead of a line of cones or drums. 3. LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- 4. LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
- 5. LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
- 6. LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10). Place reflective sheeting near the top of the LCD along the full length of the device.

WATER BALLASTED SYSTEMS USED AS BARRIERS

- Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate Manual for Assessing Safety Hardware (MASH) crashworthiness' requirements based on roadway speed and barrier application.
- Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
- 3. Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
- When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long canes and the top of the unit shall not be less than 32 inches in height.

HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS

GENERAL NOTES

- 1. Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- 2. Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
- 3. Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- 4. The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
- 5. Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
- Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
- 7. The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.

Posted Speed	Formula	Minimum Desirable Taper Lengths X X			Suggested Maximum Spacing of Channelizing Devices		
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	
30	2	150′	165′	180′	30′	60'	
35	$L = \frac{WS^2}{60}$	205′	225′	245′	35′	70′	
40	60	265′	295′	320′	40′	80′	
45		450′	495′	540′	45′	90′	
50		500′	550'	600′	50'	100′	
55	L=WS	550'	605′	660′	55′	110′	
60	2	600′	660 <i>'</i>	720'	60′	120′	
65		650′	715′	780′	65′	130′	
70		700′	770′	840′	70′	140′	
75		750′	825′	900′	75′	150′	
80		800'	880′	960′	80′	160′	


L=Length of Taper (FT.) W=Width of Offset (FT.) S=Posted Speed (MPH) SUGGESTED MAXIMUM SPACING OF

CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS

SHEET 9 OF 12	
Texas Department of Transportation	Traffic Safety Division Standard

BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC (9) -21									
.E:	bc-21.dgn		dn: T>	DOT	ск: TxDOT	DW:	TxDOT	ск: TxDOT	
TxDOT	November 2002		CONT	SECT	JOB		HIGHWAY		
	REVISIONS		1986	01	072		FN	1 1 3 1 4	
-07	8-14 5-21		DIST		COUNTY			SHEET NO.	
-13	HOU	HOU MONTGOMERY			66				
12									

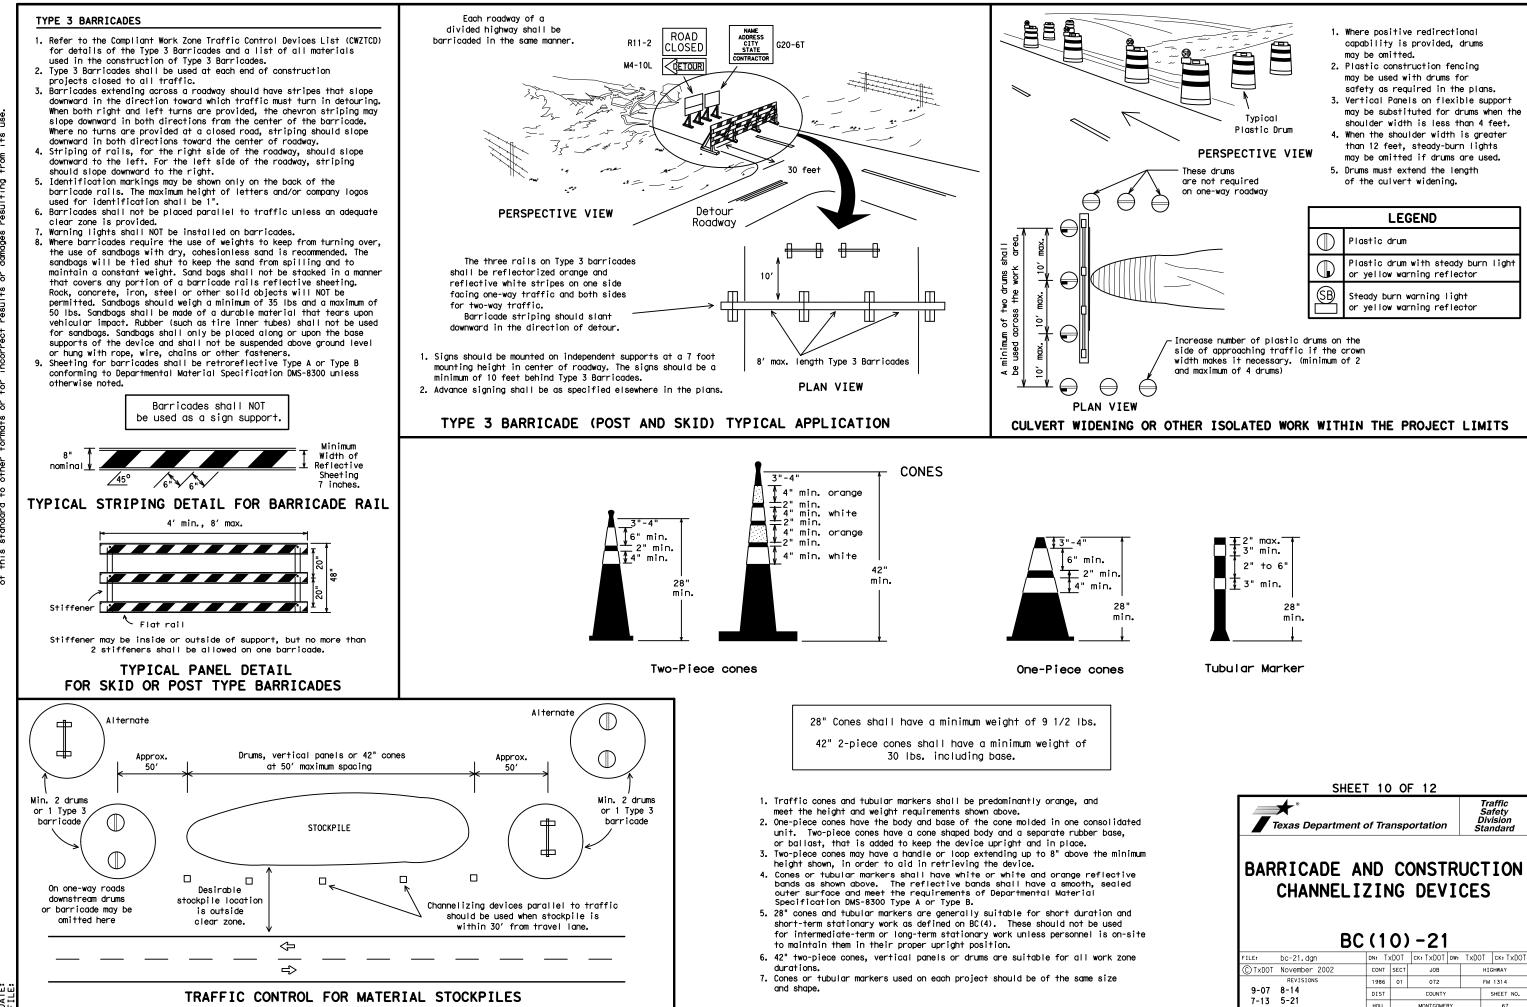

DATE:

Traffic Safety Division Standard BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES BC (10) -21 FILE: DC-21.dgn DN: TXD0T CK: TXD0T CK: TXD0T CK: TXD0T FILE: DC-21.dgn DN: TXD0T CK: TXD0T CK:	SHEET	Г 1C	0	F 12							
CHANNELIZING DEVICES BC (10) -21 FILE: bc-21.dgn DN: TXDOT CK: TXDOT DW: TXDOT CK: TXDOT CONT SECT JOB HIGHWAY REVISIONS 1986 01 072 FM 1314 9-07 8-14 DIST COUNTY SHEET NO.	Texas Department	of Tra	nsp	ortation		Sa Div	fety ision				
© TxD0T November 2002 CONT SECT JOB HIGHWAY REVISIONS 1986 01 072 FM 1314 9-07 8-14 DIST COUNTY SHEET NO.	CHANNELI	BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES									
REVISIONS 1986 01 072 FM 1314 9-07 8-14 DIST COUNTY SHEET NO. 7-13 5-21 DIST COUNTY SHEET NO.	FILE: bc-21.dgn	DN: T	<dot< th=""><th>ск: TxDOT</th><th>DW:</th><th>TxDOT</th><th>ск: ТхDОТ</th></dot<>	ск: TxDOT	DW:	TxDOT	ск: ТхDОТ				
9-07 8-14 7-13 5-21		CONT	SECT	JOB		ніс	SHWAY				
7-13 5-21		1986	01	072		FM	1314				
HOU MONTGOMERY 67		DIST		COUNTY			SHEET NO.				
	1-13 5-21	HOU		MONTGOME	٩Y		67				

WORK ZONE PAVEMENT MARKINGS

GENERAL

- The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
- 2. Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- 3. Additional supplemental pavement marking details may be found in the plans or specifications.
- Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
- 5. When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
- 6. When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
- All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

RAISED PAVEMENT MARKERS

- 1. Raised pavement markers are to be placed according to the patterns on BC(12).
- All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

PREFABRICATED PAVEMENT MARKINGS

- 1. Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
- Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


MAINTAINING WORK ZONE PAVEMENT MARKINGS

- 1. The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
- Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
- 3. The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
- Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

REMOVAL OF PAVEMENT MARKINGS

- Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
- The above shall not apply to detours in place for less than three days, where flaggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
- Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
- 4. The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
- Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
- 6. Blast cleaning may be used but will not be required unless specifically shown in the plans.
- 7. Over-painting of the markings SHALL NOT BE permitted.
- 8. Removal of raised pavement markers shall be as directed by the Engineer.
- Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
- 10.Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

Temporary Flexible-Reflective Roadway Marker Tabs

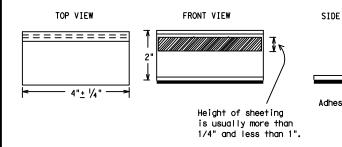

STAPLES OR NAILS SHALL NOT BE USED TO SECU TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARK TABS TO THE PAVEMENT SURFACE

- Temporary flexible-reflective roadway marker tabs used as guiden shall meet the requirements of DMS-8242.
- Tabs detailed on this sheet are to be inspected and accepted by Engineer or designated representative. Sampling and testing is normally required, however at the option of the Engineer, either or "B" below may be imposed to assure quality before placement or roadway.
 - A. Select five (5) or more tabs at random from each lot or sl and submit to the Construction Division, Materials and Par Section to determine specification compliance.
 - B. Select five (5) tabs and perform the following test. Affix (5) tabs at 24 inch intervals on an asphaltic pavement in straight line. Using a medium size passenger vehicle or pi run over the markers with the front and rear tires at a sp of 35 to 40 miles per hour, four (4) times in each directi more than one (1) out of the five (5) reflective surfaces be lost or displaced as a result of this test.
- 3. Small design variances may be noted between tab manufacturers.
- 4. See Standard Sheet WZ(STPM) for tab placement on new pavements. Standard Sheet TCP(7-1) for tab placement on seal coat work.


RAISED PAVEMENT MARKERS USED AS GUIDEMARK

- Raised pavement markers used as guidemarks shall be from the approduct list, and meet the requirements of DMS-4200.
- All temporary construction raised pavement markers provided on project shall be of the same manufacturer.
- Adhesive for guidemarks shall be bituminous material hot applie butyl rubber pad for all surfaces, or thermoplastic for concresurfaces.


Guidemarks shall be designated as:

YELLOW - (two amber reflective surfaces with yellow body). WHITE - (one silver reflective surface with white body).

		ONS
	PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
	TRAFFIC BUTTONS	DMS-4300
IEW	EPOXY AND ADHESIVES BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6100 DMS-6130
57	PERMANENT PREFABRICATED PAVEMENT MARKENS	DMS-8130
	TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8240
] ≬	TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242
re pad	A list of prequalified reflective raised pavement non-reflective traffic buttons, roadway marker tab pavement markings can be found at the Material Pro web address shown on BC(1).	s and othe
-		
.S		
" 'he		
ent nt		
ve IP, No III		
wed		
ved	SHEET 11 OF 12	
wed	SHEET 11 OF 12	Traffic
evved or		Traffic Safety Division Standard
wed	* *	Safety Division Standard
ved	Texas Department of Transportation	Safety Division Standard

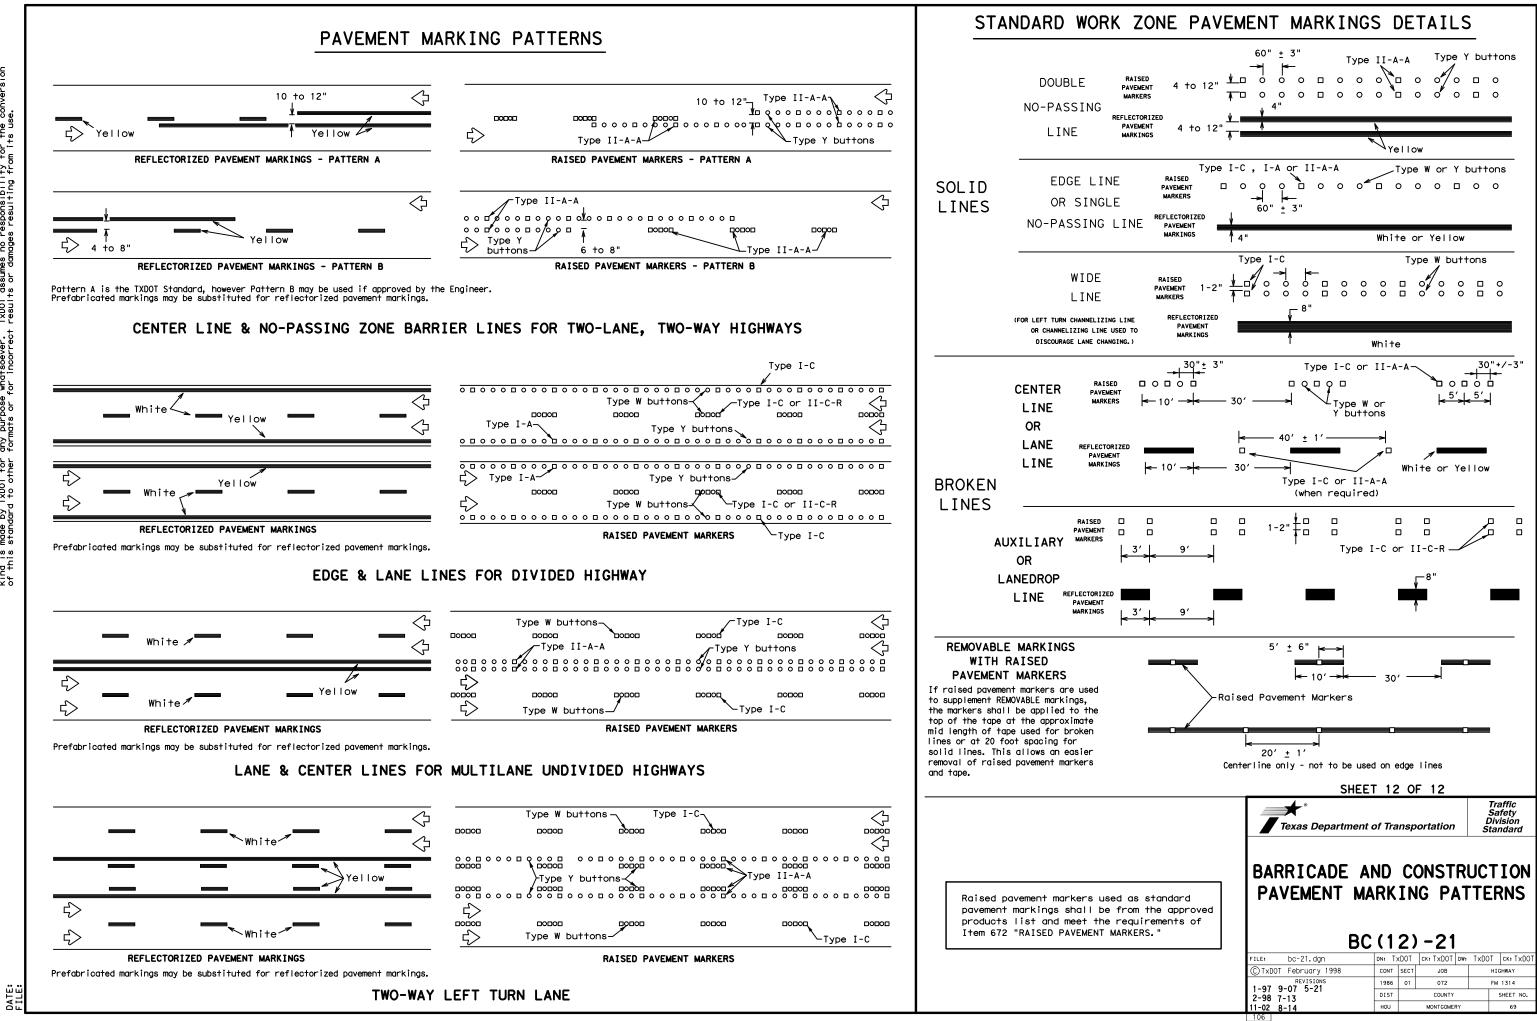

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any Kind is made by TXDDT for any purpose wharsoever. TXDDT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

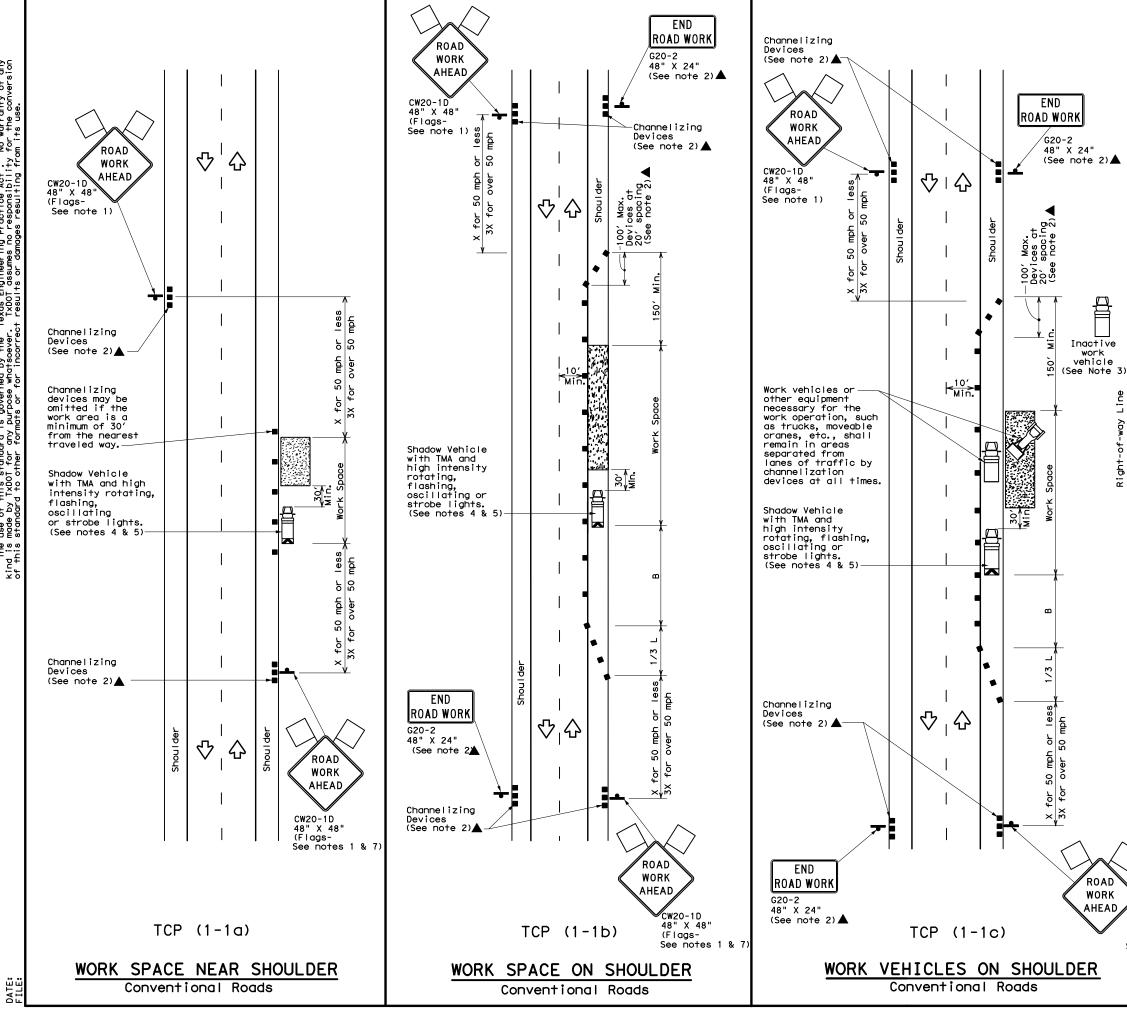

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any Kind is made by TXDD1 for any purpose wharsoever. TXDD1 assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

LEGEND									
<u>e / / / /</u>	Type 3 Barricade		Channelizing Devices						
	Heavy Work Vehicle	K	Truck Mounted Attenuator (TMA)						
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)						
-	Sign	2	Traffic Flow						
$\langle \rangle$	Flag	ЦO	Flagger						

Speed	Formula	**		Spacir Channe		Minimum Sign Spacing "X"	Suggested Longitudinal Buffer Space	
*		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	Distance	"8"
30	<u></u>	150′	1651	180′	30'	60′	120'	90'
35	$L = \frac{WS}{60}$	205′	225′	245′	35′	70'	160′	120′
40	60	265′	295′	320′	40′	80′	240′	155′
45		450′	495′	540′	45′	90′	320′	195′
50		500'	550'	600′	50'	100′	400′	240′
55	L=WS	550′	605′	660′	55 <i>'</i>	110'	500′	295′
60	2 13	600′	660′	720′	60′	120′	600′	350′
65		650′	715′	780′	65′	130′	700′	410′
70		700'	770′	840′	70′	140′	800′	475′
75		750′	825′	900′	75′	150′	900′	540′

* Conventional Roads Only

XX Taper lengths have been rounded off.

L=Length of Taper (FT) W=Width of Offset (FT) S=Posted Speed (MPH)


TYPICAL USAGE								
MOBILE	MOBILE SHORT SHORT TERM INTERMEDIATE LONG TERM DURATION STATIONARY TERM STATIONARY STATIONAR							
	4	1						

GENERAL NOTES

1. Flags attached to signs where shown are REQUIRED.

- 2. All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.
- 3. Inactive work vehicles or other equipment should be parked near the right-of-way line and not parked on the paved shoulder.
- 4. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
- 5. Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect wider work spaces. 6. See TCP(5-1) for shoulder work on divided highways, expressways and
- freeways. 7. CW21-5 "SHOULDER WORK" signs may be used in place of CW20-1D
- "ROAD WORK AHEAD" signs for shoulder work on conventional roadways.

	Texas Department	of Trar	nsportation	Traffic Operations Division Standard
CW20-1D 48" X 48" (Flags- See notes 1 & 7)		DER	· · · · - · ·	- · · ·
See notes I & ()	FILE: tcp1-1-18, dgn	DN:	CK: DW:	CK:
	© TxDOT December 1985	CONT S	ECT JOB	HIGHWAY
	2-94 4-98	1986	01 072	FM 1314
	8-95 2-12	DIST	COUNTY	SHEET NO.
	1-97 2-18	HOU	MONTGOMERY	70
	151			

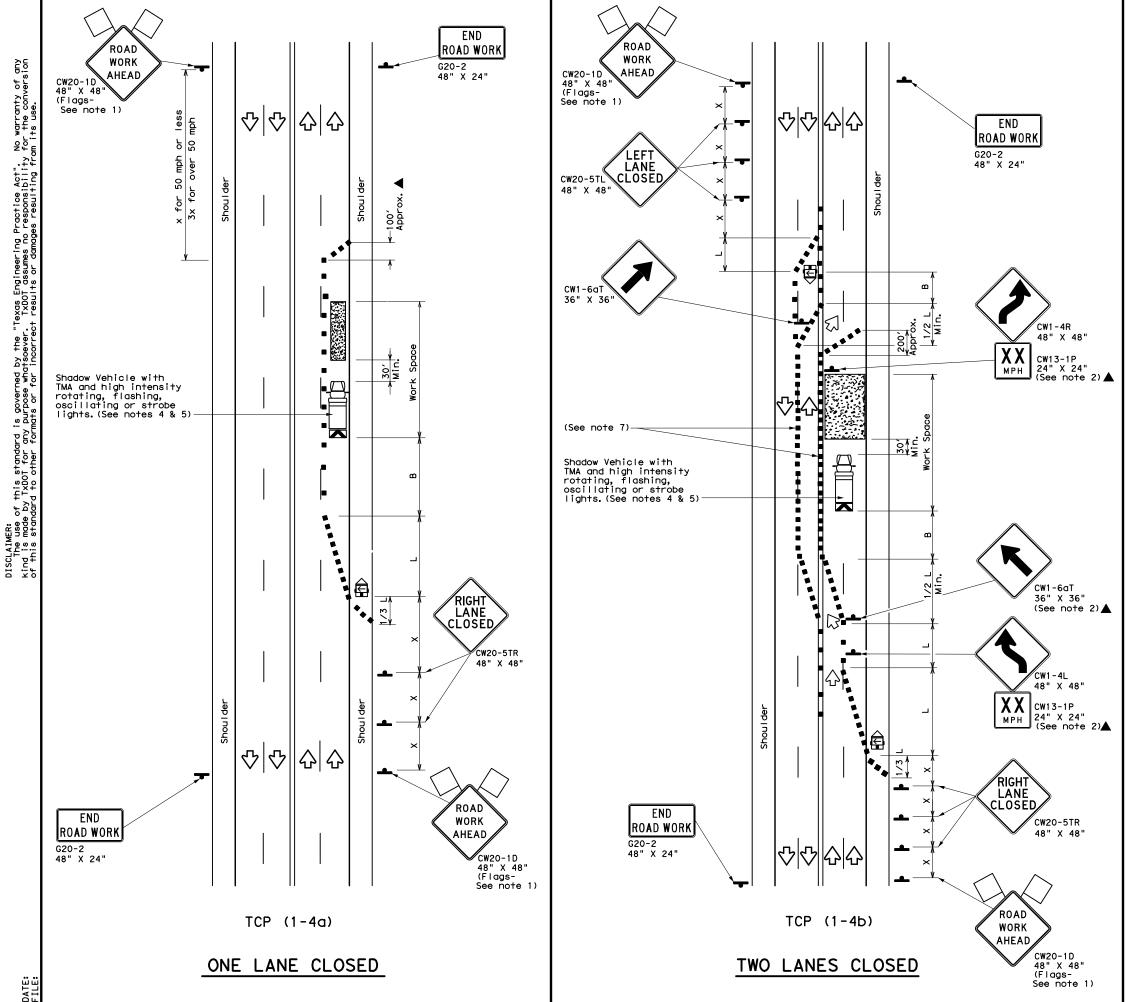

LEGEND									
<u>~ / / / /</u>	Type 3 Barricade		Channelizing Devices						
□‡	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)						
Ê	Trailer Mounted Flashing Arrow Board	M	Portable Changeable Message Sign (PCMS)						
-	Sign	\langle	Traffic Flow						
\bigtriangleup	Flag	LO	Flagger						

Posted Speed	Speed		Minimum Desirable Taper Lengths X X			d Maximum ng of lizing ices	Minimum Sign Spacing "x"	Suggested Longitudinal Buffer Space
*		10' Offs e t	11' Offset	12' Offset	On a Taper	On a Tangent	Distance	"B"
30	$\frac{WS^2}{1}$	150′	165′	180′	30′	60′	120′	90'
35	$L = \frac{WS^{-1}}{60}$	205'	225′	245′	35′	70′	160′	120′
40	60	265′	295′	320′	40′	80′	240′	155′
45		450′	495′	540′	45′	90'	320′	195′
50		500'	550'	600′	50′	100'	400′	240′
55	L=WS	550'	605′	660′	55′	110'	500′	295′
60	L-#5	600′	660′	720′	60′	120′	600′	350′
65		650′	715′	780′	65′	130'	700′	410′
70		700′	770′	840′	70′	140′	800′	475′
75		750'	825′	900′	75′	150′	900′	540′

X Conventional Roads Only

★ Taper lengths have been rounded off.

L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

TYPICAL USAGE							
MOBILE	MOBILE SHORT SHORT TERM INTERMEDIATE LONG TERM DURATION STATIONARY TERM STATIONARY STATIONARY						
	1	1					

GENERAL NOTES

1. Flags attached to signs where shown are REQUIRED.

- 2. All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer. 3. The CW20-1D "ROAD WORK AHEAD" sign may be repeated if the
- visibility of the work zone is less than 1500 feet. 4. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
- 5. Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect wider work spaces.


TCP (1-4a)

6. If this TCP is used for a left lane closure, CW20-5TL "LEFT LANE CLOSED" signs shall be used and channelizing devices shall be placed on the centerline where needed to protect the work space from opposing traffic with the arrow panel placed in the closed lane near the end of the merging taper.

TCP (1-4b)

7. Where traffic is directed over a yellow centerline, channelizing devices which separate two-way traffic should be spaced on tapers at 20' or 15' if posted speeds are 35 mph or slower, and for tangent sections, at 1/2S where S is the speed in mph. This tighter device spacing is intended for the areas of conflicting markings, not the entire work zone.

Traffic Operations Division Standard						
TRAFFIC CONTROL PLAN LANE CLOSURES ON MULTILANE CONVENTIONAL ROADS TCP (1-4)-18						
FILE: tcp1-4-18.dgn	DN:		ск:	DW:	CK:	
	DN: CONT	SECT	CK: JOB	DW:	CK: HIGHWAY	
FILE: tcp1-4-18.dgn CTXDOT December 1985 REVISIONS		SECT 01		DW:		
FILE: tcp1-4-18.dgn CTxDOT December 1985	CONT		JOB	DW:	HIGHWAY	

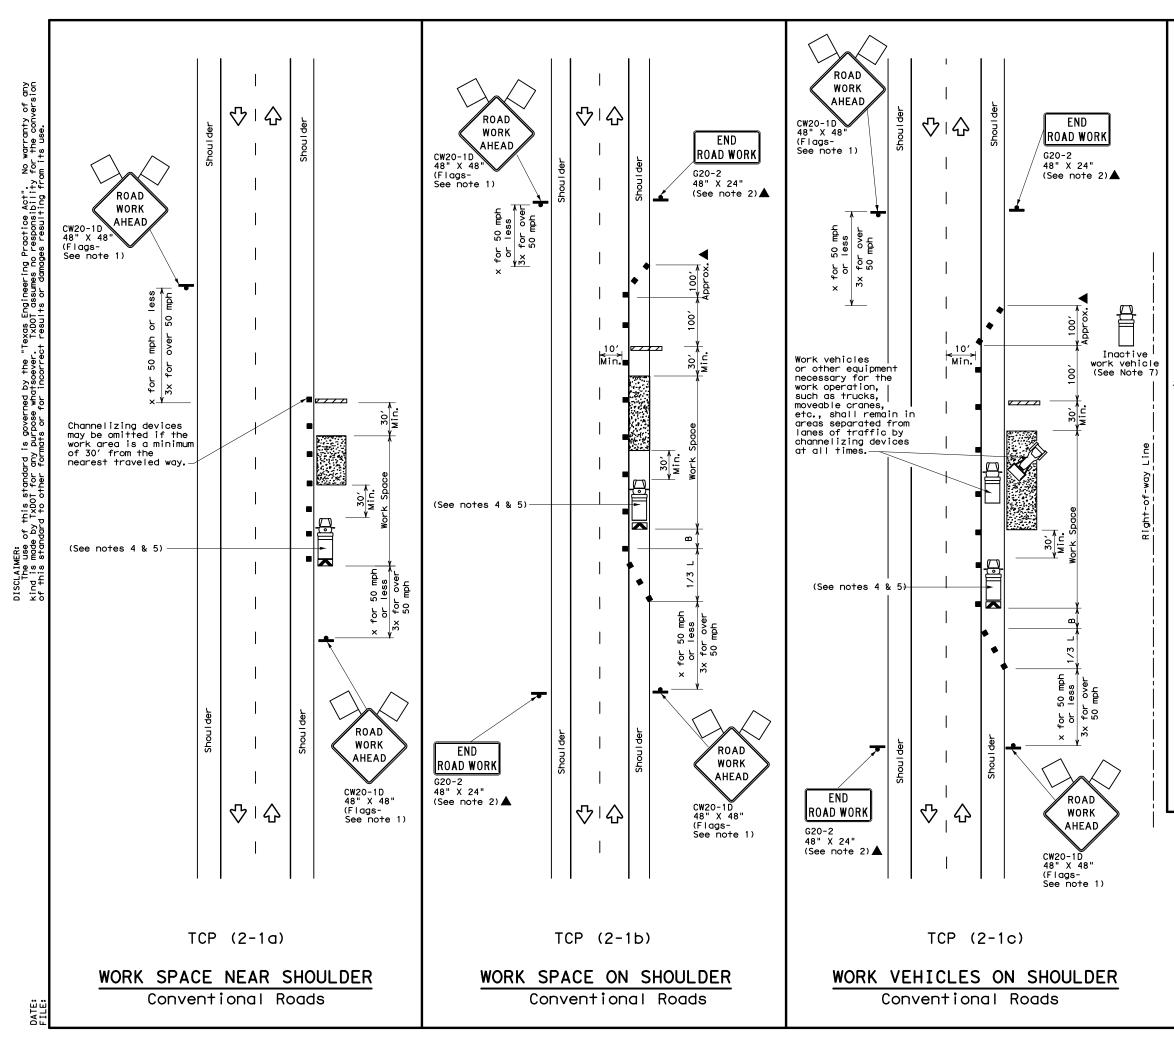

LEGEND						
<u>~~~~</u>	Type 3 Barricade		Channelizing Devices			
₿	Heavy Work Vehicle	X	Truck Mounted Attenuator (TMA)			
(U)	Trailer Mounted Flashing Arrow Board	M	Portable Changeable Message Sign (PCMS)			
•	Sign	2	Traffic Flow			
\bigtriangleup	Flag	ЦO	Flagger			

Posted Speed	Formula	Minimum Desirable Taper Lengths X X			Špacir Channe		Minimum Sign Spacing "X"	Suggested Longitudinal Buffer Space
*		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent	Distance	"B"
30	<u>ws²</u>	150′	1651	180′	30′	60′	120′	90′
35	$L = \frac{WS}{60}$	205′	225′	245'	35′	70′	160′	120′
40	60	265′	295′	320′	40′	80′	240′	155′
45		450′	495′	540′	45′	90′	320′	195′
50		500'	550'	600′	50 <i>'</i>	100′	400′	240′
55	L=WS	550'	605′	660′	55′	110′	500'	295′
60	L-#3	600′	660′	720′	60′	120′	600′	350′
65		650′	715′	780′	65′	130′	700′	410′
70		700′	770′	840'	70′	140′	800′	475′
75		750′	825′	900′	75′	150′	900′	540′

* Conventional Roads Only


XX Taper lengths have been rounded off.


L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

TYPICAL USAGE					
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY	
	1	1	1	 ✓ 	

GENERAL NOTES

- 1. Flags attached to signs where shown, are REQUIRED.
- 2. All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated in the plans, or for routine maintenance work, when approved by the Engineer. 3. Stockpiled material should be placed a minimum of 30 feet from
- a. Shadow Vehicle with TMA and high intensity rotating, flashing, oscillating or strobe lights. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.
- 5. Additional Shadow Vehicles with TMAs may be positioned off the paved surface, next to those shown in order to protect a wider work space. 6. See TCP(5-1) for shoulder work on divided highways, expressways and
- freeways. 7. Inactive work vehicles or other equipment should be parked near the
- right-of-way line and not parked on the paved shoulder. 8. CW21-5 "SHOULDER WORK" signs may be used in place of CW20-1D
- "ROAD WORK AHEAD" signs for shoulder work on conventional roadways.

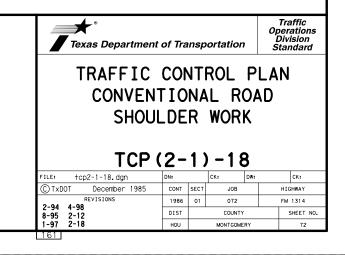

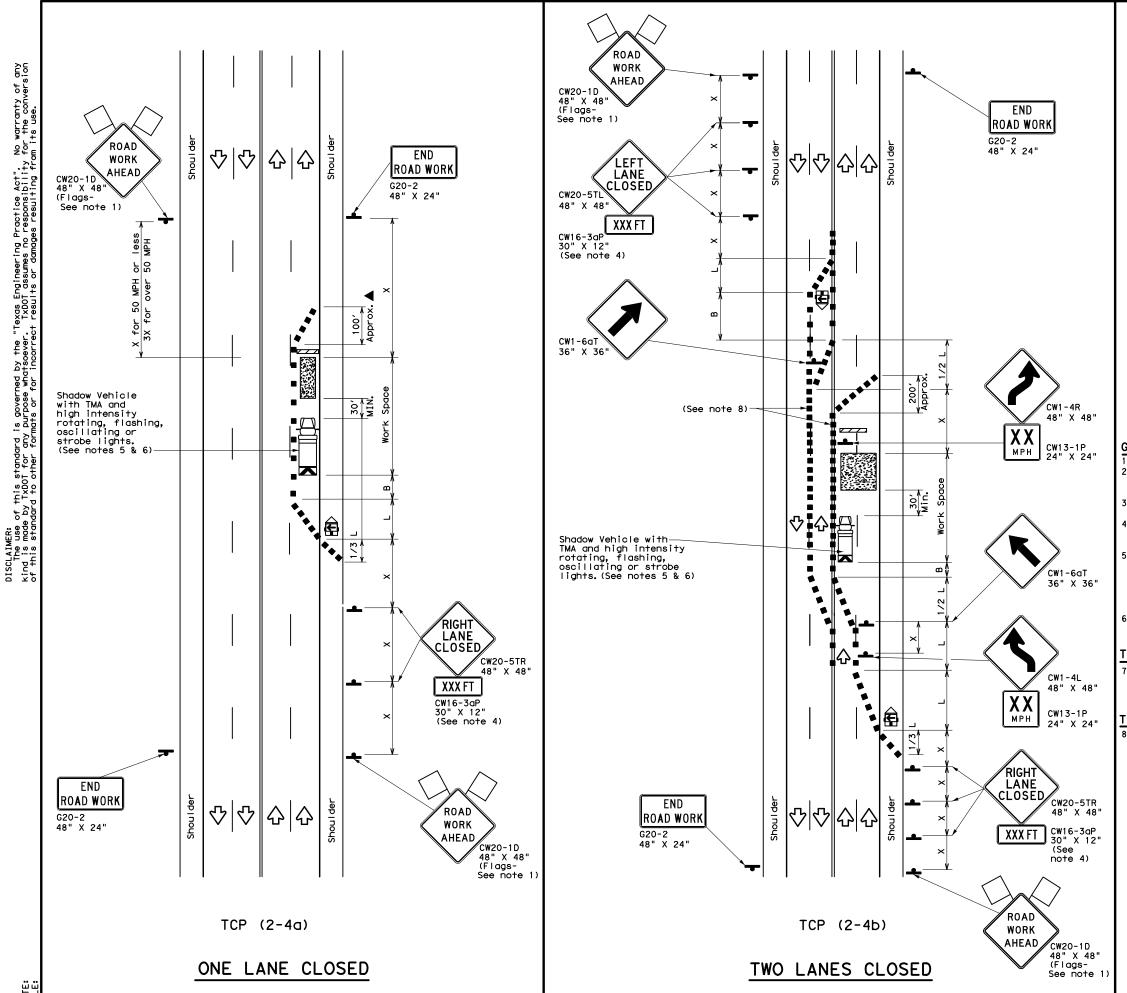

				LEGEND									
			T١	ype 3 Barricade						Channelizing Devices			
		臣	He	eavy Work Vehicle				K		Truck Mounted Attenuator (TMA)			
		Ð		ailer ashin			ŗd	<		Portable Changeable Message Sign (PCMS)			
		┻	si	gn				2		Traff	ic Flow		
	<	$\widehat{\boldsymbol{\lambda}}$	F	lag				Lo)	Flagge	er		
Post Spee		Formu	Ia	D	Minimum esirab er Leng X X	le		gested Spacir Channel Dev	ng I i :	zing	Minimum Sign Spacing "X"	Suggested Longitudinal Buffer Space	
×				10' Offset	11' Offset	12' Offset)n a aper	т	On a Distance		"B"	
30)	L= <u>W</u>	_2	150′	165′	180′		30′		60′	120′	90′	
35	5	$L = \frac{W_s}{C}$	5	205′	225′	245′		35′		70′	160′	120	'
40)	0	,	265′	295′	320'		40′		80′	240′	155	'
45				450′	495′	540′		45′		90′	320′	195	'
50)			500′	550′	600′		50′		100′	400′	240	<i>'</i>
55		L=W:	\$	550'	605′	660′		55′		110′	500′	295	'
60)	L=WS		600′	660′	720′		60′		120′	600′	350	'
65	5			650′	715′	780′		65′		130′	700′	410	'
70)			700′	770'	840′		70′		140′	800′	475	'
75	5			750′	825′	900′		75′		150′	900′	540	·

X Conventional Roads Only

XX Taper lengths have been rounded off.

L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

TYPICAL USAGE					
MOBILE	SHORT DURATION	SHORT TERM STATIONARY	INTERMEDIATE TERM STATIONARY	LONG TERM STATIONARY	
		1	1		

GENERAL NOTES

 Flags attached to signs where shown, are REQUIRED.
 All traffic control devices illustrated are REQUIRED, except those denoted with the triangle symbol may be omitted when stated elsewhere in the plans, or for routine maintenance work, when approved by the Engineer.

3. The downstream taper is optional. When used, it should be 100 feet minimum length per lane.

4. For short term applications, when post mounted signs are not used, the distance legend may be shown on the sign face rather than on a CW16-3aP supplemental plaque.

5. A Shadow Vehicle with a TMA should be used anytime it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the performance or quality of the work. If workers are no longer present but road or work conditions require the traffic control to remain in place, Type 3 Barricades or other channelizing devices may be substituted for the Shadow Vehicle and TMA.

6. Additional Shadow Vehicles with TMAs may be positioned in each closed lane, on the shoulder or off the paved surface, next to those shown in order to protect a wider work space.


TCP (2-4a)

7. If this TCP is used for a left lane closure, CW20-5TL "LEFT LANE CLOSED" signs shall be used and channelizing devices shall be placed on the centerline to protect the work space from opposing traffic with the arrow board placed in the closed lane near the end of the merging taper.

TCP (2-4b)

8. For shorter durations where traffic is directed over a yellow centerline, channelizing devices which separate two-way traffic should be spaced on tapers at 20' or 15' if posted speeds are 35 mph or slower, and for tangent sections, at 1/2(S) where S is the speed in mph. This tighter devices spacing is intended for the area of conflicting markings, not the entire work zone.

Traffic Operations Division Standard							
TRAFFIC CONTROL PLAN							
LANE CLOSUR	RES	0	N ML	۳.	TILANE		
CONVENTIONAL ROADS							
		•••					
			4) - 1				
					Ск:		
TCP	2)		1) - 1	8			
TCP FILE: tcp2-4-18.dgn ©TxDOT December 1985 REVISIONS	P (2	- 4	1) – 1 □ ^{ck} :	8	Ск:		
TCP FILE: tcp2-4-18.dgn © TxDOT December 1985	DN: CONT	- Z	1) — 1 ск: јов	8	CK: HIGHWAY		
TCP FILE: tcp2-4-18.dgn © TxDOT December 1985 8-95 3-03 REVISIONS	DN: CONT 1986	- Z	1) — 1 ск: 	DW:	CK: HIGHWAY FM 1314		

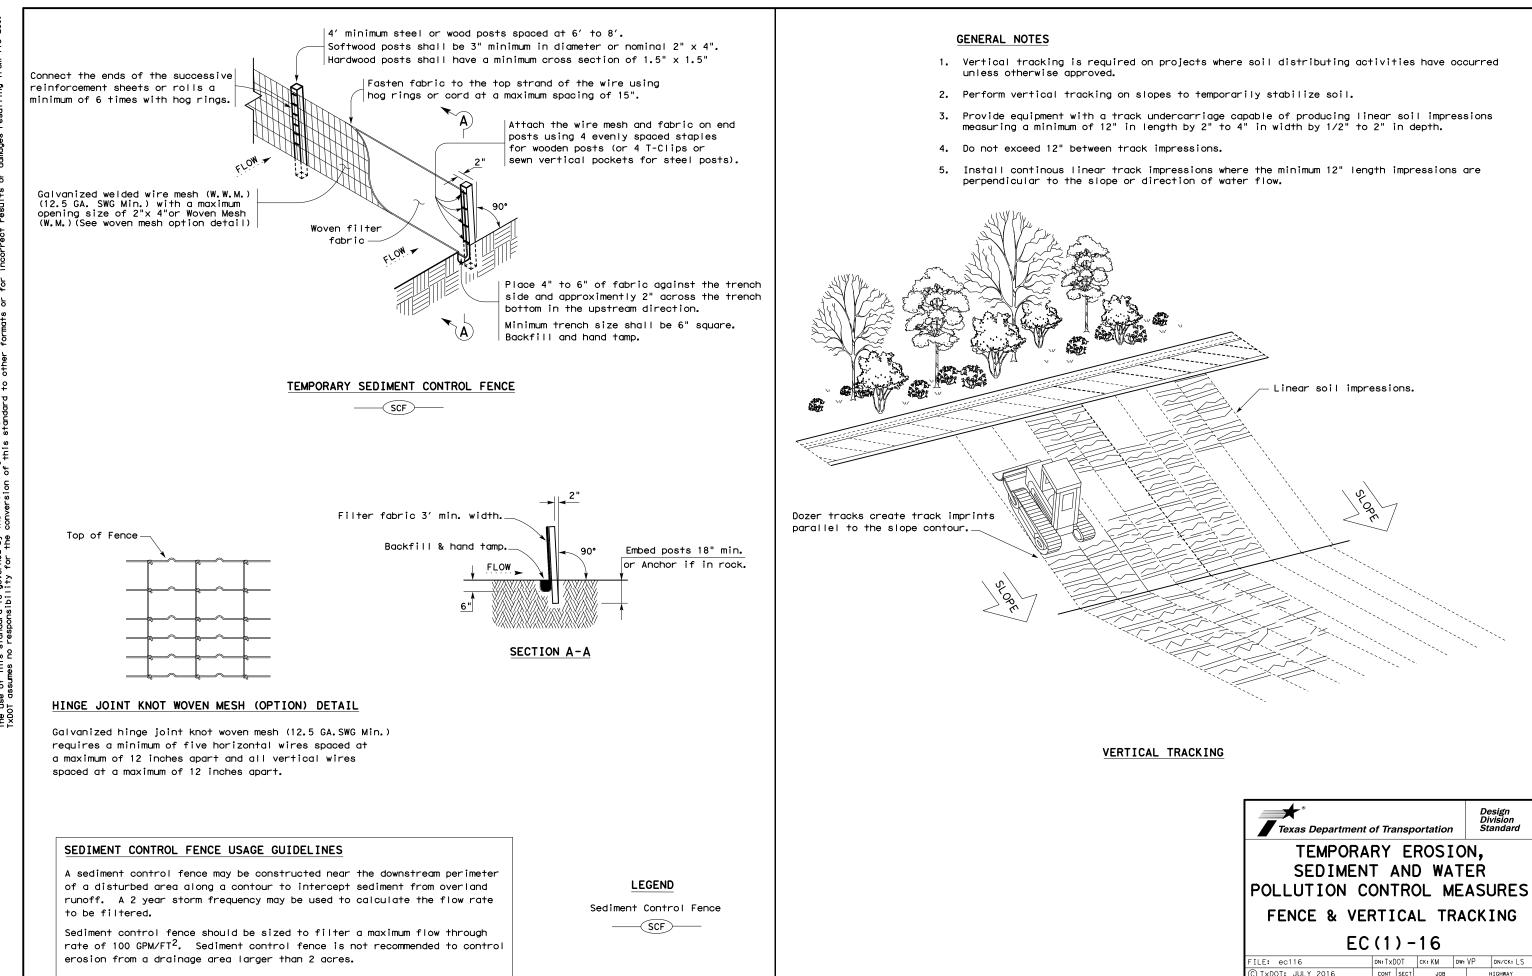

DATE

Texas Department of Transportation							
TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES							
FENCE & VEF	RLI	CA	LTR	RA	СК	ING	
EC	(1) –	16				
FILE: ec116	DN: TXE	TO	ск: КМ	DW:	VP	DN/CK: LS	
© TxDOT: JULY 2016	CONT	SECT	JOB			HIGHWAY	
REVISIONS	1986 01 072					FM 1314	
	DIST		COUNTY			SHEET NO.	
	HOU		MONTGOMER	ł۲		74	

I. STORMWATER POLLUTION PREVENTION	III. CULTURAL RESOURCES	VI. HAZARDOUS
Texas Pollutant Discharge Elimination System (TPDES) TXR 150000: Stormwater Discharge Permit or Construction General Permit is required for projects with 1 or more acres disturbed soil. Projects with any disturbed soil must protect for erosion and sedimentation in accordance with Item 506. Refer to the TxDOT SWP3 Summary Sheets, SWP3 Binder Template, and Form 2118. No Additional Comments	Refer to TxDOT Standard Specifications in the event historical issues or archeological artifacts are found during construction. Upon discovery of archeological artifacts (bones, burnt rock, flint, pottery, etc.) cease work in the area and contact the Engineer immediately. No Additional Comments	Refer to TxDOT Star observed, such as dea leaching or seepage of area and contact the I No Add
II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS	IV. VEGETATION RESOURCES Preserve native vegetation to the extent practical. Refer to TxDOT Standard Specifications in order to comply with requirements for invasive species, beneficial	-
United States Army Corps of Engineers (USACE) Permit is required for filling, dredging, excavating or other work in water bodies, rivers, creeks, streams, wetlands or wet areas. The Contractor must adhere to all of the terms and general conditions associated with the following permit(s). If additional work not represented in the plans is required, contact the Engineer immediately.	landscaping and tree/brush removal. No Additional Comments	VII. OTHER ENVI
No United States Army Corps (USACE) Permit Required		Comments.
Work is authorized by the United States Army Corps of Engineers (USACE) under a Nationwide Permit (NWP) without a Pre-Construction Notification (PCN). Project specific permit was not issued by USACE, therefore is not in the plan set. The USACE general conditions are in the "General Notes."		
Work is authorized by the United States Army Corps of Engineers (USACE) under a Nationwide Permit (NWP) with a Pre-Construction Notification (PCN). The project specific permit issued by the United States Army Corps of Engineers (USACE) is included in the plan set. The USACE general conditions are in the "General Notes."	V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRDS If any of the listed species below are observed, cease work in the area, do not disturb	-
Work is authorized by the United States Army Corps of Engineers (USACE) under a Individual Permit (IP). The project specific permit issued by the United States Army Corps of Engineers (USACE) is included in the plan set.	The work may not remove active nests (from bridges, structures, or vegetation adjacent to the roadway, etc.) during nesting season (February 15 to October 1). If removal of	
Work would be authorized by the United States Army Corps of Engineers (USACE) permit. The project specific permit issued by the USACE will be provided to the contractor.	structures or vegetation is necessary during the nesting season, the Contractor shall conduct a bird survey no more than 3 days in advance of the clearing/demolish start date. All bird surveys shall be conducted by a Field Biologist and adhere to the guidance document "Avoiding Migratory Birds and Handling Potential Violations"	
United States Coast Guard (USCG) Permit is required for projects that involve the construction or modification (including changes to lighting) of a bridge or causeway across a water body determined to be navigable by the United States Coast Guard (USCG) under Section 9 of the Rivers and Harbors Act. If additional work not represented in the plans is required, contact the Engineer immediately.	found in the TxDOT Environmental Compliance Toolkits at the time of the survey. (See below for Field Biologist and Ornithologist qualifications) No Additional Comments	
No United States Coast Guard (USCG) Coordination Required		
United States Coast Guard (USCG) Permit		
United States Coast Guard (USCG) Exemption		
No Additional Comments		
	Field Biologist, Ornithologist – a field biologist is defined as an individual qualified to perform field investigations, presence/absence surveys and habitat surveys for protected avian species or species of concern. A mandatory bachelor's degree in biology or a related science is required. At a minimum, the Field Biologist, Ornithologist, shall have completed and reported a minimum of three presence/absence and habitat surveys for protected avian species in the past five years. A minimum of three projects must have been conducted in Texas. Surveys shall have been performed for documentation of species in accordance with a protocol approved by USFWS or TPWD, or following generally accepted methodologies.	

May 20, 2024


DATE: 1

MATERIALS OR CONTAMINATION ISSUES

ndard Specifications in the event potentially contaminated materials are ead or distressed vegetation, trash disposal areas, drums, canisters, barrels, of substances, unusual smells or odors, or stained soil, cease work in the Engineer immediately.

litional Comments

IRONMENTAL ISSUES

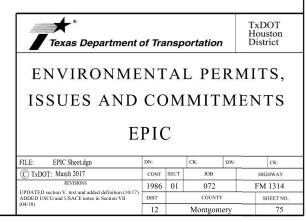

STORMWATER POLLUTION PRVENTION PLAN (SWP3):

This SWP3 has been developed in accordance with TxDOT policy for projects disturbing less than 1 acre of soil, and not part of a larger common plan of development.

For projects with less than one acre of soil disturbing activity and that have Environmental, Permits, Issues, and Commitments (EPICs) dependent on stormwater controls and water quality measures TxDOT will maintain a SWP3 with all pertinent records, correspondence, environmental documents, etc. at the project field office, Area Office, or electronically.

This SWP3 is consistent with requirements specified in applicable stormwater plans, and the project's environmental permits, issues, and commitments (EPICs).

1.0 SITE/PROJECT DESCRIPTION

1.1 PROJECT CONTROL SECTION JOB (CSJ): 1986-01-072

1.2 PROJECT LIMITS:

OLD	HOU	STON	RD
-----	-----	------	----

LP 494

1.3 PROJECT COORDINATES:

BEGIN:30.170654,-95.319564END:30.102338,-95.229763

1.4 TOTAL PROJECT AREA (Acres): N/A

1.5 TOTAL AREA TO BE DISTURBED (Acres): N/A

1.6 NATURE OF CONSTRUCTION ACTIVITY:

INSTALLATION OF FIBER OPTIC CABLE FOR TRAFFIC SIGNAL INTERCONNECT

1.7 MAJOR SOIL TYPES:

Soil Type	Description
Sorter-Tarkington complex, 0 to 1% slopes	100% very fine sandy loam, poorly drained, high rate of runoff, no erosion potential- deposition
Sorter-Urban land complex, 0 to 1% slopes	100% very fine sandy loam, poorly drained, high rate of runoff, no erosion potential- deposition
Waller silt loam, 0 to 1% slopes	100% silt loam, poorly drained, high rate of runoff, no erosion potential-deposition
Waller-Urban land complex, 0 to 1% slopes	100% silt loam, poorly drained, high rate of runoff, no erosion potential-deposition
Splendora fine sandy loam, 0 to 2% slopes	50% fine sandy loam/50% loam, poorly drained, high rate of runoff, no erosion potential-deposition
Splendora-Urban land complex, 0 to 2% slopes	50% fine sandy loam/50% loam, somewhat poorly drained, high rate of runoff, slight erosion potential
Segno fine sandy loam, 1 to 3 % slopes	11% fine sandy loam, 36% very fine sandy loam, 42% sandy clay loam, 11% loam, well drained, moderate rate of runoff, slight erosion potential
Segno-Urban land complex, 1 to 3% slopes	11% fine sandy loam, 36% very fine sandy loam, 42% sandy clay loam, 11% loam, well drained, moderate rate of runoff, slight erosion potential
Urban land	100% urban, very high rate of runoff, slight erosion potential

1.8 PROJECT SPECIFIC LOCATIONS (PSLs): N/A

PSLs must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. PSLs may be identified during preconstruction meetings or during the construction process. Please choose from the options below:

- PSLs determined during preconstruction meeting
- PSLs determined during construction
- $\hfill\square$ No PSLs planned for construction

Туре	Sheet #s

All off-ROW PSLs required by the Contractor are the Contractor's responsibility. The Contractor shall secure all permits required by local, state, federal laws for off-ROW PSLs. The contractor shall provide diagrams, areas of disturbance, acreage, and BMPs for all off-ROW PSLs within one mile of the project.

1.9 CONSTRUCTION ACTIVITIES:

Use the following list as a starting point when developing the
Construction Activity Schedule and Ceasing Record in
Attachment 2.3.)
Mobilization
Install sediment and erosion controls
Blade existing topsoil into windrows, prep ROW, clear and grub
Remove existing pavement
Grading operations, excavation, and embankment
Excavate and prepare subgrade for proposed pavement widening
Remove existing culverts, safety end treatments (SETs)
Remove existing metal beam guard fence (MBGF), bridge rail
Install proposed pavement per plans
Install culverts, culvert extensions, SETs
Install mow strip, MBGF, bridge rail
Place flex base
Rework slopes, grade ditches
Blade windrowed material back across slopes
Revegetation of unpaved areas
Achieve site stabilization and remove sediment and
erosion control measures
Other:
Other:

Other:

1.10 POTENTIAL POLLUTANTS AND SOURCES: N/A

- Sediment laden stormwater from stormwater conveyance over disturbed area
- Fuels, oils, and lubricants from construction vehicles, equipment, and storage
- Solvents, paints, adhesives, etc. from various construction activities
- □ Transported soils from offsite vehicle tracking
- Construction debris and waste from various construction activities
- Contaminated water from excavation or dewatering pump-out water

- □ Sanitary waste from onsite restroom facilities
- □ Trash from various construction activities/receptacles
- Long-term stockpiles of material and waste
- Discharges from concrete washout activities, runoff from concrete cutting activities, and other concrete related activities

Other:

□ Other: _____

r's 🛛 Other:

1.11 RECEIVING WATERS:

Receiving waters must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. Include Segment # for receiving waters.

Tributaries	Classified Waterbody				
Copeland Ditch, White Oak Creek	*Caney Creek (1010); Impaired for bacteria				
TMDL/I-Plan Project: Houston-Galveston Region BIG					
* Add (*) for impaired waterbodies with pollutant in ().					

1.12 ROLES AND RESPONSIBILITIES: TxDOT

X Development of plans and specifications

- ☑ Perform SWP3 inspections
- ${\tt X}$ Maintain SWP3 records and update to reflect daily operations
- Other:_____

□ Other:_____

1.13 ROLES AND RESPONSIBILITIES: CONTRACTOR

X Day To Day Operational Control

- X Maintain schedule of major construction activities
- X Install, maintain and modify BMPs

Other:

□ Other:_____



ROMA G. STEVENS , P.E.

6/26/2024

STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre)



Sheet 1 of 2

Texas Department of Transportation

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.	
6		SEE TITLE SHEET			76
STATE		STATE DIST.	COUNTY		
TEXAS		HOU	MONTGOMERY		
CONT.		SECT.	JOB	HIGHWAY NO.	
1986		Ø1	Ø72	FM 1314	

2.0 BEST MANAGEMENT PRACTICES (BMPs)	2.3 PERMANENT CONTRO					
AND CONTROLS, INSPECTION, AND	(Coordinate post-construction	n BMPs with approp				
MAINTENANCE	maintenance sections.) BMPs To Be Left In Place Post Construction:			2.5 POLLUTION PREVENTION MEASURES: Chemical Management		
The Contractor shall be the responsible party for implementing	Type Stationing To			Concrete and Materials Waste Management		
the BMPs described herein and for complying with the SWP3		FIOIII	10	☑ X Debris and Trash Management	ent	
for control of erosion and sedimentation during day-to-day						
operations. The Contractor shall implement changes to this				□ Sanitary Facilities		
SWP3 approved by TxDOT within the times specified in this SWP3 or the CGP.				□ Other:		
				□ Other:		
2.1 EROSION CONTROL AND SOIL STABILIZATION BMPs: N/A						
T/P				□ Other:		
Protection of Existing Vegetation				□ Other:		
Vegetated Buffer Zones				· · · · · · · · · · · · · · · · · · ·		
□ Soil Retention Blankets						
Geotextiles						
 Mulching/ Hydromulching Soil Surface Treatments 						
Soil Surace Treatments Temporary Seeding						
 Permanent Planting, Sodding or Seeding 	Refer to the Environmental L	ayout Sheets/ SWF	3 Layout Sheets			
 Biodegradable Erosion Control Logs 	located in Attachment 1.2 of					
 Biologituduble Elosion Control Elogit Rock Filter Dams/ Rock Check Dams 				2.6 VEGETATED BUFFER ZONES: N/A		
Vertical Tracking				Natural vegetated buffers shall	be maintained as fe	asible to
□ □ Interceptor Swale				protect adjacent surface waters	-	
□ □ Riprap				zones are not feasible due to s		
Diversion Dike				additional sediment control me	asures have been in	corporated
Temporary Pipe Slope Drain	2.4 OFFSITE VEHICLE TR			into this SWP3.		
 Embankment for Erosion Control Paved Flumes 			0L3. N/A	Туре	Stati	oning
Other:	 Excess dirt/mud on road removed daily Haul roads dampened for dust control 			Туре	From	То
			• .			
□ □ Other:	□ I oaded haul trucks to be c	overed with tarnau	in			
□ □ Other:	□ Loaded haul trucks to be c		In			
Other: Other:	 Loaded haul trucks to be c Stabilized construction exi Daily street sweeping 		IN			
Other:	□ Stabilized construction exi	t				
Other:	 Stabilized construction exi Daily street sweeping Other:	t				
Other:	 Stabilized construction exi Daily street sweeping Other:	t				
 Other:	 Stabilized construction exi Daily street sweeping Other:	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t		Refer to the Environmental Law	vout Sheets/ SWP3 I	avout Sheet
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t		Refer to the Environmental Lay located in Attachment 1.2 of thi		.ayout Sheet
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				.ayout Sheet
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				.ayout Sheet
 Other:	 Stabilized construction exi Daily street sweeping Other: Other: Other: Other: 	t				.ayout Sheet

located in Attachment 1.2 of this SWP3

2.7 ALLOWABLE NON-STORMWATER DISCHARGES:

- ☑ Fire hydrant flushings
- Irrigation drainage
- R Pavement washwater (where spills or leaks have not occurred, and detergents are not used)
- Potable water sources
- 🛛 Springs
- X Uncontaminated groundwater
- $\ensuremath{\mathbbmm{X}}$ Water used to wash vehicles or control dust
- ☑ Other allowable non-stormwater discharges as allowed by TPDES GP TXR150000.

2.8 DEWATERING:

Dewatering discharges of accumulated stormwater, groundwater, and surface water including discharges from dewatering of trenches, excavations, foundations, vaults, and other points of accumulation are prohibited unless managed by appropriate controls to prevent and minimize the offsite discharge of sediment and other pollutants.

2.9 INSPECTIONS:

All disturbed areas and erosion and sediment control devices shall be inspected at least once every seven (7) days. Inspections shall be performed by TxDOT as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.3 of this SWP3 .

2.10 MAINTENANCE:

Control measures shall be properly installed according to specifications. If it is determined that a BMP or control measure is not operating effectively, maintenance must be accomplished as soon as possible and before the next anticipated rain event, but in no case later than 7 calendar days after being able to access the site. Maintenance shall be performed by the Contractor as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.3 of this SWP3.



Koma Stevens ROMA G. STEVENS , P.E.

6/26/2024

STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre)



Sheet 2 of 2

Texas Department of Transportation

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.	
6	SEE TITLE SHEET			77	
STATE STATE DIST.			COUNTY		
TEXAS		HOU	MONTGOMERY		
CONT.		SECT.	JOB	HIGHWAY NO.	
1986		Ø1	Ø72	FM 1314	