

FEDERAL AID PROJECT NO.			
F 2025 (247)			
CONT	SECT	JOB	HIGHWAY
0164	03	056	SH 31
DIST	COUNTY		SHEET NO.
TYL	HENDERSON		1

INDEX OF SHEETS

SHEET NO.	DESCRIPTION
1	TITLE SHEET
2	SUPPLEMENTAL INDEX OF SHEETS

**STATE OF TEXAS
DEPARTMENT OF TRANSPORTATION**

**PLANS OF PROPOSED
STATE HIGHWAY IMPROVEMENT**

FEDERAL AID PROJECT NO. F 2025 (247)
NET LENGTH OF PROJECT = 500 FT. = .095 MI.
HENDERSON COUNTY
SH 31 AT SAWMILL RD.
CSJ: 0164-03-056

DESIGN SPEED:
SH 31 = 45 MPH (MOECC)
MOECC - MEETS OR EXCEEDS
CURRENT CONDITIONS
FUNCTIONAL CLASS: PRINCIPAL ARTERIAL
ADT:
SH 31
EXIST: 22,859
PROP: 32,003

FINAL PLANS


DATE CONTRACT LETTING: _____
DATE CONTRACTOR BEGAN WORK: _____
DATE WORK COMPLETED & ACCEPTED: _____
CONTRACTOR: _____
USED ___ OF ___ ALLOTTED DAYS: _____
FINAL CONTRACT COST: _____

FINAL AS BUILT PLANS

THE CONSTRUCTION WAS PERFORMED UNDER MY SUPERVISION IN ACCORDANCE WITH THE PLANS AND CONTRACT.

DATE AREA ENGINEER

FOR THE CONSTRUCTION OF TRAFFIC CONTROL DEVICES
CONSISTING OF INSTALL TRAFFIC AND PEDESTRIAN SIGNAL

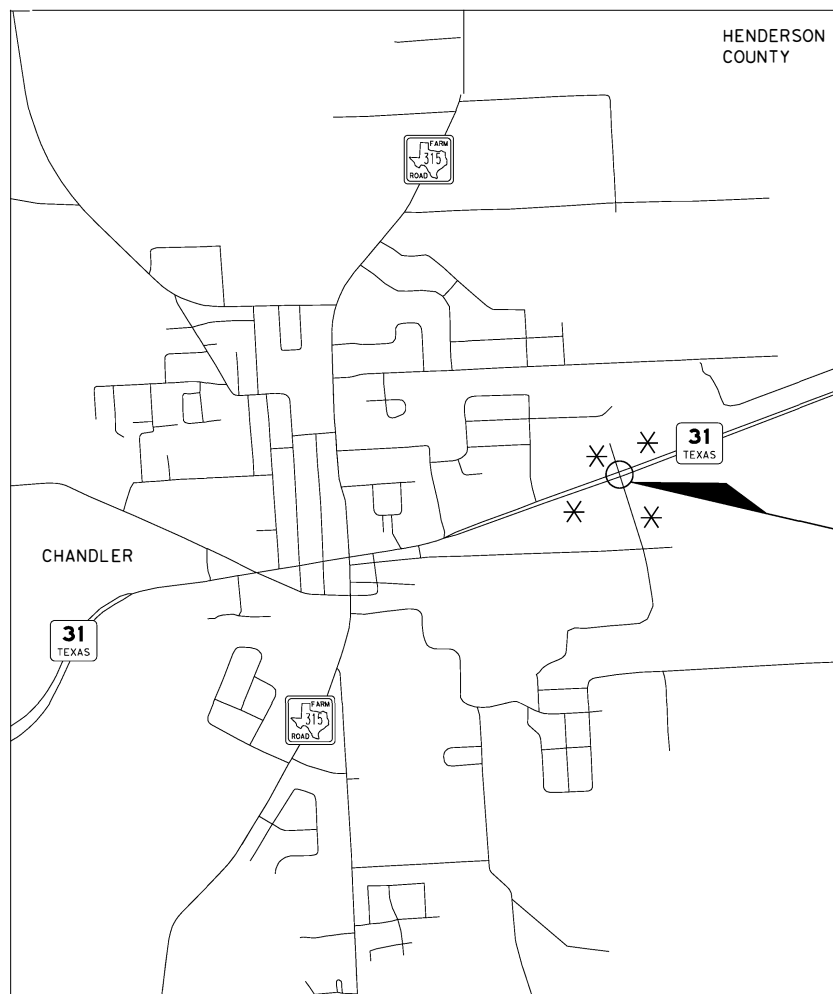

SH 31 AT SAWMILL RD.
CSJ: 0164-03-056
COUNTY: HENDERSON



* SIGNS IN ACCORDANCE WITH THE STANDARD BC SHEETS AND PART 6 OF THE TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.

EXCEPTIONS: NONE
EQUATIONS: NONE
RAILROAD CROSSINGS: NONE

© 2024 by Texas Department of Transportation; all rights reserved.

10/3/2024
RECOMMENDED FOR LETTING: _____

DocuSigned by:
Guanita Daniels-West
0087CB09B758434

DIRECTOR OF TRANSPORTATION OPERATIONS
10/4/2024

10/4/2024
SUBMITTED FOR LETTING: _____

DocuSigned by:
Rolando Mendez
8E5FE128DB7C484

DISTRICT DESIGN ENGINEER

APPROVED FOR LETTING: _____

DocuSigned by:
Vanessa M. Hill
6149184A8C65461

DISTRICT ENGINEER

SPECIFICATIONS ADOPTED BY THE TEXAS DEPARTMENT OF TRANSPORTATION, SEPTEMBER 1, 2024 AND SPECIFICATION ITEMS LISTED AND DATED AS FOLLOWS, SHALL GOVERN ON THIS PROJECT: REQUIRED CONTRACT PROVISIONS FOR ALL FEDERAL-AID CONSTRUCTION CONTRACTS (FORM FHWA 1273, OCTOBER 23, 2023)

DATE: 7/17/2023 6:47:09 AM FILE: c:\users\timel\appdata\local\bentley\project\wse\working\wpm-pw.bentley.com_wpm-pw-01\viewing@walterpmoore.com\dms47244\03-18032-03-SH 31_Sawmill Rd_DT_TTL.dgn

GENERAL

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
1	TITLE SHEET
2	SUPPLEMENTAL INDEX OF SHEETS
3, 3A-3E	GENERAL NOTES
4, 4A	ESTIMATE & QUANTITY SHEET
5 - 6	SUMMARY OF QUANTITIES

TRAFFIC CONTROL PLAN

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
7	CONSTRUCTION SEQUENCE
8	PROJECT TRAFFIC CONTROL NOTES

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
9 - 20	* BC(1)-21 TO BC(12)-21
21 - 22	* WZ(BTS)-13
23	* TCP(2-4)-18

TRAFFIC ITEMS


<u>SHEET NO.</u>	<u>DESCRIPTION</u>
24	EXISTING CONDITIONS
25	REMOVAL LAYOUT
26	RAMP LAYOUT
27	TRAFFIC SIGNAL LAYOUT
28	PROPOSED SIGNAL ELEVATION VIEWS
29 - 31	PROPOSED SIGNAL SUMMARIES
32	PROPOSED PAVEMENT MARKINGS LAYOUT
33	PEDESTRIAN SIGNAL AND DETECTOR INSTALLATION DETAILS

<u>SHEET NO.</u>	<u>STANDARDS</u>
34 - 45	* ED(1)-14 TO ED(12)-14
46 - 47	* SMA-80(1)-12 TO SMA-80(2)-12
48	* MA-C-12
49	* MA-D-12
50	* MA-DPD-20
51	* TS-BP-20
52	* TS-CF-21
53	* TS-FD-12
54	* WV & IZ-14
55	* CCCG-22
56 - 59	* PED-18
60 - 61	* TSR(3)-13 TO TSR(4)-13
62 - 65	* PM(1)-22 TO PM(3)-22, PM(4)-22A (MOD)

ENVIRONMENTAL ISSUES

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
66 - 67	* STORM WATER POLLUTION PREVENTION PLAN (SW3P)
68	* ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS - EPIC

<u>SHEET NO.</u>	<u>DESCRIPTION</u>
69 - 71	* EC(9)-16



THE STANDARD SHEETS SPECIFICALLY IDENTIFIED ABOVE BY A *
HAVE BEEN ISSUED BY ME AND ARE APPLICABLE TO THIS PROJECT.

J. Diaz P. E. 10/04/2024
DATE

NO.	DATE	REVISION	APPROV.



walter p moore
Walter P Moore and Associates, Inc.
1301 McKinney, Suite 1100
Houston, Texas 77010
Texas Firm Registration No. 1856

**SH 31 AT SAWMILL RD.
SUPPLEMENTAL INDEX OF SHEETS**

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.		
CK DN:	6	TX	SEE TITLE SHEET	SH 31		
DW:	STATE DIST.	COUNTY	CONTR. NO.	SECTION NO.	JOB NO.	SHEET NO.
CK DW:	TYL	HENDERSON	0164	03	056	2

SDATES SFILES

Project Number:

Sheet 3

County: Henderson

Control: 0164-03-056

Highway: SH 31

GENERAL NOTES:

GENERAL.

Contractor questions on this project are to be addressed to the following individuals:

Juanita Daniels-West

Juanita.DanielsWest@txdot.gov

Steven Swindell

Steven.Swindell@txdot.gov

For Q&A on Proposals navigate to:

<https://tableau.txdot.gov/views/ProjectInformationDashboard/NoticetoContractors>

Use the dashboard to navigate to the project you are interested in by scrolling or filtering the dashboard using the controls on the left. Hover over the blue hyperlink for the project and click on the link in the window that pops up to view the Q&A.

All relevant project documentation including Contract Time Determinations and cross-sections will still be posted to the districts FTP website.

<https://ftp.dot.state.tx.us/pub/txdot-info/Pre-Letting%20Responses/Tyler%20District/Construction%20Projects>

For this Contract, the following standard sheets have been modified:

PM(4)-22A (MOD)

ITEM 4. SCOPE OF WORK

Preserve the integrity of all right of way monuments within project limits. Right of way monuments damaged or destroyed during construction must be replaced by a registered professional land surveyor (RPLS), at the Contractor's expense.

Project Number:

Sheet 3

County: Henderson

Control: 0164-03-056

Highway: SH 31

ITEM 5. CONTROL OF THE WORK

If utility lines need adjustments during construction operations, modify operations and continue the work in a manner that will allow others to make the utility adjustments. Additional working time may be allowed for delays caused by these utility adjustments.

Place and maintain construction hubs near the right of way line in accordance with Article 5.9., "Construction Surveying" on both sides of the roadway until the final item of work is complete.

Utility locations shown on the plans are approximate. Contact utilities in accordance with Article 5.6., "Cooperating With Utilities."

Prior to beginning driveway and intersection work, submit a detailed construction sequence to be approved by the Engineer. Driveway and intersection completion includes existing surface removal, structure removal, removal of debris from the project site, installing the new RCP and SETs, backfilling, grading ditches to drain, and installing the permanent driveway or intersection surface (or all-weather drive surface as allowed).

ITEM 6. CONTROL OF MATERIALS

The Buy America Material Classification Sheet for clarification on material categorization is located at the link below:

<https://www.txdot.gov/business/resources/materials/buy-america-material-classification-sheet.html>

ITEM 7. LEGAL RELATIONS AND RESPONSIBILITIES

Do not initiate activities in a project specific location (PSL) associated with a U.S. Army Corps of Engineers (COE) permit area that has not been previously evaluated by the COE as part of the permit review of this project. Such activities include haul roads, equipment staging areas, borrow pits, and disposal sites. "Associated," defined here, means "materials are delivered to or from the PSL." The permit area includes all waters of the U.S. or associated wetlands affected by activities associated with this project. Special restrictions may be required for this work. The Contractor is responsible for all consultations with the COE regarding activities (including PSL) that have not been previously evaluated by the COE. Provide the Department with a copy of all consultations or approvals from the COE before initiating activities.

Proceed with activities in PSL that do not affect a COE permit area if Contractor determines that the PSL is non-jurisdictional or proper COE clearances have been obtained in jurisdictional areas or have been previously evaluated by the COE as part of the permit review of this project. The Contractor is responsible for documenting his determination that his activities do not affect a

COE permit area. Maintain copies of determination for review by the Department or any regulatory agency.

Concrete truck drivers and concrete pump operators are required to wash out only in designated areas specifically constructed for eliminating run-off. Dispose of materials in accordance with federal, state, and local requirements.

Maintain positive drainage for permanent and temporary work for the duration of the project. The Contractor will be responsible for any items associated with the temporary or interim drainage and all related maintenance. This work will be subsidiary to various bid items. The total disturbed area for this project is 0.02 acres. The disturbed area in this project and the Contractor Project Specific Locations (PSL's) within 1 mile of the project limits for the Contract will further establish the authorization requirements for storm water discharges. The Department will obtain an authorization to discharge storm water from the Texas Commission on Environmental Quality (TCEQ) for the construction activities shown on the plans. Obtain any required authorization from the TCEQ for any Contractor PSL for construction support activities on or off the ROW. When the total area disturbed for all projects in the Contract and PSLs within 1 mile of the project limits exceed 5 acres, before disturbance, provide a copy of the Contractor NOI for PSLs on the ROW and within 1 mile of the project limits to the Engineer and to any local government that operates a Municipal Separate Storm Sewer System (MSSS).

In accordance with Article 7.9, provide and maintain adequate, neat and sanitary toilet accommodations within the project limits for employees, including State employees.

No significant traffic generator events identified.

ITEM 8. PROSECUTION AND PROGRESS

Special Provision 008-005 (90-day convenience delay) is included in this Contract. This is to allow for the manufacturer's delay in providing the traffic signal poles.

ITEM 9. MEASUREMENT & PAYMENT

In accordance with Article 9.1., "Measurement of Quantities," furnish the tare and maximum gross weights as well as the volume capacity of all vehicles, trucks, truck-tractors, trailers, semi-trailers, or combination of such vehicles used to deliver materials for this Contract. Also, furnish calculations supporting these weights and capacities. Provide all measurements required for pay a minimum of 2 days before the trucks are used.

ITEM 416. DRILLED SHAFT FOUNDATIONS

Hand dressing of soil around the concrete foundations for luminaries will be required as directed. Place the level of soil at a 6:1 slope or flatter, where possible, and extend it from the top of the

concrete foundation to the established grades. This work will not be paid for directly, but will be subsidiary to this Item.

ITEMS 420 & 427. CONCRETE SUBSTRUCTURES & SURFACE FINISHES FOR CONCRETE

Provide the following surface finishes as listed: Surface Area II Rub Finish.

ITEM 421. HYDRAULIC CEMENT CONCRETE

Provide the Engineer with a mixture design report using Department-provided software in accordance with Section 421.4.1., "Classification of Concrete Mix Designs," of the standard specifications. Include in the report the producer's plant, all materials sources, and a unique identification number for the design.

Air is not required on concrete cast-in-place elements on this project. If the Contractor proposes the use of an existing concrete design containing air, the Engineer must approve the design in writing before placement. If used, air testing will be performed in accordance with the specifications.

ITEM 502. BARRICADES, SIGNS, AND TRAFFIC HANDLING

The traffic control plan for this Contract consists of: the installation and maintenance of warning signs and other traffic control devices shown on the plans; specification data, which may be included in the general notes; applicable provisions of the Texas Manual on Uniform Traffic Control Devices (TMUTCD); traffic control plan sheets included on the plans; standard BC sheets; Compliant Work Zone Traffic Control Device List, and Item 502 of the standard specifications.

Use ground-mounted sign mounts with two posts for all temporary work zone signs unless otherwise directed.

Inspect and correct deficiencies each day throughout the duration of the Contract. In accordance with Article 502.4., "Payment," no payment will be made for the month if the Contractor fails to provide or properly maintain signs and devices in compliance with Contract requirements. Temporary warning signs that are visible when conditions do not apply will be considered improper maintenance of signs.

Provide at least one employee on call nights and weekends (or any other time that work is not in progress) for maintenance of signs and traffic control devices. This employee must have an address and telephone number near the project, as approved. Notify the Engineer in writing of the name, address, and telephone number of this employee. The Engineer will furnish this information to local law enforcement officials.

County: Henderson**Control:** 0164-03-056**Highway:** SH 31

In addition to providing a Contractor's Responsible Person and a phone number for emergency contact, have an employee available to respond on the project for emergencies and for taking corrective measures within 30 minutes.

Sign all roads intersecting the project in accordance with current BC standards.

Refer to the traffic control plan sheets for traffic handling through the work area. Contractor may vary the signing arrangement and spacing as necessary to fit field conditions; however, any proposed changes in the traffic control plan must be approved before implementation.

When the sequence of work is shown on the plans, the Contractor may submit an alternate proposal for approval. Submit in writing all proposed variations and revisions.

High-visibility safety apparel is required for workers in accordance with the General Notes on current BC standards.

Place and maintain signs, channelizing devices, and flaggers to direct and route traffic at any location and for any period of time as may be required or directed.

When operations require a lane closure, provide cones, vertical panels, drums, signs, flaggers, and flashing arrow panels as necessary to route traffic around the closed lane as shown on the plans and as directed. Lane closures will be limited to one specific lane as directed.

Lane closures will not be allowed before 8:30 A.M. unless otherwise directed.

Unless otherwise approved, construction operations will not be allowed on Good Friday, Easter weekend, the Friday before Memorial Day thru Memorial Day, July 4th, the Friday before Labor Day thru Labor Day, the Wednesday before Thanksgiving Day thru Sunday, Christmas Eve, Christmas Day, New Year's Eve, New Year's Day, or on any other high traffic days or holidays as determined by the Engineer.

Erect R4-1 (Do Not Pass) and R4-2 (Pass With Care) signs to mark existing no-passing zones as directed. (These signs will not be required if these zones will not be eliminated during construction.)

Maintain existing roadside signs within this project's limits during this Contract. In order to accommodate the grading or other operations, temporarily relocate these signs in accordance with the TMUTCD as directed. Use ground-mounted sign mounts with two posts for all relocated signs unless otherwise directed. This work will not be paid for directly, but will be subsidiary to Item 502.

County: Henderson**Control:** 0164-03-056**Highway:** SH 31

Provide truck-mounted attenuators (TMA) as shown on the appropriate traffic control plan sheets. Provide a letter certifying that all TMA used on this project meet NCHRP 350 or AASHTO Manual for Assessing Safety Hardware (MASH) requirements.

Regulate all construction activities and equipment to minimize inconvenience to the traveling public. At points where it is necessary for trucks to stop, load, or unload, provide warning signs and flaggers to protect the traveling public.

The pavement must be entirely open to traffic each night. Remove or clearly barricade all material stockpiles, equipment left overnight, or any obstruction within the right of way as approved.

The Contractor Force Account "Safety Contingency" is intended to be used for work zone enhancements that could not be foreseen in the project planning and design stage for the purpose of improving the effectiveness of the Traffic Control Plan. These enhancements will be mutually agreed upon by the Engineer and the Contractor's Responsible Person based on weekly or more frequent traffic management reviews on the project. The Engineer may choose to use existing bid items if it does not slow the implementation of enhancement.

All work required by these general notes, except as provided for by Item 502, will not be paid for directly, but will be subsidiary to Item 502 unless otherwise shown on the plans.

ITEM 503. PORTABLE CHANGEABLE MESSAGE SIGN

Provide a non-erodible, stable surface to place the Portable Changeable Message Sign (PCMS) units adjacent to the roadway as directed. Payment for this surface is incidental to Item 503.

Provide a cellular modem connection to communicate with the PCMS remotely.

ITEM 505. TRUCK-MOUNTED ATTENUATOR (TMA) AND TRAILER ATTENUATOR (TA)

Shadow vehicles with truck mounted attenuator (TMA) are required on the traffic control plan and TCP standards for this project. The Contractor will be responsible for determining if one or more of these traffic control operations will be ongoing at the same time to determine the total number of TMAs needed for the project. Additional truck mounted attenuators (TMAs) may be required as deemed necessary by the Engineer.

The TMA/TA used for installation/removal of traffic control for a work area will be subsidiary to the TMA/TA used to perform the work.

ITEM 506. TEMPORARY EROSION, SEDIMENTATION, AND ENVIRONMENTAL CONTROLS

Remove dirt, silt, rocks, debris, and other foreign matter that accumulates in all structures due to project erosion and Contractor's operations. Keep stream channels open at all times. This work will not be paid for directly, but will be subsidiary to this Item.

The Engineer will provide copies of documents to meet TxDOT's posting requirements. Laminate, post, and maintain these documents at the project limits and at major roadways intersecting the project as directed. Post required Contractor documents in the same manner and location. This work will be subsidiary to Item 506.

ITEM 529. CONCRETE CURB, GUTTER, AND COMBINED CURB AND GUTTER

Provide steel reinforcement for all curb and gutter unless otherwise directed.

ITEM 531. SIDEWALKS

Provide steel reinforcement for all sidewalks unless otherwise directed.

ITEM 618. CONDUIT

Conduit placed on the underside of the bridge slab overhang must be anchored with conduit straps at 5 ft. maximum intervals as shown on standard sheets ED(1) and (2)-14. Conduit hangers will not be allowed in this location.

Furnish couplings and connections that are made wrench tight. All conduit must be brought into a ground or junction box and elbowed unless otherwise shown on the plans.

Place conduit in an area not exceeding 2 ft. in any direction from a straight line between terminal points. The minimum depth of the conduit should be 2 ft. except when crossing a roadway where the depth should not be more than 3 ft. nor less than 1 ft. below the bottom of the base material when placed by the jacking or boring method.

Where conduit is to be placed under existing riprap, cut the existing riprap to neat lines as directed and replace to match original condition after conduit placement.

The Contractor may, at his option, substitute high-density polyethylene (HDPE) conduit meeting the specifications of Item 622 for all bores requiring PVC schedule 40 conduit and, when approved by the Engineer, may substitute HDPE for schedule 80 bored conduit. HDPE must be the same size as the PVC conduit shown on the plans. HDPE must be terminated with UL listed fittings. HDPE may be threaded and used with threaded PVC connectors or couplings. HDPE should be extended through the bore in one continuous piece and should be coupled to RMC

elbows or to PVC conduit at the bore pits prior to entering ground boxes (if ground boxes are required by the plans). HDPE should not contain conductors during installation in this manner. No additional compensation will be paid to the Contractor when HDPE is substituted for this purpose.

Do not use cast iron junction boxes in concrete traffic barriers and single slope traffic barriers. Use polymer concrete junction boxes instead of the cast iron junction boxes shown on standard sheets CSB(3), CSB(4), and SSCB(4). Mount the junction boxes flush (+ 0 in., - 1/2 in.) with concrete surface of concrete barrier.

The polymer concrete barrier box will not be paid for separately, but will be subsidiary to Item 618, "Conduit."

Use materials from prequalified material producers list as shown on the Material Producer List found on the TxDOT web site. Category is "Roadway Illumination and Electrical Supplies."

ITEMS 618, 624, 680 & 684. CONDT, GRND BX, INSTL HWY TRF SIG & TRF SIG CBL

The location of the controller, conductors, conduits, junction boxes and ground boxes are diagrammatic only and may be shifted by the Engineer to accommodate field conditions.

ITEM 620. ELECTRICAL CONDUCTORS

For both transformer and shoe-base type illumination poles, provide double-pole breakaway fuse holder as shown on the Material Producer List found on the TxDOT web site. Category is "Roadway Illumination and Electrical Supplies."

Fuse holder is shown on list under Items 610 & 620.

Provide 10 amp time delay fuses.

ITEM 624. GROUND BOXES

All ground boxes will be precast polymer concrete of the size and type specified on the plans.

ITEM 636. SIGNS

Install signs in accordance with the Department of Transportation's "Sign Crew Field Book," latest edition, or as directed. Proposed sign locations must be approved by the Engineer before sign installation.

County: Henderson**Control:** 0164-03-056**Highway:** SH 31

All signs removed from the project are deemed salvageable and become the property of the Department. Stockpile salvageable material at the Athens Maintenance Section located at 2400 NE Loop 7, Athens, TX 75752.

ITEM 644. SMALL ROADSIDE SIGN ASSEMBLIES

Sign types for which details are not shown on the plans must conform to "Standard Highway Sign Designs for Texas," latest edition.

Before construction begins, locate all Texas Reference Marker (TRM) signs and Adopt-a-Highway signs using survey control methods for accuracy. Provide the survey data to the Engineer. If either type of sign is relocated during construction activities, survey the sign location and notify the Engineer before placement of the permanent sign.

Stake all sign locations for approval prior to placement.

ITEM 656. FOUNDATIONS FOR TRAFFIC CONTROL DEVICES

The Contractor may reduce the size of the traffic signal controller slab as shown on standard sheet TS-CF in order to accommodate site conditions as approved by the Engineer.

ITEM 666. RETROREFLECTORIZED PAVEMENT MARKINGS

Use the spray method for application of the thermoplastic compound for lane lines, barrier lines, edge lines and channelizing lines.

In high traffic volume areas, do not begin work before 9 A.M. and do not continue work after 4 P.M. unless otherwise approved. In other areas, the Engineer will approve and direct the time of work.

Extrude hot to the pavement surface thermoplastic compound for arrows, stop lines, yield triangles, transverse lines, crosswalk lines, words and symbols.

For lengths greater than 300-ft, provide guide markings that will not leave a permanent mark on the roadway. Have the guide marking material and equipment used for placement approved prior to use. Provide adequate notification for approval of the guide markings prior to placement of the permanent pavement markings.

Provide a crew experienced in the work of installing pilot guideline markings and in the necessary traffic control. Supply all the equipment, personnel, traffic control, and materials necessary for the placement of pilot guideline markings as directed. All work will be in conformance with Part 6 of the TMUTCD.

County: Henderson**Control:** 0164-03-056**Highway:** SH 31

The Engineer will establish beginning and ending points of no passing zones.

Correct deficiencies in the alignment of pavement markings at Contractor's expense, as directed. Use a strip seal with aggregate and asphalt types and rates as directed to eliminate the deficient pavement markings.

Static lane closures are required for all profile stripe operations. These operations will require a pilot car for all two-lane roadways, unless otherwise directed.

ITEM 672. RAISED PAVEMENT MARKERS

Provide dispensing equipment such that the bituminous material can be directly applied from the melting pot to the pavement surface without secondary handling. Dispensing material from the melting pot into a separate container and then to the pavement surface will not be permitted. Intermittent agitation of the bituminous material will be by a method approved by the Engineer to ensure even heat distribution and must be such that the adhesive is agitated at approved and consistent intervals.

ITEM 677. ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS

Furnish a high-pressure water blasting system for removing paint, thermoplastic, epoxy and preformed tape material from the following surfaces without causing any grooves or trenching of the surface: asphalt, concrete, permeable friction course, grooved asphalt and grooved concrete.

Use a high-pressure water blasting system that consists of a vacuum recovery system that must provide for a nearly dry surface eliminating the possibility of uncontained run-off blasting water or debris, or the need for any secondary clean-up vehicles or operations.

All components required for the complete operation of the water blasting system (ultra-high-pressure pump, vacuum system, clean water supply, vacuum recovery storage, primary truck-mounted and optional secondary tractor-mounted blasting components) must be mounted and transported on a single, fully self-contained and supporting single truck chassis, thereby eliminating the need for any additional water, vacuum or other transport vehicles.

ITEM 680. HIGHWAY TRAFFIC SIGNALS

The Contractor's maintenance responsibility begins on the day work is authorized, and continues until final acceptance. Designate in writing an IMSA certified signal technician who is available to perform repair work within a 2-hour response time at all times. This work will not be paid for directly, but will be subsidiary to Item 680.

Project Number:

Sheet 3E

County: Henderson

Control: 0164-03-056

Highway: SH 31

ITEM 682. VEHICLE AND PEDESTRIAN SIGNAL HEADS

Fabricate the traffic signal heads using polycarbonate. Cover the traffic signal heads with factory-made signal head covers until placed in operation.

Support for VDS not to be used for signal head support. Non-gusseted support poles must be used.

ITEM 684. TRAFFIC SIGNAL CABLES

An extra length of 5 ft. for each cable run must remain in each steel signal pole. For each conductor that terminates in the controller cabinet, an extra 5-ft. length must be provided. Wire nuts will not be permitted.

ITEM 6017. MULTI-SENSOR VEHICLE DETECTION SYSTEM FOR SIGNALIZED INTERSECTION

Each VDS must include all necessary hardware and software to adjust all detection zone features.

All VDS processors and cameras must be from same manufacturers for the duration of this Contract.

All camera cables must be inside the camera support arm.

All software must be windows 10 compatible.

Deliver digitally all related system setup data to the TxDOT Tyler District Signal Shop.



Estimate & Quantity Sheet

CONTROLLING PROJECT ID 0164-03-056

DISTRICT Tyler
HIGHWAY SH 31

COUNTY Henderson

CONTROL SECTION JOB				0164-03-056		TOTAL EST.	TOTAL FINAL
PROJECT ID				A00189826			
COUNTY				Henderson			
HIGHWAY				SH 31			
ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL		
	104-7017	REMOV CONC (CURB & GUTTER)	LF	70.000		70.000	
	104-7046	REMOV CONC (MISC)	SY	15.000		15.000	
	416-7043	DRILL SHAFT (TRF SIG POLE) (30 IN)	LF	22.000		22.000	
	416-7044	DRILL SHAFT (TRF SIG POLE) (36 IN)	LF	26.000		26.000	
	500-7001	MOBILIZATION	LS	1.000		1.000	
	502-7001	BARRICADES, SIGNS AND TRAFFIC HANDLING	MO	3.000		3.000	
	503-7001	PORTABLE CHANGEABLE MESSAGE SIGN	DAY	40.000		40.000	
	505-7001	TMA (STATIONARY)	DAY	24.000		24.000	
	505-7003	TMA (MOBILE OPERATION)	DAY	4.000		4.000	
	506-7043	BIODEG EROSN CONT LOGS (INSTL) (8")	LF	100.000		100.000	
	506-7046	BIODEG EROSN CONT LOGS (REMOVE)	LF	100.000		100.000	
	531-7001	CONC SIDEWALKS (4")	SY	47.000		47.000	
	531-7005	CURB RAMPS (TY 1)	EA	7.000		7.000	
	618-7030	CONDT (PVC) (SCH 40) (2")	LF	175.000		175.000	
	618-7036	CONDT (PVC) (SCH 40) (3")	LF	50.000		50.000	
	618-7061	CONDT (PVC) (SCH 80) (3") (BORE)	LF	450.000		450.000	
	620-7009	ELEC CONDR (NO.6) BARE	LF	55.000		55.000	
	620-7010	ELEC CONDR (NO.6) INSULATED	LF	110.000		110.000	
	624-7008	GROUND BOX TY D (162922)W/APRON	EA	5.000		5.000	
	628-7169	ELC SRV TY D 120/240 070(NS)AL(E)SP(O)	EA	1.000		1.000	
	666-7024	REFL PAV MRK TY I (W)8"(SLD)(100MIL)	LF	380.000		380.000	
	666-7036	REFL PAV MRK TY I (W)24"(SLD)(100MIL)	LF	500.000		500.000	
	666-7408	REFL PAV MRK TY I (W)6"(BRK)(100MIL)	LF	160.000		160.000	
	666-7411	REFL PAV MRK TY I (W)6"(SLD)(100MIL)	LF	1,200.000		1,200.000	
	666-7420	REFL PAV MRK TY I (Y)6"(BRK)(100MIL)	LF	80.000		80.000	
	666-7423	REFL PAV MRK TY I (Y)6"(SLD)(100MIL)	LF	1,130.000		1,130.000	
	668-7091	PREFAB PM TY C (W)(ARROW)	EA	4.000		4.000	
	668-7103	PREFAB PM TY C (W)(WORD)	EA	4.000		4.000	
	672-7002	REFL PAV MRKR TY I-C	EA	19.000		19.000	
	672-7004	REFL PAV MRKR TY II-A-A	EA	30.000		30.000	
	677-7001	ELIM EXT PM & MRKS (4")	LF	1,560.000		1,560.000	
	677-7008	ELIM EXT PM & MRKS (24")	LF	50.000		50.000	
	677-7009	ELIM EXT PM & MRKS (ARROW)	EA	7.000		7.000	
	678-7004	PAV SURF PREP FOR MRK (8")	LF	200.000		200.000	
	678-7008	PAV SURF PREP FOR MRK (24")	LF	500.000		500.000	
	678-7009	PAV SURF PREP FOR MRK (ARROW)	EA	4.000		4.000	
	678-7016	PAV SURF PREP FOR MRK (WORD)	EA	4.000		4.000	

DISTRICT	COUNTY	CCSJ	SHEET
Tyler	Henderson	0164-03-056	4



Estimate & Quantity Sheet

CONTROLLING PROJECT ID 0164-03-056

DISTRICT Tyler
HIGHWAY SH 31

COUNTY Henderson

CONTROL SECTION JOB				0164-03-056		TOTAL EST.	TOTAL FINAL
PROJECT ID				A00189826			
COUNTY				Henderson			
HIGHWAY				SH 31			
ALT	BID CODE	DESCRIPTION	UNIT	EST.	FINAL		
	680-7002	INSTALL HWY TRF SIG (ISOLATED)	EA	1.000		1.000	
	682-7001	VEH SIG SEC (12")LED(GRN)	EA	8.000		8.000	
	682-7002	VEH SIG SEC (12")LED(GRN ARW)	EA	4.000		4.000	
	682-7003	VEH SIG SEC (12")LED(YEL)	EA	8.000		8.000	
	682-7004	VEH SIG SEC (12")LED(YEL ARW)	EA	8.000		8.000	
	682-7005	VEH SIG SEC (12")LED(RED)	EA	8.000		8.000	
	682-7006	VEH SIG SEC (12")LED(RED ARW)	EA	4.000		4.000	
	682-7018	PED SIG SEC (LED)(COUNTDOWN)	EA	8.000		8.000	
	682-7037	BACKPLATE W/REFL BRDR(4 SEC)	EA	4.000		4.000	
	682-7054	BACKPLATE W/REFL BRDR(3 SEC)	EA	8.000		8.000	
	684-7007	TRF SIG CBL (TY A)(12 AWG)(2 CONDR)	LF	970.000		970.000	
	684-7010	TRF SIG CBL (TY A)(12 AWG)(5 CONDR)	LF	1,649.000		1,649.000	
	684-7012	TRF SIG CBL (TY A)(12 AWG)(7 CONDR)	LF	677.000		677.000	
	686-7025	INS TRF SIG PL AM (S)1 ARM(24')	EA	1.000		1.000	
	686-7029	INS TRF SIG PL AM (S)1 ARM(28')	EA	1.000		1.000	
	686-7041	INS TRF SIG PL AM(S)1 ARM(40')	EA	2.000		2.000	
	687-7001	PED POLE ASSEMBLY	EA	4.000		4.000	
	688-7001	PED DETECT PUSH BUTTON (APS)	EA	8.000		8.000	
	6017-7001	VDS PROSR SYS	EA	1.000		1.000	
	6017-7003	VIVDS CAM ASSY VAR LNS	EA	2.000		2.000	
	6017-7008	HVDS W/VAR LNS	EA	2.000		2.000	
	6017-7009	VDS CNTRL SOFTWARE	EA	1.000		1.000	
	6017-7012	VDS CABLING	LF	687.000		687.000	
	18	EROSION CONTROL MAINTENANCE: CONTRACTOR FORCE ACCOUNT WORK (PART)	LS	1.000		1.000	
		SAFETY CONTINGENCY: CONTRACTOR FORCE ACCOUNT WORK (PART)	LS	1.000		1.000	

ROADWAY SUMMARY				
LOCATION	ITEM 104		ITEM 531	
	REMOVING CONC (MISC)	REMOVING CONC (CURB & GUTTER)	CONC SIDEWALKS (4")	CURB RAMPS (TY 1)
	SY	LF	SY	EA
SH 31 at Sawmill Rd	15	70	47	7
PROJECT TOTAL	15	70	47	7

PAVEMENT MARKING SUMMARY																	
LOCATION	ITEM 666						ITEM 668		ITEM 672		ITEM 677			ITEM 678			
	REFL PAV MRK TY I (100 MIL)						PREFAB PAV MRK TY C		REFL PAV MRKR		ELIM EXT PAV MRK & MRKS			PAV SURF PREP FOR MRK			
	(W)			(Y)			(W)		TY I C	TY II A-A	4"	24"	ARROW	8"	24"	(ARROW)	(WORD)
	8" (SLD)	24" (SLD)	6" (BRK)	6" (SLD)	6" (BRK)	6" (SLD)	(ARROW)	(WORD)	C	A-A	LF	LF	EA	LF	LF	EA	EA
SH31 at Sawmill Rd	380	500	160	1200	80	1130			19	30	1560	50	7	200	500	4	4
PROJECT TOTAL	380	500	160	1200	80	1130			19	30	1560	50	7	200	500	4	4

BASIS OF ESTIMATE					
ITEM	DESCRIPTION	AMOUNT	UNIT	PROJECT TOTAL	PAY UNIT
500	MOBILIZATION	1	LS	1	LS
502	BARRICADES, SIGNS AND TRAFFIC HANDLING	3	MO	3	MO

PORTABLE CHANGEABLE MESSAGE SIGN		
SIGN	LOCATION	ITEM 503
		PORTABLE CHANGEABLE MESSAGE SIGN
		DAYS
1	SH 31 EB AS DIRECTED	10
2	SH 31 WB AS DIRECTED	10
3	SAWMILL DR. NB AS DIRECTED	10
4	SAWMILL DR. SB AS DIRECTED	10
PROJECT TOTAL		40

NO.	DATE	REVISION	APPROV.
-----	------	----------	---------



Walter P Moore and Associates, Inc.
1301 McKinney, Suite 1100
Houston, Texas 77010
Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
SUMMARY OF
QUANTITIES

SHEET 1 OF 2	
DN:	FED. RD. DIV. NO. STATE PROJECT NO. HIGHWAY NO.
CK DN:	6 TX SEE TITLE SHEET SH 31
DW:	STATE DIST. COUNTY CONTROL SECTION NO. JOB NO. SHEET NO.
CK DW:	TYL HENDERSON 0164 03 056 5

SIGNAL SUMMARY PART 1 OF 2																			
LOCATION	ITEM 416			ITEM 618			ITEM 620		ITEM 624	ITEM 680	ITEM 682								
	DRILL SHAFT TRF SIG POLE			CONDT (PVC)			ELEC CONDR		GROUND BOX	INSTALL	VEH SIG SEC (12") (LED)						PED SIG SEC (LED) (COUNT DOWN)	BACK PLATE W/REFL BRDR (12")	
	(24") [1]	(30")	(36")	(SCH 40) (2")	(SCH 40) (3")	(SCH 80) (3") BORE	GROUND BARE #6	POWER INSULATED #6	TY D (162922) W/APRON	HWY TRF SIG	(GRN)	(GRN ARW)	(YEL)	(YEL ARW)	(RED)	(RED ARW)	EA	EA	EA
	LF	LF	LF	LF	LF	LF	LF	EA	EA	EA	EA	EA	EA	EA	EA				
SH 31 AT SAWMILL RD	24	22	26	175	50	450	55	110	5	1	8	4	8	8	8	4	8	8	4
TOTAL	24	22	26	175	50	450	55	110	5	1	8	4	8	8	8	4	8	8	4

[1] FOR CONTRACTOR INFORMATION ONLY; PEDESTRIAN POLE FOUNDATIONS ARE SUBSIDIARY TO ITEM 687. OPTIONAL CONCRETE FOUNDATION SHOWN FOR EXAMPLE.

SIGNAL SUMMARY PART 2 OF 2													
ITEM 684			ITEM 686			ITEM 687	ITEM 688	ITEM 628	ITEM 6017				
TRF SIG CBL (TY A)(12 AWG)			INS TRF SIG PL AM (S) 1 ARM			PED POLE ASSEMBLY	PED DET PUSH BUTTON (APS)	ELE SRV TY D 120/240 070(NS)AL (E)SP(O)	VDS PROSR SYS	VIVIDS CAM ASSY VAR LNS	HVDS W/VAR LNS	VDS CNTRL SOFTWARE	VDS CABLING
BUTTONS (2 CONDR)	PED + VEH (5 CONDR)	4 SEC (7 CONDR)	(24')	(28')	(40')	EA	EA	EA	EA	EA	EA	EA	EA
LF	LF	LF	EA	EA	EA	EA	EA	EA	EA	EA	EA	EA	LF
970	1649	677	1	1	2	4	8	1	1	2	2	1	687
970	1649	677	1	1	2	4	8	1	1	2	2	1	687

EROSION CONTROL SUMMARY		
LOCATION	ITEM 506	
	BIODEG EROSN CONT LOGS	
	(INSTL) (8") LF	(REMOVE) LF
NE CORNER	50	50
NW CORNER	50	50
SE CORNER	0	0
SW CORNER	0	0
PROJECT TOTAL	100	100

TRUCK MOUNTED ATTENUATORS			
STAGE OF PROJECT	NUMBER OF TRUCKS	ITEM 505	
		TMA (STATIONARY) DAY	TMA (MOBILE OPERATION) DAY
FOUNDATIONS	1	5	
SETTING POLES	1	5	
REMOVING CONCRETE C&G/EXCAV.	1	4	
ADA RAMPS	1	4	
INSTALL MAST ARMS AND HEADS	1	2	
MOBILE			4
OTHER TCP UNDER TYPICAL CIRCUMSTANCES			
SUBTOTAL		20	4
PROJECT TOTAL		20	4

NOTE: ESTIMATED NUMBER OF TRUCKS IS FOR WORKING AT ONE LOCATION AT A TIME. ADDITIONAL TRUCKS WILL BE REQUIRED IF WORKING AT MULTIPLE LOCATIONS AT A TIME.

SMALL SIGN TABULATION	
LOCATION	ITEM 636
SUBTOTAL	60
PROJECT TOTAL	60

[1] FOR CONTRACTOR INFORMATION ONLY; SIGNS MOUNTED ON SIGNAL EQUIPMENT ARE SUBSIDIARY TO ITEM 680

NO.	DATE	REVISION	APPROV.
-----	------	----------	---------



Walter P Moore and Associates, Inc.
1301 McKinney, Suite 1100
Houston, Texas 77010
Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
SUMMARY OF QUANTITIES

SHEET 2 OF 2

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056

5 DATES 5 TIMES 5 FILES

7/17/2023 6:48:18 AM c:\users\timealappdata\local\temp\projectwise\workingdir\wpm-pw-bentley.com_wpm-pw-01\viewing@walterpmoore.com\dms4744\03-1-8032-03-SH-31_Sawmill Rd_DT_CON-SEQ.dgn

CONSTRUCTION SEQUENCE

1. INSTALL PROJECT SIGNS.
2. OBTAIN UTILITY INFORMATION FROM 811, TxDOT, AND CITY OF CHANDLER. CONTRACTOR IS REQUIRED TO POTHOLE ALL UNDERGROUND UTILITIES WITHIN 2' OF PROPOSED SIGNAL AND PEDESTRIAN POLE FOUNDATION.
3. STAKE LIMITS OF ADA RAMPS, SIDEWALKS AND SIGNAL FOUNDATIONS.
4. DRILL AND POUR TRAFFIC SIGNAL FOUNDATIONS.
5. INSTALL ADA RAMPS AND SIDEWALK.
6. PLACE PAVEMENT MARKINGS AND RPMS ACCORDING TO LAYOUTS.
7. SET POLES, MAST ARMS, HEADS, VIVIDS AND EMERGENCY TRANSPONDERS. INSTALL CONDUIT AND CONDUCTOR RUN AND GROUND BOXES. INSTALL ELECTRICAL SERVICE, CONDUIT, CONDUCTORS, TRAFFIC SIGNAL CONTROLLER AND FOUNDATION.
8. WHEN APPROVED, PLACE NEW SIGNALS IN OPERATION USING PROPOSED PHASING.
9. PERFORM FINAL CLEANUP.
10. REMOVE PROJECT SIGNS.



NO.	DATE	REVISION	APPROV.
..			
..			
..			
..			



walter p moore Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
 CONSTRUCTION
 SEQUENCE

SHEET 1 OF 1

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056
				SHEET NO. 7

PROJECT TRAFFIC CONTROL NOTES

ANY CHANGE TO THE SEQUENCE OF WORK WILL BE APPROVED BY THE ENGINEER.

STANDARD REGULATORY AND WARNING SIGNS WHICH ARE NOT SHOWN ON THE TCP SHEETS SHALL BE IN ACCORDANCE WITH THE CURRENT TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES AND STANDARDS BC(1)-21 THRU BC(12)-21.

THE CONTRACTOR MAY BE REQUIRED TO FURNISH OTHER BARRICADES AND OTHER TYPES OF DEVICES AS DIRECTED BY THE ENGINEER OR AS INDICATED IN THE TMUTCD, BC, WZ AND TCO STANDARDS.

PAVEMENT MARKINGS CONFORMING TO THE TMUTCD AND SHEETS BC(1)-21 THRU BC(12)-21 WILL BE IN PLACE BEFORE ANY OVERNIGHT TRAFFIC IS ALLOWED ON ANY CONSTRUCTION SURFACE.

BARRICADES SHALL NOT BE USED AS SIGN SUPPORTS.

SIGNS, BARRICADE, AND CONES NOT IN USE FOR 3 WORKING DAYS WILL BE REMOVED FROM THE RIGHT-OF-WAY.

SIGNS AT THE BEGINNING AND END OF THE PROJECT SHALL BE IN ACCORDANCE WITH BC(2).

SIGNS G20-2 AND G20-LAT, OR CW20-ID SHALL BE PLACED AT EACH INTERSECTING HIGHWAY.

THE CONTRACTOR WILL CONTACT ADJACENT PROPERTY OWNERS CONCERNING INGRESS AND EGRESS OF THEIR PROPERTY DURING CONSTRUCTION.

POST TRAINED FLAGMEN AS NEEDED IN SPECIAL SITUATIONS AS DEEMED NECESSARY BY THE ENGINEER.

FOLLOW TCP(2-4) FOR ONE LANE OR TWO LANE CLOSURES.

THE CONTRACTOR SHALL ACCOMMODATE ACCESS TO ALL DRIVEWAYS AS MUCH AS POSSIBLE.

THE CONTRACTOR SHALL INCLUDE IN HIS BID EXTRA TRAFFIC CONTROL MEASURES TO HANDLE TRAFFIC AT THIS INTERSECTION.

COORDINATION OF CROSSWALK/RAMP WORK SHOULD BE PHASED TO MAINTAIN CROSSWALK ACCESS.

Walter P. Moore and Associates, Inc.
TBPE Firm Registration No. 1856



NO.	DATE	REVISION	APPROV.
..			
..			
..			



walter p moore
Walter P Moore and Associates, Inc.
1301 McKinney, Suite 1100
Houston, Texas 77010
Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
PROJECT TRAFFIC
CONTROL NOTES

SHEET 1 OF 1						
DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.		
CK DN:	6	TX	SEE TITLE SHEET	SH 31		
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.	SHEET NO.	
CK DW:	TYL	HENDERSON	0164 03	056	8	

5 DATES
5 FILES

BARRICADE AND CONSTRUCTION (BC) STANDARD SHEETS GENERAL NOTES:

1. The Barricade and Construction Standard Sheets (BC sheets) are intended to show typical examples for placement of temporary traffic control devices, construction pavement markings, and typical work zone signs. The information contained in these sheets meet or exceed the requirements shown in the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
2. The development and design of the Traffic Control Plan (TCP) is the responsibility of the Engineer.
3. The Contractor may propose changes to the TCP that are signed and sealed by a licensed professional engineer for approval. The Engineer may develop, sign and seal Contractor proposed changes.
4. The Contractor is responsible for installing and maintaining the traffic control devices as shown in the plans. The Contractor may not move or change the approximate location of any device without the approval of the Engineer.
5. Geometric design of lane shifts and detours should, when possible, meet the applicable design criteria contained in manuals such as the American Association of State Highway and Transportation Officials (AASHTO), "A Policy on Geometric Design of Highways and Streets," the TxDOT "Roadway Design Manual" or engineering judgment.
6. When projects abut, the Engineer(s) may omit the END ROAD WORK, TRAFFIC FINES DOUBLE, and other advance warning signs if the signing would be redundant and the work areas appear continuous to the motorists. If the adjacent project is completed first, the Contractor shall erect the necessary warning signs as shown on these sheets, the TCP sheets or as directed by the Engineer. The BEGIN ROAD WORK NEXT X MILES sign shall be revised to show appropriate work zone distance.
7. The Engineer may require duplicate warning signs on the median side of divided highways where median width will permit and traffic volumes justify the signing.
8. All signs shall be constructed in accordance with the details found in the "Standard Highway Sign Designs for Texas," latest edition. Sign details not shown in this manual shall be shown in the plans or the Engineer shall provide a detail to the Contractor before the sign is manufactured.
9. The temporary traffic control devices shown in the illustrations of the BC sheets are examples. As necessary, the Engineer will determine the most appropriate traffic control devices to be used.
10. Where highway construction or maintenance work is being undertaken, other than mobile operations as defined by the Texas Manual on Uniform Traffic Control Devices, CSJ limit signs are required. CSJ limit signs are shown on BC(2). The OBEY WARNING SIGNS STATE LAW sign, STAY ALERT TALK OR TEXT LATER and the WORK ZONE TRAFFIC FINES DOUBLE sign with plaque shall be erected in advance of the CSJ limits. The BEGIN ROAD WORK NEXT X MILES, CONTRACTOR and END ROAD WORK signs shall be erected at or near the CSJ limits. For mobile operations, CSJ limit signs are not required.
11. Traffic control devices should be in place only while work is actually in progress or a definite need exists.
12. The Engineer has the final decision on the location of all traffic control devices.
13. Inactive equipment and work vehicles, including workers' private vehicles must be parked away from travel lanes. They should be as close to the right-of-way line as possible, or located behind a barrier or guardrail, or as approved by the Engineer.

WORKER SAFETY NOTES:

1. Workers on foot who are exposed to traffic or to construction equipment within the right-of-way shall wear high-visibility safety apparel meeting the requirements of ISEA "American National Standard for High-Visibility Apparel," or equivalent revisions, and labeled as ANSI 107-2004 standard performance for Class 2 or 3 risk exposure. Class 3 garments should be considered for high traffic volume work areas or night time work.
2. Except in emergency situations, flagger stations shall be illuminated when flagging is used at night.

COMPLIANT WORKZONE TRAFFIC CONTROL DEVICES

1. Only pre-qualified products shall be used. The "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources.
2. Work zone traffic control devices shall be compliant with the Manual for Assessing safety Hardware (MASH).

<p>THE DOCUMENTS BELOW CAN BE FOUND ON-LINE AT http://www.txdot.gov</p>
COMPLIANT WORK ZONE TRAFFIC CONTROL DEVICES LIST (CWZTCD)
DEPARTMENTAL MATERIAL SPECIFICATIONS (DMS)
MATERIAL PRODUCER LIST (MPL)
ROADWAY DESIGN MANUAL - SEE "MANUALS (ONLINE MANUALS)"
STANDARD HIGHWAY SIGN DESIGNS FOR TEXAS (SHSD)
TEXAS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (TMUTCD)
TRAFFIC ENGINEERING STANDARD SHEETS

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT or any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to any other format. Other than the original files, BC(1)-21.dgn
 FILE: c:\users\time\AppData\local\Bentley\projectwise\workingdir\pwm-pw.bentley\projectwise\workingdir\pwm-pw.bentley.com_xpm-pw-01\tewing\w\terpmoore.com\dms\427\BC(1)-21.dgn

DATE: 7/17/2023 6:49:10 AM
 FILE: c:\users\time\AppData\local\Bentley\projectwise\workingdir\pwm-pw.bentley\projectwise\workingdir\pwm-pw.bentley.com_xpm-pw-01\tewing\w\terpmoore.com\dms\427\BC(1)-21.dgn




**BARRICADE AND CONSTRUCTION
GENERAL NOTES
AND REQUIREMENTS**

BC(1)-21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0164	03	056	SH 31				
4-03	7-13	DIST	COUNTY		SHEET NO.				
9-07	8-14	TYL	HENDERSON		9				
5-10	5-21								

DATE: 7/17/2023 6:49:11 AM
 FILE: c:\users\tim\AppData\Local\Bentley\Projectwise\workingdir\pwm-pw-bentley.com\pwm-pw-011\Tewmoad\Tewmoad.dgn
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT or any purpose whatsoever. TxDOT assumes no responsibility for the conversion of the information contained herein to any other format or for the use of the information for any purpose other than that for which it was prepared.


TYPICAL LOCATION OF CROSSROAD SIGNS

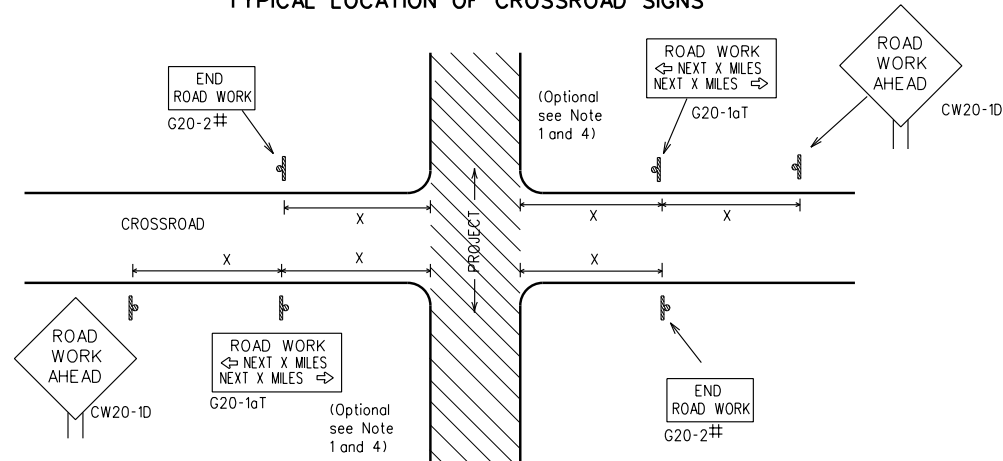

May be mounted on back of "ROAD WORK AHEAD" (CW20-1D) sign with approval of Engineer. (See note 2 below)

- The typical minimum signing on a crossroad approach should be a "ROAD WORK AHEAD" (CW20-1D) sign and a (G20-2) "END ROAD WORK" sign, unless noted otherwise in plans.
- The Engineer may use the reduced size 36" x 36" ROAD WORK AHEAD (CW20-1D) sign mounted back to back with the reduced size 36" x 18" "END ROAD WORK" (G20-2) sign on low volume crossroads (see Note 4 under "Typical Construction Warning Sign Size and Spacing"). See the "Standard Highway Sign Designs for Texas" manual for sign details. The Engineer may omit the advance warning signs on low volume crossroads. The Engineer will determine whether a road is low volume as per TMUTCD Part 5. This information shall be shown in the plans.
- Based on existing field conditions, the Engineer/Inspector may require additional signs such as FLAGGER AHEAD, LOOSE GRAVEL, or other appropriate signs. When additional signs are required, these signs will be considered part of the minimum requirements. The Engineer/Inspector will determine the proper location and spacing of any sign not shown on the BC sheets, Traffic Control Plan sheets or the Work Zone Standard Sheets.
- The "ROAD WORK NEXT X MILES" (G20-1aT) sign shall be required at high volume crossroads to advise motorists of the length of construction in either direction from the intersection. The Engineer will determine whether a roadway is considered high volume.
- Additional traffic control devices may be shown elsewhere in the plans for higher volume crossroads.
- When work occurs in the intersection area, appropriate traffic control devices, as shown elsewhere in the plans or as determined by the Engineer/Inspector, shall be in place.

T-INTERSECTION

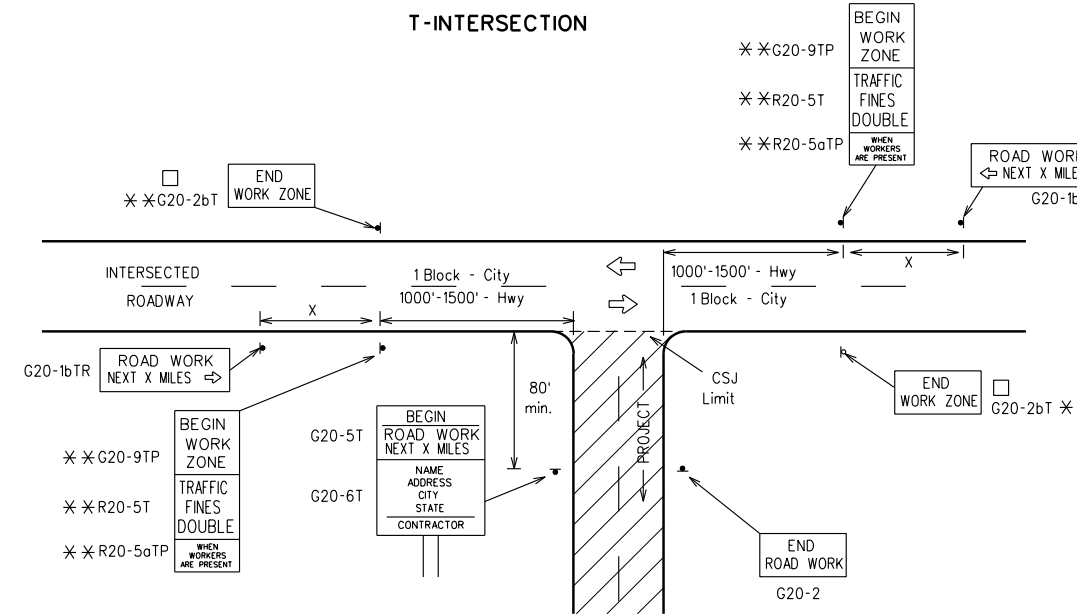

CSJ LIMITS AT T-INTERSECTION

- The Engineer will determine the types and location of any additional traffic control devices, such as a flagger and accompanying signs, or other signs, that should be used when work is being performed at or near an intersection.
- If construction closes the road at a T-intersection, the Contractor shall place the "CONTRACTOR NAME" (G20-6T) sign behind the Type 3 Barricades for the road closure (see BC(10) also). The "ROAD WORK NEXT X MILES" left arrow (G20-1bTL) and "ROAD WORK NEXT X MILES" right arrow (G20-1bTR) signs shall be replaced by the detour signing called for in the plans.

TYPICAL CONSTRUCTION WARNING SIGN SIZE AND SPACING


Sign Number or Series	SIZE		SPACING	
	Conventional Road	Expressway/Freeway	Posted Speed MPH	Sign * Spacing "X" Feet (Apprx.)
CW20 ⁴	48" x 48"	48" x 48"	30	120
CW21			35	160
CW22			40	240
CW23			45	320
CW25	36" x 36"	48" x 48"	50	400
CW1, CW2, CW7, CW8, CW9, CW11, CW14			55	500 ²
CW3, CW4, CW5, CW6, CW8-3, CW10, CW12			60	600 ²
			65	700 ²
			70	800 ²
	75	900 ²		
	80	1000 ²		
	*	*	*	* ³

- * For typical sign spacings on divided highways, expressways and freeways, see Part 6 of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) typical application diagrams or TCP Standard Sheets.
- * Minimum distance from work area to first Advance Warning sign nearest the work area and/or distance between each additional sign.

GENERAL NOTES


- Special or larger size signs may be used as necessary.
- Distance between signs should be increased as required to have 1500 feet advance warning.
- Distance between signs should be increased as required to have 1/2 mile or more advance warning.
- 36" x 36" "ROAD WORK AHEAD" (CW20-1D) signs may be used on low volume crossroads at the discretion of the Engineer as per TMUTCD Part 5. See Note 2 under "Typical Location of Crossroad Signs".
- Only diamond shaped warning sign sizes are indicated.
- See sign size listing in "TMUTCD", Sign Appendix or the "Standard Highway Sign Designs for Texas" manual for complete list of available sign design sizes.

WORK AREAS IN MULTIPLE LOCATIONS WITHIN CSJ LIMITS

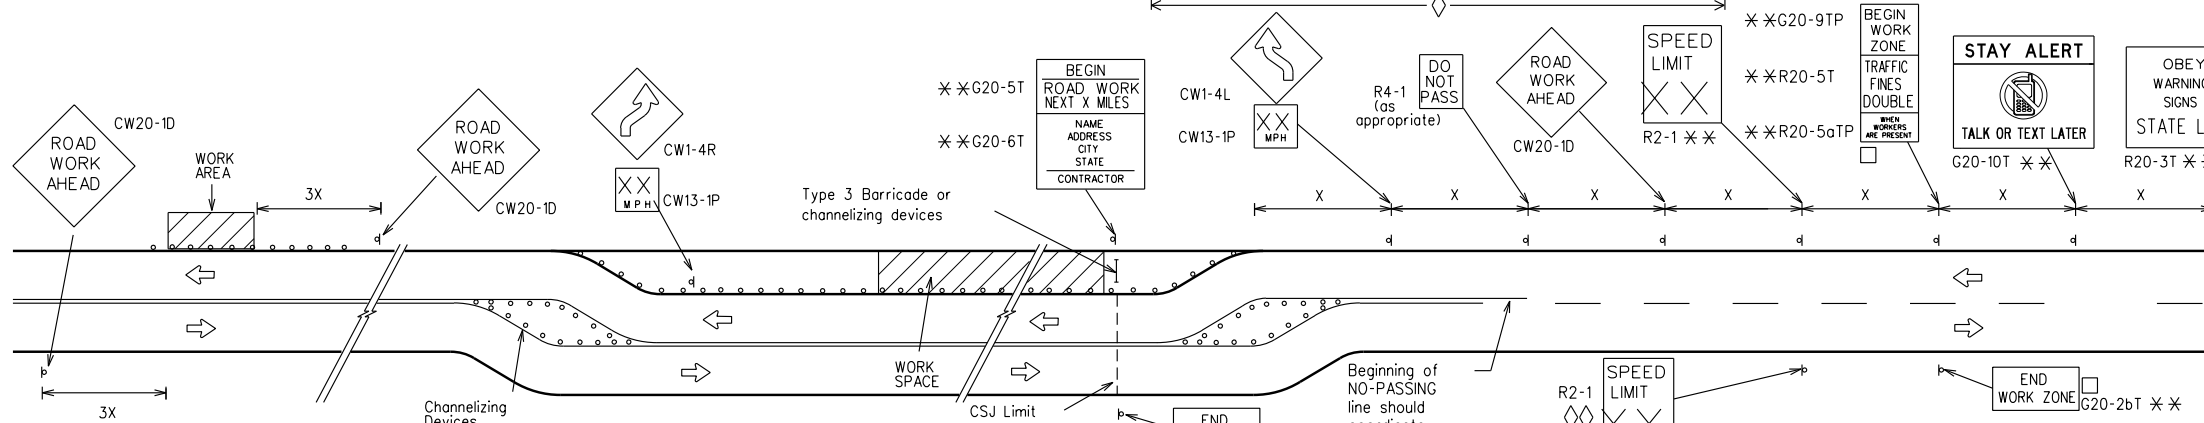

When extended distances occur between minimal work spaces, the Engineer/Inspector should ensure additional "ROAD WORK AHEAD" (CW20-1D) signs are placed in advance of these work areas to remind drivers they are still within the project limits. See the applicable TCP sheets for exact location and spacing of signs and channelizing devices.

SAMPLE LAYOUT OF SIGNING FOR WORK BEGINNING DOWNSTREAM OF THE CSJ LIMITS

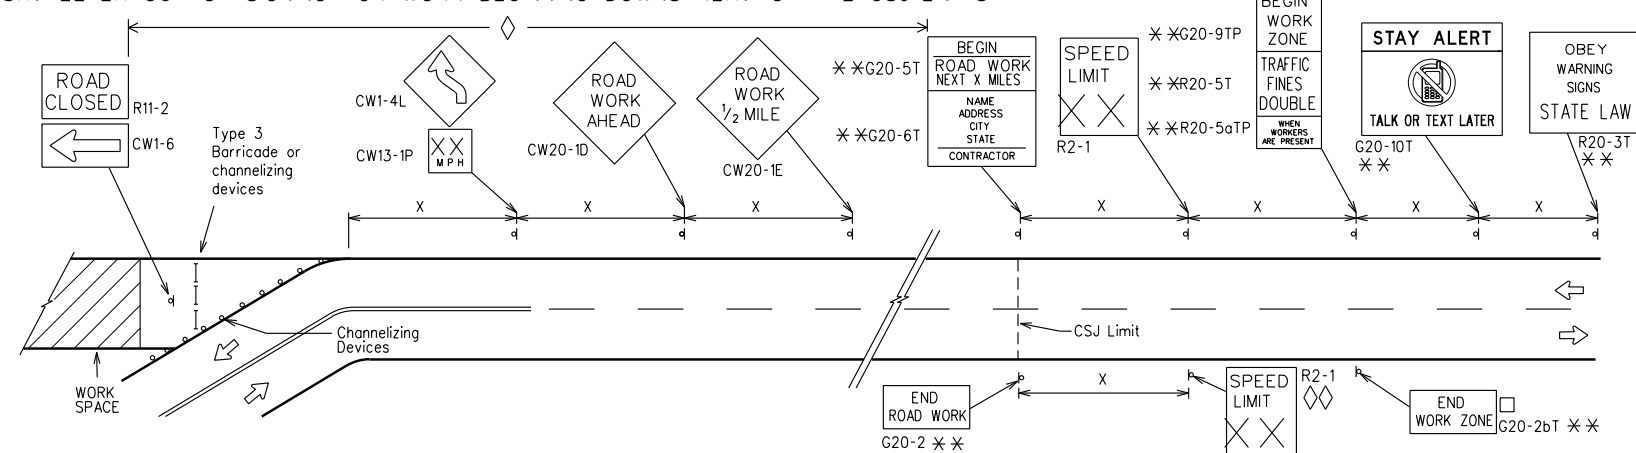

NOTES

- The Contractor shall determine the appropriate distance to be placed on the G20-1 series signs and "BEGIN ROAD WORK NEXT X MILES" (G20-5T) sign for each specific project. This distance shall replace the "X" and shall be rounded to the nearest whole mile with the approval of the Engineer. No decimals shall be used.
- The "BEGIN WORK ZONE" (G20-9TP) and "END WORK ZONE" (G20-2bT) shall be used as shown on the sample layout when advance signs are required outside the CSJ Limits. They inform the motorist of entering or leaving a part of the work zone lying outside the CSJ Limits where traffic fines may double if workers are present.
- CSJ limit signing is required for highway construction and maintenance work, with the exception of mobile operations.
- Area for placement of "ROAD WORK AHEAD" (CW20-1D) sign and other signs or devices as called for on the Traffic Control Plan.
- Contractor will install a regulatory speed limit sign at the end of the work zone.

LEGEND	
—	Type 3 Barricade
○ ○ ○	Channelizing Devices
■	Sign
X	See Typical Construction Warning Sign Size and Spacing chart or the TMUTCD for sign spacing requirements.

SHEET 2 OF 12



BARRICADE AND CONSTRUCTION PROJECT LIMIT


BC(2)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT: 0164	SECT: 03	JOB: 056	HIGHWAY: SH 31
REVISIONS				
9-07 8-14				
7-13 5-21				
	DIST: TYL	COUNTY: HENDERSON	SHEET NO. 10	

TYPICAL APPLICATION OF WORK ZONE SPEED LIMIT SIGNS

Work zone speed limits shall be regulatory, established in accordance with the "Procedures for Establishing Speed Zones," and approved by the Texas Transportation Commission, or by City Ordinance when within Incorporated City Limits.

Reduced speeds should only be posted in the vicinity of work activity and not throughout the entire project. Regulatory work zone speed signs (R2-1) shall be removed or covered during periods when they are not needed.

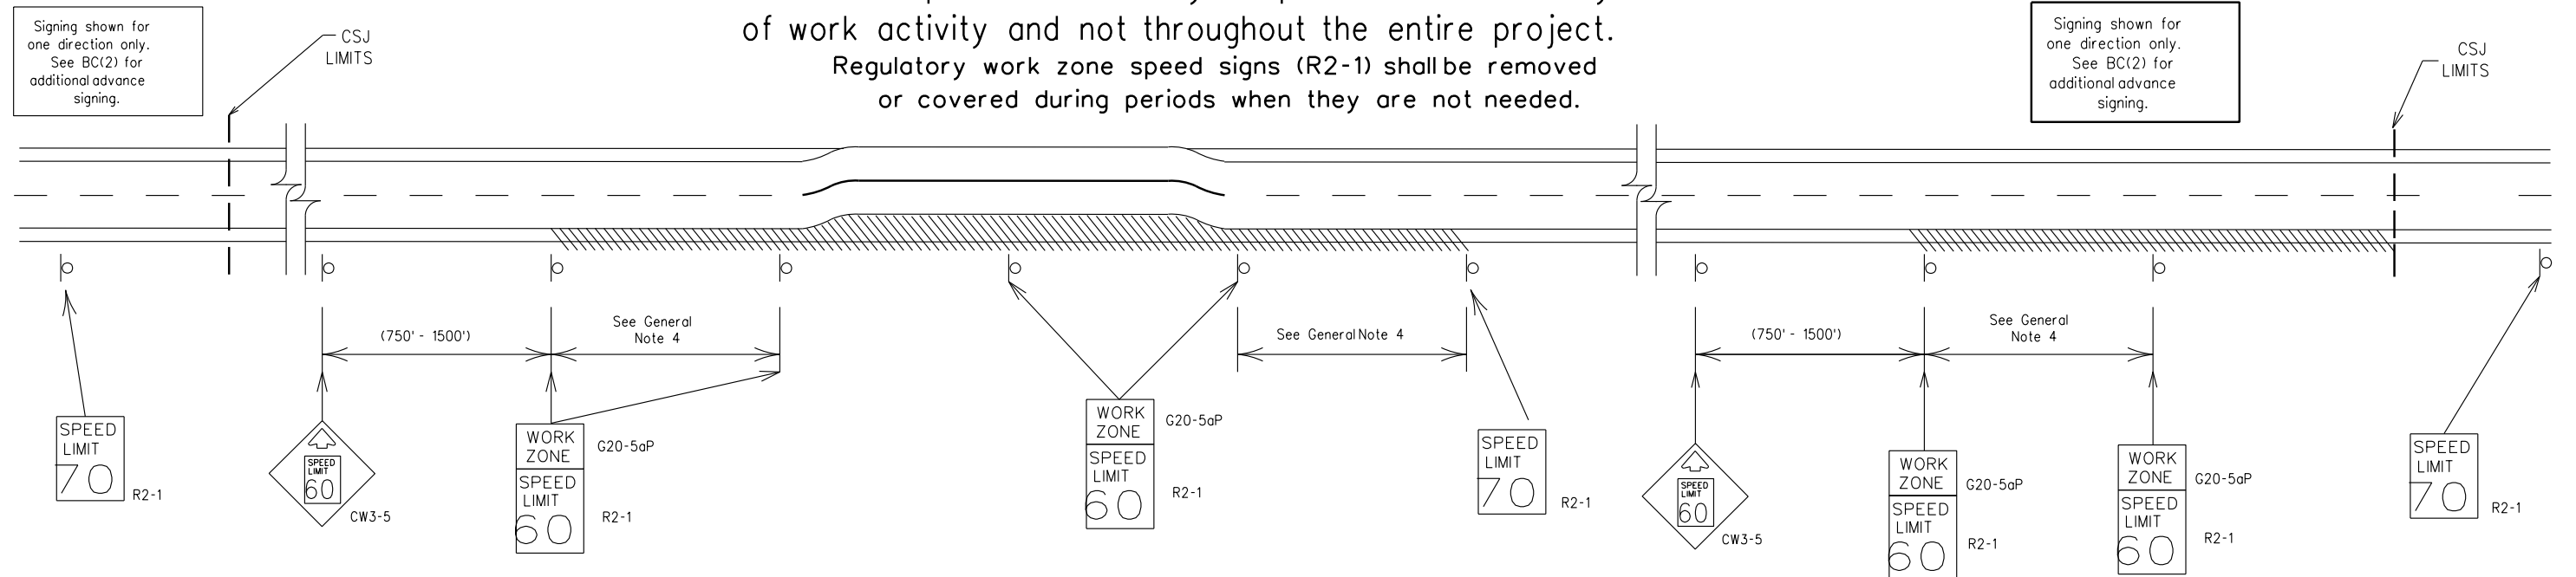

GUIDANCE FOR USE:

LONG/INTERMEDIATE TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit should be included on the design of the traffic control plans when restricted geometrics with a lower design speed are present in the work zone and modification of the geometrics to a higher design speed is not feasible.

Long/Intermediate Term Work Zone Speed Limit signs, when approved as described above, should be posted and visible to the motorist when work activity is present. Work activity may also be defined as a change in the roadway that requires a reduced speed for motorists to safely negotiate the work area, including:

- rough road or damaged pavement surface
- substantial alteration of roadway geometrics (diversions)
- construction detours
- grade
- width
- other conditions readily apparent to the driver

As long as any of these conditions exist, the work zone speed limit signs should remain in place.

SHORT TERM WORK ZONE SPEED LIMITS

This type of work zone speed limit may be included on the design of the traffic control plans when workers or equipment are not behind concrete barrier, when work activity is within 10 feet of the traveled way or actually in the traveled way.

Short Term Work Zone Speed Limit signs should be posted and visible to the motorists only when work activity is present. When work activity is not present, signs shall be removed or covered. (See Removing or Covering on BC(4)).

GENERAL NOTES

- Regulatory work zone speed limits should be used only for sections of construction projects where speed control is of major importance.
- Regulatory work zone speed limit signs shall be placed on supports at a 7 foot minimum mounting height.
- Speed zone signs are illustrated for one direction of travel and are normally posted for each direction of travel.
- Frequency of work zone speed limit signs should be:
 - 40 mph and greater 0.2 to 2 miles
 - 35 mph and less 0.2 to 1 mile
- Regulatory speed limit signs shall have black legend and border on a white reflective background (See "Reflective Sheeting" on BC(4)).
- Fabrication, erection and maintenance of the "ADVANCE SPEED LIMIT" (CW3-5) sign, "WORK ZONE" (G20-5aP) plaque and the "SPEED LIMIT" (R2-1) signs shall not be paid for directly, but shall be considered subsidiary to Item 502.
- Turning signs from view, laying signs over or down will not be allowed, unless as otherwise noted under "REMOVING OR COVERING" on BC(4).
- Techniques that may help reduce traffic speeds include but are not limited to:
 - Law enforcement.
 - Flagger stationed next to sign.
 - Portable changeable message sign (PCMS).
 - Low-power (drone) radar transmitter.
 - Speed monitor trailers or signs.
- Speeds shown on details above are for illustration only. Work Zone Speed Limits should only be posted as approved for each project.
- For more specific guidance concerning the type of work, work zone conditions and factors impacting allowable regulatory construction speed zone reduction see TxDOT form *1204 in the TxDOT e-form system.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or the accuracy of information resulting from its use.

DATE: 7/17/2023 6:49:12 AM
FILE: c:\users\time\appdata\local\bentley\projectwise\workingdir\wpm-pw\bentley.com\paw\proj\11111111111111111111111111111111\bc3-21.dgn

SHEET 3 OF 12

Traffic Safety Division Standard


BARRICADE AND CONSTRUCTION WORK ZONE SPEED LIMIT

BC(3)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
9-07 8-14	0164	03	056	SH 31
7-13 5-21	DIST	COUNTY		SHEET NO.
	TYL	HENDERSON		11

97


TYPICAL MINIMUM CLEARANCES FOR LONG TERM AND INTERMEDIATE TERM SIGNS

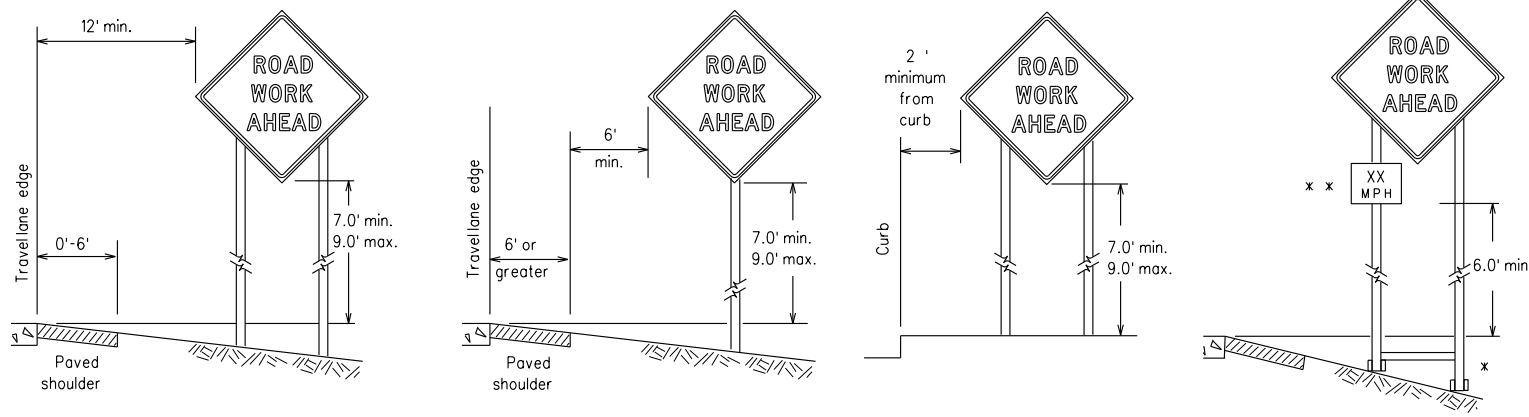

* When placing skid supports on unlevel ground, the leg post lengths must be adjusted so the sign appears straight and plumb. Objects shall NOT be placed under skids as a means of leveling.

* * When plaques are placed on dual-leg supports, they should be attached to the upright nearest the travel lane. Supplemental plaques (advisory or distance) should not cover the surface of the parent sign.

ATTACHMENT FOR SIGN SUPPORTS

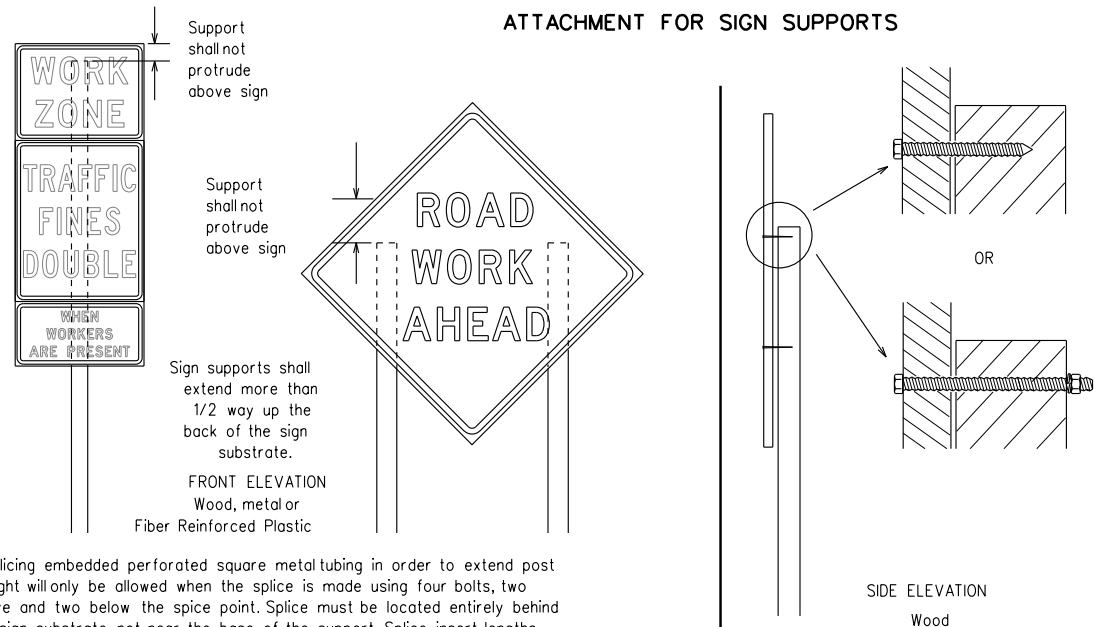


Attachment to wooden supports will be by bolts and nuts or screws. Use TxDOT's or manufacturer's recommended procedures for attaching sign substrates to other types of sign supports

Nails shall NOT be allowed.
Each sign shall be attached directly to the sign support. Multiple signs shall not be joined or spliced by any means. Wood supports shall not be extended or repaired by splicing or other means.

Splicing embedded perforated square metal tubing in order to extend post height will only be allowed when the splice is made using four bolts, two above and two below the splice point. Splice must be located entirely behind the sign substrate, not near the base of the support. Splice insert lengths should be at least 5 times nominal post size, centered on the splice and of at least the same gauge material.

STOP/SLOW PADDLES

1. STOP/SLOW paddles are the primary method to control traffic by flaggers. The STOP/SLOW paddle size should be 24" x 24".
2. STOP/SLOW paddles shall be retroreflectorized when used at night.
3. STOP/SLOW paddles may be attached to a staff with a minimum length of 6' to the bottom of the sign.
4. Any lights incorporated into the STOP or SLOW paddle faces shall only be as specifically described in Section 6E.03 Hand Signaling Devices in the TMUTCD.

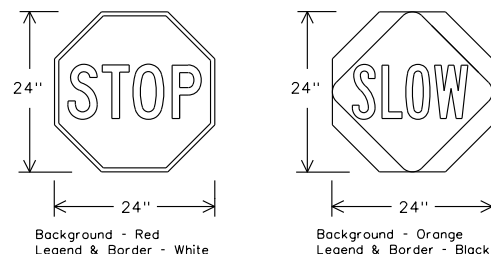

SHEETING REQUIREMENTS (WHEN USED AT NIGHT)		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	ORANGE	TYPE B _{FL} OR C _{FL} SHEETING
LEGEND & BORDER	WHITE	TYPE B OR C SHEETING
LEGEND & BORDER	BLACK	ACRYLIC NON-REFLECTIVE FILM

CONTRACTOR REQUIREMENTS FOR MAINTAINING PERMANENT SIGNS WITHIN THE PROJECT LIMITS

1. Permanent signs are used to give notice of traffic laws or regulations, call attention to conditions that are potentially hazardous to traffic operations, show route designations, destinations, directions, distances, services, points of interest, and other geographical, recreational, specific service (LOGO), or cultural information. Drivers proceeding through a work zone need the same, if not better route guidance as normally installed on a roadway without construction.
2. When permanent regulatory or warning signs conflict with work zone conditions, remove or cover the permanent signs until the permanent sign message matches the roadway condition. For details for covering large guide signs see the TS-CD standard.
3. When existing permanent signs are moved and relocated due to construction purposes, they shall be visible to motorists at all times.
4. If existing signs are to be relocated on their original supports, they shall be installed on crashworthy bases as shown on the SMD Standard sheets. The signs shall meet the required mounting heights shown on the BC Sheets or the SMD Standards. This work should be paid for under the appropriate pay item for relocating existing signs.
5. If permanent signs are to be removed and relocated using temporary supports, the Contractor shall use crashworthy supports as shown on the BC standard sheets, TLRS standard sheets or the CWZTCD list. The signs shall meet the required mounting heights shown on the BC, or the SMD standard sheets during construction. This work should be paid for under the appropriate pay item for relocating existing signs.
6. Any sign or traffic control device that is struck or damaged by the Contractor or his/her construction equipment shall be replaced as soon as possible by the Contractor to ensure proper guidance for the motorists. This will be subsidiary to Item 502.

GENERAL NOTES FOR WORK ZONE SIGNS

1. Contractor shall install and maintain signs in a straight and plumb condition and/or as directed by the Engineer.
2. Wooden sign posts shall be painted white.
3. Barricades shall NOT be used as sign supports.
4. All signs shall be installed in accordance with the plans or as directed by the Engineer. Signs shall be used to regulate, warn, and guide the traveling public safely through the work zone.
5. The Contractor may furnish either the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD). The Engineer/Inspector may require the Contractor to furnish other work zone signs that are shown in the TMUTCD but may have been omitted from the plans. Any variation in the plans shall be documented by written agreement between the Engineer and the Contractor's Responsible Person. All changes must be documented in writing before being implemented. This can include documenting the changes in the Inspector's TxDOT diary and having both the Inspector and Contractor initial and date the agreed upon changes.
6. The Contractor shall furnish sign supports listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD) for small roadside signs. Supports for temporary large roadside signs shall meet the requirements detailed on the Temporary Large Roadside Signs (TLRS) standard sheets. The Contractor shall install the sign support in accordance with the manufacturer's recommendations. If there is a question regarding installation procedures, the Contractor shall furnish the Engineer a copy of the manufacturer's installation recommendations so the Engineer can verify the correct procedures are being followed.
7. The Contractor is responsible for installing signs on approved supports and replacing signs with damaged or cracked substrates and/or damaged or marred reflective sheeting as directed by the Engineer/Inspector.
8. Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1 inch.
9. The Contractor shall replace damaged wood posts. New or damaged wood sign posts shall not be spliced.

DURATION OF WORK (as defined by the "Texas Manual on Uniform Traffic Control Devices" Part 6)

1. The types of sign supports, sign mounting height, the size of signs, and the type of sign substrates can vary based on the type of work being performed. The Engineer is responsible for selecting the appropriate size sign for the type of work being performed. The Contractor is responsible for ensuring the sign support, sign mounting height and substrate meets manufacturer's recommendations in regard to crashworthiness and duration of work requirements.
 - a. Long-term stationary - work that occupies a location more than 3 days.
 - b. Intermediate-term stationary - work that occupies a location more than one daylight period up to 3 days, or nighttime work lasting more than one hour.
 - c. Short-term stationary - daytime work that occupies a location for more than 1 hour in a single daylight period.
 - d. Short duration - work that occupies a location up to 1 hour.
 - e. Mobile - work that moves continuously or intermittently (stopping for up to approximately 15 minutes.)

SIGN MOUNTING HEIGHT

1. The bottom of Long-term/Intermediate-term signs shall be at least 7 feet, but not more than 9 feet, above the paved surface, except as shown for supplemental plaques mounted below other signs.
2. The bottom of Short-term/Short Duration signs shall be a minimum of 1 foot above the pavement surface but no more than 2 feet above the ground.
3. Long-term/Intermediate-term Signs may be used in lieu of Short-term/Short Duration signing.
4. Short-term/Short Duration signs shall be used only during daylight and shall be removed at the end of the workday or raised to appropriate Long-term/Intermediate sign height.
5. Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

SIZE OF SIGNS

1. The Contractor shall furnish the sign sizes shown on BC (2) unless otherwise shown in the plans or as directed by the Engineer.

SIGN SUBSTRATES

1. The Contractor shall ensure the sign substrate is installed in accordance with the manufacturer's recommendations for the type of sign support that is being used. The CWZTCD lists each substrate that can be used on the different types and models of sign supports.
2. "Mesh" type materials are NOT an approved sign substrate, regardless of the tightness of the weave.
3. All wooden individual sign panels fabricated from 2 or more pieces shall have one or more plywood cleat, 1/2" thick by 6" wide, fastened to the back of the sign and extending fully across the sign. The cleat shall be attached to the back of the sign using wood screws that do not penetrate the face of the sign panel. The screws shall be placed on both sides of the splice and spaced at 6" centers. The Engineer may approve other methods of splicing the sign face.

REFLECTIVE SHEETING

1. All signs shall be retroreflective and constructed of sheeting meeting the color and retro-reflectivity requirements of DMS-8300 for rigid signs or DMS-8310 for roll-up signs. The web address for DMS specifications is shown on BC(1).
2. White sheeting, meeting the requirements of DMS-8300 Type A, shall be used for signs with a white background.
3. Orange sheeting, meeting the requirements of DMS-8300 Type B or Type C, shall be used for rigid signs with orange backgrounds.

SIGN LETTERS

1. All sign letters and numbers shall be clear, and open rounded type uppercase alphabet letters as approved by the Federal Highway Administration (FHWA) and as published in the "Standard Highway Sign Design for Texas" manual. Signs, letters and numbers shall be of first class workmanship in accordance with Department Standards and Specifications.

REMOVING OR COVERING

1. When sign messages may be confusing or do not apply, the signs shall be removed or completely covered.
2. Long-term stationary or intermediate stationary signs installed on square metal tubing may be turned away from traffic 90 degrees when the sign message is not applicable. This technique may not be used for signs installed in the median of divided highways or near any intersections where the sign may be seen from approaching traffic.
3. Signs installed on wooden skids shall not be turned at 90 degree angles to the roadway. These signs should be removed or completely covered when not required.
4. When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night, without damaging the sign sheeting.
5. Burlap shall NOT be used to cover signs.
6. Duct tape or other adhesive material shall NOT be affixed to a sign face.
7. Signs and anchor stubs shall be removed and holes backfilled upon completion of work.

SIGN SUPPORT WEIGHTS

1. Where sign supports require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand should be used.
2. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
3. Rock, concrete, iron, steel or other solid objects shall not be permitted for use as sign support weights.
4. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
5. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall NOT be used.
6. Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
7. Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
8. Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

FLAGS ON SIGNS

1. Flags may be used to draw attention to warning signs. When used, the flag shall be 16 inches square or larger and shall be orange or fluorescent red-orange in color. Flags shall not be allowed to cover any portion of the sign face.

SHEET 4 OF 12



BARRICADE AND CONSTRUCTION TEMPORARY SIGN NOTES


BC(4)-21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT:	0164	SECT:	03	JOB:	056	SH:	31
REVISIONS		DIST:		COUNTY:		SHEET NO.:			
9-07	8-14	TYL		HENDERSON					12
7-13	5-21								

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 7/17/2023 6:49:12 AM
FILE: ct:\users\time\AppData\Local\Bentley\projectwise\workingdir\wpm-pw\wpm-01\tewing\w1\terpmoore.com\dms47257\BC(4)-21.dgn

DATE: 7/17/2023 6:49:13 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\pwm-pw.bentley\projectwise\workingdir\pwm-pw-01\tewing\al\termpmo-re.com\dms47257\BC(05)-21.dgn
 DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

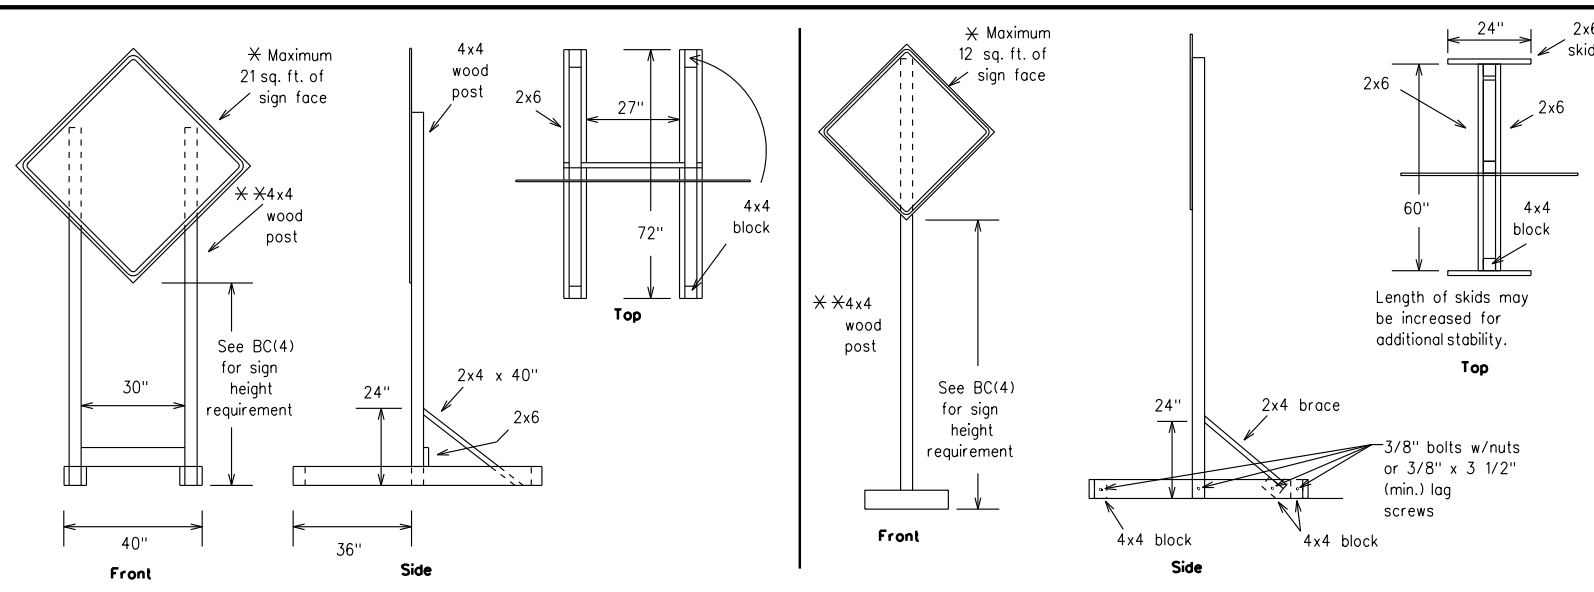


SKID MOUNTED WOOD SIGN SUPPORTS

* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

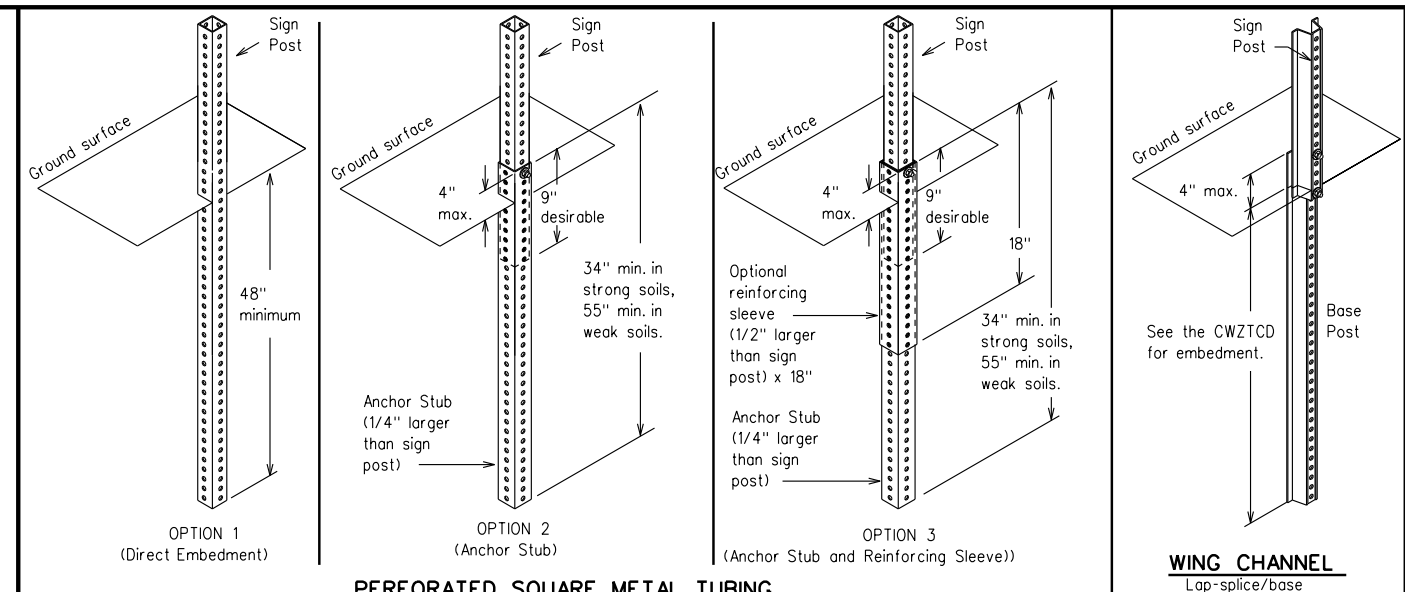

GROUND MOUNTED SIGN SUPPORTS

Refer to the CWZTCD and the manufacturer's installation procedure for each type sign support. The maximum sign square footage shall adhere to the manufacturer's recommendation. Two post installations can be used for larger signs.

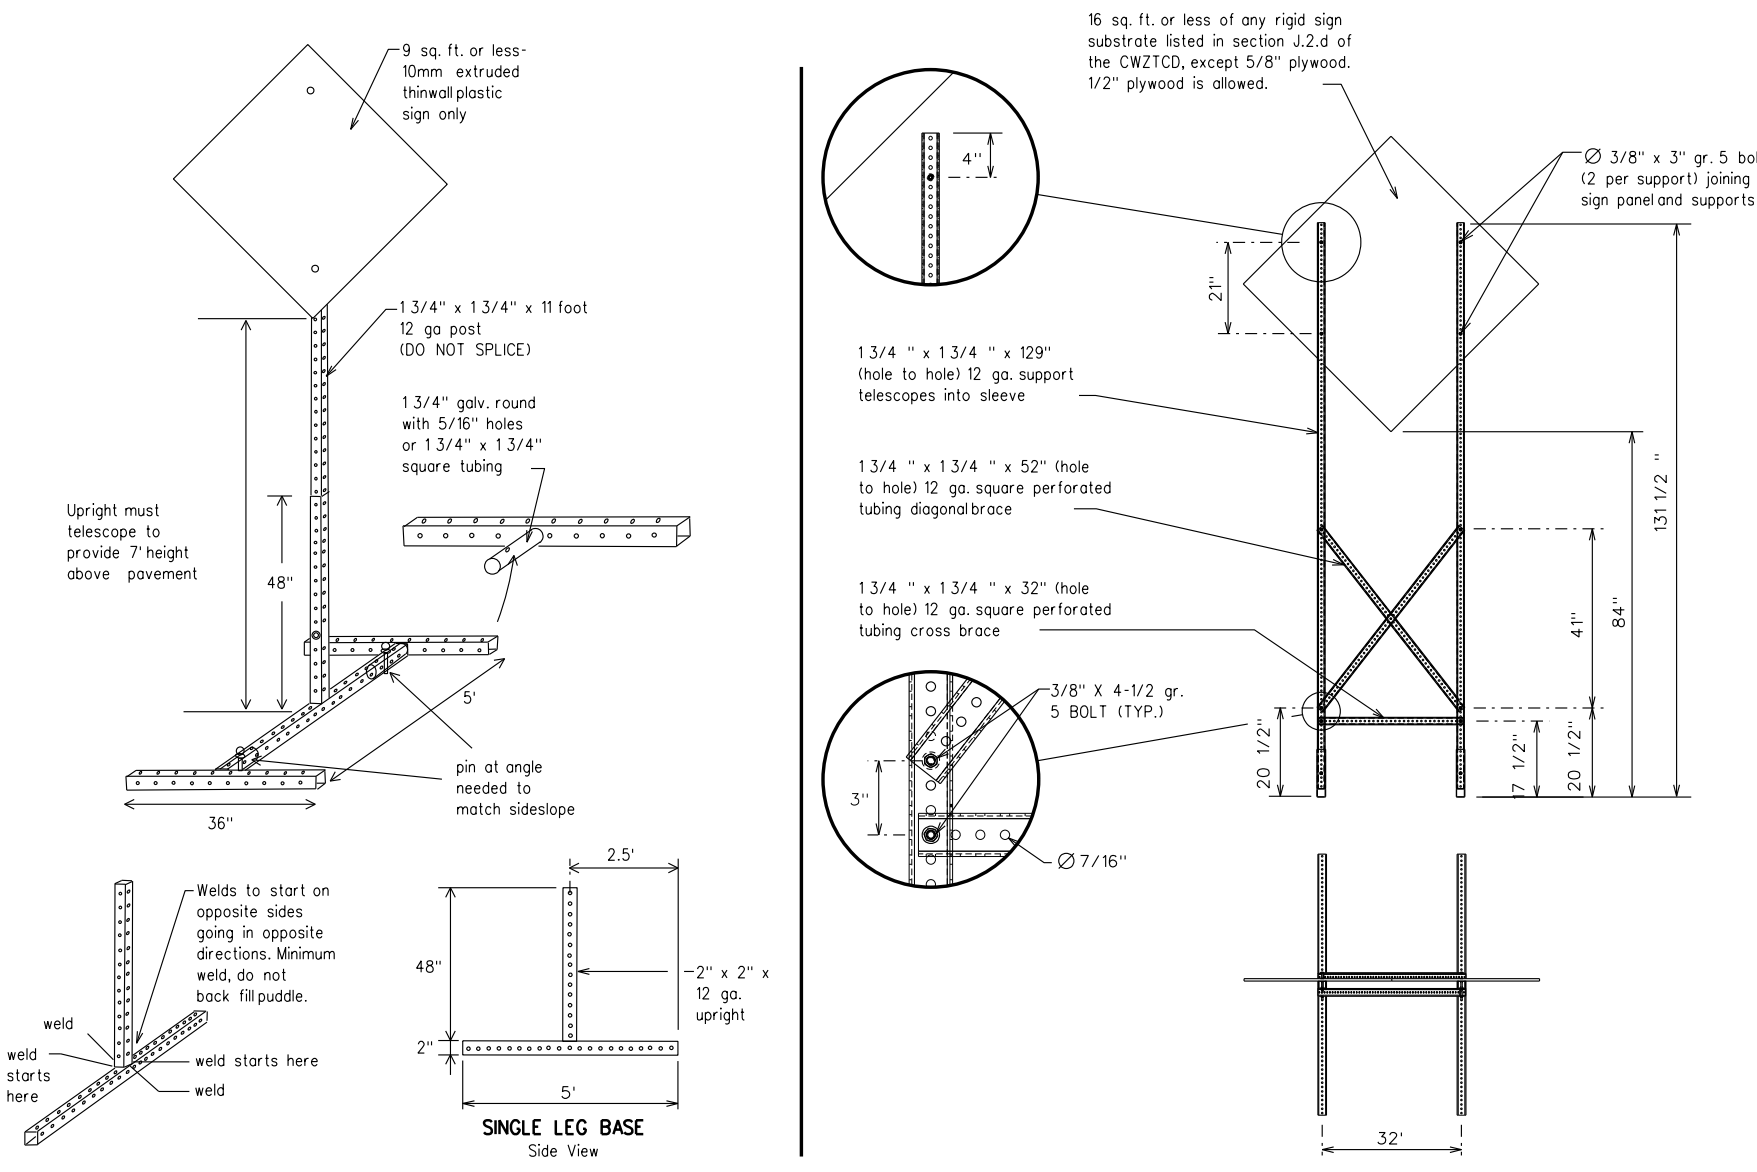

SKID MOUNTED PERFORATED SQUARE STEEL TUBING SIGN SUPPORTS

* LONG/INTERMEDIATE TERM STATIONARY - PORTABLE SKID MOUNTED SIGN SUPPORTS

WEDGE ANCHORS

Both steel and plastic Wedge Anchor Systems as shown on the SMD Standard Sheets may be used as temporary sign supports for signs up to 10 square feet of sign face. They may be set in concrete or in sturdy soils if approved by the Engineer. (See web address for "Traffic Engineering Standard Sheets" on BC(1)).

OTHER DESIGNS

MORE DETAILS OF APPROVED LONG/INTERMEDIATE AND SHORT TERM SUPPORTS CAN BE FOUND ON THE CWZTCD LIST. SEE BC(1) FOR WEBSITE LOCATION.

- #### GENERAL NOTES
- Nails may be used in the assembly of wooden sign supports, but 3/8" bolts with nuts or 3/8" x 3 1/2" lag screws must be used on every joint for final connection.
 - No more than 2 sign posts shall be placed within a 7 ft. circle, except for specific materials noted on the CWZTCD List.
 - When project is completed, all sign supports and foundations shall be removed from the project site. This will be considered subsidiary to Item 502.
- * See BC(4) for definition of "Work Duration."
 - * * Wood sign posts MUST be one piece. Splicing will NOT be allowed. Posts shall be painted white.
 - See the CWZTCD for the type of sign substrate that can be used for each approved sign support.

BARRICADE AND CONSTRUCTION TYPICAL SIGN SUPPORT

BC(5)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	TYL	HENDERSON	13	

WHEN NOT IN USE, REMOVE THE PCMS FROM THE RIGHT-OF-WAY OR PLACE THE PCMS BEHIND BARRIER OR GUARDRAIL WITH SIGN PANEL TURNED PARALLEL TO TRAFFIC

RECOMMENDED PHASES AND FORMATS FOR PCMS MESSAGES DURING ROADWORK ACTIVITIES

(The Engineer may approve other messages not specifically covered here.)

PORTABLE CHANGEABLE MESSAGE SIGNS

- The Engineer/Inspector shall approve all messages used on portable changeable message signs (PCMS).
- Messages on PCMS should contain no more than 8 words (about four to eight characters per word), not including simple words such as "TO," "FOR," "AT," etc.
- Messages should consist of a single phase, or two phases that alternate. Three-phase messages are not allowed. Each phase of the message should convey a single thought, and must be understood by itself.
- Use the word "EXIT" to refer to an exit ramp on a freeway; i.e., "EXIT CLOSED." Do not use the term "RAMP."
- Always use the route or interstate designation (IH, US, SH, FM) along with the number when referring to a roadway.
- When in use, the bottom of a stationary PCMS message panel should be a minimum 7 feet above the roadway, where possible.
- The message term "WEEKEND" should be used only if the work is to start on Saturday morning and end by Sunday evening at midnight. Actual days and hours of work should be displayed on the PCMS if work is to begin on Friday evening and/or continue into Monday morning.
- The Engineer/Inspector may select one of two options which are available for displaying a two-phase message on a PCMS. Each phase may be displayed for either four seconds each or for three seconds each.
- Do not "flash" messages or words included in a message. The message should be steady burn or continuous while displayed.
- Do not present redundant information on a two-phase message; i.e., keeping two lines of the message the same and changing the third line.
- Do not use the word "Danger" in message.
- Do not display the message "LANES SHIFT LEFT" or "LANES SHIFT RIGHT" on a PCMS. Drivers do not understand the message.
- Do not display messages that scroll horizontally or vertically across the face of the sign.
- The following table lists abbreviated words and two-word phrases that are acceptable for use on a PCMS. Both words in a phrase must be displayed together. Words or phrases not on this list should not be abbreviated, unless shown in the TMUTCD.
- PCMS character height should be at least 18 inches for trailer mounted units. They should be visible from at least 1/2 (.5) mile and the text should be legible from at least 600 feet at night and 800 feet in daylight. Truck mounted units must have a character height of 10 inches and must be legible from at least 400 feet.
- Each line of text should be centered on the message board rather than left or right justified.
- If disabled, the PCMS should default to an illegible display that will not alarm motorists and will only be used to alert workers that the PCMS has malfunctioned. A pattern such as a series of horizontal solid bars is appropriate.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

WORD OR PHRASE	ABBREVIATION	WORD OR PHRASE	ABBREVIATION
Access Road	ACCS RD	Major	MAJ
Alternate	ALT	Miles	MI
Avenue	AVE	Miles Per Hour	MPH
Best Route	BEST RTE	Minor	MNR
Boulevard	BLVD	Monday	MON
Bridge	BRDG	Normal	NORM
Cannot	CANT	North	N
Center	CTR	Northbound	(route) N
Construction Ahead	CONST AHD	Parking	PKING
CROSSING	XING	Road	RD
Detour Route	DETOUR RTE	Right Lane	RT LN
Do Not	DONT	Saturday	SAT
East	E	Service Road	SERV RD
Eastbound	(route) E	Shoulder	SHLDR
Emergency	EMER	Slippery	SLIP
Emergency Vehicle	EMER VEH	South	S
Entrance, Enter	ENT	Southbound	(route) S
Express Lane	EXP LN	Speed	SPD
Expressway	EXPWY	Street	ST
XXXX Feet	XXXX FT	Sunday	SUN
Fog Ahead	FOG AHD	Telephone	PHONE
Freeway	FRWY, FWY	Temporary	TEMP
Freeway Blocked	FWY BLKD	Thursday	THURS
Friday	FRI	To Downtown	TO DWNTN
Hazardous Driving	HAZ DRIVING	Traffic	TRAF
Hazardous Material	HAZMAT	Travelers	TRVLR
High-Occupancy Vehicle	HOV	Tuesday	TUES
Highway	HWY	Time Minutes	TIME MIN
Hour(s)	HR, HRS	Upper Level	UPR LEVEL
Information	INFO	Vehicles (s)	VEH, VEHS
It Is	ITS	Warning	WARN
Junction	JCT	Wednesday	WED
Left	LFT	Weight Limit	WT LIMIT
Left Lane	LFT LN	West	W
Lane Closed	LN CLOSED	Westbound	(route) W
Lower Level	LWR LEVEL	Wet Pavement	WET PVMT
Maintenance	MAINT	Will Not	WONT

Roadway designation * IH-number, US-number, SH-number, FM-number

Phase 1: Condition Lists

Road/Lane/Ramp Closure List

FREEWAY CLOSED X MILE
ROAD CLOSED AT SH XXX
ROAD CLSD AT FM XXXX
RIGHT X LANES CLOSED
CENTER LANE CLOSED
NIGHT LANE CLOSURES
VARIOUS LANES CLOSED
EXIT CLOSED
MALL DRIVEWAY CLOSED
XXXXXXXX BLVD CLOSED

Other Condition List

FRONTAGE ROAD CLOSED
SHOULDER CLOSED XXX FT
RIGHT LN CLOSED XXX FT
RIGHT X LANES OPEN
DAYTIME LANE CLOSURES
I-XX SOUTH EXIT CLOSED
EXIT XXX CLOSED X MILE
RIGHT LN TO BE CLOSED
X LANES CLOSED TUE - FRI

* LANES SHIFT in Phase 1 must be used with STAY IN LANE in Phase 2.

APPLICATION GUIDELINES

- Only 1 or 2 phases are to be used on a PCMS.
- The 1st phase (or both) should be selected from the "Road/Lane/Ramp Closure List" and the "Other Condition List".
- A 2nd phase can be selected from the "Action to Take/Effect on Travel, Location, General Warning, or Advance Notice Phase Lists".
- A Location Phase is necessary only if a distance or location is not included in the first phase selected.
- If two PCMS are used in sequence, they must be separated by a minimum of 1000 ft. Each PCMS should be limited to two phases, and should be understandable by themselves.
- For advance notice, when the current date is within seven days of the actual work date, calendar days should be replaced with days of the week. Advance notification should typically be for no more than one week prior to the work.

FULL MATRIX PCMS SIGNS

- When Full Matrix PCMS signs are used, the character height and legibility/visibility requirements shall be maintained as listed in Note 15 under "PORTABLE CHANGEABLE MESSAGE SIGNS" above.
- When symbol signs, such as the "Flagger Symbol" (CW20-7) are represented graphically on the Full Matrix PCMS sign and, with the approval of the Engineer, it shall maintain the legibility/visibility requirement listed above.
- When symbol signs are represented graphically on the Full Matrix PCMS, they shall only supplement the use of the static sign represented, and shall not substitute for, or replace that sign.
- A full matrix PCMS may be used to simulate a flashing arrow board provided it meets the visibility, flash rate and dimming requirements on BC(7), for the same size arrow.

Phase 2: Possible Component Lists

Action to Take/Effect on Travel List

MERGE RIGHT	FORM X LINES RIGHT
DETOUR NEXT X EXITS	USE XXXXX RD EXIT
USE EXIT XXX	USE EXIT I-XX NORTH
STAY ON US XXX SOUTH	USE I-XX E TO I-XX N
TRUCKS USE US XXX N	WATCH FOR TRUCKS
WATCH FOR TRUCKS	EXPECT DELAYS
EXPECT DELAYS	PREPARE TO STOP
REDUCE SPEED XXX FT	END SHOULDER USE
USE OTHER ROUTES	WATCH FOR WORKERS
STAY IN LANE	

Location List

AT FM XXXX
BEFORE RAILROAD CROSSING
NEXT X MILES
PAST US XXX EXIT
XXXXXXXX TO XXXXXXX
US XXX TO FM XXXX

Warning List

SPEED LIMIT XX MPH
MAXIMUM SPEED XX MPH
MINIMUM SPEED XX MPH
ADVISORY SPEED XX MPH
RIGHT LANE EXIT
USE CAUTION
DRIVE SAFELY
DRIVE WITH CARE

* * Advance Notice List

TUE-FRI XX AM-X PM
APR XX-XX X PM-X AM
BEGINS MONDAY
BEGINS MAY XX
MAY X-X XX PM - XX AM
NEXT FRI-SUN
XX AM TO XX PM
NEXT TUE AUG XX
TONIGHT XX PM-XX AM

* * See Application Guidelines Note 6.

WORDING ALTERNATIVES

- The words RIGHT, LEFT and ALL can be interchanged as appropriate.
- Roadway designations IH, US, SH, FM and LP can be interchanged as appropriate.
- EAST, WEST, NORTH and SOUTH (or abbreviations E, W, N and S) can be interchanged as appropriate.
- Highway names and numbers replaced as appropriate.
- ROAD, HIGHWAY and FREEWAY can be interchanged as needed.
- AHEAD may be used instead of distances if necessary.
- FT and MI, MILE and MILES interchanged as appropriate.
- AT, BEFORE and PAST interchanged as needed.
- Distances or AHEAD can be eliminated from the message if a location phase is used.

PCMS SIGNS WITHIN THE R.O.W. SHALL BE BEHIND GUARDRAIL OR CONCRETE BARRIER OR SHALL HAVE A MINIMUM OF FOUR (4) PLASTIC DRUMS PLACED PERPENDICULAR TO TRAFFIC ON THE UPSTREAM SIDE OF THE PCMS, WHEN EXPOSED TO ONE DIRECTION OF TRAFFIC. WHEN EXPOSED TO TWO WAY TRAFFIC, THE FOUR DRUMS SHOULD BE PLACED WITH ONE DRUM AT EACH OF THE FOUR CORNERS OF THE UNIT.

SHEET 6 OF 12



BARRICADE AND CONSTRUCTION PORTABLE CHANGEABLE MESSAGE SIGN (PCMS)

BC(6)-21

FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	TYL	HENDERSON	14	


DATE: 7/17/2023 6:49:15 AM

FILE: ct:\users\time\AppData\local\ben\proj\projectwise\workingdir\wpm-pw-bentley\projectwise\workingdir\wpm-pw-bentley.com\wpm-pw-01\newing\w1\terpmoore.com\dms47257\BC(6)-21.dgn

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 7/17/2023 6:49:16 AM
 FILE: ct:\users\tim\appdata\local\bentley\projectwise\workingdir\wpm-pw-bentley.com_wpm-pw-01\tewing\walterpmoore.com\dms47257\BC(07)-21.dgn

- Barrier Reflectors shall be pre-qualified, and conform to the color and reflectivity requirements of DMS-8600. A list of prequalified Barrier Reflectors can be found at the Material Producer List web address shown on BC(1).
- Color of Barrier Reflectors shall be as specified in the TMUTCD. The cost of the reflectors shall be considered subsidiary to Item 512.

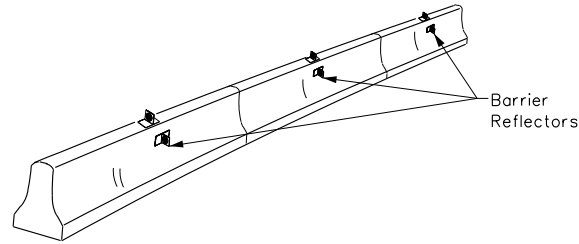

CONCRETE TRAFFIC BARRIER (CTB)

- Where traffic is on one side of the CTB, two (2) Barrier Reflectors shall be mounted in approximately the midsection of each section of CTB. An alternate mounting location is uniformly spaced at one end of each CTB. This will allow for attachment of a barrier grapple without damaging the reflector. The Barrier Reflector mounted on the side of the CTB shall be located directly below the reflector mounted on top of the barrier, as shown in the detail above.
- Where CTB separates two-way traffic, three barrier reflectors shall be mounted on each section of CTB. The reflector unit on top shall have two yellow reflective faces (Bi-Directional) while the reflectors on each side of the barrier shall have one yellow reflective face, as shown in the detail above.
- When CTB separates traffic traveling in the same direction, no barrier reflectors will be required on top of the CTB.
- Barrier Reflector units shall be yellow or white in color to match the edgeline being supplemented.
- Maximum spacing of Barrier Reflectors is forty (40) feet.
- Pavement markers or temporary flexible-reflective roadway marker tabs shall NOT be used as CTB delineation.
- Attachment of Barrier Reflectors to CTB shall be per manufacturer's recommendations.
- Missing or damaged Barrier Reflectors shall be replaced as directed by the Engineer.
- Single slope barriers shall be delineated as shown on the above detail.

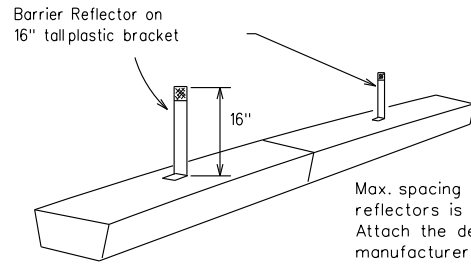


LOW PROFILE CONCRETE BARRIER (LPCB) USED IN WORK ZONES

LPCB is approved for use in work zone locations, where the posted speed is 45mph, or less. See Roadway Standard Sheet LPCB.

Max. spacing of barrier reflectors is 20 feet. Attach the delineators as per manufacturer's recommendations.

LOW PROFILE CONCRETE BARRIER (LPCB)

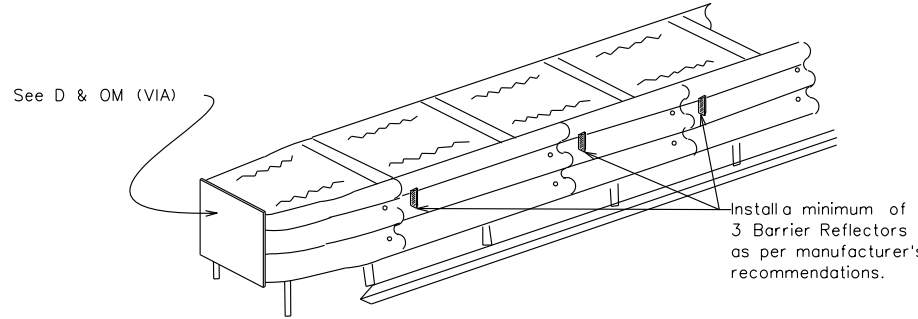

DELINEATION OF END TREATMENTS

END TREATMENTS FOR CTB'S USED IN WORK ZONES

End treatments used on CTB's in work zones shall meet the appropriate crashworthy standards as defined in the Manual for Assessing Safety Hardware (MASH). Refer to the CWZTCD List for approved end treatments and manufacturers.

BARRIER REFLECTORS FOR CONCRETE TRAFFIC BARRIER AND ATTENUATORS

WARNING LIGHTS


- Warning lights shall meet the requirements of the TMUTCD.
- Warning lights shall NOT be installed on barricades.
- Type A Low Intensity Flashing Warning Lights are commonly used with drums. They are intended to warn of or mark a potentially hazardous area. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "FL". The Type A Warning Lights shall not be used with signs manufactured with Type B or C sheeting meeting the requirements of Departmental Material Specification DMS-8300.
- Type-C and Type D degree Steady Burn Lights are intended to be used in a series for delineation to supplement other traffic control devices. Their use shall be as indicated on this sheet and/or other sheets of the plans by the designation "SB".
- The Engineer/Inspector or the plans shall specify the location and type of warning lights to be installed on the traffic control devices.
- When required by the Engineer, the Contractor shall furnish a copy of the warning lights certification. The warning light manufacturer will certify the warning lights meet the requirements of the latest ITE Purchase Specifications for Flashing and Steady-Burn Warning Lights.
- When used to delineate curves, Type-C and Type D Steady Burn Lights should only be placed on the outside of the curve, not the inside.
- The location of warning lights and warning reflectors on drums shall be as shown elsewhere in the plans.

WARNING LIGHTS MOUNTED ON PLASTIC DRUMS


- Type A flashing warning lights are intended to warn drivers that they are approaching or are in a potentially hazardous area.
- Type A random flashing warning lights are not intended for delineation and shall not be used in a series.
- A series of sequential flashing warning lights placed on channelizing devices to form a merging taper may be used for delineation. If used, the successive flashing of the sequential warning lights should occur from the beginning of the taper to the end of the merging taper in order to identify the desired vehicle path. The rate of flashing for each light shall be 65 flashes per minute, plus or minus 10 flashes.
- Type C and D steady-burn warning lights are intended to be used in a series to delineate the edge of the travel lane on detours, on lane changes, on lane closures, and on other similar conditions.
- Type A, Type C and Type D warning lights shall be installed at locations as detailed on other sheets in the plans.
- Warning lights shall not be installed on a drum that has a sign, chevron or vertical panel.
- The maximum spacing for warning lights on drums should be identical to the channelizing device spacing.

WARNING REFLECTORS MOUNTED ON PLASTIC DRUMS AS A SUBSTITUTE FOR TYPE C (STEADY BURN) WARNING LIGHTS

- A warning reflector or approved substitute may be mounted on a plastic drum as a substitute for a Type C, steady burn warning light at the discretion of the Contractor unless otherwise noted in the plans.
- The warning reflector shall be yellow in color and shall be manufactured using a sign substrate approved for use with plastic drums listed on the CWZTCD.
- The warning reflector shall have a minimum retroreflective surface area (one-side) of 30 square inches.
- Round reflectors shall be fully reflectorized, including the area where attached to the drum.
- Square substrates must have a minimum of 30 square inches of reflectorized sheeting. They do not have to be reflectorized where it attaches to the drum.
- The side of the warning reflector facing approaching traffic shall have sheeting meeting the color and retroreflectivity requirements for DMS 8300-Type B or Type C.
- When used near two-way traffic, both sides of the warning reflector shall be reflectorized.
- The warning reflector should be mounted on the side of the handle nearest approaching traffic.
- The maximum spacing for warning reflectors should be identical to the channelizing device spacing requirements.

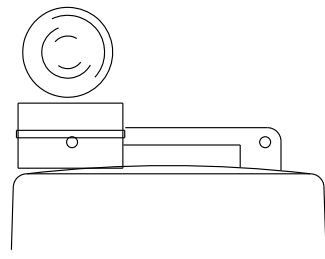


Type C Warning Light or approved substitute mounted on a drum adjacent to the travel way.

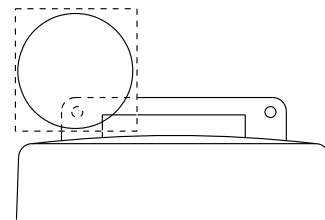

Warning reflector may be round or square. Must have a yellow reflective surface area of at least 30 square inches

Arrow Boards may be located behind channelizing devices in place for a shoulder taper or merging taper, otherwise they shall be delineated with four (4) channelizing devices placed perpendicular to traffic on the upstream side of traffic.

- The Flashing Arrow Board should be used for all lane closures on multi-lane roadways, or slow moving maintenance or construction activities on the travel lanes.
- Flashing Arrow Boards should not be used on two-lane, two-way roadways, detours, diversions or work on shoulders unless the "CAUTION" display (see detail below) is used.
- The Engineer/Inspector shall choose all appropriate signs, barricades and/or other traffic control devices that should be used in conjunction with the Flashing Arrow Board.
- The Flashing Arrow Board should be able to display the following symbols:

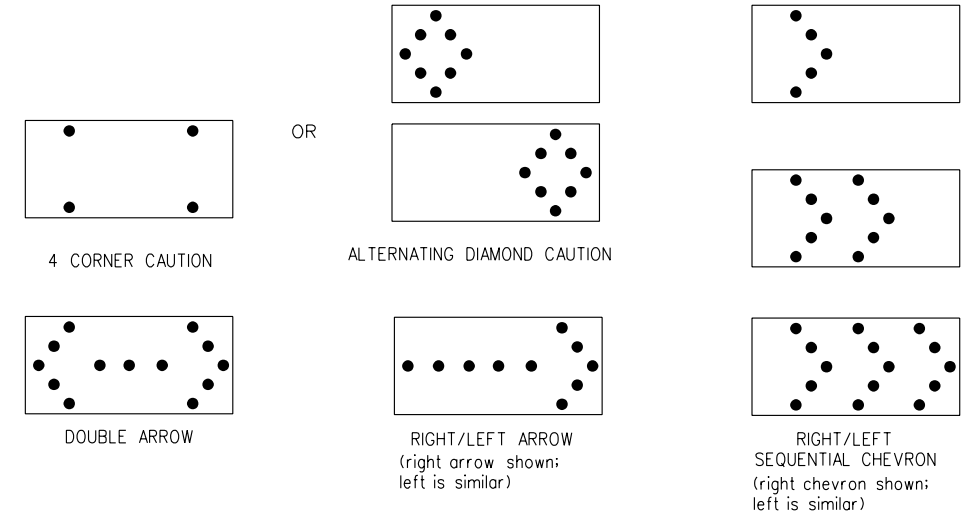

- The "CAUTION" display consists of four corner lamps flashing simultaneously, or the Alternating Diamond Caution mode as shown.
- The straight line caution display is NOT ALLOWED.
- The Flashing Arrow Board shall be capable of minimum 50 percent dimming from rated lamp voltage. The flashing rate of the lamps shall not be less than 25 nor more than 40 flashes per minute.
- Minimum lamp "on time" shall be approximately 50 percent for the flashing arrow and equal intervals of 25 percent for each sequential phase of the flashing chevron.
- The sequential arrow display is NOT ALLOWED.
- The flashing arrow display is the TxDOT standard; however, the sequential chevron display may be used during daylight operations.
- The Flashing Arrow Board shall be mounted on a vehicle, trailer or other suitable support.
- A Flashing Arrow Board SHALL NOT BE USED to laterally shift traffic.
- A full matrix PCMS may be used to simulate a Flashing Arrow Board provided it meets visibility, flash rate and dimming requirements on this sheet for the same size arrow.
- Minimum mounting height of trailer mounted Arrow Boards should be 7 feet from roadway to bottom of panel.

REQUIREMENTS			
TYPE	MINIMUM SIZE	MINIMUM NUMBER OF PANEL LAMPS	MINIMUM VISIBILITY DISTANCE
B	30 x 60	13	3/4 mile
C	48 x 96	15	1 mile

ATTENTION
 Flashing Arrow Boards shall be equipped with automatic dimming devices.

WHEN NOT IN USE, REMOVE THE ARROW BOARD FROM THE RIGHT-OF-WAY OR PLACE THE ARROW BOARD BEHIND CONCRETE TRAFFIC BARRIER OR GUARDRAIL.

FLASHING ARROW BOARDS

SHEET 7 OF 12

TRUCK-MOUNTED ATTENUATORS

- Truck-mounted attenuators (TMA) used on TxDOT facilities must meet the requirements outlined in the Manual for Assessing Safety Hardware (MASH).
- Refer to the CWZTCD for the requirements of Level 2 or Level 3 TMAs.
- Refer to the CWZTCD for a list of approved TMAs.
- TMAs are required on freeways unless otherwise noted in the plans.
- A TMA should be used anytime that it can be positioned 30 to 100 feet in advance of the area of crew exposure without adversely affecting the work performance.
- The only reason a TMA should not be required is when a work area is spread down the roadway and the work crew is an extended distance from the TMA.



BARRICADE AND CONSTRUCTION ARROW PANEL, REFLECTORS, WARNING LIGHTS & ATTENUATOR

BC(7)-21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0164	03	056	SH 31				
9-07	8-14	DIST	COUNTY		SHEET NO.				
7-13	5-21	TYL	HENDERSON		15				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.
 FILE: ct:\users\time\appdata\local\bentley\projectwise\workingdir\wpm-pw-bentley.com-wpm-pw-01\tewing@wal-terpmoore.com\dms47257\BC(8)-21.dgn
 DATE: 7/17/2023 6:49:17 AM

GENERAL NOTES

- For long term stationary work zones on freeways, drums shall be used as the primary channelizing device.
- For intermediate term stationary work zones on freeways, drums should be used as the primary channelizing device but may be replaced in tangent sections by vertical panels, or 42" two-piece cones. In tangent sections, one-piece cones may be used with the approval of the Engineer but only if personnel are present on the project at all times to maintain the cones in proper position and location.
- For short term stationary work zones on freeways, drums are the preferred channelizing device but may be replaced in tapers, transitions and tangent sections by vertical panels, two-piece cones or one-piece cones as approved by the Engineer.
- Drums and all related items shall comply with the requirements of the current version of the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD) and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Drums, bases, and related materials shall exhibit good workmanship and shall be free from objectionable marks or defects that would adversely affect their appearance or serviceability.
- The Contractor shall have a maximum of 24 hours to replace any plastic drums identified for replacement by the Engineer/Inspector. The replacement device must be an approved device.

GENERAL DESIGN REQUIREMENTS

Pre-qualified plastic drums shall meet the following requirements:




- Plastic drums shall be a two-piece design; the "body" of the drum shall be the top portion and the "base" shall be the bottom.
- The body and base shall lock together in such a manner that the body separates from the base when impacted by a vehicle traveling at a speed of 20 MPH or greater but prevents accidental separation due to normal handling and/or air turbulence created by passing vehicles.
- Plastic drums shall be constructed of lightweight flexible, and deformable materials. The Contractor shall NOT use metal drums or single piece plastic drums as channelization devices or sign supports.
- Drums shall present a profile that is a minimum of 18 inches in width at the 36 inch height when viewed from any direction. The height of drum unit (body installed on base) shall be a minimum of 36 inches and a maximum of 42 inches.
- The top of the drum shall have a built-in handle for easy pickup and shall be designed to drain water and not collect debris. The handle shall have a minimum of two widely spaced 9/16 inch diameter holes to allow attachment of a warning light, warning reflector unit or approved compliant sign.
- The exterior of the drum body shall have a minimum of four alternating orange and white retroreflective circumferential stripes not less than 4 inches nor greater than 8 inches in width. Any non-reflectORIZED space between any two adjacent stripes shall not exceed 2 inches in width.
- Bases shall have a maximum width of 36 inches, a maximum height of 4 inches, and a minimum of two footholds of sufficient size to allow base to be held down while separating the drum body from the base.
- Plastic drums shall be constructed of ultra-violet stabilized, orange, high-density polyethylene (HDPE) or other approved material.
- Drum body shall have a maximum unballasted weight of 11 lbs.
- Drum and base shall be marked with manufacturer's name and model number.

RETROREFLECTIVE SHEETING

- The stripes used on drums shall be constructed of sheeting meeting the color and retroreflectivity requirements of Departmental Materials Specification DMS-8300, "Sign Face Materials." Type A or Type B reflective sheeting shall be supplied unless otherwise specified in the plans.
- The sheeting shall be suitable for use on and shall adhere to the drum surface such that, upon vehicular impact, the sheeting shall remain adhered in-place and exhibit no delaminating, cracking, or loss of retroreflectivity other than that loss due to abrasion of the sheeting surface.


BALLAST

- Unballasted bases shall be large enough to hold up to 50 lbs. of sand. This base, when filled with the ballast material, should weigh between 35 lbs (minimum) and 50 lbs (maximum). The ballast may be sand in one to three sandbags separate from the base, sand in a sand-filled plastic base, or other ballasting devices as approved by the Engineer. Stacking of sandbags will be allowed, however height of sandbags above pavement surface may not exceed 12 inches.
- Bases with built-in ballast shall weigh between 40 lbs. and 50 lbs. Built-in ballast can be constructed of an integral crumb rubber base or a solid rubber base.
- Recycled truck tire sidewalls may be used for ballast on drums approved for this type of ballast on the CWZTCD list.
- The ballast shall not be heavy objects, water, or any material that would become hazardous to motorists, pedestrians, or workers when the drum is struck by a vehicle.
- When used in regions susceptible to freezing, drums shall have drainage holes in the bottoms so that water will not collect and freeze becoming a hazard when struck by a vehicle.
- Ballast shall not be placed on top of drums.
- Adhesives may be used to secure base of drums to pavement.

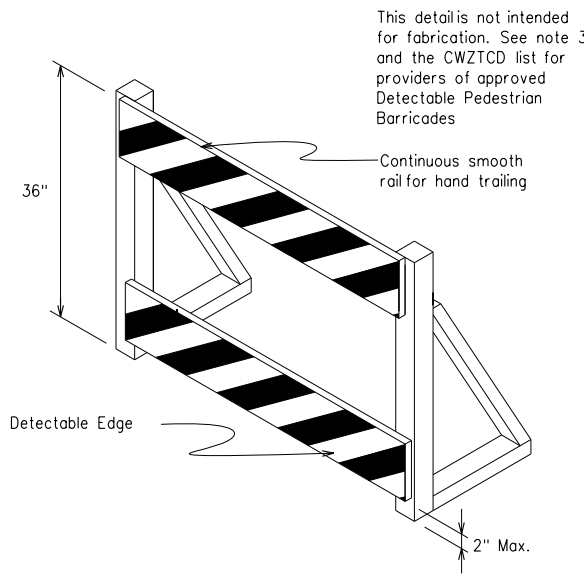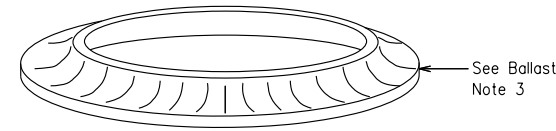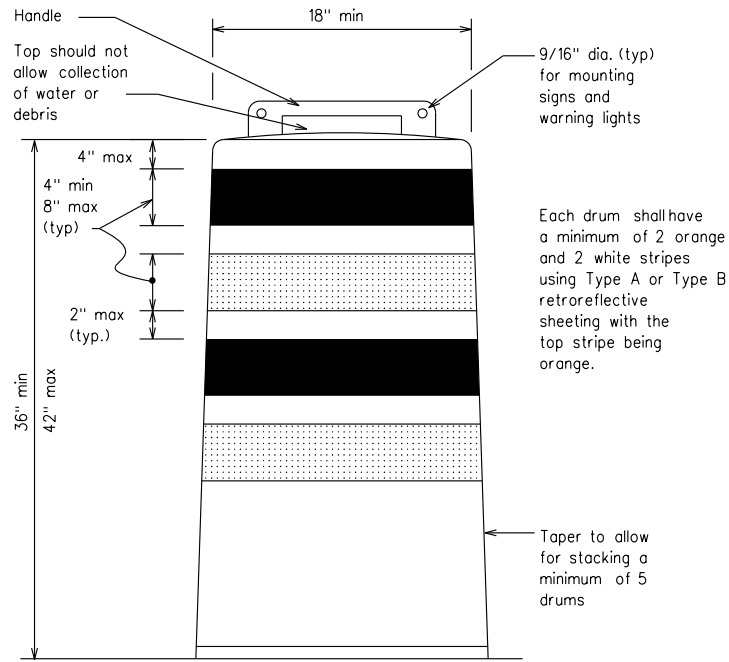


DETECTABLE PEDESTRIAN BARRICADES

- When existing pedestrian facilities are disrupted, closed, or relocated in a TTC zone, the temporary facilities shall be detectable and include accessibility features consistent with the features present in the existing pedestrian facility. Refer to WZ(BTS-2) for Pedestrian Control requirements for Sidewalk Diversions, Sidewalk Detours and Crosswalk Closures.
- Where pedestrians with visual disabilities normally use the closed sidewalk, a Detectable Pedestrian Barricade shall be placed across the full width of the closed sidewalk instead of a Type 3 Barricade.
- Detectable pedestrian barricades similar to the one pictured above, longitudinal channelizing devices, some concrete barriers, and wood or chain link fencing with a continuous detectable edging can satisfactorily delineate a pedestrian path.
- Tape, rope, or plastic chain strung between devices are not detectable, do not comply with the design standards in the "Americans with Disabilities Act Accessibility Guidelines (ADAAG)" and should not be used as a control for pedestrian movements.
- Warning lights shall not be attached to detectable pedestrian barricades.
- Detectable pedestrian barricades should use 8" nominal barricade rails as shown on BC(10) provided that the top rail provides a smooth continuous rail suitable for hand trailing with no splinters, burrs, or sharp edges.



18" x 24" Sign
(Maximum Sign Dimension)
Chevron CW1-8, Opposing Traffic Lane Divider, Driveway sign D70a, Keep Right R4 series or other signs as approved by Engineer



12" x 24" Vertical Panel
mount with diagonals sloping down towards travel way

Plywood, Aluminum or Metal sign substrates shall NOT be used on plastic drums

SIGNS, CHEVRONS, AND VERTICAL PANELS MOUNTED ON PLASTIC DRUMS

- Signs used on plastic drums shall be manufactured using substrates listed on the CWZTCD.
- Chevrons and other work zone signs with an orange background shall be manufactured with Type B or Type C Orange sheeting meeting the color and retroreflectivity requirements of DMS-8300, "Sign Face Material," unless otherwise specified in the plans.
- Vertical Panels shall be manufactured with orange and white sheeting meeting the requirements of DMS-8300 Type A or Type B. Diagonal stripes on Vertical Panels shall slope down toward the intended traveled lane.
- Other sign messages (text or symbolic) may be used as approved by the Engineer. Sign dimensions shall not exceed 18 inches in width or 24 inches in height, except for the R9 series signs discussed in note 8 below.
- Signs shall be installed using a 1/2 inch (nominal) and nut, two washers, and one locking washer for each connection.
- Mounting bolts and nuts shall be fully engaged and adequately torqued. Bolts should not extend more than 1/2 inch beyond nuts.
- Chevrons may be placed on drums on the outside of curves, on merging tapers or on shifting tapers. When used in these locations, they may be placed on every drum or spaced not more than on every third drum. A minimum of three (3) should be used at each location called for in the plans.
- R9-9, R9-10, R9-11 and R9-11a Sidewalk Closed signs which are 24 inches wide may be mounted on plastic drums, with approval of the Engineer.

SHEET 8 OF 12




BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC(8)-21

FILE:	bc-21.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	November 2002	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0164	03	056	SH 31				
4-03	8-14	DIST	COUNTY		SHEET NO.				
9-07	5-21	TYL	HENDERSON		16				
7-13									


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023 6:49:18 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\pwm-pw.bentley.com\pwm-pw-01\tewing\w1\terpmoore.com\dms47257\BC(09)-21.dgn

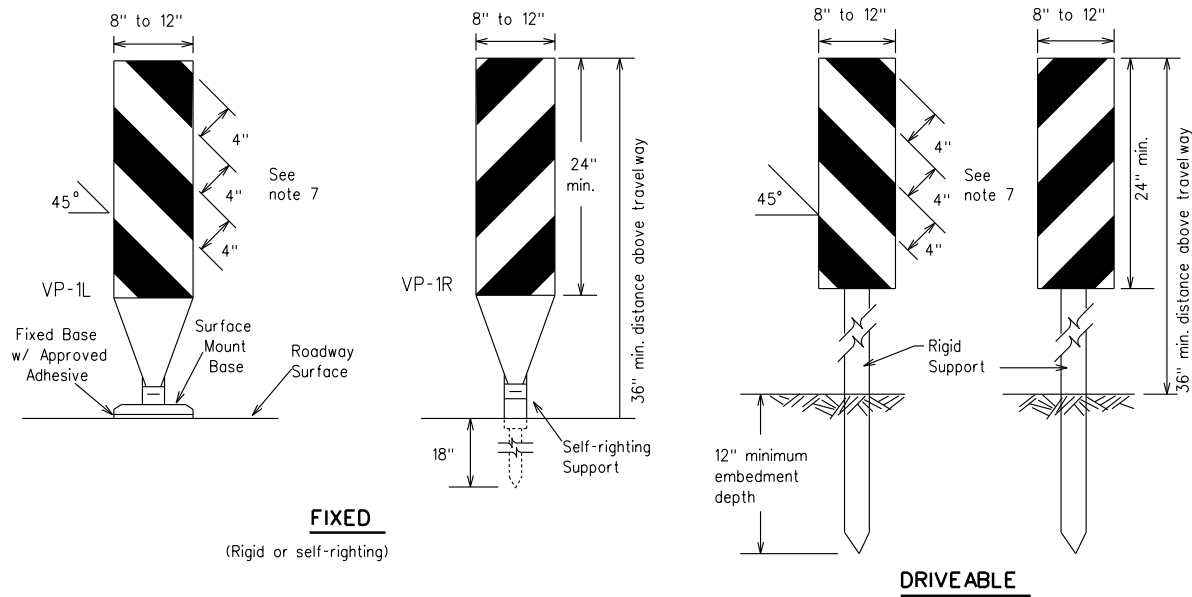

FIXED
(Rigid or self-righting)


DRIVEABLE

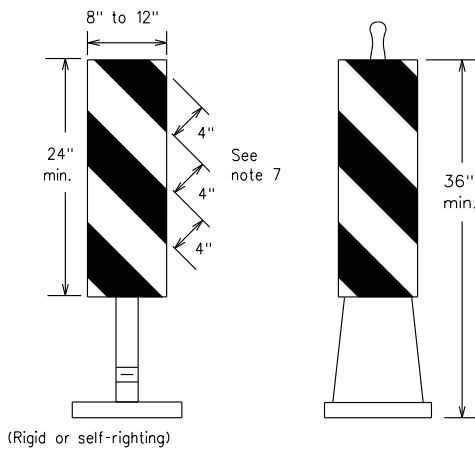

PORTABLE


VERTICAL PANELS (VPs)

- Vertical Panels (VP's) are normally used to channelize traffic or divide opposing lanes of traffic.
- VP's may be used in daytime or nighttime situations. They may be used at the edge of shoulder drop-offs and other areas such as lane transitions where positive daytime and nighttime delineation is required. The Engineer/Inspector shall refer to the Roadway Design Manual for additional requirements on the use VP's for drop-offs.
- VP's should be mounted back to back if used at the edge of cuts adjacent to two-way two lane roadways. Stripes are to be reflective orange and reflective white and should always slope downward toward the travel lane.
- VP's used on expressways and freeways or other high speed roadways, may have more than 270 square inches of retroreflective area facing traffic.
- Self-righting supports are available with portable base. See "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- Sheeting for the VP's shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300, unless noted otherwise.
- Where the height of reflective material on the vertical panel is 36 inches or greater, a panel stripe of 6 inches shall be used.

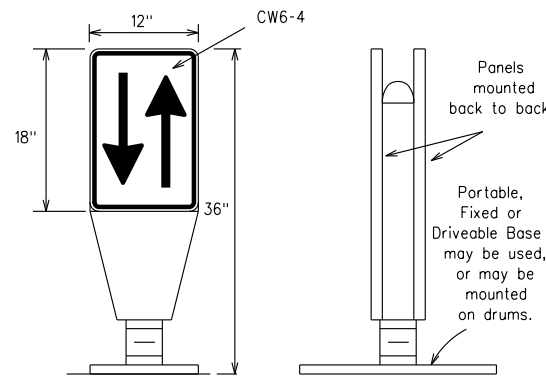

OPPOSING TRAFFIC LANE DIVIDERS (OTLD)


- Opposing Traffic Lane Dividers (OTLD) are delineation devices designed to convert a normal one-way roadway section to two-way operation. OTLD's are used on temporary centerlines. The upward and downward arrows on the sign's face indicate the direction of traffic on either side of the divider. The base is secured to the pavement with an adhesive or rubber weight to minimize movement caused by a vehicle impact or wind gust.
- The OTLD may be used in combination with 42" cones or VP's.
- Spacing between the OTLD shall not exceed 500 feet. 42" cones or VP's placed between the OTLD's should not exceed 100 foot spacing.
- The OTLD shall be orange with a black non-reflective legend. Sheeting for the OTLD shall be retroreflective Type B or Type C conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.

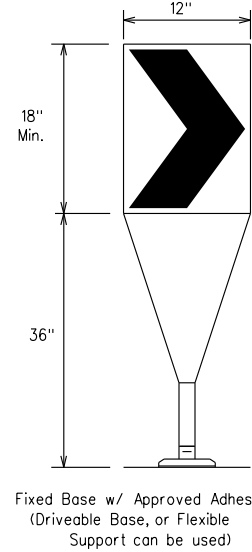

Fixed Base w/ Approved Adhesive (Driveable Base, or Flexible Support can be used)

- The chevron shall be a vertical rectangle with a minimum size of 12 by 18 inches.
- Chevrons are intended to give notice of a sharp change of alignment with the direction of travel and provide additional emphasis and guidance for vehicle operators with regard to changes in horizontal alignment of the roadway.
- Chevrons, when used, shall be erected on the outside of a sharp curve or turn, or on the far side of an intersection. They shall be in line with and at right angles to approaching traffic. Spacing should be such that the motorist always has three in view, until the change in alignment eliminates its need.
- To be effective, the chevron should be visible for at least 500 feet.
- Chevrons shall be orange with a black nonreflective legend. Sheeting for the chevron shall be retroreflective Type B or Type C conforming to Departmental Material Specification DMS-8300, unless noted otherwise. The legend shall meet the requirements of DMS-8300.
- For Long Term Stationary use on tapers or transitions on freeways and divided highways, self-righting chevrons may be used to supplement plastic drums but not to replace plastic drums.

CHEVRONS

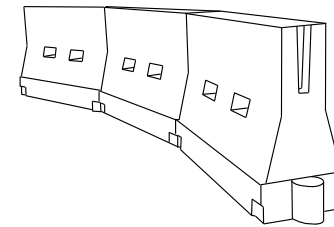

LONGITUDINAL CHANNELIZING DEVICES (LCD)

- LCDs are crashworthy, lightweight, deformable devices that are highly visible, have good target value and can be connected together. They are not designed to contain or redirect a vehicle on impact.
- LCDs may be used instead of a line of cones or drums.
- LCDs shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- LCDs should not be used to provide positive protection for obstacles, pedestrians or workers.
- LCDs shall be supplemented with retroreflective delineation as required for temporary barriers on BC(7) when placed roughly parallel to the travel lanes.
- LCDs used as barricades placed perpendicular to traffic should have at least one row of reflective sheeting meeting the requirements for barricade rails as shown on BC(10). Place reflective sheeting near the top of the LCD along the full length of the device.

WATER BALLASTED SYSTEMS USED AS BARRIERS

- Water ballasted systems used as barriers shall not be used solely to channelize road users, but also to protect the work space per the appropriate Manual for Assessing Safety Hardware (MASH) crashworthiness requirements based on roadway speed and barrier application.
- Water ballasted systems used to channelize vehicular traffic shall be supplemented with retroreflective delineation or channelizing devices to improve daytime/nighttime visibility. They may also be supplemented with pavement markings.
- Water ballasted systems used as barriers shall be placed in accordance to application and installation requirements specific to the device, and used only when shown on the CWZTCD list.
- Water ballasted systems used as barriers should not be used for a merging taper except in low speed (less than 45 MPH) urban areas. When used on a taper in a low speed urban area, the taper shall be delineated and the taper length should be designed to optimize road user operations considering the available geometric conditions.
- When water ballasted systems used as barriers have blunt ends exposed to traffic, they should be attenuated as per manufacturer recommendations or flared to a point outside the clear zone.

If used to channelize pedestrians, longitudinal channelizing devices or water ballasted systems must have a continuous detectable bottom for users of long canes and the top of the unit shall not be less than 32 inches in height.

HOLLOW OR WATER BALLASTED SYSTEMS USED AS LONGITUDINAL CHANNELIZING DEVICES OR BARRIERS

GENERAL NOTES

- Work Zone channelizing devices illustrated on this sheet may be installed in close proximity to traffic and are suitable for use on high or low speed roadways. The Engineer/Inspector shall ensure that spacing and placement is uniform and in accordance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
- Channelizing devices shown on this sheet may have a driveable, fixed or portable base. The requirement for self-righting channelizing devices must be specified in the General Notes or other plan sheets.
- Channelizing devices on self-righting supports should be used in work zone areas where channelizing devices are frequently impacted by errant vehicles or vehicle related wind gusts making alignment of the channelizing devices difficult to maintain. Locations of these devices shall be detailed elsewhere in the plans. These devices shall conform to the TMUTCD and the "Compliant Work Zone Traffic Control Devices List" (CWZTCD).
- The Contractor shall maintain devices in a clean condition and replace damaged, nonreflective, faded, or broken devices and bases as required by the Engineer/Inspector. The Contractor shall be required to maintain proper device spacing and alignment.
- Portable bases shall be fabricated from virgin and/or recycled rubber. The portable bases shall weigh a minimum of 30 lbs.
- Pavement surfaces shall be prepared in a manner that ensures proper bonding between the adhesives, the fixed mount bases and the pavement surface. Adhesives shall be prepared and applied according to the manufacturer's recommendations.
- The installation and removal of channelizing devices shall not cause detrimental effects to the final pavement surfaces, including pavement surface discoloration or surface integrity. Driveable bases shall not be permitted on final pavement surfaces. The Engineer/Inspector shall approve all application and removal procedures of fixed bases.

Posted Speed	Formula	Minimum Desirable Taper Lengths x x			Suggested Maximum Spacing of Channelizing Devices	
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent
30	L = WS ² / 60	150'	165'	180'	30'	60'
35		205'	225'	245'	35'	70'
40		265'	295'	320'	40'	80'
45	L = WS	450'	495'	540'	45'	90'
50		500'	550'	600'	50'	100'
55		550'	605'	660'	55'	110'
60		600'	660'	720'	60'	120'
65		650'	715'	780'	65'	130'
70		700'	770'	840'	70'	140'
75		750'	825'	900'	75'	150'
80		800'	880'	960'	80'	160'

x x Taper lengths have been rounded off.
 L- Length of Taper (FT.) W- Width of Offset (FT.)
 S- Posted Speed (MPH)

SUGGESTED MAXIMUM SPACING OF CHANNELIZING DEVICES AND MINIMUM DESIRABLE TAPER LENGTHS

SHEET 9 OF 12



BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES

BC(9)-21


FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT November 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
9-07 8-14	DIST	COUNTY	SHEET NO.	
7-13 5-21	TYL	HENDERSON	17	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.
 FILE: ct:\users\time\update\local\bentley\projectwise\workingdir\wpm-pw-01\tewing\w1\terpmoore.com\dms47257\BC(10)-21.dgn
 DATE: 7/17/2023 6:49:19 AM
 FILE: ct:\users\time\update\local\bentley\projectwise\workingdir\wpm-pw-01\tewing\w1\terpmoore.com\dms47257\BC(10)-21.dgn


TYPE 3 BARRICADES

1. Refer to the Compliant Work Zone Traffic Control Devices List (CWZTCD) for details of the Type 3 Barricades and a list of all materials used in the construction of Type 3 Barricades.
2. Type 3 Barricades shall be used at each end of construction projects closed to all traffic.
3. Barricades extending across a roadway should have stripes that slope downward in the direction toward which traffic must turn in detouring. When both right and left turns are provided, the chevron striping may slope downward in both directions from the center of the barricade. Where no turns are provided at a closed road, striping should slope downward in both directions toward the center of roadway.
4. Striping of rails, for the right side of the roadway, should slope downward to the left. For the left side of the roadway, striping should slope downward to the right.
5. Identification markings may be shown only on the back of the barricade rails. The maximum height of letters and/or company logos used for identification shall be 1".
6. Barricades shall not be placed parallel to traffic unless an adequate clear zone is provided.
7. Warning lights shall NOT be installed on barricades.
8. Where barricades require the use of weights to keep from turning over, the use of sandbags with dry, cohesionless sand is recommended. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight. Sand bags shall not be stacked in a manner that covers any portion of a barricade rails reflective sheeting. Rock, concrete, iron, steel or other solid objects will NOT be permitted. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber (such as tire inner tubes) shall not be used for sandbags. Sandbags shall only be placed along or upon the base supports of the device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners.
9. Sheeting for barricades shall be retroreflective Type A or Type B conforming to Departmental Material Specification DMS-8300 unless otherwise noted.

Barricades shall NOT be used as a sign support.




TYPICAL STRIPING DETAIL FOR BARRICADE RAIL

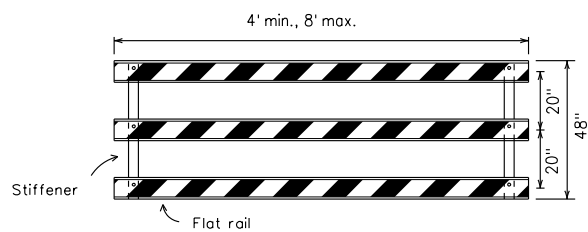

TYPICAL PANEL DETAIL FOR SKID OR POST TYPE BARRICADES


Each roadway of a divided highway shall be barricaded in the same manner.

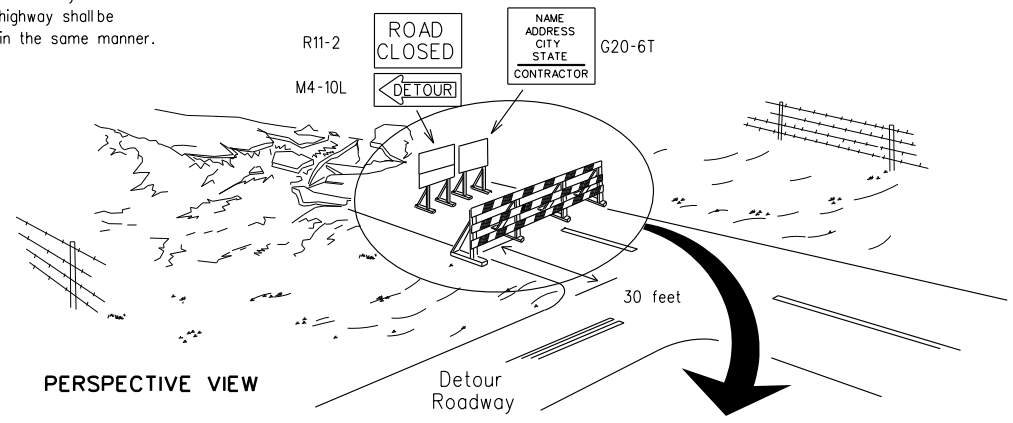

PERSPECTIVE VIEW


The three rails on Type 3 barricades shall be reflectorized orange and reflective white stripes on one side facing one-way traffic and both sides for two-way traffic. Barricade striping should slant downward in the direction of detour.

1. Signs should be mounted on independent supports at a 7 foot mounting height in center of roadway. The signs should be a minimum of 10 feet behind Type 3 Barricades.
2. Advance signing shall be as specified elsewhere in the plans.

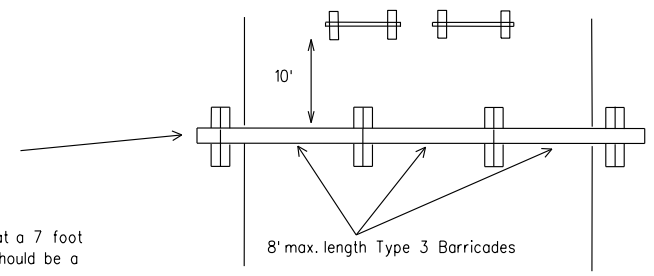


PLAN VIEW

TYPE 3 BARRICADE (POST AND SKID) TYPICAL APPLICATION

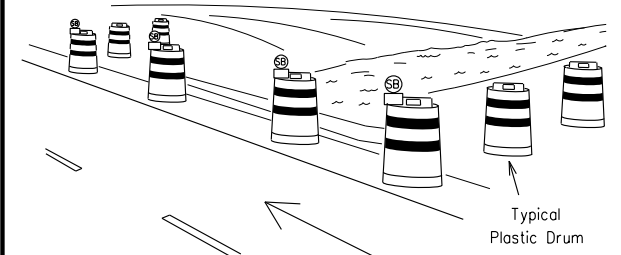

PERSPECTIVE VIEW

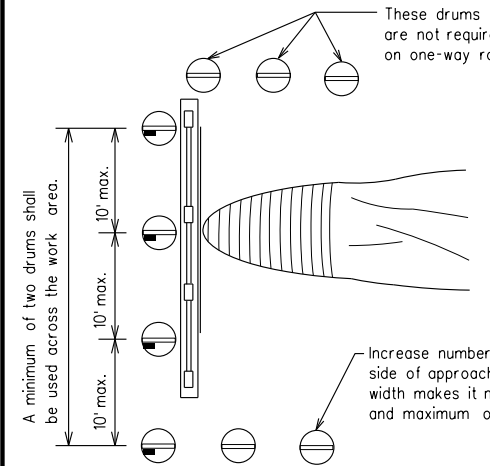


PLAN VIEW

1. Where positive redirection capability is provided, drums may be omitted.
2. Plastic construction fencing may be used with drums for safety as required in the plans.
3. Vertical Panels on flexible support may be substituted for drums when the shoulder width is less than 4 feet.
4. When the shoulder width is greater than 12 feet, steady-burn lights may be omitted if drums are used.
5. Drums must extend the length of the culvert widening.

LEGEND	
	Plastic drum
	Plastic drum with steady burn light or yellow warning reflector
	Steady burn warning light or yellow warning reflector

CULVERT WIDENING OR OTHER ISOLATED WORK WITHIN THE PROJECT LIMITS

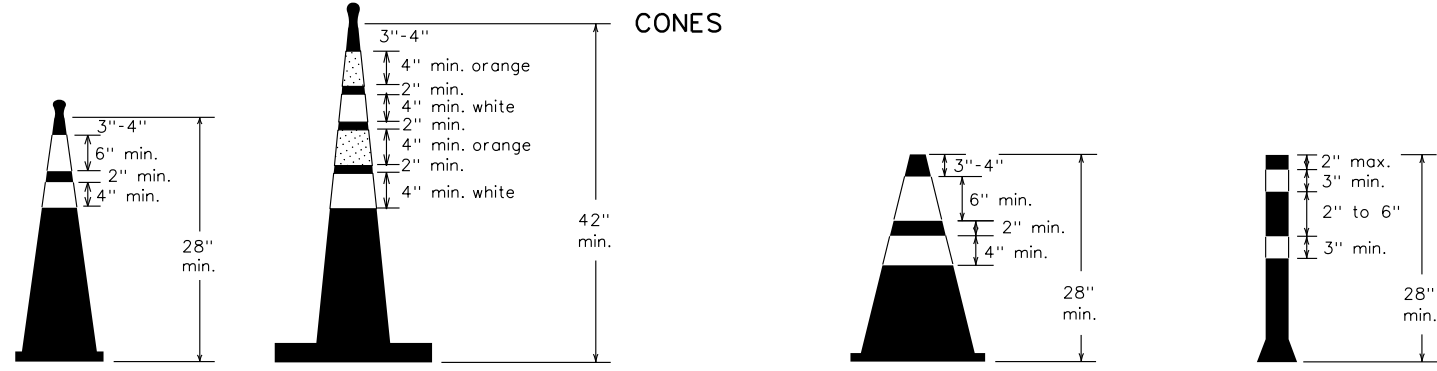


Two-Piece cones

One-Piece cones

Tubular Marker

28" Cones shall have a minimum weight of 9 1/2 lbs.
 42" 2-piece cones shall have a minimum weight of 30 lbs. including base.

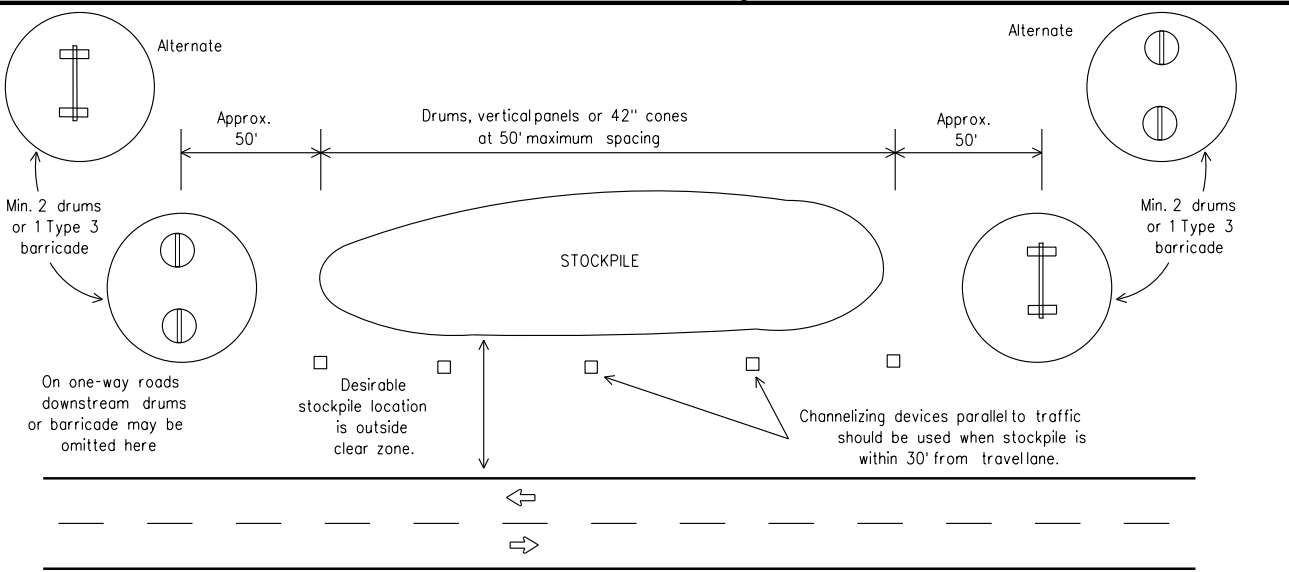

TRAFFIC CONTROL FOR MATERIAL STOCKPILES

1. Traffic cones and tubular markers shall be predominantly orange, and meet the height and weight requirements shown above.
2. One-piece cones have the body and base of the cone molded in one consolidated unit. Two-piece cones have a cone shaped body and a separate rubber base, or ballast, that is added to keep the device upright and in place.
3. Two-piece cones may have a handle or loop extending up to 8" above the minimum height shown, in order to aid in retrieving the device.
4. Cones or tubular markers shall have white or white and orange reflective bands as shown above. The reflective bands shall have a smooth, sealed outer surface and meet the requirements of Departmental Material Specification DMS-8300 Type A or Type B.
5. 28" cones and tubular markers are generally suitable for short duration and short-term stationary work as defined on BC(4). These should not be used for intermediate-term or long-term stationary work unless personnel is on-site to maintain them in their proper upright position.
6. 42" two-piece cones, vertical panels or drums are suitable for all work zone durations.
7. Cones or tubular markers used on each project should be of the same size and shape.

		Traffic Safety Division Standard	
<h2>BARRICADE AND CONSTRUCTION CHANNELIZING DEVICES</h2>			
<h3>BC(10)-21</h3>			
FILE:	bc-21.dgn	DN:	TxDOT
© TxDOT	November 2002	CK:	TxDOT
REVISIONS		DW:	TxDOT
0164	03	CK:	TxDOT
9-07	8-14	JOB	HIGHWAY
7-13	5-21	056	SH 31
		DIST	COUNTY
		TYL	HENDERSON
			SHEET NO.
			18

WORK ZONE PAVEMENT MARKINGS

GENERAL

1. The Contractor shall be responsible for maintaining work zone and existing pavement markings, in accordance with the standard specifications and special provisions, on all roadways open to traffic within the CSJ limits unless otherwise stated in the plans.
2. Color, patterns and dimensions shall be in conformance with the "Texas Manual on Uniform Traffic Control Devices" (TMUTCD).
3. Additional supplemental pavement marking details may be found in the plans or specifications.
4. Pavement markings shall be installed in accordance with the TMUTCD and as shown on the plans.
5. When short term markings are required on the plans, short term markings shall conform with the TMUTCD, the plans and details as shown on the Standard Plan Sheet WZ(STPM).
6. When standard pavement markings are not in place and the roadway is opened to traffic, DO NOT PASS signs shall be erected to mark the beginning of the sections where passing is prohibited and PASS WITH CARE signs at the beginning of sections where passing is permitted.
7. All work zone pavement markings shall be installed in accordance with Item 662, "Work Zone Pavement Markings."

RAISED PAVEMENT MARKERS

1. Raised pavement markers are to be placed according to the patterns on BC(12).
2. All raised pavement markers used for work zone markings shall meet the requirements of Item 672, "RAISED PAVEMENT MARKERS" and Departmental Material Specification DMS-4200 or DMS-4300.

PREFABRICATED PAVEMENT MARKINGS

1. Removable prefabricated pavement markings shall meet the requirements of DMS-8241.
2. Non-removable prefabricated pavement markings (foil back) shall meet the requirements of DMS-8240.


MAINTAINING WORK ZONE PAVEMENT MARKINGS

1. The Contractor will be responsible for maintaining work zone pavement markings within the work limits.
2. Work zone pavement markings shall be inspected in accordance with the frequency and reporting requirements of work zone traffic control device inspections as required by Form 599.
3. The markings should provide a visible reference for a minimum distance of 300 feet during normal daylight hours and 160 feet when illuminated by automobile low-beam headlights at night, unless sight distance is restricted by roadway geometrics.
4. Markings failing to meet this criteria within the first 30 days after placement shall be replaced at the expense of the Contractor as per Specification Item 662.

REMOVAL OF PAVEMENT MARKINGS

1. Pavement markings that are no longer applicable, could create confusion or direct a motorist toward or into the closed portion of the roadway shall be removed or obliterated before the roadway is opened to traffic.
2. The above shall not apply to detours in place for less than three days, where floggers and/or sufficient channelizing devices are used in lieu of markings to outline the detour route.
3. Pavement markings shall be removed to the fullest extent possible, so as not to leave a discernable marking. This shall be by any method approved by TxDOT Specification Item 677 for "Eliminating Existing Pavement Markings and Markers".
4. The removal of pavement markings may require resurfacing or seal coating portions of the roadway as described in Item 677.
5. Subject to the approval of the Engineer, any method that proves to be successful on a particular type pavement may be used.
6. Blast cleaning may be used but will not be required unless specifically shown in the plans.
7. Over-painting of the markings SHALL NOT BE permitted.
8. Removal of raised pavement markers shall be as directed by the Engineer.
9. Removal of existing pavement markings and markers will be paid for directly in accordance with Item 677, "ELIMINATING EXISTING PAVEMENT MARKINGS AND MARKERS," unless otherwise stated in the plans.
10. Black-out marking tape may be used to cover conflicting existing markings for periods less than two weeks when approved by the Engineer.

Temporary Flexible-Reflective Roadway Marker Tabs

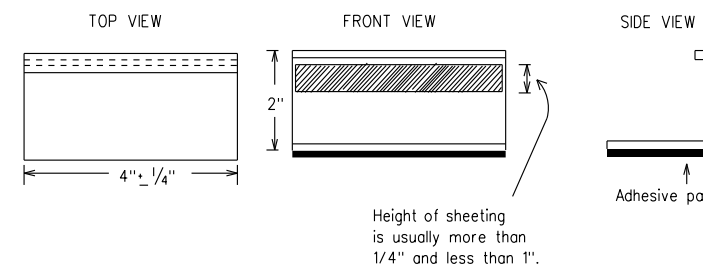

**STAPLES OR NAILS SHALL NOT BE USED TO SECURE
TEMPORARY FLEXIBLE-REFLECTIVE ROADWAY MARKER
TABS TO THE PAVEMENT SURFACE**

1. Temporary flexible-reflective roadway marker tabs used as guidemarks shall meet the requirements of DMS-8242.
2. Tabs detailed on this sheet are to be inspected and accepted by the Engineer or designated representative. Sampling and testing is not normally required, however at the option of the Engineer, either "A" or "B" below may be imposed to assure quality before placement on the roadway.
 - A. Select five (5) or more tabs at random from each lot or shipment and submit to the Construction Division, Materials and Pavement Section to determine specification compliance.
 - B. Select five (5) tabs and perform the following test. Affix five (5) tabs at 24 inch intervals on an asphaltic pavement in a straight line. Using a medium size passenger vehicle or pickup, run over the markers with the front and rear tires at a speed of 35 to 40 miles per hour, four (4) times in each direction. No more than one (1) out of the five (5) reflective surfaces shall be lost or displaced as a result of this test.
3. Small design variances may be noted between tab manufacturers.
4. See Standard Sheet WZ(STPM) for tab placement on new pavements. See Standard Sheet TCP(7-1) for tab placement on seal coat work.

RAISED PAVEMENT MARKERS USED AS GUIDEMARKS

1. Raised pavement markers used as guidemarks shall be from the approved product list, and meet the requirements of DMS-4200.
2. All temporary construction raised pavement markers provided on a project shall be of the same manufacturer.
3. Adhesive for guidemarks shall be bituminous material hot applied or butyl rubber pad for all surfaces, or thermoplastic for concrete surfaces.

Guidemarks shall be designated as:
 YELLOW - (two amber reflective surfaces with yellow body).
 WHITE - (one silver reflective surface with white body).

DEPARTMENTAL MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
TRAFFIC BUTTONS	DMS-4300
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240
TEMPORARY REMOVABLE, PREFABRICATED PAVEMENT MARKINGS	DMS-8241
TEMPORARY FLEXIBLE, REFLECTIVE ROADWAY MARKER TABS	DMS-8242

A list of prequalified reflective raised pavement markers, non-reflective traffic buttons, roadway marker tabs and other pavement markings can be found at the Material Producer List web address shown on BC(1).

SHEET 11 OF 12




BARRICADE AND CONSTRUCTION PAVEMENT MARKINGS

BC(11)-21


FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS		0164	03	056
2-98	9-07	5-21		
1-02	7-13			
11-02	8-14	TYL	HENDERSON	SH 31
				SHEET NO.
				19

DATE: 7/17/2023 6:49:20 AM
 FILE: c:\users\ttime\appdata\local\bentley\projectwise\workingdir\wpm-pw-bentley.com\projectwise\workingdir\wpm-pw-bentley.com\wpm-pw-01\wpm-pw-01\terpmore.com\dms4257\BC(11)-21.dgn
 DISCLAIMER: This use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

PAVEMENT MARKING PATTERNS

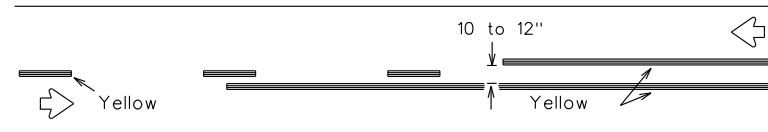


REFLECTORIZED PAVEMENT MARKINGS - PATTERN A

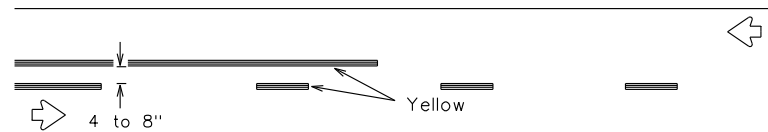


REFLECTORIZED PAVEMENT MARKINGS - PATTERN B

Pattern A is the TXDOT Standard, however Pattern B may be used if approved by the Engineer. Prefabricated markings may be substituted for reflectORIZED pavement markings.

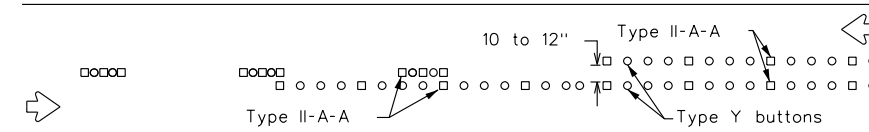


RAISED PAVEMENT MARKERS - PATTERN A

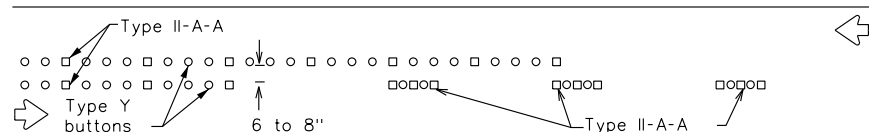


RAISED PAVEMENT MARKERS - PATTERN B

CENTER LINE & NO-PASSING ZONE BARRIER LINES FOR TWO-LANE, TWO-WAY HIGHWAYS

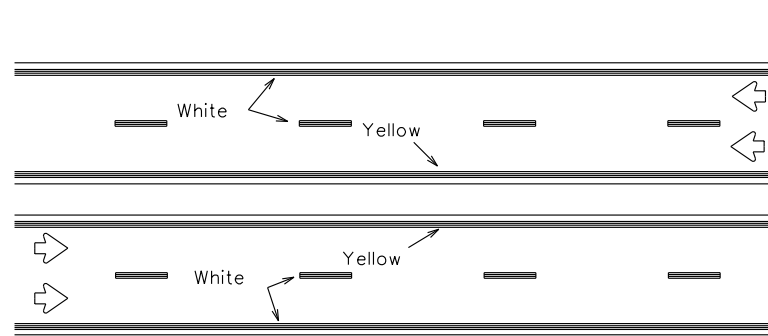


REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

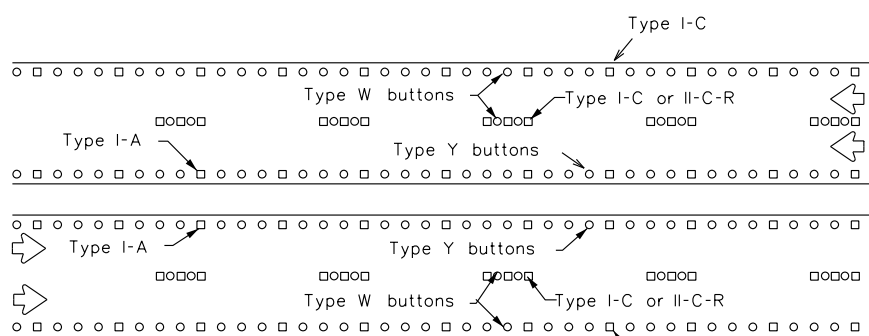


RAISED PAVEMENT MARKERS

EDGE & LANE LINES FOR DIVIDED HIGHWAY

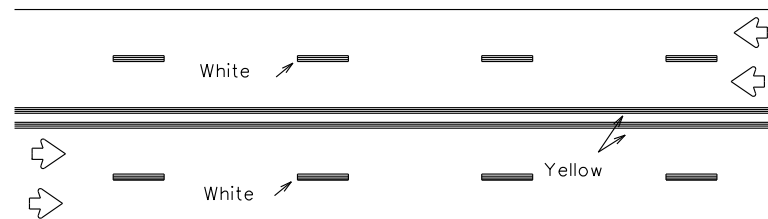


REFLECTORIZED PAVEMENT MARKINGS

Prefabricated markings may be substituted for reflectORIZED pavement markings.

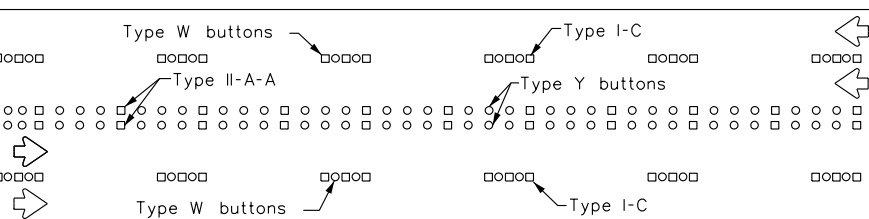


RAISED PAVEMENT MARKERS

LANE & CENTER LINES FOR MULTILANE UNDIVIDED HIGHWAYS

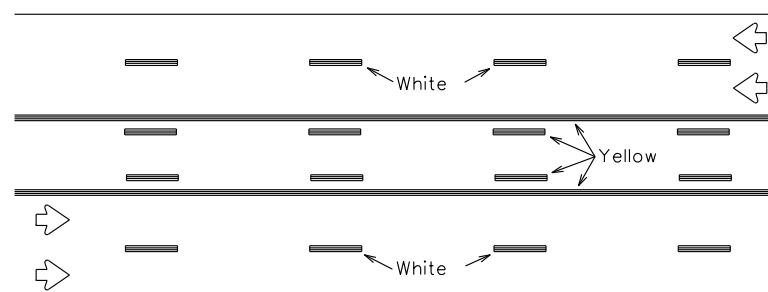

REFLECTORIZED PAVEMENT MARKINGS


Prefabricated markings may be substituted for reflectORIZED pavement markings.

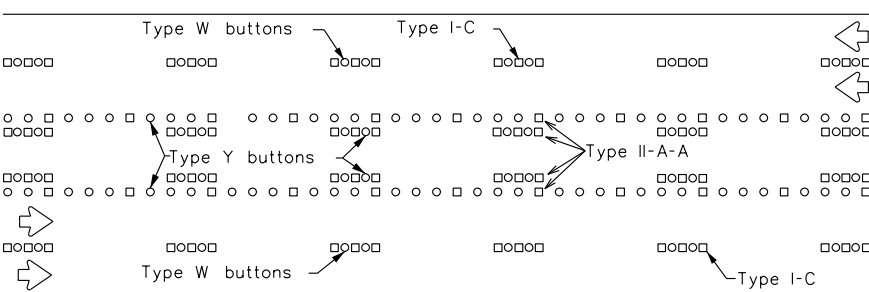




RAISED PAVEMENT MARKERS

TWO-WAY LEFT TURN LANE


STANDARD WORK ZONE PAVEMENT MARKINGS DETAILS

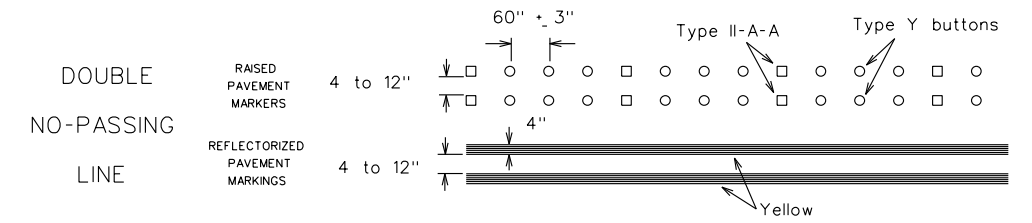

SOLID LINES

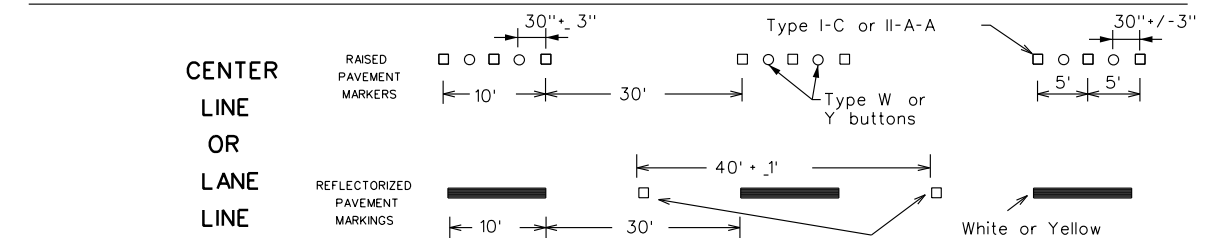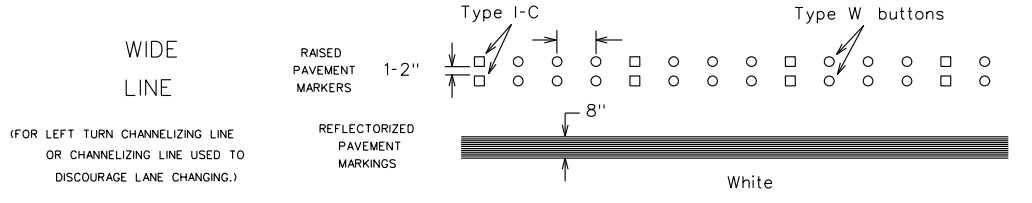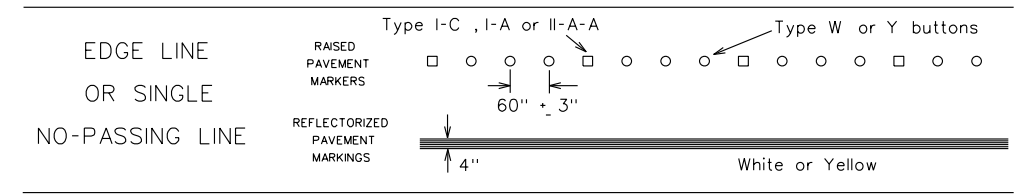


BROKEN LINES

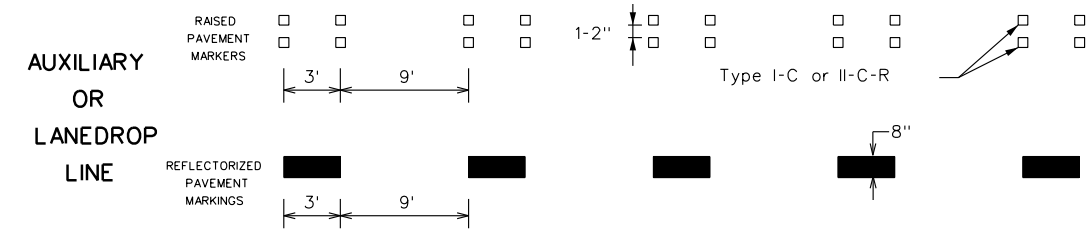

REMOVABLE MARKINGS WITH RAISED PAVEMENT MARKERS

If raised pavement markers are used to supplement REMOVABLE markings, the markers shall be applied to the top of the tape at the approximate mid length of tape used for broken lines or at 20 foot spacing for solid lines. This allows an easier removal of raised pavement markers and tape.

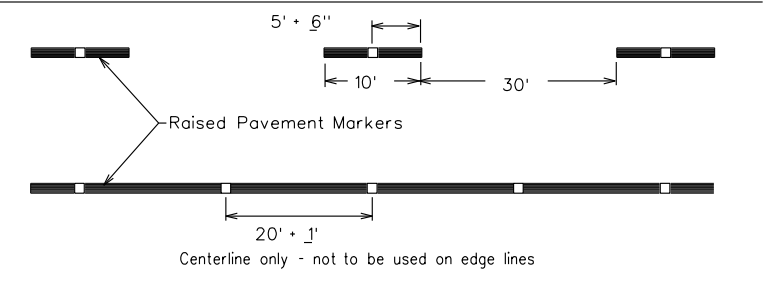

SHEET 12 OF 12



BARRICADE AND CONSTRUCTION PAVEMENT MARKING PATTERNS

BC(12)-21

Raised pavement markers used as standard pavement markings shall be from the approved products list and meet the requirements of Item 672 "RAISED PAVEMENT MARKERS."




FILE: bc-21.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT February 1998	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
1-97 9-07 5-21	DIST	COUNTY	SHEET NO.	
2-98 7-13	TYL	HENDERSON	20	
11-02 8-14				

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023 6:49:21 AM
FILE: c:\users\time\AppData\local\Bentley\projectwise\workingdir\wpm-pw.bentley.com\wpm-pw-01\tewing\w1\terpmoore.com\dms47257\BC(12)-21.dgn

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to any other units of measurement without the consent of the user.

DATE: 7/17/2023 6:49:22 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\wpm-pw.bentley.com\wz(bts-1)-13\wz(bts-1)-13.dgn

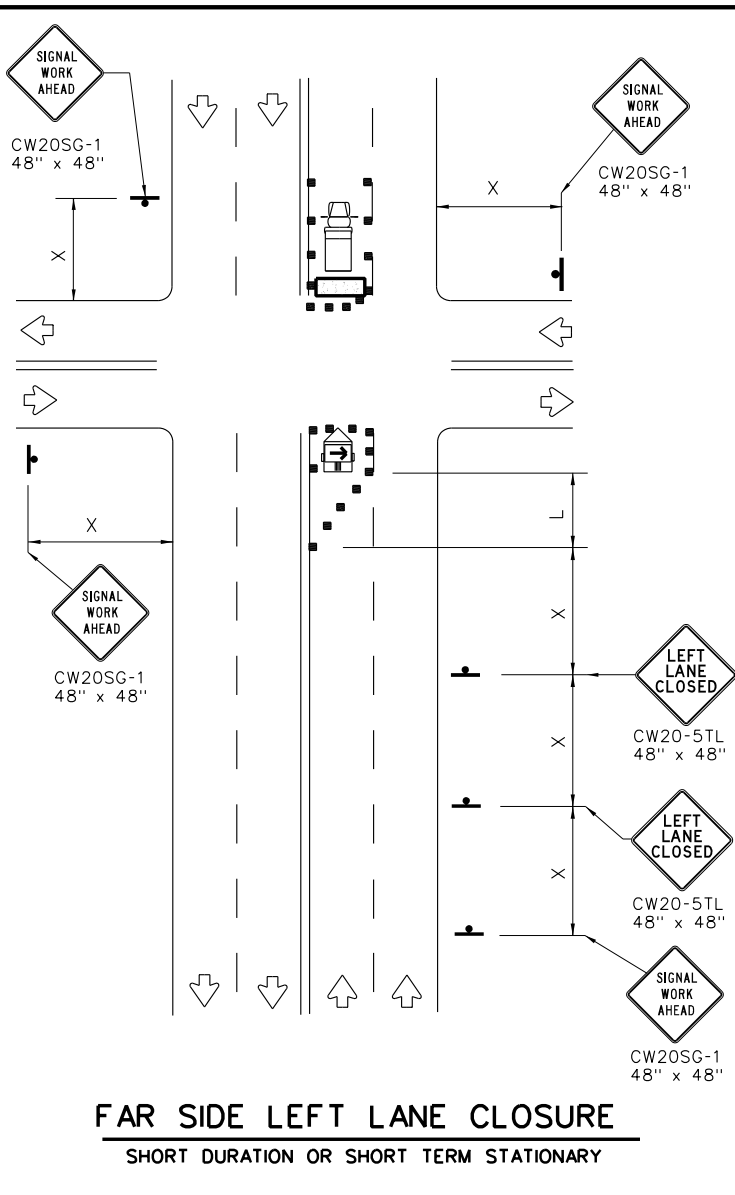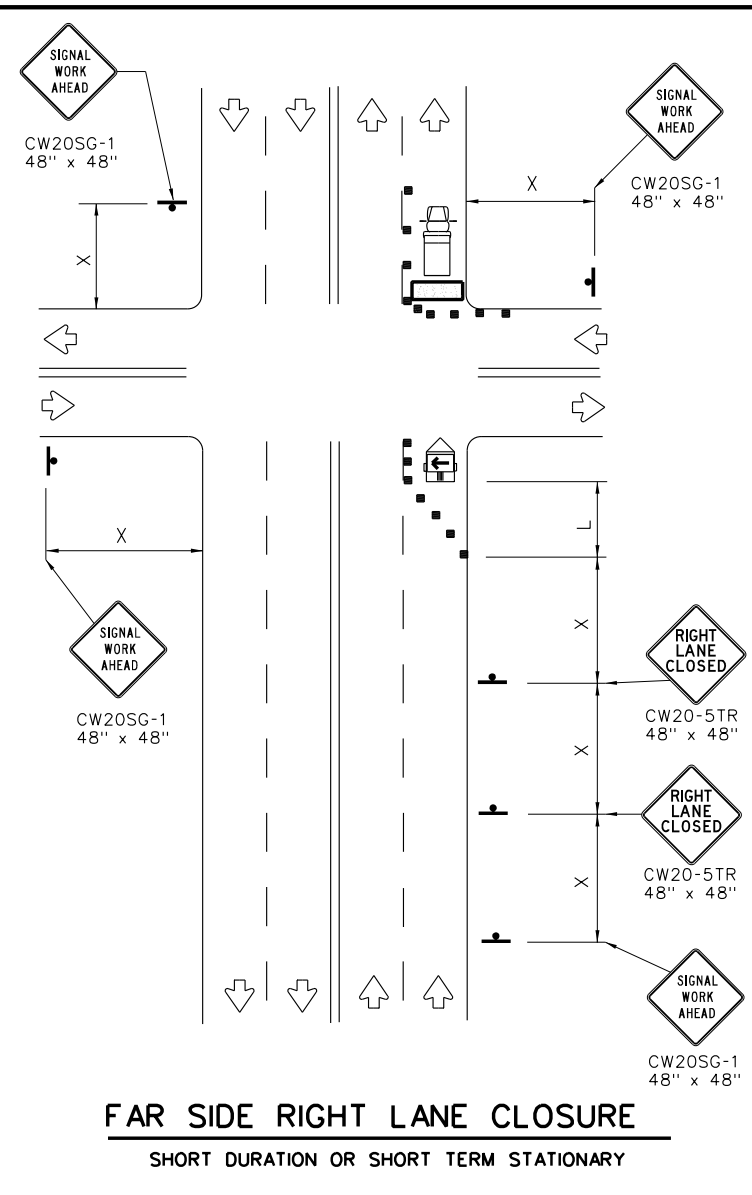
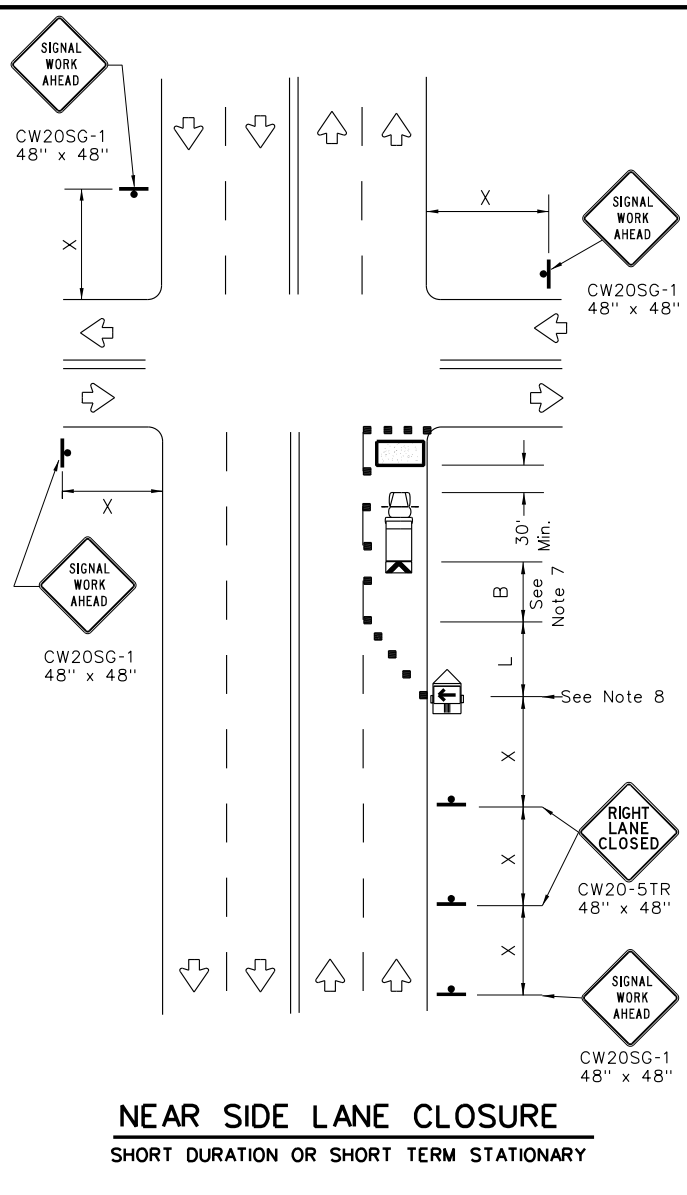


LEGEND			
	Type 3 Barricade		Channelizing Devices
	Heavy Work Vehicle		Truck Mounted Attenuator (TMA)
	Trailer Mounted Flashing Arrow Board		Portable Changeable Message Sign (PCMS)
	Sign		Traffic Flow
	Flag		Flagger

Posted Speed x	Formula	Minimum Desirable Taper Lengths x x			Suggested Maximum Spacing of Channelizing Devices		Minimum Sign Spacing "x" Distance	Suggested Longitudinal Buffer Space "B"
		10' Offset	11' Offset	12' Offset	On a Taper	On a Tangent		
30	$L = \frac{WS^2}{60}$	150'	165'	180'	30'	60'	120'	90'
35		205'	225'	245'	35'	70'	160'	120'
40		265'	295'	320'	40'	80'	240'	155'
45	L = WS	450'	495'	540'	45'	90'	320'	195'
50		500'	550'	600'	50'	100'	400'	240'
55		550'	605'	660'	55'	110'	500'	295'
60		600'	660'	720'	60'	120'	600'	350'
65		650'	715'	780'	65'	130'	700'	410'
70		700'	770'	840'	70'	140'	800'	475'
75		750'	825'	900'	75'	150'	900'	540'

* Conventional Roads Only
 ** Taper lengths have been rounded off.
 L=Length of Taper(FT) W=Width of Offset(FT) S=Posted Speed(MPH)

WORKERS IN BUCKET TRUCKS SHALL NOT WORK ABOVE OPEN LANES OF TRAFFIC.

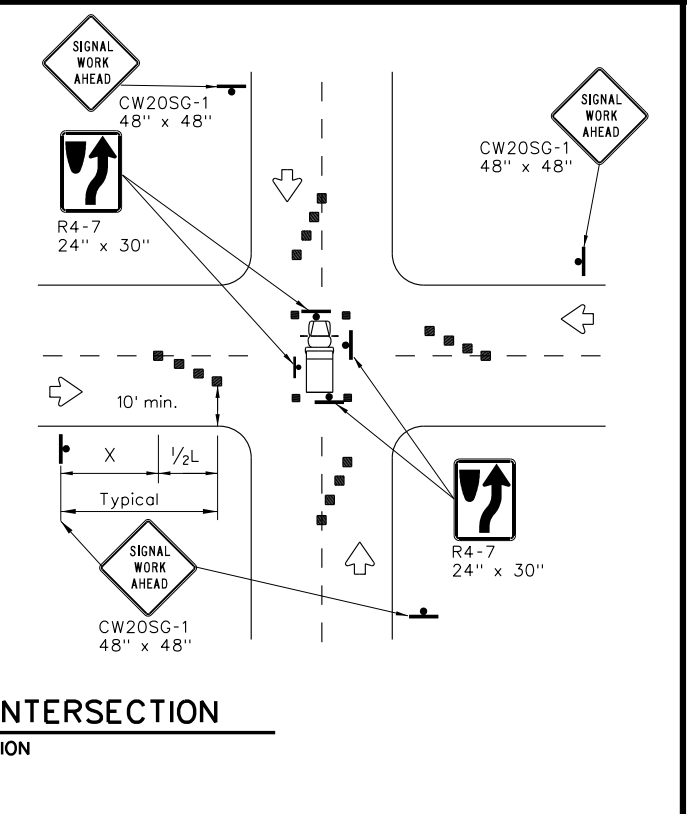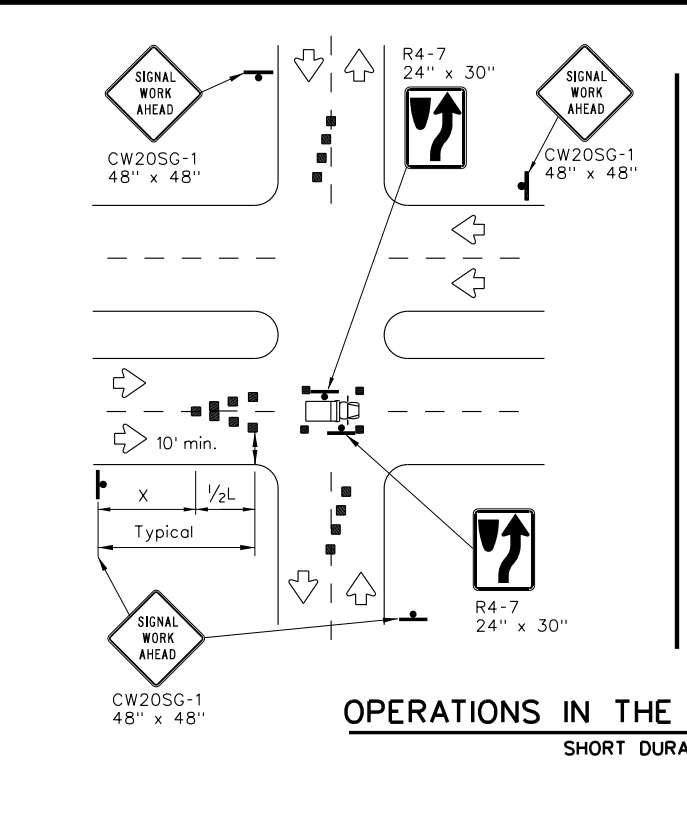

GENERAL NOTES

- The minimum size channelizing device is the 28" cone. 42" Two-piece cones, drums, vertical panels or barricades will be required when the device must be left unattended at night.
- Obstructions or hazards at the work area shall be clearly marked and delineated at all times.
- Flaggers and Flagger Symbol (CW20-7) signs may be required according to field conditions.
- Vehicles parked in roadway shall be equipped with at least two high intensity rotating, flashing, oscillating or strobe type lights.
- High level warning devices (flag trees) may be used at corners of the vehicle.
- When work operations are performed on existing signals, the signals may be placed in flashing red mode when approved by the engineer. If existing signals do not have power, All-Way Stop (R1-1 and R1-3P) signs may be implemented when approved by the engineer.
- For Short-Term Stationary work the buffer space "B" from the above table should be used if field conditions permit. For Short Duration (less than 1 hour) any buffer space provided will enhance the safety of the setup.
- The arrow board at this location may be omitted for Short Duration work if the work vehicle has an arrow board in operation. As an option, the arrow board may be placed at the end of the taper in the closed lane if space is not available at the beginning of the taper.
- Signs and devices for the NEAR SIDE LANE CLOSURE may be altered for a left lane closure by using a LEFT LANE CLOSED (CW20-5TL) and adding channelizing devices on the centerline to protect the work space from opposing traffic.




TRAFFIC SIGNAL WORK TYPICAL DETAILS

WZ(BTS-1)-13

FILE: wzbts-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT April 1992	CONT 0164	SECT 03	JOB 056	HIGHWAY SH 31
REVISIONS	DIST	COUNTY	SHEET NO.	
2-98 10-99 7-13	TYL	HENDERSON	21	
4-98 3-03				




DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion or reproduction of this standard to a different format or for errors appearing in any reproduction of this standard.

DATE: 7/17/2023 6:49:23 AM
FILE: ct:\users\tim\appdata\local\bentley\projectwise\workingdir\pwp-pw\bentley\projectwise\workingdir\wz(bts-2)-13.dgn

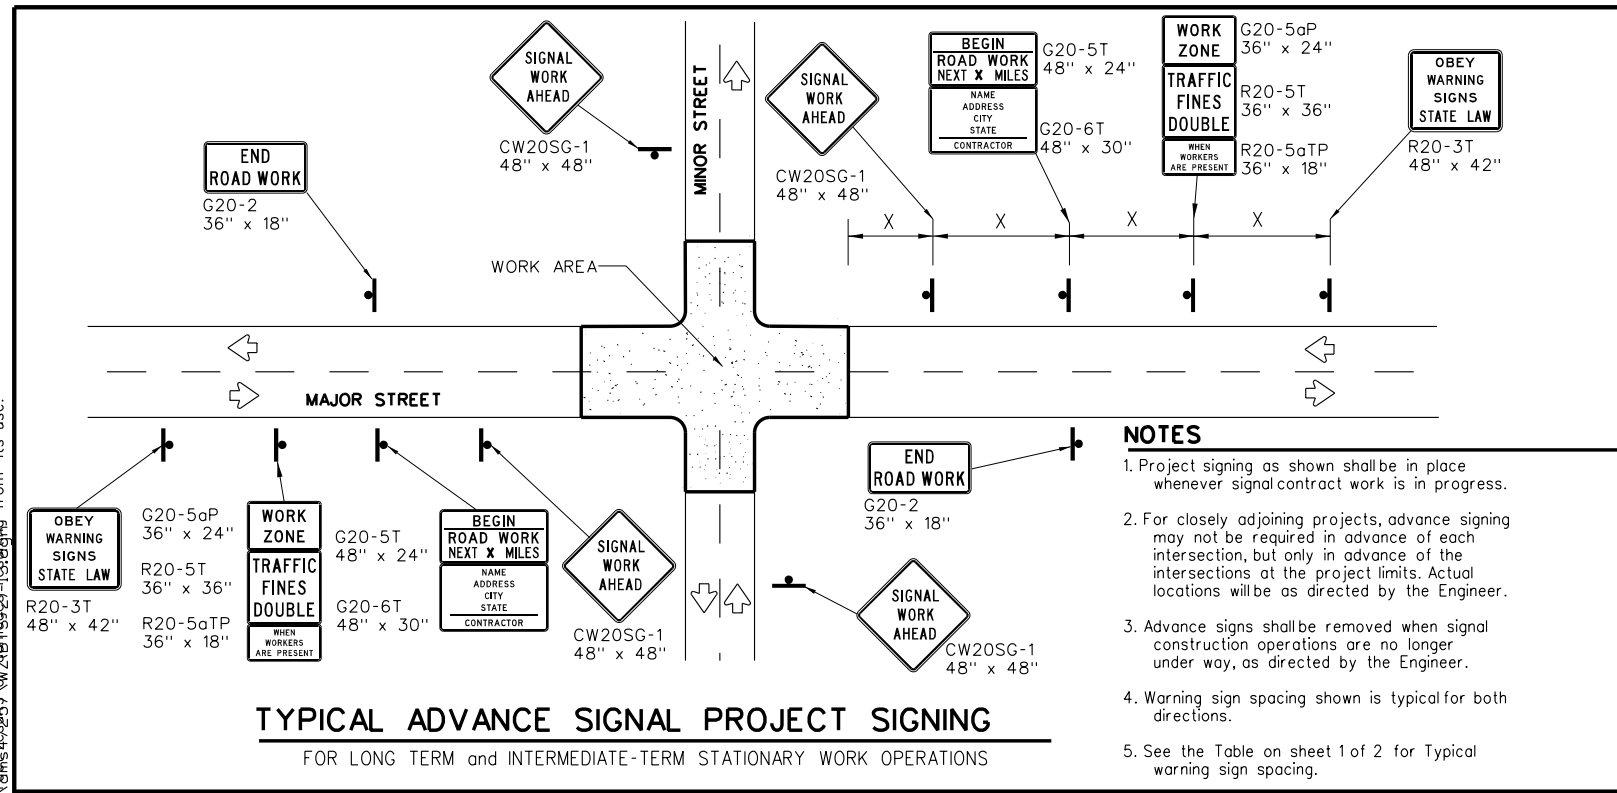

TYPICAL ADVANCE SIGNAL PROJECT SIGNING
FOR LONG TERM and INTERMEDIATE-TERM STATIONARY WORK OPERATIONS

- NOTES**
1. Project signing as shown shall be in place whenever signalcontract work is in progress.
 2. For closely adjoining projects, advance signing may not be required in advance of each intersection, but only in advance of the intersections at the project limits. Actual locations will be as directed by the Engineer.
 3. Advance signs shall be removed when signal construction operations are no longer under way, as directed by the Engineer.
 4. Warning sign spacing shown is typical for both directions.
 5. See the Table on sheet 1 of 2 for Typical warning sign spacing.

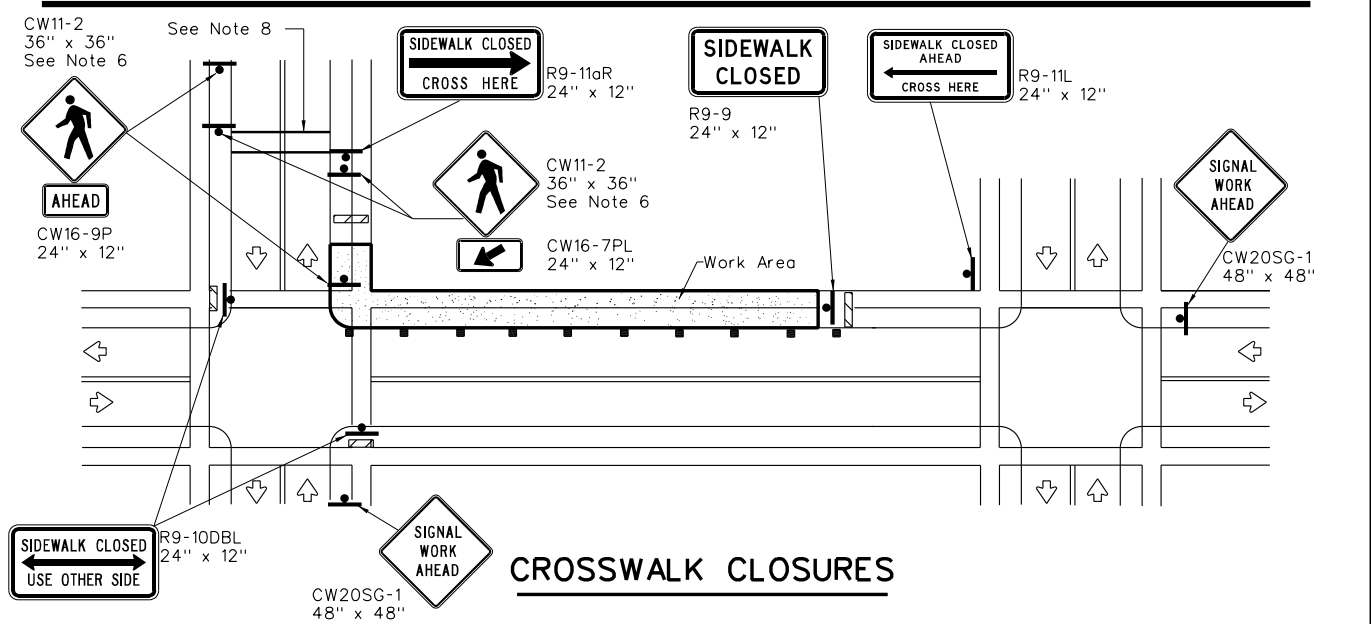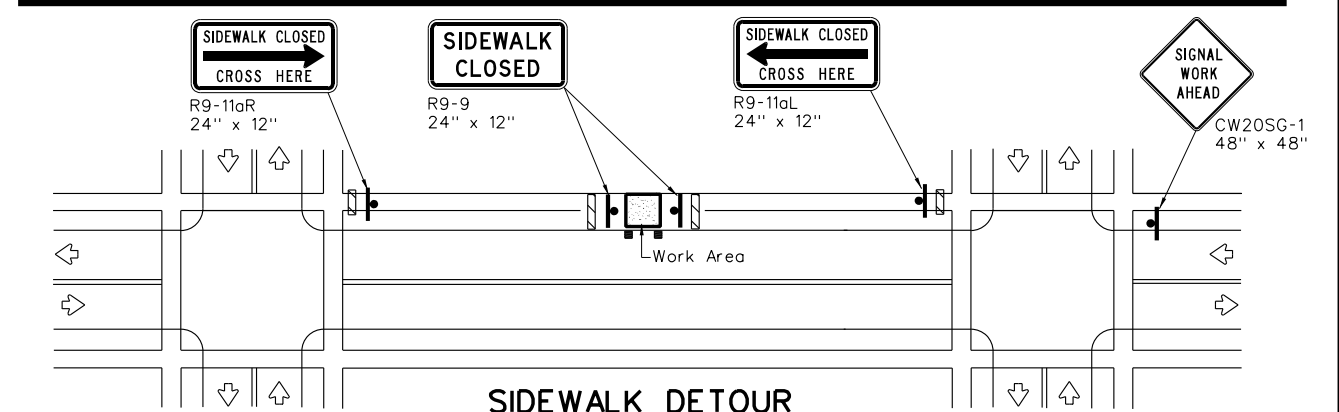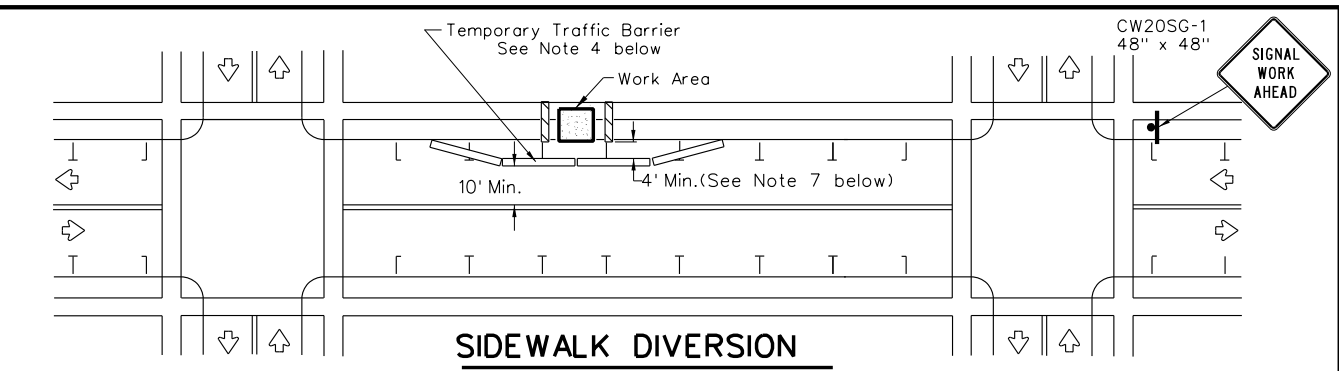

- PEDESTRIAN CONTROL**
1. Holes, trenches or other hazards shall be adequately protected by covering, delineating or surrounding the hazard with orange plastic pedestrian fencing or longitudinal channelizing devices, or as directed by the Engineer.
 2. "CROSSWALK CLOSURES" as detailed above will require the Engineer's approval prior to installation.
 3. R9 series signs shown may be placed on supports detailed on the BC standards or CWZTCD list, or when fabricated from approved lightweight plastic substrates, they may be mounted on top of a plastic drum at or near the location shown.
 4. For speeds less than 45 mph longitudinal channelizing devices may be used instead of traffic barriers when approved by the Engineer. Attenuation of blunt ends and installation of water filled devices shall be as per BC(9) and manufacturer's recommendations.
 5. Location of devices are for general guidance. Actual device spacing and location must be field adjusted to meet actual conditions.
 6. Where pedestrians with visual disabilities normally use the closed sidewalk Detectable Pedestrian Barricades should be used instead of the Type 3 Barricades shown.
 7. The width of existing sidewalk should be maintained if practical.
 8. Pavement markings for mid-block crosswalks shall be paid for under the appropriate bid items.
 9. When crosswalks or other pedestrian facilities are closed or relocated, temporary facilities shall be detectable and shall include accessibility features consistent with the features present in the existing pedestrian facility.

GENERAL NOTES FOR WORK ZONE SIGNS

1. Signs shall be installed and maintained in a straight and plumb condition.
2. Wooden sign posts shall be painted white.
3. Barricades shall NOT be used as sign supports.
4. Nails shall NOT be used to attach signs to any support.
5. All signs shall be installed in accordance with the plans or as directed by the Engineer.
6. The Contractor shall furnish the sign design shown in the plans or in the "Standard Highway Sign Designs for Texas" (SHSD).
7. The Contractor shall furnish sign supports and substrates listed in the "Compliant Work Zone Traffic Control Device List" (CWZTCD), installed as per the manufacturer's recommendations.
8. Temporary signs that have damaged or cracked substrates and/or damaged or marred reflective sheeting shall be replaced as directed by the Engineer.
9. Identification markings may be shown only on the back of the sign substrate. The maximum height of letters and/or company logos used for identification shall be 1".
10. Damaged wood posts shall be replaced. Splicing wood posts will not be allowed.

DURATION OF WORK

1. Work zone durations are defined in Part 6, Section 6G.02 of the Texas Manual on Uniform Traffic Control Devices (TMUTCD).

SIGN MOUNTING HEIGHT

1. Sign height of Long-term/Intermediate-term warning signs shall be as shown on Figure 6F-1 of the TMUTCD.
2. Sign height of Short-term/Short Duration warning signs shall be as shown on Figure 6F-2 of the TMUTCD.
3. Regulatory signs shall be mounted at least 7 feet, but not more than 9 feet, above the paved surface regardless of work duration.

REMOVING OR COVERING

1. When sign messages may be confusing or do not apply, the signs shall be removed or completely covered, unless otherwise approved by the Engineer.
2. When signs are covered, the material used shall be opaque, such as heavy mil black plastic, or other materials which will cover the entire sign face and maintain their opaque properties under automobile headlights at night without damaging the sign sheeting. Burlap, or heavy materials such as plywood or aluminum shall not be used to cover signs.
3. Duct tape or other adhesive material shall NOT be affixed to a sign face.
4. Signs and anchor stubs shall be removed and holes back filled upon completion of the work.

REFLECTIVE SHEETING

1. All signs shall be retroreflective and constructed of sheeting meeting the requirements of the DMS and color usage table shown on this sheet.

SIGN SUPPORT WEIGHTS

1. Weights used to keep signs from turning over should be sandbags filled with dry, cohesionless material.
2. The sandbags will be tied shut to keep the sand from spilling and to maintain a constant weight.
3. Rock, concrete, iron, steel or other solid objects will not be permitted for use as sign support weights.
4. Sandbags should weigh a minimum of 35 lbs and a maximum of 50 lbs.
5. Sandbags shall be made of a durable material that tears upon vehicular impact. Rubber, such as tire inner tubes, shall not be used.
6. Rubber ballasts designed for channelizing devices should not be used for ballast on portable sign supports. Sign supports designed and manufactured with rubber bases may be used when shown on the CWZTCD list.
7. Sandbags shall only be placed along or laid over the base supports of the traffic control device and shall not be suspended above ground level or hung with rope, wire, chains or other fasteners. Sandbags shall be placed along the length of the skids to weigh down the sign support.
8. Sandbags shall NOT be placed under the skid and shall not be used to level sign supports placed on slopes.

LEGEND	
	Sign
	Channelizing Devices
	Type 3 Barricade

DEPARTMENTAL MATERIAL SPECIFICATIONS	
SIGN FACE MATERIALS	DMS-8300
FLEXIBLE ROLL-UP REFLECTIVE SIGNS	DMS-8310

COLOR	USAGE	SHEETING MATERIAL
ORANGE	BACKGROUND	TYPE B _{FL} OR TYPE C _{FL} SHEETING
WHITE	BACKGROUND	TYPE A SHEETING
BLACK	LEGEND & BORDERS	ACRYLIC NON-REFLECTIVE SHEETING

Only pre-qualified products shall be used. A copy of the "Compliant Work Zone Traffic Control Devices List" (CWZTCD) describes pre-qualified products and their sources and may be found at the following web address:
http://www.txdot.gov/txdot_library/publications/construction.htm

TRAFFIC SIGNAL WORK BARRICADES AND SIGNS

WZ(BTS-2)-13



FILE: wzbts-13.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT April 1992	CONT 0164	SECT 03	JOB 056	HIGHWAY SH 31
REVISIONS	DIST	COUNTY	SHEET NO.	
2-98 10-99 7-13	TYL	HENDERSON	22	
4-98 3-03				

7/17/2023 6:50:45 AM c:\users\lme\appdata\local\bentley\projectwise\workingdir\wpm-pw-01\ewing@waltermoore.com\dms4744\03-18032-03-SH 31_Sawmill Rd_EXIST_COND.dgn



LEGEND

- EXISTING WOOD POLE
- ⊕ EXISTING MANHOLE
- ☀ EXISTING LUMINAIRE
- ⊞ EXISTING SIGN
- ↔ EXISTING TRAFFIC FLOW
- - - - - FO EXISTING UNDERGROUND FIBER OPTIC CABLE
- - - - - G EXISTING GAS LINE
- - - - - WW EXISTING STORM DRAIN
- - - - - FM EXISTING SANITARY SEWER
- - - - - W EXISTING WATER LINE

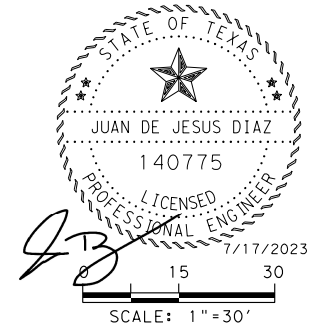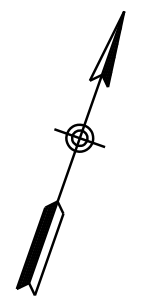

NO.	DATE	REVISION	APPROV.



walter p moore
 Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
 EXISTING CONDITIONS



SHEET 1 OF 1

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056
				SHEET NO. 24

7/17/2023 6:51:16 AM c:\users\time\appdata\local\bentley\projectwise\working\dwg\wpm-pw-01\viewing@waltermoore.com\dms7244\03-18032-03-SH 31_Sawmill Rd_REMOVAL.dgn



- LEGEND**
- EXISTING WOOD POLE
 - ☼ EXISTING LUMINAIRE
 - ⊥ EXISTING SIGN
 - ⇨ DIRECTION OF TRAFFIC FLOW
 - ▨ REMOVE CONCRETE

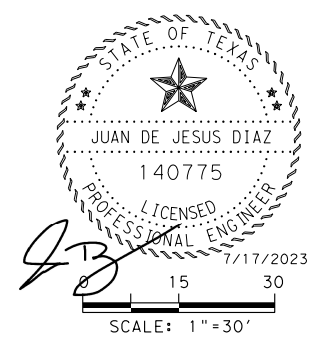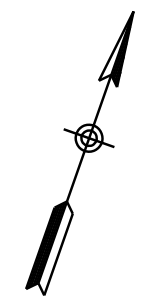

NO.	DATE	REVISION	APPROV.



walter p moore
 Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856

**SH 31 AT SAWMILL RD.
 REMOVAL LAYOUT**


SHEET 1 OF 1

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.	
CK DN:	6	TX	SEE TITLE SHEET	SH 31	
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.	SHEET NO.
CK DW:	TYL	HENDERSON	0164 03	056	25

7/17/2023 6:51:49 AM c:\users\time\appdata\local\bentley\projectwise\workingdir\wpm-pw-01\ewing@waltermoore.com\dms4744\03-1-8032-03-SH-31_Sawmill Rd_RAMPS.dgn



- LEGEND**
- EXISTING WOOD POLE
 - ⊕ EXISTING MANHOLE
 - ☀ EXISTING LUMINAIRE
 - ⊥ EXISTING SIGN
 - ⇨ DIRECTION OF TRAFFIC FLOW
 - ▭ PROPOSED RAMP
 - ▭ PROPOSED 5' MIN. CONCRETE SIDEWALK

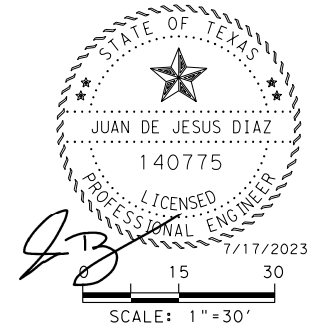

NO.	DATE	REVISION	APPROV.

© 2023
Texas Department of Transportation
walter p moore
 Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856

**SH 31 AT SAWMILL RD.
RAMP LAYOUT**

SHEET 1 OF 1


DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056
				SHEET NO. 26

7/17/2023 6:52:21 AM c:\users\timealappdata\local\temp\project\wise\working\dwg\wpm-pw-01\viewing\waltermoore.com\dms7244\03-1-8032-03-SH-31_Sawmill Rd_SIGNAL.dgn



- LEGEND**
- P# —●— PROPOSED MAST ARM POLE
 - A ◀ PROPOSED SIGNAL HEAD
 - S# ▬ PROPOSED OVERHEAD SIGN
 - ▶ PROPOSED VIDEO CAMERA
 - ◀ PROPOSED DIRECTION OF TRAFFIC FLOW
 - ◻ PROPOSED TRAFFIC CONTROLLER
 - ◻ PROPOSED GROUND BOX
 - PROPOSED PED POLE
 - W# ◻ PROPOSED PED PUSHBUTTON
 - PROPOSED POWER SOURCE

PROPOSED SIGNAL HEADS

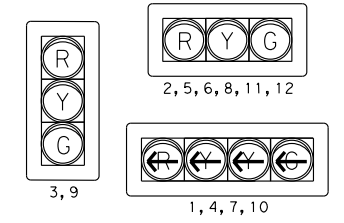

SCALE: 1" = 30'

NO.	DATE	REVISION	APPROV.


© 2023
Texas Department of Transportation

walter p moore
 Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856


**SH 31 AT SAWMILL RD.
 TRAFFIC SIGNAL
 LAYOUT**

SHEET 1 OF 1


DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056
				SHEET NO. 27

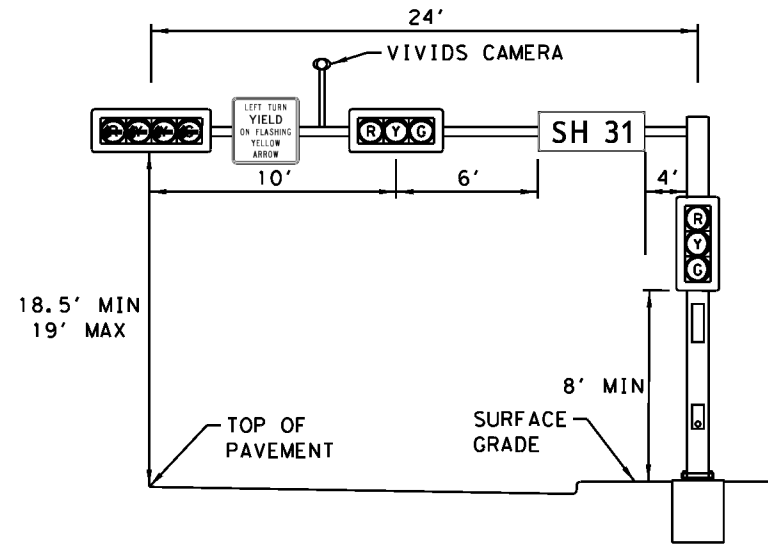


P1 (NB) MAST ARM (24')

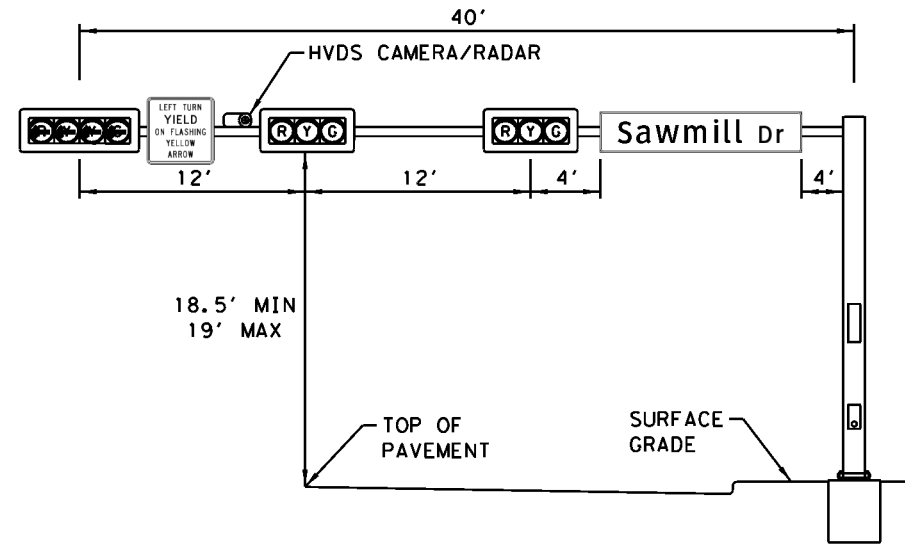

P3 (EB) MAST ARM (40')

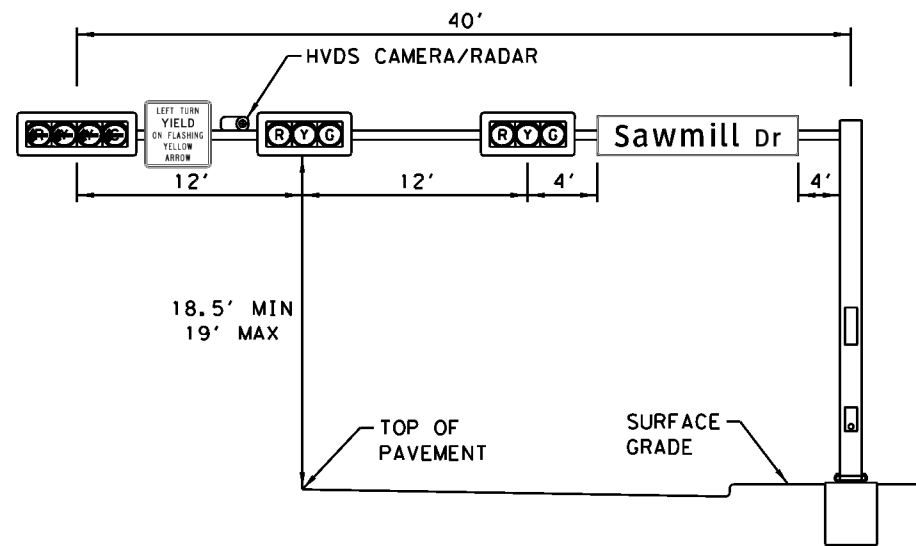


P7 (WB) MAST ARM (40')

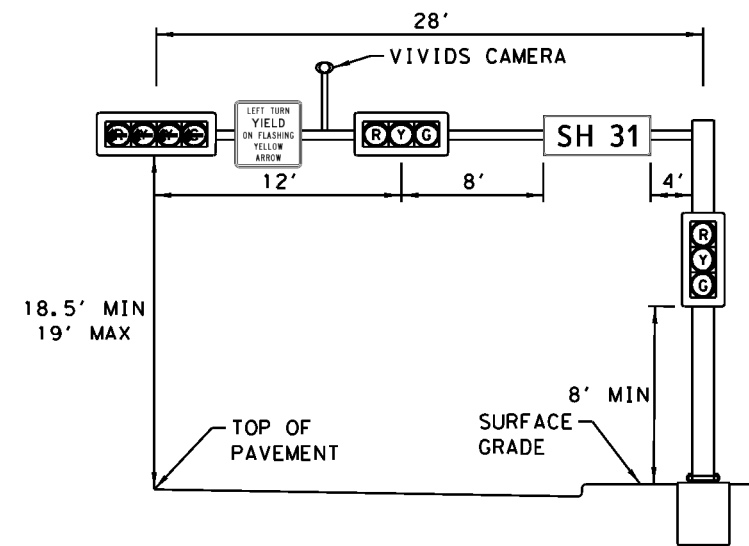

P5 (SB) MAST ARM (28')

Walter P. Moore and Associates, Inc.
TBPE Firm Registration No. 1856

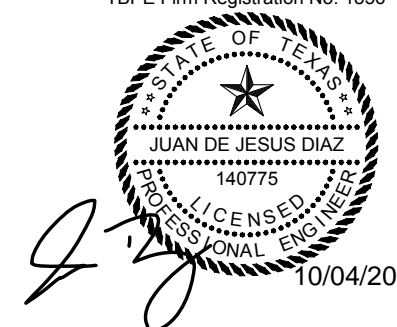

SCALE: N. T. S.

NO.	DATE	REVISION	APPROV.







walter p moore
Walter P Moore and Associates, Inc.
1301 McKinney, Suite 1100
Houston, Texas 77010
Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
PROPOSED SIGNAL
ELEVATION VIEWS

SHEET 1 OF 1		FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
DN:		6	TX	SEE TITLE SHEET	SH 31
CK DN:					
DW:		STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:		TYL	HENDERSON	0164 03	056 28

SIGNAL POLE NOTES:

1. DETAILS SUCH AS HEADS, MOUNTS, POLES ARE SHOWN AS EXAMPLE. REFER TO OTHER SHEETS FOR SPECIFIC DETAILS.
2. SEE SIGNAL HEAD LAYOUT FOR INDICATIONS AND LAYOUT.
3. SIGNAL HEAD ON ARMS SHOULD BE CENTERED IN APPROPRIATE LANE.
4. FOR MAST ARMS SEE TXDOT SMA-80 SHEET.

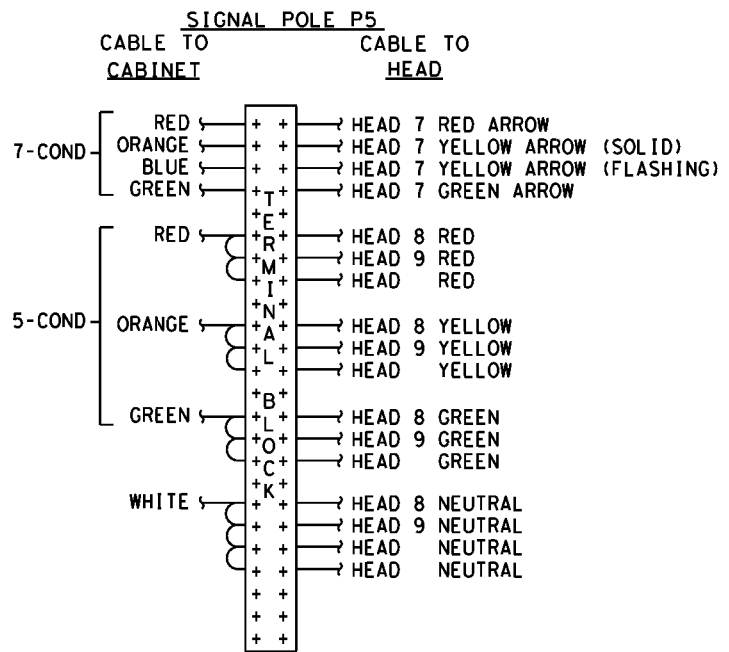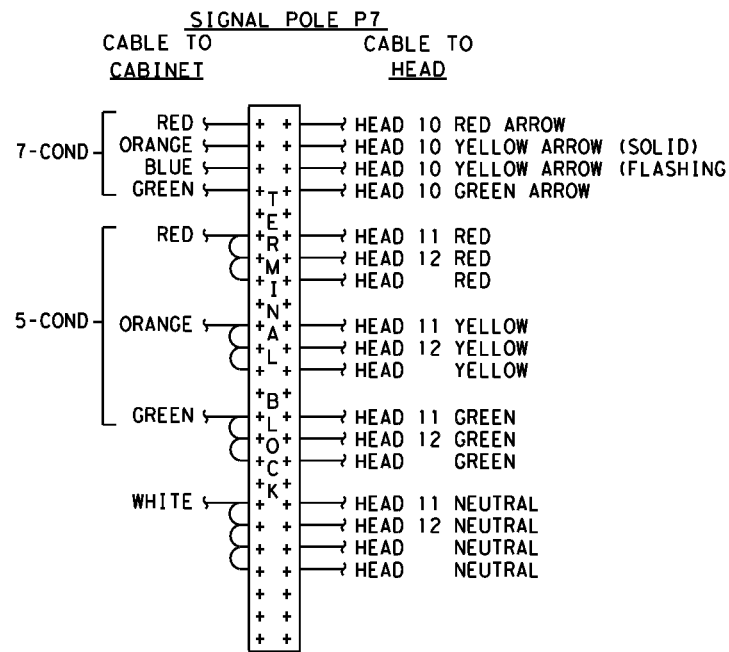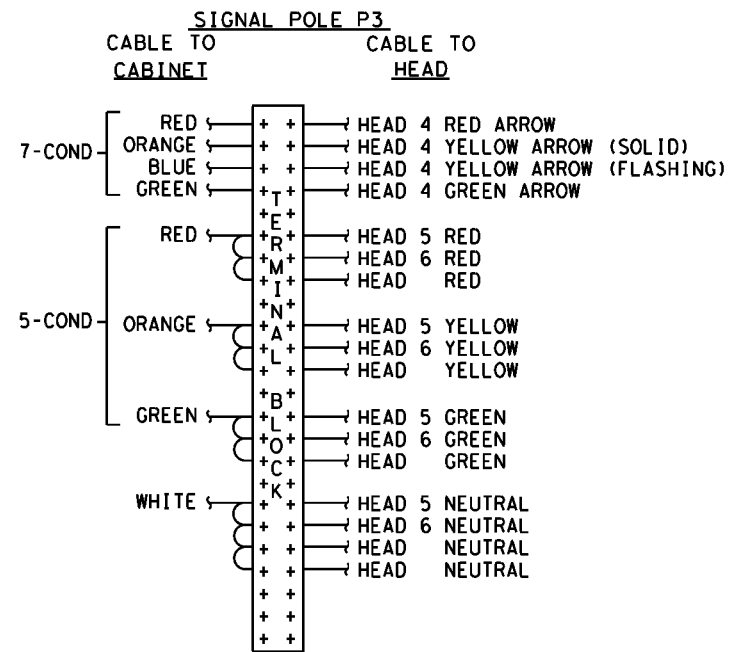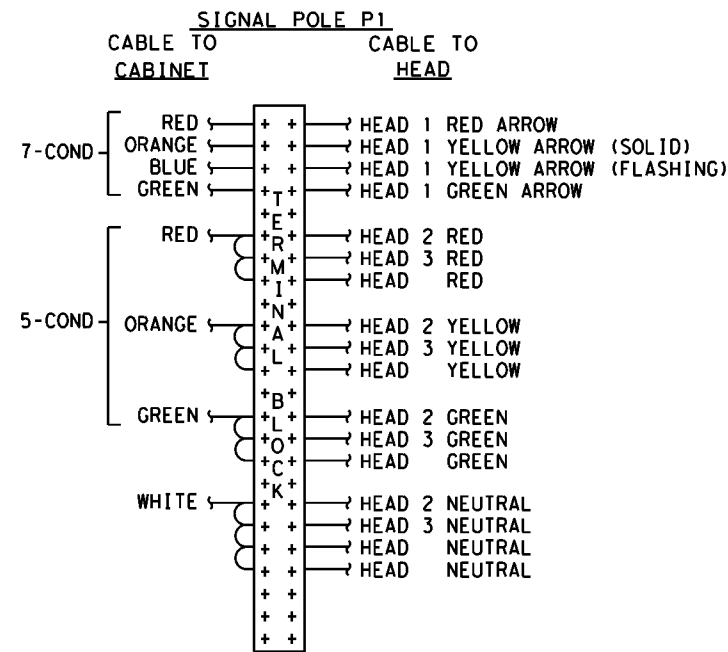

POLE AND MAST ARM SUMMARY

LOCATION	ITEM 416			ITEM 682						ITEM 684			ITEM 686			ITEM 687	ITEM 688	ITEM 6017					
	DRILL SHAFT			VEH SIG SEC (12") (LED)						PED SIG SEC (LED) (COUNT DOWN)	TRF SIG CBL (TY A)(12 AWG)			INS TRF SIG PL AM (S) 1ARM			PED POLE ASSEM BLY	PED DET PUSH BUTTON (APS)	VIVIDS CAM ASSY VAR LNS	HVDS W/VAR LNS	VDS CABLING		
	TRF SIG POLE			(GRN)	(GRN ARW)	(YEL)	(YEL ARW)	(RED)	(RED ARW)		BACK PLATE W/REFL BRDR (12")		TRF SIG CBL (TY A)(12 AWG)		(24')	(28')						(40')	
	(24") [1]	(30")	(36")	(EA)	(EA)	(EA)	(EA)	(EA)	(EA)	(3 SEC)	(4 SEC)	(2 CONDR)	(5 CONDR)	(7 CONDR)	(EA)	(EA)	(EA)	(EA)	(EA)	(EA)	(EA)	(EA)	(EA)
P1		11		2	1	2	2	2	1	1	2	1	5	48	44	1			1	1	1		44
P2	6									1			5	8				1	1				
P3			13	2	1	2	2	2	1	1	2	1	5	57	60			1	1			1	60
P4	6									1			5	8				1	1				
P5		11		2	1	2	2	2	1	1	2	1	5	50	48		1	1	1	1	1		48
P6	6									1			5	8				1	1				
P7			13	2	1	2	2	2	1	1	2	1	5	57	60			1	1			1	60
P8	6									1			5	8				1	1				
TOTAL	24	22	26	8	4	8	8	8	4	8	8	4	40	244	212	1	1	2	4	8	2	2	212

[1] FOR CONTRACTOR INFORMATION ONLY; PEDESTRIAN POLE FOUNDATIONS ARE SUBSIDIARY TO ITEM 687. OPTIONAL CONCRETE FOUNDATION SHOWN FOR EXAMPLE.

VEHICLE HEAD WIRING

HEAD NO.	HEAD INDICATION	7 CONDR COLOR
1, 4, 7, 10	RED ARROW YELLOW ARROW (SLD) YELLOW ARROW (FL) GREEN ARROW NEUTRAL	RED ORANGE BLUE GREEN WHITE
2, 3, 5, 6, 8, 9, 11, 12	RED BALL YELLOW BALL GREEN BALL NETRAL	RED ORANGE BLUE GREEN WHITE

PEDESTRAIN HEAD WIRING

HEAD NO.	HEAD INDICATION	5 CONDR COLOR
W1 - W8	DON'T WALK WALK	RED GREEN

WIRING DIAGRAM NOTES

- JUMPERS BETWEEN TERMINALS ON THE TERMINAL BLOCK ARE TO MATCH WIRE GAGE AND COLOR OF THE CABLE TO THE CABINET.

Walter P. Moore and Associates, Inc.
TBPE Firm Registration No. 1856



NO.	DATE	REVISION	APPROV.



Walter P Moore and Associates, Inc.
1301 McKinney, Suite 1100
Houston, Texas 77010
Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
PROPOSED SIGNAL
SUMMARIES


SHEET 1 OF 3		FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
DN:		6	TX	SEE TITLE SHEET	SH 31
CK DN:					
DW:		STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:		TYL	HENDERSON	0164 03	056 29

ELECTRICAL SERVICE DATA

ELECTRIC SERVICE ID	PLAN SHEET NUMBER	ELECTRIC SERVICE DESCRIPTION (SEE ED(5)-14)	SERVICE CONDUIT SIZE	SERVICE CONDUCTORS NO./SIZE	SAFETY SWITCH AMPS	MAIN CKT. BRK. POLE/AMPS	TWO-POLE CONTRACTOR AMPS	PANELBD/ LOADCENTER AMP RATING	BRANCH CIRCUIT ID	BRANCH CKT. BKR. POLE/AMPS	BRANCH CIRCUIT AMPS	KVA LOAD
ES-1	27	TY D 120/240 060 (NS) AL (E) SP (O)	1 1/2"	3 / #6	N/A	2P / 70	N/A	100	TRF. SIG.	1P / 50	40	<7.1

CONDUIT RUN SUMMARY

LOCATION	LENGTH	ITEM 618						ITEM 620				ITEM 684						ITEM 6017	
		CONDT (PVC)						ELEC CONDR				TRF SIG CBL (TY A) (12 AWG)						VDS CABLING	
		(SCH 40) (2")		(SCH 40) (3")		(SCH 80) (3") BORE		GROUND BARE #6		POWER INSULATED #6		BUTTONS (2 CONDR)		PED + VEH (5 CONDR)		4 SEC (7 CONDR)		EA LF	
		EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF	EA	LF
1	20	1	20		0		0		0	1	20	1	20		0		0		
2	20	1	20		0		0		0	1	20	2	40	1	20	1	20		
3	70		0		0	2	140		0	2	140	3	210	1	70	1	70		
4	25	1	25		0		0		0	1	25	2	50	1	25	1	25		
5	5	1	5		0		0		0	1	5	1	5		0		0		
6	75		0		0	2	150		0	2	150	3	225	1	75	1	75		
7	10	1	10		0		0		0	1	10	2	20		0	1	10		
8	20	1	20		0		0		0	1	20	1	20		0		0		
9	80		0		0	2	160		0	4	320	6	480	2	160	2	160		
10	5	1	5		0		0		0	1	5	1	5		0		0		
11	15	1	15		0		0		0	1	15	2	30	1	15	1	15		
12	25		0	2	50		0		0	8	200	12	300	4	100	4	100		
13	5	1	5		0		0	1	5	2	10		0		0		0		
14	50	1	50		0		0	1	50	2	100		0		0		0		
TOTAL (LF)		175	50	450	55	110	930	1405	465	475									

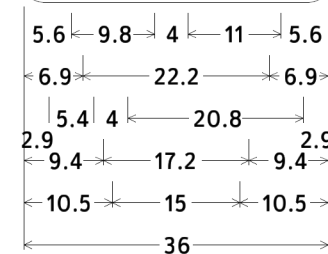

R10-17T_36x42;
 2.3" Radius, 0.9" Border, 0.6" Indent, Black on White;
 "LEFT TURN", C;
 "YIELD", D;
 "ON FLASHING", C;
 "YELLOW", C;
 "ARROW", C;
 S2, S5, S7, S8

Walter P. Moore and Associates, Inc.
 TBPE Firm Registration No. 1856




NO.	DATE	REVISION	APPROV.



Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856


**SH 31 AT SAWMILL RD.
 PROPOSED SIGNAL
 SUMMARIES**

SHEET 1 OF 1	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
DN:	6	TX	SEE TITLE SHEET	SH 31
CK DN:				
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056 30

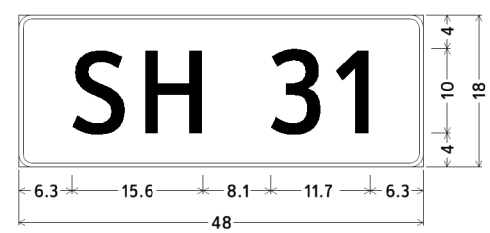

1.5" Radius, 0.5" Border, White on Green;
 "SH 31", ClearviewHwy-3-W;

S1, S4

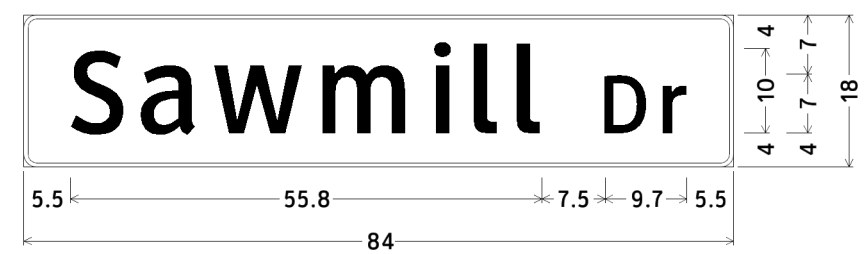

1.5" Radius, 0.5" Border, White on Green;
 "Sawmill", ClearviewHwy-3-W; "Dr", ClearviewHwy-3-W;
 S3, S6

5 DATES 5 TIMES 5 FILES

CABLE TERMINATION


CNDR	COLOR	NO: FROM: TO: TYPE:	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	CABINET	
			P-1 7/C	P-1 5/C	P-1 5/C	P-2 5/C	P-3 7/C	P-3 5/C	P-3 5/C	P-4 5/C	P-5 7/C	P-5 5/C	P-5 5/C	P-6 5/C	P-7 7/C	P-7 5/C	P-7 5/C	P-8 5/C
1	BLACK	INDICATION: PHASE & HEADS:	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	SPARE	
2	WHITE	INDICATION: PHASE & HEADS:	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	SIGNAL COMMON	
3	RED	INDICATION: PHASE & HEADS:	RED ARW Ø7: 1	RED Ø4: 2 & 3	DON'T WALK Ø6: W6	DON'T WALK Ø4: W5	RED ARW Ø5: 4	RED Ø2: 5 & 6	DON'T WALK Ø4: W4	DON'T WALK Ø2: W3	RED ARW Ø3: 7	RED Ø8: 8 & 9	DON'T WALK Ø2: W2	DON'T WALK Ø8: W1	RED ARW Ø1: 10	RED Ø6: 11 & 12	DON'T WALK Ø8: W8	DON'T WALK Ø6: W7
4	GREEN	INDICATION: PHASE & HEADS:	GRN ARW Ø7: 1	GRN Ø4: 2 & 3	WALK Ø6: W6	WALK Ø4: W5	GRN ARW Ø5: 4	GRN Ø2: 5 & 6	WALK Ø4: W4	WALK Ø2: W3	GRN ARW Ø3: 7	GRN Ø8: 8 & 9	WALK Ø2: W2	WALK Ø8: W1	GRN ARW Ø1: 10	GRN Ø6: 11 & 12	WALK Ø8: W8	WALK Ø6: W7
5	ORANGE	INDICATION: PHASE & HEADS:	YEL ARW Ø7: 1	YEL Ø4: 2 & 3	SPARE	SPARE	YEL ARW Ø5: 4	YEL Ø2: 5 & 6	SPARE	SPARE	YEL ARW Ø3: 7	YEL Ø8: 8 & 9	SPARE	SPARE	YEL ARW Ø1: 10	YEL Ø6: 11 & 12	SPARE	SPARE
6	BLUE	INDICATION: PHASE & HEADS:	YEL ARW Ø7: 1	N/A	N/A	N/A	YEL ARW Ø5: 4	N/A	N/A	N/A	YEL ARW Ø3: 7	N/A	N/A	N/A	YEL ARW Ø1: 10	N/A	N/A	N/A
7	WHITE W/ BLACK	INDICATION: PHASE & HEADS:	SPARE	N/A	N/A	N/A	SPARE	N/A	N/A	N/A	SPARE	N/A	N/A	N/A	SPARE	N/A	N/A	N/A

NOTE: PEDESTRIAN PUSH BUTTON CABLES ARE NOT SHOWN.

APS INFORMATION

UNIT	PHASE	MIN. WALK INTERVAL (S)	MIN. PEDESTRIAN CLEARANCE (S)	DEFAULT OPERATION		EXTENDED PUSHBUTTON PRESS	
				ACKNOWLEDGEMENT INDICATION	WALK INDICATION	ACKNOWLEDGEMENT MESSAGE	WALK MESSAGE
W1-W8	SOUTHBOUND CROSSING SH 31	7	20	AUDIBLE "WAIT" AND PILOT LIGHT	AUDIBLE TONE AND BUTTON VIBRATION.	"WAIT TO CROSS SH 31"	"SH 31. WALK SIGN IS ON TO CROSS SH31."
W2-W3	EASTBOUND CROSSING SAWMILL DR	7	13	AUDIBLE "WAIT" AND PILOT LIGHT	AUDIBLE TONE AND BUTTON VIBRATION.	"WAIT TO CROSS SAWMILL"	"SAWMILL. WALK SIGN IS ON TO CROSS SAWMILL."
W4-W5	NORTHBOUND CROSSING SH 31	7	20	AUDIBLE "WAIT" AND PILOT LIGHT	AUDIBLE TONE AND BUTTON VIBRATION.	"WAIT TO CROSS SH 31"	"SH 31. WALK SIGN IS ON TO CROSS SH31."
W6-W7	WESTBOUND CROSSING SAWMILL DR	7	12	AUDIBLE "WAIT" AND PILOT LIGHT	AUDIBLE TONE AND BUTTON VIBRATION.	"WAIT TO CROSS SAWMILL"	"SAWMILL. WALK SIGN IS ON TO CROSS SAWMILL."

NOTE: APS PUSH BUTTON UNITS ARE IDENTIFIED BY THE OVERHEAD PEDESTRIAN SIGNAL MOUNTED ON THE SAME POLE AND USED DURING THE SAME PHASE REQUESTED BY THE BUTTON. IF TWO APS UNITS MUST BE CLOSER THAN 10 FT FROM EACH OTHER, A VERBAL MESSAGE WILL BE REQUIRED DURING DEFAULT OPERATION. CONTACT ENGINEER FOR APPROVAL.

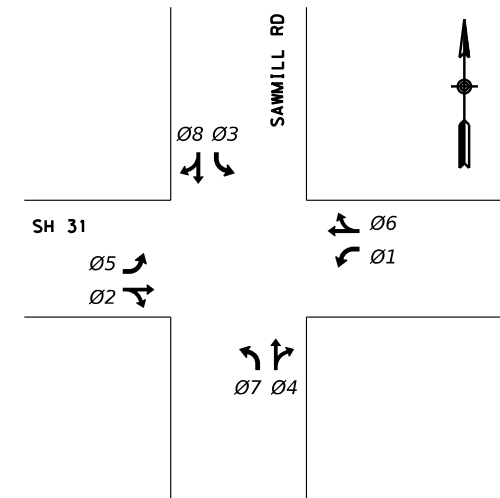

NO.	DATE	REVISION	APPROV.



Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856


**SH 31 AT SAWMILL RD.
 PROPOSED SIGNAL
 SUMMARIES**

SHEET 3 OF 3

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056


7/17/2023 6:53:19 AM c:\users\lme\appdata\local\temp\working\wpm-pw-01\viewing\wpm-pw-bentley.com_wpm-pw-01\viewing\wpm-pw-bentley.com\dms4744\03-18032-03-SH-31_Sawmill Rd_DT_516_50M-03.dgn

7/17/2023 6:54:00 AM
 c:\user\time\appdata\local\bentley\project\workingdir\wpm-pw-bentley.com_wpm-pw-01\tevwing@waltermoore.com\dms47244\03-18032-03-SH 31_Sawmill Rd_SPM.dgn

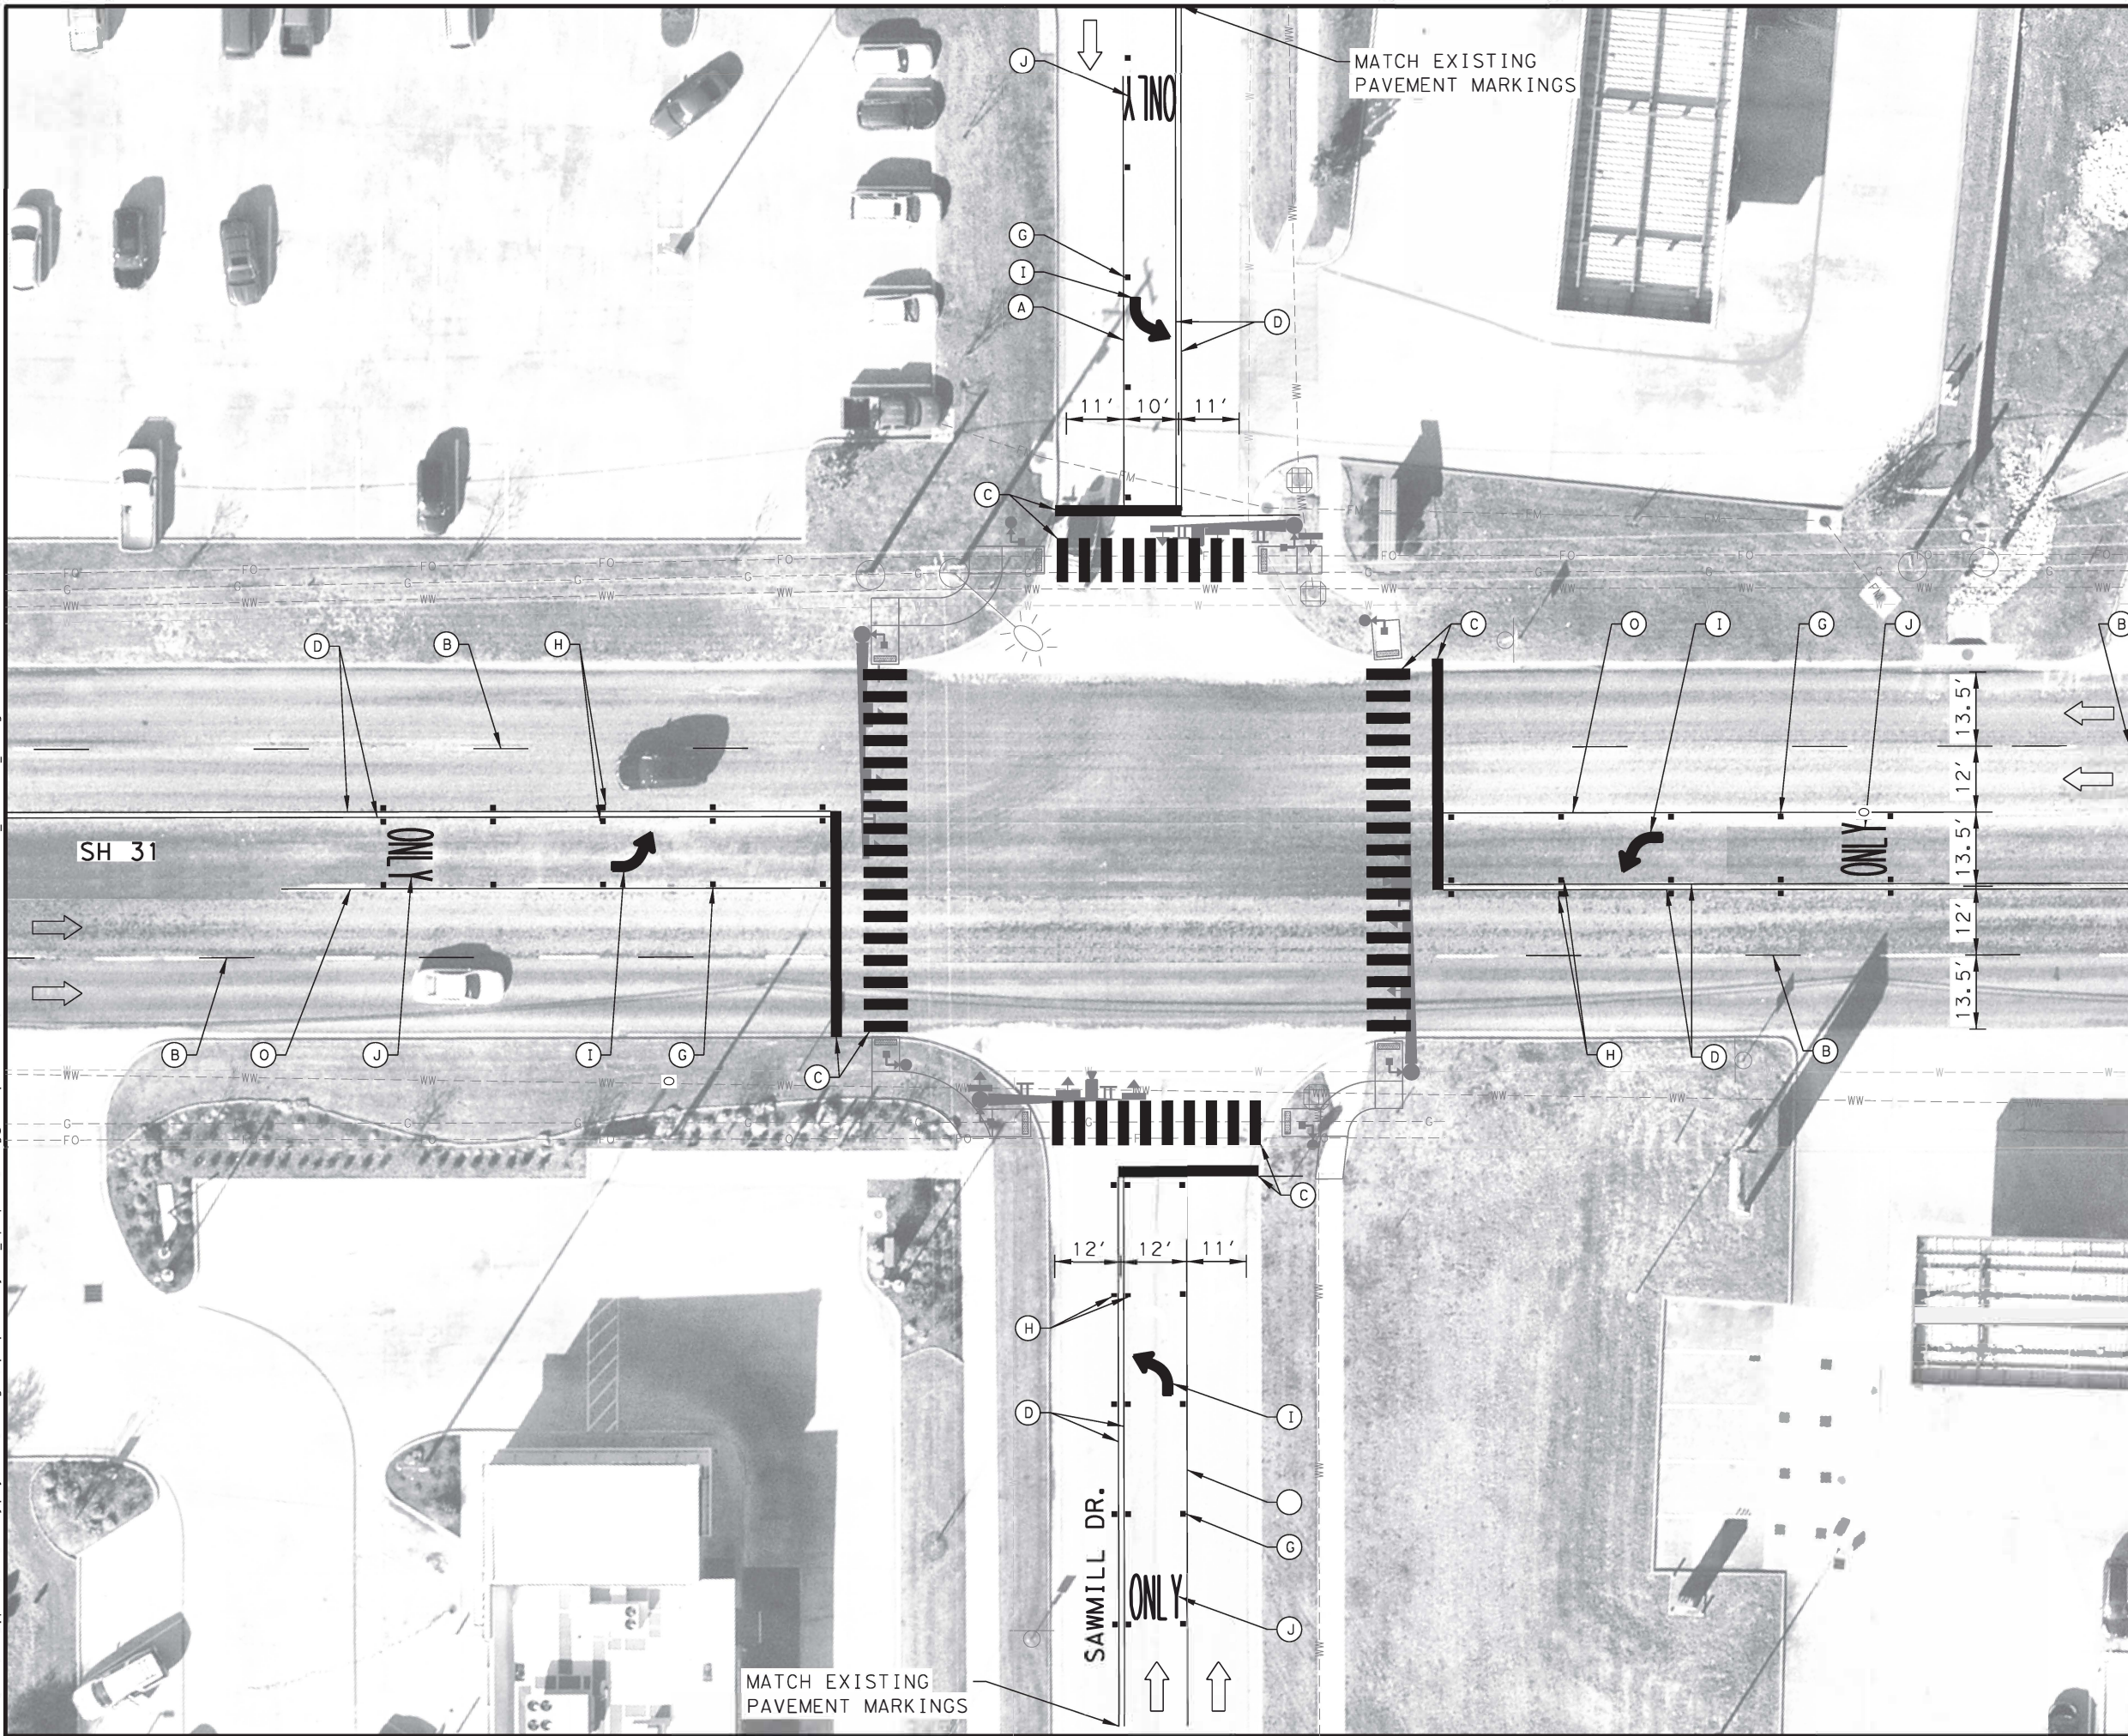

LEGEND


- (A) REFL PAV MRK TY I (W) (6") (SLD) (100MIL)
- (B) REFL PAV MRK TY I (W) (6") (BRK) (100MIL)
- (C) REFL PAV MRK TY I (W) (24") (SLD) (100MIL)
- (D) REFL PAV MRK TY I (Y) (6") (SLD) (100MIL)
- (E) REFL PAV MRK TY I-C
- (H) REFL PAV MRK TY II-A-A
- (I) REFL PAV MRK TY II(W) (ARROW) (100MIL)
- (J) REFL PAV MRK TY II(W) (WORD) (100MIL)
- (O) REFL PAV MRK TY I (W) (8") (SLD) (100MIL)
- H PROPOSED SMALL SIGN



Walter P. Moore and Associates, Inc.
 TBPE Firm Registration No. 1856



Juan de Jesus Diaz
 10/04/2024



NO.	DATE	REVISION	APPROV.






walter p moore
 Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856

**SH 31 AT SAWMILL RD.
 PROP. PAVEMENT MARKINGS
 LAYOUT**

SHEET 1 OF 1


DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056
				SHEET NO. 32

- NOTES:
1. All pedestrian signal heads shall be installed on the away-from-traffic side of the pedestal pole or signal pole.
 2. All wiring for pedestrian signals shall be completely enclosed within the signal mounting hardware.
 3. All pedestrian signal heads and push button detectors shall display the symbolized message shown.
 4. There shall be a continuous bare ground wire from all steel poles back to the electrical service.
 5. All pedestrian signal heads shall be 12" LED with 2 indications per signal head, unless otherwise shown in the plans.
 6. Use either a Screw-In Type Anchor Foundation or 24" Drill Shaft Foundation as shown elsewhere in the plans.
 7. See Special Specification 4003, "Screw-In Type Anchor Foundations" for further requirements.
 8. Engage all thread on the pedestal pole base and pipe, according to manufacturers recommendation, unless pipe is fully seated into base.
 9. Conduit in foundation and within 6" of foundation is subsidiary to Item 687, "Pedestal Pole Assemblies."
 10. Provide non-fused watertight breakaway electrical connectors for breakaway poles. (Bussmann HET, Littelfuse LET, Ferraz-Shawmut FEBN, or approved equal).
 11. For both pedestal pole and signal pole mounts, provide clearance as shown above the sidewalk level.
 12. Make connections to ground rods according to the NEC. Ground rod clamps shall be listed for their intended purpose.
 13. Provide pedestal pole base in accordance with Departmental Material Specifications.
 14. Unless otherwise shown on the plans, pole shaft shall be one piece, SCH 40 aluminum pipe, ASTM B221 (Alloy 6061-T6) only. Aluminum conduit will not be permitted.

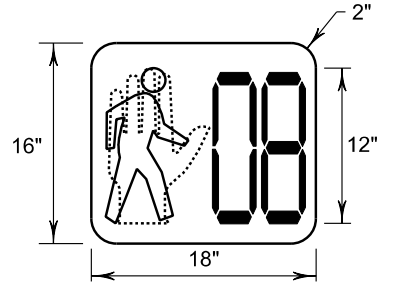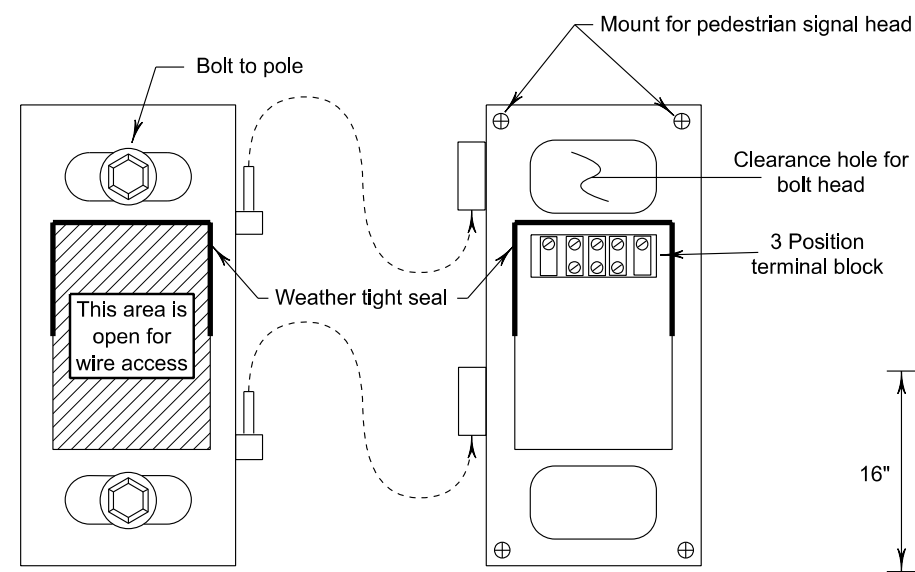
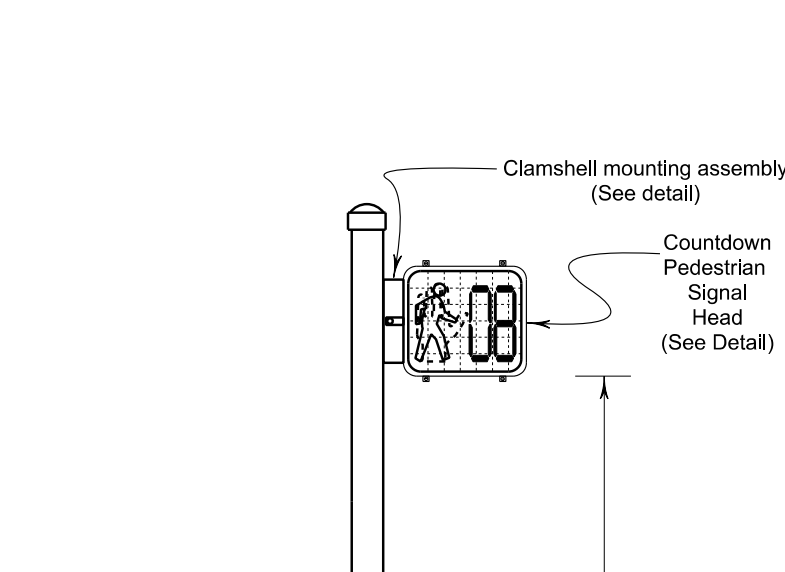


DETAIL OF CLAMSHELL TWO-PART MOUNTING ASSEMBLY WITH VANDAL-PROOF EXTERIOR LOCK

PEDESTRIAN COUNTDOWN SIGNAL HEAD DETAIL

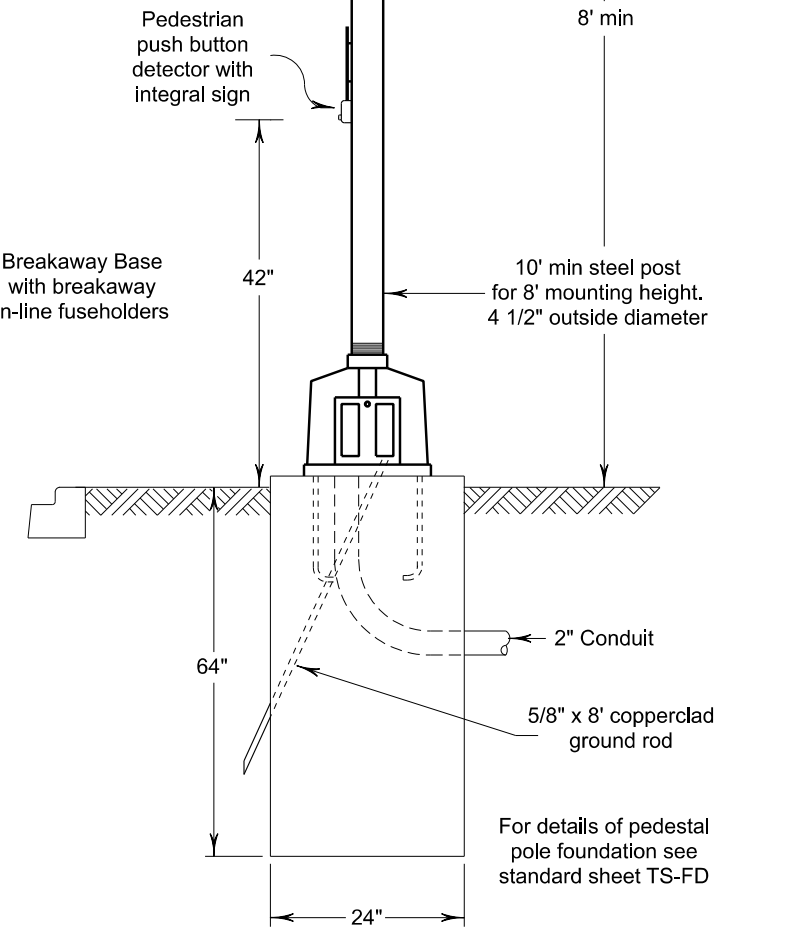


DETAIL OF PEDESTAL POLE WITH OPTIONAL CONCRETE FOUNDATION

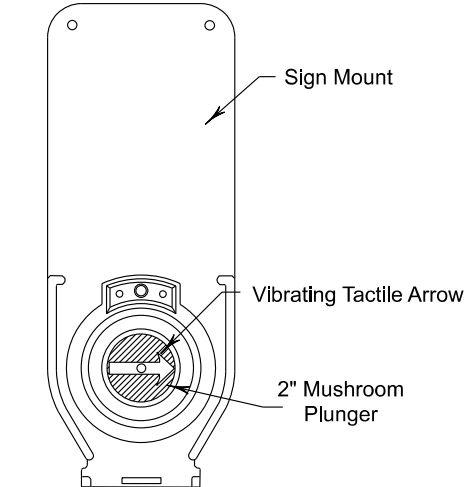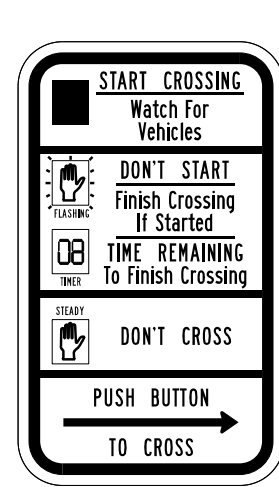


ACCESSIBLE PEDESTRIAN PUSH BUTTON DETECTOR WITH SIGN



Audible Pedestrian Signal

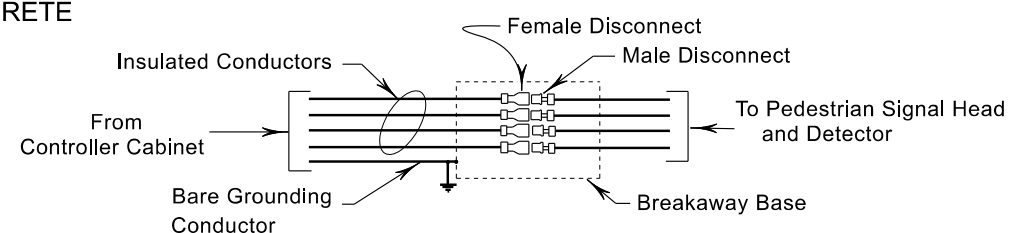

NON-FUSED BREAKAWAY ELECTRICAL CONNECTORS

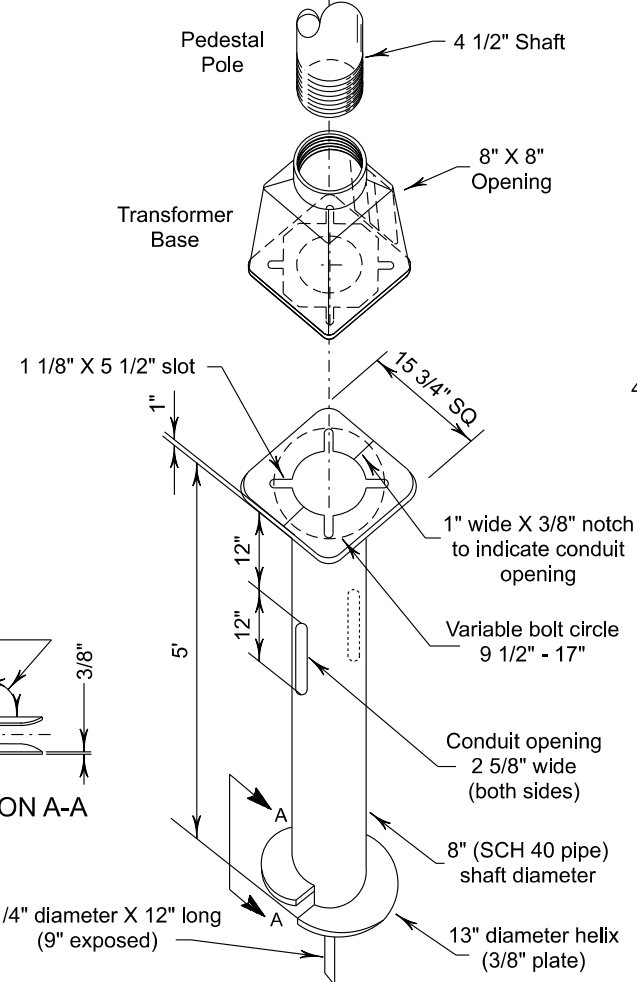

SCREW-IN ANCHOR FOUNDATION DETAIL

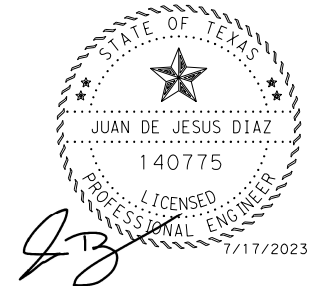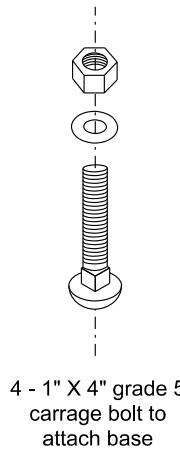

SCALE: N. T. S.

NO.	DATE	REVISION	APPROV.

© 2023
Texas Department of Transportation
 Walter P Moore and Associates, Inc.
 1301 McKinney, Suite 1100
 Houston, Texas 77010
 Texas Firm Registration No. 1856

SH 31 AT SAWMILL RD.
 PEDESTRIAN SIGNAL AND
 DETECTOR INSTALLATION DETAILS


SHEET 1 OF 1

DN:	FED. RD. DIV. NO.	STATE	PROJECT NO.	HIGHWAY NO.
CK DN:	6	TX	SEE TITLE SHEET	SH 31
DW:	STATE DIST.	COUNTY	CONTROL SECTION NO.	JOB NO.
CK DW:	TYL	HENDERSON	0164 03	056

7/17/2023 6:54:14 AM c:\users\lmalappdata\local\temp\project\working\wpm-pw-bentley.com_wpm-pw-01\viewing\wpm-pw-bentley.com\dmms47244\03-18032-03-sh_31_PED-SIG_DET.dgn

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for any errors or omissions resulting from its use.


DATE: 7/17/2023 6:54:56 AM
 FILE: c:\users\tim\AppData\Local\Bentley\Projectwise\workingdir\wpm-pw.bentley.com\projects\ed2-14\ed2-14.dgn

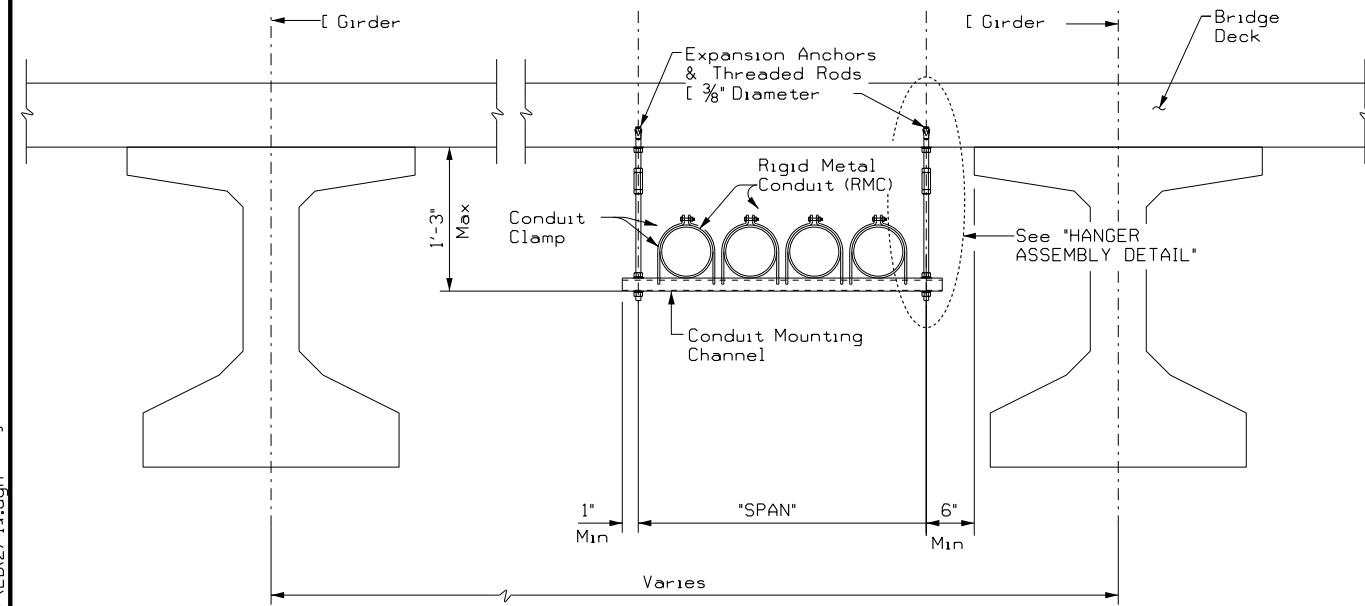


CONDUIT HANGING DETAIL

CONDUIT MOUNTING CHANNEL		
"SPAN"	"W" x "H"	"T"
less than 2'	1 5/8" x 1 3/8"	12 Ga.
2'-0" to 2'-6"	1 5/8" x 1 5/8"	12 Ga.
>2'-6" to 3'-0"	1 5/8" x 2 7/16"	12 Ga.


Channels with round or short slotted hole patterns are allowed, if the load carrying capacity is not reduced by more than 15%.

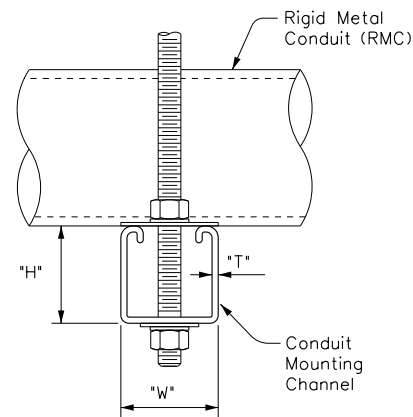

HANGER ASSEMBLY DETAIL

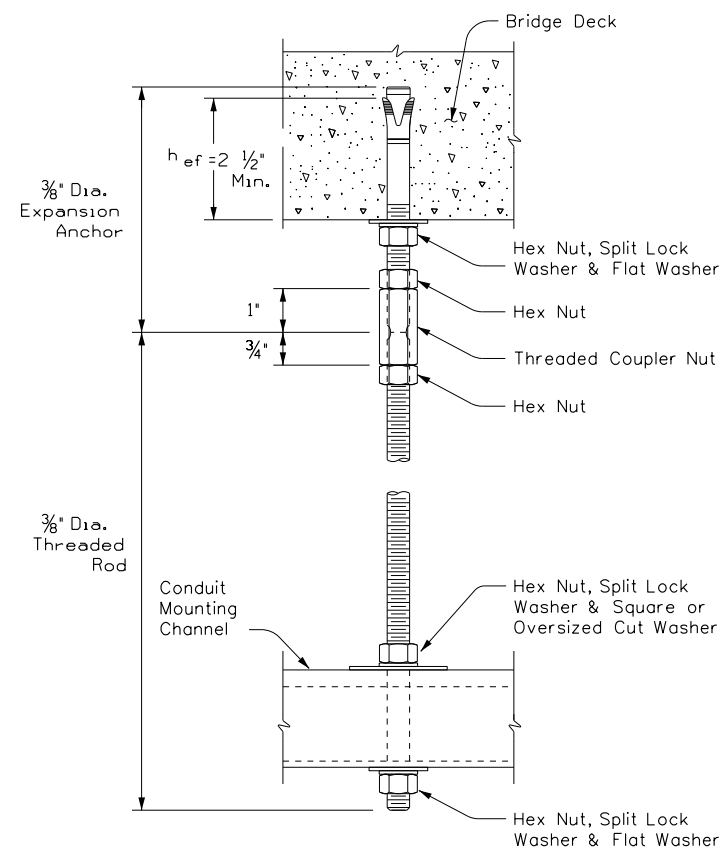


ELECTRIC CONDUIT TO BRIDGE DECK ATTACHMENT

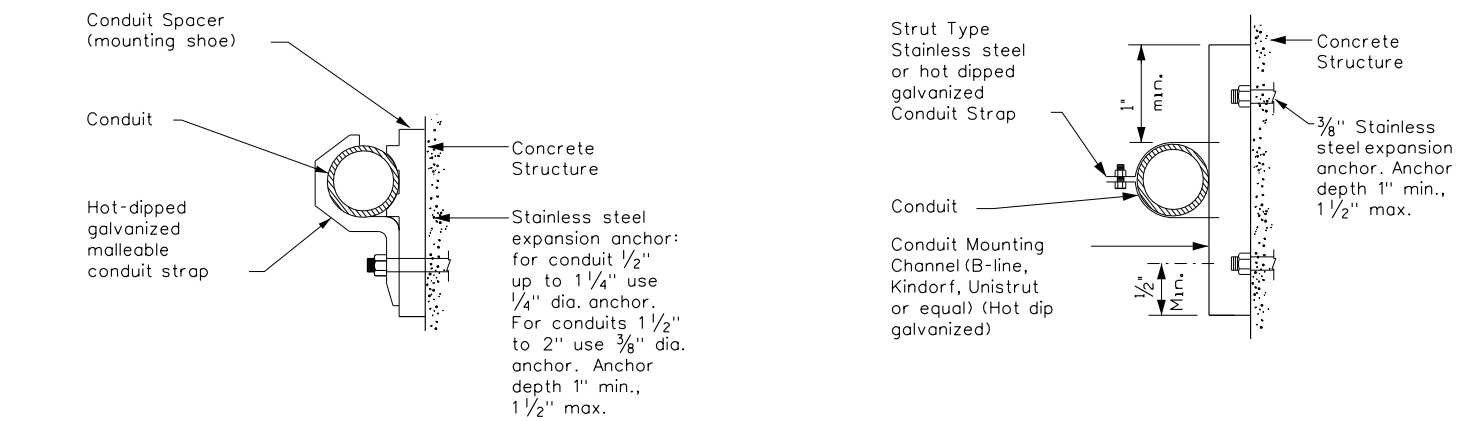

CONDUIT MOUNTING OPTIONS

Attachment to concrete surfaces
 See ED(1)B.2

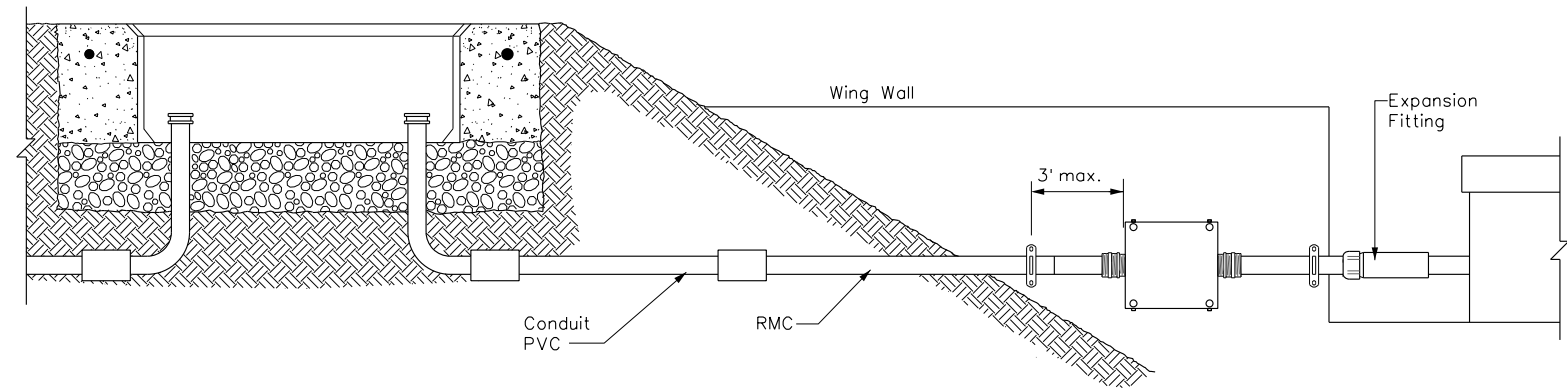

TYPICAL CONDUIT ENTRY TO BRIDGE STRUCTURE DETAIL


EXPANSION ANCHOR NOTES FOR BRIDGE DECK ATTACHMENT

1. Use torque controlled mechanical expansion anchors that are approved for use in cracked concrete by the International Code Council, Evaluation Service (ICC-ES). The chosen anchor product shall have a designated ICC-ES Evaluation Report number, and its approval status shall be maintained on the ICC-ES website under Division 031600 for Concrete Anchors.
2. Unless otherwise approved by the Engineer: do not use adhesive anchors; do not use expansion anchors that are not included in the ICC-ES approval list; and do not use expansion anchors that are only approved for use in uncracked concrete.
3. Use anchors manufactured with stainless steel expansion wedges. Anchors manufactured with carbon steel expansion wedges are not allowed. Anchor bodies can be either zinc-plated carbon steel or stainless steel. For application in marine environment, both the anchor body and expansion wedge shall be stainless steel.
4. Install anchors as shown on the plans and in accordance with the anchor manufacturer's published installation instructions. Arrange a field demonstration test to evaluate the procedures and tools. The test shall be witnessed and approved by the Engineer prior to furnishing anchors on the structure.
5. Prior to hole drilling, use rebar locator to ensure clearing of existing deck strands or reinforcement. Install anchors to ensure a minimum effective embedment depth, (ef), as shown. Increase (ef) as needed to ensure sufficient thread length for proper torqueing and tightening of anchors.
6. Use anchors of minimum 1600 Lbs tensile capacity (minimum of steel, concrete breakout, and concrete pullout strengths as determined by ACI 318 Appendix D) at the required minimum embedment depth (ef). No lateral loads shall be introduced after conduit installation.

				Traffic Operations Division Standard	
<h2>ELECTRICAL DETAILS</h2> <h2>CONDUIT SUPPORTS</h2>					
<h3>ED(2)-14</h3>					
FILE:	ed2-14.dgn	DWG:	TxDOT	CHK:	TxDOT
© TxDOT	October 2014	CONT:	0164	SECT:	03
REVISIONS		JOB:	056	HIGHWAY:	SH 31
		DIST:	COUNTY:	SHEET NO.	
		TYL:	HENDERSON	35	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for any errors or omissions resulting from its use.

DATE: 7/17/2023 6:55:00 AM
 FILE: c:\users\time\AppData\Local\Bentley\Projectwise\workingdir\pwm-pw.bentley.com\... \ed4-14.dgn

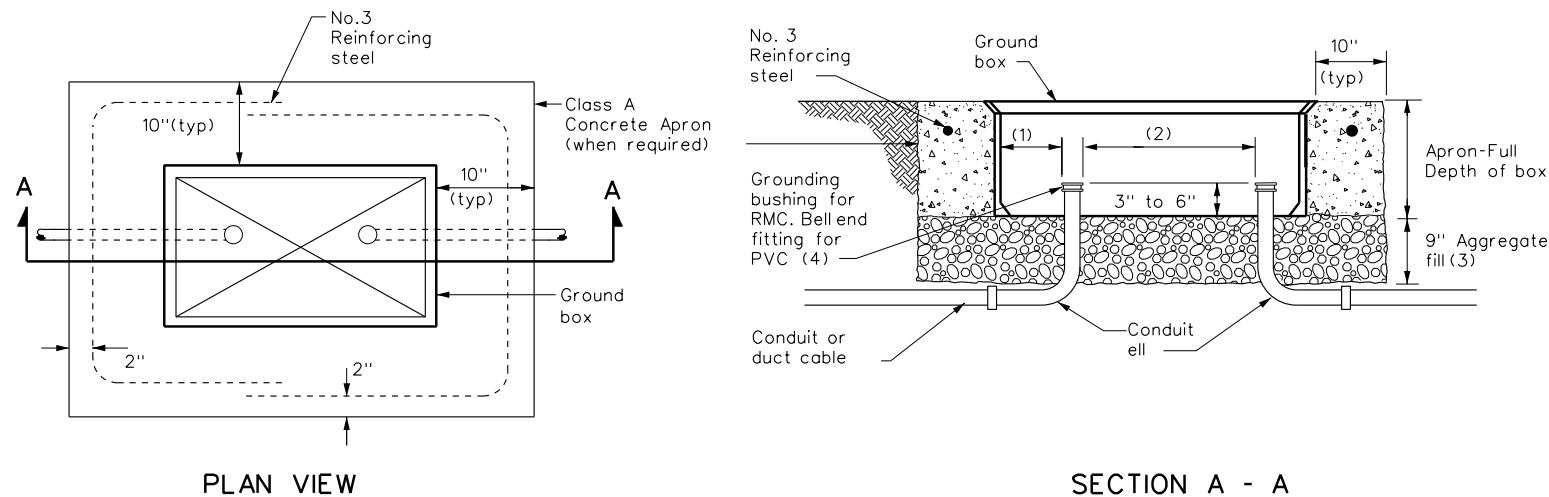

APRON FOR GROUND BOX

- (1) Uniformly space ends of conduits within the ground box. Position ends of conduits so that ground box walls do not interfere with the installation of grounding bushings or bell end fittings.
- (2) Maintain sufficient space between conduits to allow for proper installation of bushing.
- (3) Place aggregate under the box, not in the box. Aggregate should not encroach on the interior volume of the box.
- (4) Install a grounding bushing on the upper end of all RMC terminating in a ground box. Ground RMC elbows when any part of the elbow is less than 18 in. below the bottom of the ground box. Install a PVC bushing or bell end fitting on the upper end of all PVC conduits terminating in a ground box.

GROUND BOXES

A. MATERIALS

1. Provide polymer concrete ground boxes measuring 16x30x24 in. (WxLxD) or smaller in accordance with Departmental Material Specification (DMS) 11070 "Ground Boxes" and Item 624 "Ground Boxes."
2. Provide Type A, B, C, D, and E ground boxes as shown in the plans, and as listed on the Material Producers List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies," Item 624.
3. Ensure ground box cover is correctly labeled in accordance with DMS 11070.
4. Provide larger ground boxes in accordance with Item 624 and as shown in the plans.

B. CONSTRUCTION METHODS


1. Remove all gravel and dirt from conduit. Cap all conduits prior to placing aggregate and setting ground box. Provide Grade 3 or 4 coarse aggregate as shown on Table 2 of Item 302 "Aggregates for Surface Treatments." Ensure aggregate bed is in place and at least 9 inches deep, prior to setting the ground box. Install ground box on top of aggregate.
2. Cast ground box aprons in place. Reinforcing steel may be field bent. Ensure the depth of concrete for the apron extends from finished grade to the top of the aggregate bed under the box. Ground box aprons, including concrete and reinforcing steel, are subsidiary to ground boxes when called for by descriptive code.
3. Keep bolt holes in the box clear of dirt. Bolt covers down when not working in ground boxes.
4. Install all conduits and ells in a neat and workmanlike manner. Uniformly space conduits so grounding bushings and bell end fittings can easily be installed.
5. Temporarily seal all conduits in the ground box until conductors are installed.
6. Permanently seal conduits immediately after the completion of conductor installation and pull tests. Permanently seal the ends of all conduits with duct seal, expandable foam, or other method as approved. Do not use duct tape as a permanent conduit sealant. Do not use silicone caulk as a sealant.
7. When a ground rod is present in a ground box, bond all equipment grounding conductors together and to the ground rod with listed connectors.
8. When a type B or D ground box is stacked to meet volume requirements, it is allowable to cut an appropriately sized hole for conduit entry in the side wall at least 18 inches below grade.
9. If an existing ground box in the contract has a metal cover, bond the cover to the equipment grounding conductor with a 3 ft. long stranded bonding jumper the same size as the grounding conductor. The bonding jumper is subsidiary to various bid items. Verify existing ground boxes with metal covers are shown on the plans, with notes fully describing the work required.
10. If other ground boxes with metal covers are within the project limits but are not part of the contract, the Engineer may direct the Contractor to bond the metal covers, identifying the specific boxes in writing. This work will be paid for separately.
11. Bond metal ground box covers to the grounding conductor with a tank ground type lug.

GROUND BOX DIMENSIONS

TYPE	OUTSIDE DIMENSIONS (INCHES) (Width x Length X Depth)
A	12 X 23 X 11
B	12 X 23 X 22
C	16 X 29 X 11
D	16 X 29 X 22
E	12 X 23 X 17

GROUND BOX COVER DIMENSIONS

TYPE	DIMENSIONS (INCHES)							
	H	I	J	K	L	M	N	P
A, B & E	23 1/4	23	13 3/4	13 1/2	9 7/8	5 1/8	1 3/8	2
C & D	30 1/2	30 1/4	17 1/2	17 1/4	13 1/4	6 3/4	1 3/8	2

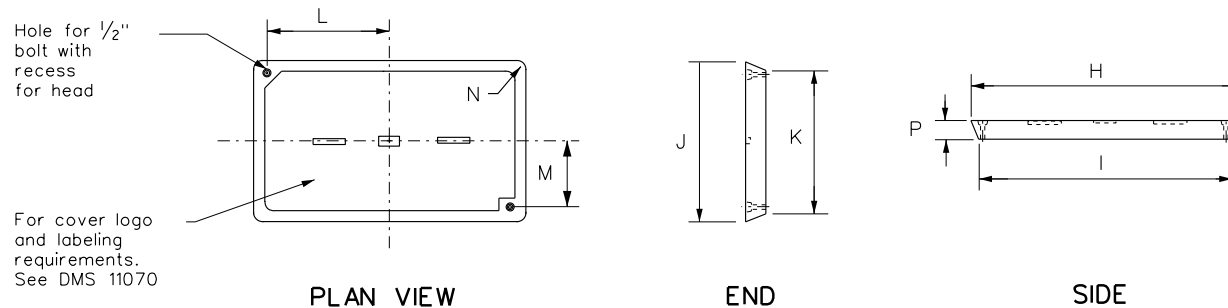


GROUND BOX COVER


				Traffic Operations Division Standard	
<p>ELECTRICAL DETAILS GROUND BOXES</p> <p>ED(4)-14</p>					
FILE:	ed4-14.dgn	DWG:	TxDOT	CHK:	TxDOT
© TxDOT	October 2014	CONT:	0164	SECT:	03
REVISIONS		JOB:	056	HIGHWAY:	SH 31
		DIST:	COUNTY	SHEET NO.	
		TYL:	HENDERSON	37	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to metric units or for any errors or omissions resulting from its use.


DATE: 7/17/2023 6:55:02 AM
FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\wpm-pw.bentley.com\projects\0164\03\056\ED(6)-14.dgn

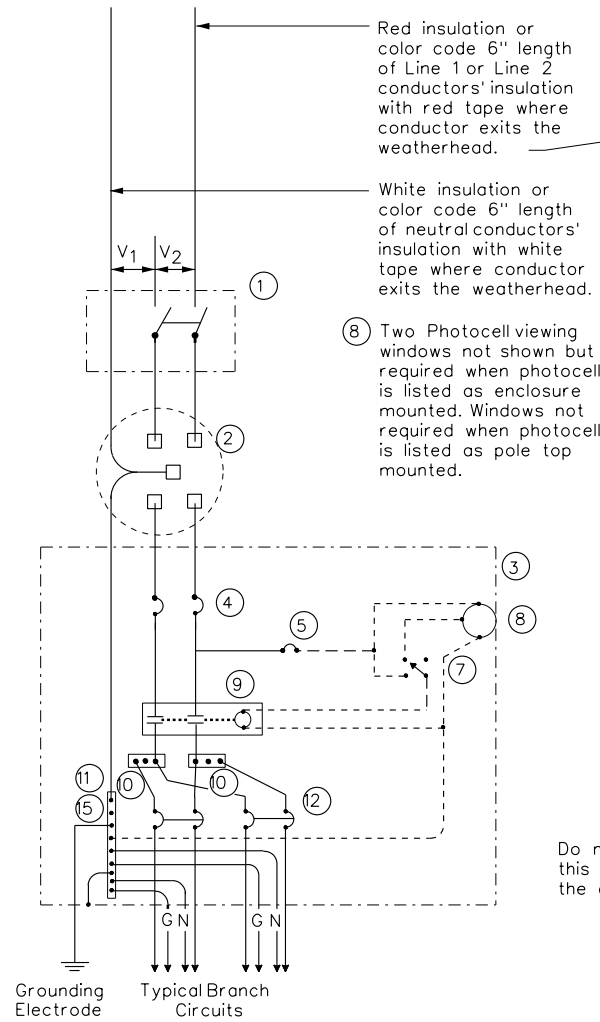


SCHEMATIC TYPE A
THREE WIRE

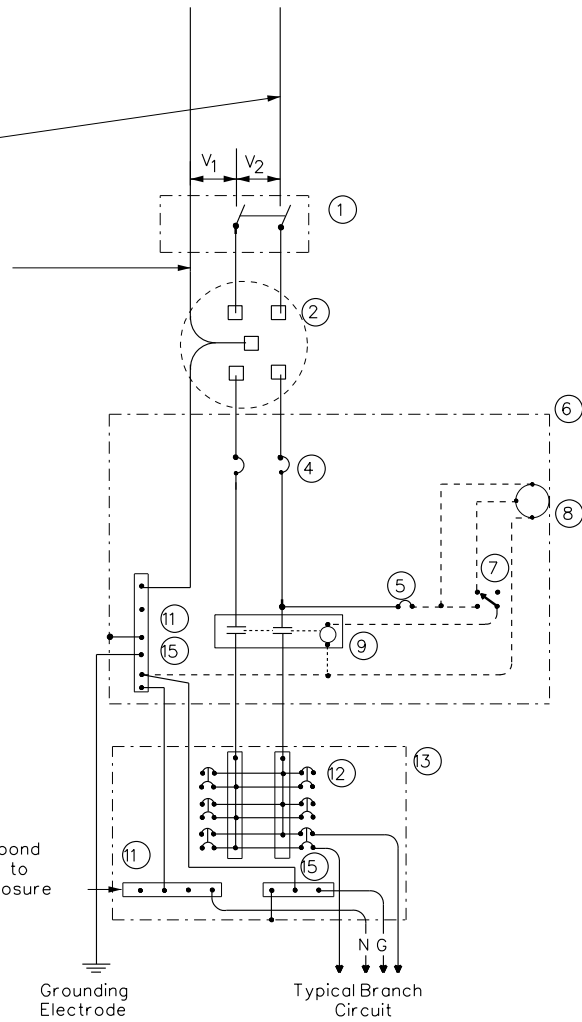

SCHEMATIC TYPE C
THREE WIRE

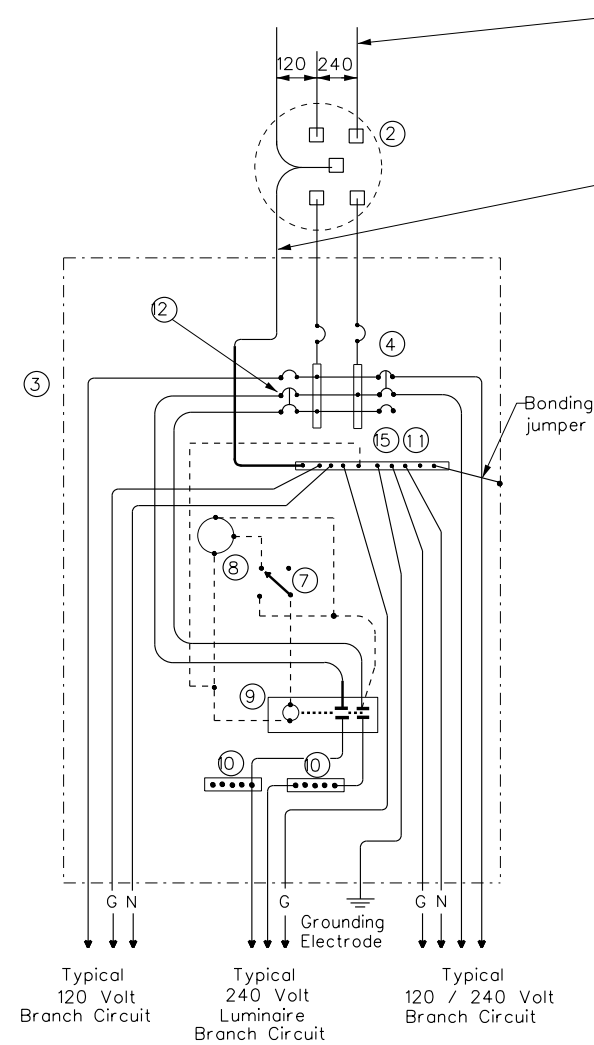

SCHEMATIC TYPE D - CUSTOM
120/240 VOLTS - THREE WIRE

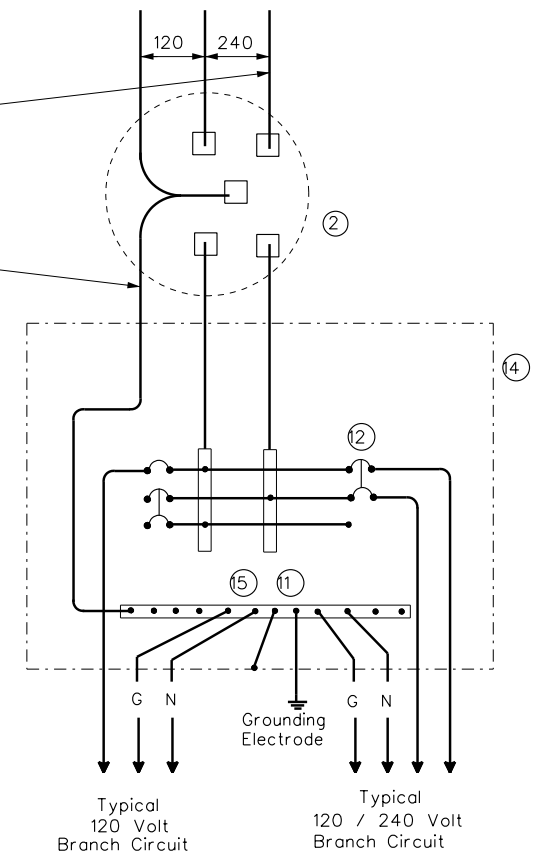

SCHEMATIC TYPE T
120/240 VOLTS - THREE WIRE

Galvanized steel-"Buy Off The Shelf" only. When required install photocell top of the pole or on luminaire only, no lighting contractor will be installed.

WIRING LEGEND	
—————	Power Wiring
-----	Control Wiring
—N—	Neutral Conductor
—G—	Equipment grounding conductor-always required

SCHEMATIC LEGEND	
1	Safety Switch (when required)
2	Meter (when required-verify with electric utility provider)
3	Service Assembly Enclosure
4	Main Disconnect Breaker (See Electrical Service Data)
5	Circuit Breaker, 15 Amp (Control Circuit)
6	Auxiliary Enclosure
7	Control Station ("H-O-A" Switch)
8	Photo Electric Control (enclosure-mounted shown)
9	Lighting Contactor
10	Power Distribution Terminal Blocks
11	Neutral Bus
12	Branch Circuit Breaker (See Electrical Service Data)
13	Separate Circuit Breaker Panelboard
14	Load Center
15	Ground Bus

Traffic Operations Division Standard

ELECTRICAL DETAILS
SERVICE ENCLOSURE
AND NOTES

ED(6)-14

FILE: ed6-14.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
© TxDOT October 2014	CONT: 0164	SECT: 03	JOB: 056	HIGHWAY: SH 31
REVISIONS		DIST: TYL	COUNTY: HENDERSON	SHEET NO.: 39

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for the accuracy of the information contained herein.

DATE: 7/17/2023 6:55:04 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\pwm-pw.bentley.com\pwm-pw.bentley.com\projects\ed7-14\ed7-14.dwg

SUPPORT TYPE STEEL POLE (SP) AND STEEL FRAME (SF)

1. Provide steel pole and steel frame supports as per TxDOT Departmental Material Specification (DMS) 11080 "Electrical Services." Mount all equipment and conduit on 12 gauge galvanized steel or stainless steel channel strut, 1 1/2 in. or 1 3/8 in. wide by 1 in. up to 3 3/4 in. deep Unistrut, Kindorf, B-line or equal. Bolt or weld all channel and hardware to vertical members as approved. Do not stack channel. File smooth and paint field cut ends of all channel with zinc-rich paint before installing.
2. Provide poles for overhead service with an eyebolt or similar fitting for attachment of the service drop to the pole in conformance with the electric utility provider's specifications.
3. Provide and install galvanized 3/4 in. x 18 in. x 4 in. (dia. x length x hook length) anchor bolts for underground service supports. Provide and install galvanized 3/4 in. x 56 in. x 4 in. anchor bolts for overhead service supports. Ensure anchor bolts have 3 in. of thread, with 3 1/4 in. to 3 1/2 in. of the exposed anchor bolt projecting above finished foundation. Provide and install leveling nuts for all anchor bolts.
4. Bond one of the anchor bolts to the rebar cage with 6 AWG bare stranded copper conductor. Use listed mechanical connectors rated for embedment in concrete. See Inset B.
5. Furnish and install rigid metallic ells in all steel pole and steel frame foundations for all conduits entering the service from underground.
6. Use class C concrete for foundations. Ensure reinforcing steel is Grade 60 with 3" of unobstructed concrete cover.
7. Drill and tap steel poles and frames for 1/2 in. X 13 UNC tank ground fitting. For steel pole service supports, provide and install tank ground fitting 4 in. to 6 in. below electrical service enclosure. Provide properly sized hole through the bottom of the enclosure for the service grounding electrode conductor. Ensure electrical service grounding electrode conductor is as short and straight as possible from the enclosure to the tank ground fitting. For steel frame service supports, provide and install tank ground fitting on steel frame post. Install service grounding electrode conductor in a non-metallic conduit or tubing from the enclosure to the steel frame post. Connect electrical service grounding electrode conductor to the tank ground fitting. See steel frame and steel pole details and Inset A for more information. Size service entrance conduit and branch circuit conduit as shown in the plans. For underground conduit runs from the electrical service, extend RMC from the service enclosure to an RMC elbow, and then connect the schedule type and size of conduit shown in the plans. Provide and install grounding bushings where RMC terminates in the enclosure. Grounding bushings are not required when RMC is fitted into a sealing hub or threaded boss.
8. If Steel pole or frame is painted, bond each separate painted piece with a bonding jumper attached to a tapped hole.
9. Provide 1/4" - 20 machine screws for bonding. Do not use sheet metal screws. Remove all non-conductive material at contact points. Terminate bonding jumpers with listed devices. Install minimum size 6 AWG stranded copper bonding jumpers. Make up all threaded bonding connections wrench tight.
10. Avoid contact of the service drop and service entrance conductors with the metal pole to prevent abrasion of the insulated conductors.
11. Shop drawings are not required for service support structure unless specifically stated elsewhere or directed by the Engineer.

White insulation or color code 6" of neutral conductor's insulation with white tape where conductor exits weatherhead.

Red insulation or color code 6" length of Line 1 or Line 2 conductor's insulation with red tape where conductor exits the weatherhead. Conductor slack length, 12" min., 18" max.

2" to 6" 4" (typ.)

RMC

Service Enclosure

Inset A

Channel bracket or other arrangement approved by the Engineer. (Kindorf, Unistrut, B-line or equal.)

Inset B

60" TYP.

2"

18" Min.

Class "C" concrete

RMC

PVC

24 Dia. x 60" depth foundation 4-#5 reinforcing bars and #2 spiral (typ.) at 6" pitch

20' measured from grade. Circumstances may require the electrical service support to be taller than the 20' shown, check with utility before installing.

Point of attachment of service drop to be below weatherhead.

Conduit support spacing, 3' max from the ends, and 5' in between unless otherwise called for by the utility.

Top of weatherhead to be 2" to 6", 4" typical below the top of pole.

White insulation or color code 6" of neutral conductor's insulation with white tape where conductor exits weatherhead.

Red insulation or color code 6" length of Line 1 or Line 2 conductor's insulation with red tape where conductor exits the weatherhead. Conductor slack length, 12" min., 18" max.

Meter

Service Enclosure

Inset A

Inset B

18" Min.

24" dia. X 60" foundation 4-#5 reinforcing bars and #2 spiral (typ.) at 6" pitch

Drill, tap, and thread 1/2" X 13 UNC. Install tank ground fitting, connect electrical service grounding electrode conductor. See Note 7.

Rebar

Anchor Bolt


See Note 4

5" thick concrete pad (class C concrete and 6" X 6" #6 wire mesh)



1/2" expansion joint material

5'-6"


Dimension varies, install only as wide as required to accommodate equipment

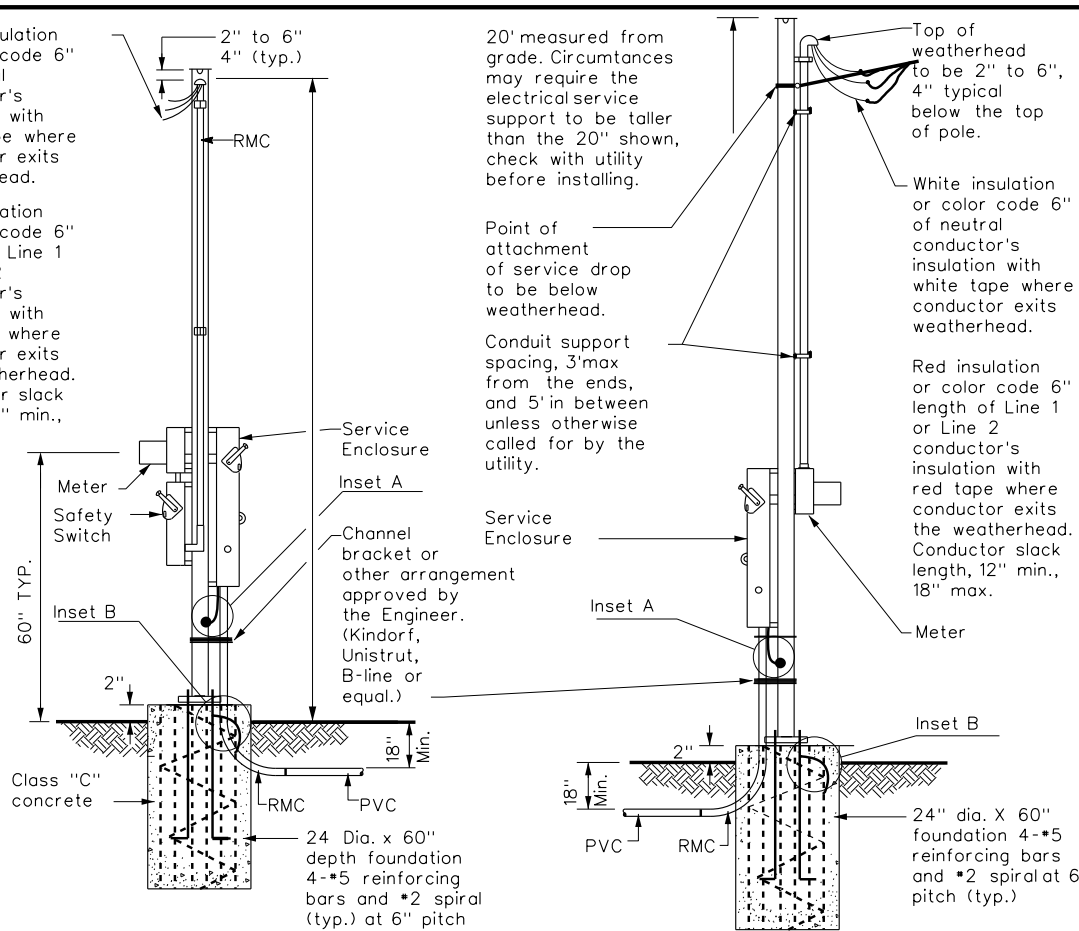




WITH SAFETY SWITCH WITHOUT SAFETY SWITCH
SERVICE SUPPORT TYPE SP (O) - OVERHEAD SERVICE

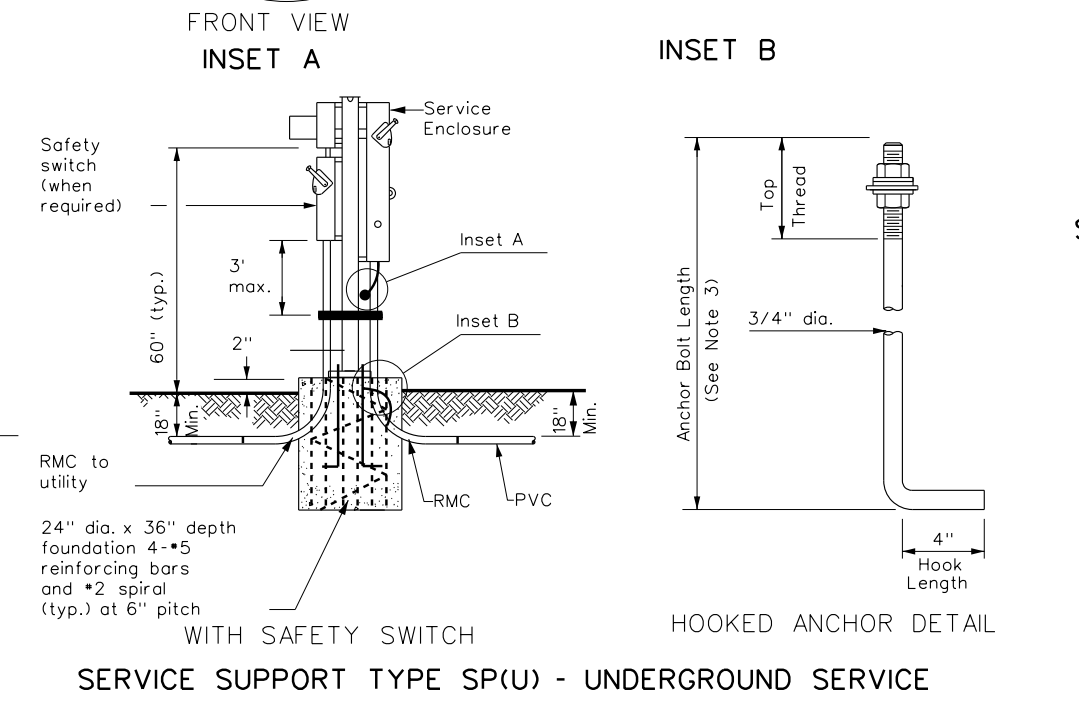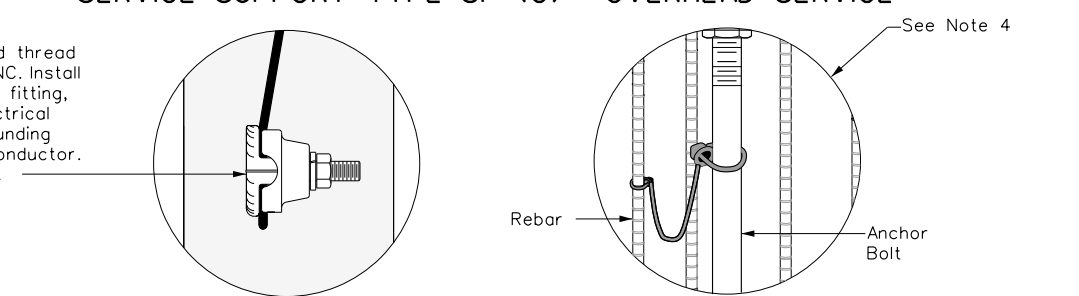


WITH SAFETY SWITCH HOOKED ANCHOR DETAIL
SERVICE SUPPORT TYPE SP (U) - UNDERGROUND SERVICE

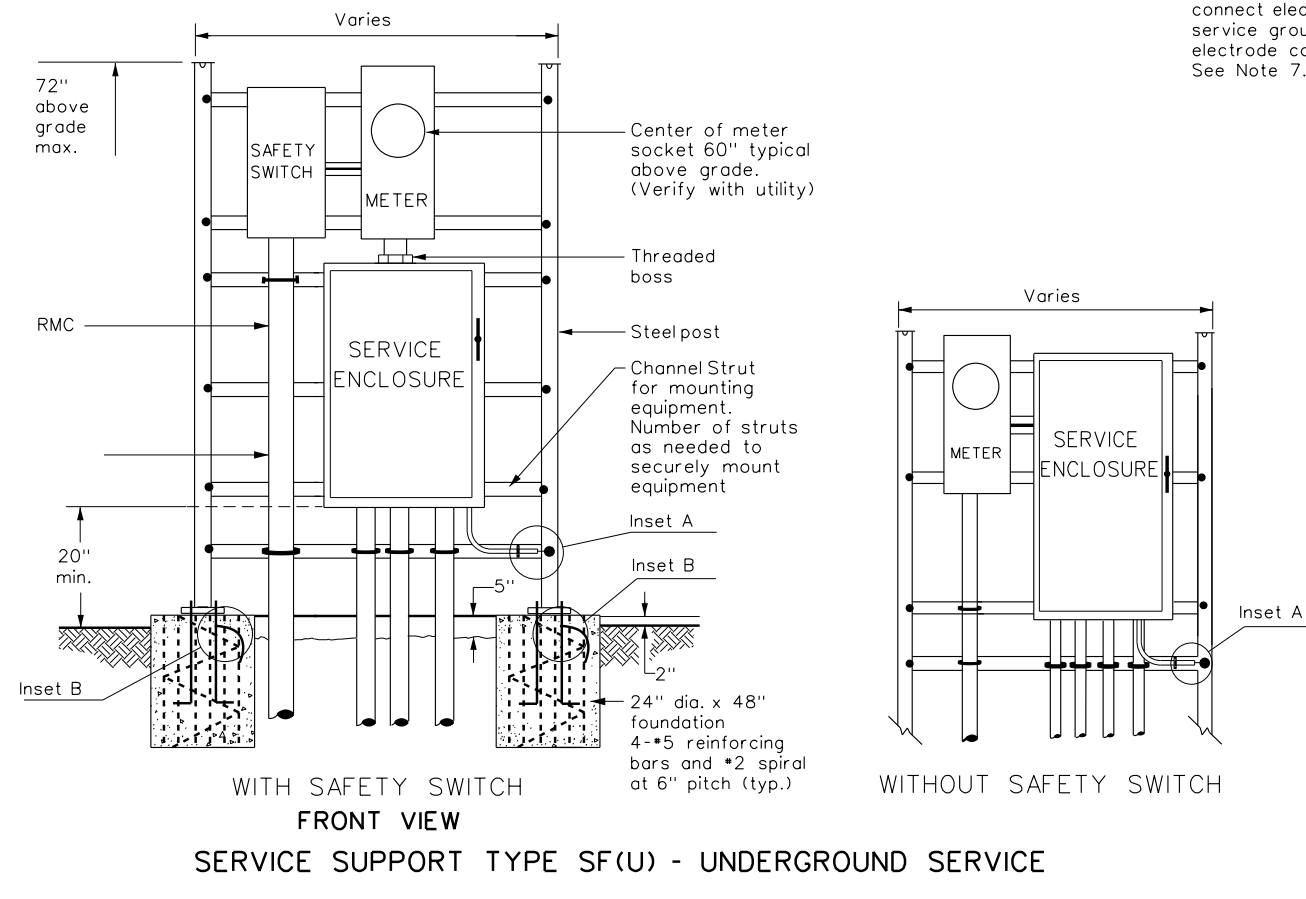

WITH SAFETY SWITCH WITHOUT SAFETY SWITCH
SERVICE SUPPORT TYPE SF (U) - UNDERGROUND SERVICE

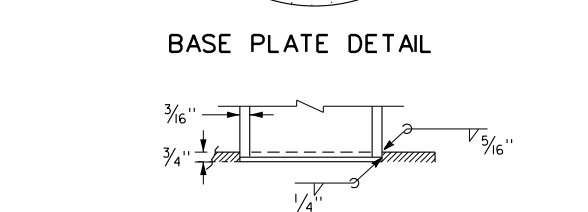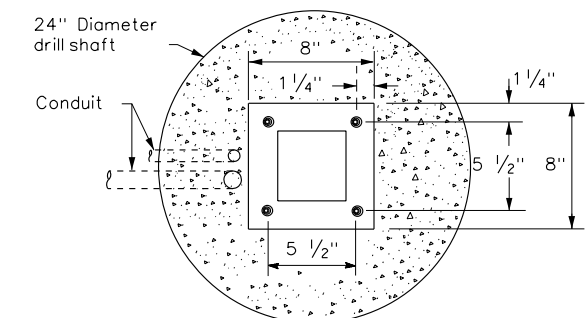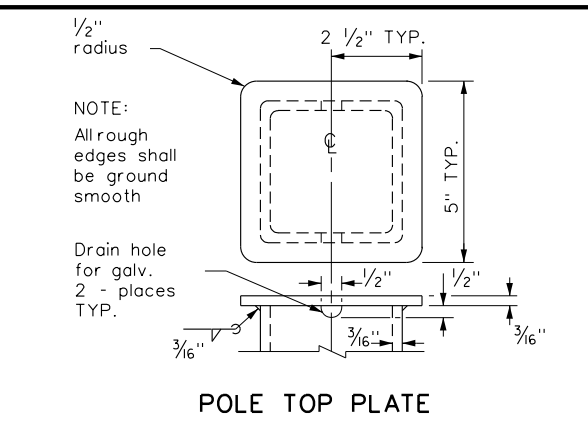

POLE TOP PLATE
BASE PLATE DETAIL
BOTTOM OF POLE

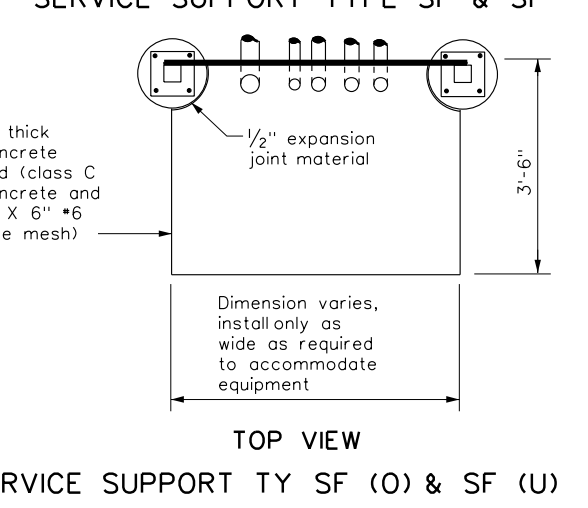


SERVICE SUPPORT TYPE SF (O) & SF (U)

		Traffic Operations Division Standard	
ELECTRICAL DETAILS SERVICE SUPPORT TYPES SF & SP ED(7)-14			
FILE: ed7-14.dgn	DWG: TxDOT	CK: TxDOT	DW: TxDOT
© TxDOT October 2014	CON: 0164	SECT: 03	JOB: 056
REVISIONS	DIST: TYL	COUNTY: HENDERSON	HIGHWAY: SH 31
			SHEET NO. 40

TRAFFIC SIGNAL NOTES

- 1. Do not pass luminaire conductors through the signal controller cabinet.
- 2. Include an equipment grounding conductor in all conduits throughout the electrical system. Bond all exposed metal parts to the grounding conductor.
- 3. Provide roadway luminaires, when required, in accordance with the material and construction sections of Item 610, "Roadway Illumination Assemblies," except for performance testing of luminaires. Test installed roadway luminaires for proper operation as a part of the associated traffic signal system test.
- 4. If internally illuminated street name signs are approved for use, ground the fixture to the pole with a 12 AWG green XHHW conductor.
- 5. Bond anchor bolts to rebar cage in two locations using #3 bars or 6 AWG stranded copper conductors. Use listed mechanical connectors rated for embedment in concrete. See TXDOT standard TS-FD for further details.
- 6. Drill and tap signal poles for $\frac{1}{2}$ in. X 13 UNC tank ground fitting. Provide and install tank ground fitting 4 in. to 6 in. directly below electrical service enclosure. Provide properly sized hole through the bottom of the enclosure for the service grounding electrode conductor. Connect the electrical service grounding electrode conductor to the tank ground fitting. Ensure electrical service grounding electrode conductor is as short and straight as possible from the enclosure to the tank ground fitting. See Inset A detail for further information. Size service entrance conduit and branch circuit conduit as shown in the plans.
- 7. Mount electrical service enclosure and meter to signal pole with stainless steel bands. Ensure bands are a minimum width of $\frac{1}{4}$ in. Secure enclosures to bands using two-bolt brackets. Install brackets near top and bottom of each enclosure. Install properly sized stainless steel washers on each bolt in the enclosure. Band or drill and tap properly sized stand-off straps to signal pole for attaching conduit.
- 8. Conduct pull tests and insulation resistance tests on all illumination and power conductors as required in Item 620 "Electrical Conductors" and ED(3). To prevent electronics damage, do not conduct insulation resistance tests on traffic signal cables after termination.
- 9. Lock all enclosures and bolt down all ground box covers before applying power to the signal installation.
- 10. Terminate conduits entering the top of enclosures with a conduit-sealing hub or threaded boss such as meter hub. Install a grounding bushing on all metal conduits not connected to conduit-sealing hub or threaded boss. Bond the grounding bushing to the ground bus with a bonding jumper. Seal all conduits entering enclosures with duct seal or expanding foam. Do not use silicone to seal conduit ends.
- 11. For all conduits, ensure the burial depth is a minimum of 18". Ensure the minimum burial depth for conduit placed under a roadway is 24".

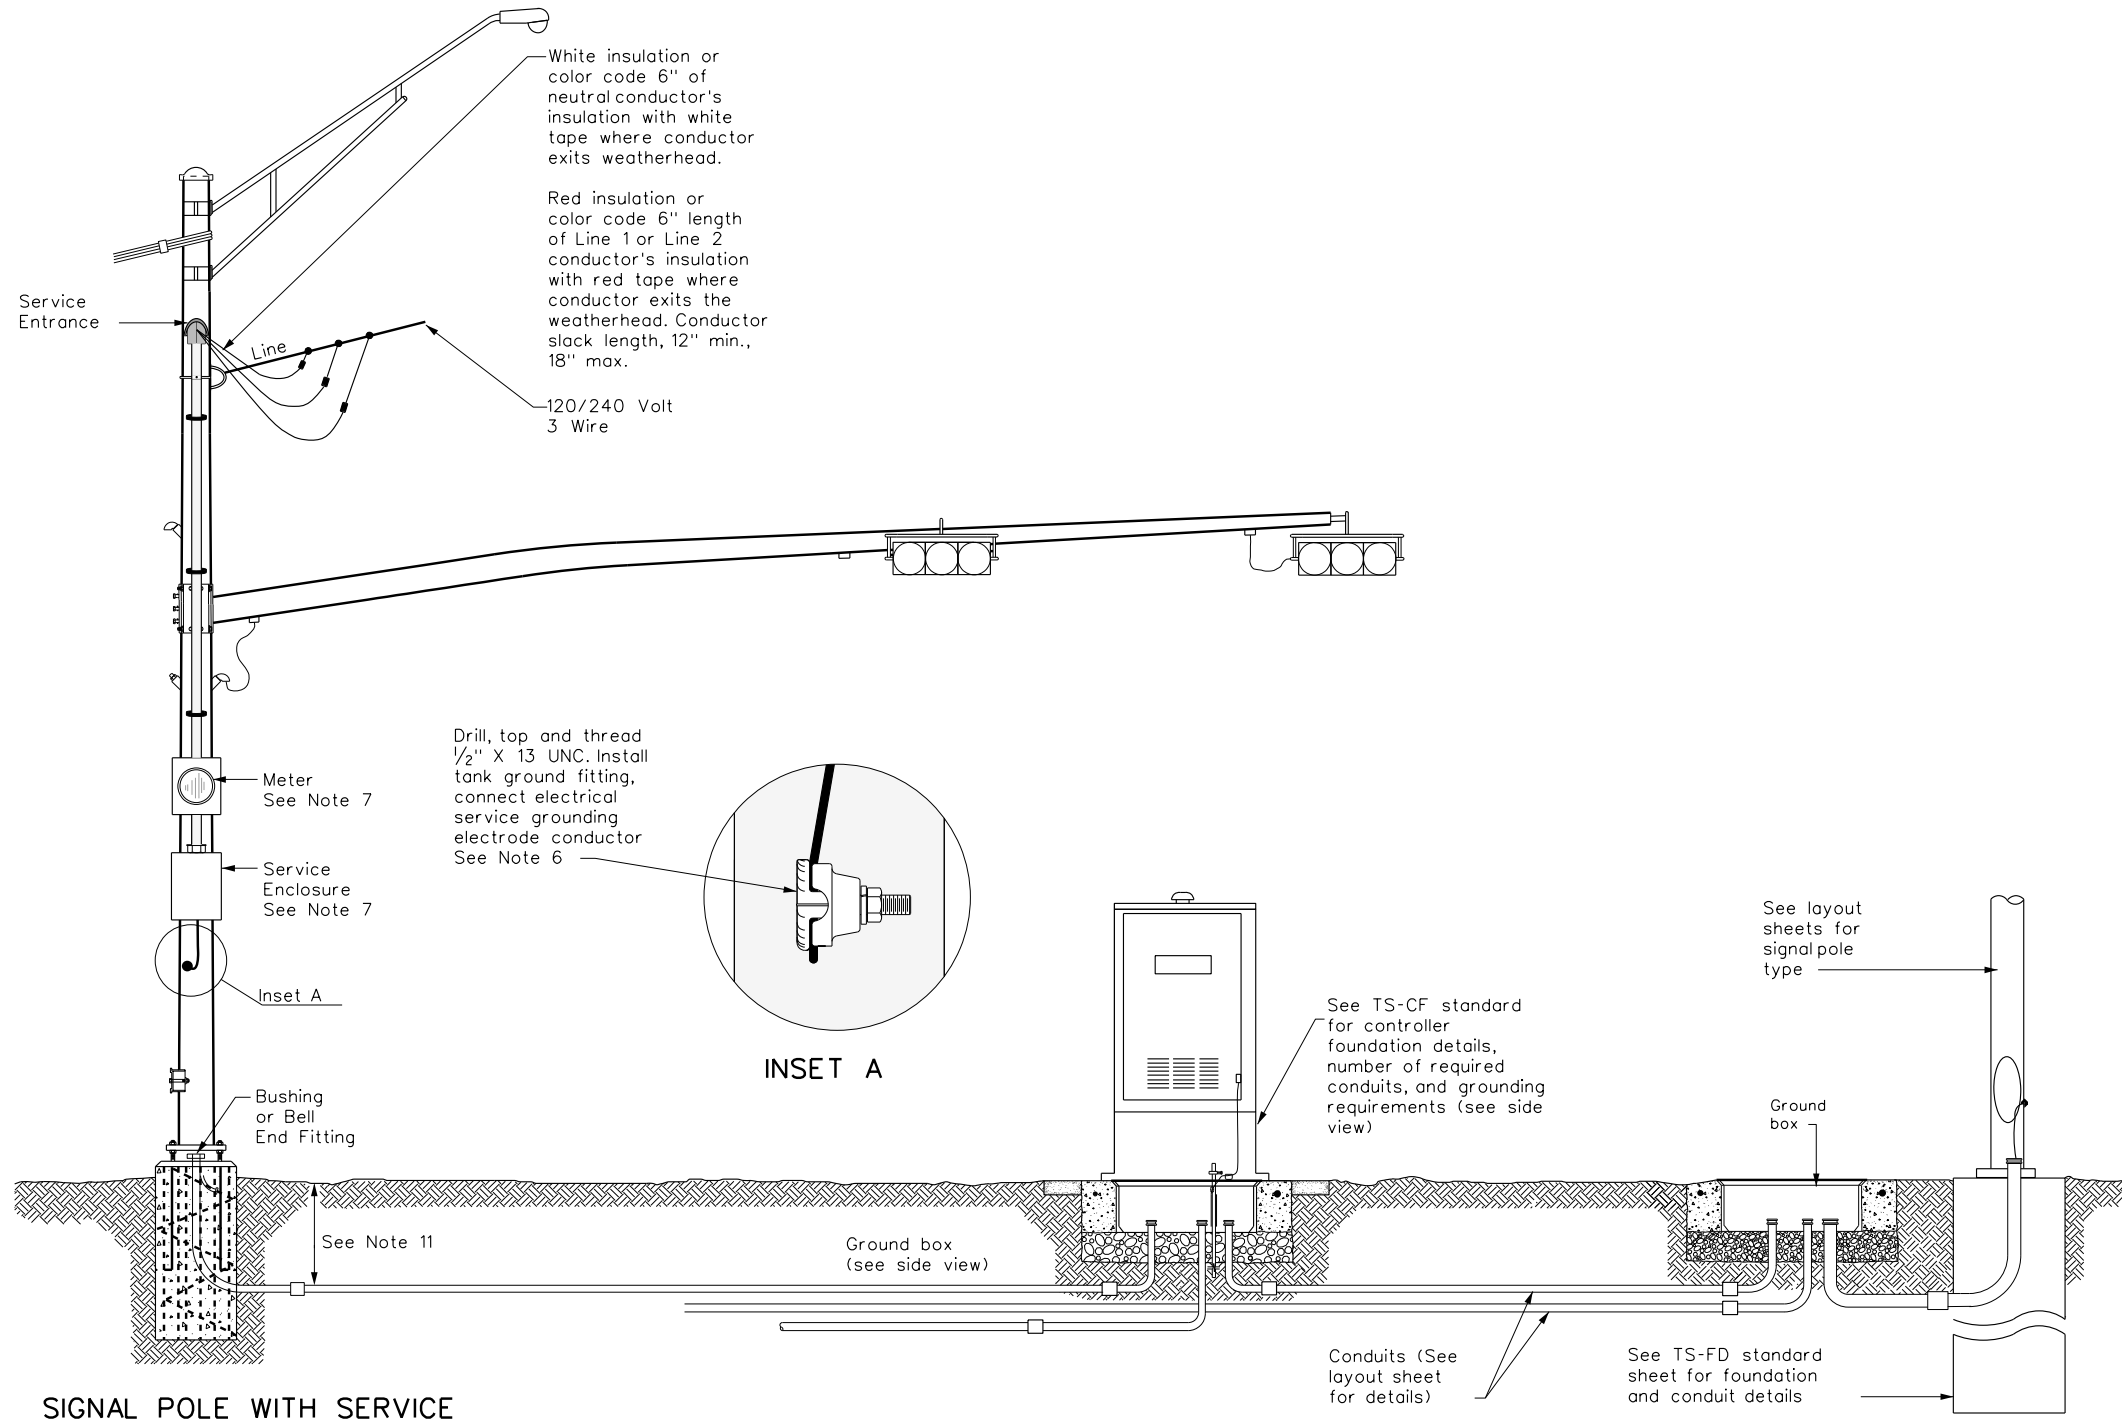


SIGNAL POLE WITH SERVICE

Type T electrical service mounted on signal pole shown as an example. See electrical details, layout sheets, and electrical service data chart for additional details.

SIGNAL CONTROLLER FRONT VIEW

SIGNAL POLE

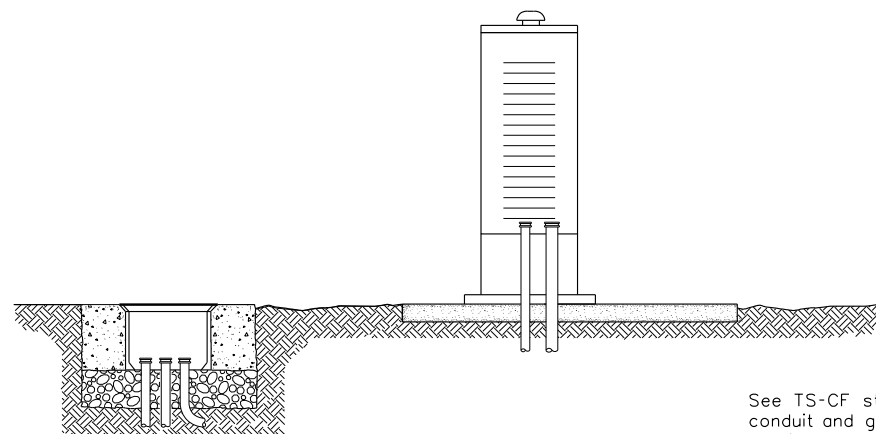

SIGNAL CONTROLLER SIDE VIEW

See TS-CF standard for conduit and grounding requirements. See layout sheets for ground box locations and any additional conduits that are required.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TXDOT for any purpose whatsoever. TXDOT assumes no responsibility for the conversion of units.


DATE: 7/17/2023 6:55:05 AM
 FILE: ct\users\time\update\local\bentley\projectwise\workingdir\pwm-pw.bentley\projectwise\workingdir

Texas Department of Transportation				Traffic Operations Division Standard	
ELECTRICAL DETAILS TYPICAL TRAFFIC SIGNAL SYSTEM DETAILS ED(8)-14					
FILE:	ed8-14.dgn	DWG:	TxDOT	CHK:	TxDOT
©TXDOT	October 2014	CONT:	0164	SECT:	03
REVISIONS		JOB:	056	HIGHWAY:	SH 31
		DIST:	COUNTY	SHEET NO.	
		TYL:	HENDERSON	41	


PEDESTAL SERVICE NOTES

1. Manufacture pedestal electrical services in accordance with Departmental Material Specifications (DMS) 11080 "Electrical Services", 11085 "Electrical Services-Pedestal (PS)" and Item 628 "Electrical Services." Provide pedestal electrical services as listed on the Material Producers list (MPL) on the Department's web site under "Roadway Illumination and Electrical Supplies," Item 628. Ensure all mounting hardware and installation details of services meet utility company specifications. Contact the local utility company for approval of pedestal details prior to installing the electrical pedestal service. Submit any changes required by the utility company prior to manufacturing the pedestal enclosure.
2. When a meter socket is required, provide a socket with a minimum 100 amp rating that complies with local utility requirements.
3. Provide Class A or C concrete for pedestal service foundations in accordance with Item 420, "Concrete Substructures," except that concrete will not be paid for directly but is considered subsidiary to Item 628.
4. Provide #4 reinforcing steel for foundations in accordance with Item 440, "Reinforcement for Concrete."
5. Install 1/2 in. X 2 1/16 in. minimum length concrete single expansion type anchors for mounting pedestal enclosure to foundation. Anchor location to match mounting holes in each corner of enclosure. Secure each of the four corners of the pedestal enclosure to the anchors in the foundation with a 1/2 in. galvanized or stainless steel machine thread bolt, a properly sized locknut and a flat washer.
6. Finish top of concrete foundation in a neat and workmanlike manner. If leveling washers are used, ensure no more than 1/8 in. gap at any corner. Do not exceed a maximum dip or rise in the foundation of 1/8 in. per foot. When properly installed, ensure the top of the service enclosure is level front to back and side to side within 1/4 in. Repair rocking or movement of the service enclosure at no additional cost to the department.
7. Do not use liquidtight flexible metal conduit (LFMC) on pedestal type services.
8. Ensure all elbows in the foundation are sized as per utility provider's conduit requirements for underground conduit and feeders. PVC extensions may be installed provided the ends of the rigid metal conduits are more than 2 in. below the top of the concrete foundation. Where extension conduits are metal, grounding bushings must be installed with a bonding jumper properly terminated.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for any errors or omissions that may appear in this document.

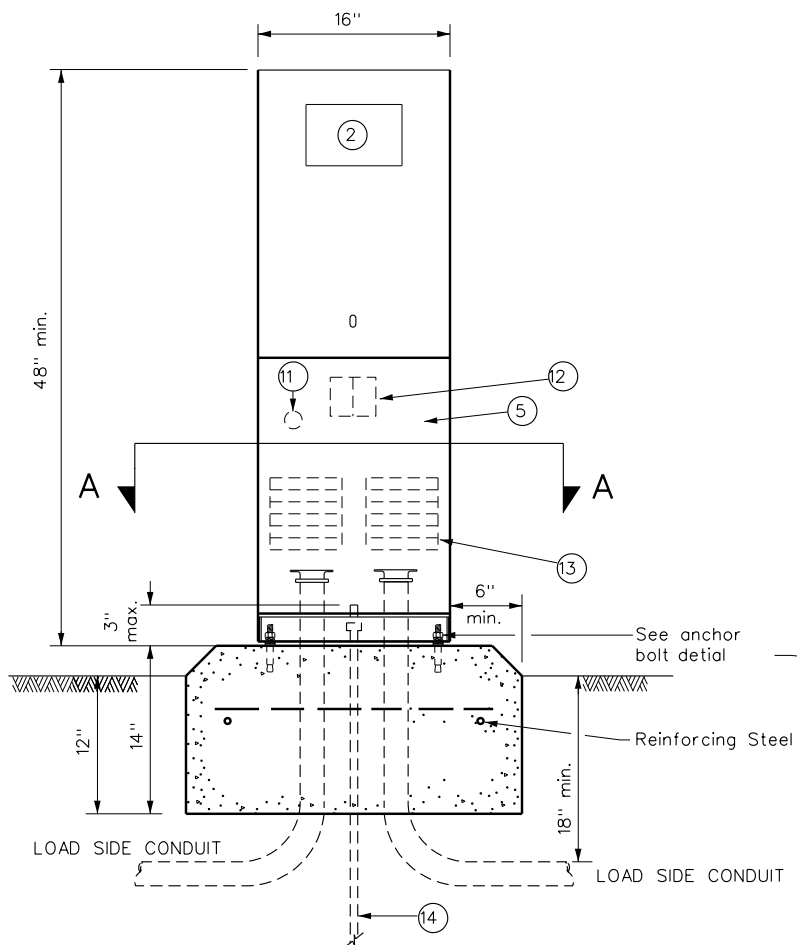


FRONT VIEW

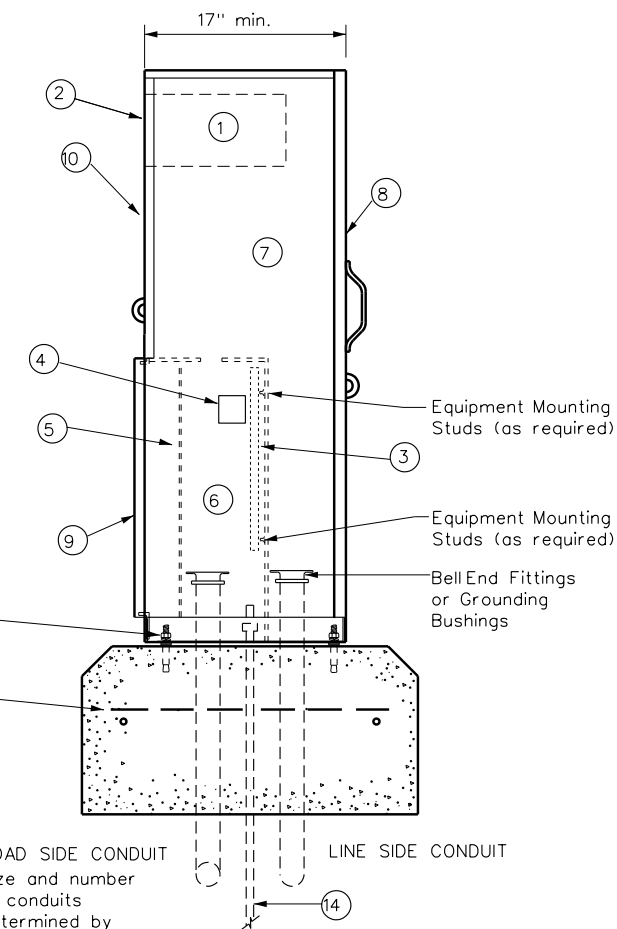

SIDE VIEW

TYPE C shown, TYPE A similar except that TYPE A shall have individual circuit breakers (CB) mounted on an equipment mounting panel. CB Handles shall protrude through hinged deadfront trim.

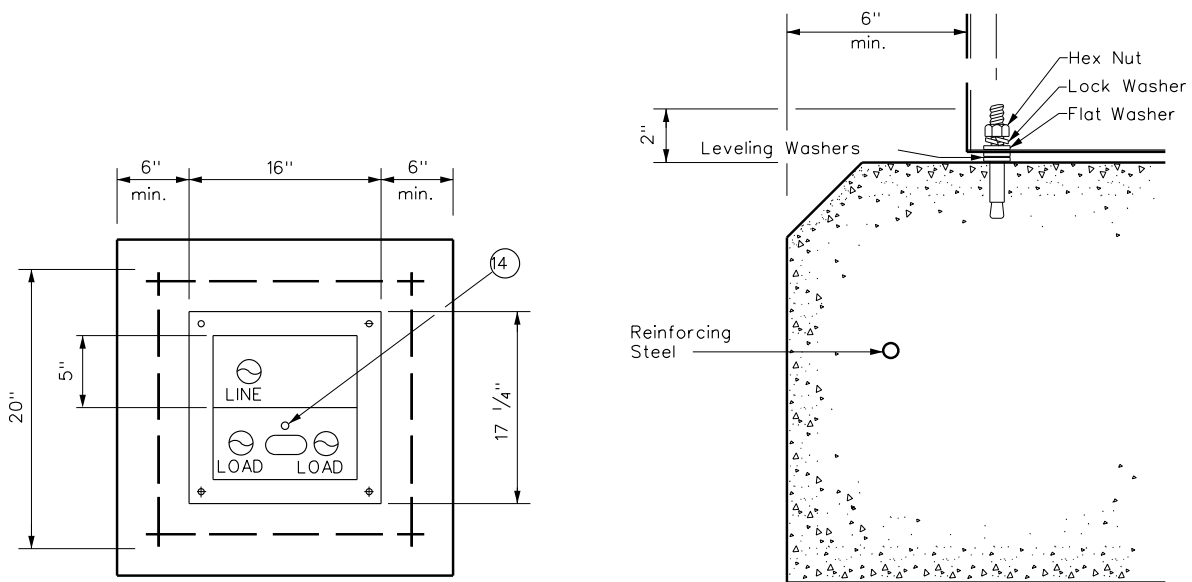

SECTION A-A

ANCHOR BOLT DETAIL

LEGEND	
1	Meter Socket, (when required)
2	Meter Socket Window, (when required)
3	Equipment Mounting Panel
4	Photo Electric Control Window, (When required)
5	Hinged Deadfront Trim
6	Load Side Conduit Trim
7	Line Side Conduit Area
8	Utility Access Door, with handle
9	Pedestal Door
10	Hinged Meter Access
11	Control Station (H-O-A Switch)
12	Main Disconnect
13	Branch Circuit Breakers
14	Copper Clad Ground Rod - 5/8" X 10'


				Traffic Operations Division Standard	
ELECTRICAL DETAILS ELECTRICAL SERVICE SUPPORT PEDESTAL SERVICE TYPE PS					
ED(9)-14					
FILE: ed9-14.dgn	DWG: TxDOT	CHK: TxDOT	DES: TxDOT	APP: TxDOT	DATE: TxDOT
© TxDOT October 2014	CONT: 0164	SECT: 03	JOB: 056	HIGHWAY: SH 31	
REVISIONS	DIST: TYL	COUNTY: HENDERSON	SHEET NO.: 42		

DATE: 7/17/2023 6:55:06 AM
 FILE: c:\users\tim\AppData\Local\Bentley\Projectwise\workingdir\pwm-pw.bentley.com\pwm-pw.bentley.com\workingdir\project\ed9-14.dgn

TIMBER POLE(TP)SERVICE SUPPORT NOTES

1. Ensure electrical service support is a class 5 treated timber pole as per Item 627 "Treated Timber Poles." Embed timber pole to depth required in Item 627.
2. Conduit and electrical conductors attached to the electrical service pole and underground within 12 in. of service pole are not paid for directly but are subsidiary to the electrical service.
3. Install pole-top mounted photocell (T) on north side of pole, or in service enclosure (E) as required. See Electrical Service Data chart in plan set.
4. Gain pole as required to provide flat surface for each channel. Gain timber pole to 5/8 in. max. depth and 1 1/8 in. max. height. Gain pole in a neat and workmanlike manner.
5. Mount meter and service equipment on stainless steel or galvanized channel (Unistrut, Kindorf, or equal). Provide channelsized 1 in. to 3 3/4 in. maximum depth, and 1/2 in. to 1 5/8 in. maximum width. File smooth the cut ends of galvanized channel and paint with zinc rich paint before installing on pole. Secure each channel section to timber pole with two galvanized or SS lag bolts, 1/4 in. minimum diameter by 1/2 in. minimum length. Use a galvanized or SS flat washer on each lag bolt. Do not stack channel.
6. When excess length must be trimmed from poles, trim from the top end only.

- 1 Class 5 pole, height as required
- 2 Service drop from utility company (attached below weatherhead)
- 3 Service conduit (RMC) and service entrance conductors - One Red, One Black, One White (See Electrical Service Data)
- 4 Safety switch (when required)
- 5 Meter (when required)
- 6 Service enclosure
- 7 6 AWG bare grounding electrode conductor in 1/2 in. PVC to ground rod - extend 1/2 in. PVC 6 in. underground.
- 8 5/8 in. x 8 ft. Copper clad ground rod - drive ground rod to a depth of 2 in. to 4 in. below grade.
- 9 RMC same size as branch circuit conduit.
- 10 See pole-top mounted photocell detail on ED(5).
- 11 When required by the serving utility provide bare 6 AWG copper conductor. Run wire from pole top to butt wrap or copper butt plate. Protect conductor with non-conductive material to a height of 8 ft. above finished grade.
- 12 When required by utility, cut top of pole at an angle to enhance rain run off.

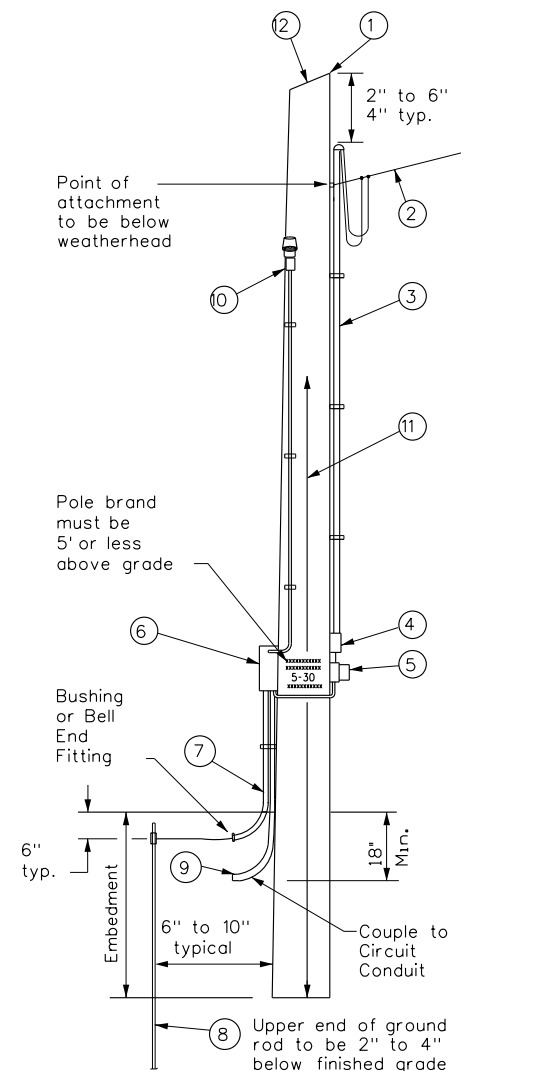


SERVICE SUPPORT TYPE TP (O)


GRANITE CONCRETE(GC)& OTHER CONCRETE(OC)NOTES

Ensure electrical service support structures bid as type Granite Concrete (GC) or Other Concrete (OC) meet the following requirements.


1. Provide GC and OC poles that meet the requirements of DMS 11080 "Electrical Services."
2. Provide prestressed concrete poles suitable for direct embedment into the ground without special foundations.
3. Verify poles are marked as required on DMS 11080. Location of marking should be approximately 4' above final grade. Use the two-point pickup locations when handling pole in horizontal position, and one-point pickup location for use in raising the pole to a vertical position. These marks are small but conspicuous.
4. Embed poles 42 in. or 10% of the length plus 2 ft., whichever is greater.
5. Ensure all installation details of services are in accordance with utility company specifications.
6. Install a one point rack or eye bolt bracket 6 inches to 12 inches below the weatherhead as an overhead service drop anchoring point for the electric utility.
7. Furnish and install galvanized or stainless steel channel strut 1 1/2 in. or 1 5/8 in. wide by 1 in. up to 3 3/4 in. deep (Unistrut, Kindorf, B-line or equal). Attach channel strut with stainless steel concrete anchors (max. 1" depth), square U-bolts or back to back channel strut with long bolts, or other secure mounting as approved by the Engineer. Ensure bolts are galvanized in accordance with ASTM A153. Do not stack channel struts.
8. Backfill the holes thoroughly by tamping in 6 in. lifts. After tamping to grade, place additional backfill material in a 6 inch high cone around the pole to allow for settling. Use material equal in composition and density to the surrounding area. Backfilling will not be paid for directly but is subsidiary to various bid items.

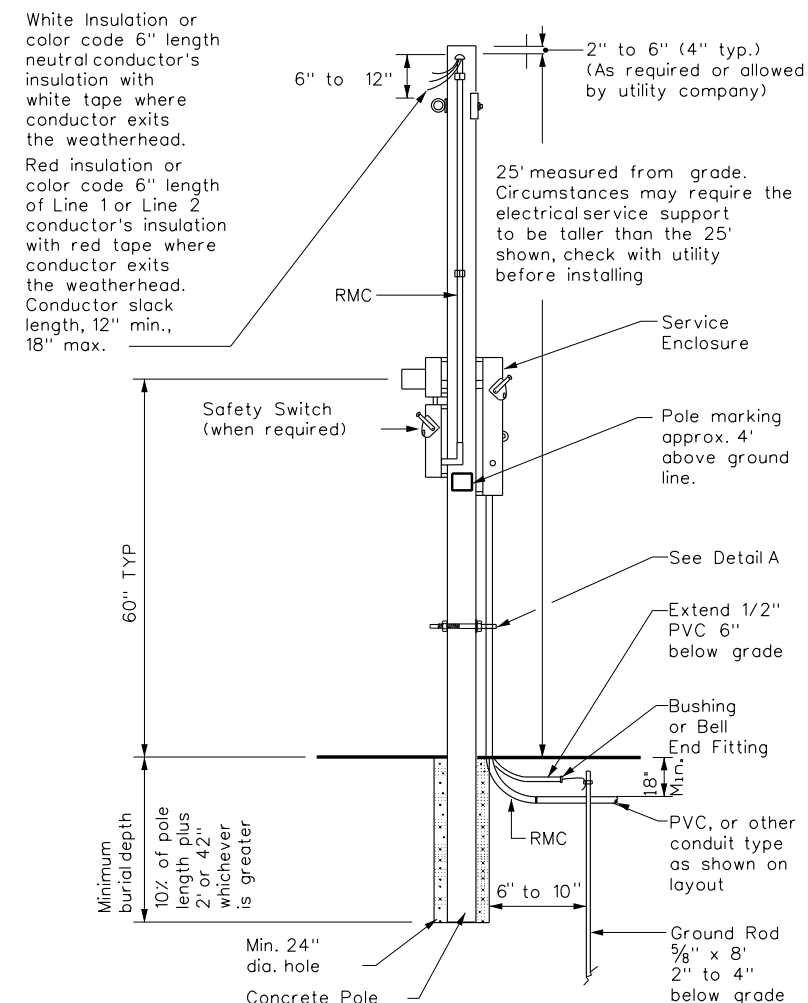

CONCRETE SERVICE SUPPORT Overhead(O)

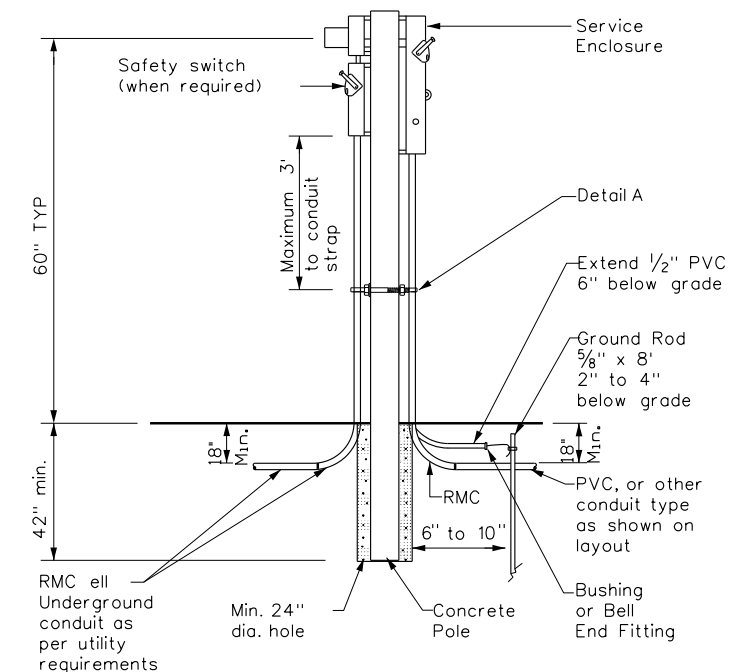

CONCRETE SERVICE SUPPORT Underground(U)

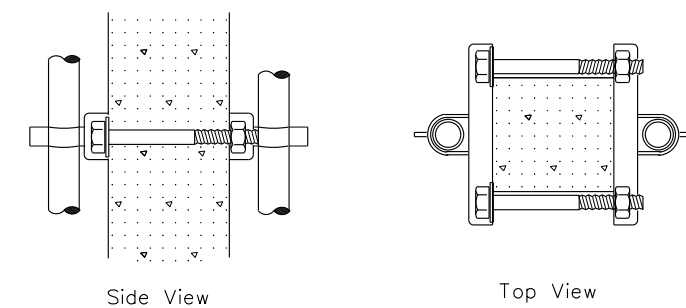

DETAIL A

See Note 7. Before installing channel that has been cut, file sharp edges and paint with zinc-rich paint. Ensure there is no paint splatter on the pole.


		Texas Department of Transportation		Traffic Operations Division Standard	
ELECTRICAL DETAILS SERVICE SUPPORT TYPES GC, OC, & TP					
ED(10)-14					
FILE:	ed10-14.dgn	DWG:	TxDOT	CHK:	TxDOT
© TxDOT	October 2014	CONT:	0164	SECT:	03
REVISIONS		JOB:	056		SH 31
DIST:	TYL	COUNTY:	HENDERSON		SHEET NO. 43

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or the use of the standard for any project.

DATE: 7/17/2023 6:55:07 AM
 FILE: c:\users\tim.epp\data\local\appdata\local\bentley\projectwise\workingdir\wpm-pw.bentley.com\projects\10164\03\ED(10)-14.dgn

DUCT CABLE & HDPE CONDUIT NOTES


1. Provide duct cable in accordance with Departmental Material Specification (DMS) 11060 "Duct Cable" and Item 622 "Duct Cable." Provide duct cable as listed on the Material Producer List (MPL) on the Department web site under "Roadway Illumination and Electrical Supplies" Item 622.
2. Provide High-Density Polyethylene (HDPE) conduit in accordance with DMS 11060 and Item 618, "Conduit." Provide HDPE as listed on the MPL on the Department web site under "Roadway Illumination and Electrical Supplies," Item 618.
3. Supply duct cable with a minimum 2 in. diameter, unless otherwise shown in the plans. Provide duct cable and HDPE conduit as shown by descriptive code or on the plans. Bend duct cable and HDPE conduit as recommended by the manufacturer, with a minimum bending radius of 26 in. for 2 in. duct. Follow manufacturers' recommendations when handling duct cable and HDPE conduit reels and during installation of duct cable and HDPE conduit.
4. Do not splice conductors within duct cable or HDPE conduit. Couple duct cable and HDPE entering a ground box or foundation to a PVC elbow. When galvanized steel RMC elbows are called for in the plans and any portion of the RMC elbow is buried less than 18" from possible contact, ground the RMC elbow.
5. Furnish and install duct cable with factory installed conductors, sized as shown in the plans and as required by the National Electrical Code (NEC). The NEC contains specific requirements for duct cable in Article, "Nonmetallic Underground Conduit with Conductors: Type NUCC."
6. When conduit casing is called for in the plans, extend duct cable or HDPE conduit through the conduit casing in one continuous length without connection to the casing.
7. Seal the ends of duct cable or HDPE conduit with duct seal, expandable foam, or other approved method after completing the pull tests required by Item 622.
8. Provide minimum cover of 24 in. under roadways, 18 in. in other locations, or as shown on the plans.
9. Furnish and install listed fittings to couple duct cable or HDPE conduit to other types of conduit. Duct cable and HDPE conduit may be field-threaded and spliced with PVC or RMC threaded couplings; connected with listed tie-wrap fittings; connected using listed coupling made of HDPE with stainless steel external banding clamps and locking rings; connected with approved electrofusion conduit couplings; or connected using an approved chemical fusion method using an epoxy or adhesive specifically designed for HDPE couplings and connectors all installed in accordance with their manufacturer's instructions. Do not use PVC glue on HDPE. Do not use water pipe fittings, or connect conduit with heat shrink tubing.

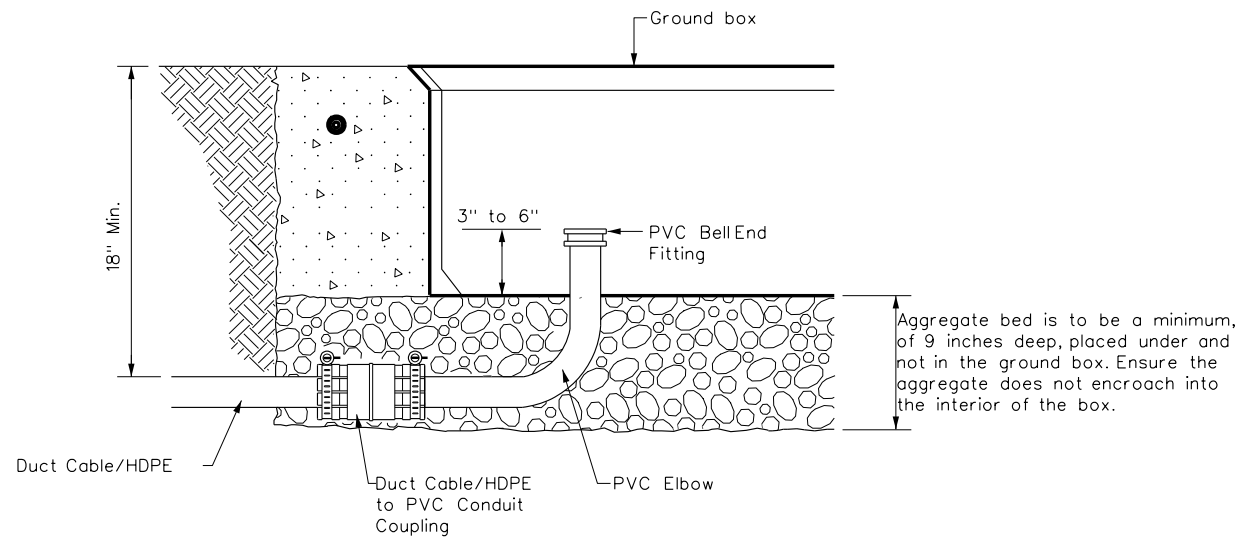

DUCT CABLE/HDPE AT GROUND BOX

When the upper end of an RMC Elldoes not enter the ground box, it may be extended with a SCH-40 PVC conduit nipple and bell end, provided there is a minimum of 18" of cover over all parts of the elbow. If not, a rigid extension and ground bushing is required.


Couple duct to conduit elbow at foundations. Ensure conductors extend into pole base. Do not splice conductors in conduit.

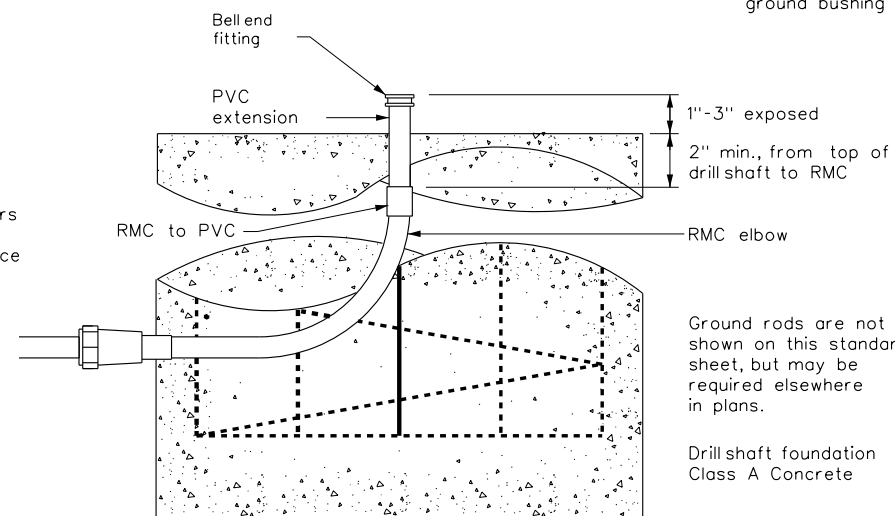


DUCT CABLE / HDPE AT FOUNDATION

Ground rods are not shown on this standard sheet, but may be required elsewhere in plans.


Drill shaft foundation Class A Concrete

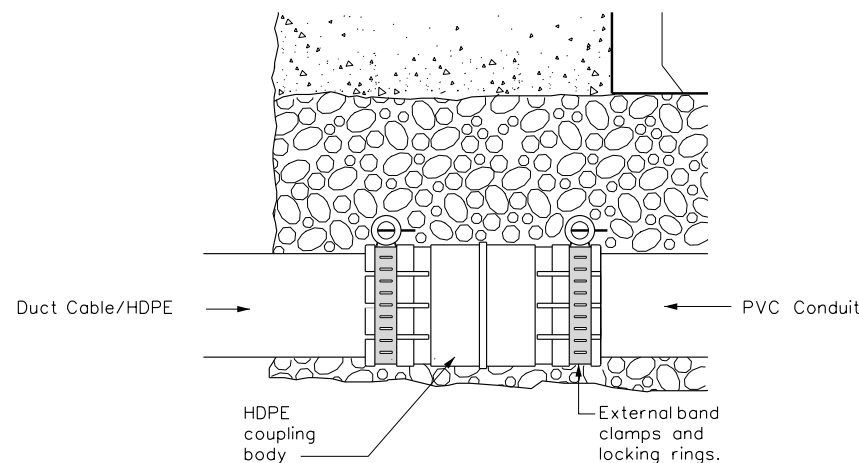

DUCT CABLE/HDPE TO PVC

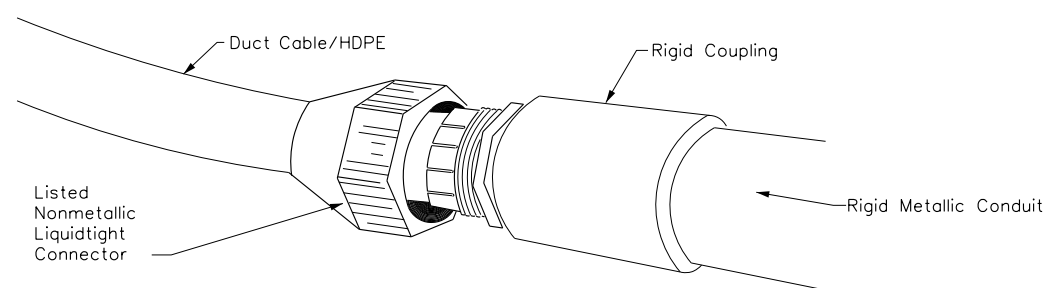

DUCT CABLE/HDPE TO RMC

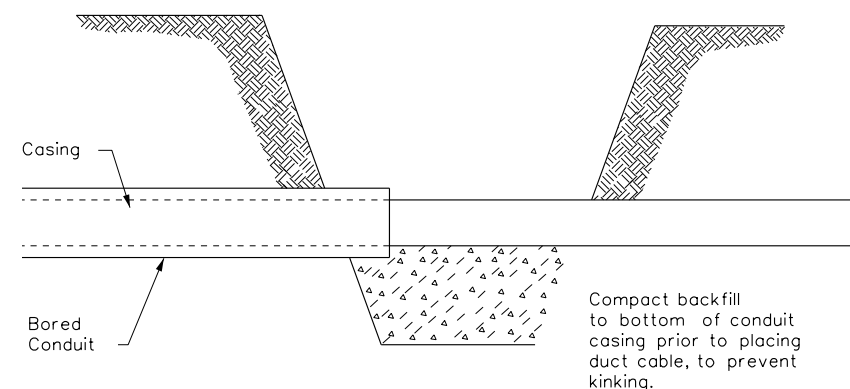

BORE PIT DETAIL

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or the use of this standard in any project. The user is responsible for the accuracy of the information resulting from its use.

DATE: 7/17/2023 6:55:08 AM
FILE: c:\users\tim\AppData\Local\Bentley\Projectwise\workingdir\pwm-pw.bentley.com\proj\11-14\11-14.dwg

				Traffic Operations Division Standard	
ELECTRICAL DETAILS DUCT CABLE / HDPE CONDUIT					
ED(11)-14					
FILE: ed11-14.dgn	DW: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT	
© TxDOT October 2014	CONT: 0164	SECT: 03	JOB: 056	HIGHWAY: SH 31	
REVISIONS		DIST: TYL	COUNTY: HENDERSON	SHEET NO.: 44	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for the accuracy of the information presented herein.

DATE: 7/17/2023 6:55:09 AM
 FILE: c:\users\tim\AppData\Local\Bentley\projectwise\workingdir\pwm-pw.bentley.com\ed12-14.dgn


BATTERY BOX GROUND BOXES NOTES

A. MATERIALS


1. Provide polymer concrete or fiberglass reinforced plastic (FRP) battery box ground box and cover in accordance with Departmental Material Specification (DMS) 11071 "Battery Box Ground Boxes." Battery box will accommodate up to 4 batteries, each measuring 8 in. x 13.5 in. x 10 in. (W x L x D). Label battery box ground box cover in accordance with DMS 11071.
2. Supply a marine grade batteries with covers. Secure the marine grade batteries with covers to the stainless steel rack in the bottom of the ground box with tie down straps.

B. CONSTRUCTION METHODS

1. Ensure conduit entry will not interfere with placement of the batteries in the battery box ground box.
2. Remove all gravel and dirt from conduit. Cap all conduits prior to placing aggregate and setting battery box ground box. Provide Grade 3 or 4 coarse aggregate as shown on Table 2 of Item 302 "Aggregates for Surface Treatments." Ensure the aggregate bed is in place and is a minimum of 9 in. deep prior to setting the box. Install battery box ground box on top of aggregate.
3. Cast battery box aprons in place. Reinforcing steel may be field bent. Ensure the depth of concrete for the apron extends from finished grade to the top of the aggregate bed under the box. Battery box ground box aprons, including concrete and reinforcing steel, are subsidiary to battery box ground boxes when called for by descriptive code.
4. Bolt covers down when not working in battery box ground boxes. Keep bolt holes in the box clear of dirt.

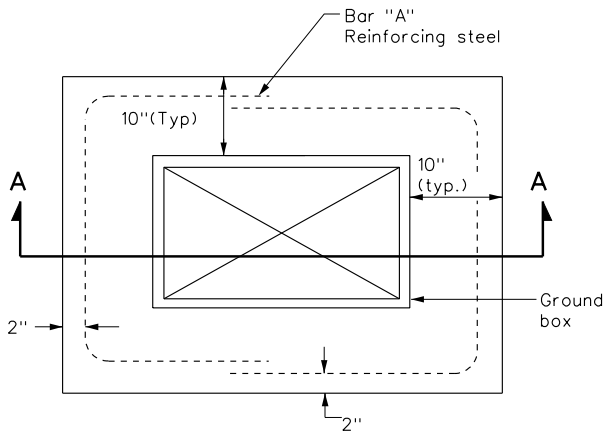


PLAN VIEW

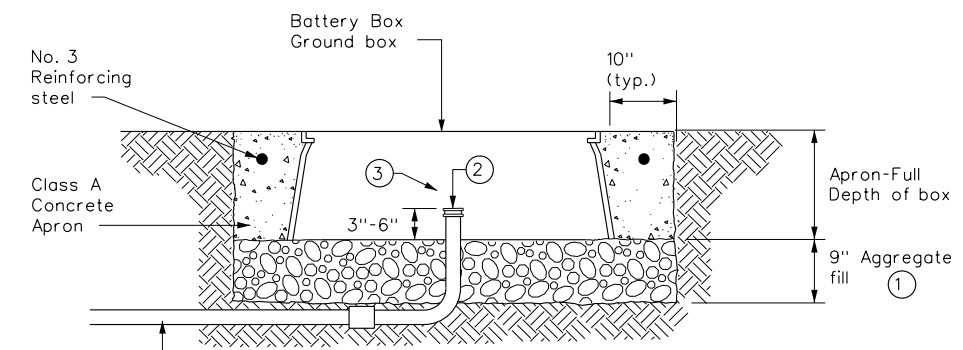


SECTION A - A

APRON FOR BATTERY BOX GROUND BOXES


- ① Place aggregate under the box and not in the box. Aggregate should not encroach on the interior volume of the box.
- ② Install bushing or bell end fitting on the upper end of all ells.
- ③ Install all conduits in a neat and workmanlike manner.

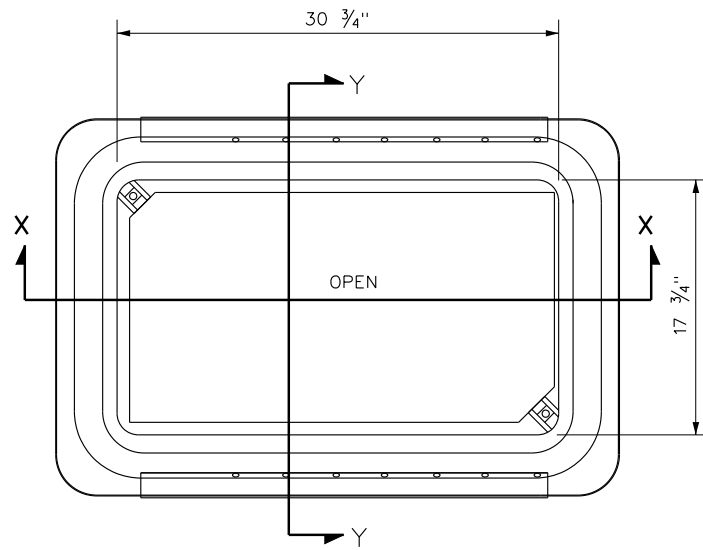


BATTERY BOX TOP VIEW

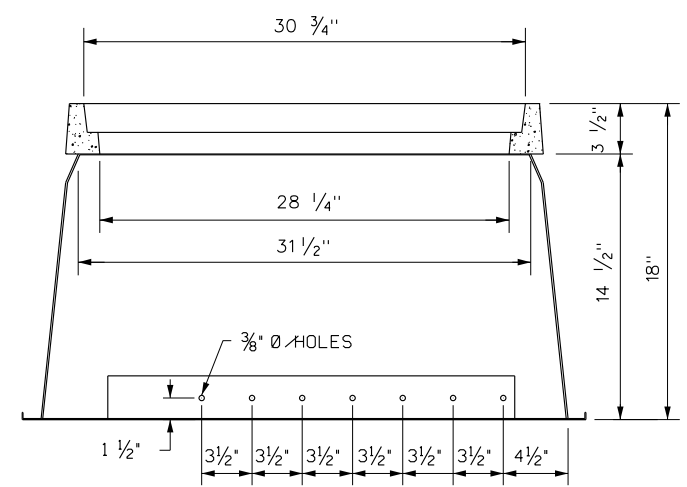

SECTION X-X

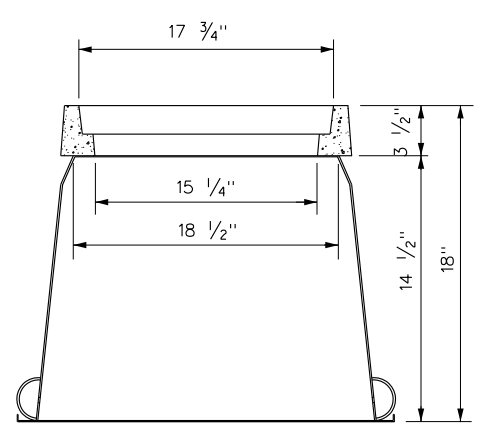

SECTION Y-Y

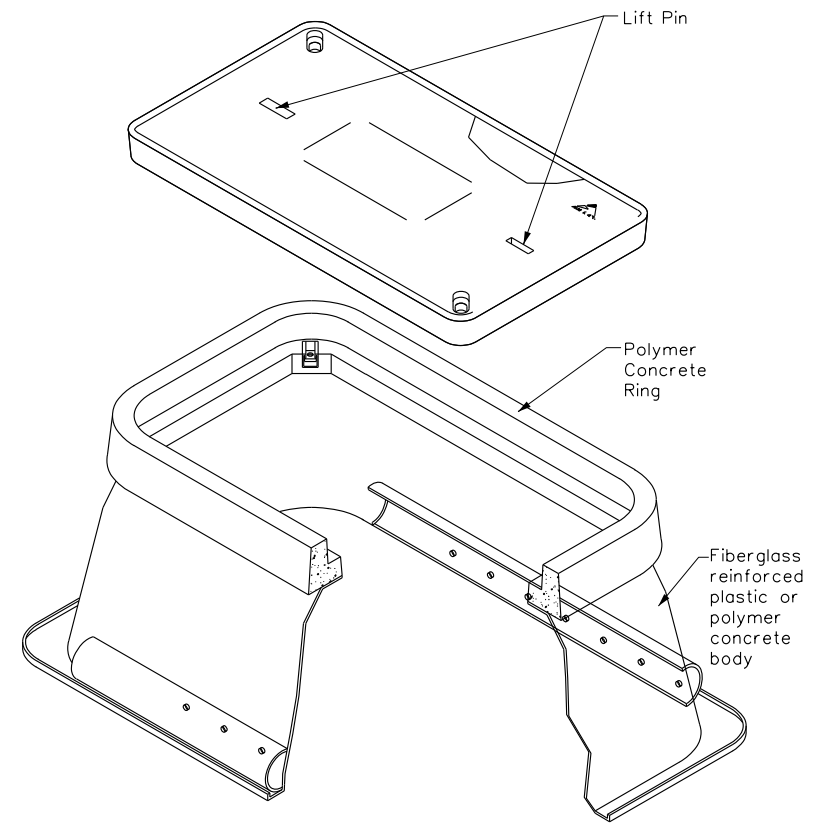

		Traffic Operations Division Standard	
ELECTRICAL DETAILS BATTERY BOX GROUND BOXES			
ED(12)-14			
FILE: ed12-14.dgn	DWG: TxDOT	CHK: TxDOT	DWG: TxDOT
© TxDOT October 2014	CONT: 0164	SECT: 03	JOB: 056
REVISIONS	DIST: TYL	COUNTY: HENDERSON	HIGHWAY: SH 31
			SHEET NO. 45


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023 6:55:10 AM
 FILE: c:\users\time\appdata\local\bentley\projectwise\workingdir\wpm-pw-bentley.com_wpm-pw-01\tewing\waterpmoore.com\dms47257\SMA-80(1)-12-PS&E*2.dgn


Arm Length	ROUND POLES					POLYGONAL POLES					Foundation Type
	D _B	D ₁₉	D ₂₄	D ₃₀	① thk	D _B	D ₁₉	D ₂₄	D ₃₀	① thk	
ft.	in.	in.	in.	in.	in.	in.	in.	in.	in.	in.	
20	10.5	7.8	7.1	6.3	.179	11.5	8.5	7.7	6.8	.179	30-A
24	11.0	8.3	7.6	6.8	.179	12.0	9.0	8.2	7.3	.179	30-A
28	11.5	8.8	8.1	7.3	.179	12.5	9.5	8.7	7.8	.179	30-A
32	12.5	9.8	9.1	8.3	.179	12.0	9.0	8.2	7.3	.239	30-A
36	12.0	9.3	8.6	7.8	.239	12.5	9.5	8.7	7.8	.239	36-A
40	12.0	9.3	8.6	7.8	.239	13.5	10.5	9.7	8.8	.239	36-A
44	12.5	9.8	9.1	8.3	.239	14.0	11.0	10.2	9.3	.239	36-A
48	13.0	10.3	9.6	8.8	.239	15.0	12.0	11.2	10.3	.239	36-A

Arm Length	ROUND ARMS					POLYGONAL ARMS				
	L ₁	D ₁	D ₂	① thk	Rise	L ₁	D ₁	② D ₂	① thk	Rise
ft.	ft.	in.	in.	in.		ft.	in.	in.	in.	
20	19.1	6.5	3.8	.179	1'-9"	19.1	7.0	3.5	.179	1'-8"
24	23.1	7.5	4.3	.179	1'-10"	23.1	7.5	3.5	.179	1'-9"
28	27.1	8.0	4.2	.179	1'-11"	27.1	8.0	3.5	.179	1'-10"
32	31.0	9.0	4.7	.179	2'-1"	31.0	9.0	3.5	.179	2'-0"
36	35.0	9.5	4.6	.179	2'-4"	35.0	10.0	3.5	.179	2'-1"
40	39.0	9.5	4.1	.239	2'-8"	39.0	9.5	3.5	.239	2'-3"
44	43.0	10.0	4.1	.239	2'-11"	43.0	10.0	3.5	.239	2'-6"
48	47.0	10.5	4.1	.239	3'-4"	47.0	11.0	3.5	.239	2'-9"

- D_B = Pole Base O.D.
 - D₁₉ = Pole Top O.D. with no Luminaire and no ILSN
 - D₂₄ = Pole Top O.D. with ILSN w/out Luminaire
 - D₃₀ = Pole Top O.D. with Luminaire
 - D₁ = Arm Base O.D.
 - D₂ = Arm End O.D.
 - L₁ = Shaft Length
 - L = Nominal Arm Length
- ① Thickness shown are minimums, thicker materials may be used.
- ② D₂ may be increased by up to 1" for polygonal arms.

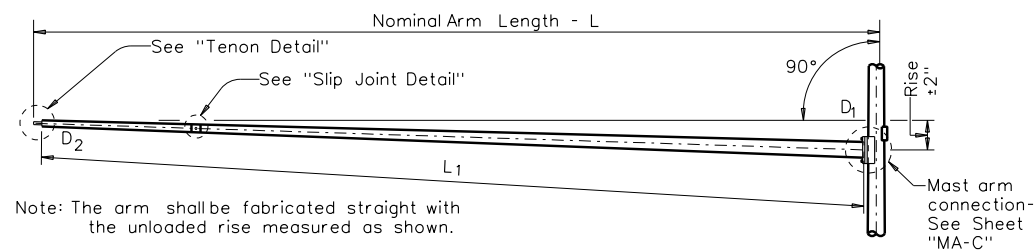

TRAFFIC SIGNAL ARM
(Fixed Mount)

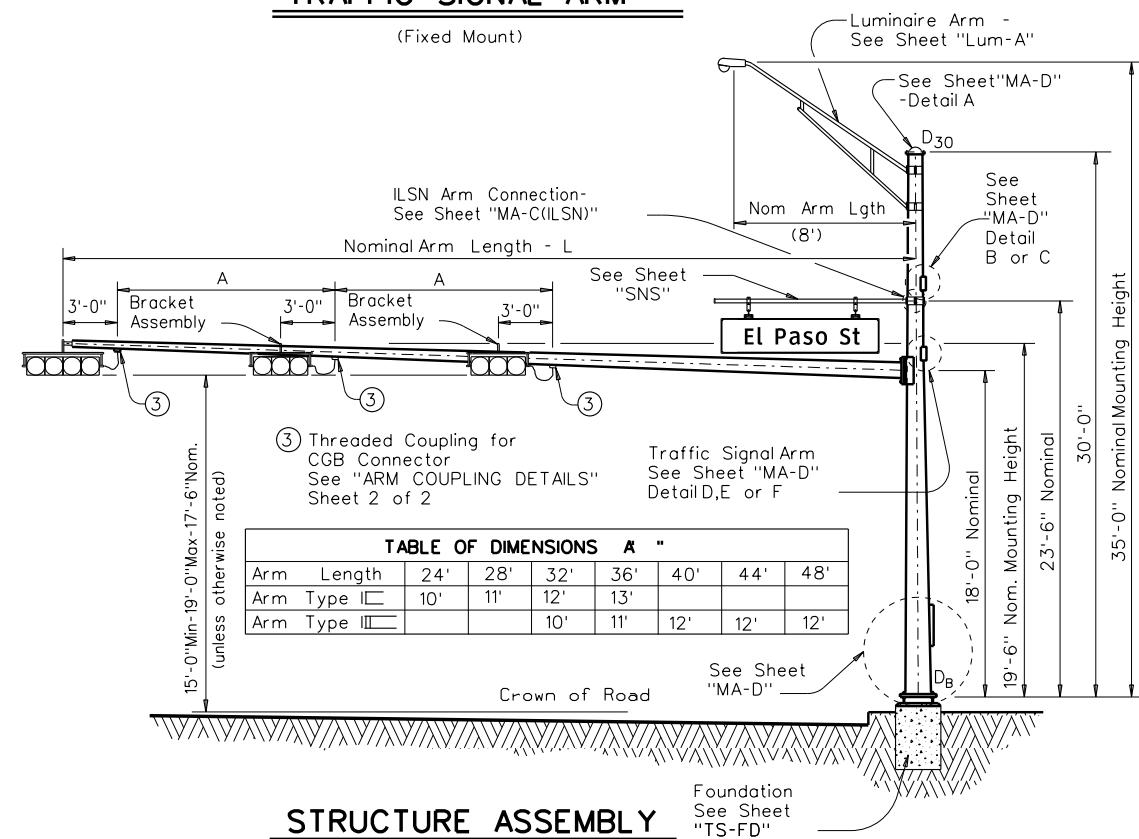

STRUCTURE ASSEMBLY

SHIPPING PARTS LIST

Ship each pole with the following attached: enlarged hand hole, pole cap, fixed-arm connection bolts and washers and any additional hardware listed in the table.

Nominal Arm Length	30' Poles With Luminaire		24' Poles With ILSN		19' Poles With No Luminaire and No ILSN	
	Designation	Quantity	Designation	Quantity	Designation	Quantity
ft	Designation	Quantity	Designation	Quantity	Designation	Quantity
20	20L-80		20S-80		20-80	
24	24L-80		24S-80		24-80	1
28	28L-80		28S-80		28-80	1
32	32L-80		32S-80		32-80	
36	36L-80		36S-80		36-80	
40	40L-80		40S-80		40-80	2
44	44L-80		44S-80		44-80	
48	48L-80		48S-80		48-80	

Traffic Signal Arms (1 per Pole) Ship each arm with the listed equipment attached

Nominal Arm Length	Type I Arm (1 Signal)		Type II Arm (2 Signals)		Type III Arm (3 Signals)	
	Designation	Quantity	Designation	Quantity	Designation	Quantity
ft	Designation	Quantity	Designation	Quantity	Designation	Quantity
20	20I-80					
24	24I-80		24II-80	1		
28	28I-80		28II-80	1		
32			32II-80		32III-80	
36			36II-80		36III-80	
40					40III-80	2
44					44III-80	
48					48III-80	

Luminaire Arms (1 per 30' pole)

Nominal Arm Length	Quantity
8' Arm	

ILSN Arm (Max. 2 per pole) Ship with clamps, bolts and washers

Nominal Arm Length	Quantity
7' Arm	
9' Arm	

Anchor Bolt Assemblies (1 per pole)

Anchor Bolt Diameter	Anchor Bolt Length	Quantity
1 1/2"	3'-4"	2
1 3/4"	3'-10"	2

Each anchor bolt assembly consists of the following: Top and Bottom templates, 4 anchor bolts, 8 nuts, 8 flat washers, and 4 nut anchor devices (Type 2) per Standard Drawing "TS-FD".

Templates may be removed for shipment.




Texas Department of Transportation
 Traffic Operations Division
TRAFFIC SIGNAL SUPPORT STRUCTURES
 SINGLE MAST ARM ASSEMBLY
 (80 MPH WIND ZONE)
SMA-80(1)-12


© TxDOT August 1995	DN: MS	CK: JSY	DW: MMF	CK: JSY
REVISIONS	CONT	SECT	JOB	HIGHWAY
5-96 11-99 1-12	0164	03	056	SH 31
	DIST	COUNTY	SHEET NO.	
	TYL	HENDERSON	46	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023 6:55:12 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\wpm-pw-bentley.com\wpm-pw-01\tewing\waterpmoore.com\dms47257\SMA-80(2)-12.dgn

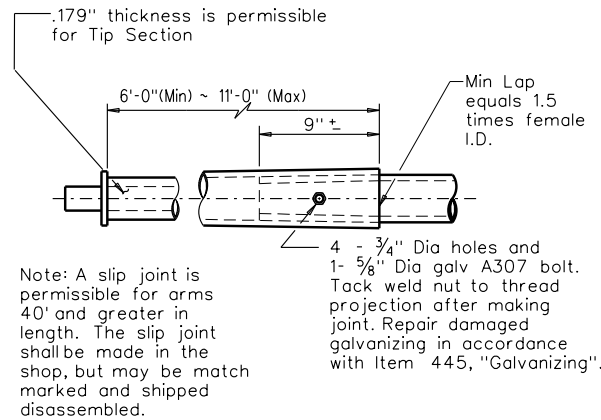


SLIP JOINT DETAIL

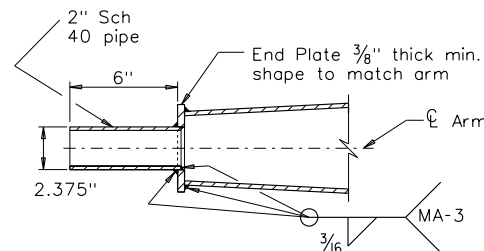

TENON DETAIL

Stainless steelbands (or Cables) and cast bracket as in "Astro-Brac", "Sky Bracket" or "Easy Bracket" with 1 1/2" Dia Threaded Coupling.

BRACKET ASSEMBLY

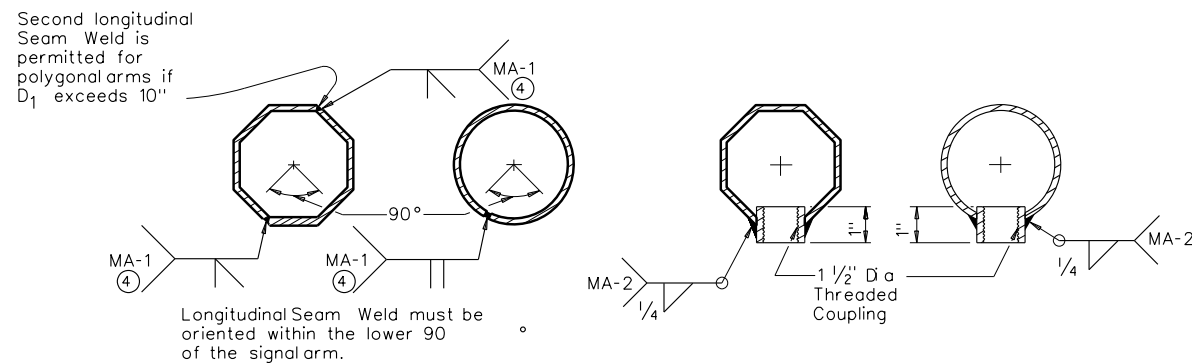

ARM WELD DETAIL

ARM COUPLING DETAILS

④ 60% Min. penetration
 100% penetration within
 6" of circumferential
 base welds.

VIBRATION WARNING

Mast Arms of SMA and DMA structures and clamp-on Arms of LMA structures of approximately 40 ft or longer are subject to harmonic vertical vibrations in light wind conditions due to the aeroelastic characteristics of a few of the myriads of possible combinations of the following: signal numbers, weights and positions; existence/solidity of backplates; presence of additional attachments to the arm, such as signs and cameras; arm-wind orientation; and arm-pole stiffness.

Such vibrations may cause fatigue damage to the structure and may lead to galloping in moderate wind conditions which may further damage the structure and alarm the public. Tests have indicated that when wind is blowing toward the back side of signal heads having un-vented backplates attached the probability of unacceptable harmonic vibration and/or galloping is rather high.

If backplates are not required for improved visibility they should not be applied to the signal heads or, if they must be applied, they should be vented as a first and inexpensive measure to mitigate vibrations.

The traffic signal mast arms shall be visually inspected in 5 to 20 mph wind conditions after installation of signal heads and any attachments, including any required backplates. If vertical movements with a total excursion (maximum upward excursion to maximum downward excursion) of more than approximately 8" are observed at the arm tip, a damping plate shall be fitted to the arm. See "Damping Plate Mounting Details" on standard sheet, MA-DPD-10.

This visual inspection shall be repeated after each modification of the structure that could affect its aeroelastic response. Excessive vibrations shall not be allowed to continue for more than two days.

GENERAL NOTES:

Design conforms to 1994 AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires, and Traffic Signals and Interim Specifications thereto. Design Wind Speed equals 80 mph plus a 1.3 gust factor.

Poles are designed to support one 8'-0" luminaire arm, one 9'-0" internally lighted street name sign and one traffic signal arm with a length as tabulated. The specified luminaire load applied at the end of the luminaire arm equals 60 lbs vertical dead load plus the horizontal wind load on an effective projected area of 1.6 sq ft. The specified internally lighted street name sign load applied 4.5 ft from the centerline of the pole equals 85 lbs vertical dead load plus horizontal wind load on an effective projected area of 11.5 sq ft. The specified signal load applied at the end of the traffic signal arm equals 180 lbs vertical dead load plus the horizontal wind load on an effective projected area of 32.4 sq ft (actual area times drag coefficient).

See Standard Sheet "MA-D" for pole details, "MA-C" for traffic signal arm connection details, "MA-C (ILSN)" for internally lighted street name sign arm connection details, "LUM-A" for luminaire arm and connection details, "SNS" for internally lighted street name sign details, and "TS-FD" for anchor bolt and foundation details. See "MA-C" for material specifications.

Fabrication shall be in accordance with Item 686, "Traffic Signal Pole Assemblies (Steel)" and with the details, dimensions, and weld procedures shown herein. Weld references call for preapproved weld procedures which the Fabricator must obtain prior to fabrication. Materials, fabrication tolerances, and shipping practices shall meet the requirements of this sheet and Item 686, "Traffic Signal Pole Assemblies (Steel)".

Unless otherwise noted, all parts shall be galvanized in accordance with Item 445, "Galvanizing", after fabrication.

Deviation from the details and dimensions shown herein require submission of shop drawings in accordance with Item 441, "Steel Structures". Alternate designs are not acceptable.




**TRAFFIC SIGNAL
 SUPPORT STRUCTURES
 SINGLE MAST ARM ASSEMBLY
 (80 MPH WIND ZONE)
 SMA-80(2)-12**

© TxDOT August 1995		DN: MS	CK: JSY	DW: MMF	CK: JSY
REVISIONS		CONT	SECT	JOB	HIGHWAY
5-96	0164	03	056		SH 31
1-12	DIST		COUNTY		SHEET NO.
		TYL		HENDERSON	47

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 7/17/2023 6:55:13 AM
 FILE: c:\users\tim\appdata\local\bentley\projectwise\workingdir\wpm-pw-bentley.com_wpm-pw-01\tewing\waterpmoore.com\dms47257\MA-C-12.dgn

ARM SIZE		A	B	C	D	E	CONN BOLT DIA
D ₁	#	in.	in.	in.	in.	in.	in.
6.5	.179	12	9	9	6	1 3/4	1
7.5	.179	13	9	10	6	1 3/4	1
8.0	.179	14	10	11	7	2	1 1/4
9.0	.179	16	11	13	8	2	1 1/4
9.5	.179	17	12	14	9	2	1 1/4
9.5	.239	18	12	15	9	2	1 1/4
10.0	.239	18	12	15	9	2	1 1/4
10.5	.239	18	13	15	10	3	1 1/2
11.0	.239	18	13	15	10	3	1 1/2

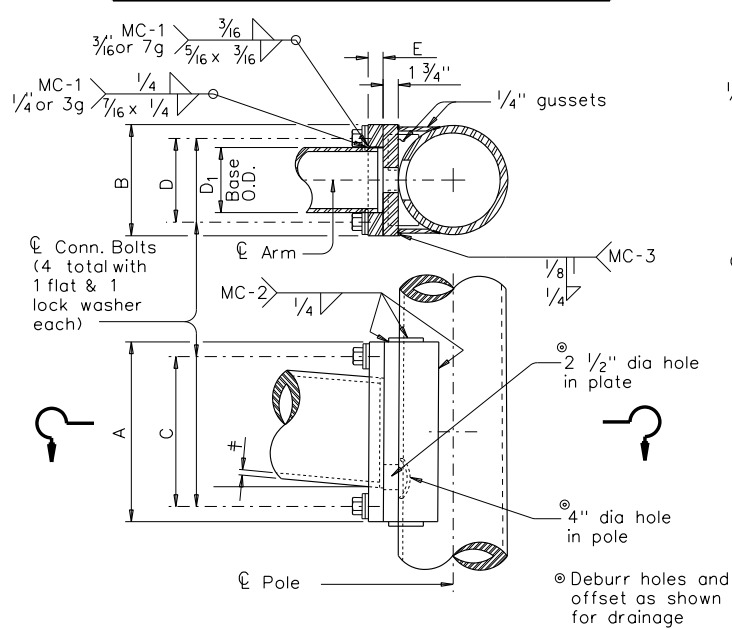


FIXED MOUNT DETAIL 1

ARM SIZE		A	F	CONN. BOLTS		PIN BOLTS	
D ₁	#	in.	in.	No.	Dia	No.	Dia
6.5	.179	12	6	4	1	2	5/8
7.5	.179	14	8	4	1	2	5/8
8.0	.179	14	8	4	1	2	5/8
9.0	.179	16	10	4	1	2	5/8
9.5	.179	18	12	4	1 1/4	3	5/8
9.5	.239	18	12	4	1 1/4	3	5/8
10.0	.239	18	12	4	1 1/4	3	5/8

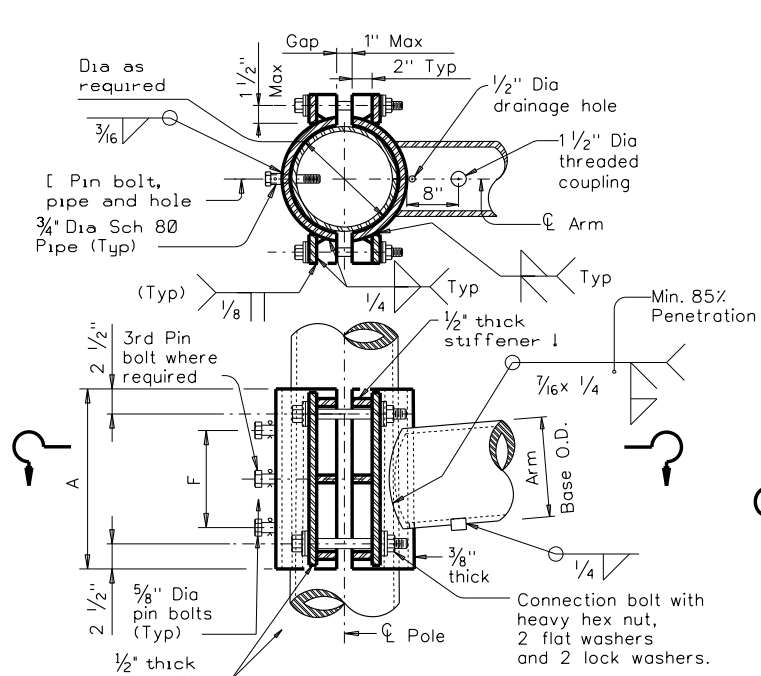


CLAMP-ON DETAIL 1

ARM SIZE		A	B	C	D	E	CONN BOLT DIA
D ₁	#	in.	in.	in.	in.	in.	in.
7.0	.179	11	11	8	8	1 3/4	1 1/4
7.5	.179	11	11	8	8	1 3/4	1 1/4
8.0	.179	11	11	8	8	2	1 1/4
9.0	.179	13	13	10	10	2	1 1/4
10.0	.179	13	13	10	10	2	1 1/4
9.5	.239	13	13	10	10	2	1 1/4
10.0	.239	14	14	11	11	2	1 1/2
11.0	.239	14	14	11	11	3	1 1/2
11.5	.239	14	14	11	11	3	1 1/2

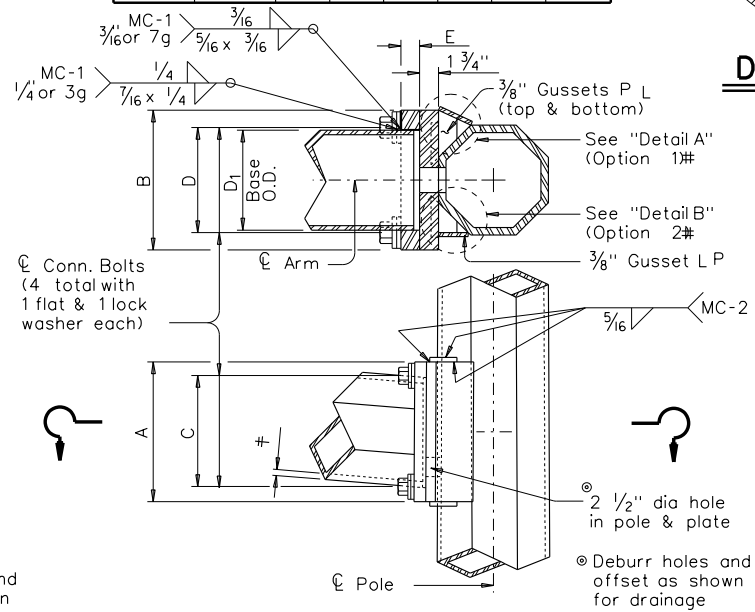


FIXED MOUNT DETAIL 2

ARM SIZE		A	F	T	CONN. BOLTS		PIN BOLTS	
D ₁	#	in.	in.	in.	No.	Dia	No.	Dia
7.0	.179	12	6	3/4	4	3/4	2	5/8
7.5	.179	14	8	3/4	4	3/4	2	5/8
8.0	.179	14	8	3/4	4	3/4	2	5/8
9.0	.179	16	10	7/8	4	1	2	5/8
10.0	.179	18	10	7/8	4	1	2	5/8
9.5	.239	18	10	1	6	1	3	5/8
10.0	.239	18	10	1	6	1	3	5/8

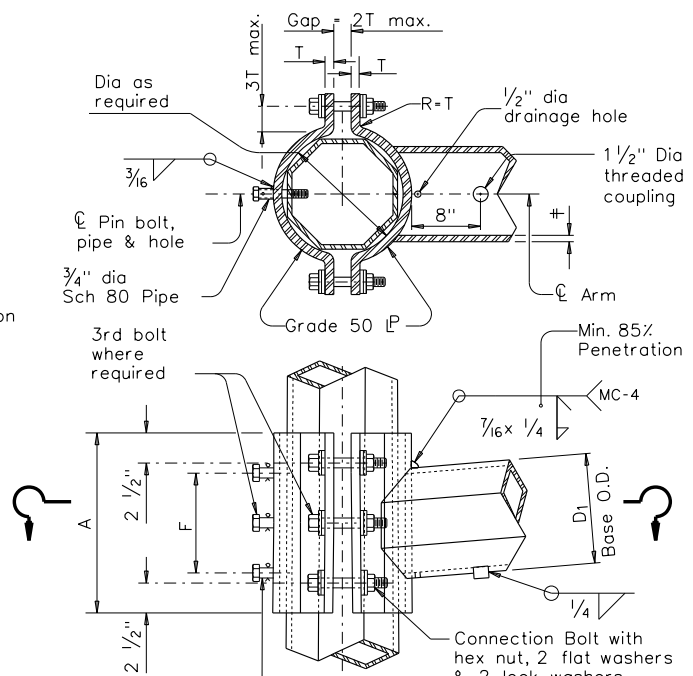


CLAMP-ON DETAIL 2

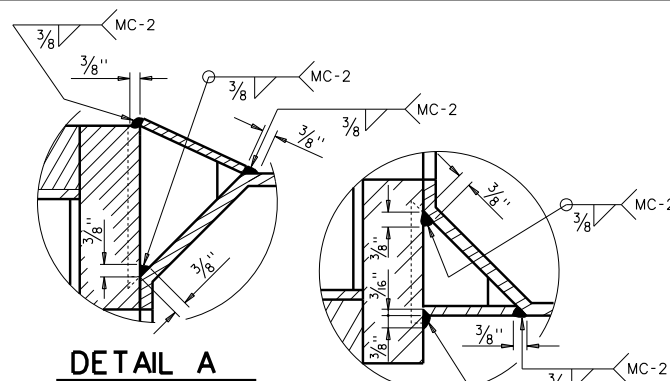

DETAIL A

DETAIL B

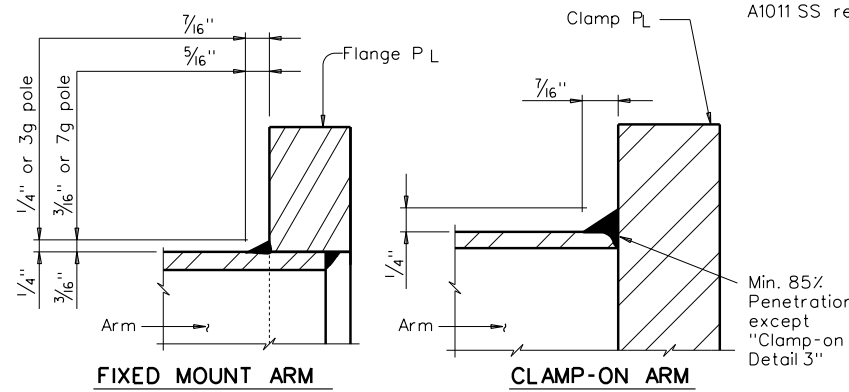


FIXED MOUNT ARM

CLAMP-ON ARM

ARM BASE WELD DETAILS

ARM SIZE		A	F	CONN. BOLTS		PIN BOLTS	
D ₁	#	in.	in.	No.	Dia	No.	Dia
6.5	.179	12	6	4	1	2	5/8
7.5	.179	14	8	4	1	2	5/8
8.0	.179	14	8	4	1	2	5/8
9.0	.179	16	10	4	1	2	5/8
9.5	.179	18	12	6	1	3	5/8
9.5	.239	18	12	6	1	3	5/8
10.0	.239	18	12	6	1	3	5/8

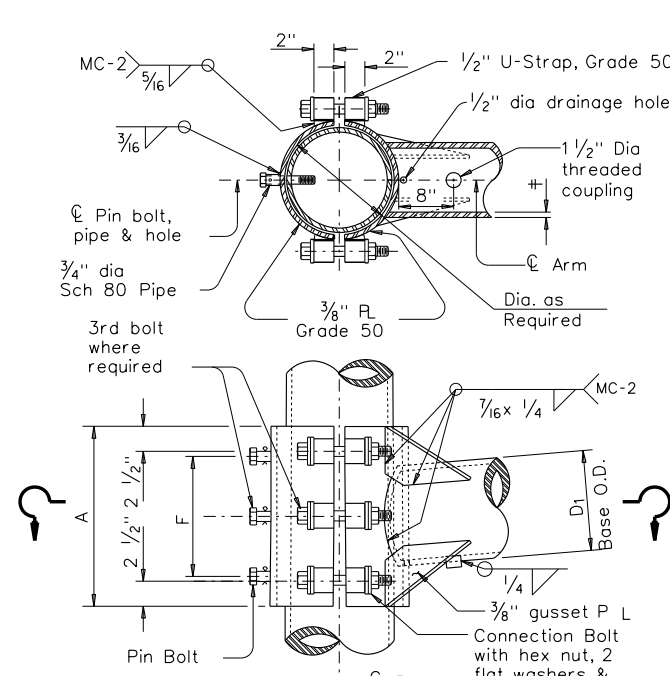

CLAMP-ON DETAIL 3

MATERIALS	
Round Shafts or Polygonal Shafts ①	ASTM A595 Gr.A, A588, A1008 HSLAS Gr.50 Class 2, A1011 HSLAS Gr.50 Class 2, A572 Gr.50 or A1011 SS Gr.50 ②
Plates ①	ASTM A36, A588, or A572 Gr.50
Connection Bolts	ASTM A325 or A449, except where noted
Pin Bolts	ASTM A325
Pipe ①	ASTM A53 Gr.B, A501, A1008 HSLAS-F Gr.50, A1011 HSLAS-F Gr.50
Misc. Hardware	Galvanized steel or stainless steel or as noted

- ① ASTM A572, A1008 HSLAS, A1011 HSLAS, A1008 HSLAS-F, A1011 HSLAS-F or A1011 SS may have higher yield strengths but shall not have less elongation than the grade indicated.
- ② ASTM A1011 SS Gr.50 material shall also have a minimum elongation of 18 percent in 8 inches or 23 percent in 2 inches. Material thickness in excess of those stipulated under A1011 SS will be acceptable providing the material meets all other A1011 SS requirements and the requirements of this item.

GENERAL NOTES:

Clamp-on details are used for the second arm on dualmast arm assemblies. A Maximum 1 1/2" wide vertical slotted hole shall be cut in the front clamp plate to facilitate drainage during galvanizing. The slot shall be centered behind the arm and shall be no longer than the arm diameter minus 1"

Fixed mount details are used for single mast arm assemblies and for the first arm on dualmast arm assemblies.

Where duplicate parts occur on a detail, welds shown for one part shall apply to all similar parts on the detail.

Pin bolts are required to prevent rotation of clamp-on arms under design wind forces.

NOTE:

Pin bolts shall be A325 with threads excluded from the shear plane. Pin bolt and 3/4" dia pipe shall have 3/16" dia holes for a 1/8" dia galvanized cotter pin. Back clamp plate shall be furnished with a 3/4" dia hole for each pin bolt. An 1/16" dia hole for each pin bolt shall be field drilled through the pole after arm orientations have been approved by the Engineer.

Texas Department of Transportation
 Traffic Operations Division

STANDARD ASSEMBLY FOR TRAFFIC SIGNAL SUPPORT STRUCTURES


MAST ARM CONNECTIONS

MA-C-12


© TxDOT August 1995		DN: MS	CK: JSY	DW: MMF	CK: JSY
REVISIONS		CONT	SECT	JOB	HIGHWAY
5-96	0164	03	056		SH 31
5-09					
1-12					
	DIST	COUNTY		SHEET NO.	
	TYL	HENDERSON		48	

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 7/17/2023 6:55:14 AM
 FILE: c:\users\tm\appdata\local\bentley\projectwise\workingdir\wpm-pw-01\teving\waterpmoore.com\dms47257\MA-D-12.dgn

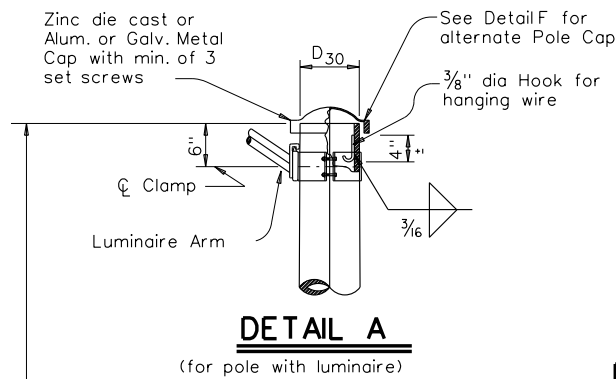


DETAIL A
(for pole with luminaire)

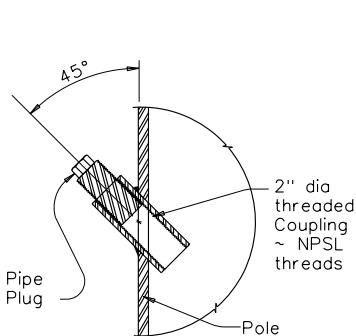

POLE COUPLING DETAIL

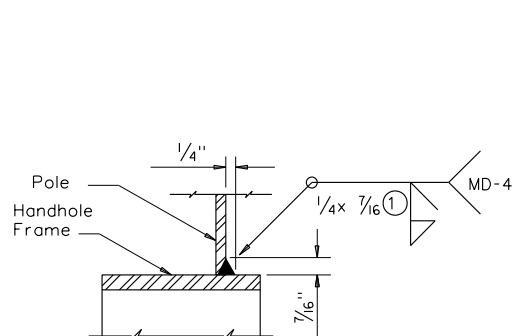


DETAIL G

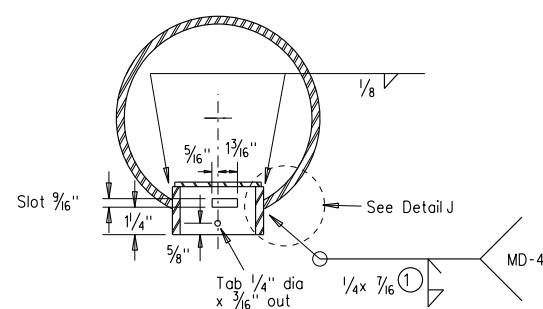


SECTION X-X


Opening for access compartment shall be no more than 1/16 inch wider than the access compartment itself.

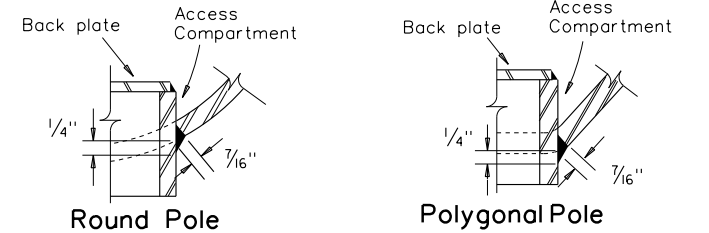


DETAIL J

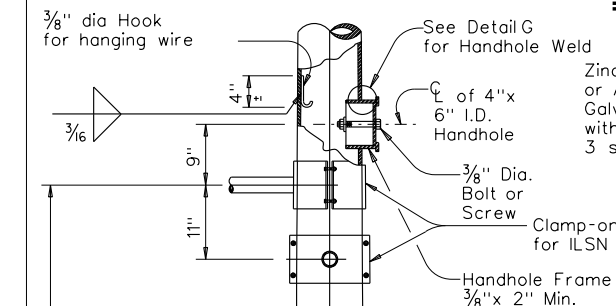


DETAIL B
(if ILSN applied)

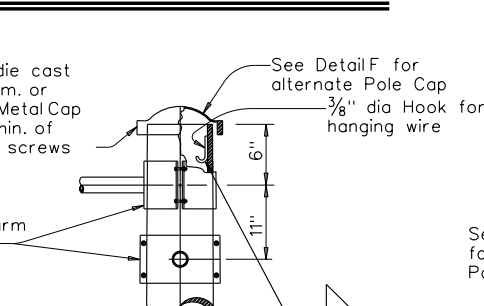


DETAIL C

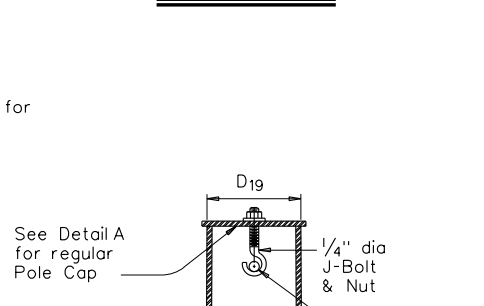

SECTION Y-Y

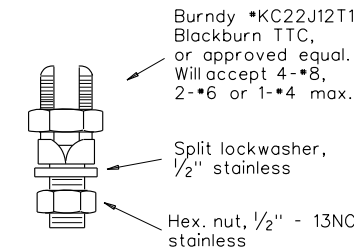


COPPER GROUND CONNECTOR

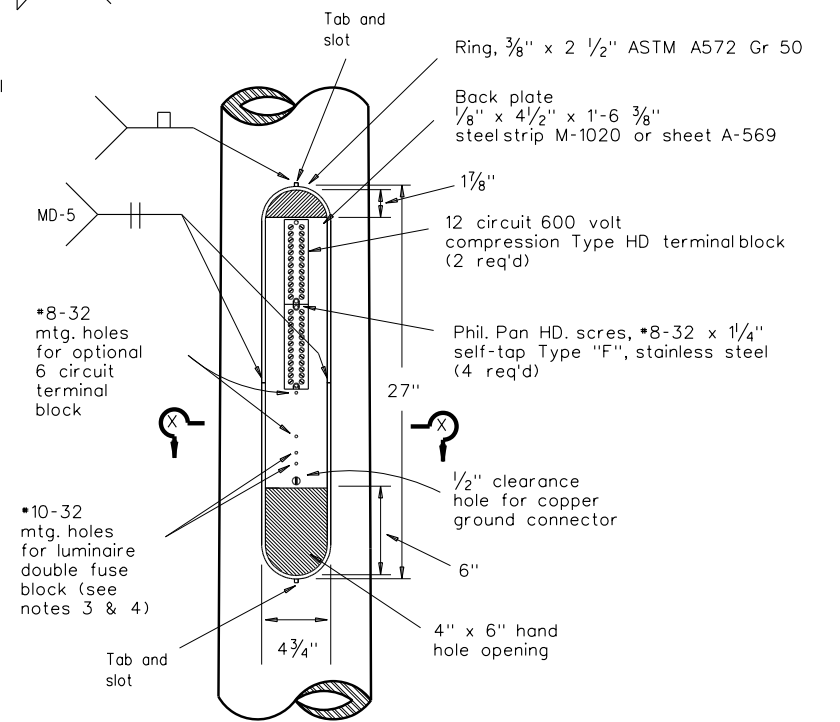


ACCESS COMPARTMENT

NOTES:


- The cover shall be one piece formed from ABS plastic, shall be a pearl gray color, and shall be suitable for exposure to harsh sunlight and extreme weather. Cover shall latch with two screw latches and shall fit tightly to the enclosure ring to create a rainproof seal. Latch screws shall be 1/4-20 stainless flat socket head screws with tamper proof feature.
- The pole manufacturer shall provide with each pole a separate kit consisting of: one cover with two latching assemblies, two terminal strips (Marathon *985GP12CU or approved equal), four *8-32 x 1/4 self tapping type "F" stainless steel pan head screws, and one ground connector (Blackburn TTC, Burndy KC22J12T13, or Ilco SSS-5). The traffic signal contractor shall install the kit items in the field.
- The screw hole spacing on the enclosure back plate shall be for two Marathon *985GP12 terminal strips, one Marathon *985GP06CU terminal strip, and one Bussmann *BM6032B fuse block.
- Install one Bussmann *BM6032B, Littelfuse *L60030M-2C, or Ferraz-Shawmut *30352 fuse block for poles where luminaires are to be installed.

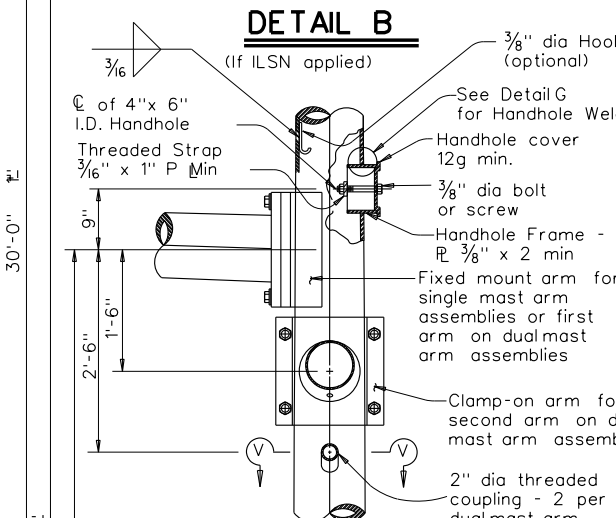


DETAIL D
(for 30' pole with luminaire and ILSN sign)

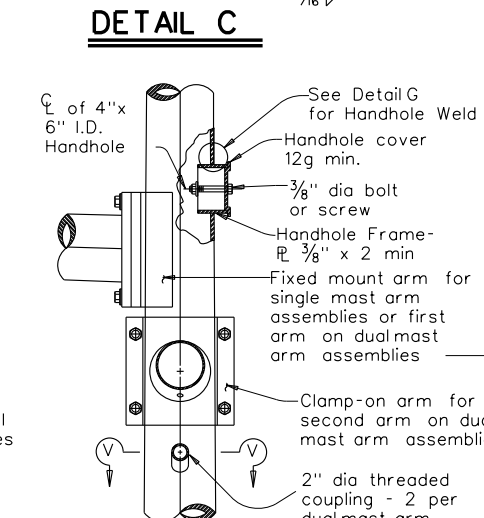

DETAIL E
(for 24' pole with ILSN sign and no luminaire)

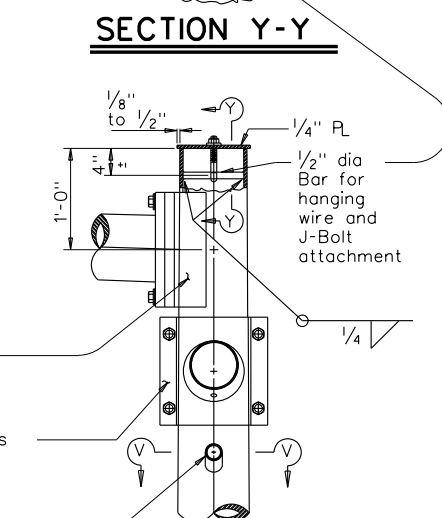


DETAIL F
(for 19' pole with no ILSN sign and no luminaire)

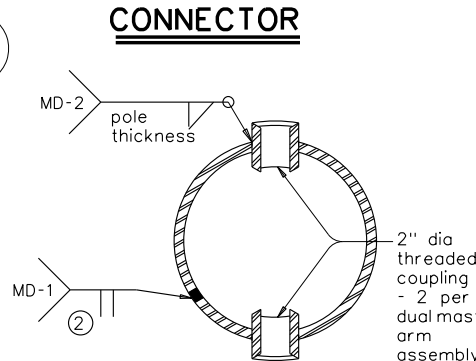


SECTION V-V


Anchor Bolt Diameter	Bolt Hole Diameter	Slot Length	Bolt Circle Diameter	Base PL Dim. L x T	Adjust. Range
1 1/2"	1 3/4"	3 1/2"	17"	18" x 1 1/2"	13.4°
1 3/4"	2"	4"	19"	20" x 1 3/4"	13.5°
2"	2 1/4"	4 1/2"	21"	22" x 2"	13.6°
2 1/4"	2 1/2"	5"	23"	24" x 2 1/4"	13.7°

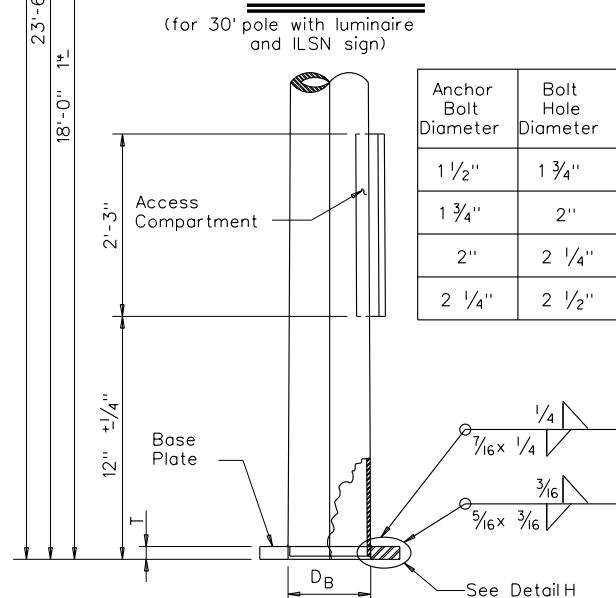

POLE ELEVATION

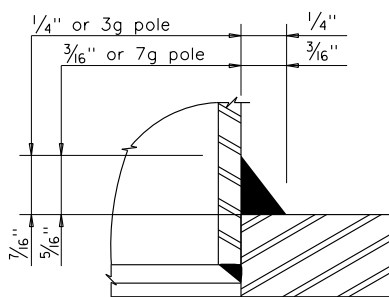

DETAIL H

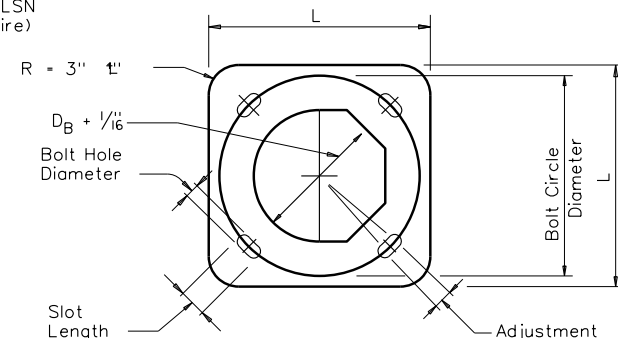

BASE PLATE PLAN

- ① 85% Min. penetration
- ② 60% Min. penetration 100% penetration within 6" of circumferential base welds.

Texas Department of Transportation
 Traffic Operations Division


TRAFFIC SIGNAL SUPPORT STRUCTURES MAST ARM POLE DETAILS

MA-D-12


© TxDOT August 1995	DN: MS	CK: JSY	DW: FDN	CK: CAL
8-99 1-12	REVISIONS	CONT	SECT	JOB
		0164	03	056
		DIST	COUNTY	HIGHWAY
		TYL	HENDERSON	SH 31
				SHEET NO.
				49

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for the use of this standard for any purpose not intended by the original author.

DATE: 7/17/2023 6:55:15 AM
 FILE: ct:\users\time\appdate\local\bentley\projectwise\workingdir\wpm-pw\bentley\c\of\this\project\dwg\ma-dpd-20.dwg

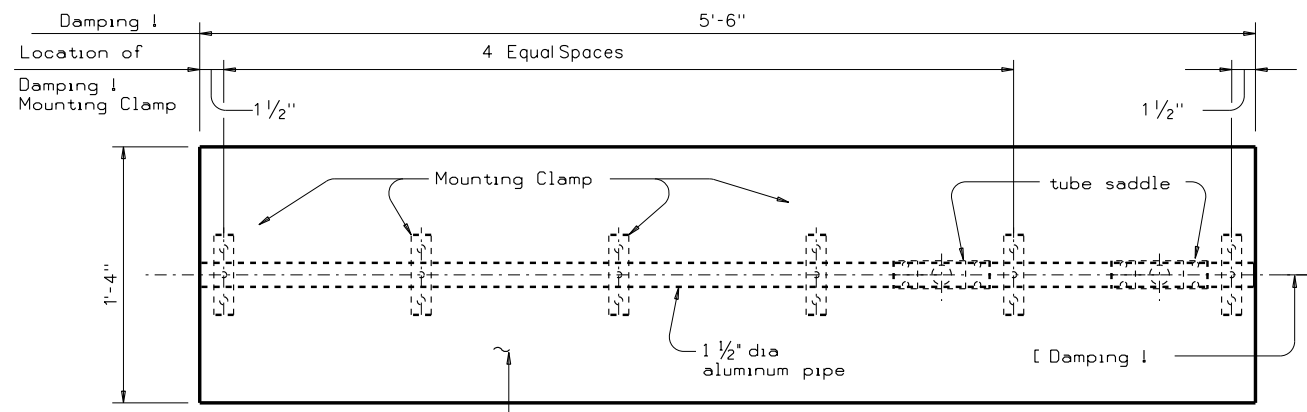


PLAN

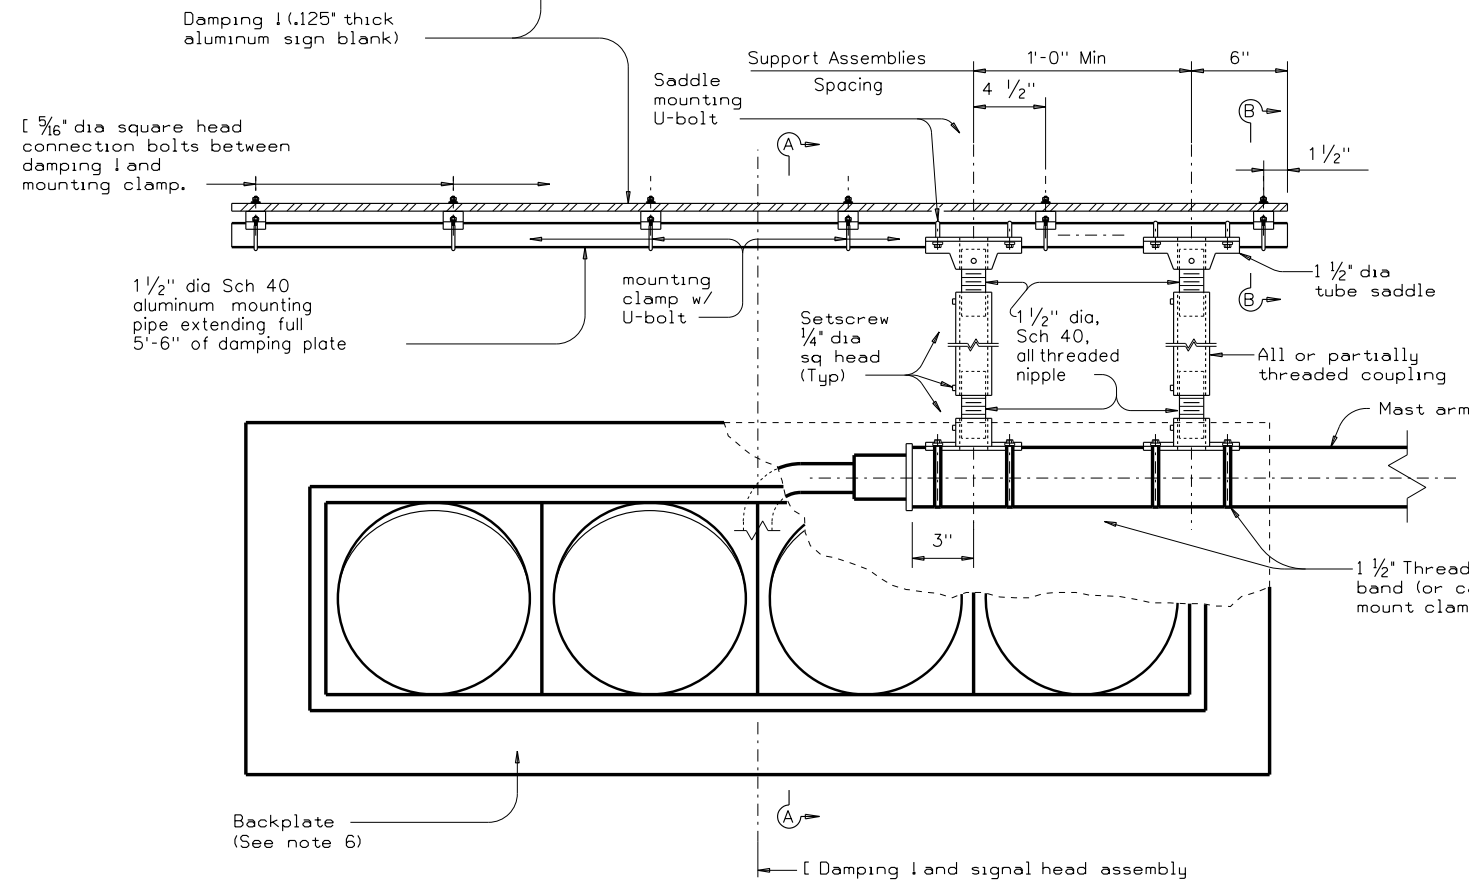

ELEVATION


DAMPING PLATE MOUNTING DETAILS

(Showing alternate placement of signal head)

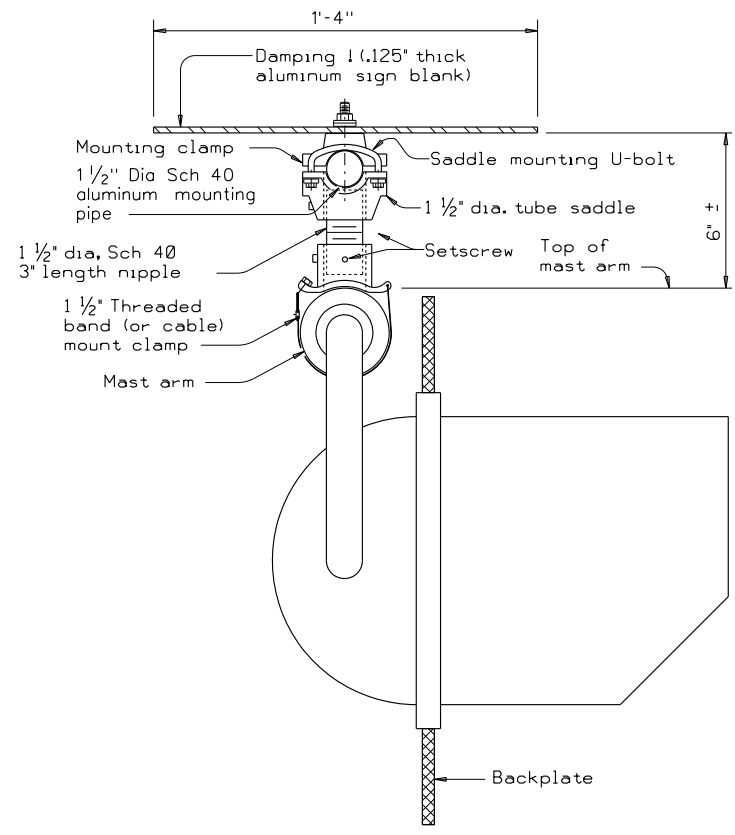


SECTION A-A

(Showing standard placement of signal head)
 (Mounting clamp U-bolt is not shown for clarity)

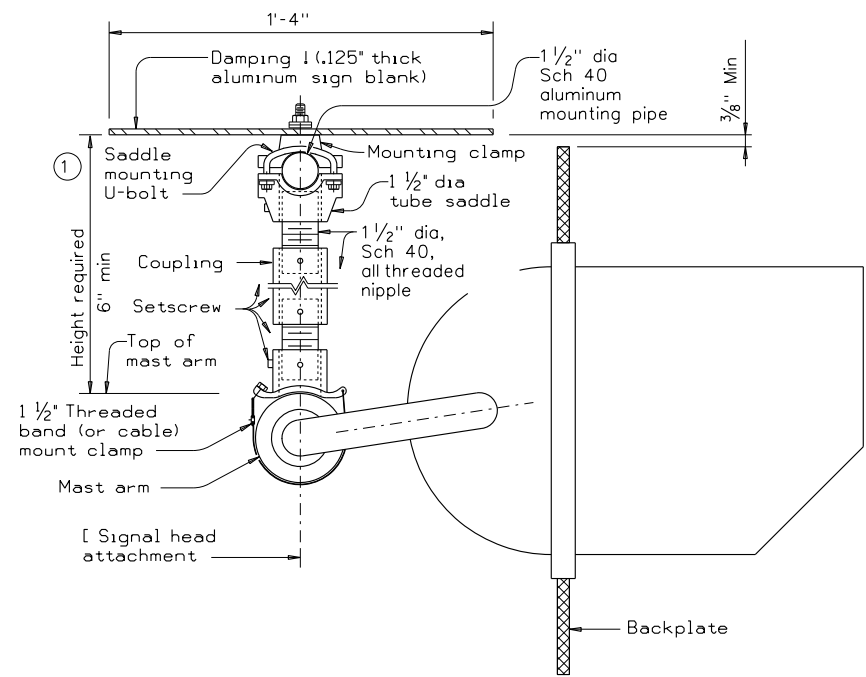

SECTION A-A

(Showing alternate placement of signal head)
 (Mounting clamp U-bolt is not shown for clarity)

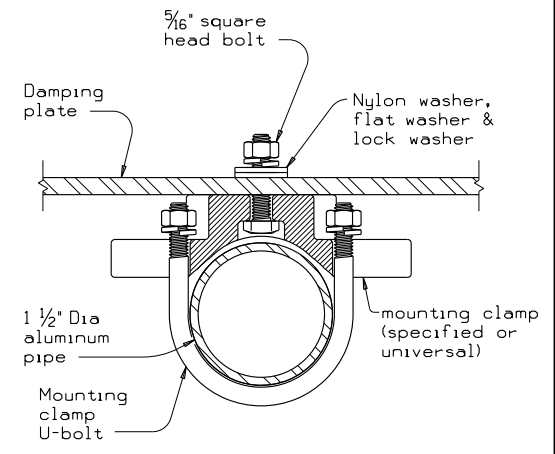

SECTION B-B

(Showing damping plate attachment)

GENERAL NOTES:

- In accordance with the findings of TxDOT sponsored research, the installation of a damping plate in accordance with the details shown here at the end of signal mast arms of SMA and DMA standard structures reduces excessive harmonic vertical vibration, and thus fatigue damage. Any deviation from these details may reduce the effectiveness of this damping device.
- Aluminum sign blank for damping plate will conform to Departmental Material Specifications DMS-7110. Materials for mast arm mounting clamp and tube saddle will be aluminum castings or aluminum alloys as in accordance with manufacturers' stipulations. Mounting pipe, pipe nipple and coupling will be aluminum alloy 6061-T6 or 6063-T6. Damping plate mounting clamp and U-bolt assemblies will conform to Standard sheet SMD(GEN). U-bolts for saddle mounting will have a minimum yield strength of 36 ksi.
- Damping plate will be mounted horizontally. Position centerline of damping plate to align with centerline of mast arm or horizontal signal head assembly. Vertical clearance between signal head (with or without backing plate) and bottom of damping plate will be maintained as shown. The attachments shown here are examples only, other supporting details which meet both alignment and vertical clearance requirements are also acceptable.
- Unless stipulated by the manufacturers, all steel parts will be galvanized finish in accordance with Standard Specification Item 445, "Galvanizing".
- Contractor will verify applicable field dimensions before the installation.
- Backplates are optional for traffic signals. When backplates are used, Backplates will have a 2-inch fluorescent yellow AASHTO Type B or C FL retroreflective border conforming to TxDOT DMS-8300 "Sign Face Materials." See Sheet TS-BP-20 for backplate details.

① Recommended supporting assemblies to achieve required height for horizontal section heads

Height required	One nipple each length	Two nipples each length	plus One coupling each length
6'-6 3/4"	3"	-	-
7'-8 1/2"	4"	-	-
9'-10 1/2"	6"	-	-
11'-15 1/2"	-	4"	5"
16'-24"	-	6"	10"

Texas Department of Transportation Traffic Safety Division Standard

MAST ARM DAMPING PLATE DETAILS

MA-DPD-20


FILE: ma-dpd-20.dgn DNE: TxDOT CK: TxDOT DW: TxDOT CK: TxDOT
 © TxDOT January 2012 CONT SECT JOB HIGHWAY
 REVISIONS 0164 03 056 SH 31
 6-20 DIST COUNTY SHEET NO.
 TYL HENDERSON 50

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to the metric system or for any errors or omissions that may appear hereon.


DATE: 7/17/2023 6:55:16 AM
FILE: c:\users\tim\appdata\local\bentley\projectwise\workingdir\wpm-pw-bentley\local\bentley\projectwise\workingdir\ts-bp-20.dgn

Backplate louvers based on wind and vibration rating.

Retroreflective border. See general note 1

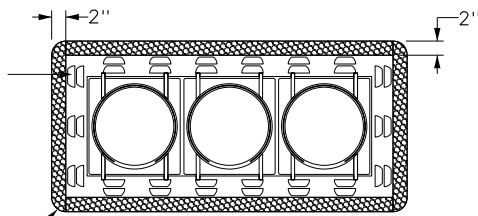


Vented backplate with retroreflective border

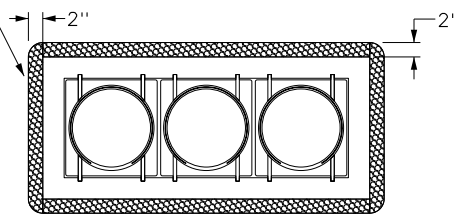


Backplate with retroreflective border

THREE-SECTION HEAD HORIZONTAL OR VERTICAL

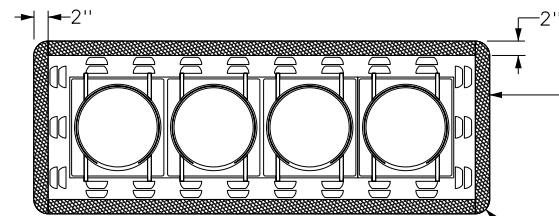

Vented backplate with retroreflective border

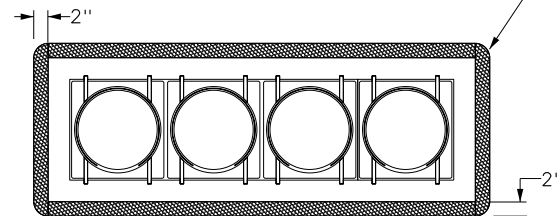


Backplate with retroreflective border


FOUR-SECTION HEAD HORIZONTAL OR VERTICAL

Backplate louvers based on wind and vibration rating.

Retroreflective border. See general note 1

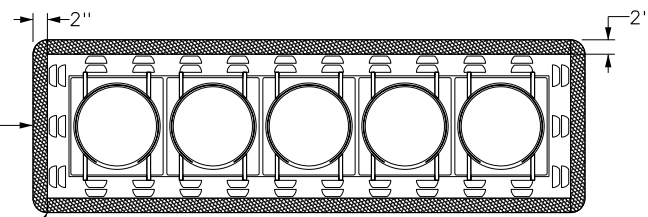


Vented backplate with retroreflective border

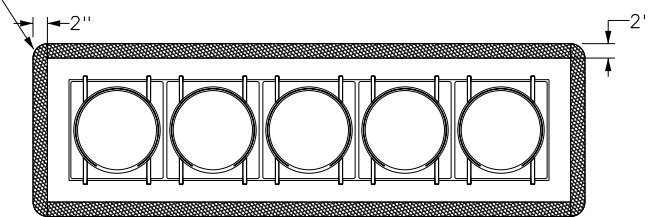


Backplate with retroreflective border

FIVE-SECTION HEAD HORIZONTAL OR VERTICAL

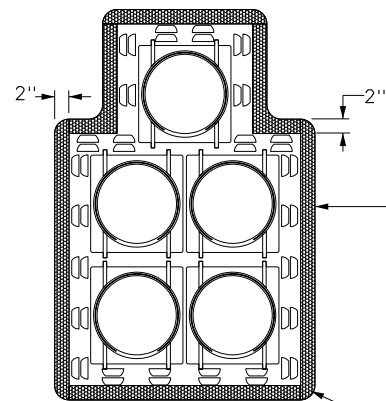

Vented backplate with retroreflective border

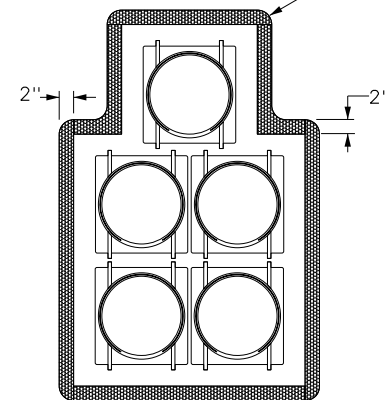


Backplate with retroreflective border


FIVE-SECTION HEAD CLUSTER

Backplate louvers based on wind and vibration rating.

Retroreflective border. See general note 1

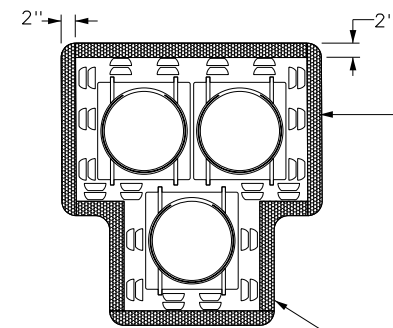

Vented backplate with retroreflective border

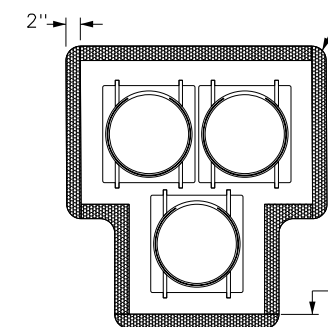

Backplate with retroreflective border

PEDESTRIAN HYBRID BEACON


GENERAL NOTES:

1. Backplates are optional for traffic signals and pedestrian hybrid beacons. When backplates are used, a 2-inch wide fluorescent yellow AASHTO Type B or A retroreflective border conforming to TxDOT DMS-8300 is required. Place on all approaches when used.
2. Signalhead and backplate compatibility must be verified by the contractor prior to installation.
3. When using backplates on signalheads, venting is preferred to reduce cyclic vibration stress.
4. When a vented backplate is used, the retroreflective border must not be placed over the louvers.
5. This standard sheet applies to all signalheads with backplates, including but not limited to:
 - Pole mounted
 - Overhead mounted
 - Span wire mounted
 - Mast arm mounted
 - Vertical signal heads
 - Horizontal signal heads
 - Clustered signal heads
 - Pedestrian hybrid beacons


		Traffic Safety Division Standard	
TRAFFIC SIGNAL HEAD WITH BACKPLATE			
TS-BP-20			
FILE: ts-bp-20.dgn	DN: TxDOT	CK: TxDOT	DW: TxDOT
© TxDOT June 2020	CONT: 0164	SECT: 03	JOB: 056
REVISIONS	DIST: TYL	COUNTY: HENDERSON	HIGHWAY: SH 31
			SHEET NO.: 51

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for the accuracy of the information contained herein. The user of this standard shall be responsible for its use.

DATE: 7/17/2023 6:55:18 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\pwm-pw.bentley.com\ts-cf-21.dgn

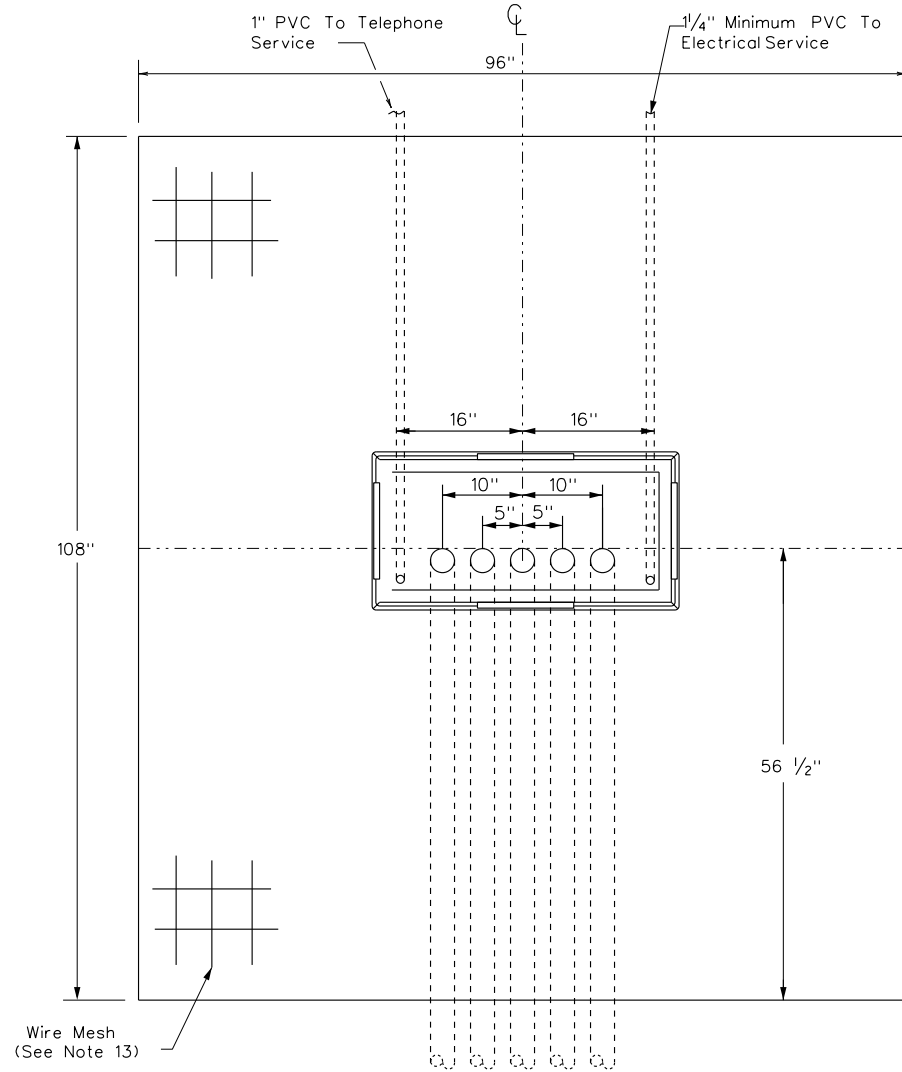

TOP VIEW

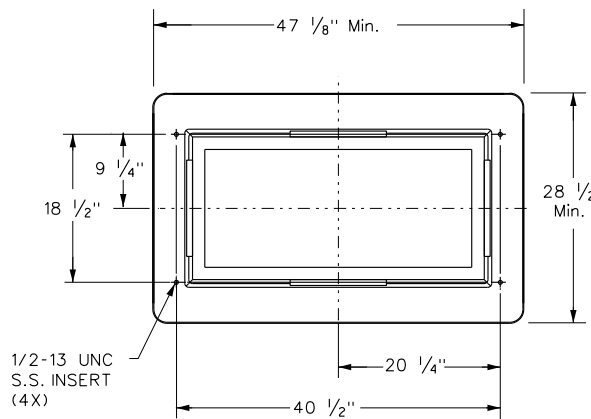

CABINET BASE

TRAFFIC SIGNAL CONTROLLER BASE:

1. Provide a traffic signal controller base (cabinet base) manufactured of polymer concrete material consisting of calcareous and siliceous stone, glass fibers and thermoset polyester resin. The polymer concrete cabinet base must be reinforced on the inside of the cabinet base with fiberglass matting. Provide one of the following bases: Armorcast Part # A6001848X24, Quazite Model # PG3048Z709, or other as approved by TxDOT Traffic Safety Division.
2. The polymer concrete material must have a minimum compressive strength of 10,300 pounds per square inch (psi), minimum flexural strength of 3600 psi, and minimum shear strength of 3600 psi.
3. The polymer concrete cabinet base must conform to the dimensions shown and must accommodate a standard TxDOT basemount cabinet.
4. Supply the cabinet base with four 1/2"-13 UNC stainless steel inserts for attachment of the cabinet to the base. Inserts must withstand a minimum torque of 50 ft-lb and a minimum straight pullout strength of 750 lbs.
5. Provide the cabinet base with 4 cable racks mounted one on each side of the base 2" to 7" from the top edge of the base. Unless approved otherwise, cable racks must be 1-1/2 x 9*16x 3*16inch steel channel with eight T-slots spaced at 1-1/2 inches. The cable racks must easily accommodate the insertion of tie wraps to attach field wiring to the racks to serve as strain relief. Secure cable racks to the base using 1/2"-13 UNC stainless steel screws and inserts.
6. The cabinet base, when secured to the concrete slab with controller cabinet attached, must withstand a minimum wind load of 125 mph or a 850 lb force applied at 49" above the bottom of the base without causing the base or cabinet to come out of their anchored position or cause any permanent deformation. The manufacturer must supply certification by an independent testing laboratory or sealed by a Texas Licensed Professional Engineer. Provide the cabinet base with hardware for attachment to a concrete slab.
7. The traffic signal base must be permanently marked either by impress or by permanent ink with the manufacturer's model number and name or logo.
8. Seal the base to the concrete with a silicone caulk bead and fastened to the slab per manufacturer's instructions.

CONCRETE SLAB:

9. Traffic signal controller pad must be a portland cement concrete slab poured in place, must conform to the dimensions shown, and must be level.
10. Grade earthwork such that it is flush with the concrete pad on all four sides, unless otherwise shown on the plans. Subsidiary to ITEM 680, four inch rip rap may be used in lieu of earthwork. Slopes shall gradually contour to match plans.
11. Bond a #8 AWG copper ground wire and an 8 ft ground rod bonded to the reinforcing mesh by a suitable UL Listed clamp and terminated to the cabinet grounding bus for the purpose of providing a local ground for the electrical grounding conductor. The electrical grounding conductor specified in Item 680-3.A.4 is required and must be terminated to the cabinet ground bus.
12. Install a PVC sleeve to prevent the ground rod from direct embedment in the slab.
13. Provide welded wire mesh 6X6-W2.9 X W2.9 for reinforcement. Provide joints and splices in the mesh with a minimum 6-inch overlap. Center the mesh between top and bottom and provide a minimum 3 inch cover on the edges.
14. Provide Class B concrete minimum for the slab in accordance with Item 421. Construct the slab in accordance with Item 531.

CONDUITS:


15. Stub up and run 3-inch conduits through the slab to the various traffic signal poles and ground boxes as shown on the layouts. Install the number of conduits as shown on layouts plus two additional 3 inch conduits for future use. Terminate the conduits with a bushing between 2 and 4-inches above the slab.
16. Extend conduits for future use at least 18-inches from the edge of the slab, terminate underground with a coupling, and cap and seal so that the seal can be removed without damaging the coupling. This must also apply to unused telephone conduit.
17. Stub up two separate conduits through the slab from the electrical and telephone services. Run the conduit for the electrical feed directly to the electrical service enclosure. Run the conduit for the telephone line directly to the telephone service, usually located on the same pole as the electrical service. Telephone must not under any circumstance share a conduit with any other function.
18. Terminate electric and telephone conduits above the slab with a coupling. After the base is installed, extend the conduits above the top of the base and secure to the base using a steel one-hole strap or similar suitable substitute.

CONTROLLER CABINET:

19. Anchor the controller cabinet to the base using four stainless steel 1/2-13 NC bolts.
20. The silicone caulk bead specified in Item 680.3.B must be RTV 133.

PAYMENT:

21. Bid TS-CF as subsidiary to Item 680.

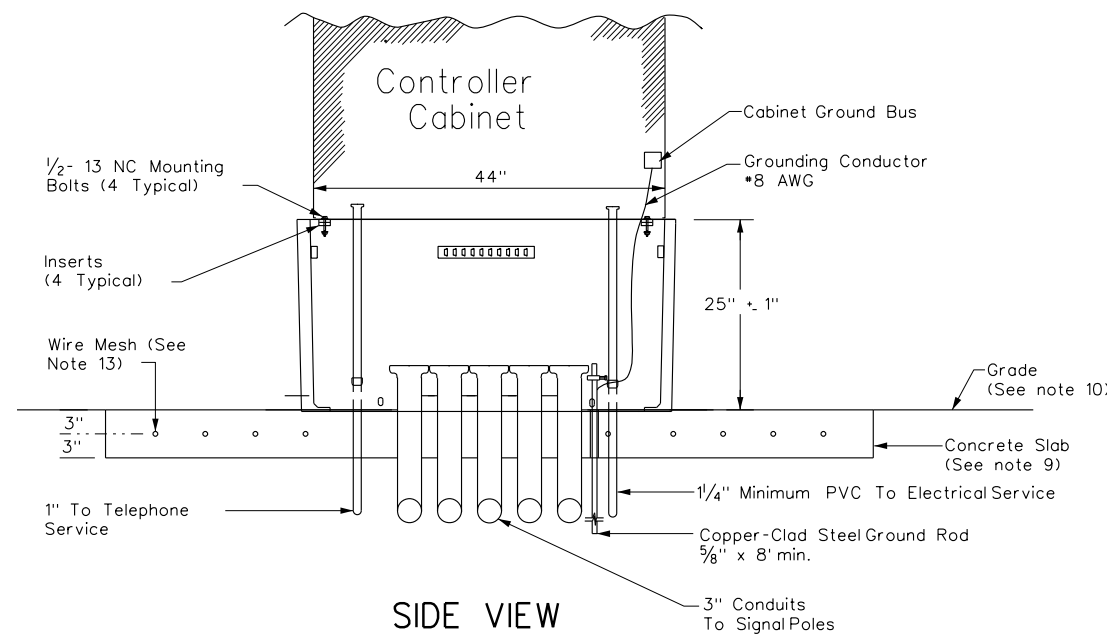

SIDE VIEW

				Texas Department of Transportation		Traffic Safety Division Standard	
TRAFFIC SIGNAL CONTROLLER CABINET BASE AND PAD							
TS-CF-21							
FILE:	ts-cf-21.dgn	DWG:		CK:		DW:	CK:
© TxDOT	October 2000	CONT	SECT	JOB	HIGHWAY		
REVISIONS		0164	03	056	SH 31		
12-04		DIST	COUNTY		SHEET NO.		
2-21		TYL	HENDERSON		52		

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023 6:55:20 AM
 FILE: c:\users\time\appdata\local\benley\project\wise\workingdir\wpm-pw-01\tewing\waterpmoore.com\dms47257\TS-FD-12-PS&E*2.dgn

FOUNDATION DESIGN TABLE

FDN TYPE	DRILLED SHAFT DIA	REINFORCING STEEL		EMBEDDED DRILLED SHAFT LENGTH-ft ④ ⑤ ⑥			ANCHOR BOLT DESIGN ①				FOUNDATION DESIGN LOAD ②		TYPICAL APPLICATION
		VERT BARS	SPIRAL & PITCH	TEXAS CONE PENETROMETER N blows/ft			ANCHOR BOLT DIA	F _y (ksi)	BOLT CIR DIA	ANCHOR TYPE	MOMENT K-ft	SHEAR Kips	
				10	15	40							
24-A	24"	4- #5	#2 at 12"	5.7	5.3	4.5	¾"	36	12 ¾"	1	10	1	Pedestal pole, pedestal mounted controller.
30-A	30"	8- #8	#3 at 6"	11.3	10.3	8.0	1½"	55	17"	2	87	3	Mast arm assembly. (see Selection Table)
36-A	36"	10- #8	#3 at 6"	13.2	12.0	9.4	1¾"	55	19"	2	131	5	Mast arm assembly. (see Selection Table) 30' strain pole with or without luminaire.
36-B	36"	12- #8	#3 at 6"	15.2	13.6	10.4	2"	55	21"	2	190	7	Mast arm assembly. (see Selection Table) Strain pole taller than 30' & strain pole with mast arm
42-A	42"	14- #8	#3 at 6"	17.4	15.6	11.9	2 ¼"	55	23"	2	271	9	Mast arm assembly. (see Selection Table)

NOTES:


- Anchor bolt design develops the foundation capacity given under Foundation Design Loads.
- Foundation Design Loads are the allowable moments and shears at the base of the structure.
- Foundations may be listed separately or grouped according to similarity of location and type. Quantities are for the Contractor's information only.
- Field Penetrometer readings at a depth of approximately 3 to 5 feet may be used to adjust shaft lengths.
- If rock is encountered, the Drilled Shaft shall extend a minimum of two diameters into solid rock.
- Decimal lengths in Design Table are to allow interpolation for other penetrometer values. Round to nearest foot for entry into Summary Table.

FOUNDATION SUMMARY TABLE ③

LOCATION IDENTIFICATION	AVG. N BLOW /ft.	FDN TYPE	NO. EA	DRILLED SHAFT LENGTH (FEET) ⑥				
				24-A	30-A	36-A	36-B	42-A
P-1	10	30-A	1		11			
P-2	10	24-A	1	6				
P-3	10	36-A	1			13		
P-4	10	24-A	1	6				
P-5	10	30-A	1		11			
P-6	10	24-A	1	6				
P-7	10	36-A	1			13		
P-8	10	30-A	1	6				
TOTAL DRILLED SHAFT LENGTHS				24	22	26		

FOUNDATION SELECTION TABLE FOR STANDARD MAST ARM PLUS ILSN SUPPORT ASSEMBLIES (ft)

WIND SPEED	MAX SINGLE ARM LENGTH	FDN 30-A	FDN 36-A	FDN 36-B	FDN 42-A
		80 MPH	32'	48'	
80 MPH	MAXIMUM DOUBLE ARM LENGTH COMBINATIONS	24' X 24'			
		28' X 28'			
		32' X 28'			
			32' X 32'		
			36' X 36'		
			40' X 36'		
100 MPH	MAXIMUM DOUBLE ARM LENGTH COMBINATIONS		44' X 28'	44' X 36'	
			24' X 24'		
			28' X 28'		
			32' X 24'		
				32' X 32'	
		36' X 36'			
		40' X 24'		40' X 36'	
				44' X 36'	

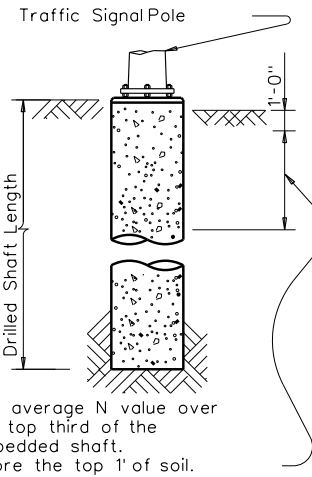


ANCHOR BOLT & TEMPLATE SIZES

BOLT DIA IN.	⑦ BOLT LENGTH	TOP THREAD	BOTTOM THREAD	BOLT CIRCLE	R ₂	R ₁
¾"	1'-6"	3"	—	12 ¾"	7 ⅛"	5 ⅝"
1 ½"	3'-4"	6"	4"	17"	10"	7"
1 ¾"	3'-10"	7"	4 ½"	19"	11 ¼"	7 ¾"
2"	4'-3"	8"	5"	21"	12 ½"	8 ½"
2 ¼"	4'-9"	9"	5 ½"	23"	13 ¾"	9 ¼"

⑦ Min dimensions given, longer bolts are acceptable.



EXAMPLE:

- For 80mph design wind speed, foundation 30-A can support up to a 32' arm with another arm up to 28'
- For 100mph design wind speed, foundation 36-A can support a single 36' mast arm.

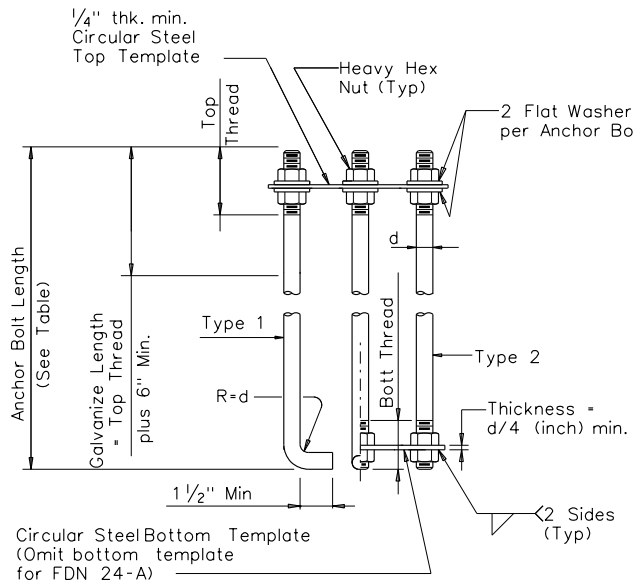


HOOKED ANCHOR (TYPE 1) NUT ANCHOR (TYPE 2) ANCHOR BOLT ASSEMBLY

⑧ Orient anchor bolts orthogonal with the fixed arm direction to ensure that two bolts are in tension under dead load.

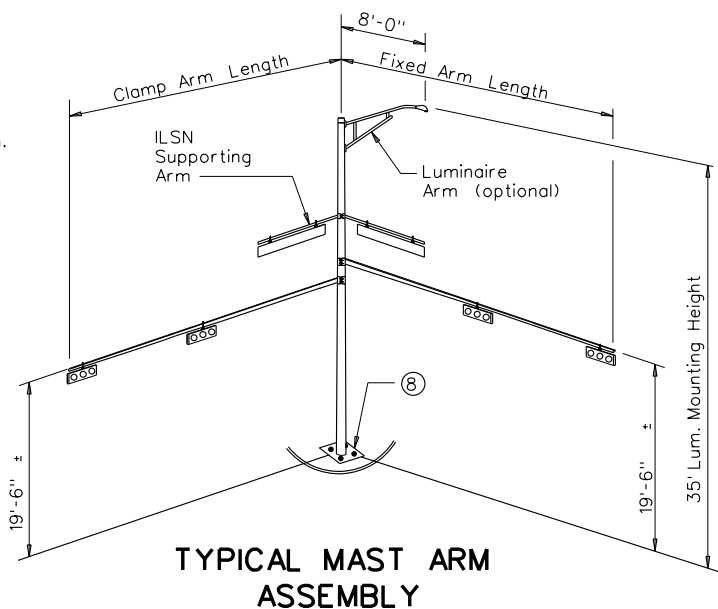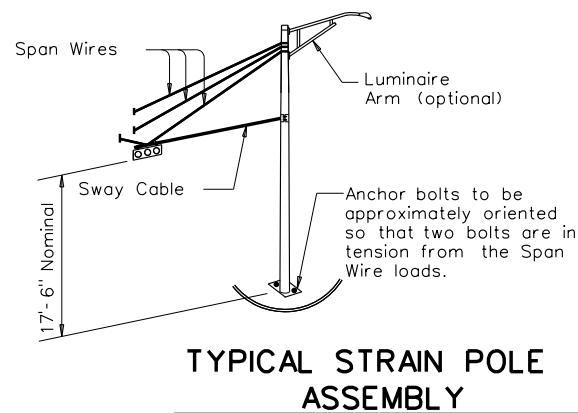

Steel Template with holes ⅛" greater than bolt diameter

Bond anchor bolts to rebar cage, two locations using #3 bar or #6 copper jumper. Mechanical connectors shall be UL Listed for concrete encasement.

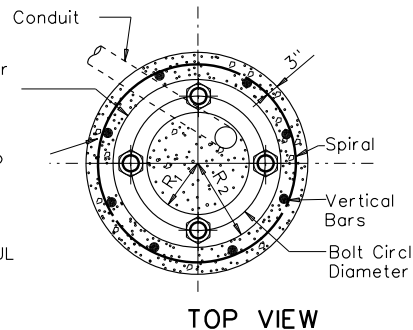


Conduit (See Layout Sheets for diameter. Orient as directed by the Engineer. 1 or 2 required)

Vertical Bars (See Design Table for size & number).

Spiral, 3 flat turns top & 1 flat turn bottom. (See Design Table for size & pitch)

Vertical bars may rest on bottom of drilled hole if material is firm enough to do so when concrete is placed.

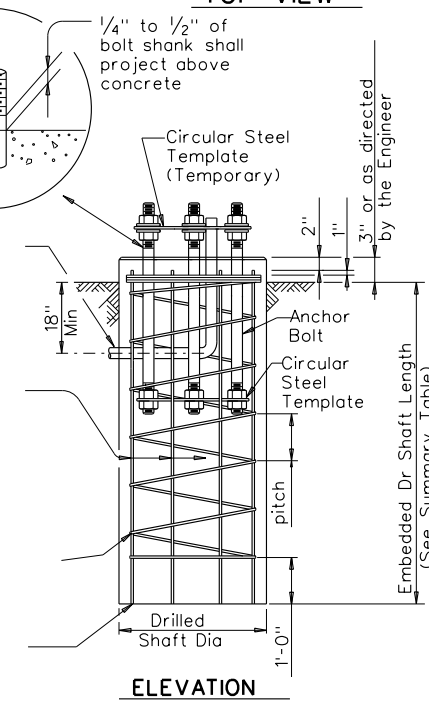

FOUNDATION DETAILS

GENERAL NOTES:

Design conforms to 1994 AASHTO Standard Specifications for Structural Supports for Highway Signs, Luminaires and Traffic Signals and interim revisions thereto.

Reinforcing steel shall conform to Item 440, "Reinforcing Steel".

Concrete shall be Class "C".

Threads for anchor bolts and nuts shall be rolled or cut threads of BUN series up to 2" in diameter or UNC series for all sizes. Bolts and nuts shall have Class 2A and 2B fit tolerances. Galvanized nuts shall be tapped after galvanizing.


Anchor bolts that are larger than 1" in diameter shall conform to "alloy steel" or "medium-strength mild steel" per Item 449, "Anchor Bolts". Anchor bolts that are 1" in diameter or less shall conform to ASTM A36. Galvanize a minimum of the top end thread length plus 6" for all anchor bolts unless otherwise noted. Exposed washers and exposed nuts shall be galvanized. All galvanizing shall be in accordance with Item 445, "Galvanizing".

Templates and embedded nuts need not be galvanized. Lubricate and tighten anchor bolts when erecting the structure in accordance with Item 449, "Anchor Bolts".



TRAFFIC SIGNAL POLE FOUNDATION


TS-FD-12




© TxDOT August 1995		DN: MS	CK: JSY	DW: MAD/MMF	CK: JSY/TEB
5-96	11-99	0164	03	056	SH 31
REVISIONS		CON	SECT	JOB	HIGHWAY
		DIST	COUNTY		SHEET NO.
		TYL	HENDERSON		53

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 7/17/2023
 FILE: c:\users\tim.eppdata\local\ben\projectwise\projectwise\workingdir\wpm-pw-bentley.com-wpm-pw-01\tewing@walterpmoore.com\dms47257\CCCG-22.dgn

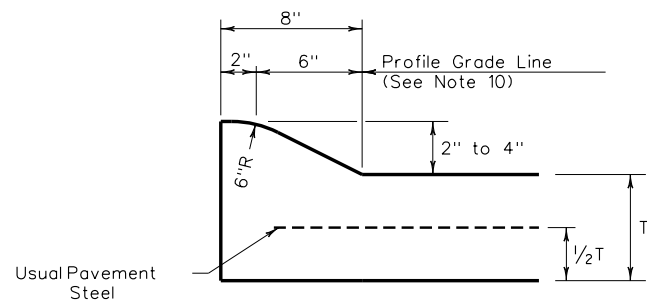


TYPE I CURB (MONOLITHIC)
 2" - 4" HEIGHT

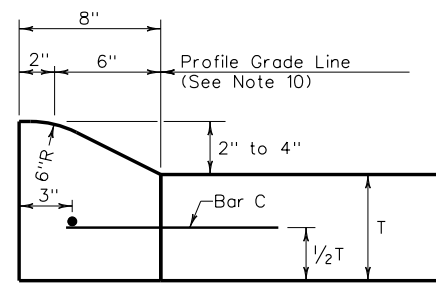


TYPE I CURB
 2" - 4" HEIGHT

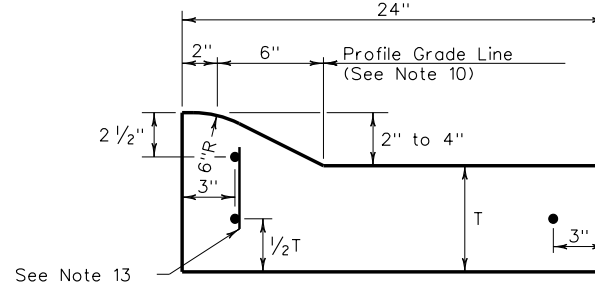


TYPE I CURB AND GUTTER
 2" - 4" HEIGHT

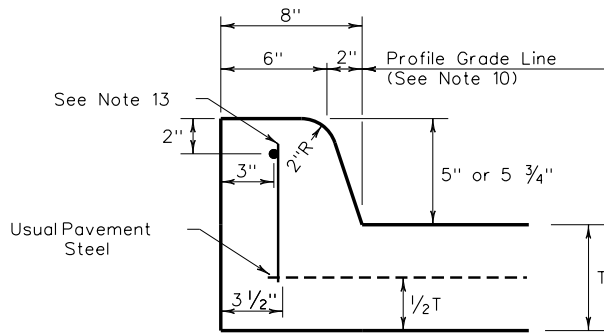


TYPE II CURB (MONOLITHIC)
 5" - 5 3/4" HEIGHT

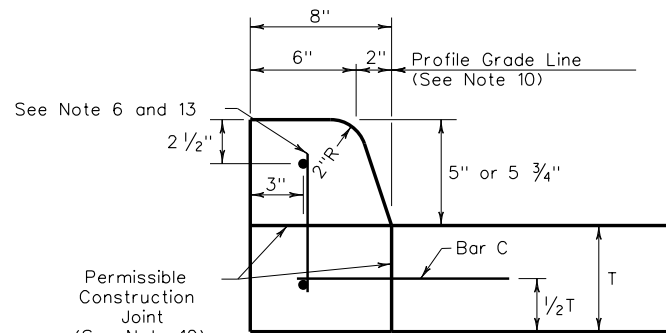


TYPE II CURB
 5" - 5 3/4" HEIGHT

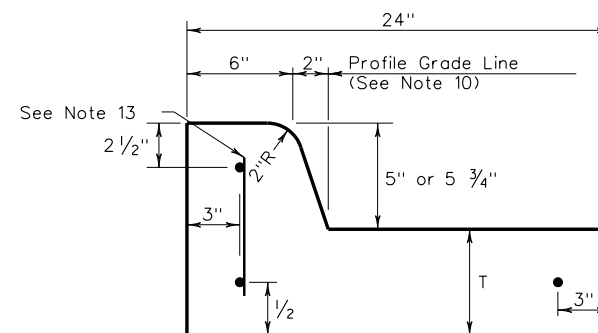


TYPE II CURB AND GUTTER
 5" - 5 3/4" HEIGHT

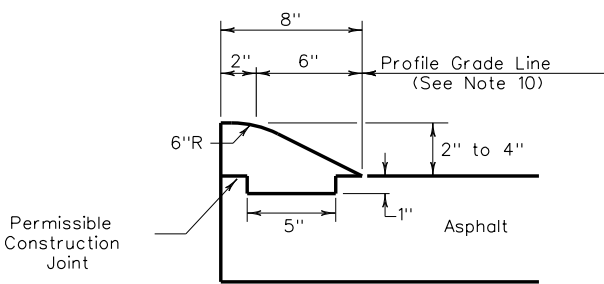


TYPE III CURB (KEYED)
 2" - 4" HEIGHT

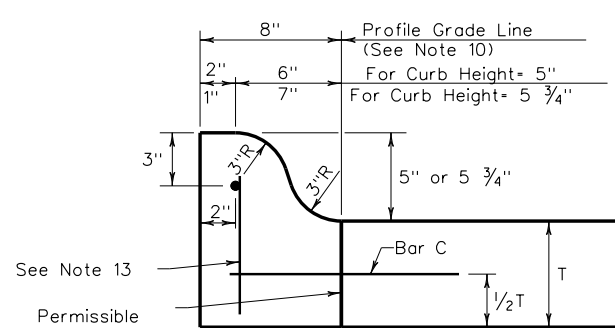


TYPE IIa CURB
 5" - 5 3/4" HEIGHT

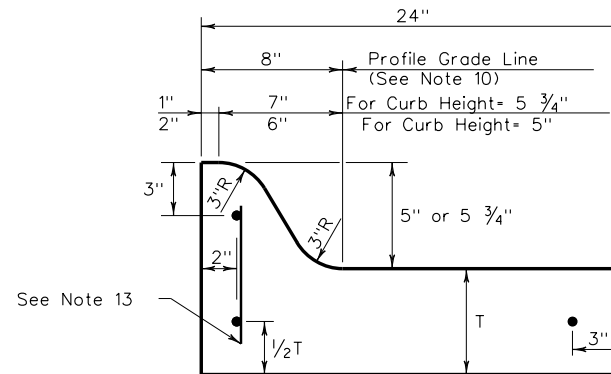


TYPE IIa CURB AND GUTTER
 5" - 5 3/4" HEIGHT

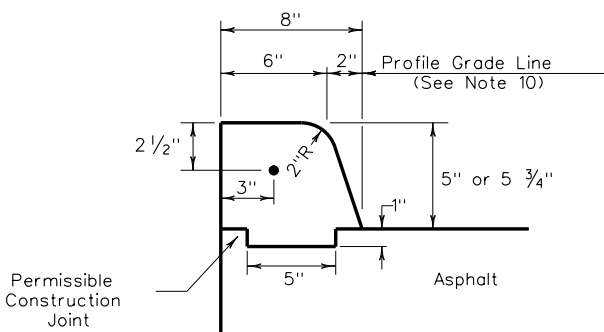

TYPE IV CURB (KEYED)
 5" - 5 3/4" HEIGHT

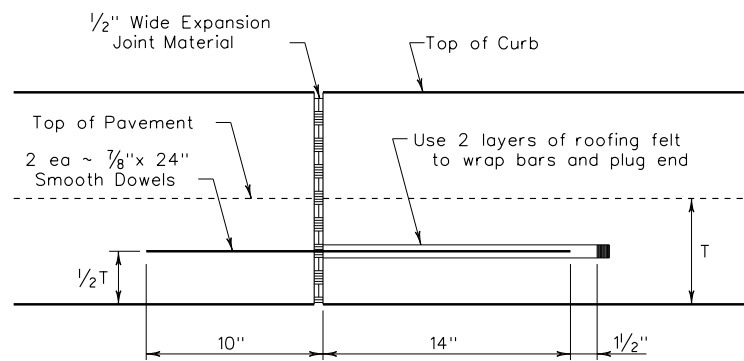

EXPANSION JOINT DETAIL

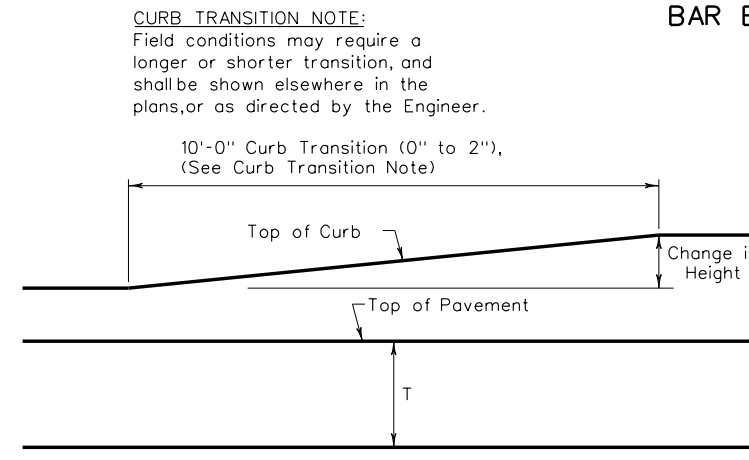


CURB TRANSITION

Note: To be paid for as Highest Curb

GENERAL NOTES

- All materials and construction shall be in accordance with Item 529, "Concrete Curb, Gutter, and Combined Curb and Gutter."
- Concrete shall be Class A.
- When reinforcing bars are used, they shall be No.4 unless otherwise shown. The use of fiber reinforced concrete in lieu of reinforcing steel is acceptable. Use fibers meeting the requirements of DMS 4550, "Fibers for Concrete," and dose fibers in accordance with Material Producers List (MPL) "Fibers for Class A and B Concrete Applications."
- Round exposed sharp edges with a rounding tool, to a minimum radius of 1/4 inch.
- All existing curbs and driveways to be removed shall be sawed or removed at existing joints.
- Where concrete curb is to be placed on existing concrete pavement, Bar B may be drilled and grouted in place, or may be inserted into fresh concrete.
- Expansion and contraction joints shall be constructed to match pavement joints in all curbs and curb and gutter adjacent to jointed concrete pavement. Where placement of curb or curb and gutter is not adjacent to concrete pavement, expansion joints shall be provided at structures, curb returns at streets, and at locations directed by The Engineer.
- Vertical and horizontal dowel bars and transverse reinforcing bars shall be placed at four feet C-C.
- Dimension 'T' shown is the thickness of concrete pavement. When curb is installed adjacent to flexible pavement dimension 'T' is 8" maximum.
- Usual profile grade line. Refer to typical sections and plan-profile sheets for exact locations.
- One-half inch expansion joint material shall be provided where curb or curb and gutter is adjacent to sidewalk or riprap.
- When horizontal permissible construction joints are used, the longitudinal pavement steel shall be placed in accordance with pavement details shown elsewhere in the plans. Reinforcing steel for curb section shall then conform to that required for concrete curb.
- Bar B placement as needed (typically at four ft. C-C) to support curb reinforcing steel during concrete placement.

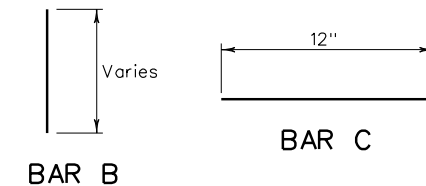

BAR B












BAR C

CURB TRANSITION NOTE:
 Field conditions may require a longer or shorter transition, and shall be shown elsewhere in the plans, or as directed by the Engineer.

				Design Division Standard	
CONCRETE CURB AND GUTTER					
CCCG-22					
FILE: cccg21.dgn	DN: TxDOT	CK: AN	DW: CS	CK: KM	
© TxDOT: JUNE 2022	CONT	SECT	JOB	HIGHWAY	
REVISIONS	0164	03	056	SH 31	
	DIST	COUNTY	SHEET NO.		
	TYL	HENDERSON	55		

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023
 FILE: ct:\users\tim_appdata\local\bentley\projectwise_workingdir\wpm-pw-bentley.com-wpm-pw-01\tewing@walterpmoore.com\dms47257\PED-18_01.dgn

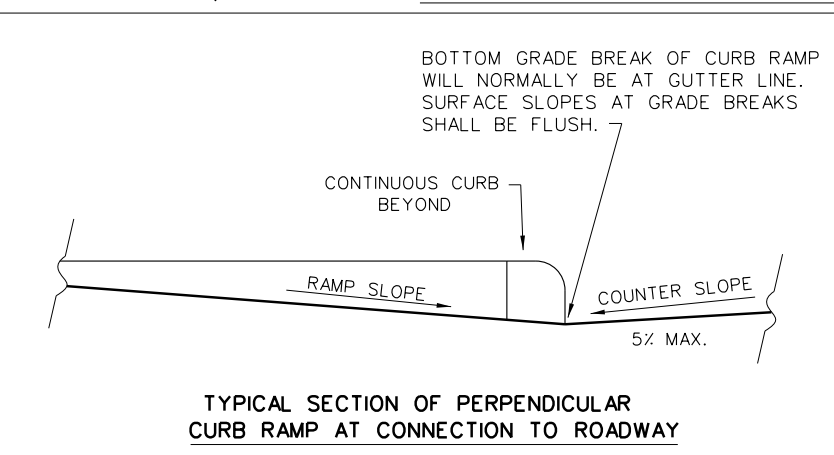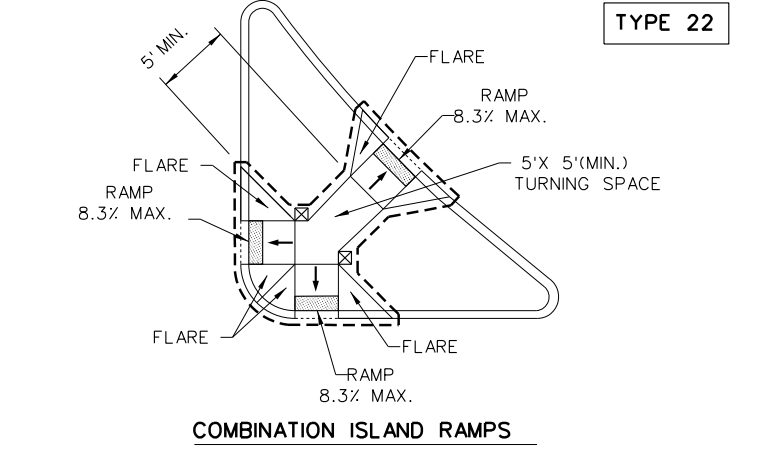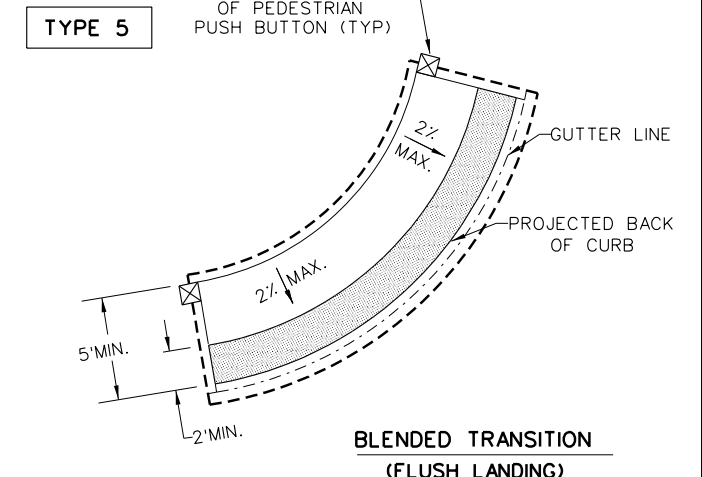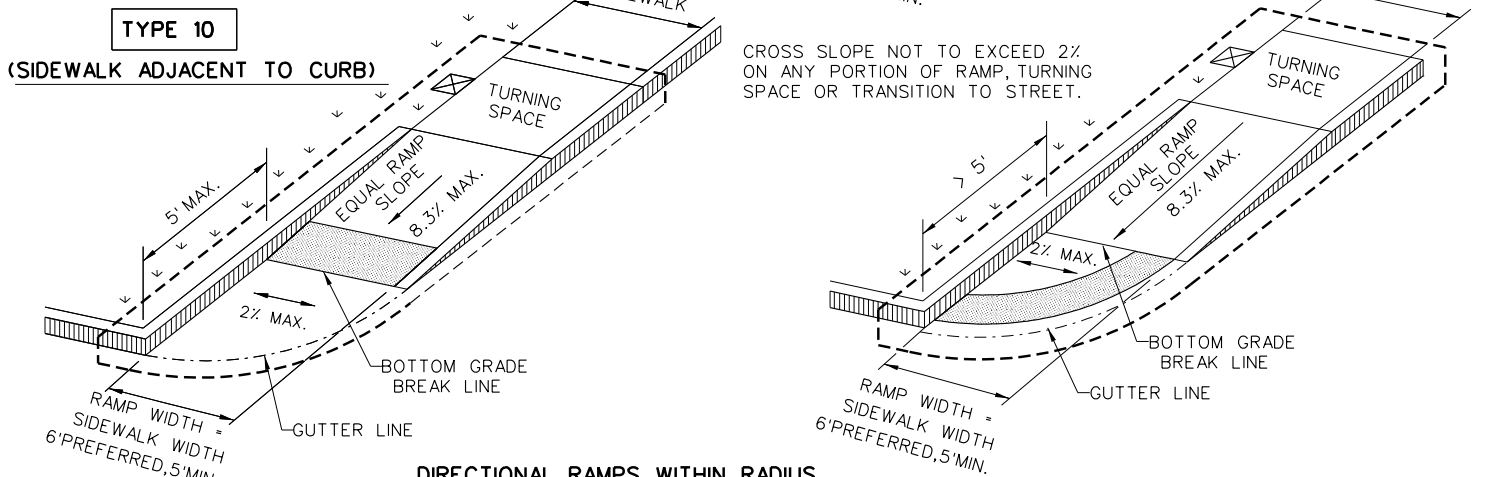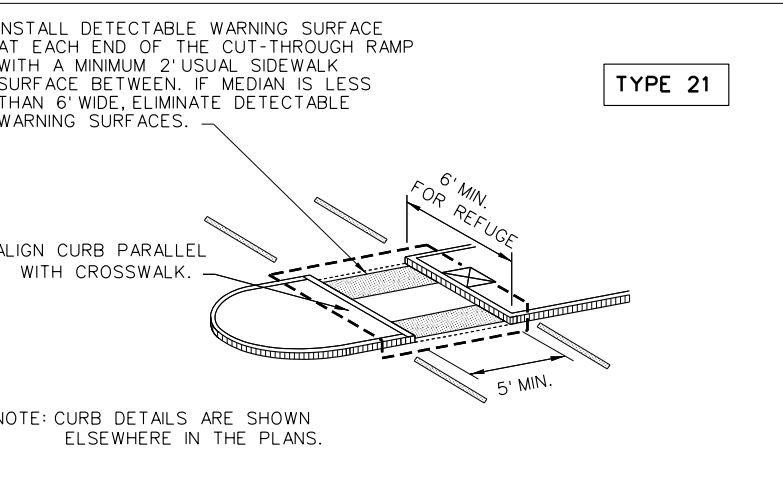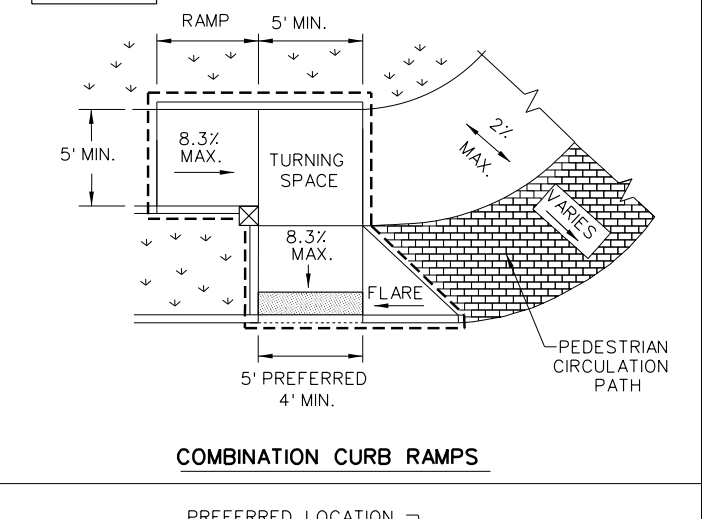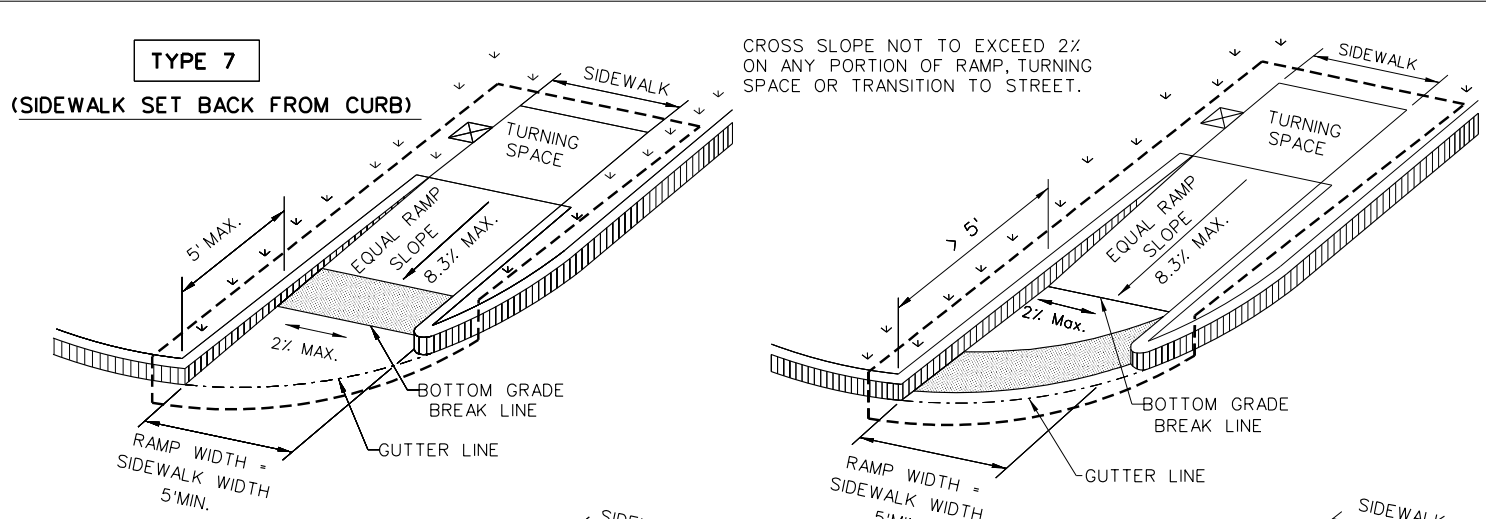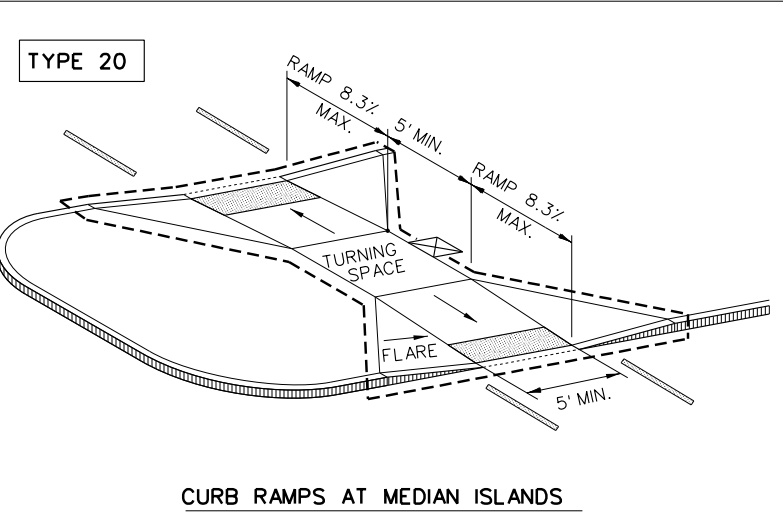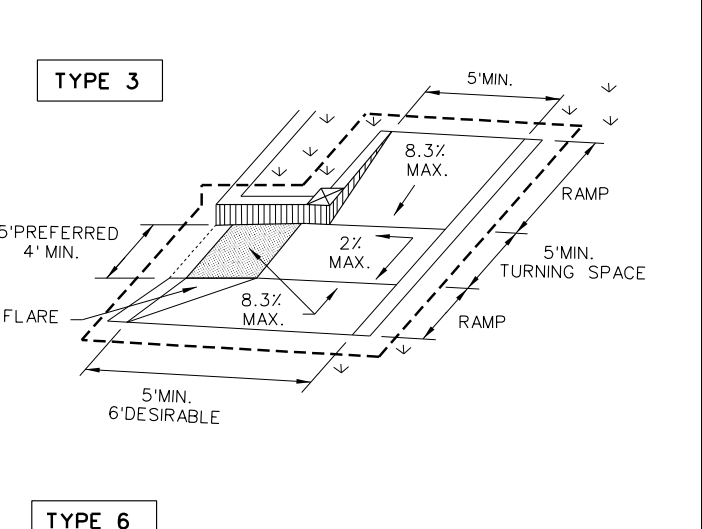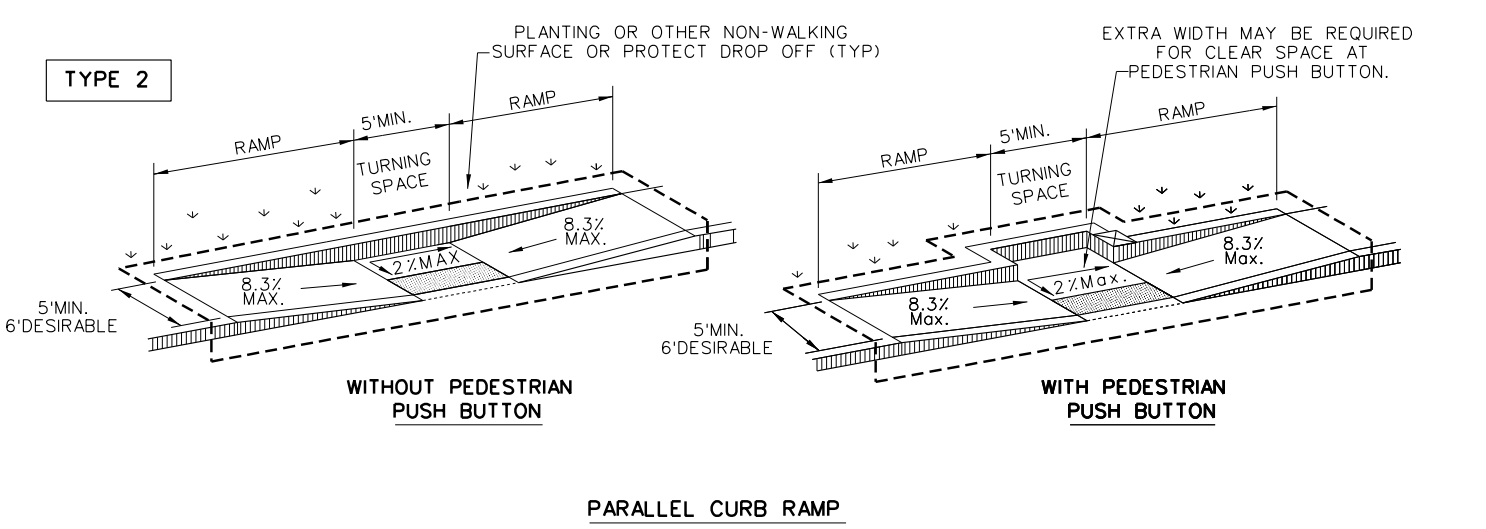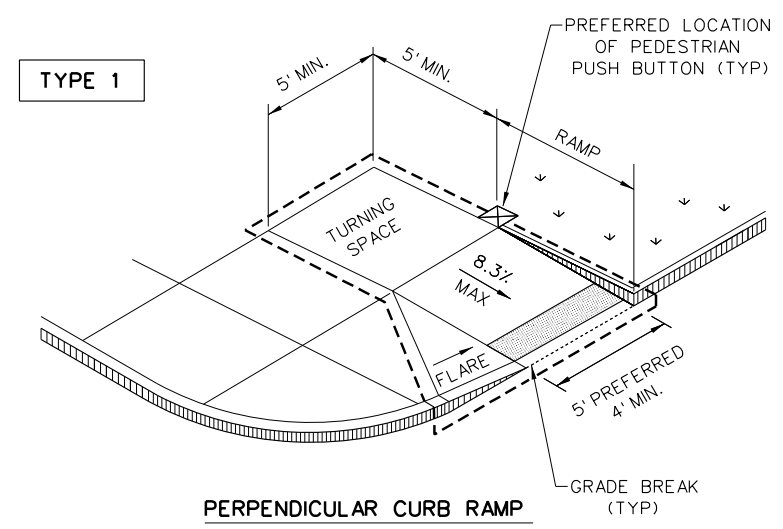

NOTES / LEGEND:
 SEE GENERAL NOTES ON SHEET 2 OF 4 FOR MORE INFORMATION.

DENOTES PLANTING OR NON-WALKING SURFACE NOT PART OF PEDESTRIAN CIRCULATION PATH.

DENOTES PREFERRED LOCATION OF PEDESTRIAN PUSH BUTTON IF APPLICABLE.

Detectable Warning Surface: [Symbol]

Grade Break: [Symbol]

Ramp Limits of Payment: [Symbol]

Gutter Line: [Symbol]

SHEET 1 OF 4

Design Division Standard

PEDESTRIAN FACILITIES CURB RAMPS

PED-18

FILE: ped18	DN: TxDOT	DW: VP	CK: KM	CK: PK & JG
© TxDOT: MARCH, 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
REVISED 08, 2005	DIST	COUNTY	SHEET NO.	
REVISED 06, 2012	TYL	HENDERSON	56	
REVISED 01, 2018				

GENERAL NOTES

CURB RAMPS

1. Install a curb ramp or blended transition at each pedestrian street crossing.
2. All slopes shown are maximum allowable. Cross slopes of 1.5% and lesser running should be used. Adjust curb ramp length or grade of approach sidewalks as directed.
3. Maximum allowable cross slope on sidewalk and curb ramp surfaces is 2%.
4. The minimum sidewalk width is 5'. Where the sidewalk is adjacent to the back of curb, a 6' sidewalk width is desirable. Where a 5' sidewalk cannot be provided due to site constraints, sidewalk width may be reduced to 4' for short distances. 5' x 5' passing areas at intervals not to exceed 200' are required.
5. Turning Spaces shall be 5' x 5' minimum. Cross slope shall be maximum 2%.
6. Clear space at the bottom of curb ramps shall be a minimum of 4' x 4' wholly contained within the crosswalk and wholly outside the parallel vehicular travel path.
7. Provide flared sides where the pedestrian circulation path crosses the curb ramp. Flared sides shall be sloped at 10% maximum, measured parallel to the curb. Returned curbs may be used only where pedestrians would not normally walk across the ramp, either because the adjacent surface is planted, substantially obstructed, or otherwise protected.
8. Additional information on curb ramp location, design, light reflective value and texture may be found in the latest draft of the Proposed Guidelines for Pedestrian Facilities in the Public Right of Way (PROWAG) as published by the U.S. Architectural and Transportation Barriers Compliance Board (Access Board).
9. To serve as a pedestrian refuge area, the median should be a minimum of 6' wide, measured from back of curbs. Medians should be designed to provide accessible passage over or through them.
10. Small channelization islands, which do not provide a minimum 5' x 5' landing at the top of curb ramps, shall be cut through level with the surface of the street.
11. Crosswalk dimensions, crosswalk markings and stop bar locations shall be as shown elsewhere in the plans. At intersections where crosswalk markings are not required, curb ramps shall align with theoretical crosswalks unless otherwise directed.
12. Provide curb ramps to connect the pedestrian access route at each pedestrian street crossing. Handrails are not required on curb ramps.
13. Curb ramps and landings shall be constructed and paid for in accordance with Item 531 "Sidewalks".
14. Place concrete at a minimum depth of 5" for ramps, flares and landings, unless otherwise directed.
15. Furnish and install No. 3 reinforcing steel bars at 18" o.c. both ways, unless otherwise directed.
16. Provide a smooth transition where the curb ramps connect to the street.
17. Curbs shown on sheet 1 within the limits of payment are considered part of the curb ramp for payment, whether it is concrete curb, gutter, or combined curb and gutter.
18. Existing features that comply with applicable standards may remain in place unless otherwise shown on the plans.

DETECTABLE WARNING MATERIAL


19. Curb ramps must contain a detectable warning surface that consists of raised truncated domes complying with PROWAG. The surface must contrast visually with adjoining surfaces, including side flares. Furnish and install an approved cast-in-place dark brown or dark red detectable warning surface material adjacent to uncolored concrete, unless specified elsewhere in the plans.
20. Detectable Warning Materials must meet TxDOT Departmental Materials Specification DMS 4350 and be listed on the Material Producer List. Install products in accordance with manufacturer's specifications.
21. Detectable warning surfaces must be firm, stable and slip resistant.
22. Detectable warning surfaces shall be a minimum of 24 inches in depth in the direction of pedestrian travel, and extend the full width of the curb ramp or landing where the pedestrian access route enters the street.
23. Detectable warning surfaces shall be located so that the edge nearest the curb line is at the back of curb and neither end of that edge is greater than 5 feet from the back of curb. Detectable warning surfaces may be curved along the corner radius.
24. Shaded areas on Sheet 1 of 4 indicate the approximate location for the detectable warning surface for each curb ramp type.

DETECTABLE WARNING PAVERS (IF USED)

25. Furnish detectable warning paver units meeting all requirements of ASTM C-936, C-33. Lay in a two by two unit basket weave pattern or as directed.
26. Lay full-size units first followed by closure units consisting of at least 25 percent (25%) of a full unit. Cut detectable warning paver units using a power saw.


SIDEWALKS

27. Provide clear ground space at operable parts, including pedestrian push buttons. Operable parts shall be placed within unobstructed reach range specified in PROWAG section R406.
28. Place traffic signal or illumination poles, ground boxes, controller boxes, signs, drainage facilities and other items so as not to obstruct the pedestrian access route or clear ground space.
29. Street grades and cross slopes shall be as shown elsewhere in the plans.
30. Changes in level greater than 1/4 inch are not permitted.
31. The least possible grade should be used to maximize accessibility. The running slope of sidewalks and crosswalks within the public right of way may follow the grade of the parallel roadway. Where a continuous grade greater than five percent (5%) must be provided, handrails may be desirable to improve accessibility. Handrails may also be needed to protect pedestrians from potentially hazardous conditions. If provided, handrails shall comply with PROWAG R409.
32. Handrail extensions shall not protrude into the usable landing area or into intersecting pedestrian routes.
33. Driveways and turnouts shall be constructed and paid for in accordance with Item "Intersections, Driveways and Turnouts". Sidewalks shall be constructed and paid for in accordance with Item, "Sidewalks".
34. Sidewalk details are shown elsewhere in the plans.

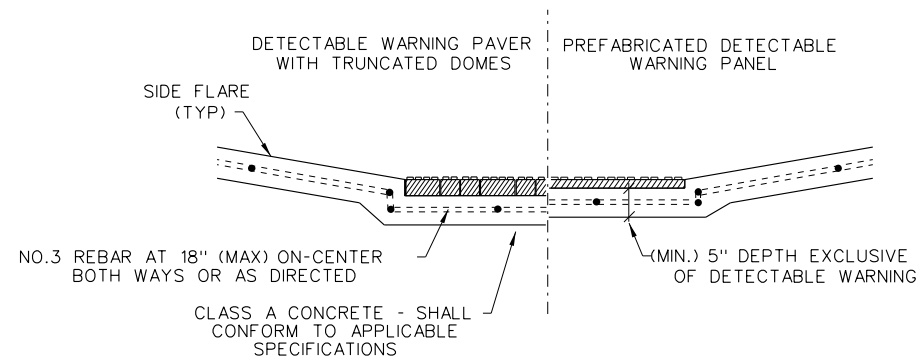


**SECTION VIEW DETAIL
CURB RAMP AT DETECTIBLE WARNINGS**


DETECTABLE WARNING SURFACE DETAILS

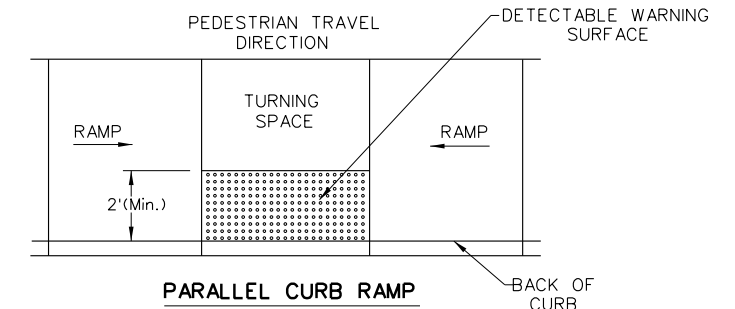

**PARALLEL CURB RAMP
TYPICAL PLACEMENT OF DETECTABLE WARNING SURFACE ON LANDING AT STREET EDGE.**

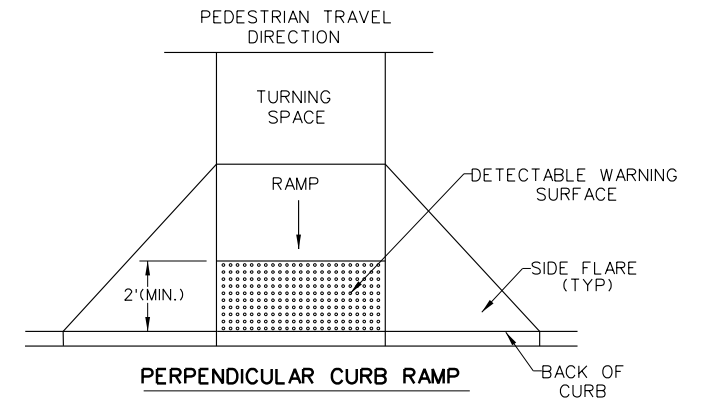

**PERPENDICULAR CURB RAMP
TYPICAL PLACEMENT OF DETECTABLE WARNING SURFACE ON SLOPING RAMP RUN.**

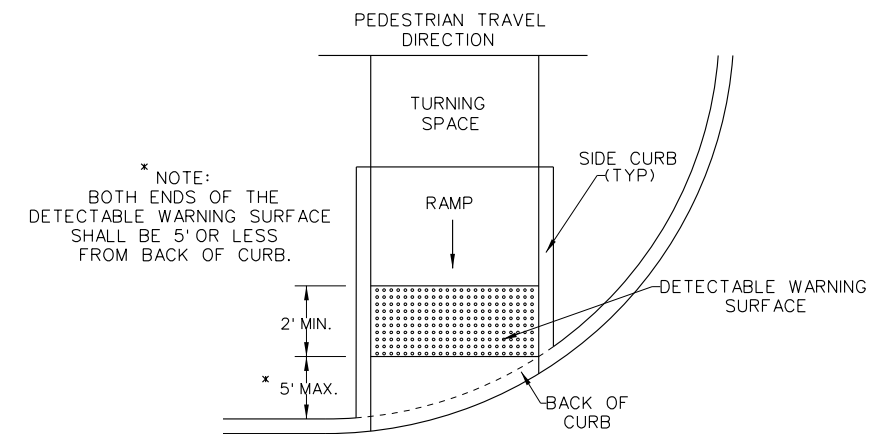

* NOTE:
BOTH ENDS OF THE
DETECTABLE WARNING SURFACE
SHALL BE 5' OR LESS
FROM BACK OF CURB.

DIRECTIONAL CURB RAMP

TYPICAL PLACEMENT OF DETECTABLE WARNING SURFACE ON SLOPING RAMP RUN.





SHEET 2 OF 4

		Design Division Standard	
PEDESTRIAN FACILITIES CURB RAMPS			
PED-18			
FILE: ped18	DN: TxDOT	DW: VP	CK: KM
© TxDOT: MARCH, 2002	CONT: 0164	SECT: 03	JOB: 056
REVISIONS	DIST: COUNTY		HIGHWAY: SH 31
REVISED 08, 2005	TYL HENDERSON		SHEET NO. 57
REVISED 06, 2012			
REVISED 01, 2018			

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE: 7/17/2023
 FILE: c:\users\tim\AppData\Local\Bentley\ProjectWise\workingdir\wpm-pw-bentley.com-wpm-pw-01\tewing@waltermoore.com\dms47257\PED-18_021.dgn

SIDEWALK TREATMENT AT DRIVEWAYS

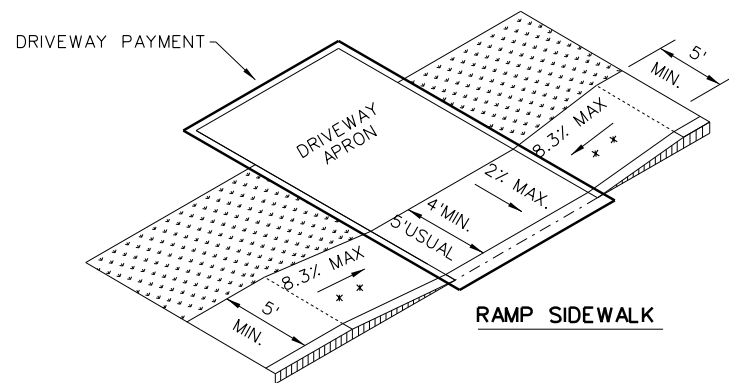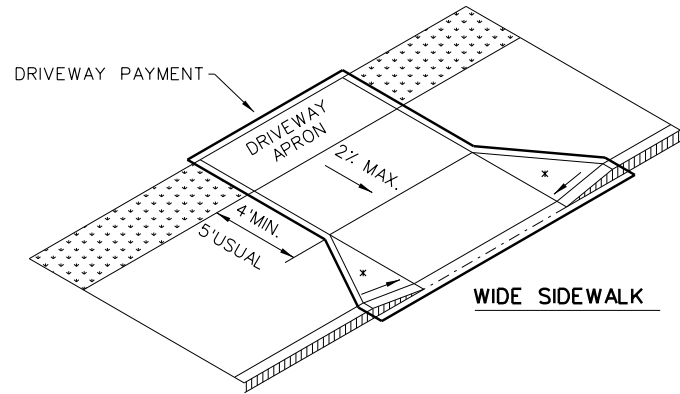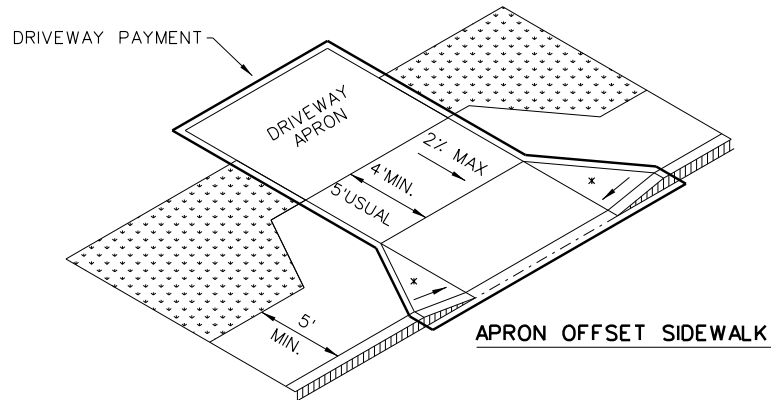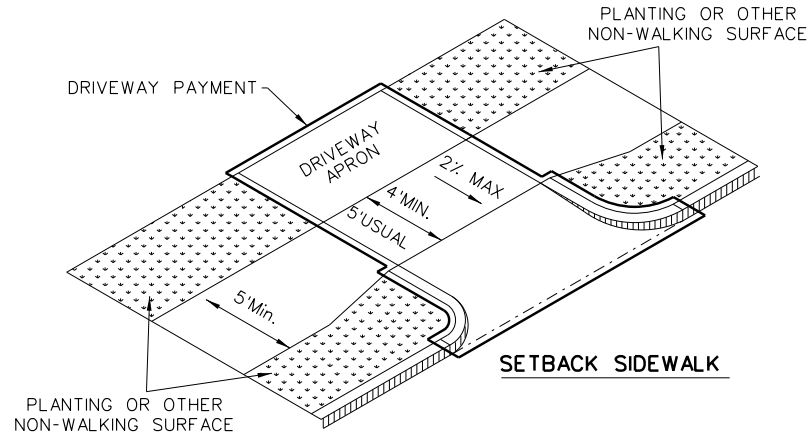


NOTES:

- * WHERE DRIVEWAYS CROSS THE PEDESTRIAN ROUTE, SIDES SHALL BE FLARED AT 10% MAX SLOPE.
- * * IF CURB HEIGHT IS GREATER THAN 6 INCHES, USE GRADE LESS THAN OR EQUAL TO 5%. HANDRAIL AND DETECTABLE WARNING ARE NOT REQUIRED.

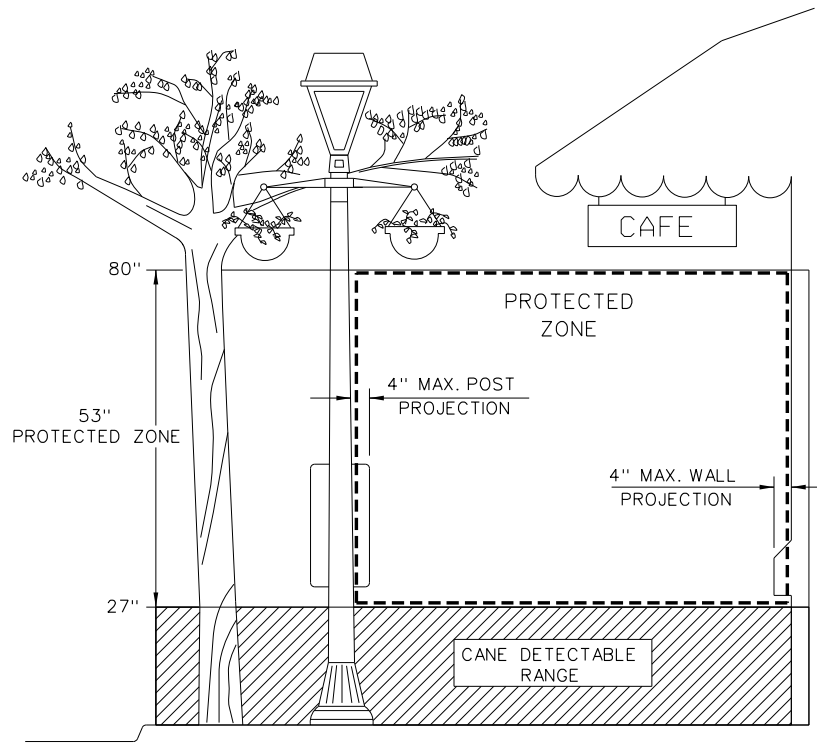


PROTECTED ZONE

NOTE: IN PEDESTRIAN CIRCULATION AREA, MAXIMUM 4" PROJECTION FOR POST OR WALL MOUNTED OBJECTS BETWEEN 27" AND 80" ABOVE THE SURFACE.

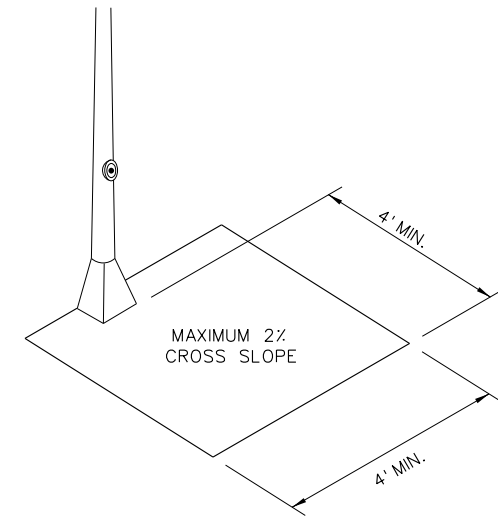


CLEAR SPACE ADJACENT TO PEDESTRIAN PUSH BUTTON

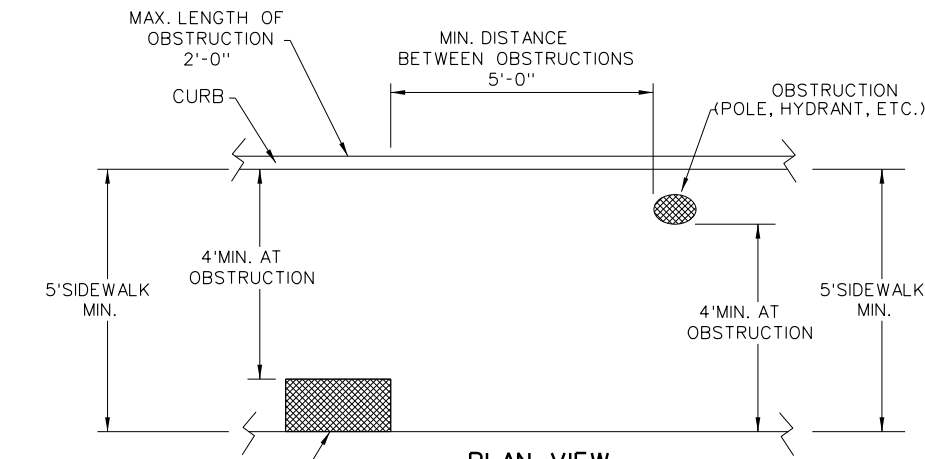

PLACEMENT OF STREET FIXTURES

NOTE: ITEMS NOT INTENDED FOR PUBLIC USE. MINIMUM 4' X 4' CLEAR GROUND SPACE REQUIRED AT PUBLIC USE FIXTURES.

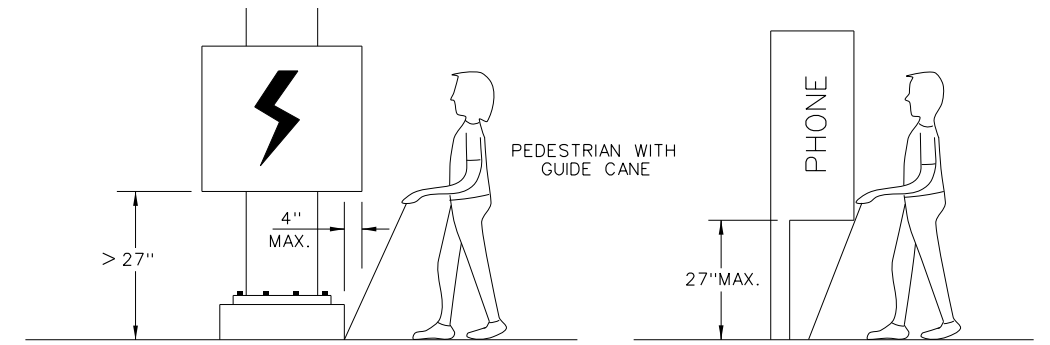

WHEN AN OBSTRUCTION OF A HEIGHT GREATER THAN 27" FROM THE SURFACE WOULD CREATE A PROTRUSION OF MORE THAN 4" INTO THE PEDESTRIAN CIRCULATION AREA, CONSTRUCT ADDITIONAL CURB OR FOUNDATION AT THE BOTTOM TO PROVIDE A MAXIMUM 4" OVERHANG.

PROTRUDING OBJECTS OF A HEIGHT \leq 27" ARE DETECTABLE BY CANE AND DO NOT REQUIRE ADDITIONAL TREATMENT.

DETECTION BARRIER FOR VERTICAL CLEARANCE < 80"


SHEET 3 OF 4

		Design Division Standard	
PEDESTRIAN FACILITIES CURB RAMPS PED-18			
FILE: ped18	DN: TxDOT	DW: VP	CK: KM
© TxDOT: MARCH, 2002	CONT: 0164	SECT: 03	JOB: 056
REVISIONS	DIST: COUNTY		SHEET NO.
REVISED 08, 2005	TYL		HENDERSON
REVISED 06, 2012			58
REVISED 01, 2018			


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023
 FILE: ct:\users\time\appdata\local\bentley\projectwise\workingdir\wpm-pw.bentley.com\wpm-pw-01\tewing@walterpmoore.com\dms47257\PED-18 (03).dgn


TYPICAL CROSSING LAYOUTS
SEE SHEET 1 OF 4 FOR DETAILS AND DIMENSIONS

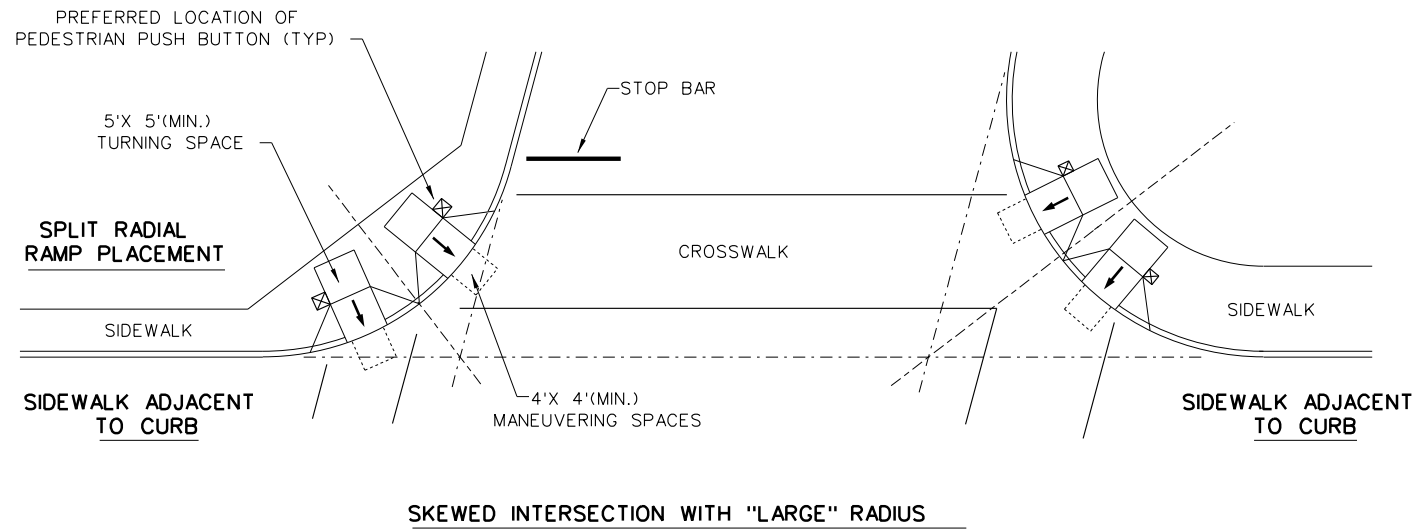



SKewed INTERSECTION WITH "LARGE" RADIUS

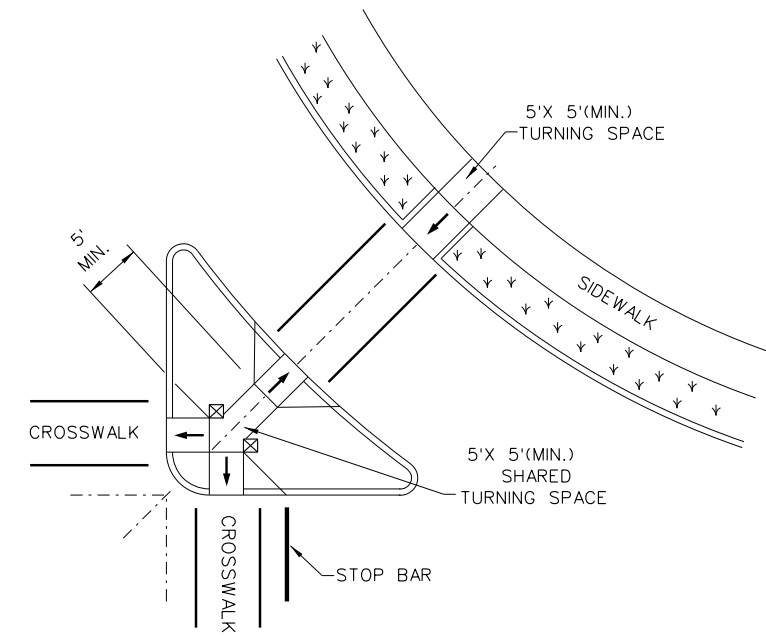


AT INTERSECTION
W/FREE RIGHT TURN & ISLAND

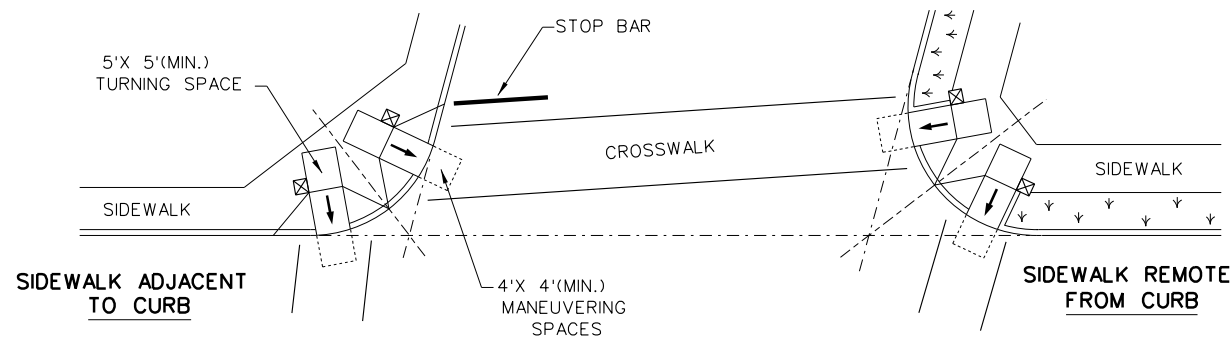

SKewed INTERSECTION WITH "SMALL" RADIUS

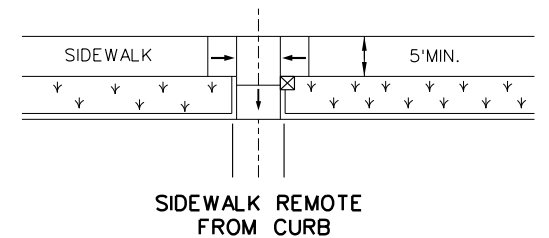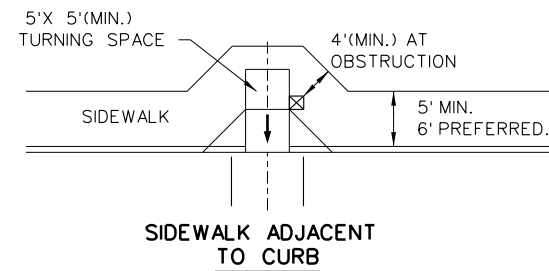

MID-BLOCK PLACEMENT
PERPENDICULAR RAMPS

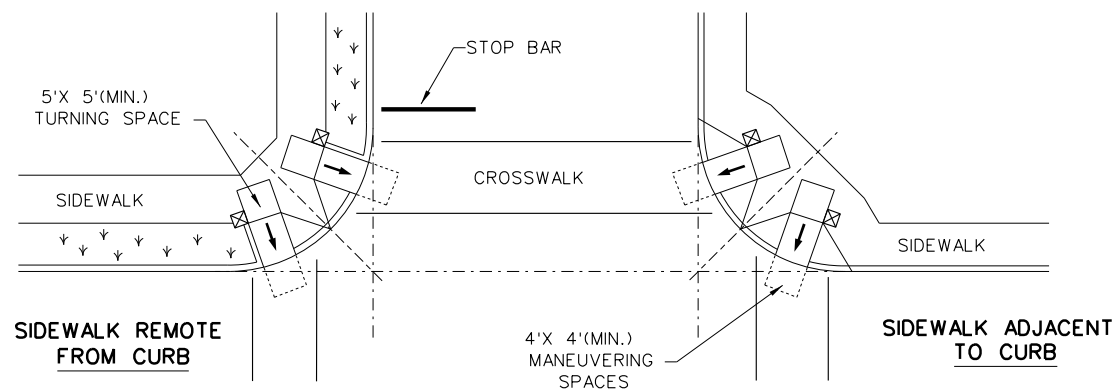

NORMAL INTERSECTION WITH "SMALL" RADIUS

LEGEND:

SHOWS DOWNWARD SLOPE. →

DENOTES PREFERRED LOCATION OF PEDESTRIAN PUSH BUTTON (IF APPLICABLE). ☒

DENOTES PLANTING OR NON-WALKING SURFACE NOT PART OF PEDESTRIAN CIRCULATION PATH. ↙ ↘ ↙ ↘ ↙ ↘

SHEET 4 OF 4



PEDESTRIAN FACILITIES
CURB RAMPS

PED-18




FILE: ped18	DN: TxDOT	DW: VP	CK: KM	CK: PK & JG
© TxDOT: MARCH, 2002	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
REVISED 08, 2005	DIST	COUNTY	SHEET NO.	
REVISED 06, 2012	TYL	HENDERSON	59	
REVISED 01, 2018				

DISCLAIMER:
The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023
FILE: c:\users\tim.eppdata\local\ben.tiley\projectwise\workingdir\wpm-pw.bentley.com_wpm-pw-01\tewing@walterpmoore.com\dms47257\PED-18 (04).dgn

REQUIREMENTS FOR INDEPENDENT MOUNTED ROUTE SIGNS



SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	WHITE	TYPE A SHEETING
BACKGROUND	ALL OTHERS	TYPE B OR C SHEETING
LEGEND & BORDERS	WHITE	TYPE A SHEETING
LEGEND & BORDERS	BLACK	ACRYLIC NON-REFLECTIVE FILM
LEGEND & BORDERS	ALL OTHERS	TYPE B OR C SHEETING

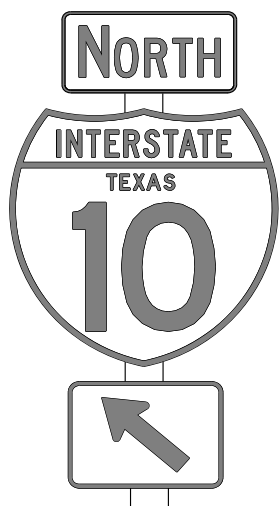


TYPICAL EXAMPLES

REQUIREMENTS FOR BLUE, BROWN & GREEN D AND I SERIES GUIDE SIGNS

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	ALL	TYPE B OR C SHEETING
LEGEND & BORDERS	WHITE	TYPE D SHEETING
LEGEND, SYMBOLS & BORDERS	ALL OTHERS	TYPE B OR C SHEETING

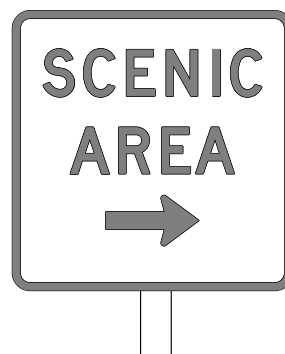

TYPICAL EXAMPLES

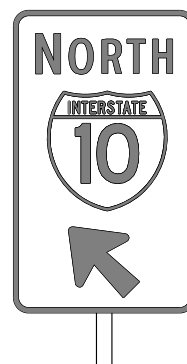

GENERAL NOTES

- Signs to be furnished shall be as detailed elsewhere in the plans and/or as shown on sign tabulation sheet. Standard sign designs and arrow dimensions can be found in the "Standard Highway Sign Designs for Texas" (SHSD).
- White legend shall use the Clearview Alphabet. The following Clearview fonts shall be used to replace the existing white Federal Highway Administration (FHWA) Standard Highway Alphabets, when not specified in the SHSD, or in the plans.

B	CV-1W
C	CV-2W
D	CV-3W
E	CV-4W
Emod	CV-5WR
F	CV-6W
- Route sign legend (ie. IH, US, SH and FM shields) shall use the Federal Highway Administration (FHWA) Standard Highway Alphabets B, C, D, E, Emod or F).
- Lateral spacing between letters and numerals shall conform with the SHSD, and any approved changes thereto. Lateral spacing of legend shall provide a balanced appearance when spacing is not shown.
- Independent mounted route sign with white or colored legend and borders shall be applied by screening process with transparent color ink, transparent colored overlay film to white background sheeting or cut-out white sheeting to colored background sheeting, or combination thereof. White legend, symbols and borders on all other signs shall be cut-out white sheeting applied to colored background sheeting.
- Information regarding borders and radii for signs is found in the "Standard Highway Sign Designs for Texas". Dimensions shown and described for borders and corner radii on parent sign are nominal. Borders may vary in width as much as 1/2 inch. Corner radii above 3 inches may vary in width as much as 1 inch. Borders and corner radii within a parent sign must be of matching widths. The sign area outside the corner radius should be trimmed or rounded.
- Sign substrate shall be any material that meets the Departmental Material Specification requirements of DMS-7110 or approved alternative.
- Mounting details of roadside signs are shown in the "SMD series" Standard Plan Sheets.

DEPARTMENTAL MATERIAL SPECIFICATIONS	
ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

ALUMINUM SIGN BLANKS THICKNESS	
Square Feet	Minimum Thickness
Less than 7.5	0.080
7.5 to 15	0.100
Greater than 15	0.125

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website:
<http://www.txdot.gov/>

Texas Department of Transportation
Traffic Operations Division Standard

TYPICAL SIGN REQUIREMENTS

TSR(3)-13

FILE: tsr3-13.dgn	DW: TxDOT	CK: TxDOT	DW: TxDOT	CK: TxDOT
©TxDOT October 2003	CONT	SECT	JOB	HIGHWAY
REVISIONS	0164	03	056	SH 31
12-03 7-13	DIST	COUNTY		SHEET NO.
9-08	TYL	HENDERSON		60

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to metric units. This standard is not to be used for the design of signs or signposts.


DATE: 7/17/2023 6:55:30 AM
FILE: c:\users\time\AppData\Local\Bentley\Projectwise\workingdir\pwm-pw.bentley.com\pwm-pw.bentley.com\projectwise\workingdir\pwm-pw.bentley.com\pwm-pw.bentley.com\projectwise\workingdir\pwm-pw.bentley.com\pwm-pw.bentley.com

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or the accuracy of the information contained herein.

DATE: 7/17/2023 6:55:31 AM
 FILE: c:\users\time\AppData\Local\Bentley\Projectwise\workingdir\pwm-pw.bentley.com\projects\2023\07\17\2023\tsr4-13.dgn

REQUIREMENTS FOR RED BACKGROUND REGULATORY SIGNS

(STOP, YIELD, DO NOT ENTER AND WRONG WAY SIGNS)

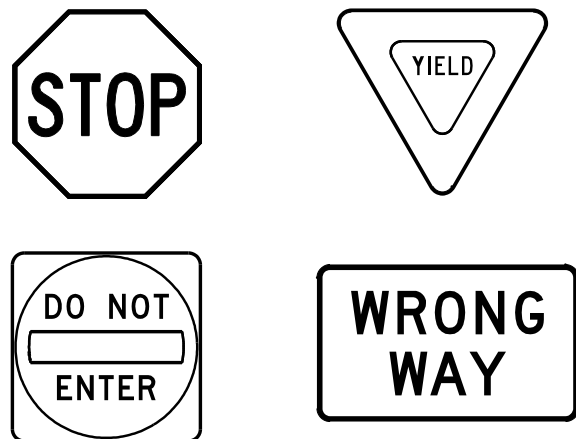

REQUIREMENTS FOR FOUR SPECIFIC SIGNS ONLY

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	RED	TYPE B OR C SHEETING
BACKGROUND	WHITE	TYPE B OR C SHEETING
LEGEND & BORDERS	WHITE	TYPE B OR C SHEETING
LEGEND	RED	TYPE B OR C SHEETING

REQUIREMENTS FOR WHITE BACKGROUND REGULATORY SIGNS


(EXCLUDING STOP, YIELD, DO NOT ENTER AND WRONG WAY SIGNS)



TYPICAL EXAMPLES

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	WHITE	TYPE A SHEETING
BACKGROUND	ALL OTHERS	TYPE B OR C SHEETING
LEGEND, BORDERS AND SYMBOLS	BLACK	ACRYLIC NON-REFLECTIVE FILM
LEGEND, BORDERS AND SYMBOLS	ALL OTHER	TYPE B OR C SHEETING

REQUIREMENTS FOR WARNING SIGNS

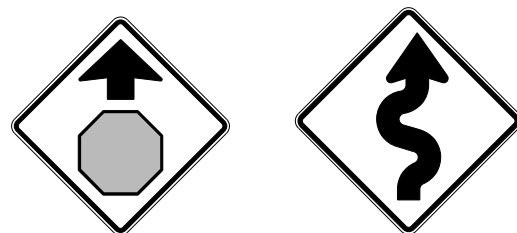

TYPICAL EXAMPLES

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	FLOURESCENT YELLOW	TYPE B _{FL} OR C _{FL} SHEETING
LEGEND & BORDERS	BLACK	ACRYLIC NON-REFLECTIVE FILM
LEGEND & SYMBOLS	ALL OTHER	TYPE B OR C SHEETING

REQUIREMENTS FOR SCHOOL SIGNS



TYPICAL EXAMPLES

SHEETING REQUIREMENTS		
USAGE	COLOR	SIGN FACE MATERIAL
BACKGROUND	WHITE	TYPE A SHEETING
BACKGROUND	FLOURESCENT YELLOW GREEN	TYPE B _{FL} OR C _{FL} SHEETING
LEGEND, BORDERS AND SYMBOLS	BLACK	ACRYLIC NON-REFLECTIVE FILM
SYMBOLS	RED	TYPE B OR C SHEETING

GENERAL NOTES

- Signs to be furnished shall be as detailed elsewhere in the plans and/or as shown on sign tabulation sheet. Standard sign designs and arrow dimensions can be found in the "Standard Highway Sign Designs for Texas" (SHSD).
- Sign legend shall use the Federal Highway Administration (FHWA) Standard Highway Alphabets (B, C, D, E, Emod or F).
- Lateral spacing between letters and numerals shall conform with the SHSD, and any approved changes thereto. Lateral spacing of legend shall provide a balanced appearance when spacing is not shown.
- Black legend and borders shall be applied by screening process or cut-out acrylic non-reflective black film to background sheeting, or combination thereof.
- White legend and borders shall be applied by screening process with transparent colored ink, transparent colored overlay film to white background sheeting or cut-out white sheeting to colored background sheeting, or combination thereof.
- Colored legend shall be applied by screening process with transparent colored ink, transparent colored overlay film or colored sheeting to background sheeting, or combination thereof.
- Sign substrate shall be any material that meets the Departmental Material Specification requirements of DMS-7110 or approved alternative.
- Mounting details for roadside mounted signs are shown in the "SMD series" Standard Plan Sheets.

ALUMINUM SIGN BLANKS THICKNESS

Square Feet	Minimum Thickness
Less than 7.5	0.080
7.5 to 15	0.100
Greater than 15	0.125

DEPARTMENTAL MATERIAL SPECIFICATIONS

ALUMINUM SIGN BLANKS	DMS-7110
SIGN FACE MATERIALS	DMS-8300

The Standard Highway Sign Designs for Texas (SHSD) can be found at the following website.

<http://www.txdot.gov/>




TYPICAL SIGN REQUIREMENTS

TSR(4)-13


FILE:	tsr4-13.dgn	DN:	TxDOT	CK:	TxDOT	DW:	TxDOT	CK:	TxDOT
© TxDOT	October 2003	CONT	SECT	JOB	HIGHWAY				
REVISIONS		0164	03	056	SH 31				
12-03	7-13	DIST	COUNTY			SHEET NO.			
9-08		TYL	HENDERSON			61			

REFLECTIVE RAISED PAVEMENT MARKERS FOR VEHICLE POSITIONING GUIDANCE



DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for the accuracy of the information presented herein.

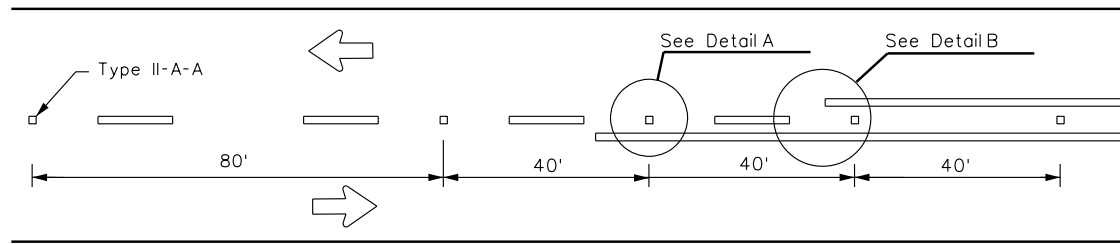


CENTERLINE FOR ALL TWO LANE TWO-WAY ROADWAYS

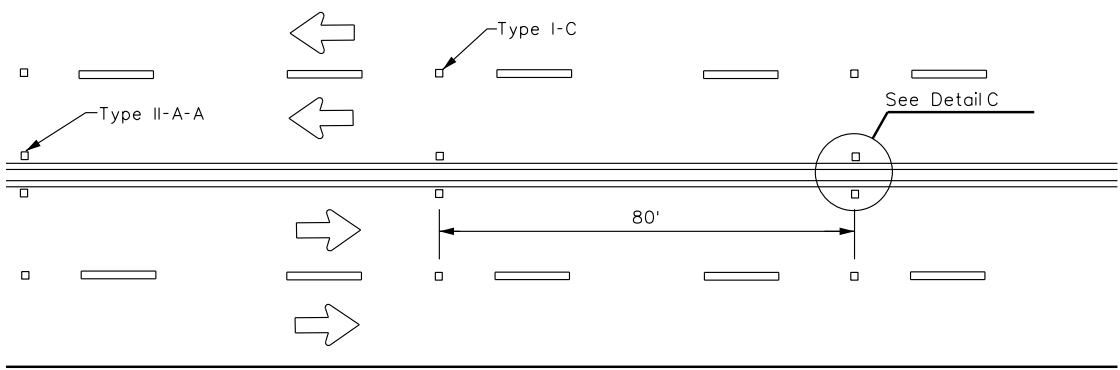

**CENTERLINE & LANE LINES
FOR FOUR LANE TWO-WAY ROADWAYS**

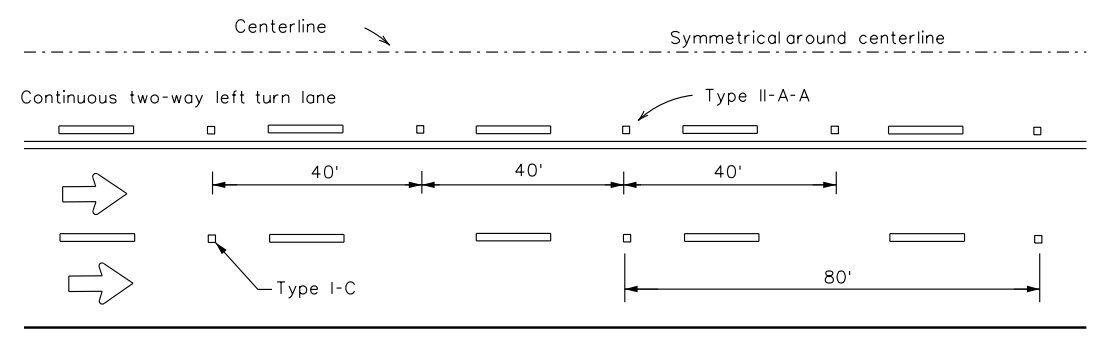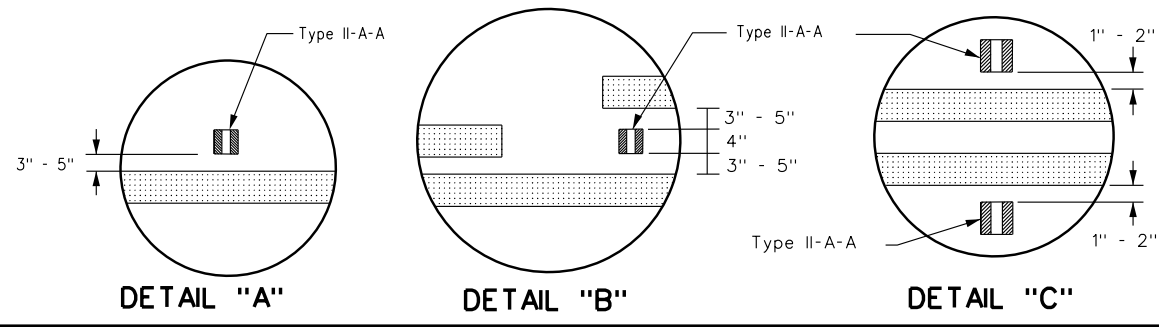

CENTERLINE AND LANE LINES FOR TWO-WAY LEFT TURN LANE

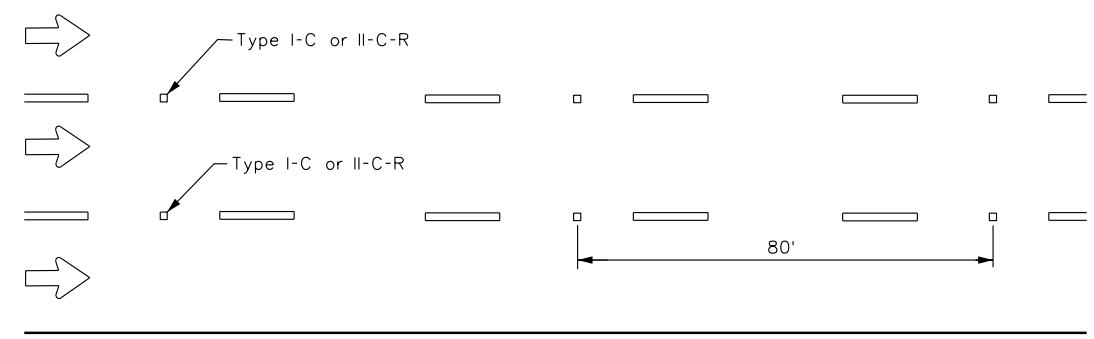


LANE LINES FOR ONE-WAY ROADWAY (NON-FREEWAY FACILITIES)


Raised pavement markers Type II-C-R shall have clear face toward normal traffic and red face toward wrong-way traffic.
 See Note 3.

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240


All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

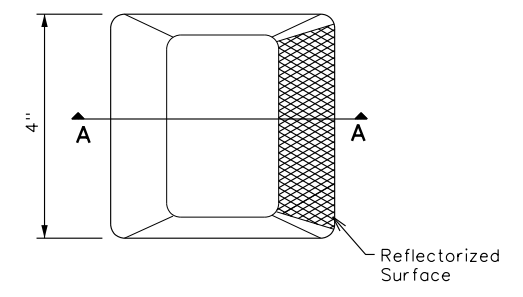

Type I (Top View)

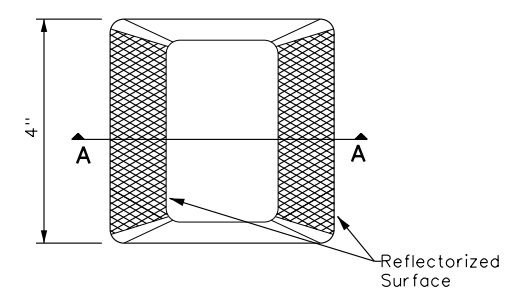

Type II (Top View)


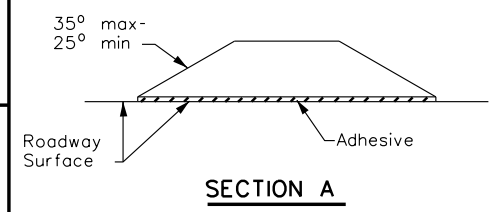


RAISED PAVEMENT MARKERS




POSITION GUIDANCE USING RAISED MARKERS REFLECTORIZED PROFILE MARKINGS PM(2)-22

FILE: pm2-22.dgn	DWG: 0164	SECT: 03	JOB: 056	HIGHWAY: SH 31
© TxDOT December 2022	DIST: TYL	COUNTY: HENDERSON	SHEET NO. 63	

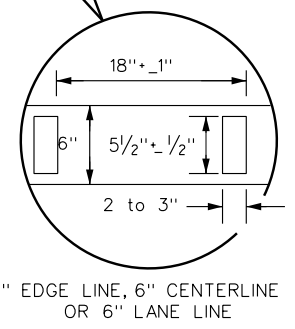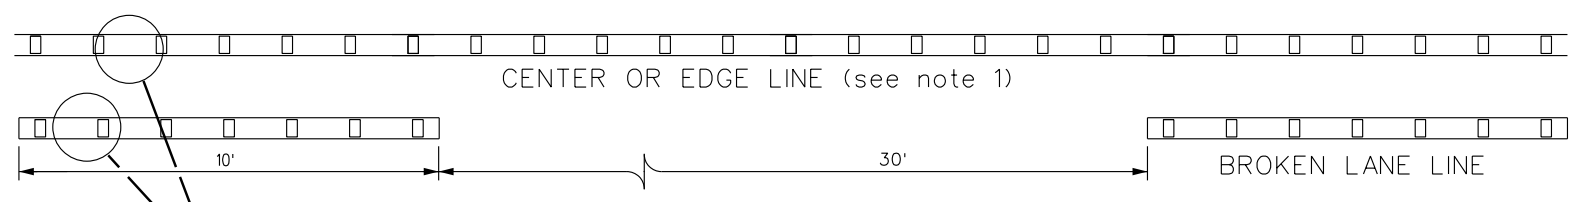

**REFLECTORIZED PROFILE
PATTERN DETAIL**
USING REFLECTIVE PROFILE PAVEMENT MARKINGS



A quick field check for the thickness of base line and profile marking is approximately equal to a stack of 5 quarters to a maximum height of 7 quarters.

NOTES


- Edge lines should typically be 6" wide and the materials shall be specified in the plans.
- Profile markings shall not be placed on roadways with a posted speed limit of 45 MPH or less.

GENERAL NOTES

- All raised pavement markers placed along broken lines shall be placed in line with and midway between the stripes.
- On concrete pavements the raised pavement markers should be placed to one side of the longitudinal joints.
- Use raised pavement marker Type I-C with undivided roadways, flush medians and two way left turn lanes. Use raised pavement marker Type II-C-R with divided highways and raised medians.

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of units or for any errors or omissions resulting from its use.

DATE: 7/17/2023 6:55:34 AM
 FILE: c:\users\time\AppData\Local\Bentley\projectwise\workingdir\pwm-pw.bentley.com\project\pm3-22.dgn

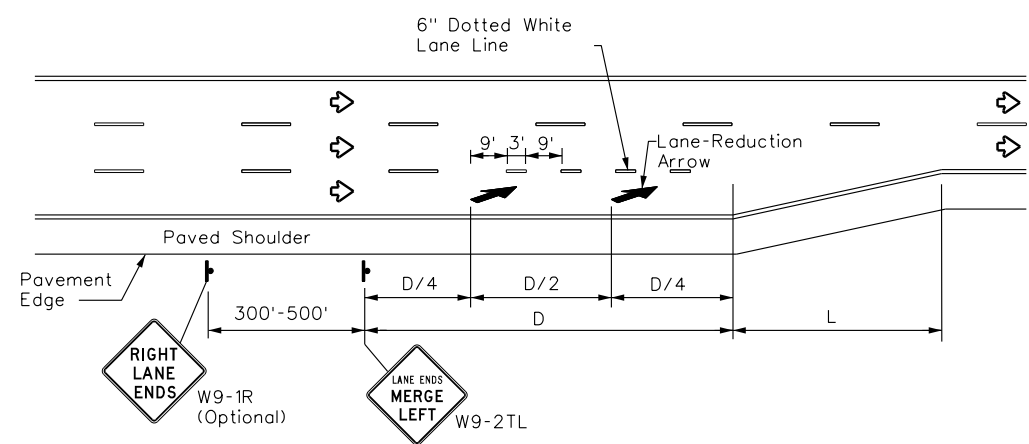

LANE REDUCTION

NOTES

- Lane reduction pavement markings are used where the number of through lanes is reduced because of narrowing of the roadway or because of a section of on-street parking in what would otherwise be a through lane. For Texas Super 2 Passing Lanes, see TS2(PL) standard sheets.
- On divided highways, an additional RIGHT LANE ENDS (W9-1R) sign may be installed in the median aligned with the W9-1R sign on the right side of the highway.
- Lane reduction arrows are required for speeds of 45 mph or greater. An optional third lane reduction arrow may be added based on engineering judgement. If used, the optional third lane reduction arrow should be centered between the first and last lane reduction arrows.
- For lane reductions on Freeways and Expressways, signing shall conform to the TxDOT Freeway Signing Handbook.


Posted Speed	D (ft)	L (ft)
30 MPH	460	$L = \frac{WS^2}{60}$
35 MPH	565	
40 MPH	670	L=WS
45 MPH	775	
50 MPH	885	
55 MPH	990	
60 MPH	1,100	
65 MPH	1,200	
70 MPH	1,250	
75 MPH	1,350	

GENERAL NOTES


- Lane use word and arrow markings shall be used where through lanes approaching an intersection become mandatory turn lanes. Lane use word and arrow markings should be used in auxiliary lanes of substantial length. Lane use arrow markings or word and arrow markings may be used in other lanes and turn bays for emphasis. Details for words and arrows are as shown in the Standard Highway Sign Designs for Texas.
- When lane-use words and arrow markings are used, two sets of arrows should be used if the length of the bay is greater than 180 feet. When a single lane use arrow or word and arrow marking is used for a short turn lane, it should be located at or near the upstream end of the full-width turn lane.
- Use raised pavement marker Type I-C with undivided highways, flush medians and two way left turn lanes. Use raised pavement marker Type II-C-R with divided highways and raised medians.
- Length of turn bays, including taper, deceleration, and storage lengths shall be as shown on the plans or as directed by the Engineer. See Chapter 3 of the Roadway Design Manual for additional information on turning lanes or storage lengths.

MATERIAL SPECIFICATIONS	
PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

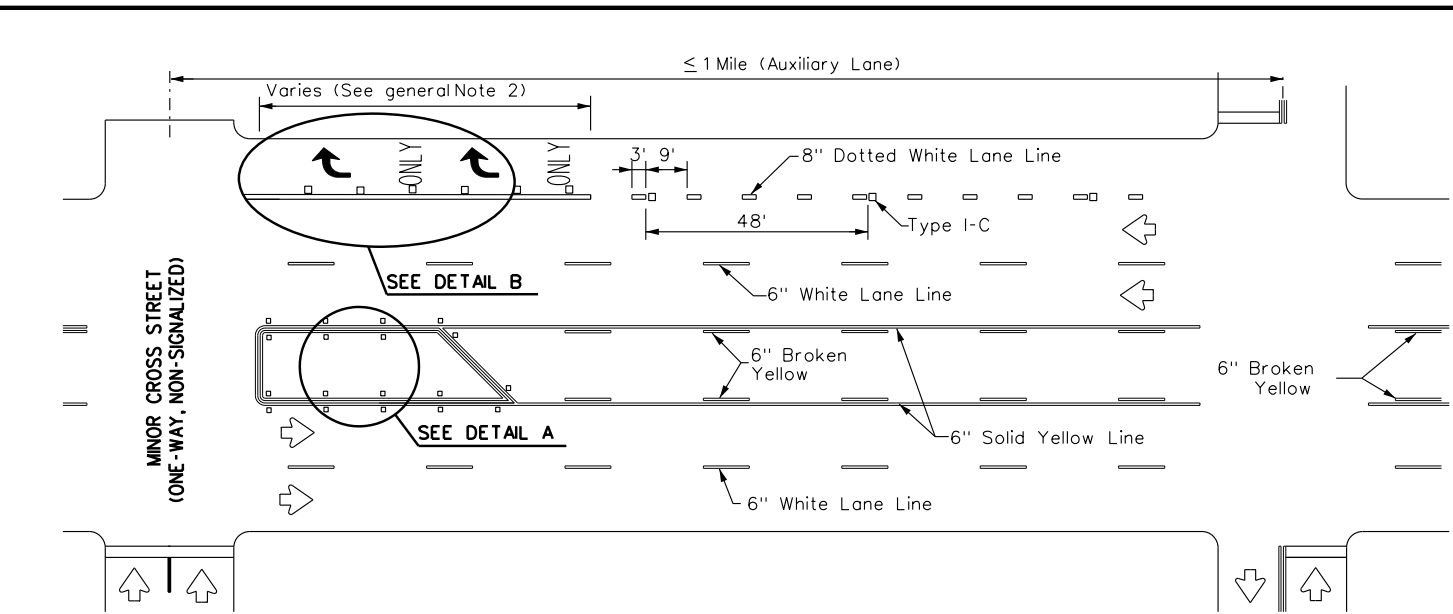


TYPICAL TWLTL AT ONE-WAY STREET AND RIGHT TURN AUXILIARY LANE

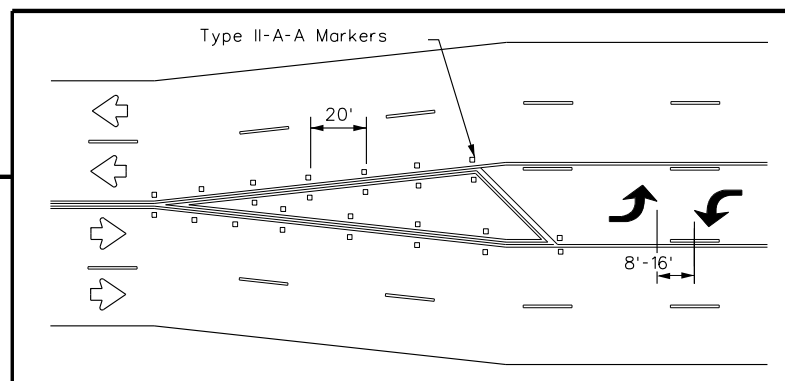


A two-way left-turn (TWLTL) lane-use arrow pavement marking should be used at or just downstream from the beginning of a two-way left-turn lane within a corridor. Repeating the marking after each intersection or dedicated turn bay is not required unless stated elsewhere in the plans.


TYPICAL TRANSITION FOR TWLTL AND DIVIDED HIGHWAY

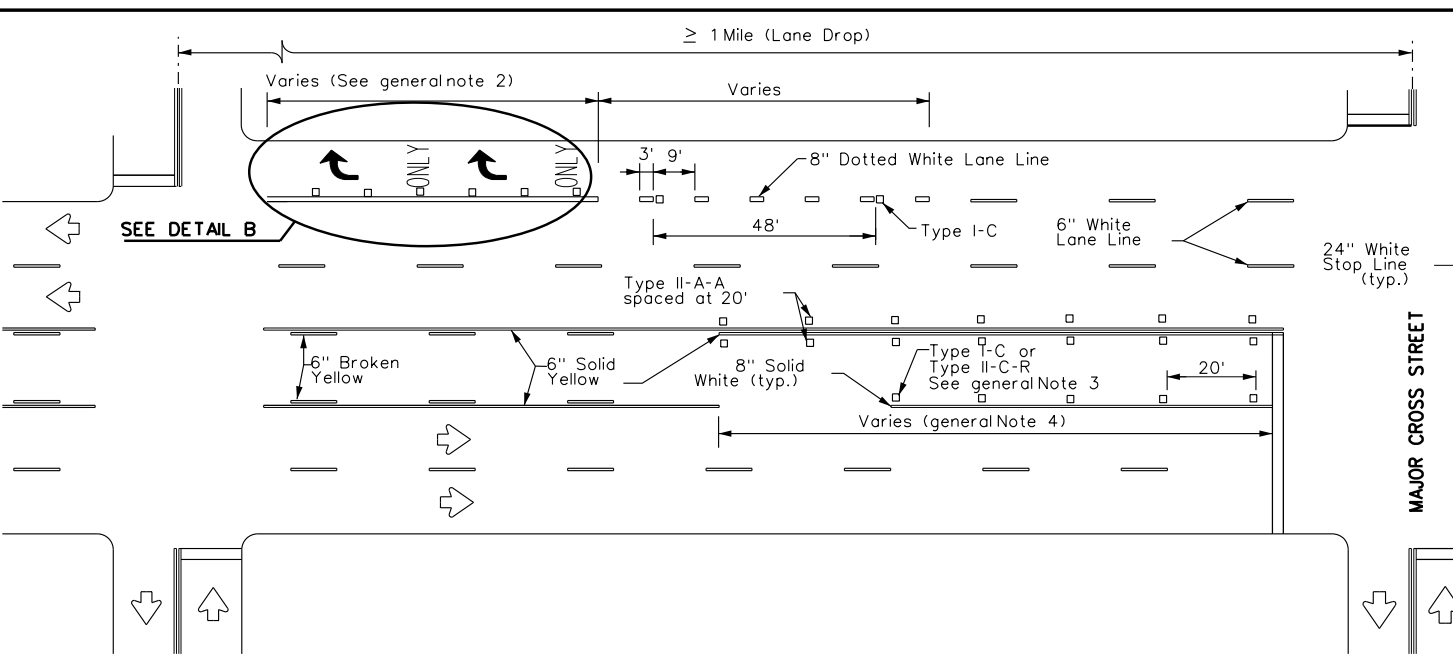

TYPICAL TWLTL AT TWO-WAY CROSS STREET AND RIGHT TURN LANE DROP

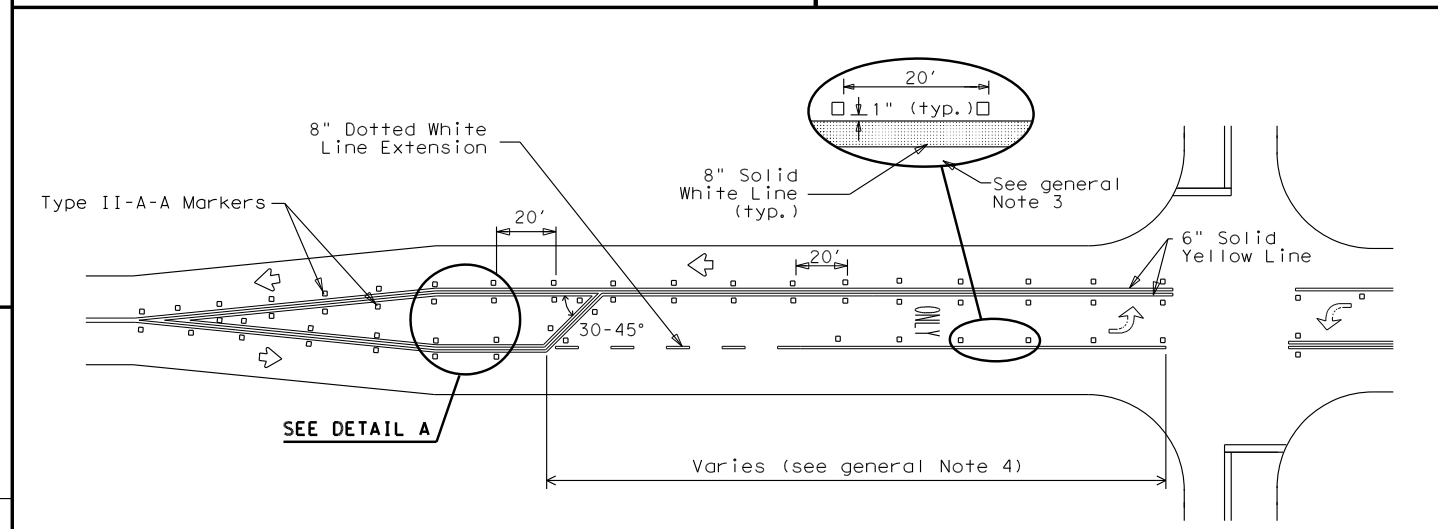

TYPICAL TWO-LANE ROADWAY INTERSECTION WITH LEFT TURN BAYS

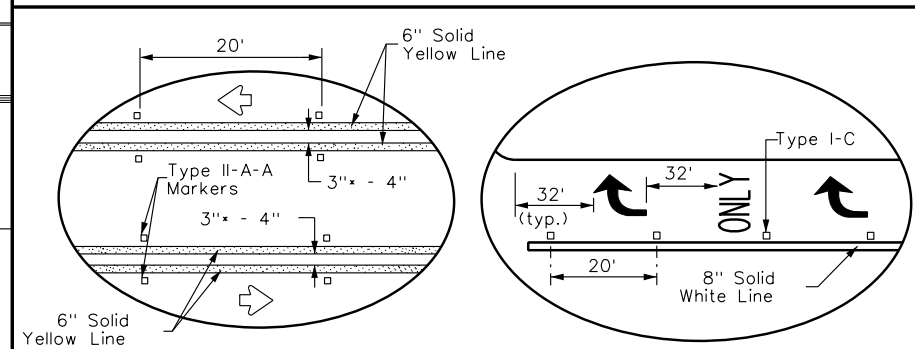

DETAIL A
 DETAIL B
 • 2" minimum allowed for restripe projects when approved by the Engineer.

Texas Department of Transportation
 Traffic Safety Division Standard


TWO-WAY LEFT TURN LANES, RURAL LEFT TURN BAYS, AND LANE REDUCTION PAVEMENT MARKINGS PM(3)-22

FILE: pm3-22.dgn	DWG:	CK:	DW:	CK:
© TxDOT December 2022	CONT: 0164	SECT: 03	JOB: 056	HIGHWAY: SH 31
REVISIONS	DIST:	COUNTY:	SHEET NO.	
4-98 3-03 6-20	TYL	HENDERSON	64	
5-00 2-10 12-22				
8-00 2-12				

22C

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to any other format without the express written consent of TxDOT.

DATE: 7/17/2023 6:55:35 AM
 FILE: c:\users\time\appdata\local\ben\le\projectwise\workingdir\pwm-pw\ben\le\c\of\this\pdm\4-22a\pm(4)-22a.dgn

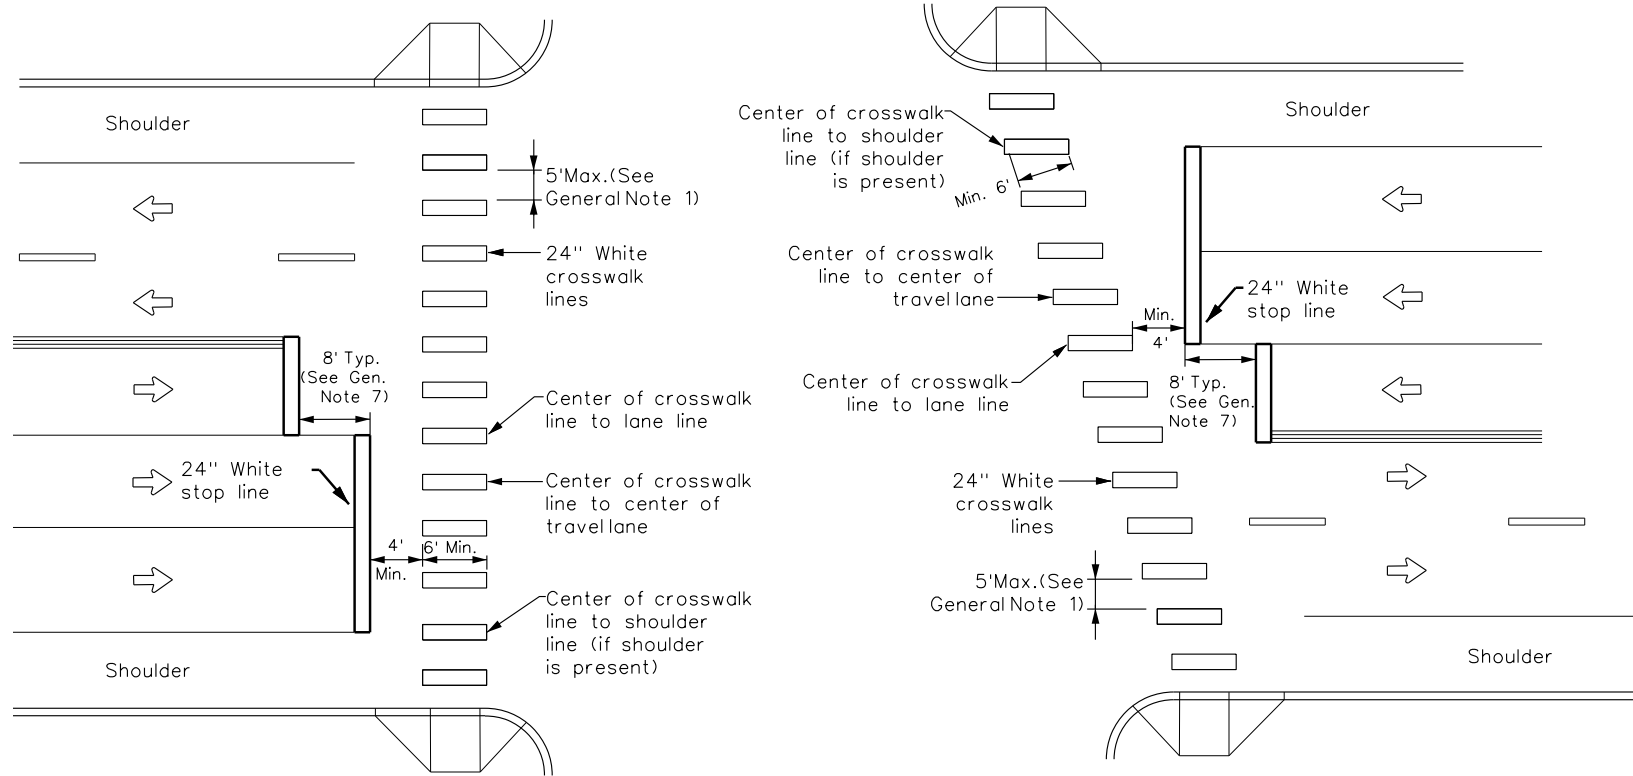

**HIGH-VISIBILITY LONGITUDINAL CROSSWALK
AT CONTROLLED APPROACH**


GENERAL NOTES

1. Longitudinal crosswalk lines should not be placed in the wheel path of vehicles. Center the crosswalk lines on travel lanes, lane lines, and shoulder lines (if present).
2. A minimum 6" clear distance shall be provided to the curb face. If the last crosswalk line falls into this distance it must be omitted.
3. For divided roadways, adjustments in spacing of the crosswalk lines should be made in the median so that the crosswalk lines are maintained in their proper location across the travel portion of the roadway.
4. At skewed crosswalks, the crosswalk lines are to remain parallel to the lane lines.
5. Each crosswalk shall be a minimum of 6' wide.
6. The High-Visibility Longitudinal Crosswalk is the preferred crosswalk pattern on State Highways. Other crosswalk patterns as shown in the "Texas Manual on Uniform Traffic Control Devices" may be used. All crosswalk designs and dimension shall comply with the "Texas Manual on Uniform Traffic Control Devices."
7. Final placement of Stop Bar and Crosswalk shall be approved by the Engineer in the field.

MATERIAL SPECIFICATIONS

PAVEMENT MARKERS (REFLECTORIZED)	DMS-4200
EPOXY AND ADHESIVES	DMS-6100
BITUMINOUS ADHESIVE FOR PAVEMENT MARKERS	DMS-6130
TRAFFIC PAINT	DMS-8200
HOT APPLIED THERMOPLASTIC	DMS-8220
PERMANENT PREFABRICATED PAVEMENT MARKINGS	DMS-8240

All pavement marking materials shall meet the required Departmental Material Specifications as specified by the plans.

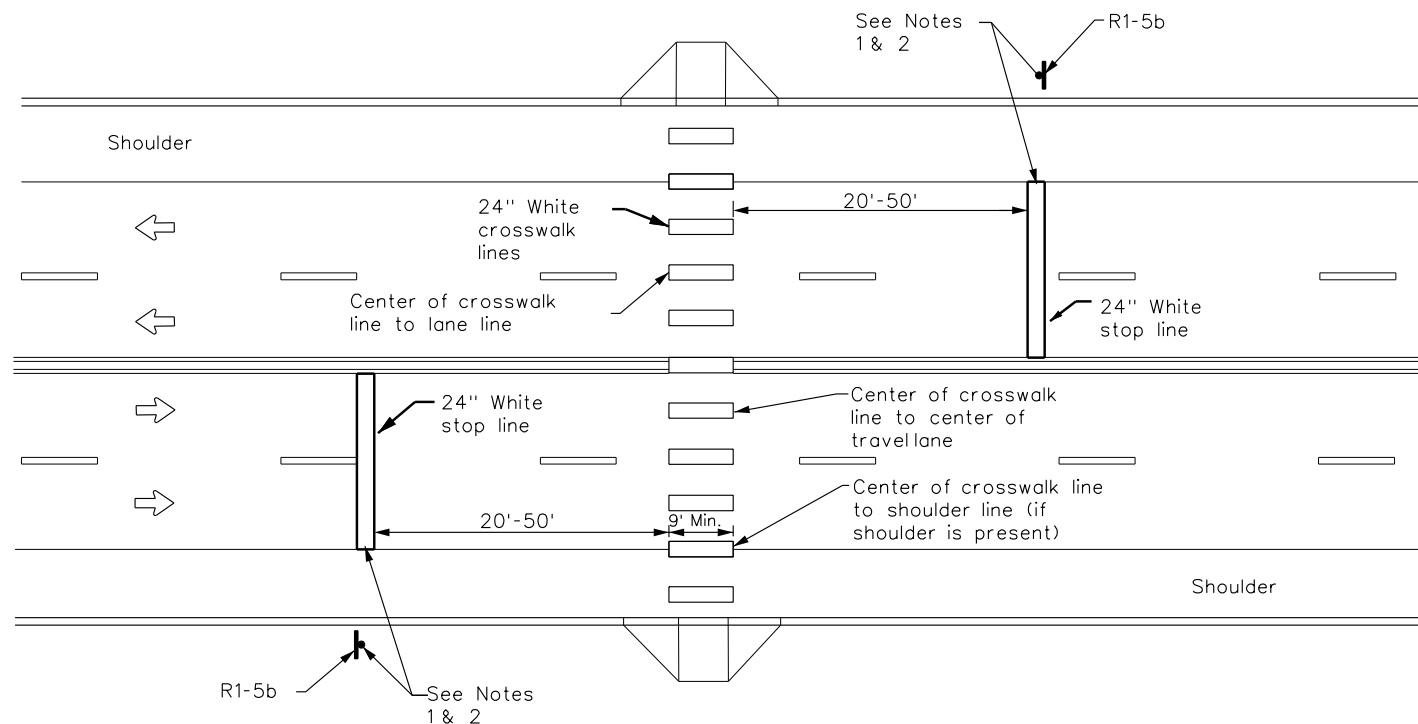

**UNSIGNALIZED MID BLOCK HIGH-VISIBILITY
LONGITUDINAL CROSSWALK**

NOTES:

1. Use stop bars with Stop Here For Pedestrians (R1-5b) signs at unsignalized midblock crosswalks.
2. Use stop bars with STOP HERE ON RED (R10-6 or R10-6a) signs at mid block crosswalks controlled by traffic signals or pedestrian hybrid beacons.

CROSSWALK WIDTH = 9' FOR APPROACH SPEEDS OF 30 MPH OR LESS
 CROSSWALK WIDTH = 12' FOR APPROACH SPEEDS OF 35 MPH OR MORE

Walter P. Moore and Associates, Inc.
TBPE Firm Registration No. 1856



10/04/2024

 Texas Department of Transportation				 Traffic Safety Division Standard	
<h2>CROSSWALK PAVEMENT MARKINGS</h2> <h3>PM(4)-22A (MOD)</h3>					
FILE: pm4-22a.dgn	DWG:	CK:	DW:	CK:	
© TxDOT December 2022	CONT 0164	SECT 03	JOB 056	HIGHWAY SH 31	
12-22 REVISIONS	DIST	COUNTY	SHEET NO.		
	TYL	HENDERSON	65		

STORMWATER POLLUTION PREVENTION PLAN (SWP3):

This SWP3 has been developed in accordance with TxDOT policy for projects disturbing less than 1 acre of soil, and not part of a larger common plan of development.

For projects with less than one acre of soil disturbing activity and that have Environmental, Permits, Issues, and Commitments (EPICs) dependent on stormwater controls and water quality measures TxDOT will maintain a SWP3 with all pertinent records, correspondence, environmental documents, etc. at the project field office, Area Office, or electronically.

This SWP3 is consistent with requirements specified in applicable stormwater plans, and the project's environmental permits, issues, and commitments (EPICs).

1.0 SITE/PROJECT DESCRIPTION

1.1 PROJECT CONTROL SECTION JOB (CSJ):

0164-03-056

1.2 PROJECT LIMITS:

From: 250' E. OF THE INTERSECTION OF SH 31 AT SAWMILL RD

To: 250' W. OF THE INTERSECTION OF SH 31 AT SAWMILL RD

1.3 PROJECT COORDINATES:

BEGIN: (Lat) 32.3102536 ,(Long) -95.4695984

END: (Lat) 32.3104858 ,(Long) -95.4687402

1.4 TOTAL PROJECT AREA (Acres): 1.0

1.5 TOTAL AREA TO BE DISTURBED (Acres): 0.02

1.6 NATURE OF CONSTRUCTION ACTIVITY:

FOR THE CONSTRUCTION OF INSTALATION OF TRAFFIC SIGNAL, PEDESTRIAN SIGNAL, AND PAVEMENT MARKINGS

1.7 MAJOR SOIL TYPES:

Soil Type	Description
FINE SANDY LOAM	CONSISTS OF DEEP, WELL DRAINED SOILS. GENTLY SLOPING TO MODERATELY STEEP SOILS, 2 TO 8 PERCENT SLOPES

1.8 PROJECT SPECIFIC LOCATIONS (PSLs):

PSLs must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. PSLs may be identified during preconstruction meetings or during the construction process. Please choose from the options below:

- PSLs determined during preconstruction meeting
- PSLs determined during construction
- No PSLs planned for construction

Type	Sheet #s

All off-ROW PSLs required by the Contractor are the Contractor's responsibility. The Contractor shall secure all permits required by local, state, federal laws for off-ROW PSLs. The contractor shall provide diagrams, areas of disturbance, acreage, and BMPs for all off-ROW PSLs within one mile of the project.

1.9 CONSTRUCTION ACTIVITIES:

(Use the following list as a starting point when developing the Construction Activity Schedule and Ceasing Record in Attachment 2.3.)

- Mobilization
- Install sediment and erosion controls
- Blade existing topsoil into windrows, prep ROW, clear and grub
- Remove existing pavement
- Grading operations, excavation, and embankment
- Excavate and prepare subgrade for proposed pavement widening
- Remove existing culverts, safety end treatments (SETs)
- Remove existing metal beam guard fence (MBGF), bridge rail
- Install proposed pavement per plans
- Install culverts, culvert extensions, SETs
- Install mow strip, MBGF, bridge rail
- Place flex base
- Rework slopes, grade ditches
- Blade windrowed material back across slopes
- Revegetation of unpaved areas
- Achieve site stabilization and remove sediment and erosion control measures

Other: _____
 Other: _____
 Other: _____

1.10 POTENTIAL POLLUTANTS AND SOURCES:

- Sediment laden stormwater from stormwater conveyance over disturbed area
- Fuels, oils, and lubricants from construction vehicles, equipment, and storage
- Solvents, paints, adhesives, etc. from various construction activities
- Transported soils from offsite vehicle tracking
- Construction debris and waste from various construction activities
- Contaminated water from excavation or dewatering pump-out water
- Sanitary waste from onsite restroom facilities
- Trash from various construction activities/receptacles
- Long-term stockpiles of material and waste
- Discharges from concrete washout activities, runoff from concrete cutting activities, and other concrete related activities
- Other: _____
- Other: _____
- Other: _____

1.11 RECEIVING WATERS:

Receiving waters must be depicted on the Environmental Layout Sheets in Attachment 1.2 of this SWP3. Include Segment # for receiving waters.

Tributaries	Classified Waterbody
NECHES RIVER	(0606)
KICKAPOO CREEK	(0605A)
LAKE PALESTINE	(0605)

* Add (*) for impaired waterbodies with pollutant in ().

1.12 ROLES AND RESPONSIBILITIES: TxDOT

- Development of plans and specifications
- Perform SWP3 inspections
- Maintain SWP3 records and update to reflect daily operations
- Other: _____
- Other: _____

1.13 ROLES AND RESPONSIBILITIES: CONTRACTOR

- Day To Day Operational Control
- Maintain schedule of major construction activities
- Install, maintain and modify BMPs
- Other: _____
- Other: _____

Walter P. Moore and Associates, Inc.
 TBPE Firm Registration No. 1856



STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre)

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.
	F 2025(247)			66
STATE	STATE DIST.	COUNTY		
TEXAS	TYL	HENDERSON		
CONT.	SECT.	JOB	HIGHWAY NO.	
0164	03	056	SH 31	

STORMWATER POLLUTION PREVENTION PLAN (SWP3):

2.0 BEST MANAGEMENT PRACTICES (BMPs) AND CONTROLS, INSPECTION, AND MAINTENANCE

The Contractor shall be the responsible party for implementing the BMPs described herein and for complying with the SWP3 for control of erosion and sedimentation during day-to-day operations. The Contractor shall implement changes to this SWP3 approved by TxDOT within the times specified in this SWP3 or the CGP.

2.1 EROSION CONTROL AND SOIL STABILIZATION BMPs:

T / P

- Protection of Existing Vegetation
- Vegetated Buffer Zones
- Soil Retention Blankets
- Geotextiles
- Mulching/ Hydromulching
- Soil Surface Treatments
- Temporary Seeding
- Permanent Planting, Sodding or Seeding
- Biodegradable Erosion Control Logs
- Rock Filter Dams/ Rock Check Dams
- Vertical Tracking
- Interceptor Swale
- Riprap
- Diversion Dike
- Temporary Pipe Slope Drain
- Embankment for Erosion Control
- Paved Flumes
- Other: _____
- Other: _____
- Other: _____
- Other: _____

2.2 SEDIMENT CONTROL BMPs:

T / P

- Biodegradable Erosion Control Logs
- Dewatering Controls
- Inlet Protection
- Rock Filter Dams/ Rock Check Dams
- Sandbag Berms
- Sediment Control Fence
- Stabilized Construction Exit
- Floating Turbidity Barrier
- Vegetated Buffer Zones
- Vegetated Filter Strips
- Other: _____
- Other: _____
- Other: _____
- Other: _____

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

2.3 PERMANENT CONTROLS:

(Coordinate post-construction BMPs with appropriate TxDOT maintenance sections.)

BMPs To Be Left In Place Post Construction:


Type	Stationing	
	From	To

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

2.4 OFFSITE VEHICLE TRACKING CONTROLS:

- Excess dirt/mud on road removed daily
- Haul roads dampened for dust control
- Loaded haul trucks to be covered with tarpaulin
- Stabilized construction exit
- Daily street sweeping
- Other: _____
- Other: _____
- Other: _____
- Other: _____

Walter P. Moore and Associates, Inc.
TBPE Firm Registration No. 1856

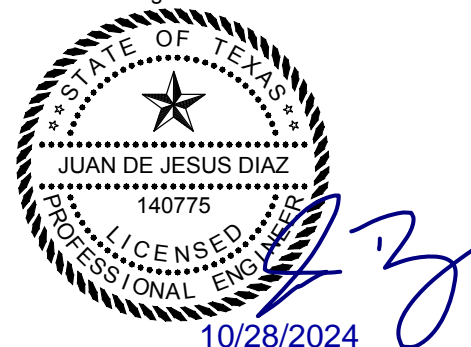

2.5 POLLUTION PREVENTION MEASURES:

- Chemical Management
- Concrete and Materials Waste Management
- Debris and Trash Management
- Dust Control
- Sanitary Facilities
- Other: _____
- Other: _____
- Other: _____
- Other: _____

2.6 VEGETATED BUFFER ZONES:

Natural vegetated buffers shall be maintained as feasible to protect adjacent surface waters. If vegetated natural buffer zones are not feasible due to site geometry, the appropriate additional sediment control measures have been incorporated into this SWP3.

Type	Stationing	
	From	To

Refer to the Environmental Layout Sheets/ SWP3 Layout Sheets located in Attachment 1.2 of this SWP3

2.7 ALLOWABLE NON-STORMWATER DISCHARGES:

- Fire hydrant flushings
- Irrigation drainage
- Pavement washwater (where spills or leaks have not occurred, and detergents are not used)
- Potable water sources
- Springs
- Uncontaminated groundwater
- Water used to wash vehicles or control dust
- Other allowable non-stormwater discharges as allowed by TPDES GP TXR150000.

2.8 DEWATERING:

Dewatering discharges of accumulated stormwater, groundwater, and surface water including discharges from dewatering of trenches, excavations, foundations, vaults, and other points of accumulation are prohibited unless managed by appropriate controls to prevent and minimize the offsite discharge of sediment and other pollutants.

2.9 INSPECTIONS:

All disturbed areas and erosion and sediment control devices shall be inspected at least once every seven (7) days. Inspections shall be performed by TxDOT as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.3 of this SWP3 .

2.10 MAINTENANCE:

Control measures shall be properly installed according to specifications. If it is determined that a BMP or control measure is not operating effectively, maintenance must be accomplished as soon as possible and before the next anticipated rain event, but in no case later than 7 calendar days after being able to access the site. Maintenance shall be performed by the Contractor as indicated on the Field Inspection and Maintenance Report Form 2118 and retained in Attachment 2.3 of this SWP3.

STORMWATER POLLUTION PREVENTION PLAN (SWP3) (Less Than 1 Acre)

FED. RD. DIV. NO.	PROJECT NO.			SHEET NO.
	F 2025(247)			67
STATE	STATE DIST.	COUNTY		
TEXAS	TYL	HENDERSON		
CONT.	SECT.	JOB	HIGHWAY NO.	
0164	03	056	SH 31	

DISCLAIMER: This standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE: 7/17/2023
FILE: c:\users\tim\appdata\local\bentley\projectwise\workingdir\wpm-pw-01\sewing\wal\terpmoore.com\dms47257\EPIC-PS&E+2.dgn

I. STORMWATER POLLUTION PREVENTION-CLEAN WATER ACT SECTION 402

TPDES TXR 150000: Stormwater Discharge Permit or Construction General Permit required for projects with 1 or more acres disturbed soil. Projects with any disturbed soil must protect for erosion and sedimentation in accordance with Item 506.

List MS4 Operator(s) that may receive discharges from this project. They may need to be notified prior to construction activities.

- 1. No Action Required Required Action

Action No.

- 1. FOLLOW SWP3
- 2.
- 3.
- 4.

II. WORK IN OR NEAR STREAMS, WATERBODIES AND WETLANDS CLEAN WATER ACT SECTIONS 401 AND 404

USACE Permit required for filling, dredging, excavating or other work in any water bodies, rivers, creeks, streams, wetlands or wet areas.

The Contractor must adhere to all of the terms and conditions associated with the following permit(s):

- No Permit Required
- Nationwide Permit 14 - PCN not Required (less than 1/10th acre waters or wetlands affected)
- Nationwide Permit 14 - PCN Required (1/10 to <1/2 acre, 1/3 in tidal waters)
- Individual 404 Permit Required
- Other Nationwide Permit Required: NWP* _____

Required Actions: List waters of the US permit applies to, location in project and check Best Management Practices planned to control erosion, sedimentation and post-project TSS.

- 1.
- 2.
- 3.
- 4.

The elevation of the ordinary high water marks of any areas requiring work to be performed in the waters of the US requiring the use of a nationwide permit can be found on the Bridge Layouts.

Best Management Practices:

- Erosion: Temporary Vegetation, Blankets/Matting, Mulch, Sodding, Interceptor Swale, Diversion Dike, Erosion Control Compost, Mulch Filter Berm and Socks, Compost Filter Berm and Socks
- Sedimentation: Silt Fence, Rock Berm, Triangular Filter Dike, Sand Bag Berm, Straw Bale Dike, Brush Berms, Erosion Control Compost, Mulch Filter Berm and Socks, Compost Filter Berm and Socks, Stone Outlet Sediment Traps, Sediment Basins
- Post-Construction TSS: Vegetative Filter Strips, Retention/Irrigation Systems, Extended Detention Basin, Constructed Wetlands, Wet Basin, Erosion Control Compost, Mulch Filter Berm and Socks, Compost Filter Berm and Socks, Vegetation Lined Ditches, Sand Filter Systems, Grassy Swales

III. CULTURAL RESOURCES

Refer to TxDOT Standard Specifications in the event historical issues or archeological artifacts are found during construction. Upon discovery of archeological artifacts (bones, burnt rock, flint, pottery, etc.) cease work in the immediate area and contact the Engineer immediately.

- No Action Required Required Action

Action No.

- 1. NO ACTION NECESSARY ABOVE THOSE REQUIRED BY THE 2004 TEXAS STANDARDS FOR SPECIFICATIONS, CONSTRUCTION AND MAINTENANCE OF HIGHWAYS, STREETS, AND BRIDGES.
- 2.
- 3.
- 4.

IV. VEGETATION RESOURCES

Preserve native vegetation to the extent practical. Contractor must adhere to Construction Specification Requirements Specs 162, 164, 192, 193, 506, 730, 751, 752 in order to comply with requirements for invasive species, beneficial landscaping, and tree/brush removal commitments.

- No Action Required Required Action

Action No.

- 1. ADHERE TO SPECS AS LISTED ABOVE
- 2.
- 3.
- 4.

V. FEDERAL LISTED, PROPOSED THREATENED, ENDANGERED SPECIES, CRITICAL HABITAT, STATE LISTED SPECIES, CANDIDATE SPECIES AND MIGRATORY BIRDS.

- No Action Required Required Action

Action No.

- 1. FOLLOW GUIDANCE BELOW CONCERNING MIGRATORY BIRDS.
- 2.
- 3.
- 4.

If any of the listed species are observed, cease work in the immediate area, do not disturb species or habitat and contact the Engineer immediately. The work may not remove active nests from bridges and other structures during nesting season of the birds associated with the nests. If caves or sinkholes are discovered, cease work in the immediate area, and contact the Engineer immediately.

LIST OF ABBREVIATIONS

BMP: Best Management Practice	SPCC: Spill Prevention Control and Countermeasure
CGP: Construction General Permit	SWSP: Storm Water Pollution Prevention Plan
DSHS: Texas Department of State Health Services	PCN: Pre-Construction Notification
FHWA: Federal Highway Administration	PSL: Project Specific Location
MOA: Memorandum of Agreement	TCEQ: Texas Commission on Environmental Quality
MOU: Memorandum of Understanding	TPDES: Texas Pollutant Discharge Elimination System
MS4: Municipal Separate Stormwater Sewer System	TPWD: Texas Parks and Wildlife Department
MBTA: Migratory Bird Treaty Act	TxDOT: Texas Department of Transportation
NOT: Notice of Termination	T&E: Threatened and Endangered Species
NWP: Nationwide Permit	USACE: U.S. Army Corps of Engineers
NQ: Notice of Intent	USFWS: U.S. Fish and Wildlife Service

VI. HAZARDOUS MATERIALS OR CONTAMINATION ISSUES

General (applies to all projects):

Comply with the Hazard Communication Act (the Act) for personnel who will be working with hazardous materials by conducting safety meetings prior to beginning construction and making workers aware of potential hazards in the workplace. Ensure that all workers are provided with personal protective equipment appropriate for any hazardous materials used.

Obtain and keep on-site Material Safety Data Sheets (MSDS) for all hazardous products used on the project, which may include, but are not limited to the following categories: Paints, acids, solvents, asphalt products, chemical additives, fuels and concrete curing compounds or additives. Provide protected storage, off bare ground and covered, for products which may be hazardous. Maintain product labeling as required by the Act.

Maintain an adequate supply of on-site spill response materials, as indicated in the MSDS. In the event of a spill, take actions to mitigate the spill as indicated in the MSDS, in accordance with safe work practices, and contact the District Spill Coordinator immediately. The Contractor shall be responsible for the proper containment and cleanup of all product spills.

Contact the Engineer if any of the following are detected:

- Dead or distressed vegetation (not identified as normal)
- Trash piles, drums, canister, barrels, etc.
- Undesirable smells or odors
- Evidence of leaching or seepage of substances

Does the project involve any bridge class structure rehabilitation or replacements (bridge class structures not including box culverts)?

- Yes No

If "No", then no further action is required.

If "Yes", then TxDOT is responsible for completing asbestos assessment/inspection.

Are the results of the asbestos inspection positive (is asbestos present)?

- Yes No

If "Yes", then TxDOT must retain a DSHS licensed asbestos consultant to assist with the notification, develop abatement/mitigation procedures, and perform management activities as necessary. The notification form to DSHS must be postmarked at least 15 working days prior to scheduled demolition.

If "No", then TxDOT is still required to notify DSHS 15 working days prior to any scheduled demolition.

In either case, the Contractor is responsible for providing the date(s) for abatement activities and/or demolition with careful coordination between the Engineer and asbestos consultant in order to minimize construction delays and subsequent claims.

Any other evidence indicating possible hazardous materials or contamination discovered on site. Hazardous Materials or Contamination Issues Specific to this Project:

- No Action Required Required Action

Action No.

- 1.
- 2.
- 3.


VII. OTHER ENVIRONMENTAL ISSUES

(includes regional issues such as Edwards Aquifer District, etc.)

- No Action Required Required Action


Action No.

- 1.
- 2.
- 3.


		Design Division Standard			
ENVIRONMENTAL PERMITS, ISSUES AND COMMITMENTS					
EPIC					
FILE: epic.dgn	DN: TxDOT	CK: RG	DW: VP	CK: AR	
© TxDOT: February 2015 REVISIONS		CONT	SECT	JOB	HIGHWAY
		0164	03	056	SH 31
12-12-2011 (DS)		DIST		COUNTY	SHEET NO.
09-07-14 ADDED NOTE SECTION IV.		TYL		HENDERSON	68
01-23-2015 SECTION I CHANGED ITEM 1122 TO ITEM 506. ADDED GRASSY SWALES.					

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.


DATE:
FILE:

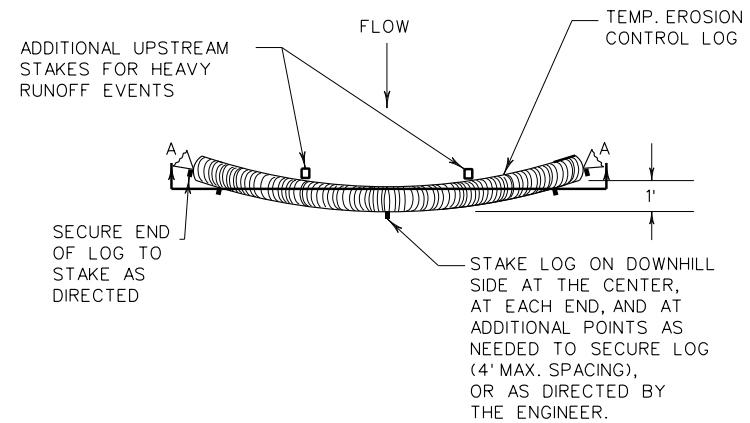


PLAN VIEW

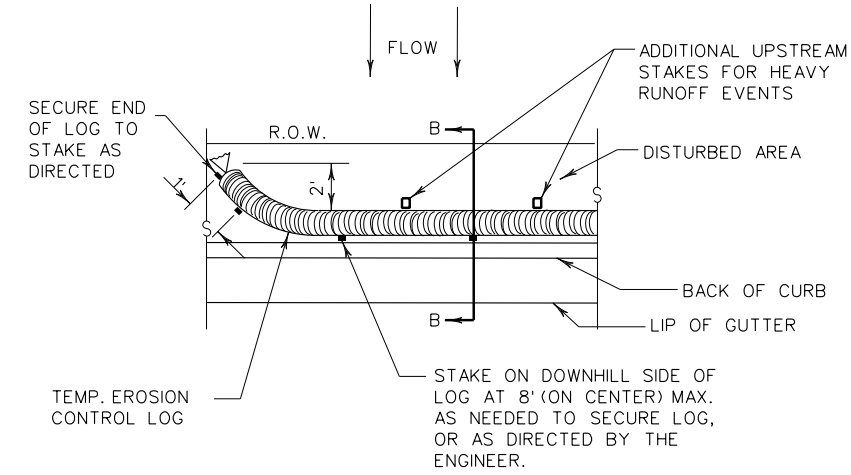

PLAN VIEW

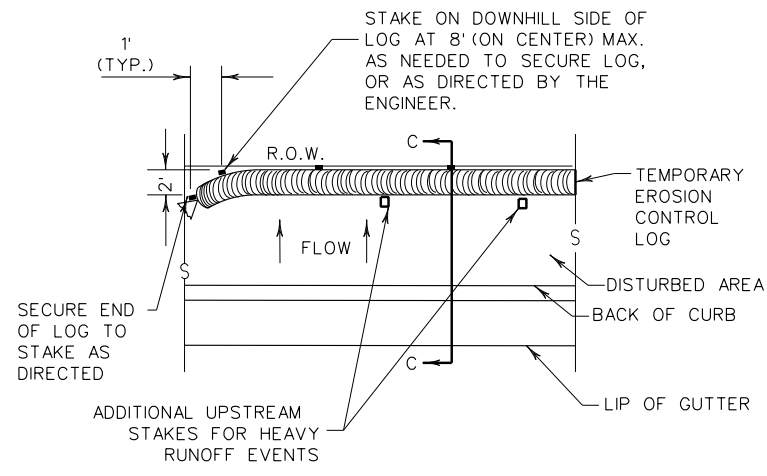


PLAN VIEW

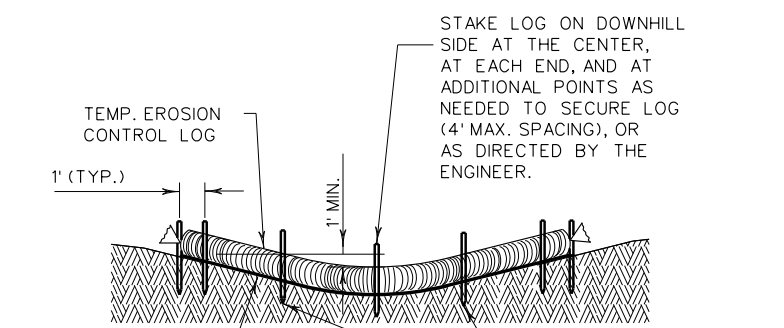

SECTION A-A

EROSION CONTROL LOG DAM


CL-D

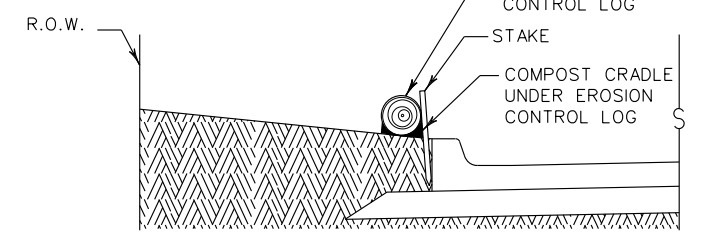

SECTION B-B

EROSION CONTROL LOG AT BACK OF CURB


CL-BOC

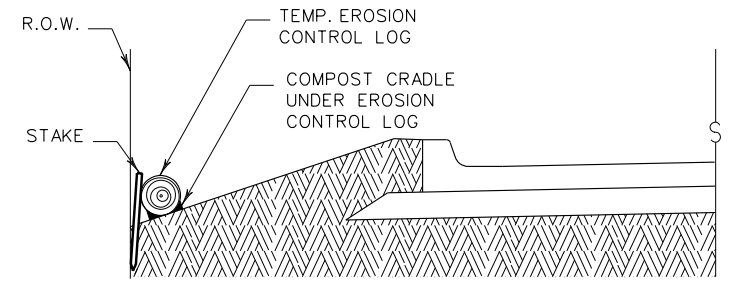

SECTION C-C


EROSION CONTROL LOG AT EDGE OF RIGHT-OF-WAY

CL-ROW

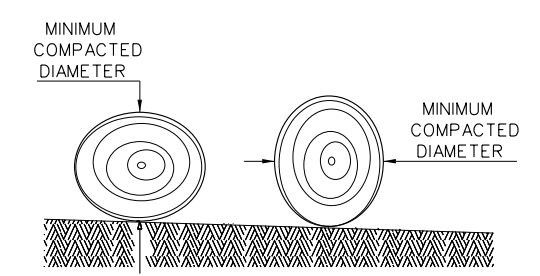

DIAMETER MEASUREMENTS OF EROSION CONTROL LOGS SPECIFIED IN PLANS

- LEGEND**
- CL-D EROSION CONTROL LOG DAM
 - CL-BOC EROSION CONTROL LOG AT BACK OF CURB
 - CL-ROW EROSION CONTROL LOG AT EDGE OF RIGHT-OF-WAY
 - CL-SST EROSION CONTROL LOGS ON SLOPES STAKE AND TRENCHING ANCHORING
 - CL-SSL EROSION CONTROL LOGS ON SLOPES STAKE AND LASHING ANCHORING
 - CL-DI EROSION CONTROL LOG AT DROP INLET
 - CL-CI EROSION CONTROL LOG AT CURB INLET
 - CL-GI EROSION CONTROL LOG AT CURB & GRATE INLET

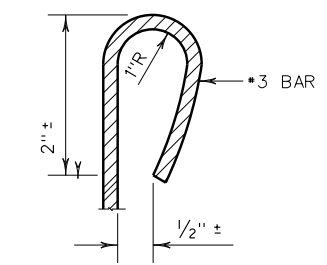

REBAR STAKE DETAIL

SEDIMENT BASIN & TRAP USAGE GUIDELINES

An erosion controllog sediment trap may be used to filter sediment out of runoff draining from an unstabilized area.

Log Traps: The drainage area for a sediment trap should not exceed 5 acres. The trap capacity should be 1800 CF/Acre (0.5" over the drainage area).

Controllogs should be placed in the following locations:

1. Within drainage ditches spaced as needed or min. 500' on center
2. Immediately preceding ditch inlets or drain inlets
3. Just before the drainage enters a water course
4. Just before the drainage leaves the right of way
5. Just before the drainage leaves the construction limits where drainage flows away from the project.

The logs should be cleaned when the sediment has accumulated to a depth of 1/2 the log diameter.

Cleaning and removal of accumulated sediment deposits is incidental and will not be paid for separately.

GENERAL NOTES:


1. EROSION CONTROL LOGS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS, OR AS DIRECTED BY THE ENGINEER.
2. LENGTHS OF EROSION CONTROL LOGS SHALL BE IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS AND AS REQUIRED FOR THE PURPOSE INTENDED.
3. UNLESS OTHERWISE DIRECTED, USE BIODEGRADABLE OR PHOTODEGRADABLE CONTAINMENT MESH ONLY WHERE LOG WILL REMAIN IN PLACE AS PART OF A VEGETATIVE SYSTEM. FOR TEMPORARY INSTALLATIONS, USE RECYCLABLE CONTAINMENT MESH.
4. FILL LOGS WITH SUFFICIENT FILTER MATERIAL TO ACHIEVE THE MINIMUM COMPACTED DIAMETER SPECIFIED IN THE PLANS WITHOUT EXCESSIVE DEFORMATION.
5. STAKES SHALL BE 2" X 2" WOOD OR #3 REBAR, 2'-4' LONG, EMBEDDED SUCH THAT 2" PROTRUDES ABOVE LOG, OR AS DIRECTED BY THE ENGINEER.
6. DO NOT PLACE STAKES THROUGH CONTAINMENT MESH.
7. COMPOST CRADLE MATERIAL IS INCIDENTAL & WILL NOT BE PAID FOR SEPARATELY.
8. SANDBAGS USED AS ANCHORS SHALL BE PLACED ON TOP OF LOGS & SHALL BE OF SUFFICIENT SIZE TO HOLD LOGS IN PLACE.
9. TURN THE ENDS OF EACH ROW OF LOGS UPSLOPE TO PREVENT RUNOFF FROM FLOWING AROUND THE LOG.
10. FOR HEAVY RUNOFF EVENTS, ADDITIONAL UPSTREAM STAKES MAY BE NECESSARY TO KEEP LOG FROM FOLDING IN ON ITSELF.

SHEET 1 OF 3

		Design Division Standard	
TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES			
EROSION CONTROL LOG			
EC(9)-16			
FILE: ec916	DN: TxDOT	CK: KM	DW: LS/PT
© TxDOT: JULY 2016	CONT: 0164	SECT: 03	JOB: 056
REVISIONS	DIST: TYL	COUNTY: HENDERSON	SHEET NO. 69


DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

DATE:
FILE:

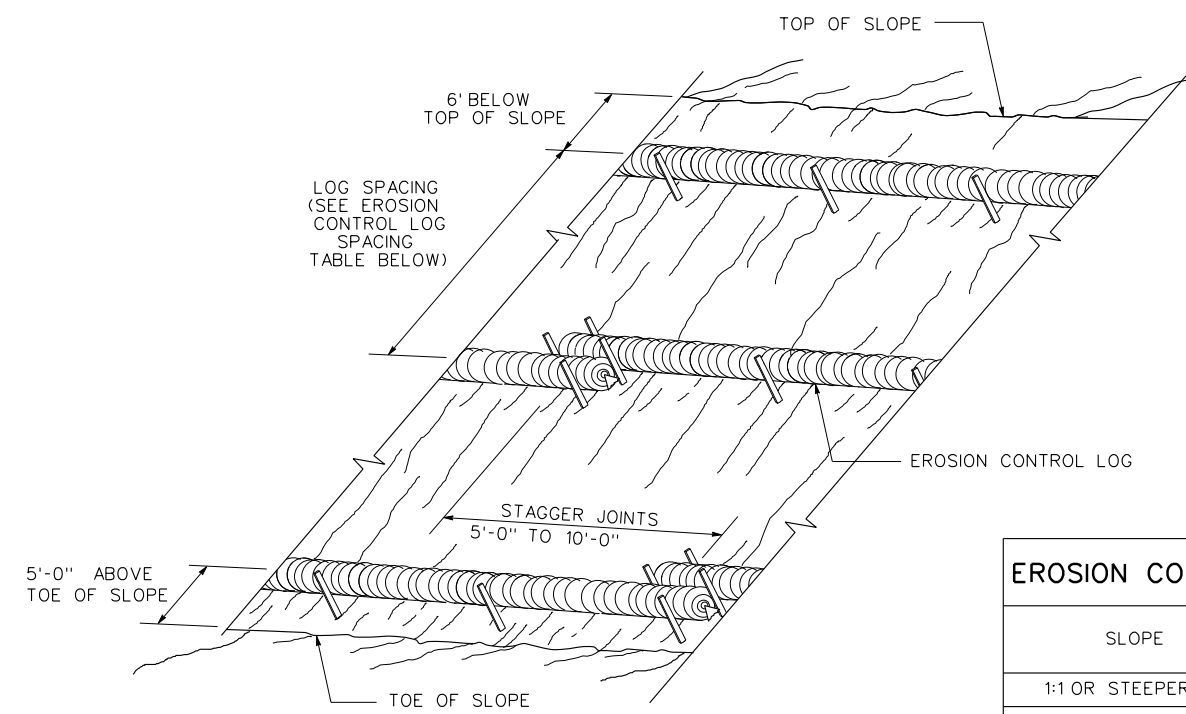

**EROSION CONTROL LOGS ON SLOPES
STAKE AND TRENCHING ANCHORING**


CL-SST

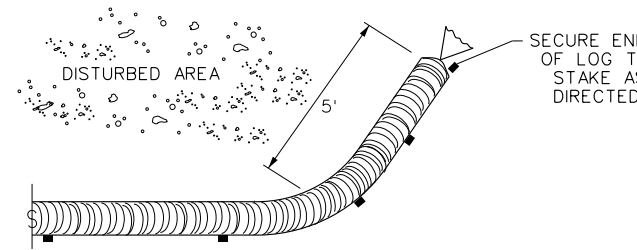

END SECTION RAP DETAIL


SLOPE	LOG DIAMETER			
	6"	8"	12"	18"
1:1 OR STEEPER	5'	10'	15'	20'
2:1	10'	20'	30'	40'
3:1	15'	30'	45'	60'
4:1 OR FLATTER	20'	40'	60'	80'

* ADJUSTMENTS CAN BE MADE FOR SOIL TYPE:
SOFT, LOAMY SOILS-ADJUST ROWS CLOSER TOGETHER;
HARD, ROCKY SOILS- ADJUST ROWS FARTHER APART

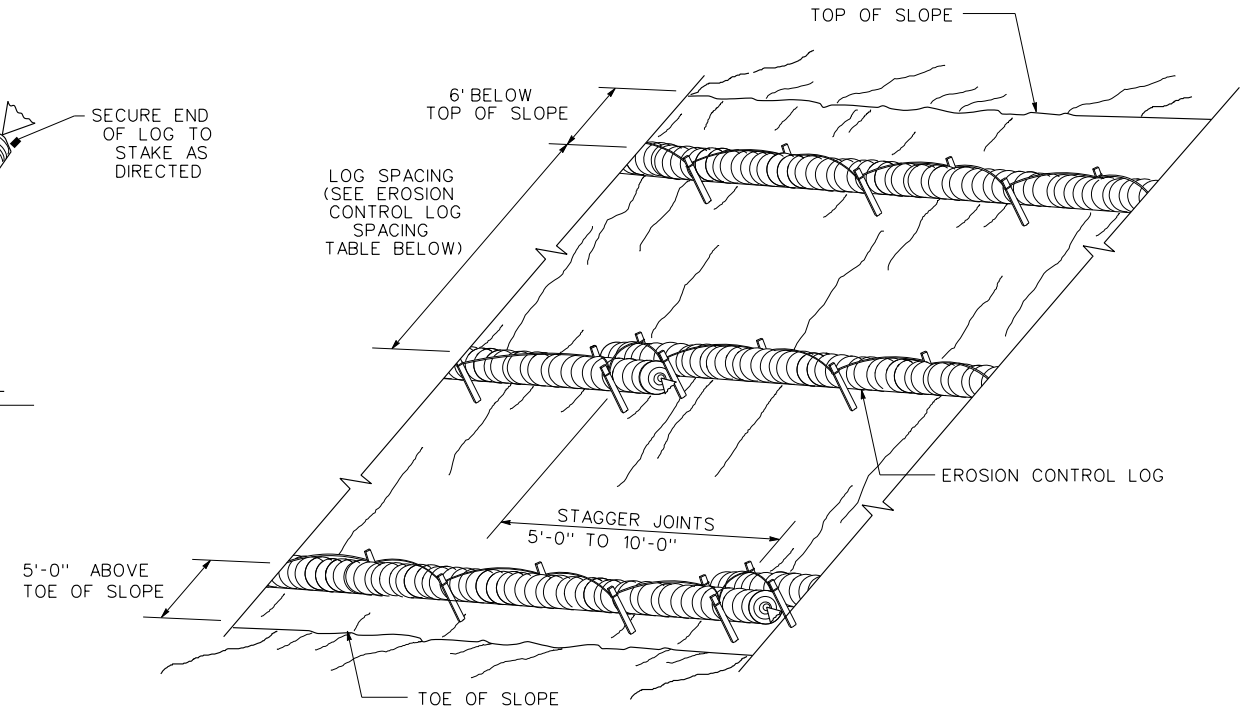


**EROSION CONTROL LOGS ON SLOPES
STAKE AND LASHING ANCHORING**

CL-SSL

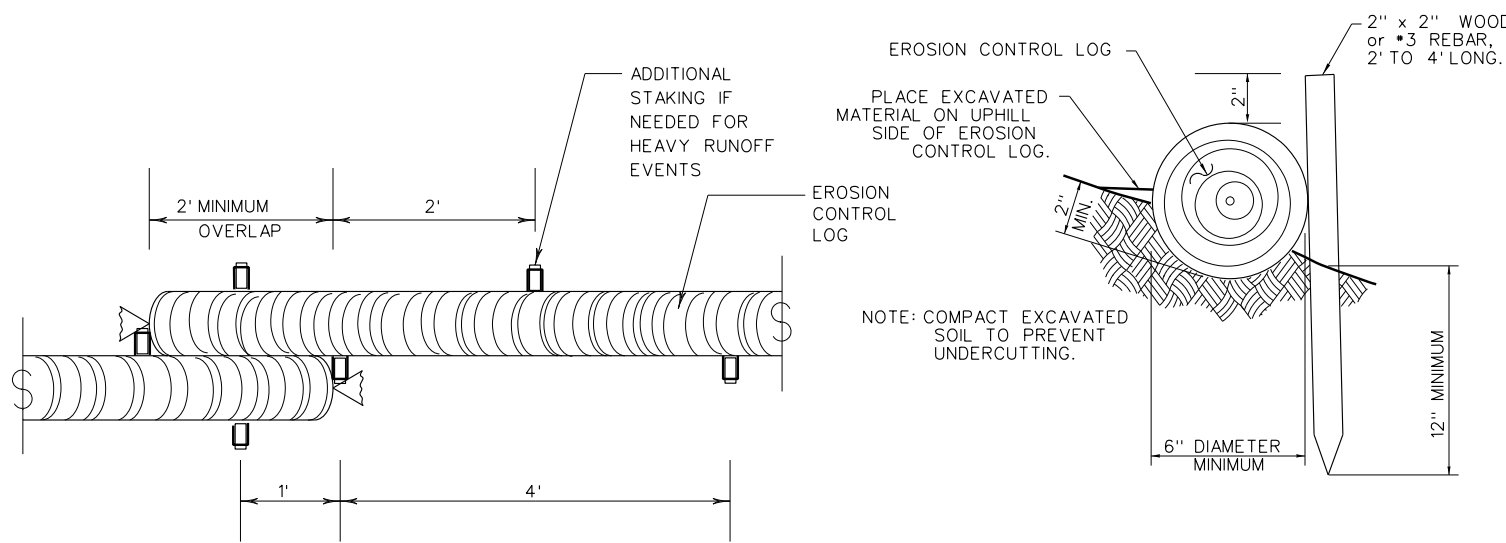

STAKE AND TRENCHING ANCHORING DETAIL

CL-SST

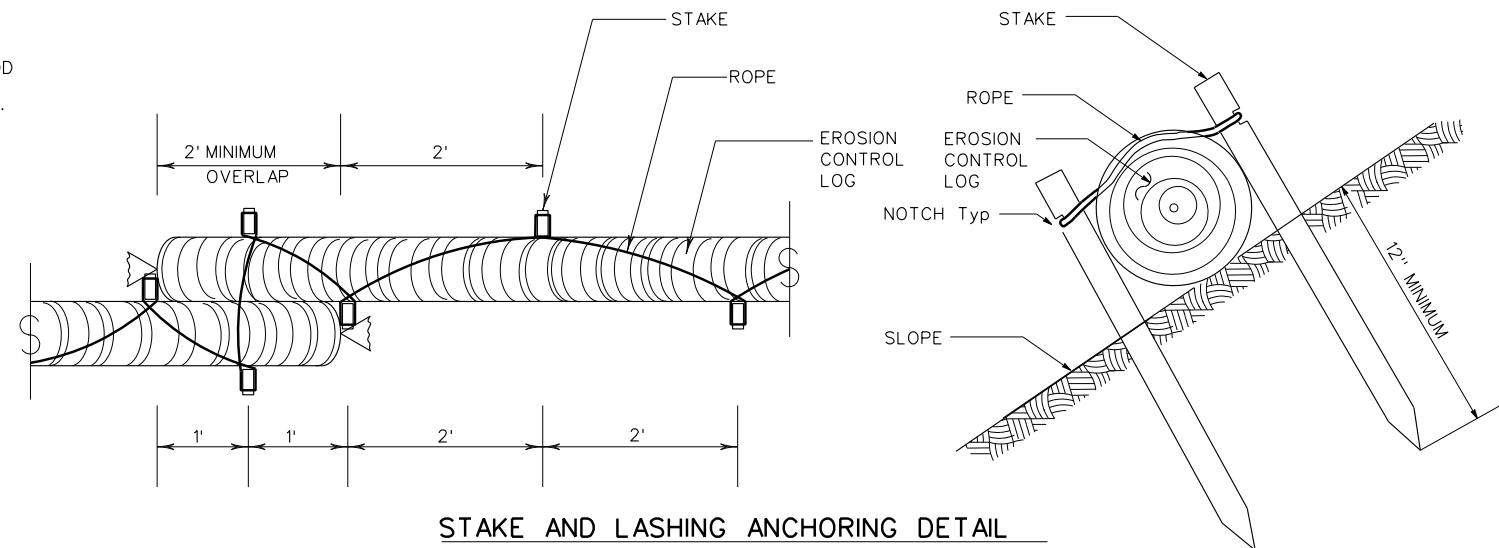


STAKE AND LASHING ANCHORING DETAIL

CL-SSL

SHEET 2 OF 3


				Design Division Standard	
TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES EROSION CONTROL LOG EC(9)-16					
FILE: ec116	DN: TxDOT	CK: KM	DW: LS/PT	CK: LS	
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY	
REVISIONS	0164	03	056	SH 31	
	DIST	COUNTY		SHEET NO.	
	TYL	HENDERSON		70	

LOG DIAMETER	DEPTH
6"	2"
8"	3"
12"	4"
18"	5"




STAKE NOTCH DETAIL

DISCLAIMER: The use of this standard is governed by the "Texas Engineering Practice Act". No warranty of any kind is made by TxDOT for any purpose whatsoever. TxDOT assumes no responsibility for the conversion of this standard to other formats or for incorrect results or damages resulting from its use.

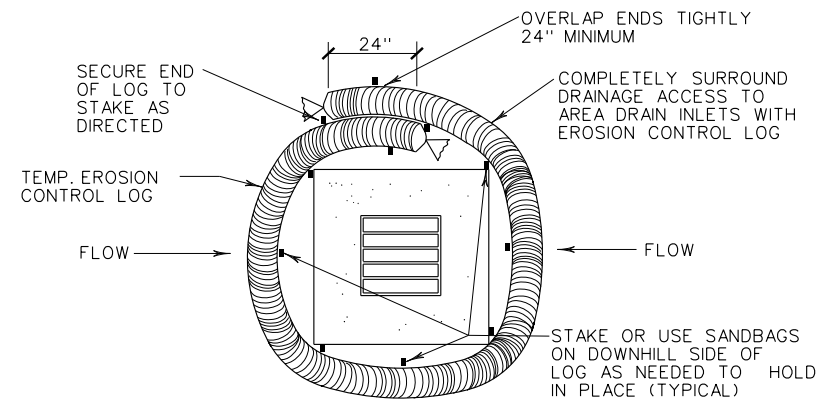


EROSION CONTROL LOG AT DROP INLET

CL-DI

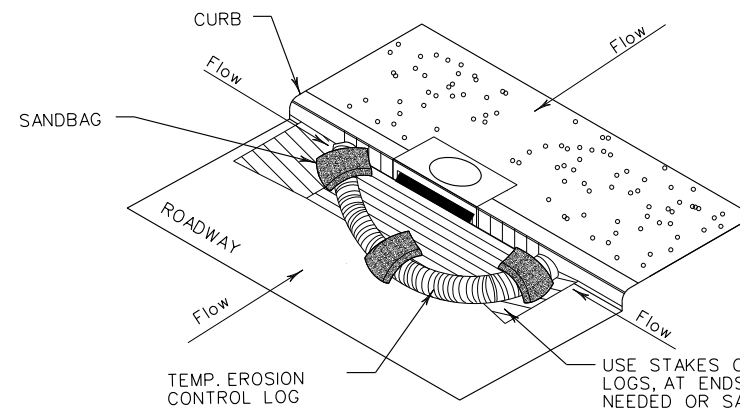

EROSION CONTROL LOG AT CURB INLET


CL-CI

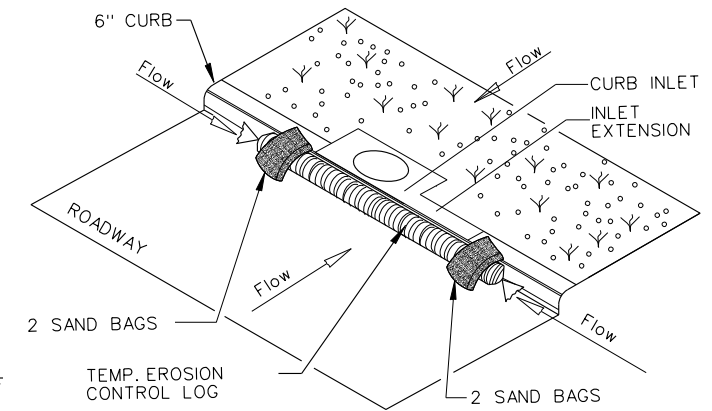

EROSION CONTROL LOG AT CURB INLET



CL-CI

NOTE:
EROSION CONTROL LOGS USED AT CURB INLETS SHOULD ONLY BE USED IF THEY WILL NOT IMPEDE TRAFFIC OR FLOOD THE ROADWAY OR WHEN THE STORM SEWER SYSTEM IS NOT FULLY FUNCTIONAL.

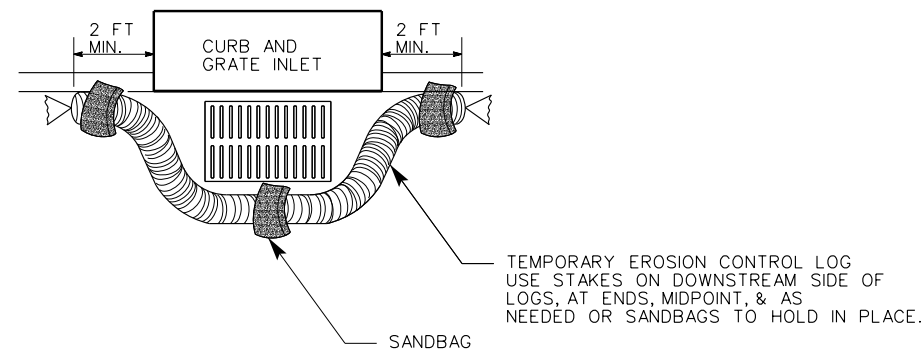

EROSION CONTROL LOG AT CURB & GRADE INLET

CL-GI

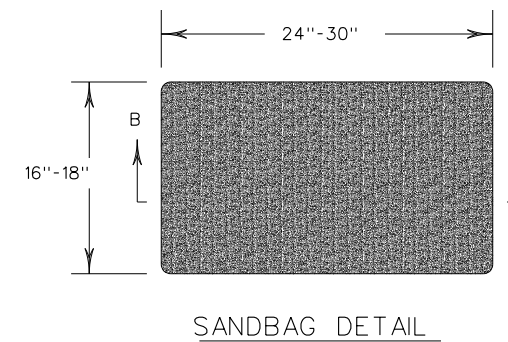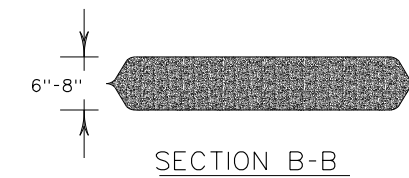

SHEET 3 OF 3

				Design Division Standard	
TEMPORARY EROSION, SEDIMENT AND WATER POLLUTION CONTROL MEASURES EROSION CONTROL LOG EC(9)-16					
FILE: ec916	DN: TxDOT	CK: KM	DW: LS/PT	CK: LS	
© TxDOT: JULY 2016	CONT	SECT	JOB	HIGHWAY	
REVISIONS	0164	03	056	SH 31	
	DIST	COUNTY		SHEET NO.	
	TYL	HENDERSON		71	

DATE:
FILE: